
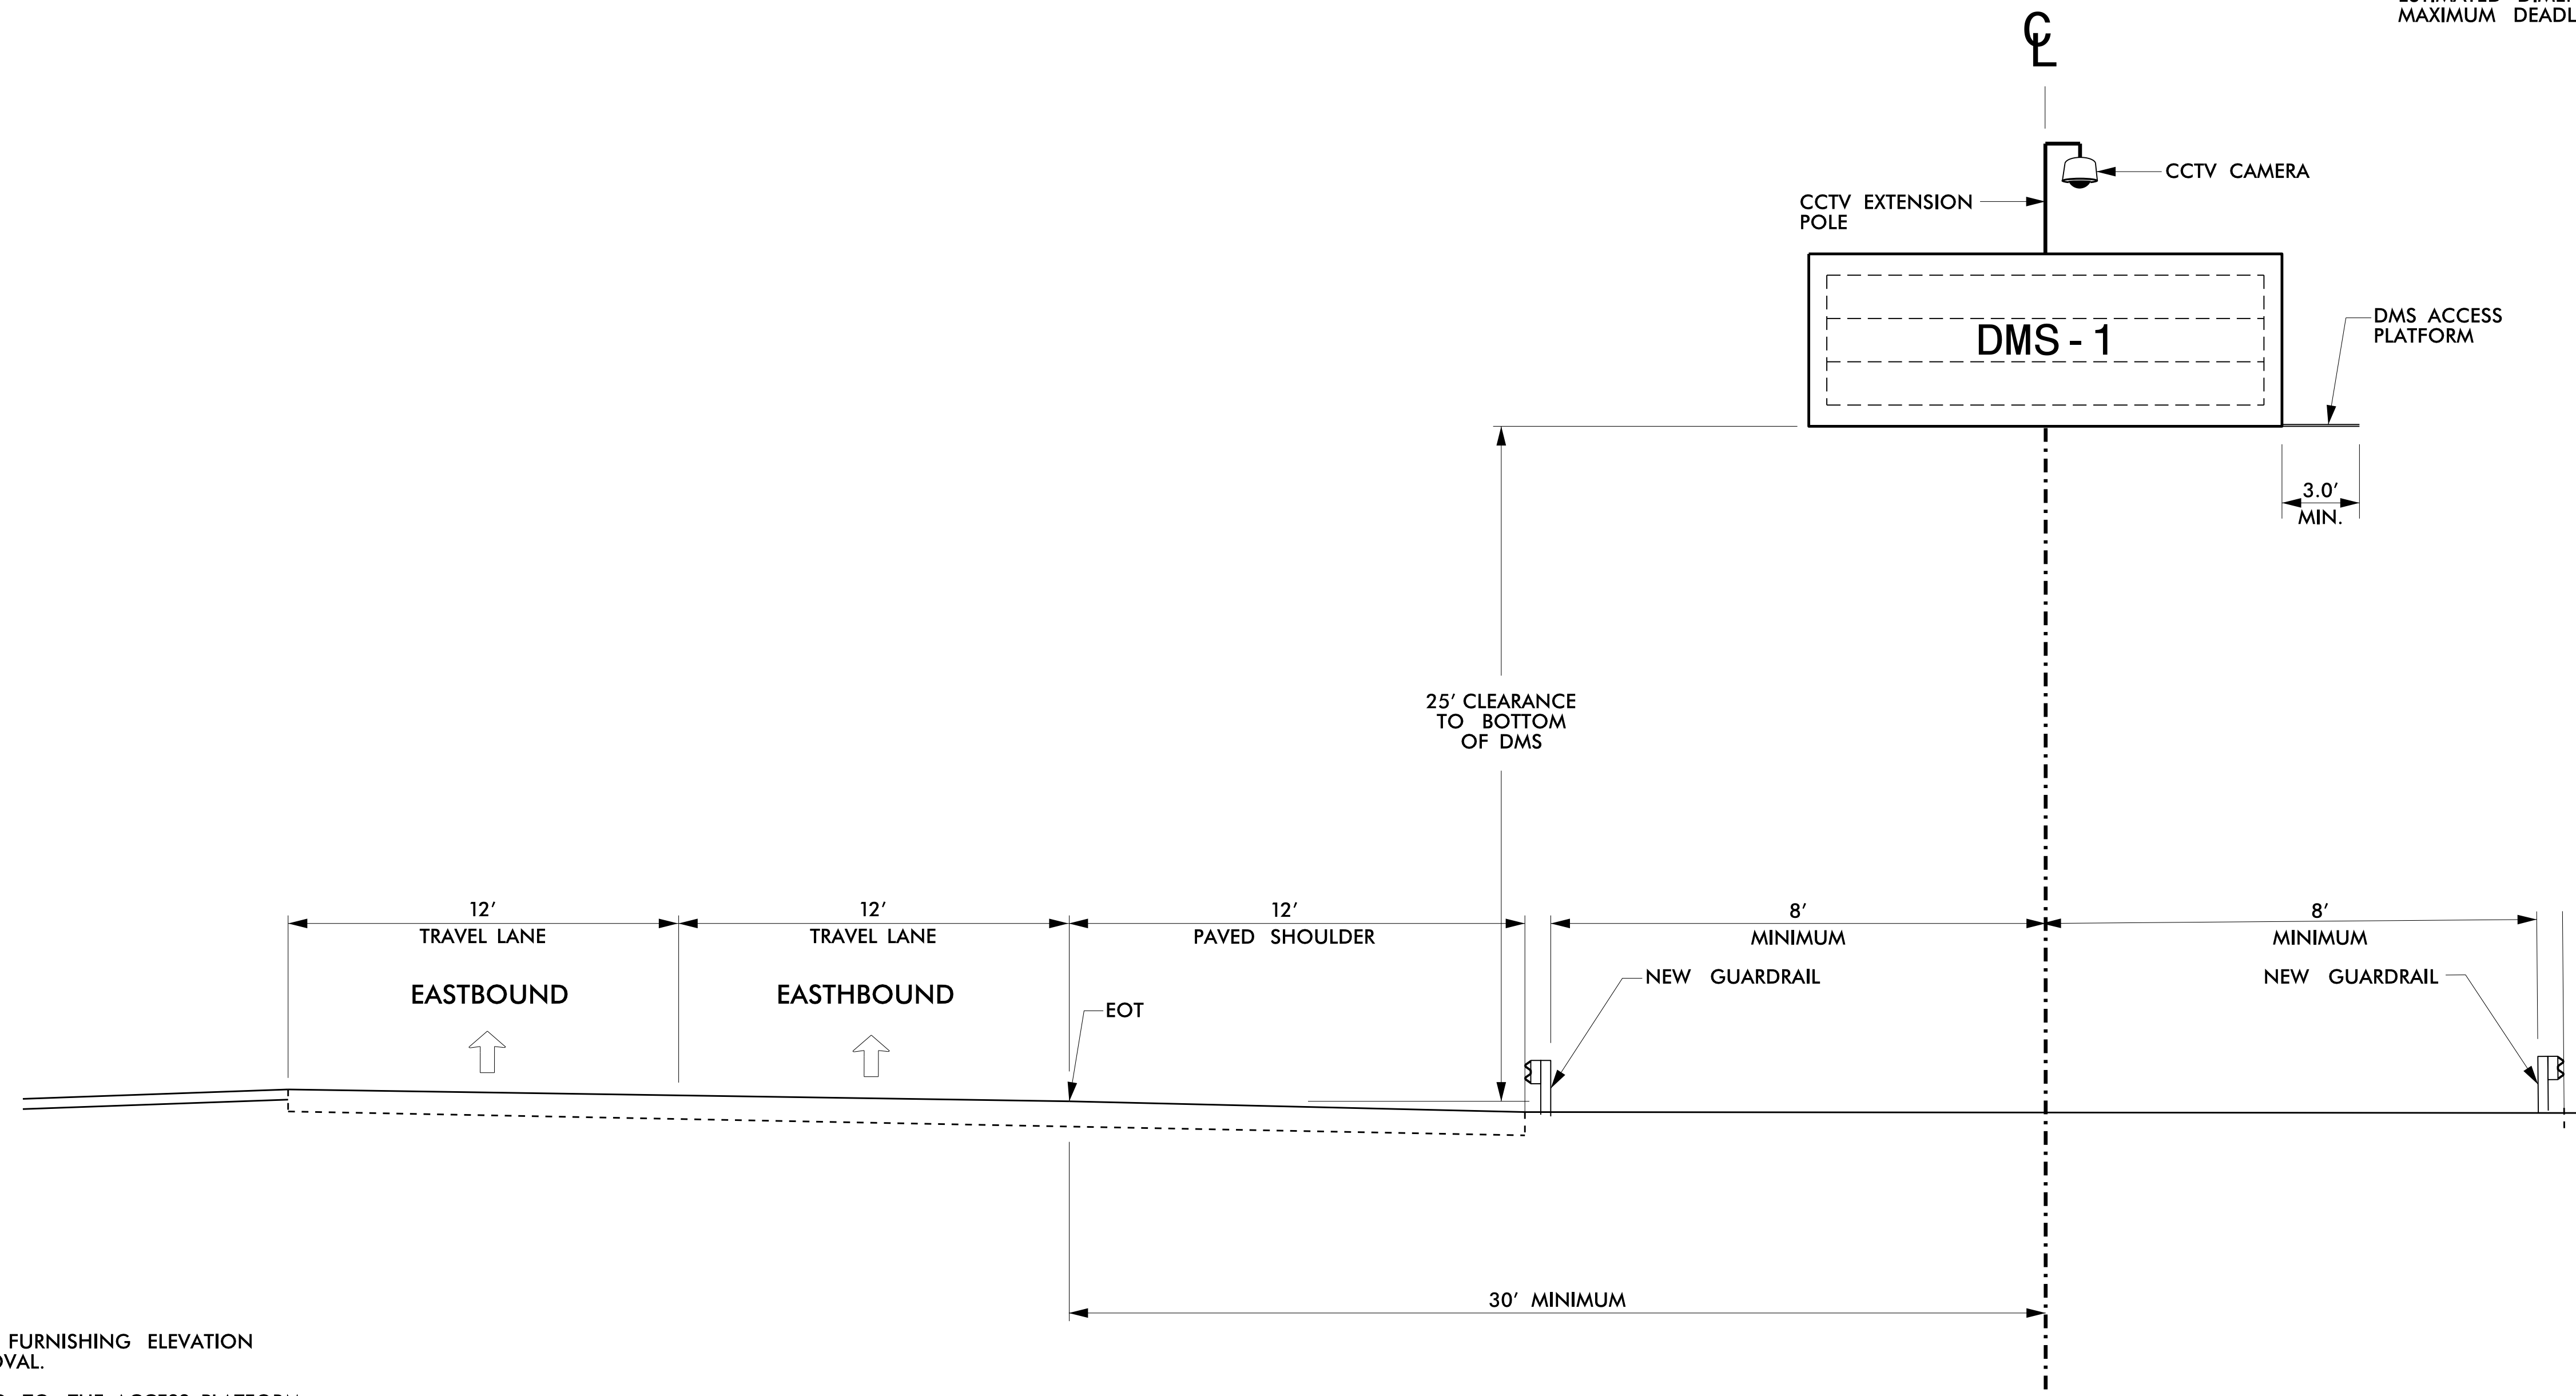
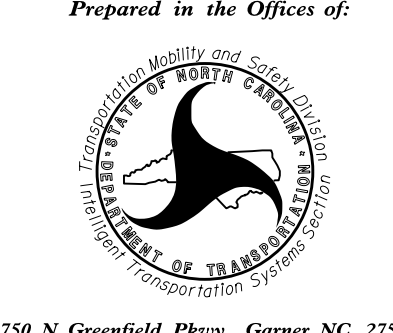


ESTIMATED DIMENSION : 27' X 10'
 MAXIMUM DEADLOAD : 5200 LBS

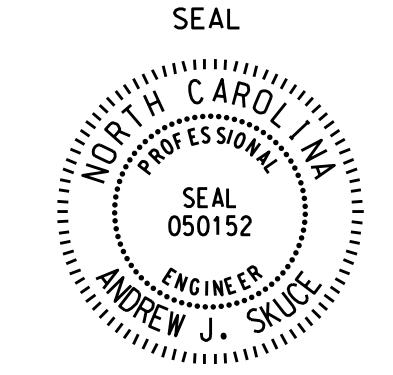

NOTES

- CONTRACTOR IS RESPONSIBLE FOR FURNISHING ELEVATION DRAWINGS FOR ENGINEER'S APPROVAL.
- PROVIDE A FIXED LADDER LEADING TO THE ACCESS PLATFORM.
- EQUIP THE LADDER WITH A SECURITY COVER (LADDER GUARD). START THE FIRST LADDER RUNG NO. MORE THAN 18 INCHES ABOVE A CONCRETE LANDING PAD. DESIGN RUNGS ON 12 INCH CENTER-TO-CENTER TYPICAL SPACING.
- INSTALL A CONCRETE LANDING PAD MEASURING A MINIMUM 4 INCHES DEEP, 24 INCHES WIDE, AND 36 INCHES LONG DIRECTLY BENEATH THE LADDER.
- USE ACTUAL DIMENSIONS AND WEIGHT OF THE DMS TO COMPLETE THE DESIGN OF THE DMS STRUCTURE.
- FIELD VERIFY ALL FOOTING ELEVATIONS AND GROUND SLOPES AT THE FOOTING USING THE LATEST NCDOT STANDARD SPECIFICATIONS FOR ROADS AND STRUCTURES.
- ENSURE THAT THE TOP OF THE FOOTING EXTENDS AT LEAST 6 INCHES AND NOT MORE THAN 24 INCHES ABOVE THE HIGHEST POINT OF THE GROUND SURFACE AT THE FOOTING.
- DESIGN AND CONSTRUCT THE PEDESTAL STRUCTURE AND DMS ENCLOSURE TO WITHSTAND WIND VELOCITIES OF 110 MPH.
- VERIFY ALL UNDERGROUND UTILITY LOCATIONS BEFORE BEGINNING ANY UNDERGROUND WORK. DO NOT DAMAGE ANY EXISTING UTILITIES OR NCDOT CABLES DURING CONSTRUCTION.
- DESIGN THE STRUCTURE TO ACCOMODATE THE INSTALLATION OF THE DMS WITH A CCTV CAMERA EXTENSION POLE AS DESCRIBED IN THE PROJECT SPECIAL PROVISIONS.
- SEE ROADWAY PLANS FOR GUARDRAIL DETAILS.

 Prepared in the Offices of: 750 N. Greenfield Pkwy., Garner, NC 27529	DMS ELEVATION		SEAL  ANDREW J. SKUCE
	DIVISION 04 JOHNSTON CO. WILLSON MILLS		
PLAN DATE: JUNE 2020	REVIEWED BY: A. J. SKUCE	PREPARED BY: L. E. NEAL	
REVISIONS	INIT.	DATE	DocuSigned by: Andrew J. Skuce 6/3/2020
SCALE 0 N/A	DATE		