



STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION

ROY COOPER
GOVERNOR

J. ERIC BOYETTE
SECRETARY

April 16, 2021

Addendum No. 4

RE: Contract # C204499

WBS # 36599.3.1

STATE FUNDED

Guilford County (R-4707)

INTERCHANGE OF US-29 AND SR-4771 (REEDY FORK PARKWAY)

April 20, 2021 Letting

To Whom It May Concern:

Reference is made to the plans furnished to you on this project.

The following revisions have been made to the Wall plans.

Sheet No.	Revision
W-3	Notes 8, 9, 10, and 11 were revised to match the pile driving sequence in the Bridge plans

Please void the above listed Sheet in your plans and staple the revised Sheet thereto.

The contract will be prepared accordingly.

Sincerely,

DocuSigned by:
Ronald E. Davenport, Jr.
F81B6038A47A442...

Ronald E. Davenport, Jr., PE
State Contract Officer

RED/jjr
Attachments

cc: Mr. Lamar Sylvester, PE
Mr. Wright R. Archer, III, PE
Mr. Boyd Tharrington, PE
Mr. Jon Weathersbee, PE
Mr. Ken Kennedy, PE
Project File (2)

Mr. Ray Arnold, PE
Ms. Jaci Kincaid
Ms. Lori Strickland
Mr. Mike Gwyn
Ms. Penny Higgins
Mr. Kyle Kempf

NOTES:

1. FOR MECHANICALLY STABILIZED EARTH (MSE) RETAINING WALLS, SEE MECHANICALLY STABILIZED EARTH RETAINING WALLS PROVISION.
2. FOR TYPE III REINFORCED BRIDGE APPROACH FILL, SEE BRIDGE APPROACH FILLS PROVISION AND ROADWAY DETAIL DRAWING NO. 422D10.
3. FOR SINGLE FACED PRECAST CONCRETE BARRIER, SEE ROADWAY PLANS AND SECTION 857 OF THE STANDARD SPECIFICATIONS.
4. AT THE CONTRACTOR'S OPTION, USE FINE AGGREGATE IN THE REINFORCED ZONE OF RETAINING WALLS AT END BENT NO.1 AND NO.2.
5. CIP REINFORCED CONCRETE COPING IS REQUIRED FOR RETAINING WALLS AT END BENTS NO.1 AND NO. 2.
6. A SEPARATION GEOTEXTILE IS REQUIRED AT THE BACK OF THE REINFORCED ZONE FOR RETAINING WALLS AT END BENTS NO.1 AND NO.2.
7. A DRAIN IS REQUIRED FOR RETAINING WALLS AT END BENTS NO.1 AND NO.2.
8. DRIVE PILES AT END BENT NO.1 AND END BENT NO.2 PRIOR TO BEGINNING MSE WALL CONSTRUCTION.
9. INSTALLATION OF 24-INCH DIAMETER CORRUGATED METAL CANS OR YELLOW JACKET™ PILE SLEEVES AROUND THE PILES AFTER THEY ARE DRIVEN FROM THE BOTTOM OF THE PILE CAP TO THE LEVELING PAD ELEVATION IS REQUIRED FOR PILES AT END BENT NO.1 AND END BENT NO. 2 .
10. THE CORRUGATED METAL CANS SHALL BE DESIGNED TO WITHSTAND THE PRESSURES FROM COMPACTION OPERATIONS ON ADJACENT FILL WITHOUT DISTORTION. AT A MINIMUM, CORRUGATED METAL CANS SHALL BE 16-GUAGE WITH A WALL THICKNESS OF 0.064 INCHES.
11. LOOSELY BACKFILL CORRUGATED METAL CANS USING THE SAME MATERIAL AS MSE REINFORCED ZONE PRIOR TO CONSTRUCTION OF THE END BENT PILE CAP. DO NOT COMPACT MATERIAL WITHIN THE CAN.
12. DESIGN RETAINING WALLS AT END BENTS NO.1 AND NO.2 FOR THE FOLLOWING:

- 1) H = DESIGN HEIGHT + EMBEDMENT
- 2) DESIGN LIFE = 100 YEARS
- 3) MAXIMUM FACTORED VERTICAL PRESSURE ON FOUNDATION MATERIAL = 5,500 LB/SF
- 4) MINIMUM REINFORCEMENT LENGTH (L) = 1.3 H OR 6 FT, WHICHEVER IS LONGER
- 5) MINIMUM EMBEDMENT DEPTH = 2 FT
- 6) REINFORCED ZONE AGGREGATE PARAMETERS:


AGGREGATE TYPE*	UNIT WEIGHT (γ) LB/CF	FRICTION ANGLE (ϕ) DEGREES	COHESION (c) LB/SF
COARSE	110	38	0
FINE	115	34	0


* SEE MSE RETAINING WALLS PROVISION FOR COARSE AND FINE AGGREGATE MATERIAL REQUIREMENTS.

- 7) IN-SITU ASSUMED MATERIAL PARAMETERS:

MATERIAL TYPE	UNIT WEIGHT (γ) LB/CF	FRICTION ANGLE (ϕ) DEGREES	COHESION (c) LB/SF
BACKFILL	120	30	0
FOUNDATION	120	30	100


13. DESIGN RETAINING WALLS AT END BENTS NO.1 AND NO.2 FOR A LIVE LOAD (TRAFFIC) SURCHARGE.
14. DESIGN REINFORCEMENT CONNECTED TO END BENT CAPS FOR FACTORED LOAD AND LENGTH OF REINFORCEMENT IN ACTIVE ZONE (L_a) SHOWN. CAST REINFORCEMENT OR CONNECTORS INTO CAP BACKWALL FOR END BENT NO.1 AND END BENT NO.2 LOCATED AT STATIONS 40+67.01 -Y- AND 42+12.01 -Y- RESPECTIVELY. MAINTAIN A CLEARANCE OF AT LEAST 3" BETWEEN REINFORCEMENT OR CONNECTORS AND REINFORCING STEEL IN CAP.
15. BEFORE BEGINNING MSE WALL DESIGN FOR RETAINING WALLS AT END BENTS NO.1 AND NO.2, SURVEY WALL LOCATION AND SUBMIT A REVISED WALL PROFILE VIEW (WALL ENVELOPE) FOR REVIEW. DO NOT START WALL DESIGN OR CONSTRUCTION UNTIL THE REVISED WALL ENVELOPE IS ACCEPTED.
16. DO NOT PLACE LEVELING PAD CONCRETE, AGGREGATE OR REINFORCEMENT FOR RETAINING WALLS AT END BENTS NO.1 AND NO.2 UNTIL EXCAVATION DIMENSIONS AND FOUNDATION MATERIAL ARE APPROVED.
17. FOUNDATIONS FOR SIGNS OR LIGHTING MAY BE LOCATED BEHIND RETAINING WALLS AT END BENTS NO.1 AND NO.2 AND MAY INTERFERE WITH REINFORCEMENT. BEFORE BEGINNING MSE WALL CONSTRUCTION, SUBMIT PROPOSED CONSTRUCTION METHODS FOR THESE FOUNDATIONS FOR APPROVAL.
18. EXISTING OR FUTURE OBSTRUCTIONS SUCH AS FOUNDATIONS, GUARDRAIL, FENCE OR HANDRAIL POSTS, PAVEMENTS, PIPES, INLETS OR UTILITIES MAY INTERFERE WITH REINFORCEMENT FOR RETAINING WALLS AT END BENTS NO.1 AND NO. 2.
19. UNDERCUT SOFT CLAY AT END BENT NO.1 AND END BENT NO.2, IF ENCOUNTERED, TO SUITABLE MATERIAL. BACKFILL UNDERCUT MATERIAL WITH SUITABLE BORROW MATERIAL OR THE SAME MATERIAL AS THE MSE BACKFILL.
20. FINAL GRADING AT BACK OF THE MSE RETAINING WALLS AT END BENT NO.1 AND END BENT NO.2 SHOULD NOT BE STEEPER THAN 2:1 (H:V) AT ANY POINT.

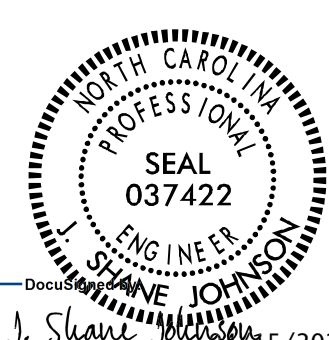PROJECT REFERENCE NO. R-4707	SHEET NO. W-3
GEOTECHNICAL ENGINEER  J. Shane Johnson 773ECAA5F84423	
DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED	

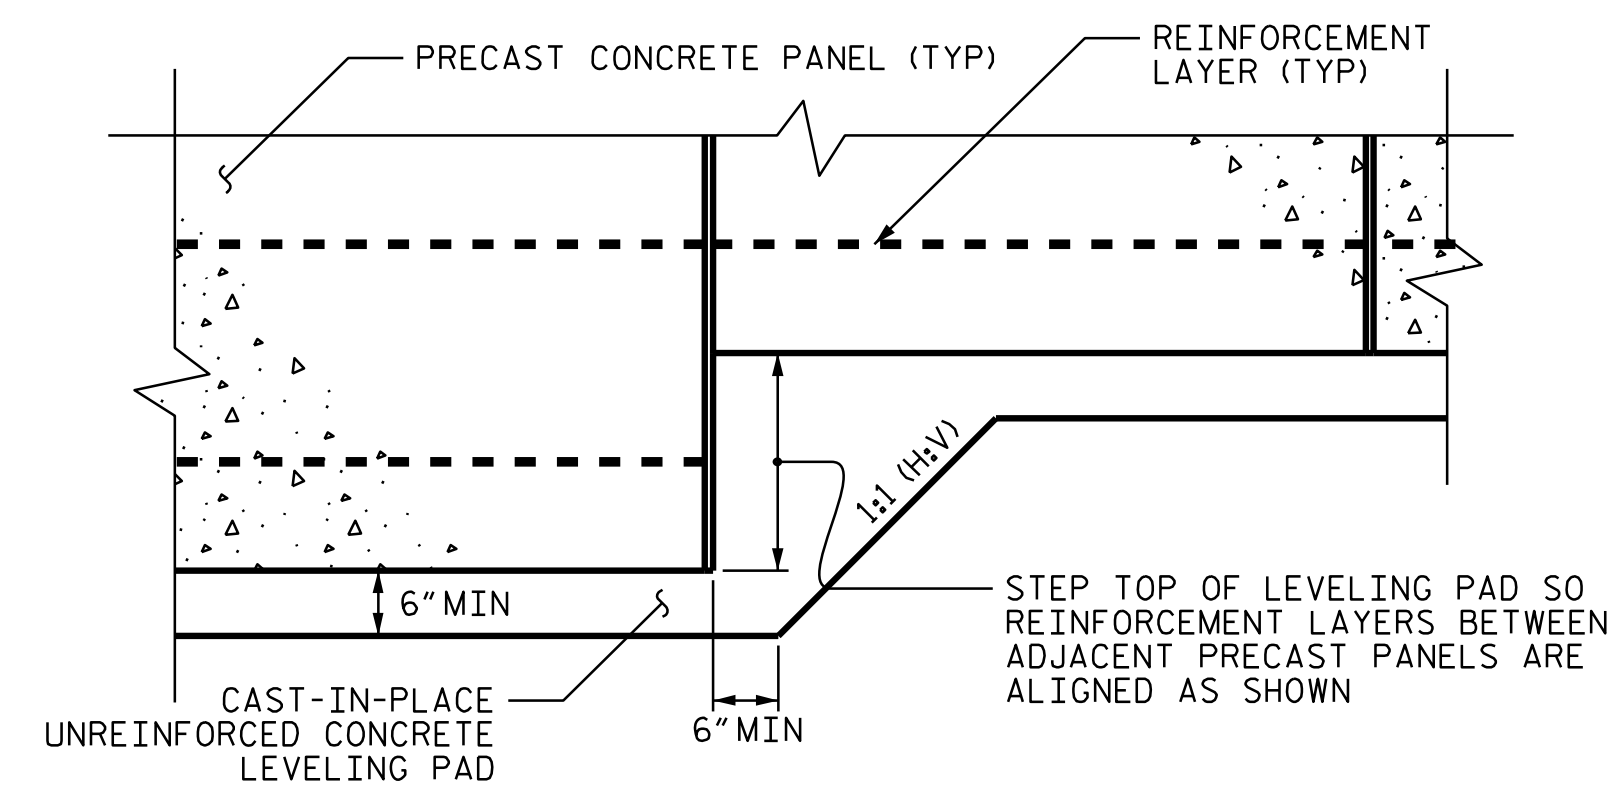

**PRECAST PANELS
LEVELING PAD STEP DETAIL**

I:\APP-2021\64311\15-APP-2021\Projects\Road\NC-D01\2018\NR-4707 - Reedy Fork Parkway - 6468-18-8042\MSE Abutment Wall\15-APP-2021\15-APP-2021.dgn

 Wood Environment & Infrastructure Solutions, Inc. 4021 STIRRUP CREEK DRIVE, SUITE 100, DURHAM, NC, 27703 TEL: (919) 381-9900 FAX: (919) 351-9901 LICENSURE: NC ENG: F-1253 NC GEOLOGY: C-247		MSE RETAINING WALLS NO. 1 AND NO. 2 NOTES			
REVISIONS					
NO	BY	DATE	BY	DATE	
1			1		
2			2		
3			3		