

NOTES:


1. SEE SHEET UC-3A FOR CONNECTION TO EXISTING AC WATER LINE DETAIL.
2. PROPOSED WATER METER BOX FOR FUTURE METER BY CITY OF WHITEVILLE.
3. FOLLOWING CONSTRUCTION OF THE PROPOSED WATER LINE, ABANDON VALVE IN PLACE.
4. EXISTING PIPE TO BE ABANDONED SHALL BE REMOVED AS NECESSARY BY CONTRACTOR FOR THE PROPOSED PIPE INSTALLATION.

WATER LINE



UTILITY CONSTRUCTION

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

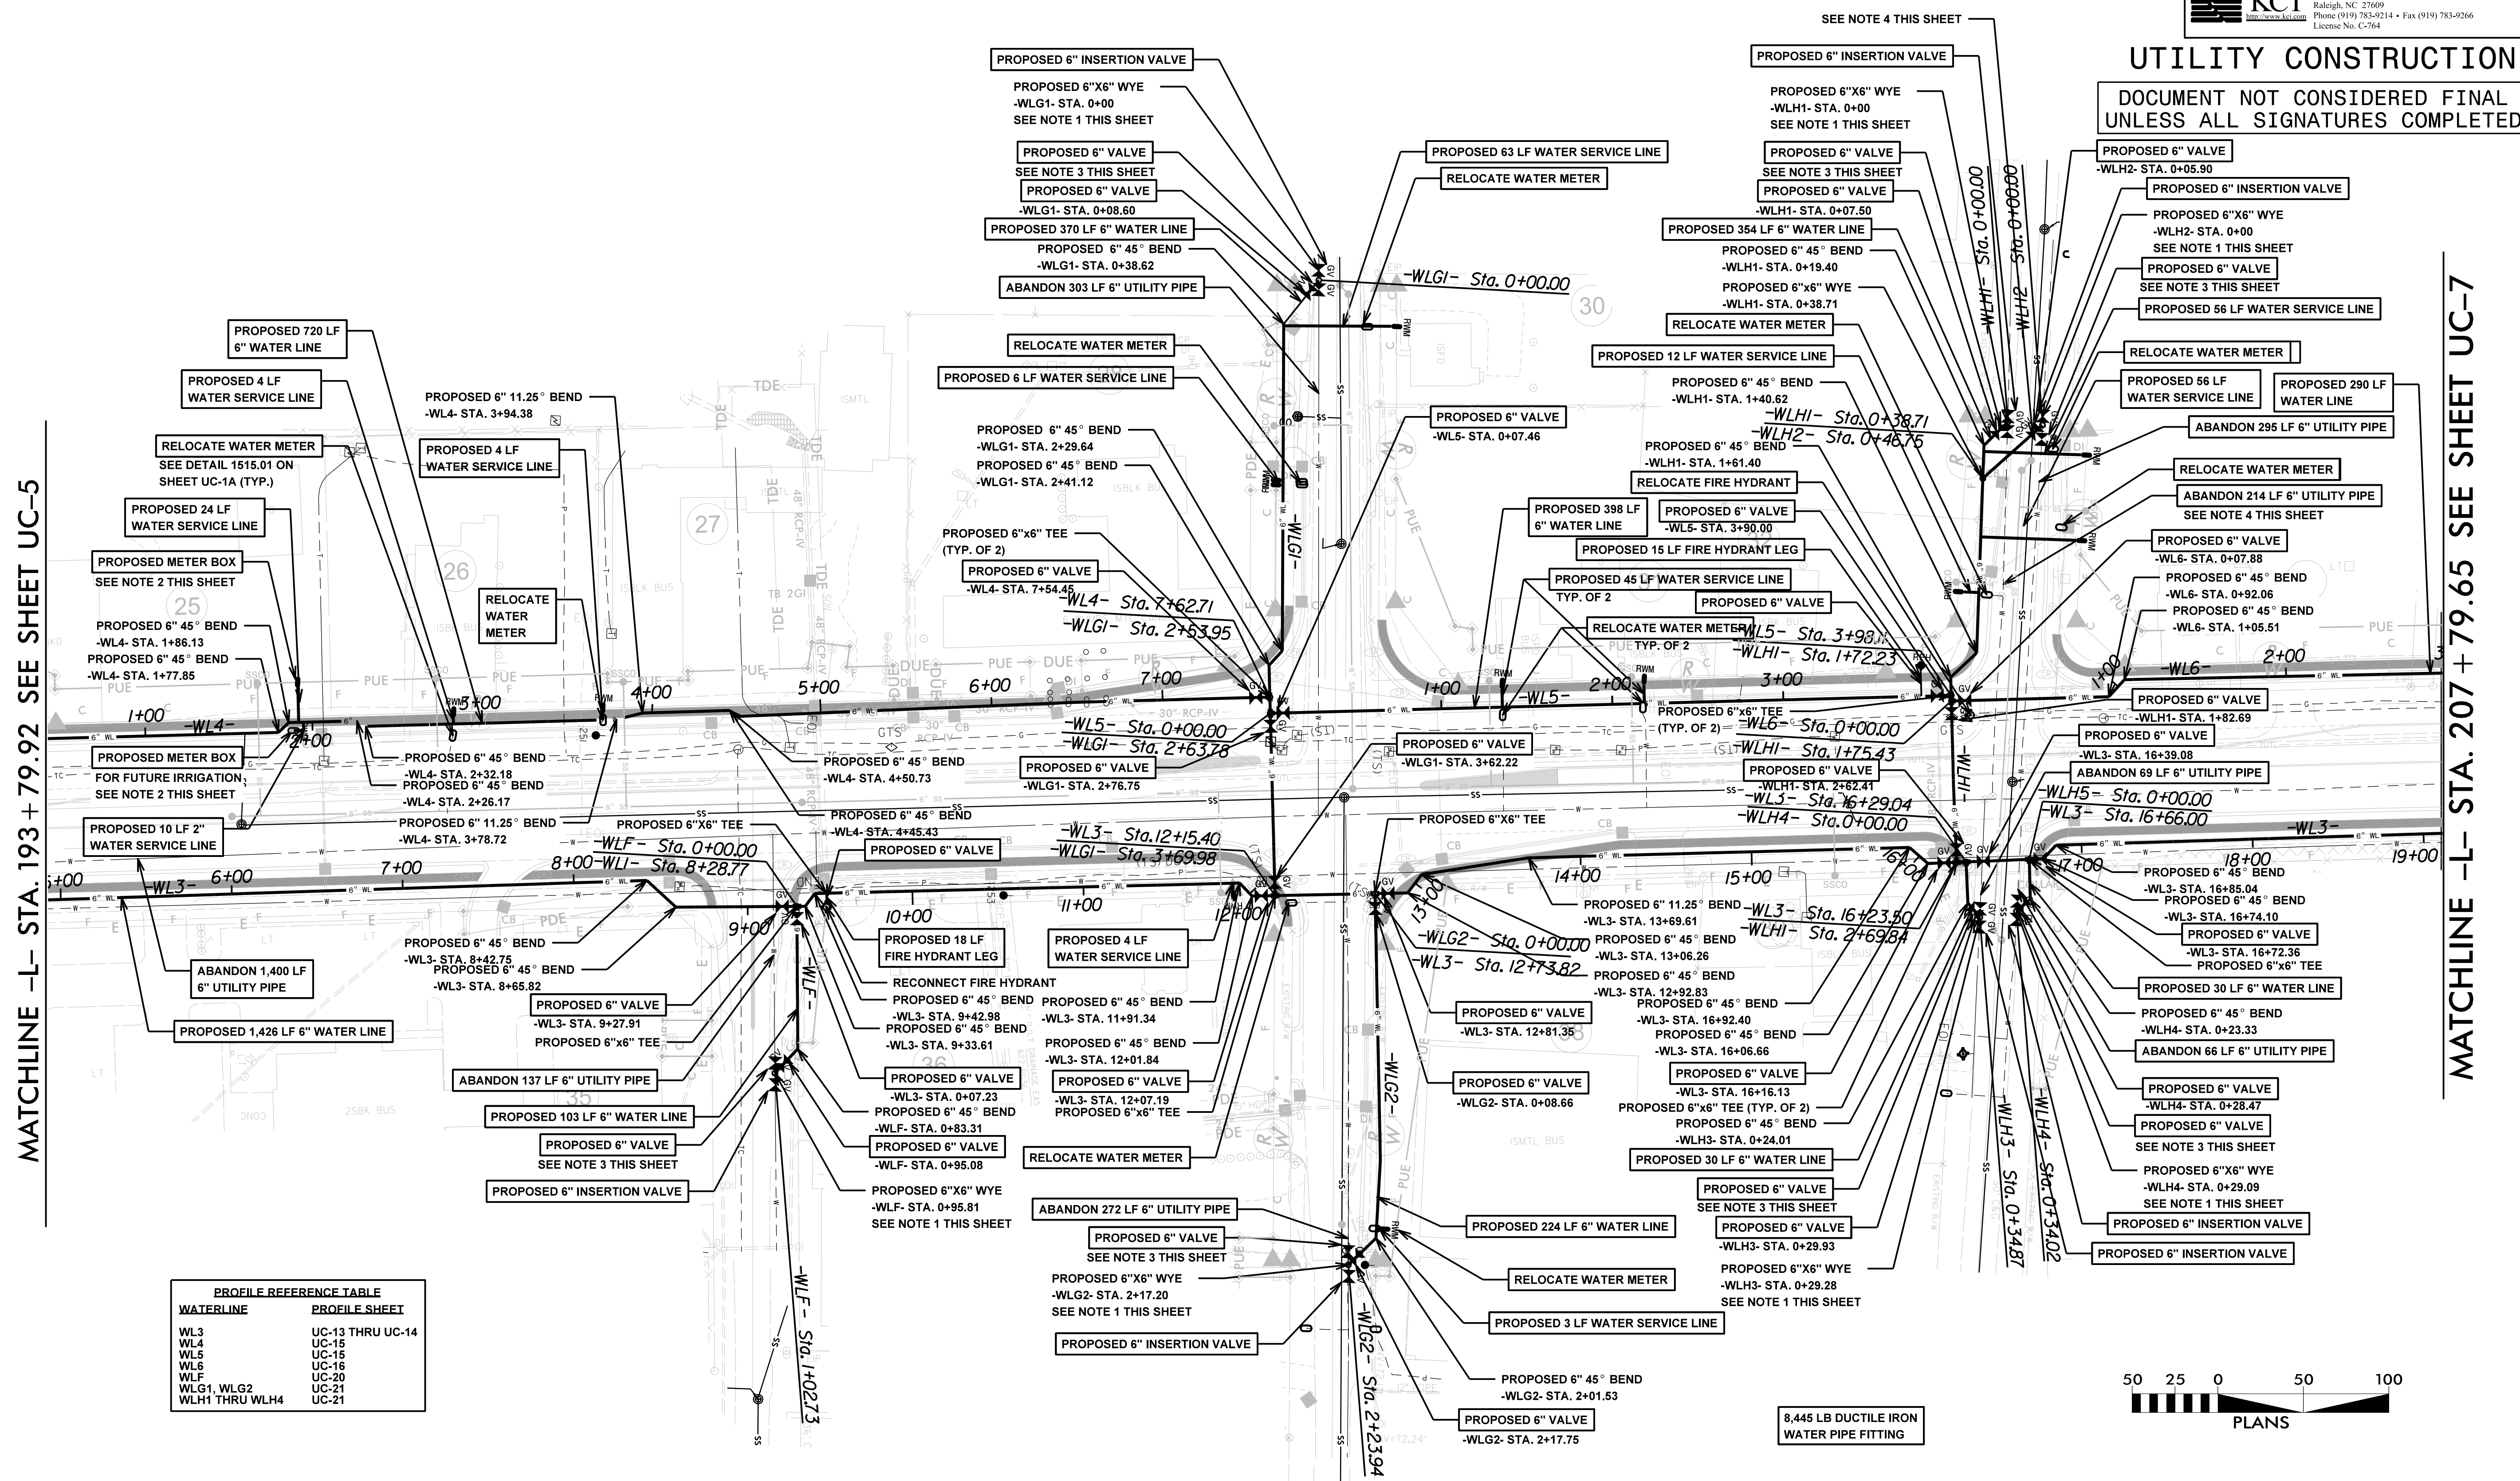

MATCHLINE -L- STA. 193 + 79.92 SEE SHEET UC-5

MATCHLINE -L- STA. 207 + 79.65 SEE SHEET UC-7

PROFILE REFERENCE TABLE	
WATERLINE	PROFILE SHEET
WL3	UC-13 THRU UC-14
WL4	UC-15
WL5	UC-15
WL6	UC-16
WL7	UC-20
WL8	UC-21
WL9	UC-21
WL10	UC-21
WL11	UC-21
WL12	UC-21
WL13	UC-21
WL14	UC-21
WL15	UC-21
WL16	UC-21
WL17	UC-21
WL18	UC-21
WL19	UC-21
WL20	UC-21
WL21	UC-21
WL22	UC-21
WL23	UC-21
WL24	UC-21
WL25	UC-21
WL26	UC-21
WL27	UC-21
WL28	UC-21
WL29	UC-21
WL30	UC-21
WL31	UC-21
WL32	UC-21
WL33	UC-21
WL34	UC-21
WL35	UC-21
WL36	UC-21
WL37	UC-21
WL38	UC-21
WL39	UC-21
WL40	UC-21
WL41	UC-21
WL42	UC-21
WL43	UC-21
WL44	UC-21
WL45	UC-21
WL46	UC-21
WL47	UC-21
WL48	UC-21
WL49	UC-21
WL50	UC-21
WL51	UC-21
WL52	UC-21
WL53	UC-21
WL54	UC-21
WL55	UC-21
WL56	UC-21
WL57	UC-21
WL58	UC-21
WL59	UC-21
WL60	UC-21
WL61	UC-21
WL62	UC-21
WL63	UC-21
WL64	UC-21
WL65	UC-21
WL66	UC-21
WL67	UC-21
WL68	UC-21
WL69	UC-21
WL70	UC-21
WL71	UC-21
WL72	UC-21
WL73	UC-21
WL74	UC-21
WL75	UC-21
WL76	UC-21
WL77	UC-21
WL78	UC-21
WL79	UC-21
WL80	UC-21
WL81	UC-21
WL82	UC-21
WL83	UC-21
WL84	UC-21
WL85	UC-21
WL86	UC-21
WL87	UC-21
WL88	UC-21
WL89	UC-21
WL90	UC-21
WL91	UC-21
WL92	UC-21
WL93	UC-21
WL94	UC-21
WL95	UC-21
WL96	UC-21
WL97	UC-21
WL98	UC-21
WL99	UC-21
WL100	UC-21



8,445 LB DUCTILE IRON WATER PIPE FITTING