


STATE OF NORTH CAROLINA


DIVISION OF HIGHWAYS

BRUNSWICK COUNTY

LOCATION: NC 211 FROM WEST OF NC 906 (MIDWAY ROAD) TO EAST OF NC 87

TYPE OF WORK: GRADING, DRAINAGE, PAVING, STRUCTURES, CULVERTS, WALLS & SIGNALS

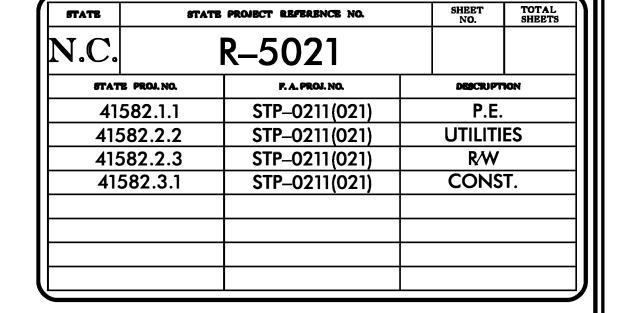

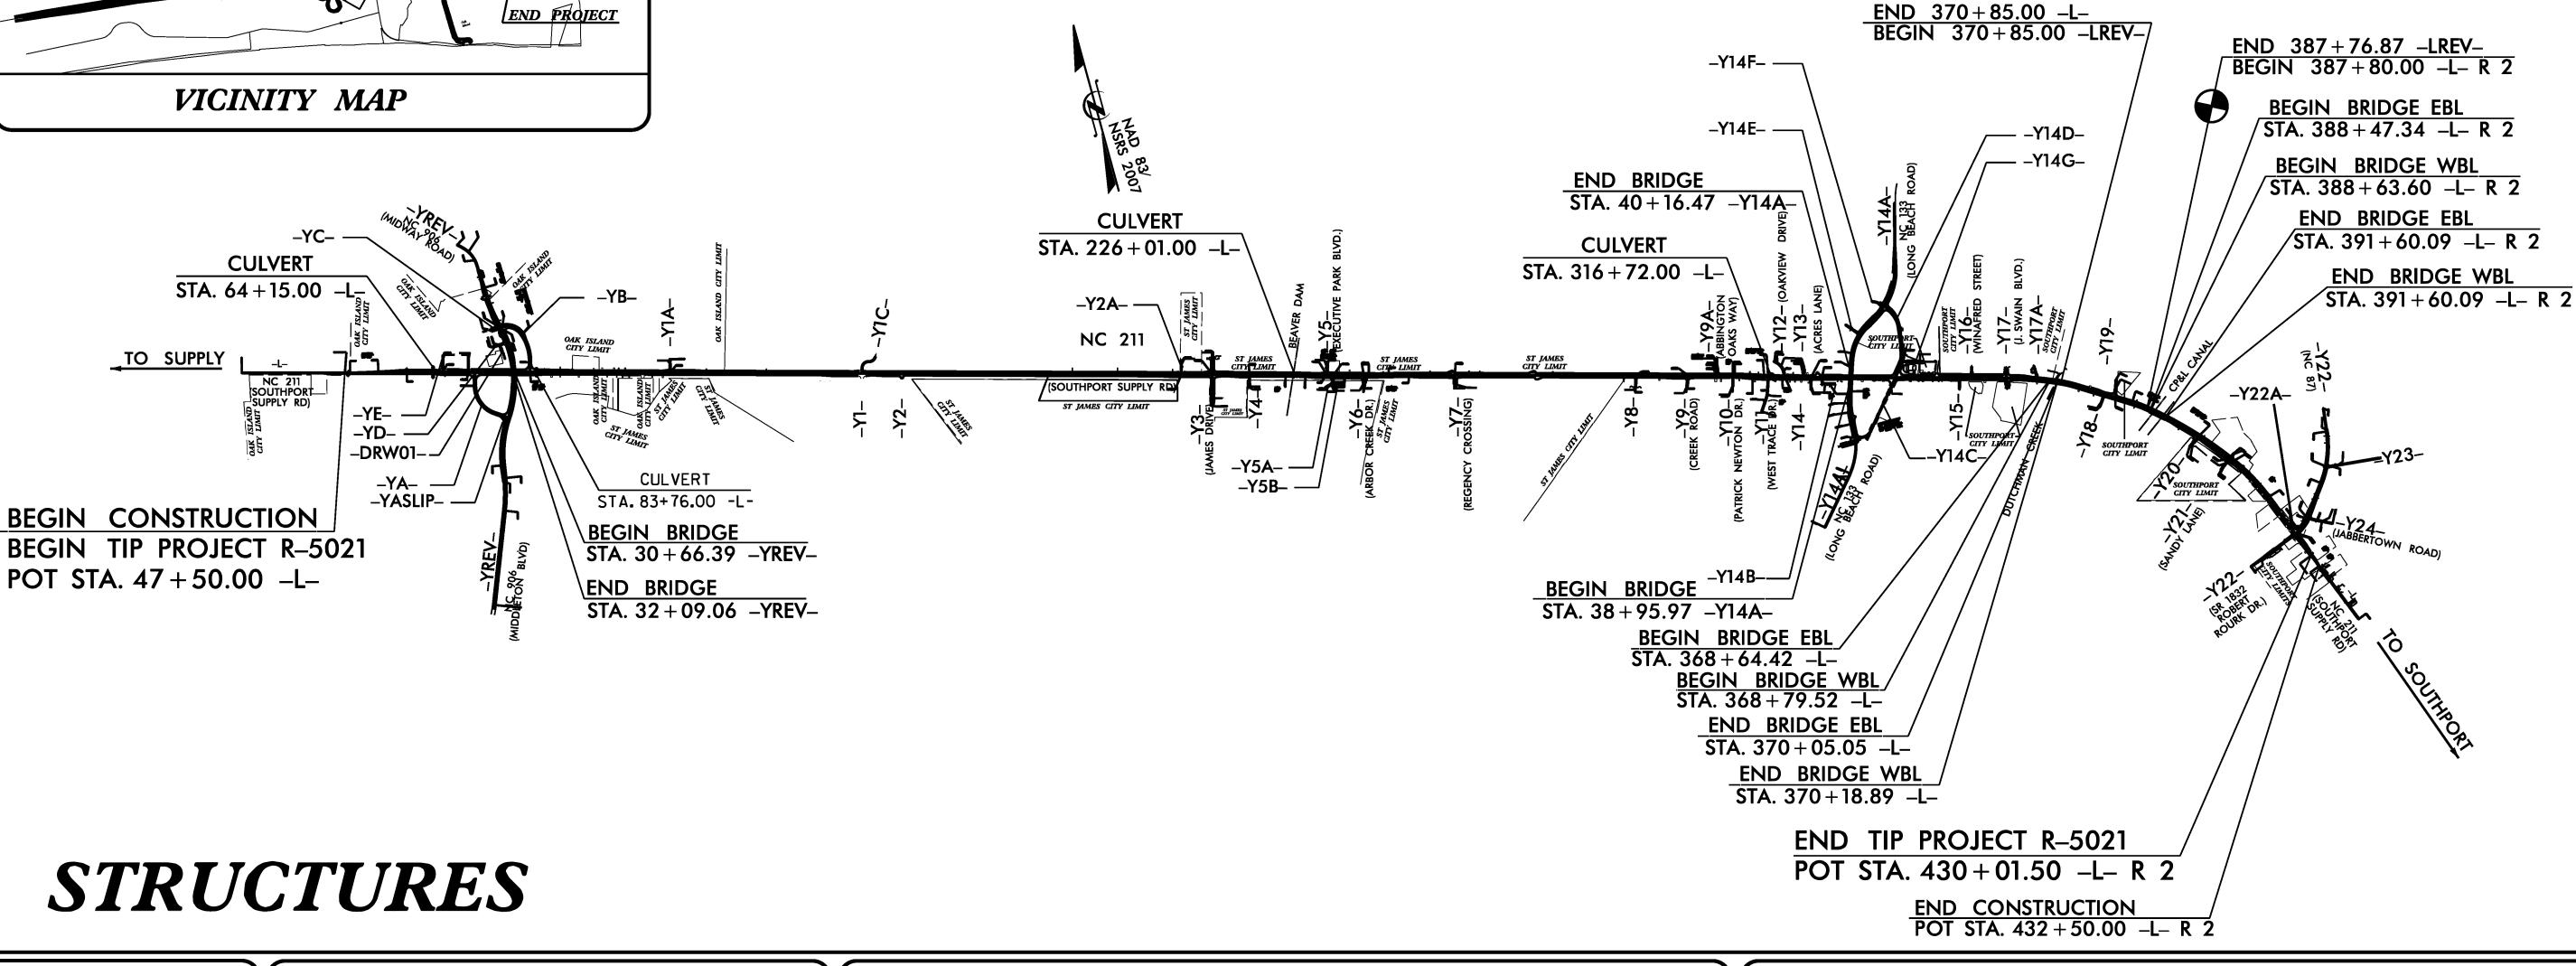

DESIGN DATA

ADT 2019 = 28,000ADT 2039 = 44,000K = 8D = 55T = 6 % *V = 40-60 MPH

COLLECTOR

REGIONAL TIER

* (TTST 2% + DUAL 4%) FUNC CLASS = RURAL MAJOR

ALL LENGTH BASED ON -L- CENTERLINE STRUCTURES LENGTH BASED ON EBL

PROJECT LENGTH

LENGTH ROADWAY TIP PROJECT R-5021 = 7.158 MILES MILES LENGTH STRUCTURE TIP PROJECT R-5021 = 0.086 MILES

TOTAL LENGTH TIP PROJECT R-5021 = 7.244 MILES MILES


Prepared in the Office of: **DIVISION OF HIGHWAYS** STRUCTURES MANAGEMENT UNIT

1000 BIRCH RIDGE DR. RALEIGH, N.C. 27610


LETTING DATE:

2018 STANDARD SPECIFICATIONS


December 7, 2021

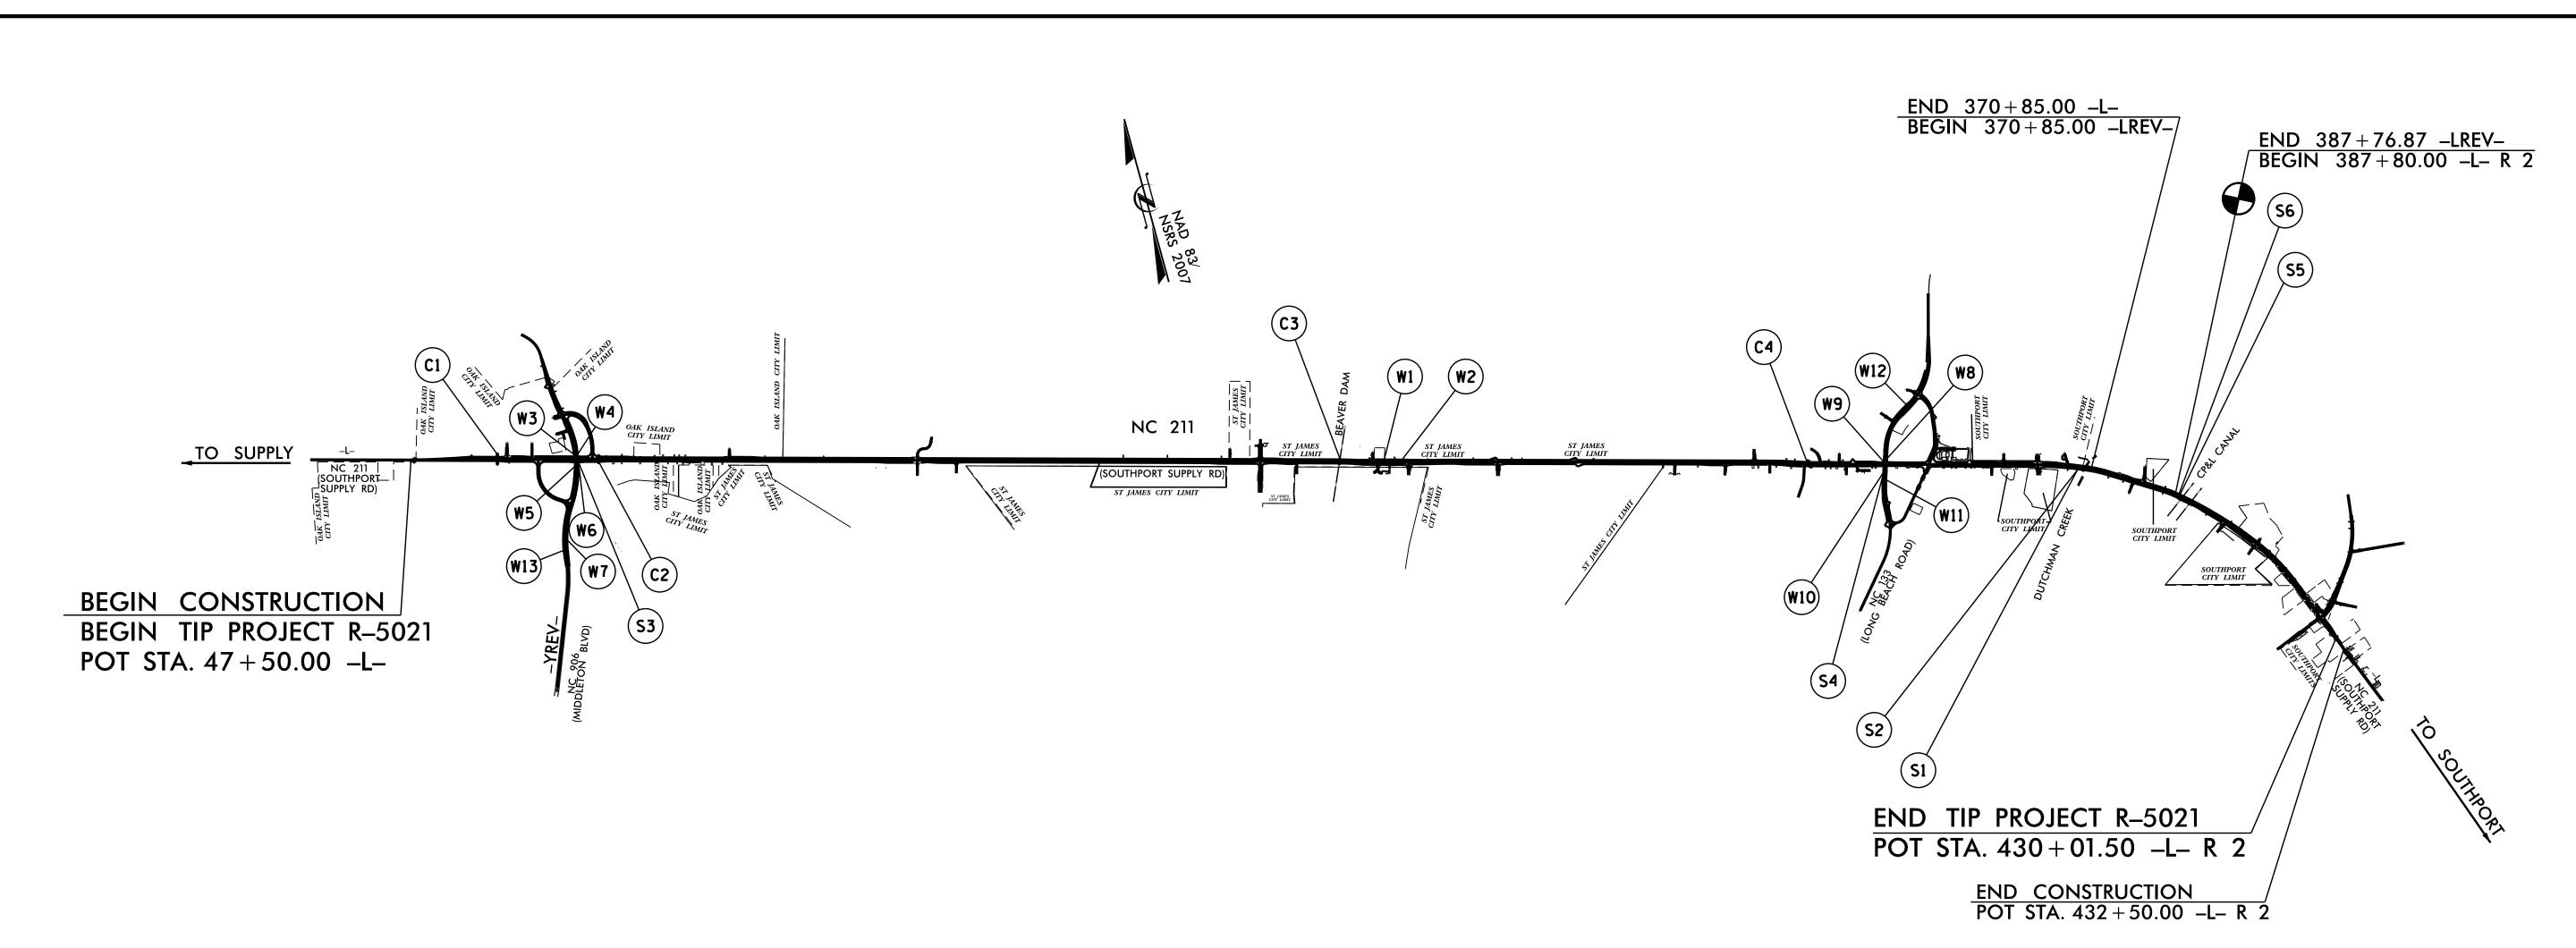

	INDEX											
STR. NO.	STATION	DESCRIPTION	SHEETS	STR. NO.	STATION	DESCRIPTION	SHEETS					
S1)	STA.369+42.00 -L-	BRIDGE ON NC 211 OVER DUTCHMAN CREEK (WBL)	S1-1 THRU S1-38	W3)	31+30.81 -YREV-	MSE RETAINING WALL 3						
(S2)	STA.369+42.00 -L-	BRIDGE ON NC 211 OVER DUTCHMAN CREEK (EBL)	S2-1 THRU S2-38	W4)	31+30.81 -YREV-	MSE RETAINING WALL 4	W3 THRU W7					
S 3	POC STA. 31+30.81 -YREV- POT STA. 79+32.24 -L-	BRIDGE OVER NC 211 ON SR 1500 BETWEEN US 17 AND OAK ISLAND DRIVE	S3-1 THRU S3-25	W5)	31+30.81 -YREV-	MSE RETAINING WALL 5	WS THRU WI					
<u>S4</u>	STA. 39+52.37 -Y14A- STA. 331+20.00 -L-	BRIDGE OVER NC 211 ON NC 133 BETWEEN SR 1857 AND NC 87	S4-1 THRU S4-24	<u>W6</u>)	31+30.81 -YREV-	MSE RETAINING WALL 6						
<u>S5</u>	STA. 390+15.00 -L-	BRIDGE OVER CP & L CANAL ON NC 211 BETWEEN NC 133 AND NC 87 (LEFT LANE)	S5-1 THRU S5-39	W7)	38+00.00 -YREV-	MSE RETAINING WALL 7	W8 THRU W11					
<u>\$6</u>	STA. 390+15.00 -L-	BRIDGE OVER CP & L CANAL ON NC 211 BETWEEN NC 133 AND NC 87 (RIGHT LANE)	S6-1 THRU S6-39	(W8)	39+52 . 37 -Y14A-	MSE RETAINING WALL 8						
C1)	STA.64+15.00 -L-	SINGLE 10'X5' RCBC 90° SKEW	C1-1 THRU C1-4	(ew)	39+52.37 -Y14A-	MSE RETAINING WALL 9	W12 THRU W17					
(C2)	STA.83+76.00 -L-	DOUBLE 8'X6' RCBC 90° SKEW	C2-1 THRU C2-5	W10)	39+52.37 -Y14A-	MSE RETAINING WALL 10	WIZ TING WIT					
C3	STA. 226+01.00 -L-	DOUBLE 9'X8' RCBC 105° SKEW	C3-1 THRU C3-5	W11)	39+52.37 -Y14A-	MSE RETAINING WALL 11						
(C4)	STA. 316+72.00 -L-	DOUBLE 7'X7' RCBC 60° SKEW	C4-1 THRU C4-5	W12)	48+50.00 -Y14A-	MSE RETAINING WALL 12	W18 THRU W22					
W1)	232+85 . 00 -L-	MSE RETAINING WALL 1	W1 THRU W2	W13)	47+00.00 -YREV-	MSE RETAINING WALL 13	WIO THILD WZZ					
W2)	232+85 . 00 -L-	MSE RETAINING WALL 2	MI LIUO MS									

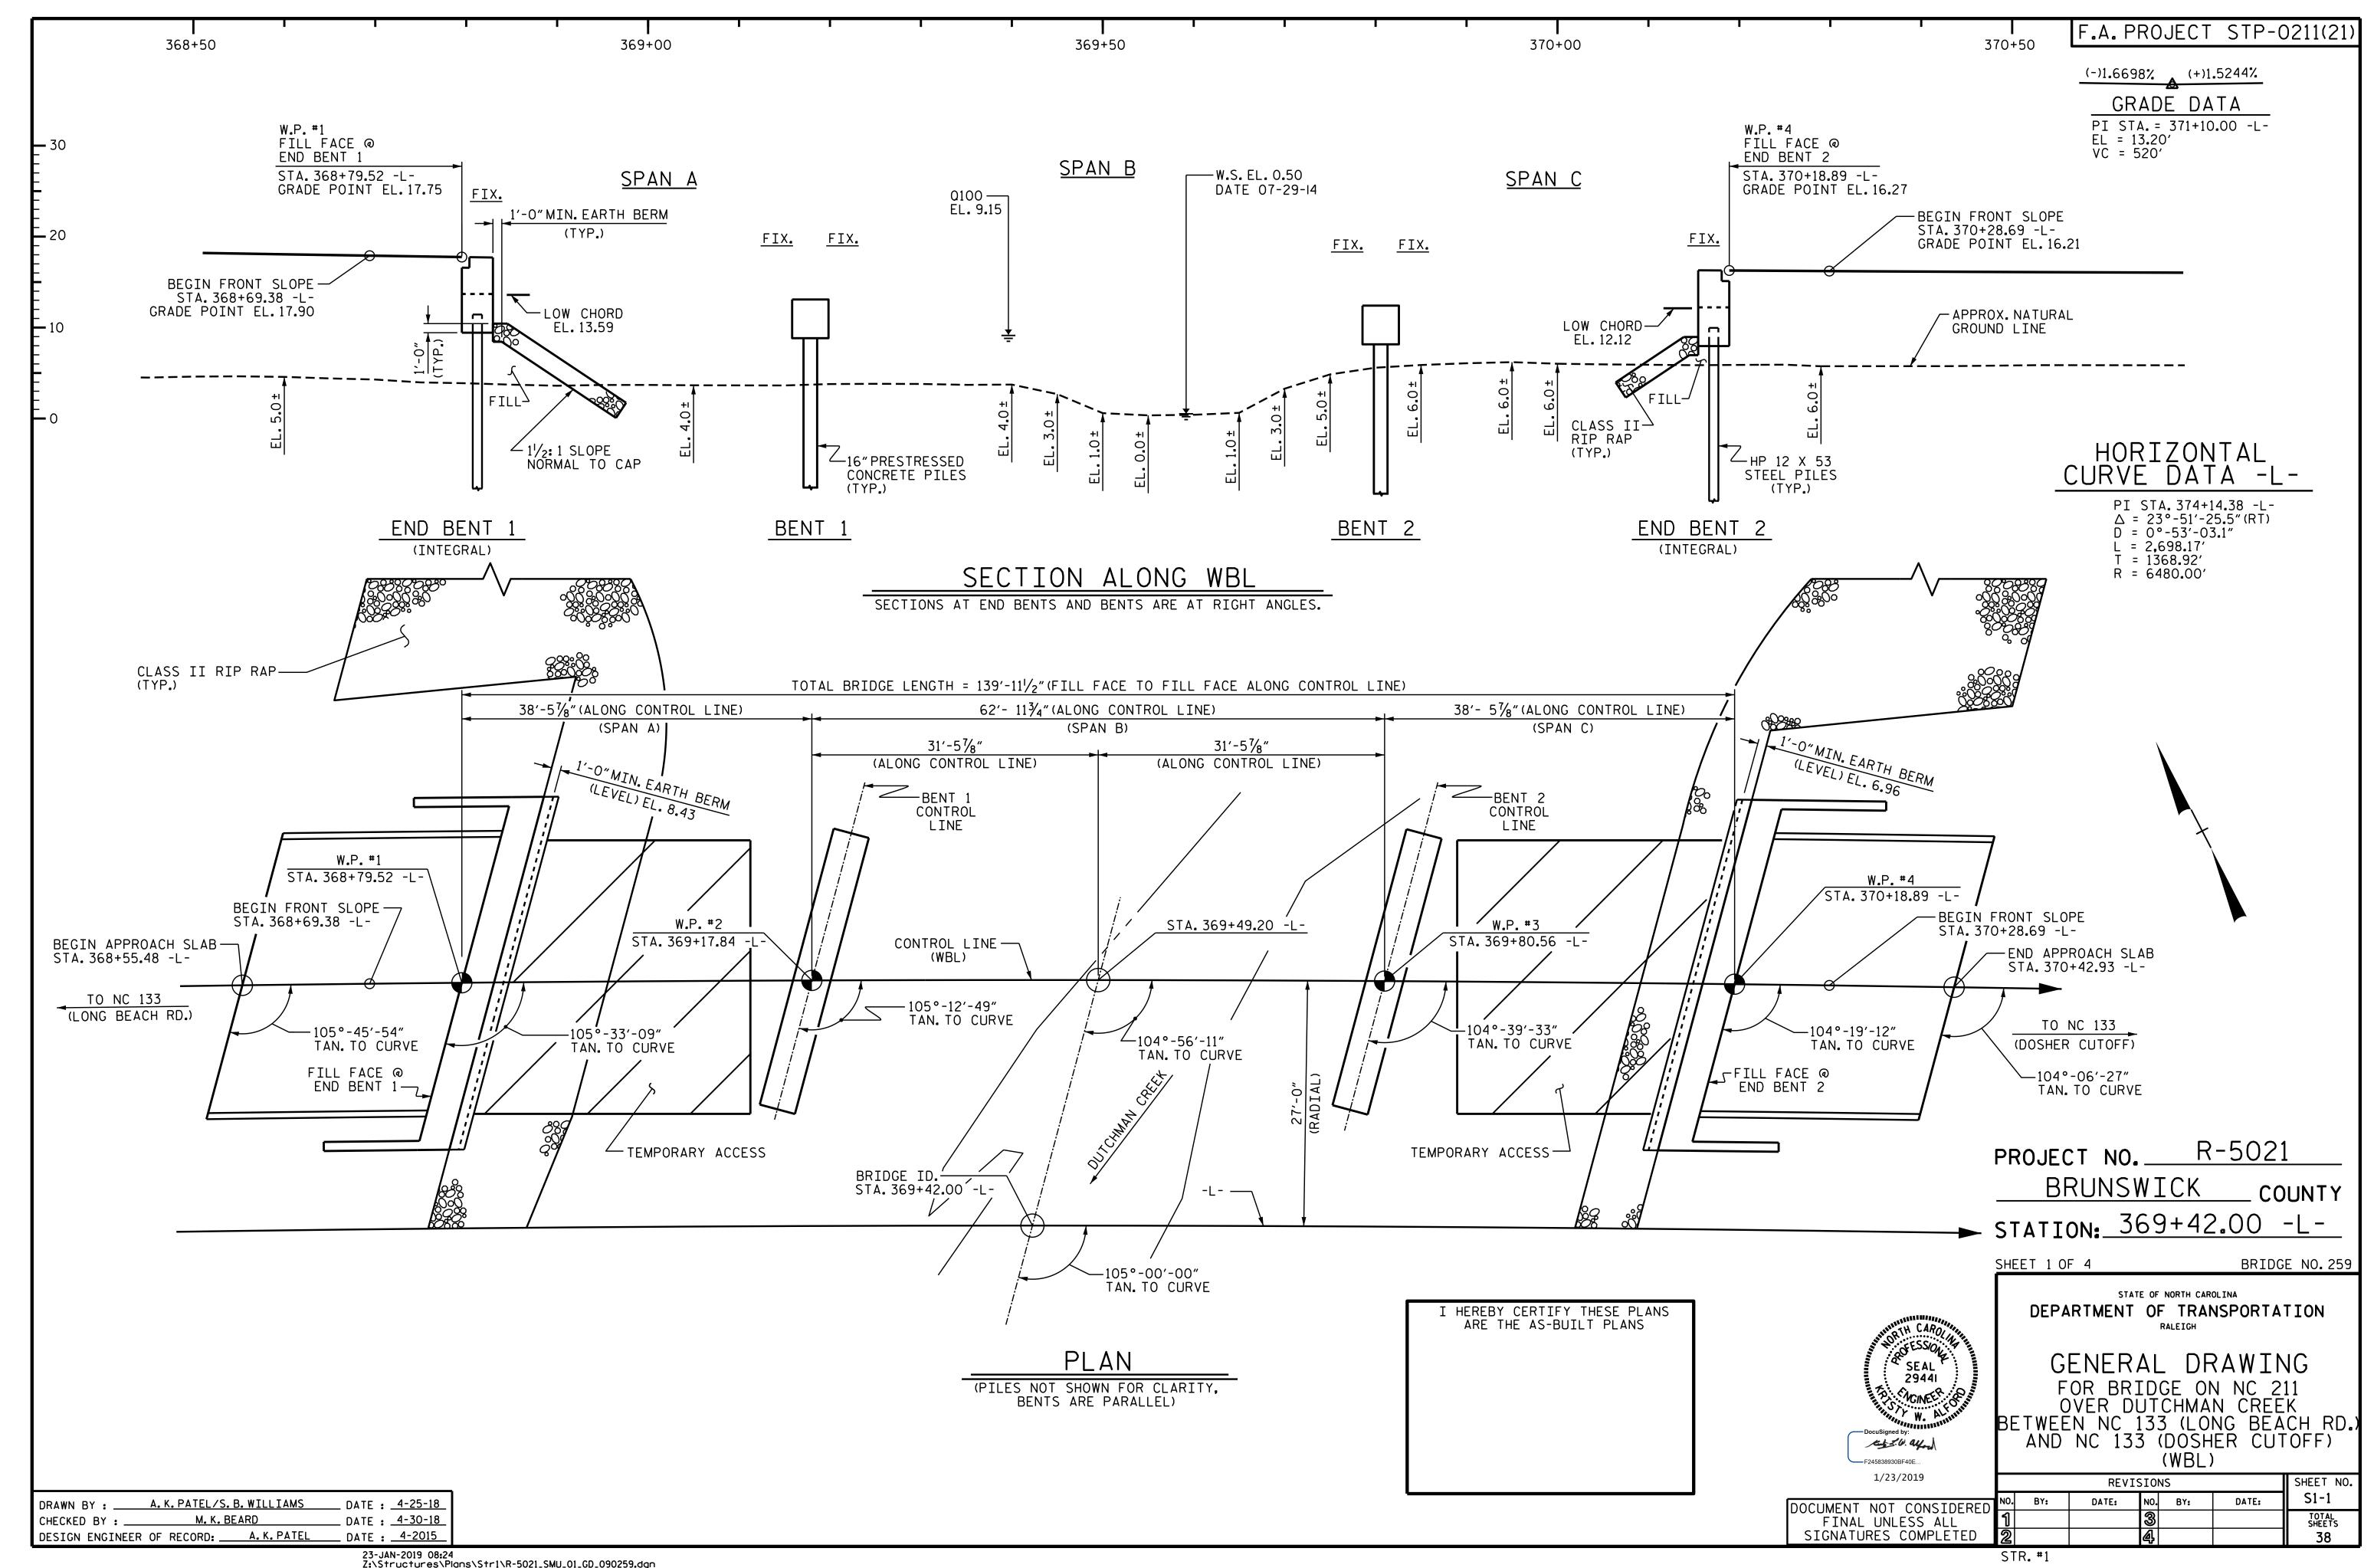

23-JAN-2019 08:24
Z:\Structures\Plans\Str1\R-5021_SMU_01_GD_090259.dgn
kalford

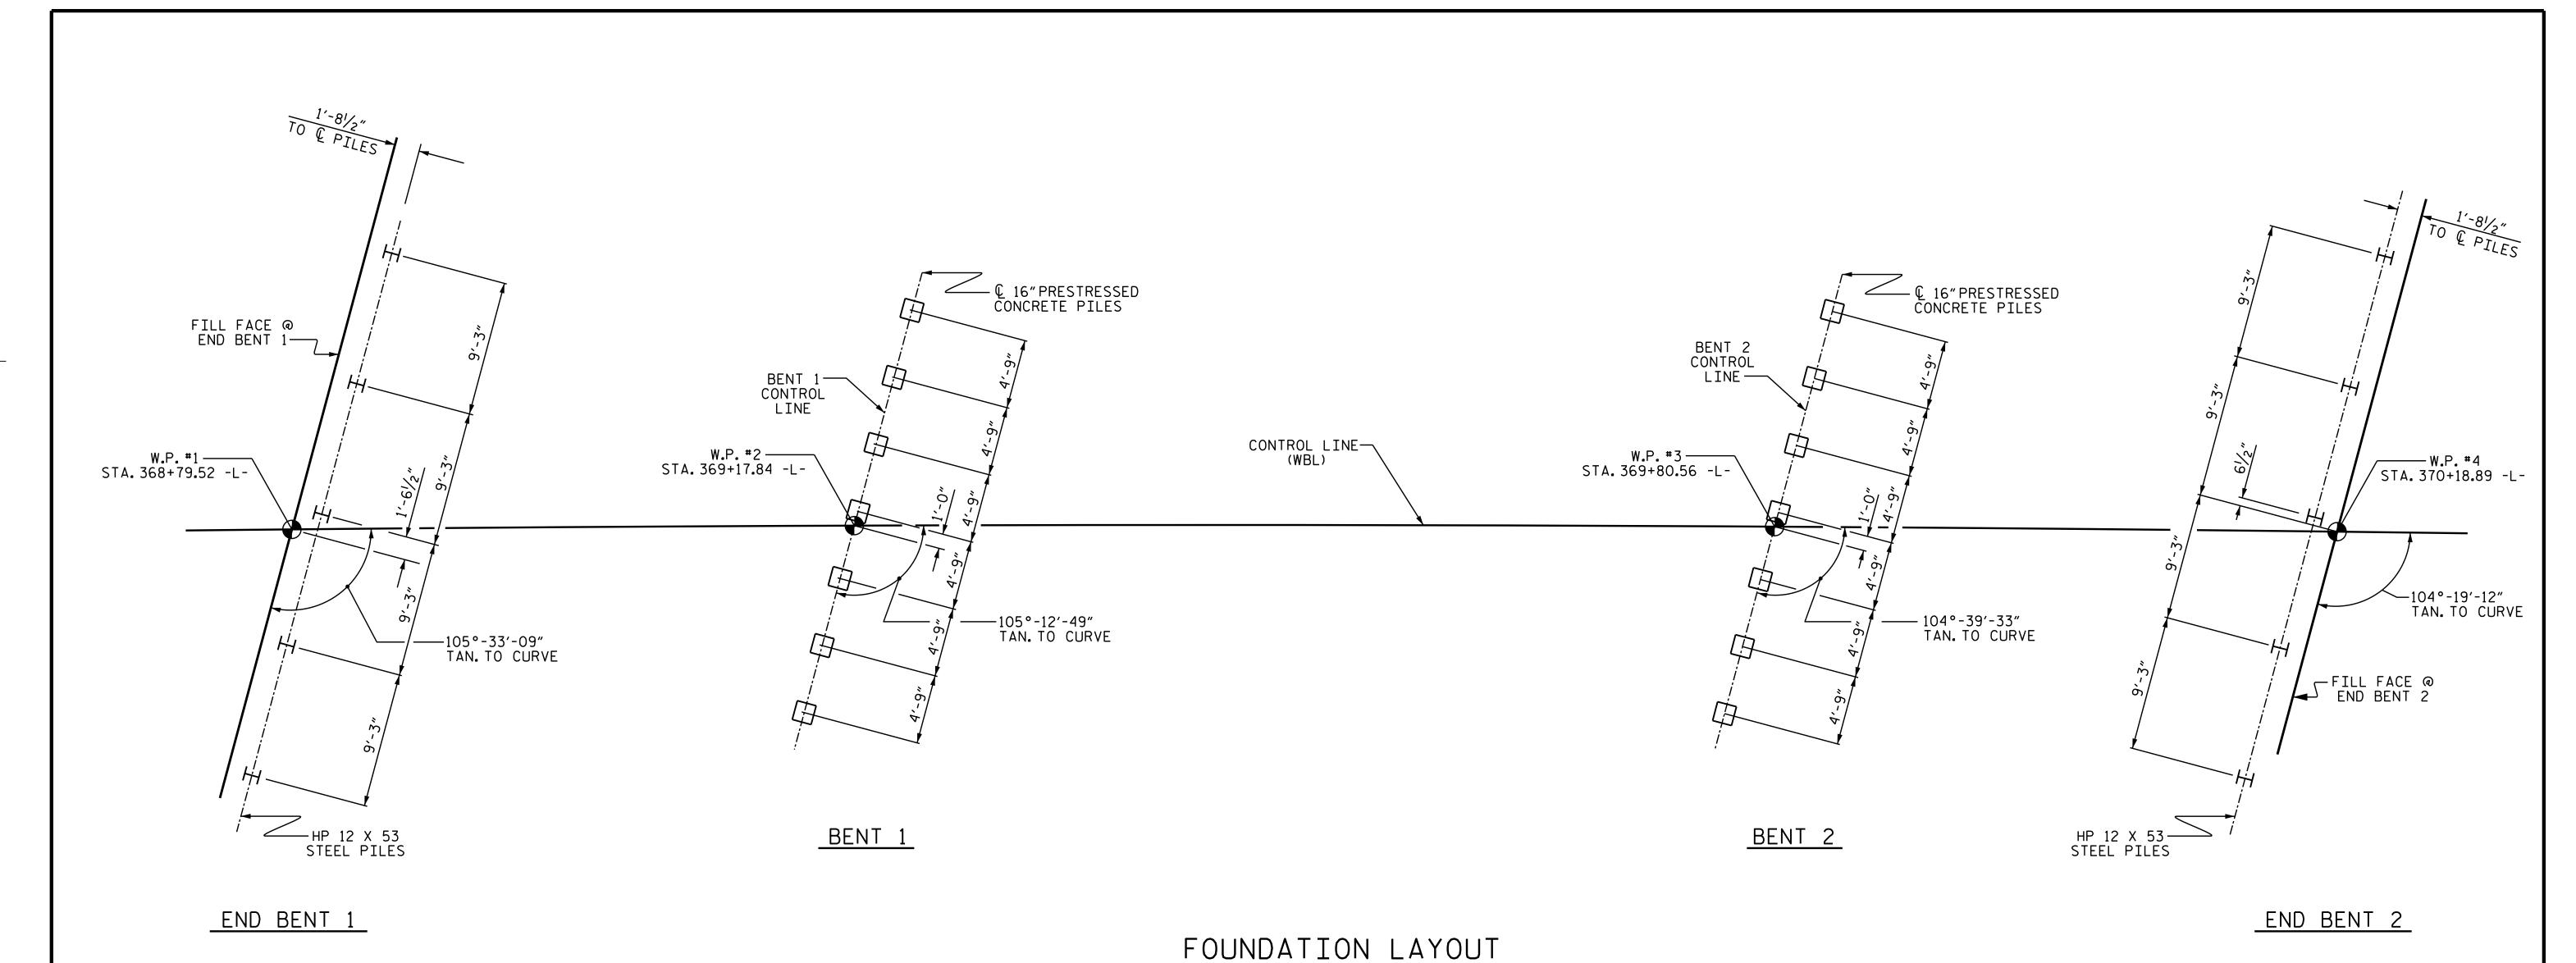

RE TO CENTER INF OF THE P

DIMENSIONS LOCATING PILES ARE TO CENTERLINE OF THE PILE AT THE BOTTOM OF THE CAP

NOTES

FOR PILES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

PILES AT END BENT 1 AND END BENT 2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 90 TONS PER PILE.

DRIVE PILES AT END BENT 1 AND END BENT 2 TO A REQUIRED DRIVING RESISTANCE OF 150 TONS PER PILE.

PILES AT BENT 1 AND BENT 2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 100 TONS PER PILE.

DRIVE PILES AT BENT 1 TO A REQUIRED DRIVING RESISTANCE OF 185 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.

DRIVE PILES AT BENT 2 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.

STEEL H-PILE POINTS ARE REQUIRED FOR STEEL H-PILES AT END BENT 1 AND END BENT 2. FOR STEEL PILE POINTS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

TESTING PILES WITH THE PDA DURING DRIVING, RESTRIKING OR REDRIVING MAY BE REQUIRED. THE ENGINEER WILL DETERMINE THE NEED FOR PDA TESTING. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

INSTALL PILES AT BENT 1 TO A TIP ELEVATION NO HIGHER THAN -25.0 FEET.

INSTALL PILES AT BENT 2 TO A TIP ELEVATION NO HIGHER THAN -30.0 FEET.

STEEL PILE TIPS ARE REQUIRED FOR PRESTRESSED CONCRETE PILES AT BENTS 1 AND 2. FOR STEEL PILE TIPS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

OBSERVE A ONE MONTH WAITING PERIOD AFTER CONSTRUCTING THE EMBANKMENT, END BENT, AND REINFORCED BRIDGE APPROACH FILL BEFORE BEGINNING APPROACH SLAB CONSTRUCTION AT END BENTS 1 AND 2. FOR BRIDGE WAITING PERIODS, SEE ROADWAY PLANS AND SPECIAL PROVISIONS.

THE SCOUR CRITICAL ELEVATION FOR BENT 1 AND BENT 2 IS ELEVATION -6.0 FEET. SCOUR CRITICAL ELEVATIONS ARE USED TO MONITOR POSSIBLE SCOUR PROBLEMS DURING THE LIFE OF THE STRUCTURE.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SHEET 2 OF 4

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

GENERAL DRAWING
FOR BRIDGE ON NC 211 OVER
DUTCHMAN CREEK BETWEEN
NC 133 (LONG BEACH RD.)
AND NC 133 (DOSHER CUTOFF)
(WBL)

1/23/2019			SHEET NO.				
DOCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-2
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			38

DRAWN BY: ______S.B. WILLIAMS DATE: _____5-18

CHECKED BY: ______M.K. BEARD DATE: _____5-24-18


DESIGN ENGINEER OF RECORD: _____A.K. PATEL DATE: _____4-2015

SIGNATUR

STR. #1

SEAL 3 29441

the Z. W. ayou

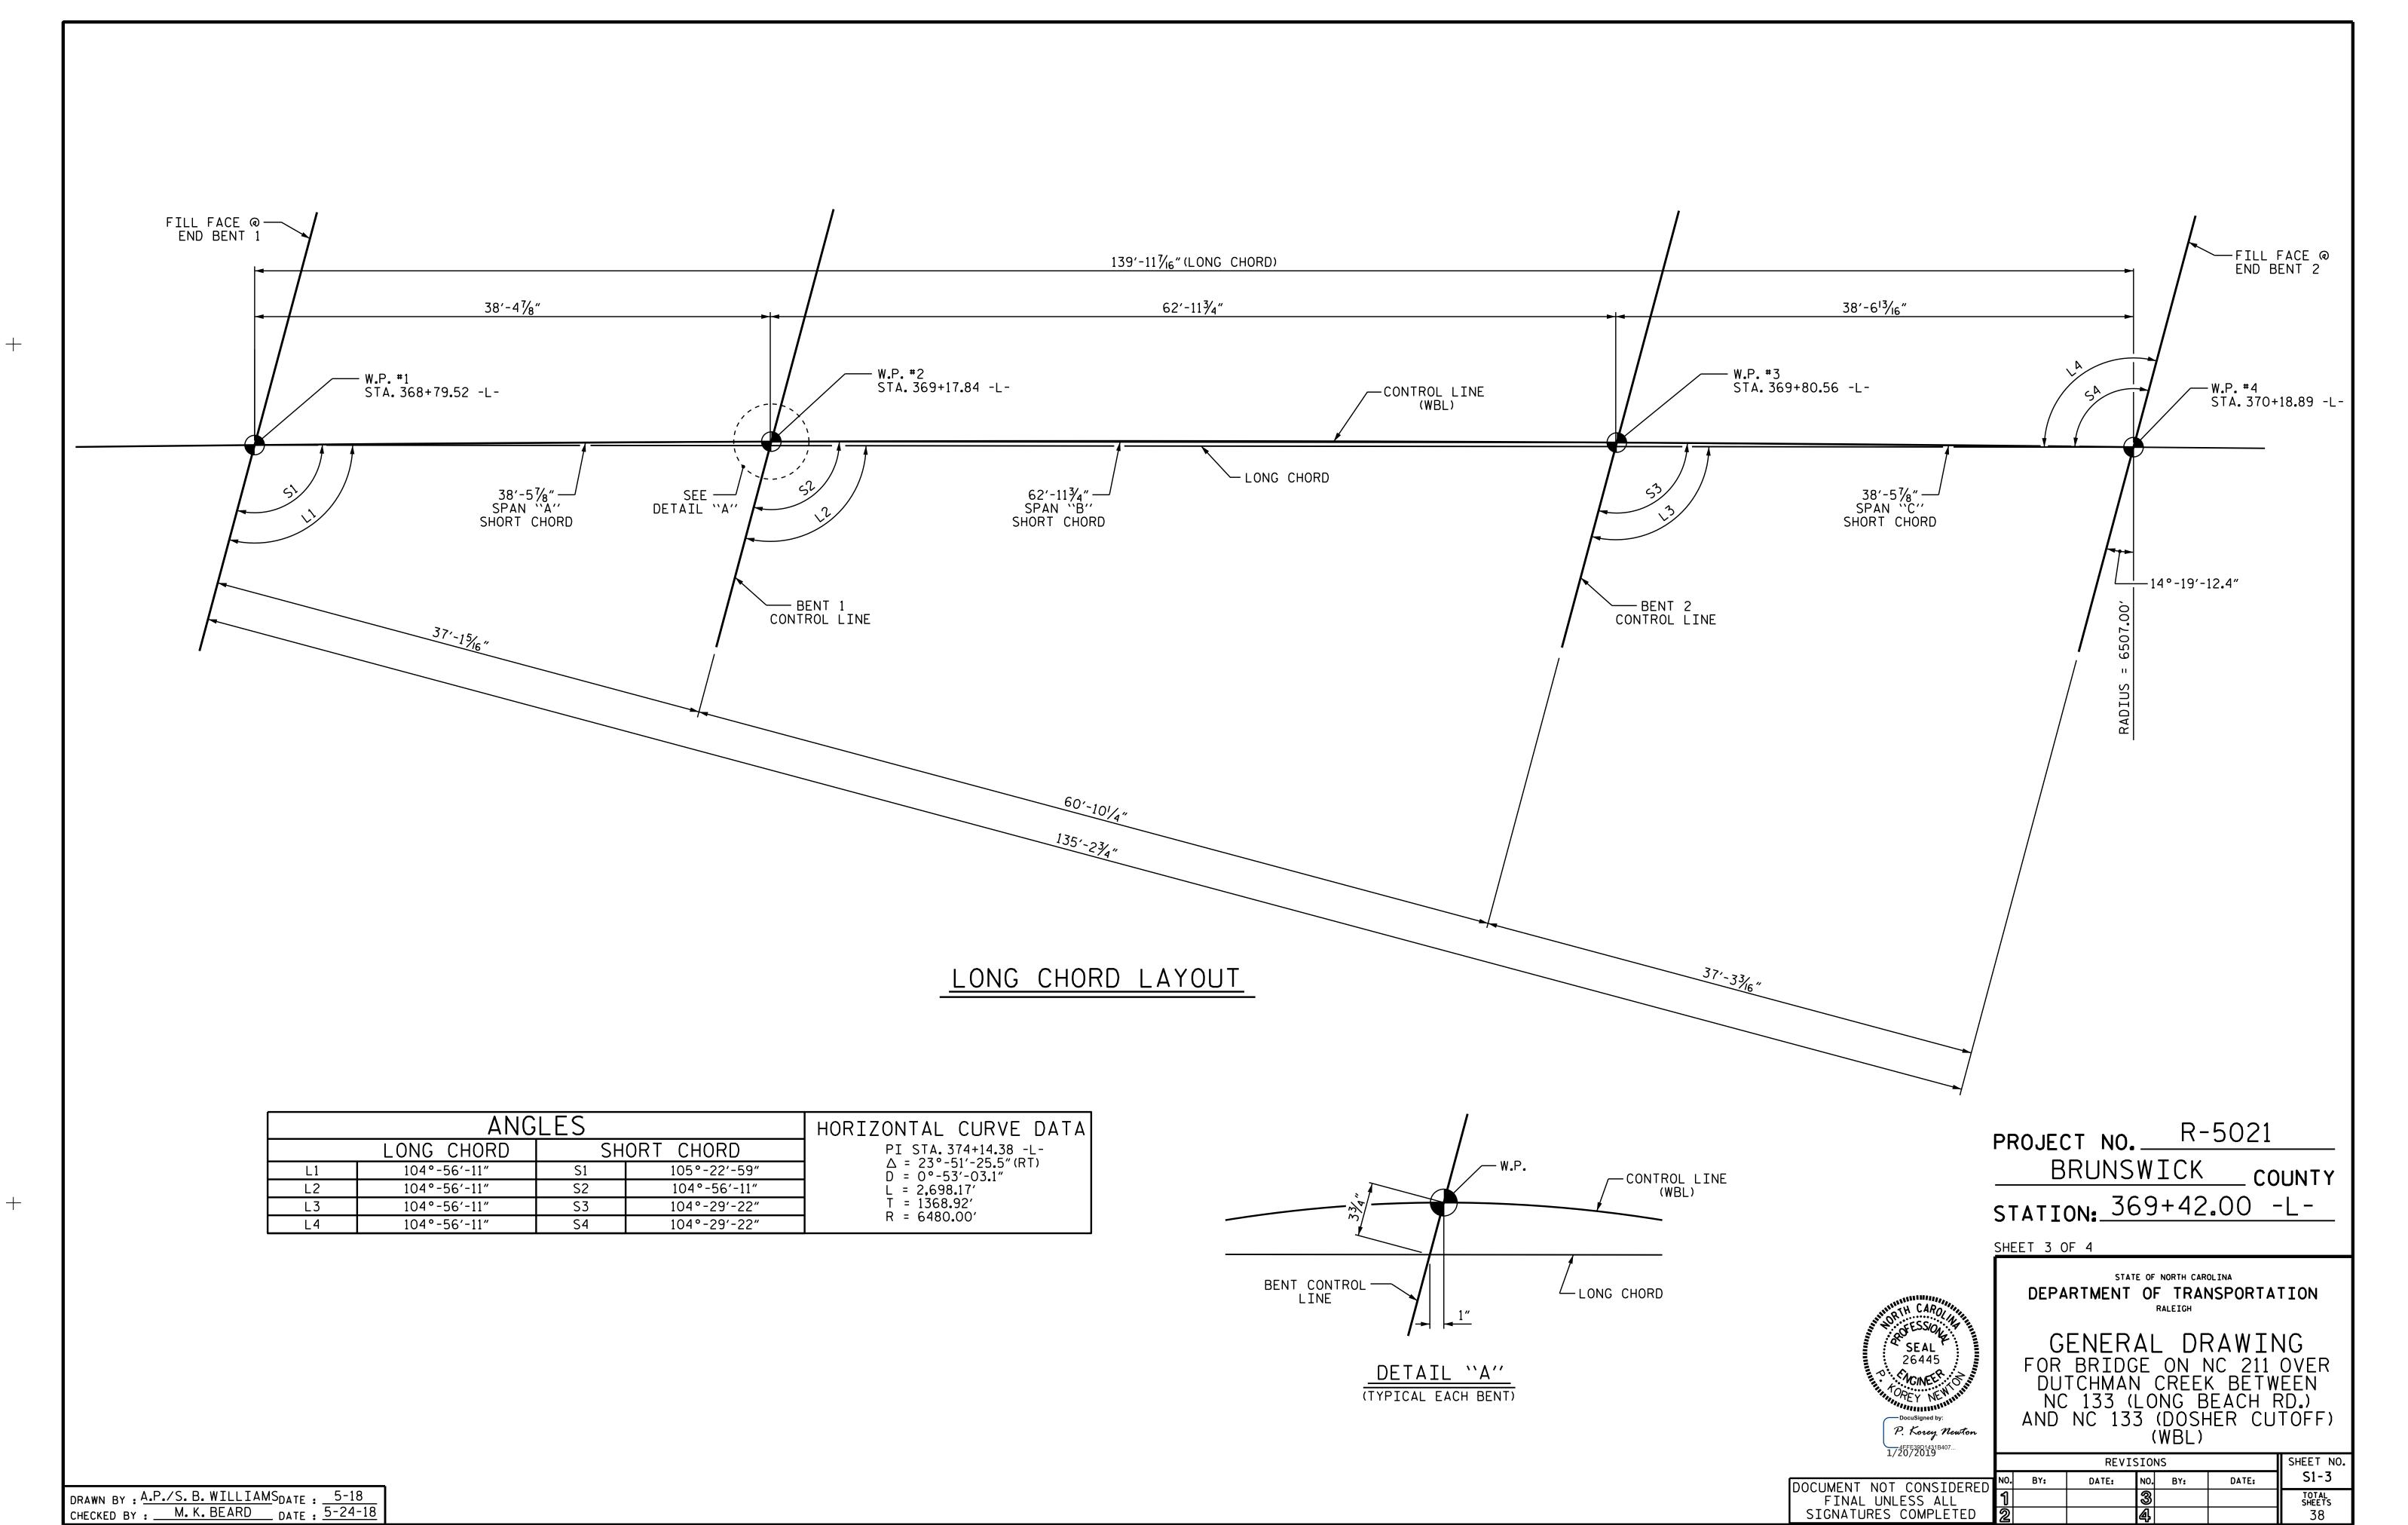

20-JAN-2019 22:03
Z:\Structures\Plans\Str1\R-5021_SMU_01_GD_090259.dgn
pknewton

STR.#1

-----TOTAL BILL OF MATERIAL-----PILE DRIVING | PILE DRIVING REINFORCED GROOVING BRIDGE EPOXY COATED EQUIPMENT EQUIPMENT 1'-2" X 2'-6" RIP RAP GEOTEXTILE STEEL PRESTRESSED | ELASTOMERIC CLASS AA **PRESTRESSED** HP 12X53 TWO BAR SETUP FOR 16" BRIDGE REINFORCING SETUP FOR CLASS II CONCRETE APPROACH | CONCRETE FOR STEEL PILES | POINTS TESTING CONCRETE CONCRETE CONCRETE REDRIVES | METAL RAIL BEARINGS DECK SLAB FLOORS HP 12 X 53 PARAPET SLABS PRESTRESSED (2'-0" THICK) DRAINAGE STEEL GIRDERS PILES STEEL PILES CONCRETE PILES | EACH SQ.FT. SQ.FT. CU. YDS. UMP SUM LBS. NO. | LIN. FT EACH EACH NO. | LIN. FT. | NO. | LIN. FT. | EACH EACH LIN.FT. LIN.FT. TONS SQ. YDS. LUMP SUM SUPERSTRUCTURE 260.84 4504 5026 15 680.4 276.47 29.3 3553 5 350 5 END BENT 1 170 490 7 BENT 1 2240 BENT 2 11.5 2240 385 END BENT 2 3541 325 125 875 10 4504 5026 LUMP SUM 11574 680.4 10 10 24 260.84 295 LUMP SUM TOTAL 82.1 15 14 276.47 330

BM #R5021-10 - 24" ROD WITH ALUMINIUM CAP, STA. 365+04.81 -L-, 39.66' RIGHT, EL. 18.37 ¥ PROPOSED — BRIDGE -PROPOSED PROPOSED GUARDRAIL TOE PROTECTION ¥ (ROADWAY DETAIL (ROADWAY DETAIL & PAY ITEM) (TYP.) — & PAY ITEM) BRIDGE ID. 17CHWAN CAL STA. 369+42.00 -L-**永** CONTROL LINE -(WBL) TO NC 133 (DOSHER CUTOFF) -CONTROL LINE -105°-00′-00″ EXISTING STRUCTURE (EBL) TAN. TO CURVE -4'LAT.BASE DITCH FOR UTILITY INFORMATION, SEE UTILITY CLASS "I" RIP-RAP PLANS AND SPECIAL PROVISIONS. (ROADWAY DETAIL * * & PAY ITEM) (TYP.) LOCATION SKETCH

ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.

THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS.

THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.

FOR OTHER DESIGN DATA AND GENERAL NOTES, SEE SHEET SN.

FOR EROSION CONTROL MEASURES SEE EROSION CONTROL PLANS.

THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH "HEC 18 - EVALUATING SCOUR AT BRIDGES".

ALL METALIZED SURFACES SHALL RECEIVE A SEAL COATING AS SPECIFIED IN TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

METALIZE PILES IN ACCORDANCE WITH TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

AFTER DRIVING THE PILES APPLY 1 COAT EACH OF 1080-09 BROWN AND 1080-09 GRAY PAINT TO THE EMBEDDED SECTION OF THE METALLIZED PILE PRIOR TO CONCRETE EMBEDMENT IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS.

PRIOR TO BEGINNING METALLIZATION THE CONTRACTOR WILL PROVIDE METALLIZED SAMPLES TO THE ENGINEER FOR APPROVAL.

THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE SAMPLE BARS SHOULD COME FROM STEEL ACTUALLY USED IN THE PROJECT AND THE SAMPLE BARS SHOULD BE REPLACED BY SPLICED BARS AS SPECIFIED IN THE SAMPLE BAR REPLACEMENT CHART. PAYMENT FOR THE SAMPLE BARS AND REPLACEMENT REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.

NOTES

NEEDLE BEAMS WILL NOT BE ALLOWED UNLESS OTHERWISE CALLED FOR ON THE PLANS OR APPROVED BY THE ENGINEER.

FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.

PRESTRESSED CONCRETE GIRDERS, PRECAST DECK PANELS, AND PRESTRESSED CONCRETE PILES SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.

PRESTRESSED CONCRETE GIRDERS ARE DESIGNED FOR O PSI TENSION IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

PRECAST PANELS SHALL BE DESIGNED FOR AN ALLOWABLE TENSILE STRESS OF O PSI IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

CLASS AA CONCRETE SHALL BE USED IN ALL CAST-IN-PLACE END BENT AND BENT CAPS AND SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.

ALL BAR SUPPORTS AND ALL INCIDENTAL REINFORCING STEEL SHALL BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

THE CONCRETE IN THE END BENT AND BENT CAPS, AND PRESTRESSED CONCRETE PILES OF BENTS 1 & 2 SHALL CONTAIN SILICA FUME. SILICA FUME SHALL BE SUBSTITUTED FOR 5% OF THE PORTLAND CEMENT BY WEIGHT. IF THE OPTION OF ARTICLE 1024-1 OF THE STANDARD SPECIFICATIONS TO PARTIALLY SUBSTITUTE CLASS F FLY ASH FOR PORTLAND CEMENT IS EXERCISED, THEN THE RATE OF FLY ASH SUBSTITUTION SHALL BE REDUCED TO 1.0 LB OF FLY ASH PER 1.0 LB OF CEMENT. NO PAYMENT WILL BE MADE FOR THIS SUBSTITUTION AS IT IS CONSIDERED INCIDENTAL TO THE VARIOUS PAY ITEMS.

THIS STRUCTURE CONTAINS THE NECESSARY CORROSION PROTECTION REQUIRED FOR A CORROSIVE SITE.

THE WATER/CEMENT RATIO FOR CONCRETE PILES SHALL NOT EXCEED 0.40.

29441

tate 2.0. ayou

SAMPLE BAR REPLACEMENT LENGTH #3 6'-2" #4 7'-4" 8'-6" 9'-8" #7 10'-10" #8 12'-0" 13'-2" 14'-6" 15′-10"

SAMPLE BAR REPLACEMENT LENGTHS BASED ON 30" (SAMPLE LENGTH) PLUS TWO SPLICE LENGTHS AND $f_v = 60$ ksi.

PROJECT NO. R-5021 BRUNSWICK COUNTY STATION: 369+42.00 -L-

SHEET 4 OF 4

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

GENERAL DRAWING FOR BRIDGE ON NC 211 OVER DUTCHMAN CREEK BETWEEN NC 133 (LONG BEACH RD. AND NC 133 (DOSHER CUTOFF) (WBL)

1/23/2019 REVISIONS S1-4 DATE: DOCUMENT NOT CONSIDERED TOTAL SHEETS FINAL UNLESS ALL SIGNATURES COMPLETED

HYDRAULIC DATA

DESIGN DISCHARGE ____= 2300 CFS FREQUENCY OF DESIGN DISCHARGE_= 50 YRS. DESIGN HIGH WATER ELEVATION __= 8.9 FT. DRAINAGE AREA _____ = 5.2 SQ. MI BASE DISCHARGE (Q100) ____= 2500 CFS BASE HIGH WATER ELEVATION ___= 9.15 FT.

OVERTOPPING FLOOD DATA

OVERTOPPING DISCHARGE _____ = 2900+ CFS FREQUENCY OF OVERTOPPING FLOOD __ = 500+ YRS. OVERTOPPING FLOOD ELEVATION ____ = 16.37 FT.

DRAWN BY: _____A.K.PATEL/S.B.WILLIAMS DATE: 4-26-18 CHECKED BY: M.K.BEARD _ DATE : <u>4-30-18</u> DESIGN ENGINEER OF RECORD: A.K. PATEL DATE: 4-30-18

LOAD AND RESISTANCE FACTOR RATING (LRFR) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS STRENGTH I LIMIT STATE SERVICE III LIMIT STATE MOMENT SHEAR MOMENT DISTRIBUTION FACTORS (DF) ROLLING RATING GIRDER GIRDER CONT DIST, LEFT SPAN DIST, LEFT SPAN DIST, LEFT SPAN 0.674 17.822 1.02 N/A 1.02 1.75 1.78 С 0.748 1.91 0.80 0.643 EL 30.402 HL-93(Inv)10.691 2.30 0.748 2.47 HL-93(0pr) N/A 1.35 0.674 2.30 17.822 10.691 DESIGN LOAD 46.963 0.674 2.29 21.386 2.16 0.643 1.30 36.000 1.30 1.75 0.748 0.80 30.402 HS-20(Inv) С 24.945 RATING 100.877 0.748 36.000 2.80 21.386 HS-20(0pr) 1.35 0.674 2.97 С 2.80 24.945 N/A 13.500 38.207 0.674 5.10 0.748 5.14 30.402 2.83 17.822 24.945 0.643 2.83 С 0.80 SNSH EL 43.144 0.674 4.24 0.748 4.05 30.402 21.386 24.945 0.80 0.643 2.16 SNGARBS2 20.000 2.16 1.4 С 0.674 0.748 30.402 22.000 2.06 45.403 21.386 3.93 24.945 0.643 2.06 SNAGRIS2 4.18 С 0.80 27.250 2.55 0.748 2.60 30.402 38.415 0.674 17.822 0.643 SNCOTTS3 1.41 1.4 24.945 0.80 1.41 SNAGGRS4 34.925 1.20 41.785 0.674 2.34 17.822 0.748 2.45 24.945 0.643 1.20 30.402 0.80 35.550 41.547 0.674 2.27 17.822 0.748 2.66 24.945 0.643 30.402 1.17 С 1.17 SNS5A 1.4 0.80 43.150 30.402 0.674 2.18 17.822 2.56 0.643 1.08 SNS6A 39.950 1.08 С 0.748 24.945 0.80 43.213 2.65 30.402 SNS7B 42.000 1.03 0.674 2.08 С 17.822 0.748 24.945 0.80 0.643 1.03 LEGAL LOAD TNAGRIT3 33.000 1.32 43.542 0.674 17.822 0.748 2.95 24.945 0.80 0.643 1.32 30.402 1.4 2.69 С EL RATING 17.822 24.945 1.33 TNT4A 33.075 1.33 43.905 1.4 0.674 2.72 С 0.748 2.71 0.80 0.643 EL 30.402 2.34 0.748 TNT6A 41.600 1.09 45.468 1.4 0.674 С 17.822 2.63 24.945 0.80 0.643 1.09 EL 30.402 46.307 0.674 2.41 0.748 30.402 42.000 1.10 С 17.822 2.57 24.945 0.80 0.643 1.10 TNT7A 48.339 0.674 2.40 0.748 2.47 0.643 30.402 42.000 1.15 1.4 С 17.822 24.945 0.80 1.15 TNT7B 21.386 43.000 1.09 46.750 0.674 2.37 С 0.748 2.40 24.945 0.643 1.09 30.402 TNAGRIT4 1.4 0.80 2.58 1.02 45.970 0.674 2.21 17.822 0.748 0.643 1.02 30.402 TNAGT5A 45.000 24.945 0.80 1.4 1.01 45.274 1.4 0.674 2.14 C I 17.822 0.748 2.25 A I 24.945 0.80 0.643 1.01

LOAD FACTORS:

	DESIGN LOAD RATING	LIMIT STATE	$\gamma_{\sf DC}$	$\gamma_{\sf DW}$
		STRENGTH I	1.25	1.50
	FACTORS	SERVICE III	1.00	1.00

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:


EL 30.402

- (#) CONTROLLING LOAD RATING
- 1 DESIGN LOAD RATING (HL-93)
- 2 DESIGN LOAD RATING (HS-20)
- 3 LEGAL LOAD RATING **
- ** SEE CHART FOR VEHICLE TYPE

GIRDER LOCATION

- I INTERIOR GIRDER
- EL EXTERIOR LEFT GIRDER
- ER EXTERIOR RIGHT GIRDER

R-5021 PROJECT NO. ____ BRUNSWICK __ COUNTY STATION: 369+42.00 -L-



DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD LRFR SUMMARY FOR PRESTRESSED CONCRETE GIRDERS

SHEET NO

S1-5

STATE OF NORTH CAROLINA

(NON-INTERSTATE TRAFFIC) (WBL)

REVISIONS DATE: DATE: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

BENT 2 END BENT 2

35′-75/8″

(SPAN C BRG. TO BRG.)

LRFR SUMMARY

60′-9¾"

(SPAN B BRG. TO BRG.)

DESIGN ENGINEER OF RECORD: P.K.NEWTON DATE : 7/31/17

ASSEMBLED BY : P.K. NEWTON DATE: 7/28/17 CHECKED BY : A.K. PATEL REV. II/I2/08RR MAA/GM DRAWN BY : MAA 1/08 REV. 10/1/11

CHECKED BY : GM/DI 2/08

20-JAN-2019 22:03 Z:\Structures\Plans\Str1\R-5021_SMU_01_LRFR_090259.dgn

35′-7⁵/₈"

(SPAN A BRG. TO BRG.)


BENT 1


45.000


END BENT 1

TNAGT5B


STD. NO. LRFR1 STR.#1

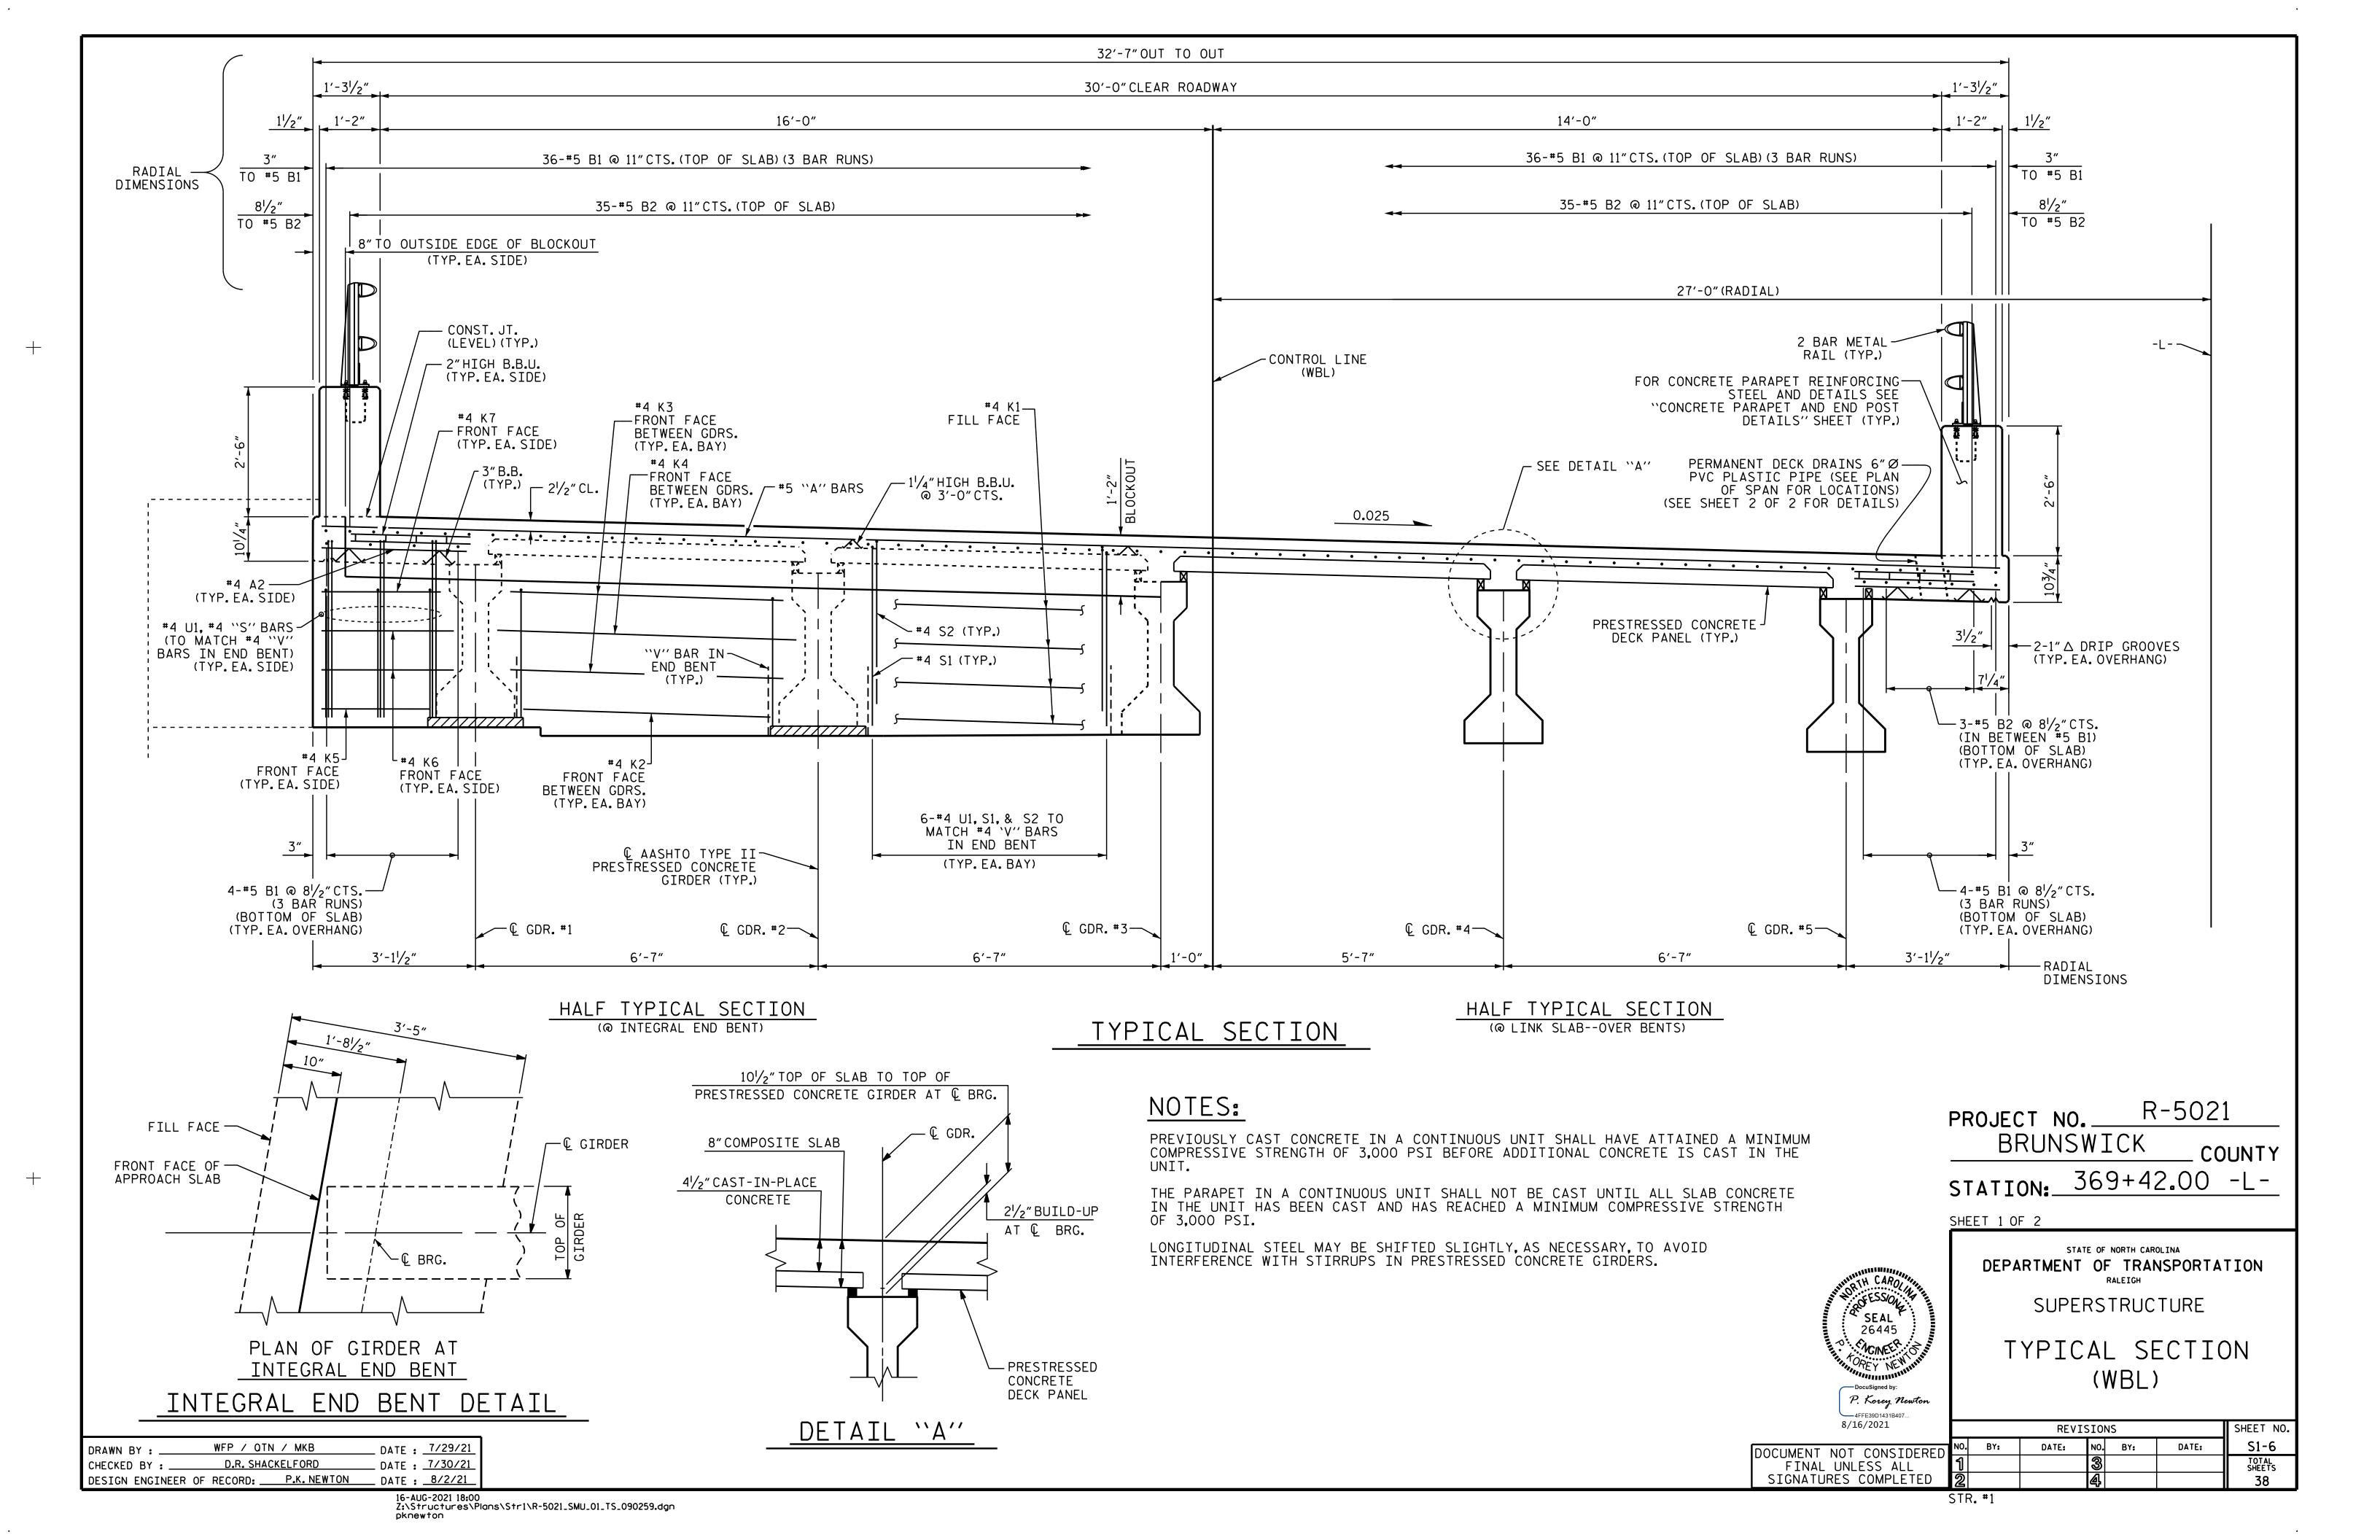


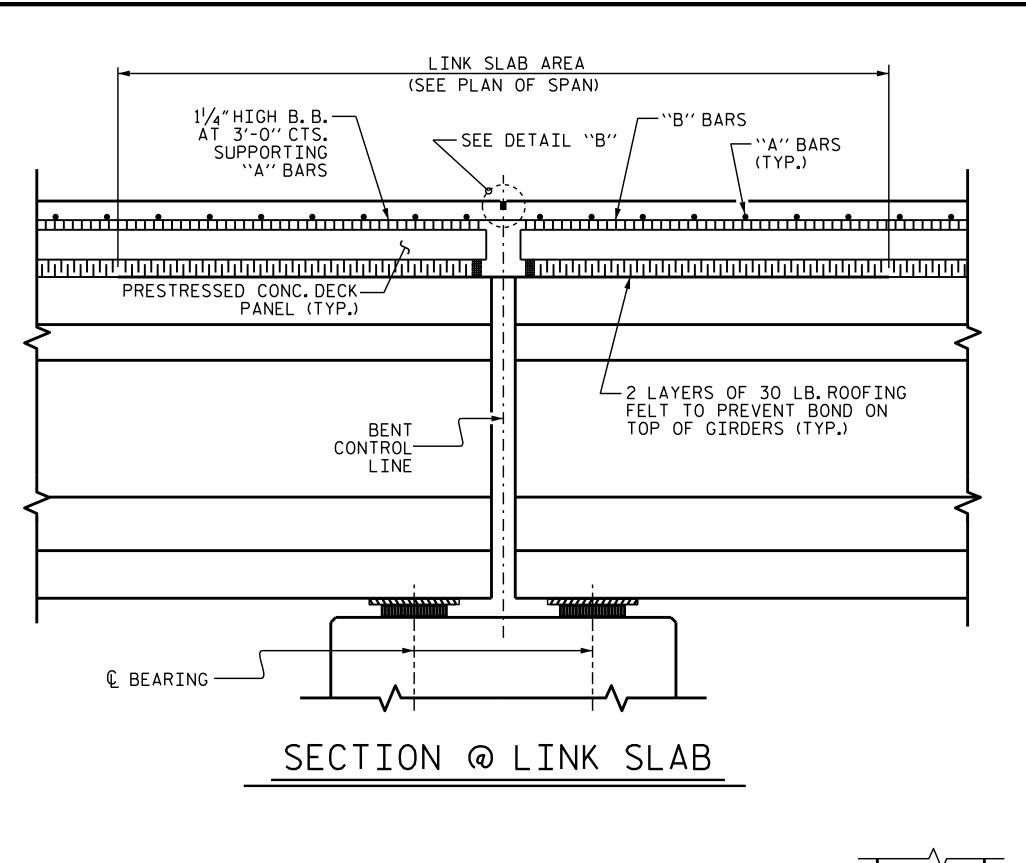


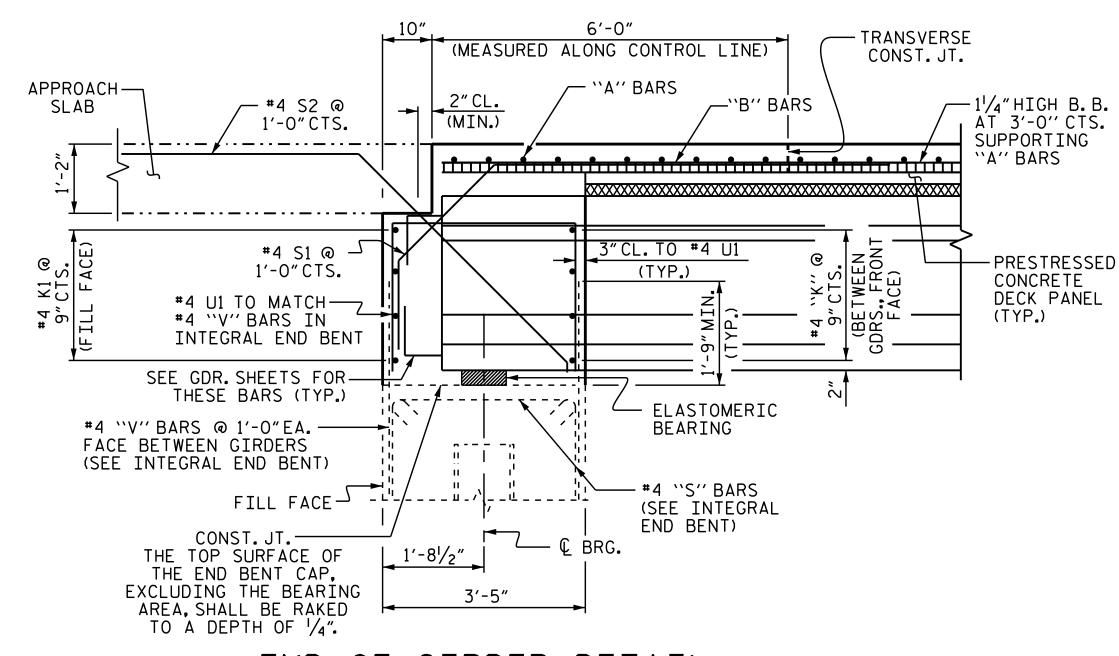




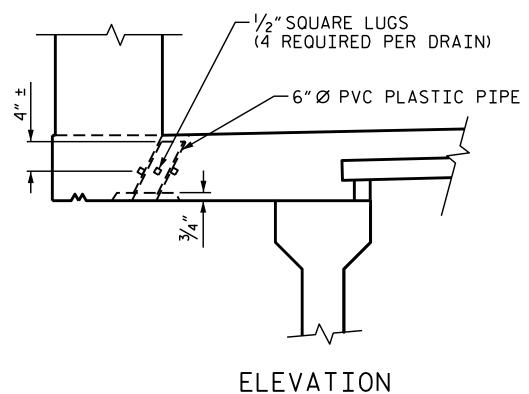

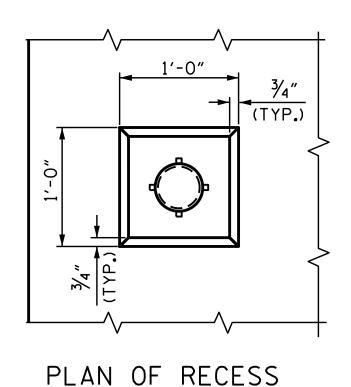

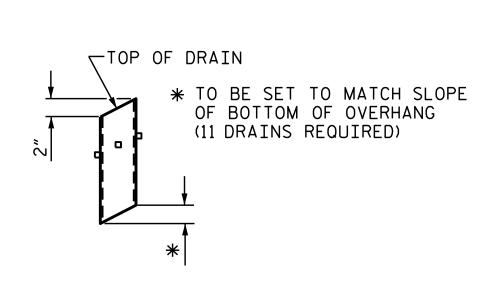

PIPE DETAIL

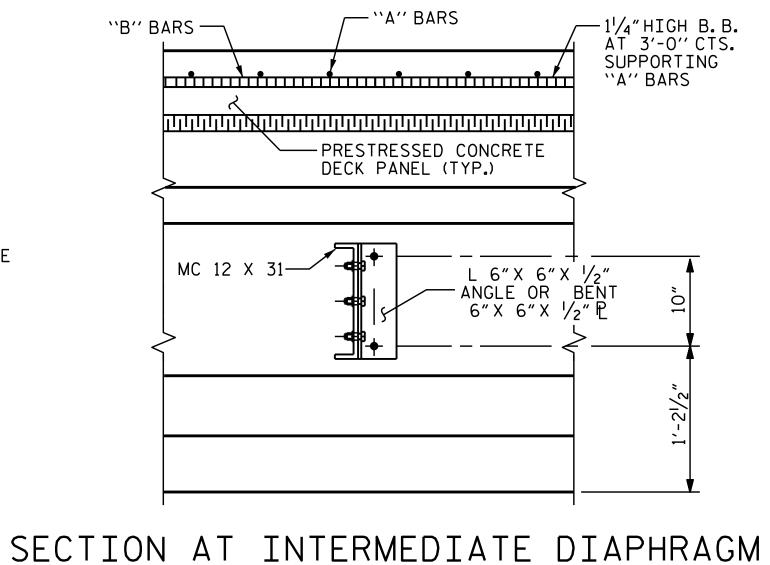

__``A'' BARS

6'-7"(RADIAL)

TYPICAL SECTION AT

INTERMEDIATE DIAPHRAGM

(TYP. EA. BAY IN SPAN B)

MC 12×31

 $-2^{1/2}$ " CL.

• • • • • • •

PRESTRESSED-

DECK PANEL

ℚ GDR.

CONCRETE

(TYP.)

"B" BARS


(TYP.)

TOP OF FLOOR DRAINS TO BE SET 3/8" BELOW SURFACE OF SLAB.

4 - 1/2" SQUARE LUGS TO BE GLUED TO THE P.V.C. PLASTIC PIPE AT EQUAL SPACES AROUND THE PIPE DRAIN APPROXIMATELY 4" FROM THE TOP OF THE PIPE.

THE 6" Ø PVC PLASTIC PIPE AND FITTINGS SHALL BE SCHEDULE 40 AND CONFORM TO ASTM D1785.

DRAIN DETAILS

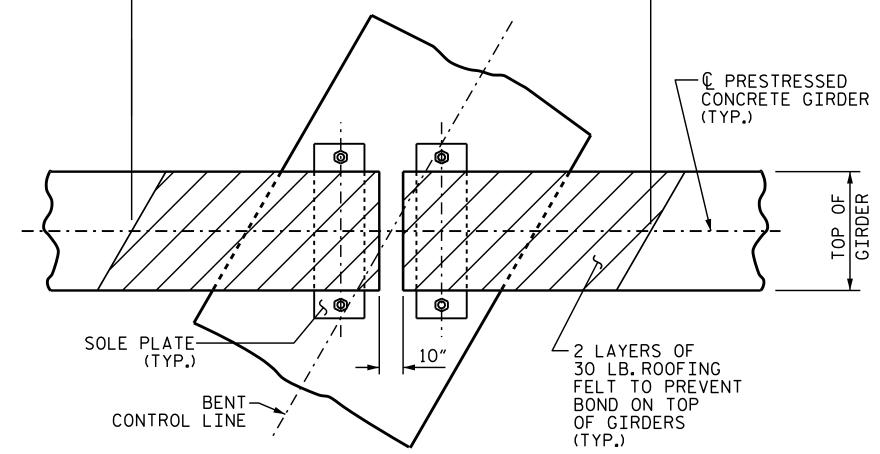

** LINK SLAB AREA

(SEE PLAN OF SPAN)

PLAN OF LINK SLAB


** THE TOP OF GIRDER IN THE REGION OF THE LINK SLAB SHALL BE SMOOTH (NOT RAKED) AND FREE OF STIRRUPS, DECK FORMWORK ATTACHMENTS, AND OVERHANG FALSEWORK/FORMWORK ATTACHMENTS.

A $1\frac{1}{2}$ DEEP. $\frac{3}{8}$ WIDE CONTRACTION JOINT AT THE BENT CONTROL LINE SHALL BE SAWED WITHIN 24 HOURS OF POURING THE LINK SLAB DECK. THE JOINT SHALL BE FILLED WITH JOINT SEALER MATERIAL. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE STANDARD SPECIFICATIONS.

-JOINT SEALER

3/8" SAWED OPENING

MATERIAL

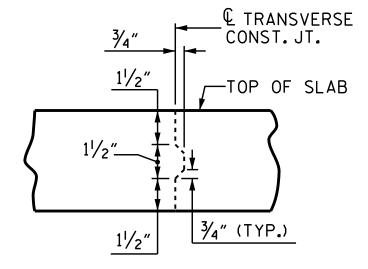

TRANSVERSE CONSTRUCTION JOINT DETAIL

NOTE: REINFORCING STEEL IN SLAB NOT SHOWN.
LONGITUDINAL REINFORCING STEEL SHALL BE CONTINUOUS THRU JOINT

R-5021 PROJECT NO. BRUNSWICK COUNTY 369+42.00 -L-STATION:_

SHEET 2 OF 2

SESSION.

26445

P. Korey Newton

O. CHOINEER


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

SUPERSTRUCTURE

TYPICAL SECTION (WBL)

4FFE39D1431B407							
8/16/2021			SHEET NO.				
DOCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-7
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			38

STR. #1

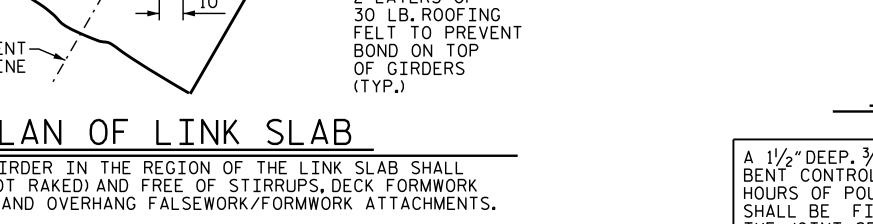

WFP / QTN / MKB DRAWN BY : DATE : 7/29/21 D. R. SHACKELFORD _ DATE : <u>7/30/21</u> CHECKED BY : ___ DESIGN ENGINEER OF RECORD: P.K. NEWTON DATE: 8/2/21


16-AUG-2021 18:00 Z:\Structures\Plans\Str1\R-5021_SMU_01_TS_090259.dgn

DECK PANEL SUPPORTS

THE CONTRACTOR SHALL PROVIDE THE DECK PANEL SUPPORT SYSTEM SHOWN OR HE MAY SUBMIT A DECK PANEL SUPPORT SYSTEM OF HIS OWN DESIGN TO THE ENGINEER FOR APPROVAL.

POLYSTYRENE SUPPORT SYSTEM

- 1. ALL POLYSTYRENE SHALL BE DOW STYROFOAM 60 HIGH-LOAD, UC INDUSTRIES FOAMULAR 600 OR APPROVED EQUAL.
- 2. THE POLYSTYRENE SUPPORT SYSTEM SHALL CONSIST OF ONE LAYER WITH A MINIMUM WIDTH OF $1^{1}/2^{n}$ AND A MAXIMUM WIDTH OF 2^{n} . THE POLYSTYRENE SHALL HAVE $1^{1}/2^{n}$ WIDE SLOTS OR $1^{1}/2^{n}$ DIAMETER HOLES AT $4^{1}/2^{n}$ CENTERS STAGGERED ALONG THE TOP AND BOTTOM.
- 3. THE POLYSTYRENE MAY BE CUT AND PLACED ON EDGE AS NECESSARY TO MATCH THE REQUIRED BUILDUP PROFILE ALONG THE GIRDER.
- 4. ADHESIVE, AS APPROVED BY THE ENGINEER, SHALL BE APPLIED TO THE TOP OF THE GIRDER IN A CONTINUOUS BEAD AND IN SUFFICIENT AMOUNT TO PREVENT THE POLYSTYRENE FROM BLOWING OUT AND TO PREVENT GAPS FROM FORMING BETWEEN THE POLYSTYRENE AND THE GIRDER. PRIOR TO PLACEMENT OF THE DECK PANELS, THE ADHESIVE SHALL ALSO BE APPLIED TO THE TOP OF THE POLYSTYRENE.
- 5. CONCRETE-FILLED BUCKETS, STACKS OF DECK PANELS, BUNDLED REINFORCING BARS OR OTHER HEAVY CONCENTRATED LOADS WILL NOT BE PERMITTED ON THE DECK PANEL ONCE THE PANEL HAS BEEN PLACED ON THE POLYSTYRENE SUPPORT SYSTEM.

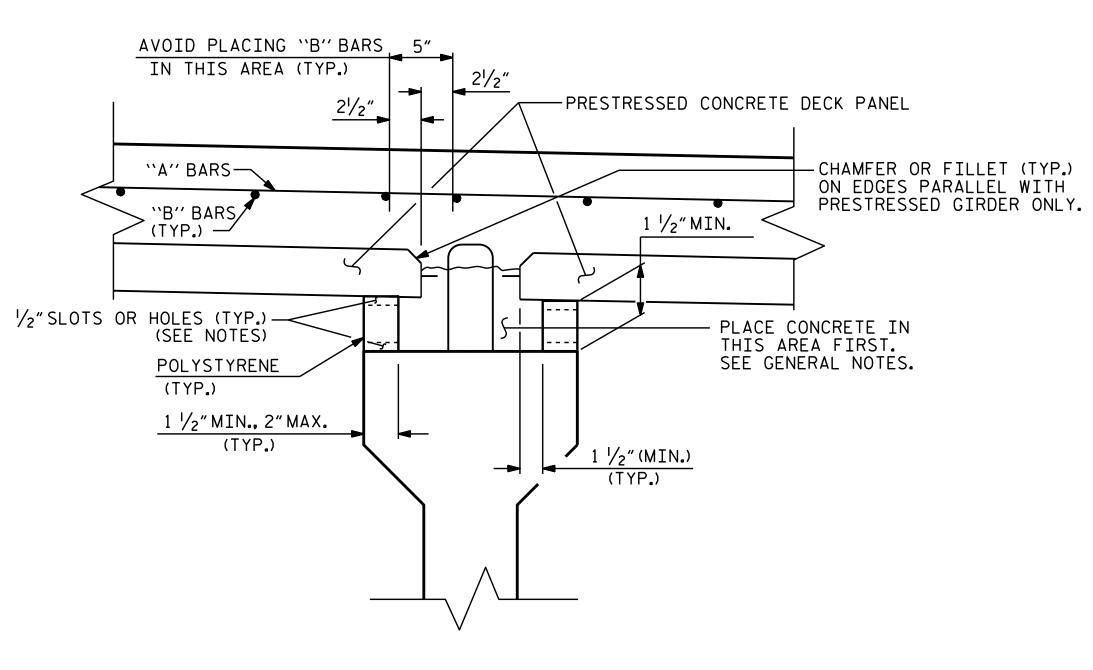

POLYSTYRENE SUPPORT

ASSEMBLED BY: WFP / OTN DATE: 8/14/18
CHECKED BY: M.K.BEARD DATE: II/18

DRAWN BY: ELR 1/92 REV.5/I/O6R REV.10/I/II MAA/GM REV.10/I/II REV. 12/17

REV. 12/17


GENERAL NOTES

- 1. THE DESIGN COMPRESSIVE STRENGTH (f'c) FOR THE CONCRETE IN PRESTRESSED PANELS SHALL BE 5000 PSI MINIMUM AT 28 DAYS. COMPRESSIVE STRENGTH OF CONCRETE AT TIME OF RELEASE OF STRANDS SHALL BE 4000 PSI MINIMUM.
- 2. THE PRECAST PRESTRESSED PANEL SHALL HAVE A THICKNESS OF 3 $\frac{1}{2}$ " WITH THE PRESTRESSED STRANDS LOCATED AT HALF THE DEPTH OF THE PANEL.
- 3. FOR SKEWED SPANS, TRAPEZOIDAL CLOSURE PANELS SHALL HAVE A MINIMUM WIDTH OF 2 FEET ON THE SHORT SIDE.
- 4. ALL PRESTRESSING STRANDS SHALL EXTEND 2" BEYOND THE PANEL EDGES.
- 5. SHEAR REINFORCING OF 0.60 SQ. INCHES OF REINFORCING STEEL PER 10 SQ. FEET OF PANEL SURFACE SHALL BE PROVIDED IN THE PANEL TO ENSURE COMPOSITE ACTION BETWEEN PANEL AND THE CAST-IN-PLACE CONCRETE. SHEAR REINFORCEMENT SHALL BE MADE OF WELDED WIRE HAVING A MINIMUM YIELD STRENGTH OF 60 KSI.
- 6. SHEAR REINFORCEMENT AND LIFTING DEVICES SHALL BE CONSTRUCTED AND PLACED SO AS TO AVOID ANY INTERFERENCE WITH REINFORCING STEEL IN THE CAST-IN-PLACE DECK SLAB AND TO ALLOW FOR PROPER CONCRETE CONSOLIDATION IN THE DECK PANEL.
- 7. SHIFT LONGITUDINAL "B" BARS AS NECESSARY TO OBTAIN A MINIMUM CLEAR DISTANCE OF 2 $\frac{1}{2}$ " TO THE RIGHT OR LEFT OF THE EDGE OF THE DECK PANEL. IF, IN SHIFTING TO OBTAIN THIS CLEARANCE, THE "B" BAR INTERFERES WITH THE STIRRUP IN THE TOP OF THE GIRDER THE "B" BAR MAY BE ELIMINATED.
- 8. WHEN CASTING THE DECK, PLACE CONCRETE FIRST OVER THE GIRDERS IN CONTINUOUS STRIPS A MINIMUM OF THREE PANEL LENGTHS AHEAD OF THE REST OF THE CONCRETE. CAREFULLY VIBRATE THE CONCRETE OVER THE GIRDERS SO THAT CONCRETE COMPLETELY FILLS THE AREA UNDER THE DECK PANEL OVERHANGS. THEN PLACE AND VIBRATE THE REMAINING DECK CONCRETE.
- 9. PRECAST PANELS SHALL BE DESIGNED FOR AN ALLOWABLE TENSILE STRESS OF O PSI IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.
- 10. PRECAST PANELS SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
- 11. ALL BAR SUPPORTS AND INCIDENTAL REINFORCING STEEL USED IN THE PRECAST PANELS SHALL BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-



STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION


RALEIGH


STANDARD


PRECAST PRESTRESSED CONCRETE DECK PANELS (WBL)


DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

20/2019											
20/2013		REVISIONS									
CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-8				
ESS ALL	1			3			TOTAL SHEETS				
COMPLETED	2			4			38				

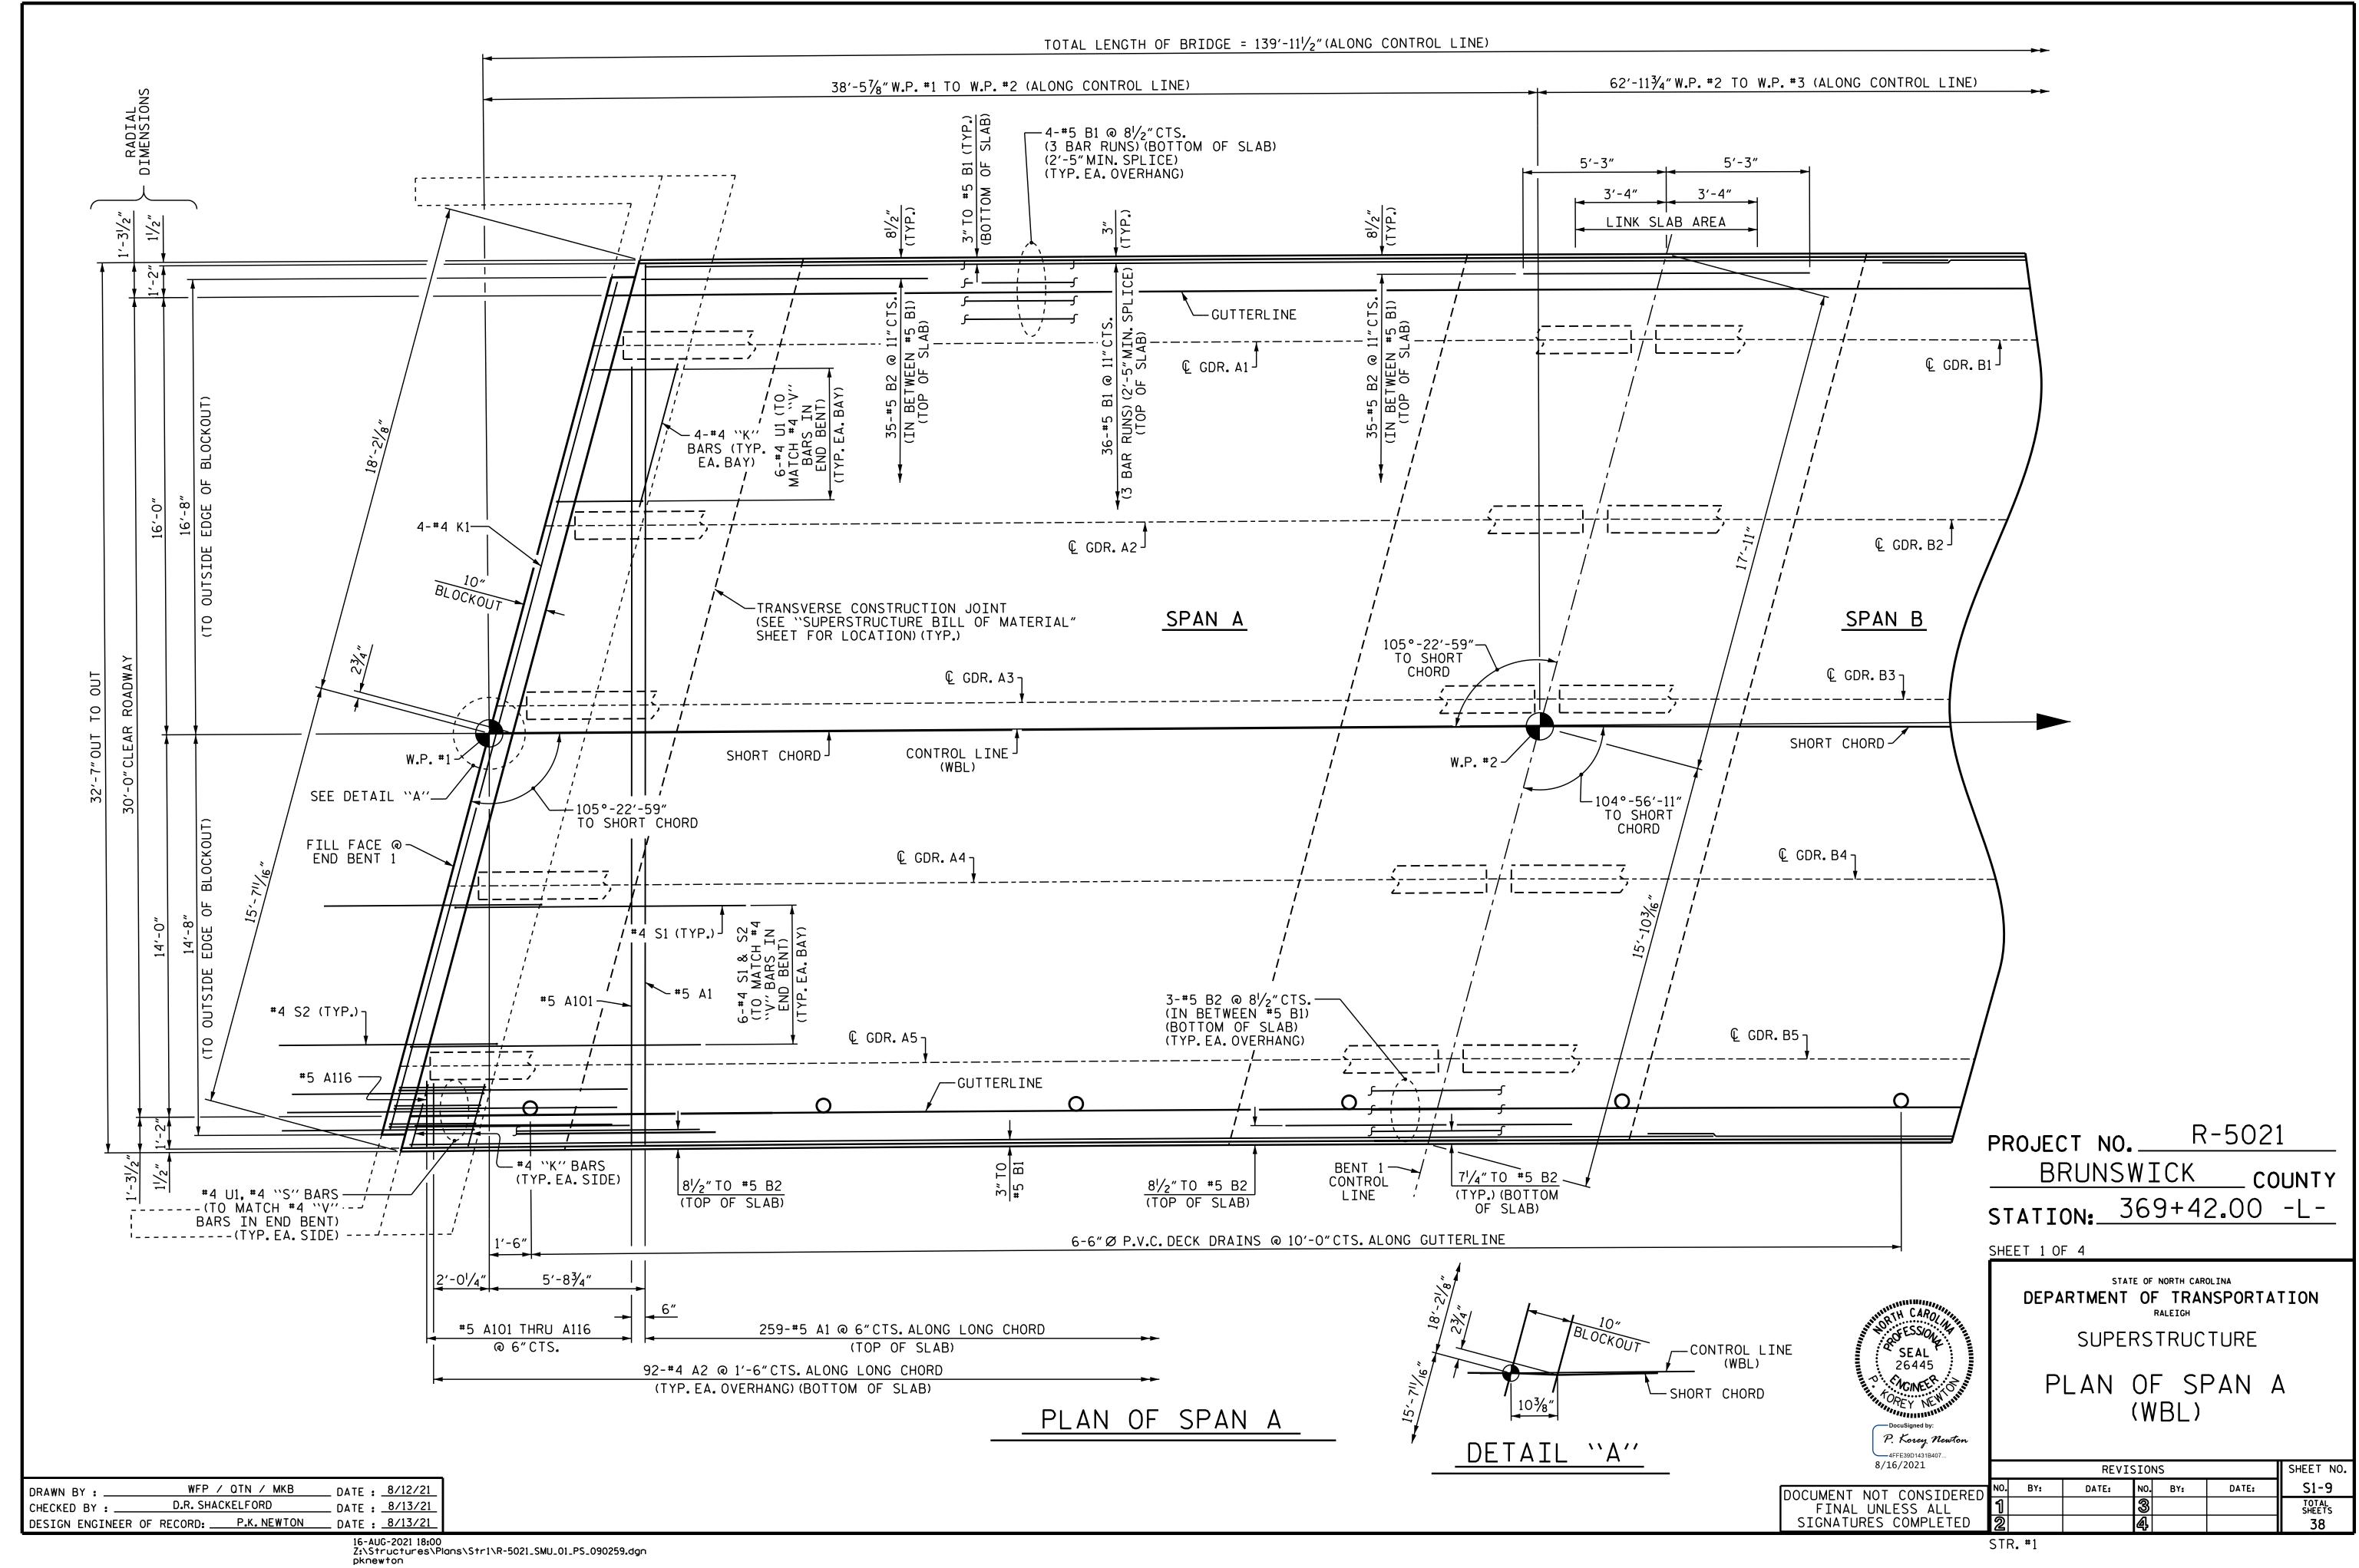

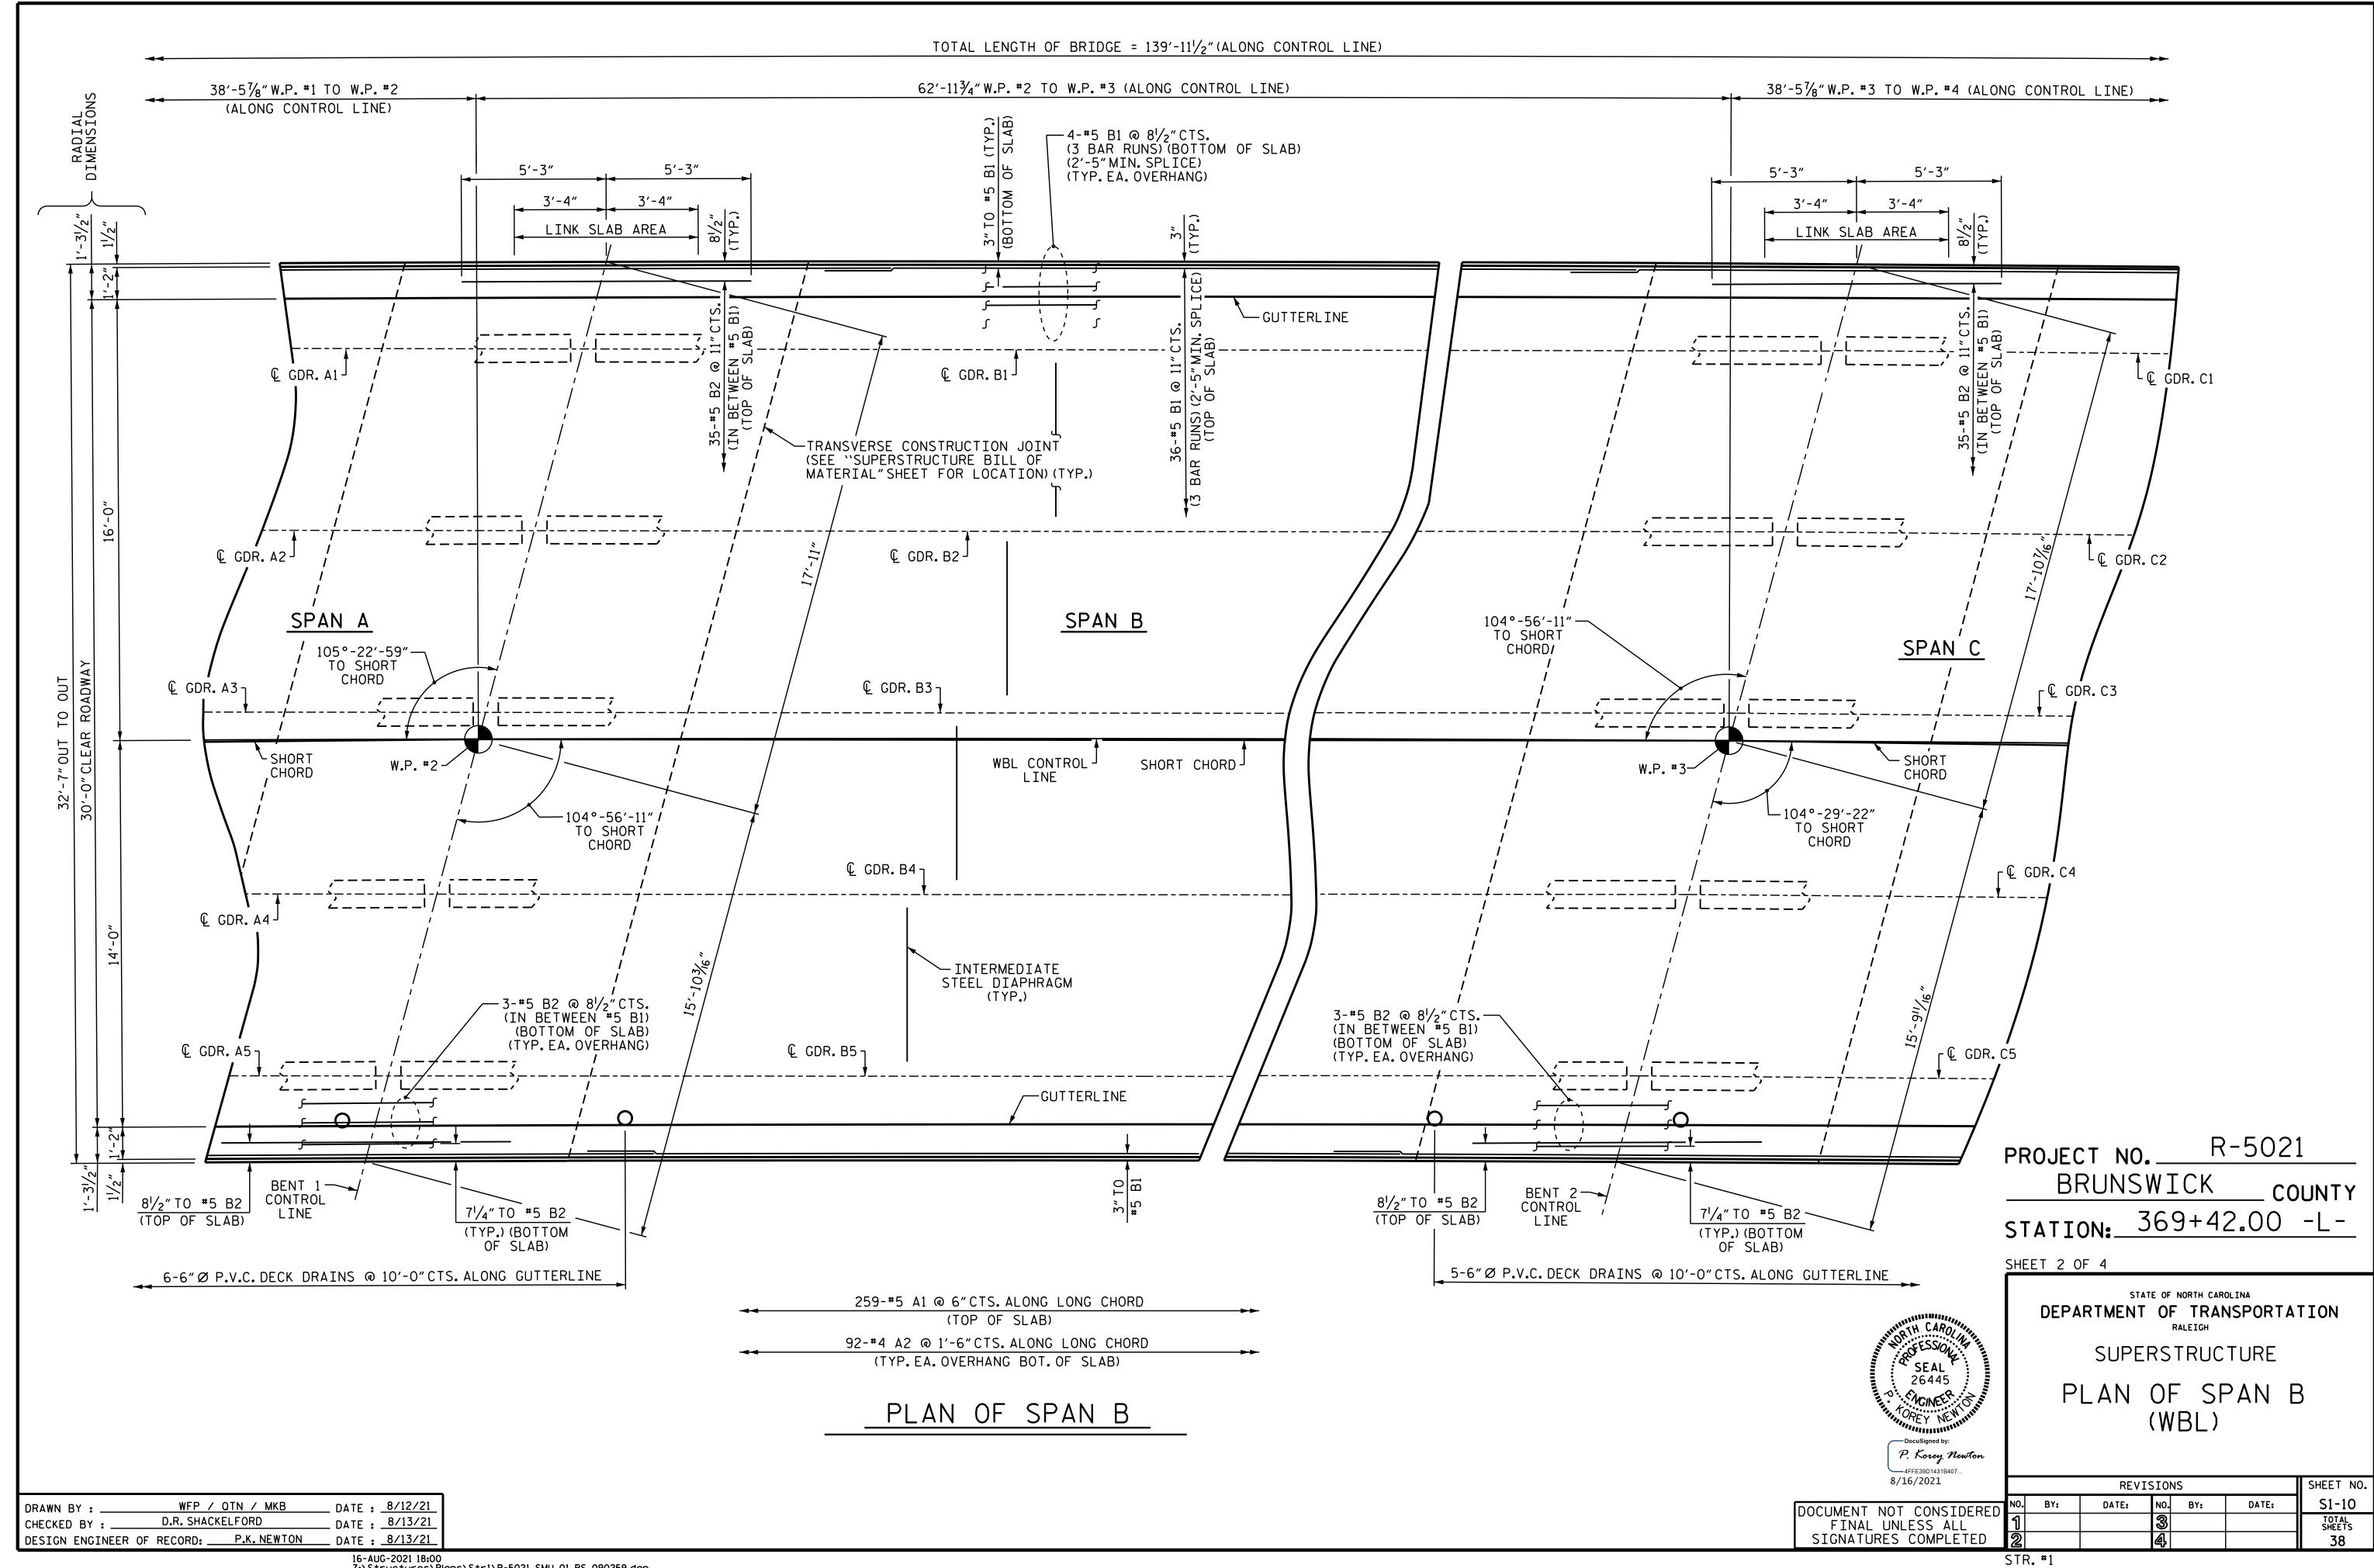


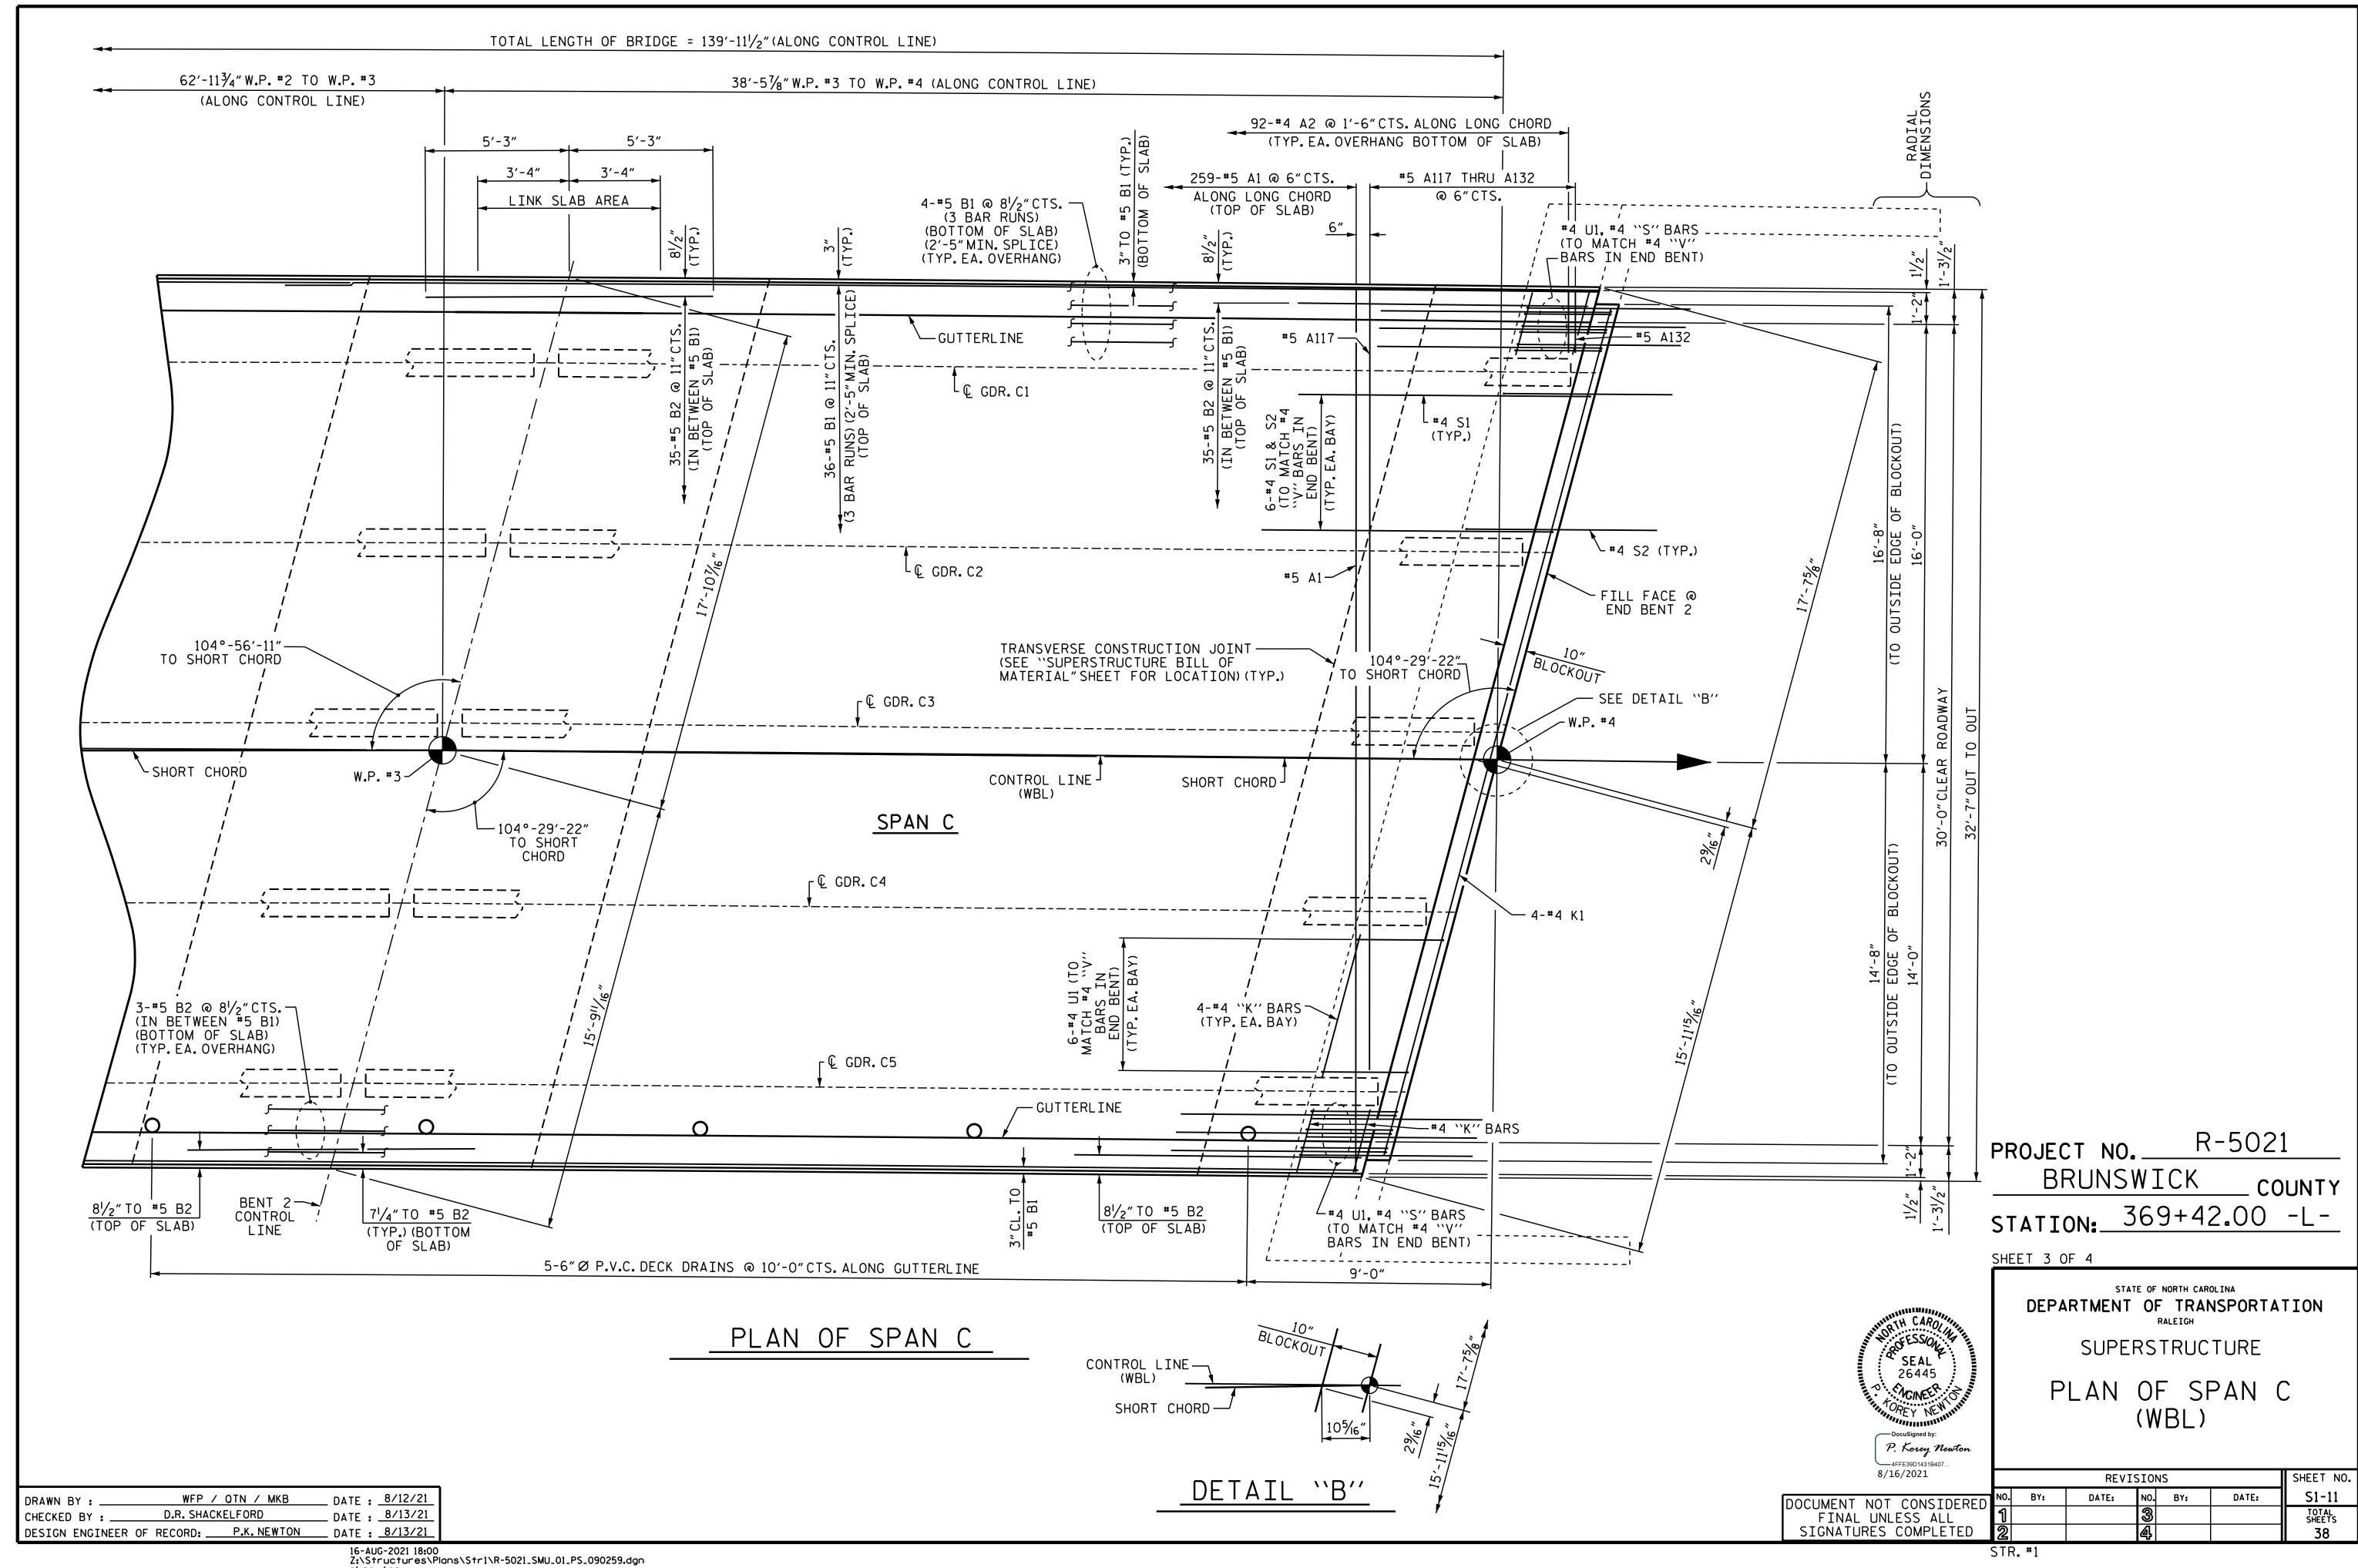

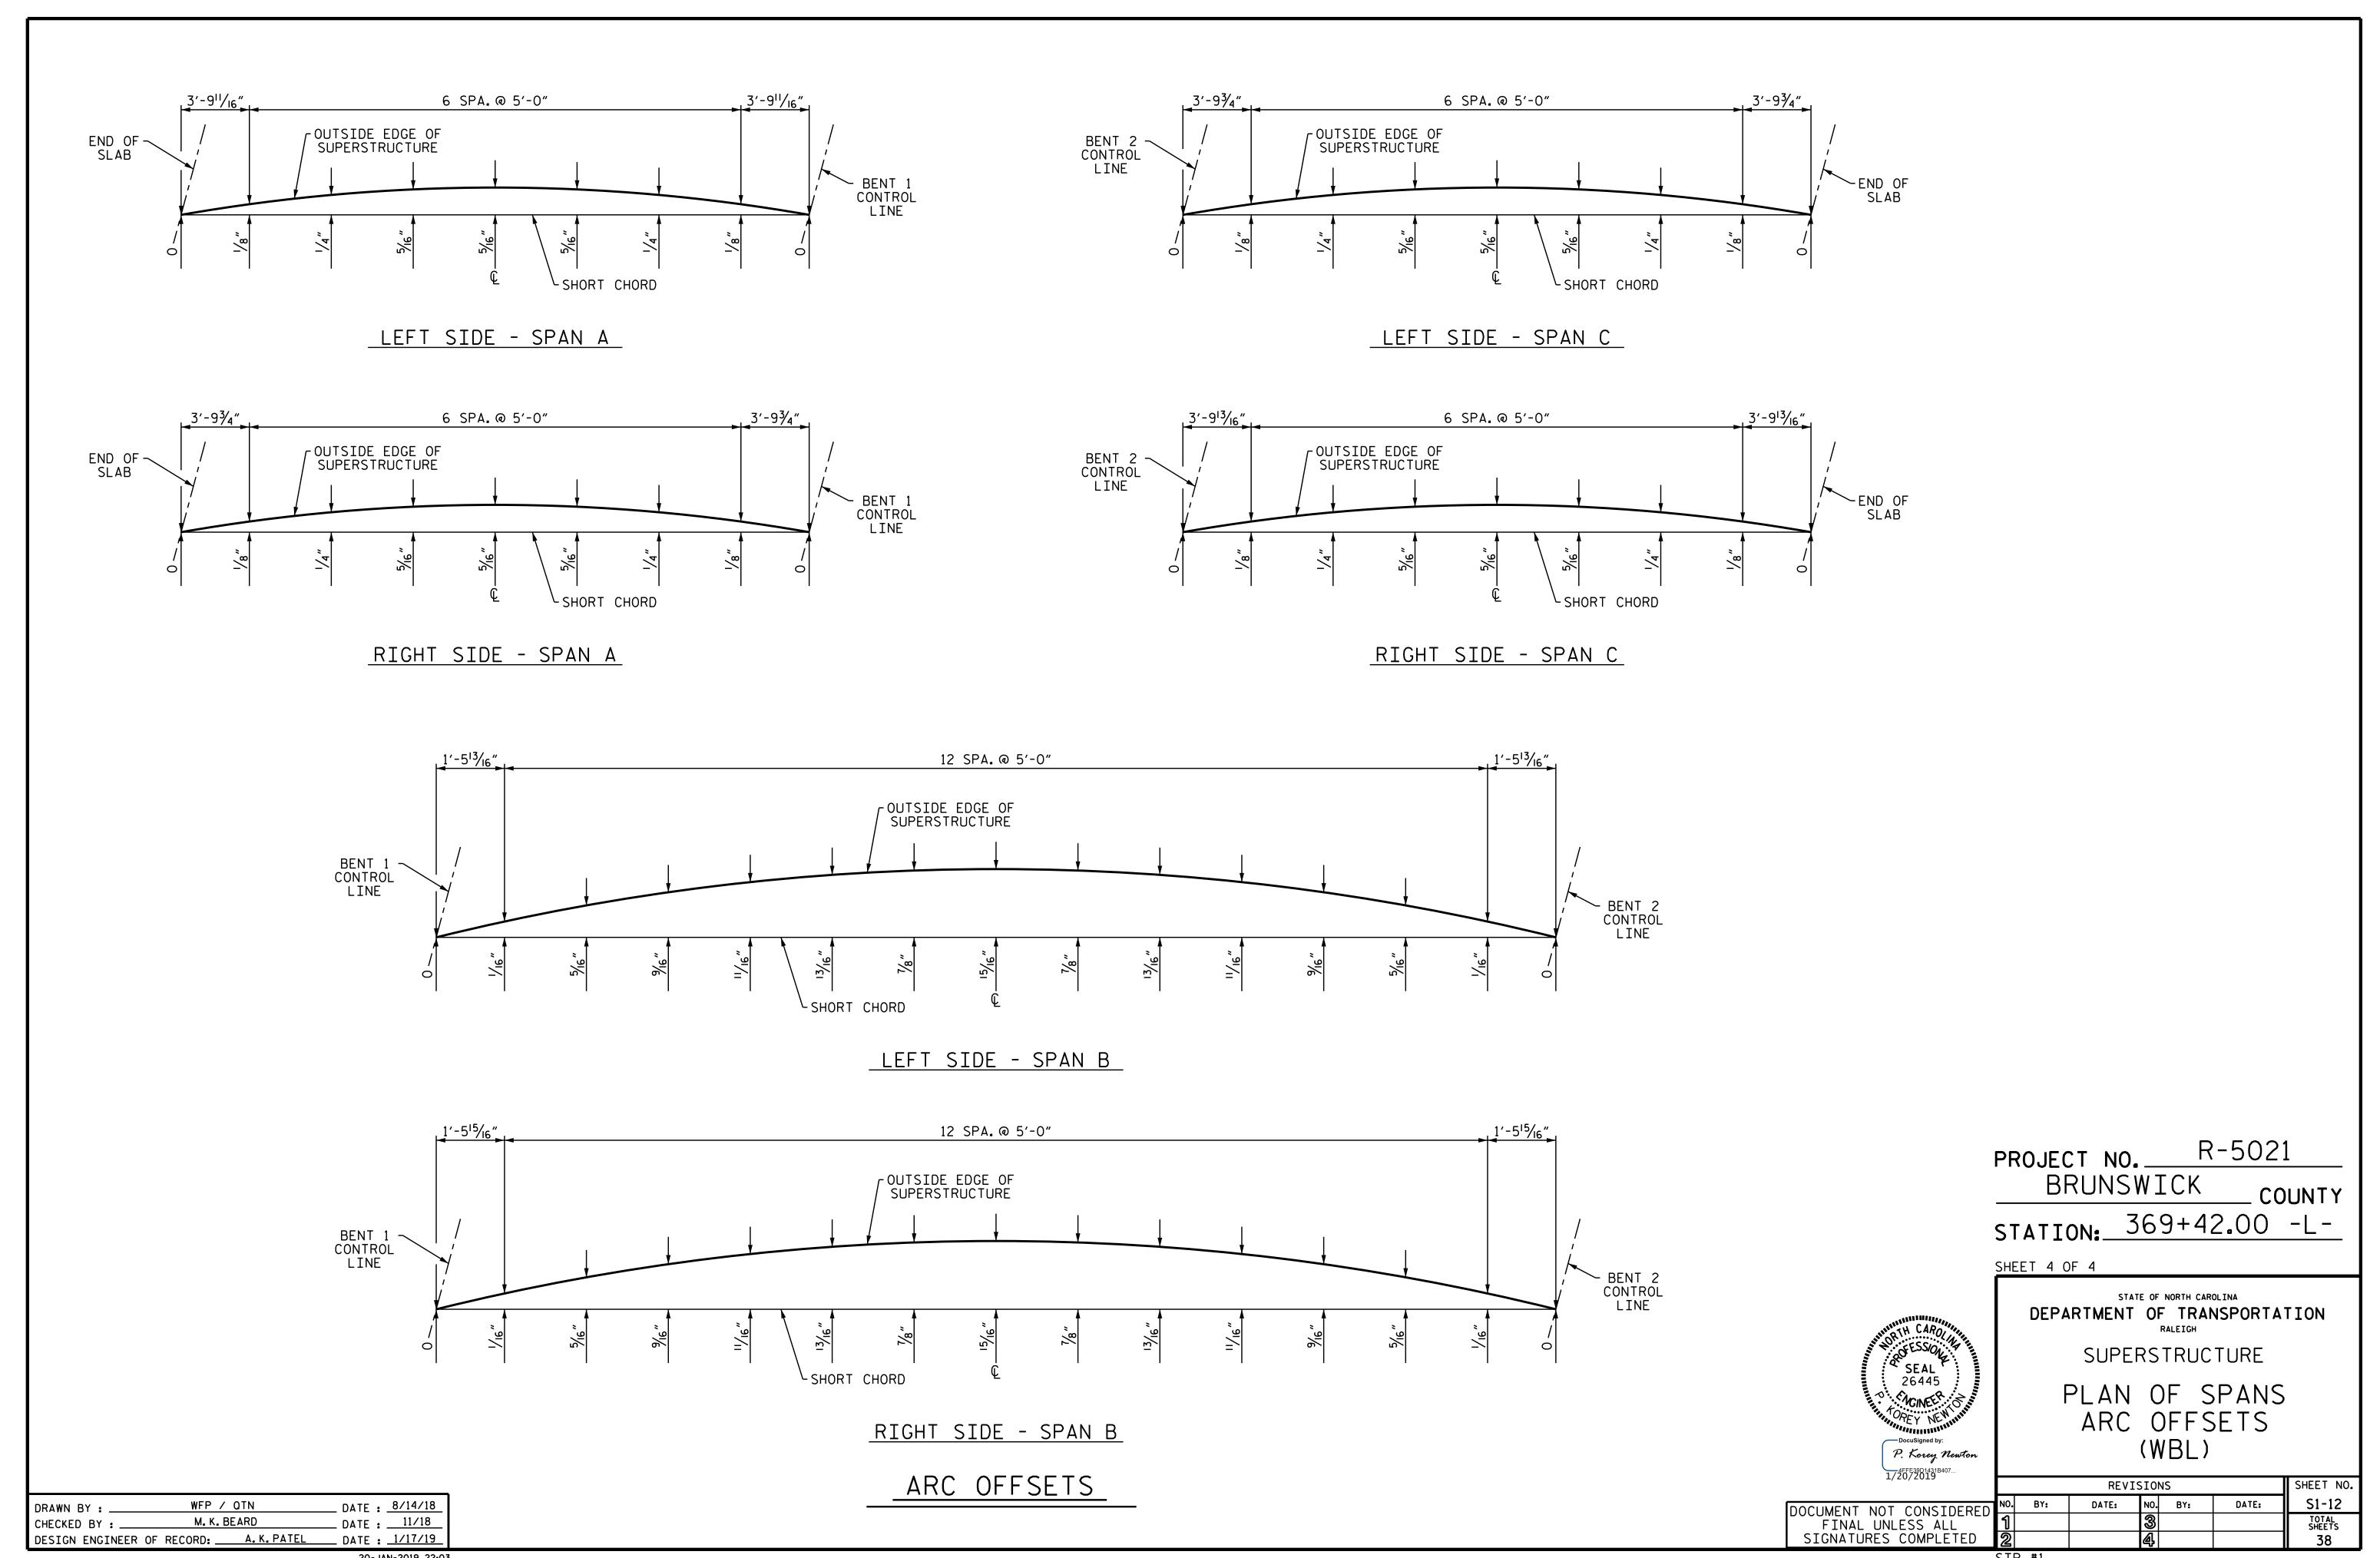

20-JAN-2019 22:03 Z:\Structures\Plans\Str1\R-5021_SMU_01_PS_090259.dgn pknewton

STR. ¹

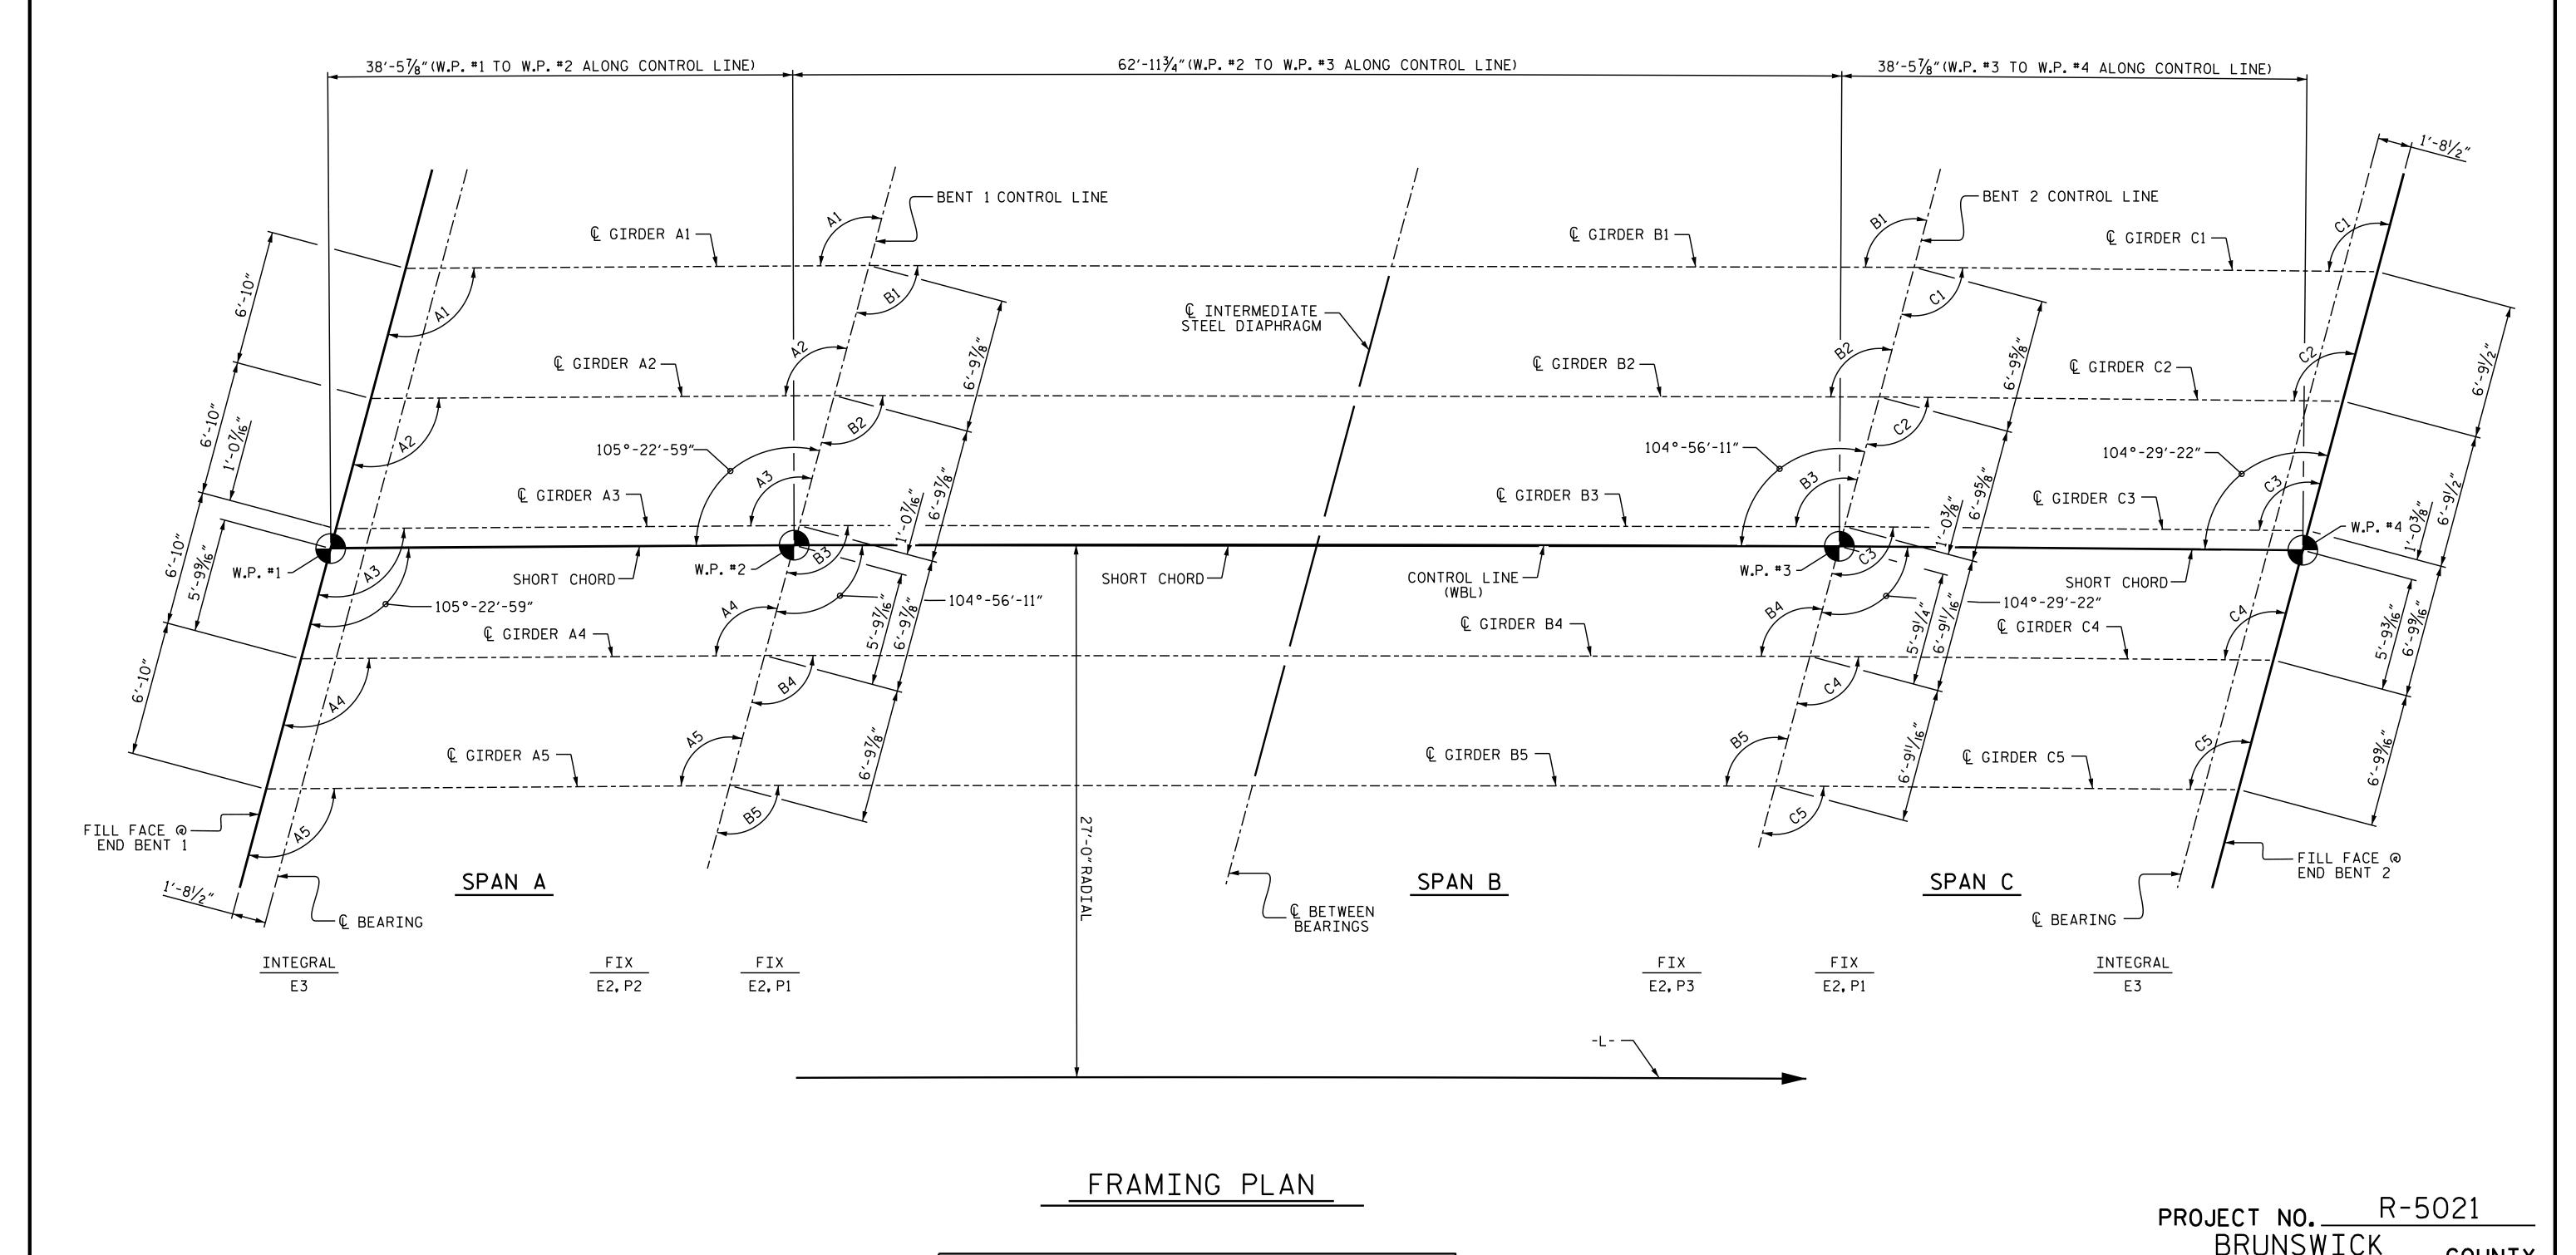

SKEW ANGLES										
SPAN A SPAN B SPAN C										
Α1	105°-20′-56″	B1	104°-54′-11″	C1	104°-27′-27"					
Α2	105°-21′-53″	B2	104°-55′-07"	C2	104°-28′-20″					
Α3	105°-22′-50″	В3	104°-56′-02″	С3	104°-29′-14″					
۸4	105°-23′-48″	B4	104°-56′-58″	C4	104°-30′-08″					
A5	105°-24′-45"	B5	104°-57′-54″	C5	104°-31′-02″					

BRUNSWICK _ COUNTY

STATION: 369+42.00 -L-

Et J. W. ayou

DEPARTMENT OF TRANSPORTATION
RALEIGH SUPERSTRUCTURE


STATE OF NORTH CAROLINA


FRAMING PLAN (WBL)

1/23/2019 DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS SHEET NO. S1-13 DATE: STR. #1


WFP / QTN _ DATE : <u>8/14/18</u> DRAWN BY : _ DATE : 11/18
DATE : 1/10/19 M.K.BEARD CHECKED BY : ___ DESIGN ENGINEER OF RECORD: A.K.PATEL

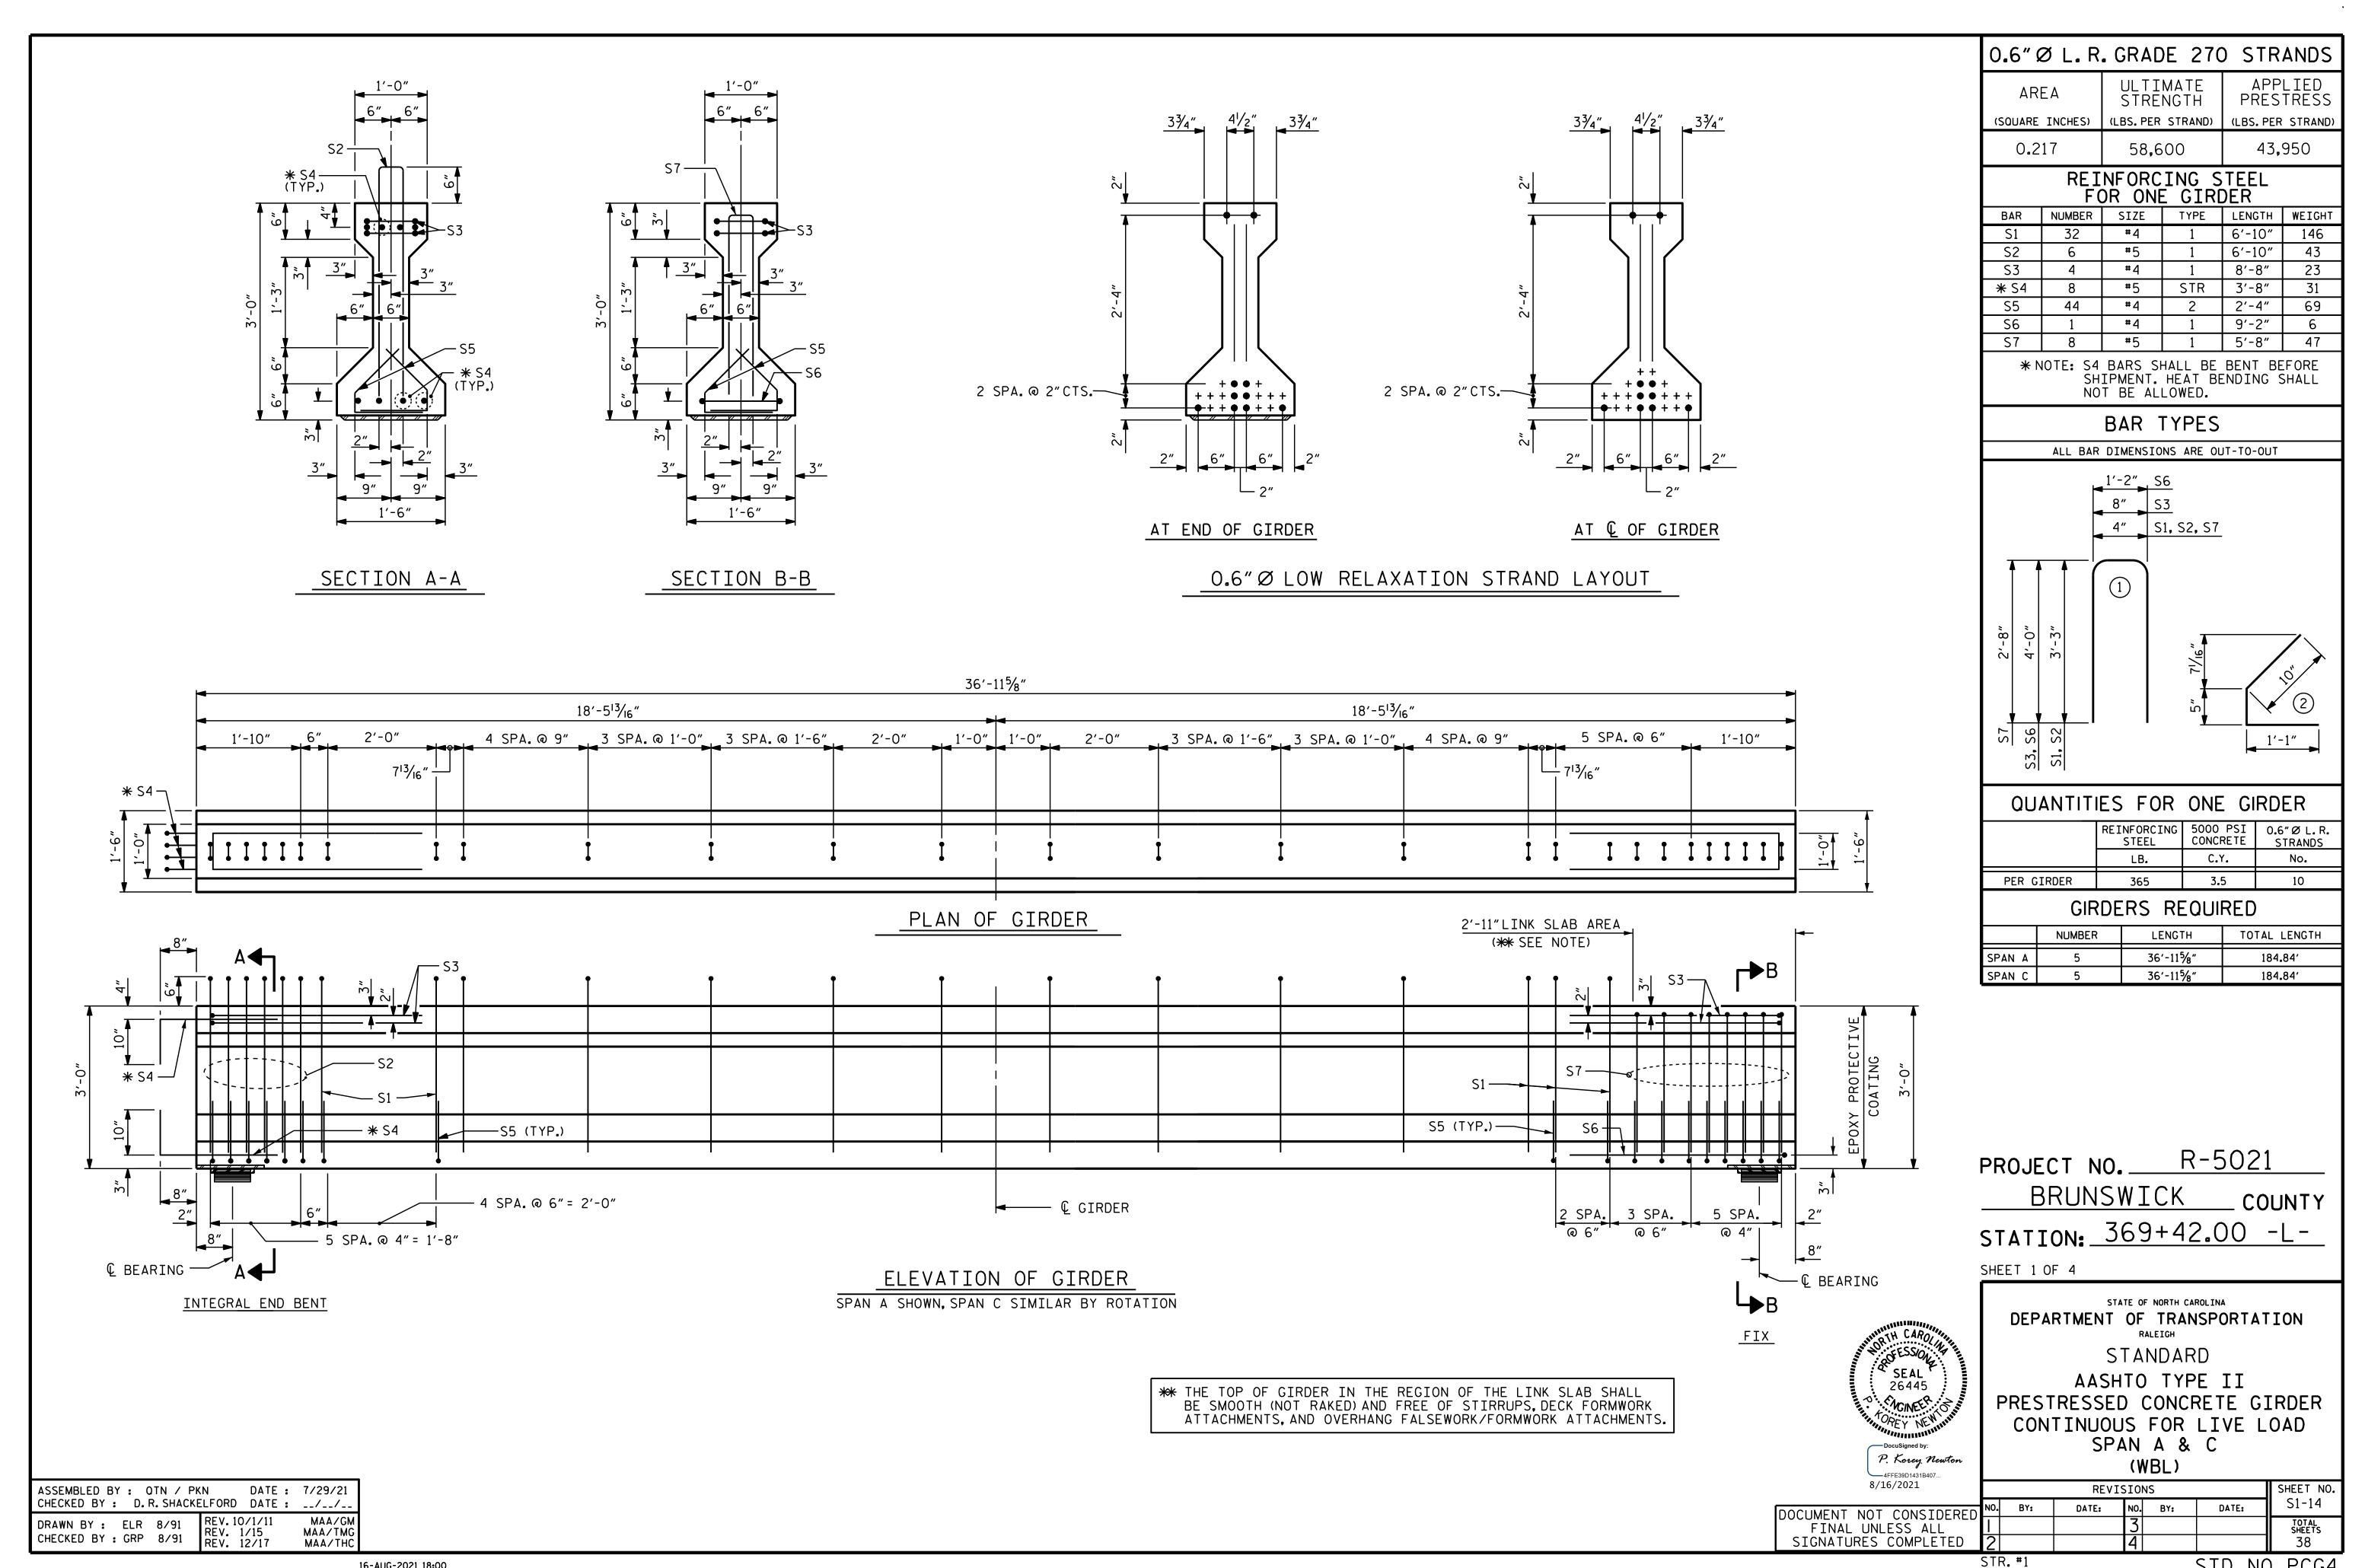

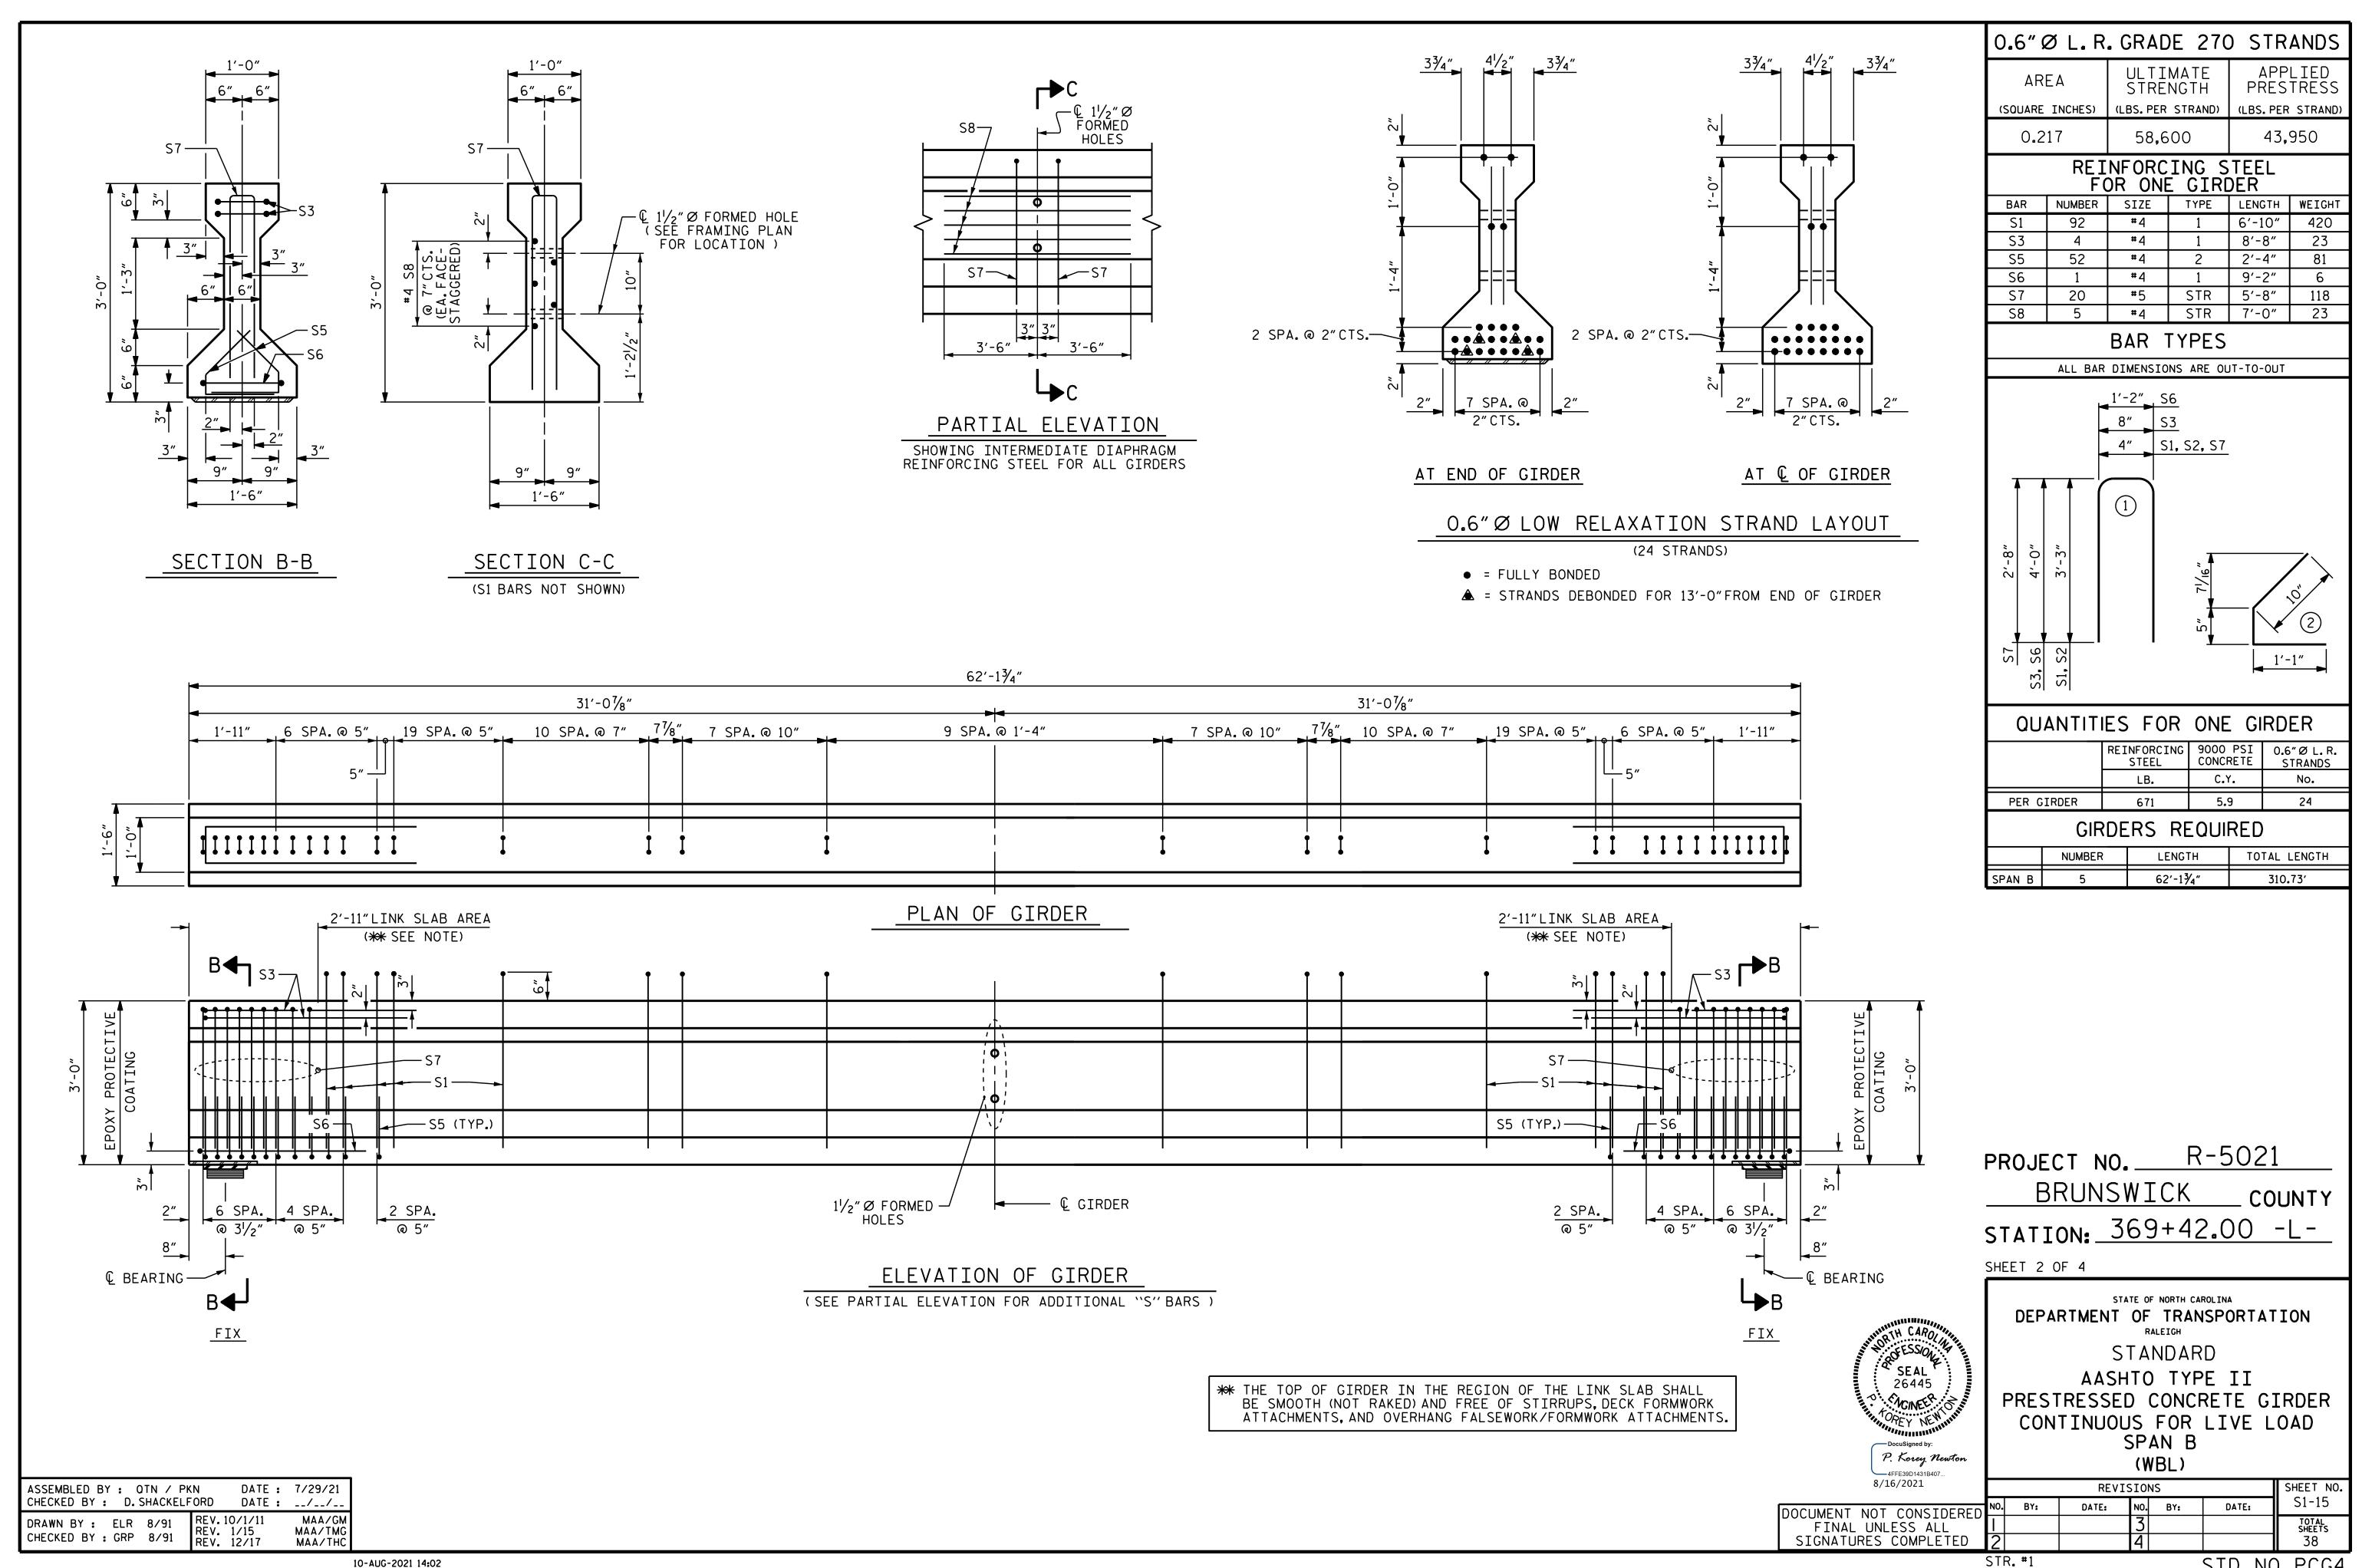

————DEAD LOAD DEFLECTION TABLE FOR GIRDERS———											
SPANS A & C											
0.6"Ø LOW RELAXATION					GIRD	ERS 1	& 5				
TENTH POINTS	0	.1	. 2	.3	. 4	. 5	. 6	.7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.010	0.019	0.026	0.031	0.033	0.031	0.026	0.019	0.010	0
* DEFLECTION DUE TO SUPERIMPOSED D.L. ↓	0	0.004	0.008	0.010	0.012	0.013	0.012	0.010	0.008	0.004	0
FINAL CAMBER	0	1/16"	1/8"	3/16"	1/4"	1/4"	1/4"	³ / ₁₆ "	1/8"	1/16"	0
SPANS A & C											
O.6" Ø LOW RELAXATION GIRDERS 2 - 4											
TENTH POINTS	0	.1	. 2	. 3	. 4	. 5	.6	.7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.010	0.019	0.026	0.031	0.033	0.031	0.026	0.019	0.010	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	0	0.004	0.007	0.010	0.012	0.012	0.012	0.010	0.007	0.004	0
FINAL CAMBER	0	1/16"	1/8"	3/16"	1/4"	1/4"	1/4"	3/16"	1/8"	1/16"	0
	_	SPAI	N B								
0.6" Ø LOW RELAXATION					GIRD	ERS 1	& 5				
TENTH POINTS	0	.1	. 2	. 3	. 4	. 5	.6	.7	. 8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.049	0.093	0.127	0.149	0.157	0.149	0.127	0.093	0.049	0
* DEFLECTION DUE TO SUPERIMPOSED D.L. ↓	0	0.026	0.048	0.066	0.077	0.081	0.077	0.066	0.048	0.026	0
FINAL CAMBER	0	5/16"	9/16"	3/4"	7/8"	7/8"	7/8"	3/4"	9/16"	5/16″	0
		SPAI	N B								
0.6"Ø LOW RELAXATION					GIRD	ERS 2	- 4				
TENTH POINTS	0	.1	.2	. 3	.4	. 5	. 6	. 7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.049	0.093	0.127	0.149	0.157	0.149	0.127	0.093	0.049	0
* DEFLECTION DUE TO SUPERIMPOSED D.L. ↓	0	0.025	0.048	0.065	0.076	0.080	0.076	0.065	0.048	0.025	0
FINAL CAMBER	0	5/16"	9/16"	3/4"	7⁄8"	¹⁵ / ₁₆ "	⁷ /8″	3/4"	9/16"	⁵ /16″	0

^{*} INCLUDES FUTURE WEARING SURFACE ALL VALUES ARE SHOWN IN FEET (DECIMAL FORM), EXCEPT "FINAL CAMBER", WHICH IS GIVEN IN INCHES (FRACTION FORM).

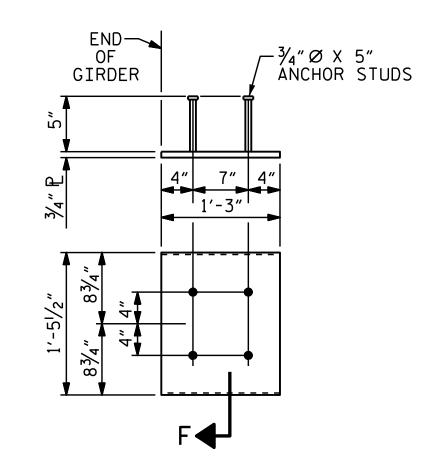

EMBEDDED PLATE "B-1" DETAILS FOR AASHTO TYPE II GIRDER

→ ¾"BEVEL EDG

SECTION "F"

(SEE NOTES)

ASSEMBLED BY: WFP / QTN DATE: 8/14/18 CHECKED BY: M.K.BEARD DATE: 11/18

DRAWN BY: ELR 11/91 REV. 1/15 MAA/TMG REV. 2/15 REV. 2/15 REV. 12/17 MAA/THC

NOTES

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M2O3 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL SHALL BE GRADE 60.

APPLY EPOXY PROTECTIVE COATING TO END OF GIRDER SURFACES INDICATED IN ELEVATION VIEW.

EMBEDDED PLATE 'B-1" SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ANCHOR STUDS SHALL CONFORM TO AASHTO M169 GRADES 1010 THROUGH 1020 OR APPROVED EQUAL, AND SHALL MEET THE TYPE "B" REQUIREMENTS OF SUBSECTION 7.3 OF THE ANSI/AASHTO/AWS D1.5 BRIDGE WELDING CODE.

AT ENDS OF GIRDERS TO BE EMBEDDED IN CONCRETE DIAPHRAGMS OR END WALLS, PRESTRESSING STRANDS MAY EXTEND A MAXIMUM OF 2"BEYOND THE GIRDER ENDS. OTHERWISE, PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE GIRDER ENDS.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE GIRDER SHALL BE DONE WHEN CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 4000 PSI FOR SPANS A AND C, AND 7400 PSI FOR SPAN B.

THE TOP SURFACE OF THE GIRDER, EXCLUDING THE OUTSIDE 4", SHALL BE RAKED TO A DEPTH OF $\frac{1}{4}$ ".

PRESTRESSED CONCRETE GIRDERS SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

PRESTRESSED CONCRETE GIRDERS ARE DESIGNED FOR O PSI TENSION IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SHEET 3 OF 4

PREST

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION
RALEIGH

STANDARD

PRESTRESSED CONCRETE GIRDER
CONTINUOUS FOR LIVE LOAD
DETAILS
(WBL)


T/20/2019 REVISIONS

REVISIONS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2


P. Korey Newton


S1-16

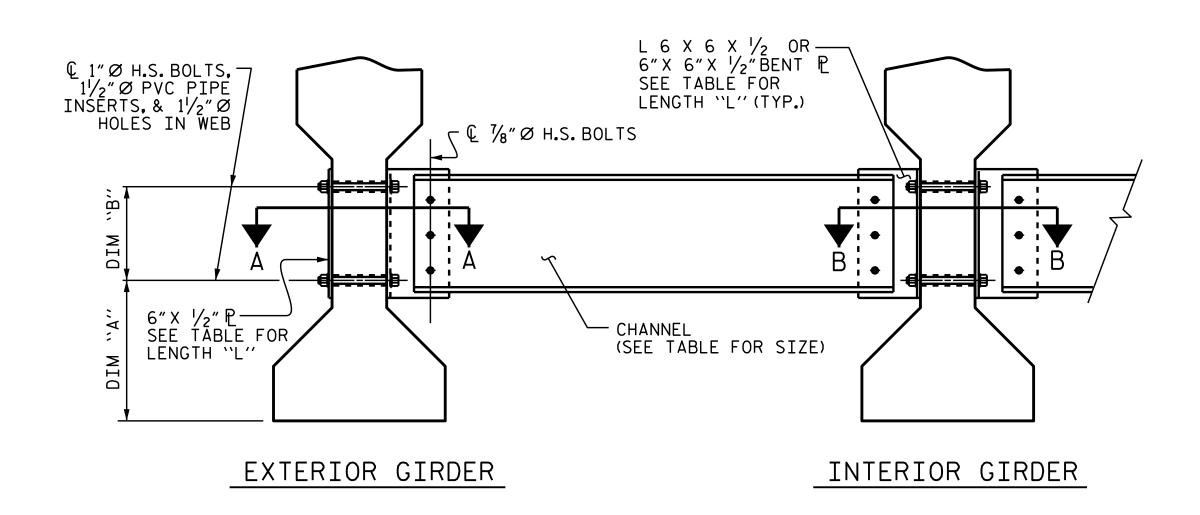

(TYPE II GIRDER SHOWN)

SECTION AT INTERMEDIATE DIAPHRAGM

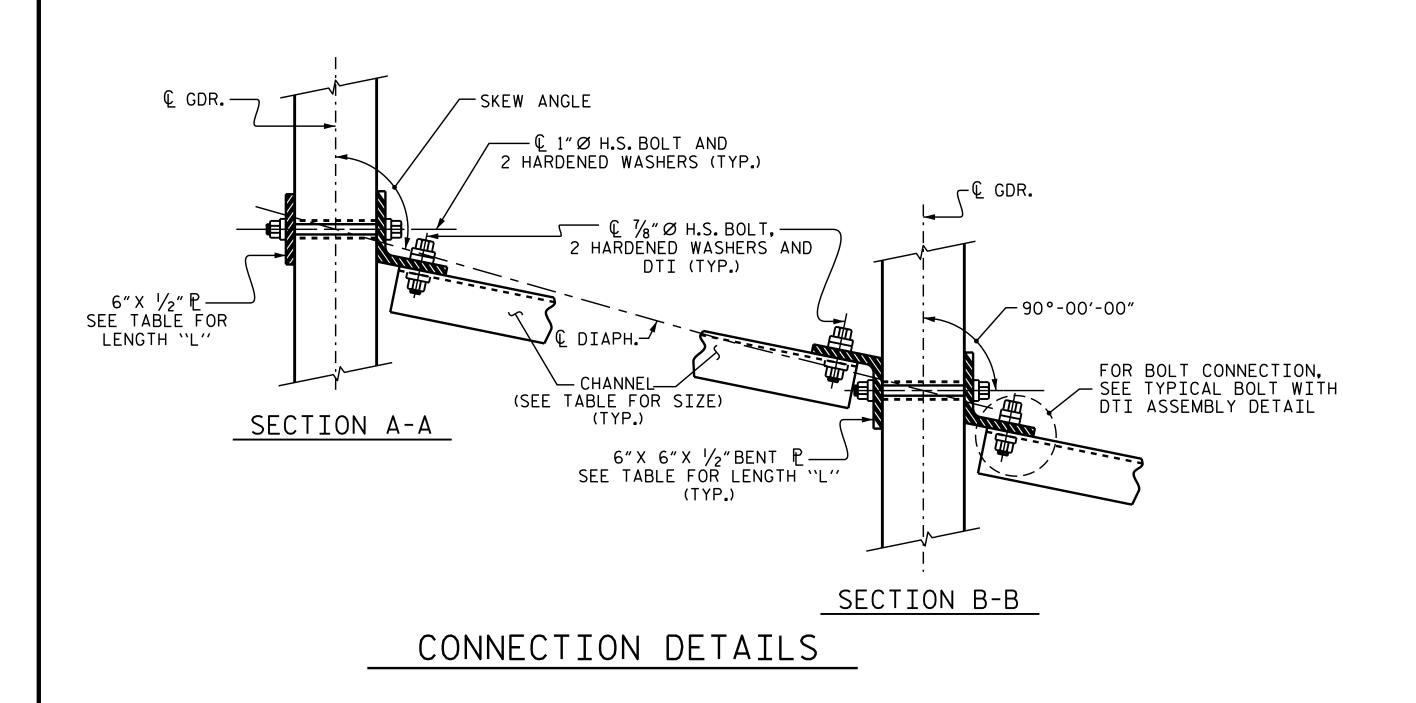

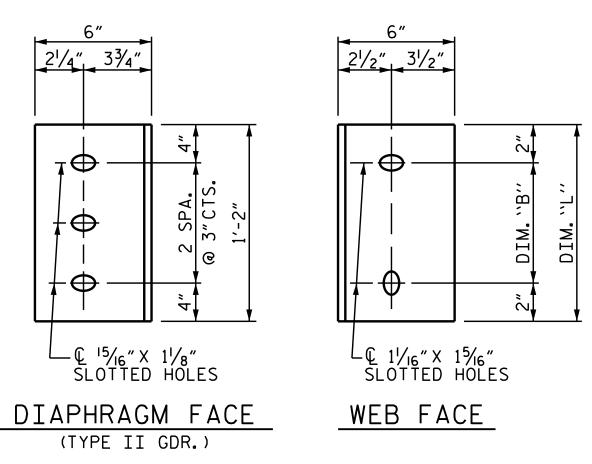

CONNECTOR PLATE DETAILS

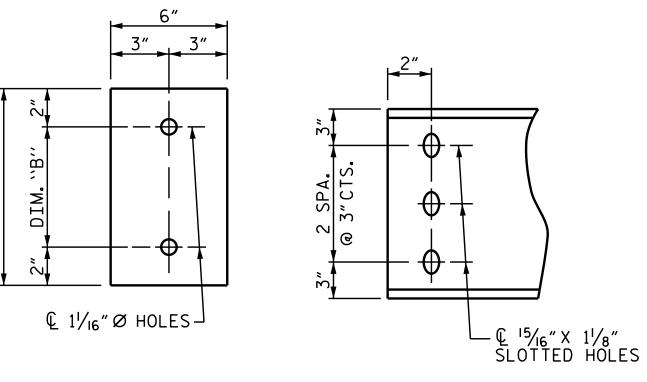


PLATE DETAILS

CHANNEL END (TYPE II GDR.)

TABLE

STRUCTURAL STEEL NOTES

ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

AASHTO M270 GRADE 50 OR APPROVED EQUAL.

UNDER EACH BOLT HEAD AND NUT.

OF THE STANDARD SPECIFICATIONS.

IN PLACE 3 DAYS AFTER CONCRETE IS PLACED.

FOR DISTRIBUTION.

GIRDERS.

ALL INTERMEDIATE DIAPHRAGM STEEL AND CONNECTOR PLATES SHALL BE

SHALL BE CALIBRATED USING DIRECT TENSION INDICATOR WASHERS IN

THE PLATES, BENT PLATES, CHANNELS, AND ANGLES SHALL BE METALLIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. FOR THERMAL

FOR METALLIZATION, APPLY AN 8 MIL THICK 99.99 PERCENT PERCENT 1350

SEAL COAT TO ALL PLATES, BENT PLATES, CHANNELS, ANGLES, AND PLATE WASHERS IN ACCORDANCE WITH THE THERMAL SPRAYED COATINGS SPECIAL

GALVANIZE THE HIGH STRENGTH BOLTS, NUTS, WASHERS AND DIRECT TENSION

USE AN ASTM F436 HARDENED WASHER WITH STANDARD AND SLOTTED HOLES

FOR BOLTS THROUGH THE GIRDER WEB, PROVIDE SUFFICIENT LENGTH OF THREADS ON ALL BOLTS TO ACCOMMODATE WASHERS AND THE THICKNESS

OF CONNECTING MEMBER PLUS AT LEAST 1/4" PROJECTION BEYOND THE NUT.

INTERMEDIATE DIAPHRAGM ASSEMBLY SHALL COMPLY WITH SECTION 1072

IN THE EXTERIOR BAYS, PLACE TEMPORARY STRUTS BETWEEN PRESTRESSED GIRDERS ADJACENT TO THE STEEL DIAPHRAGMS. STRUTS SHALL REMAIN

SUBMIT TWO SETS OF WORKING DRAWINGS FOR THE INTERMEDIATE DIAPHRAGM ASSEMBLY FOR REVIEW. COMMENTS AND ACCEPTANCE. AFTER REVIEW, COMMENTS, AND ACCEPTANCE, SUBMIT SEVEN SETS

THE COST OF THE STEEL DIAPHRAGMS AND ASSEMBLIES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE

ALUMINUM (W-A1-1350) THERMAL SPRAYED COATING WITH A 0.5 MIL THICK

TENSION ON THE ASTM A449 BOLTS THROUGH THE GIRDER WEB SHALL

BE SNUG TIGHTENED FOLLOWED BY AN ADDITIONAL $\frac{1}{4}$ TURN.

SPRAYED COATINGS (METALLIZATION), SEE SPECIAL PROVISIONS.

PROVISION AND SECTION 442 OF THE STANDARD SPECIFICATIONS.

INDICATORS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

TENSION ON THE ASTM A325 BOLTS THROUGH THE CHANNEL MEMBER

GIRDER TYPE	CHANNEL SIZE	DIM "A"	DIM "B"	DIM "L"	
II	MC 12 × 31	1'-21/2"	10"	1'-2"	

BOLT THROUGH GIRDER WEB NUT (TURNED ELEMENT) --HARDENED WASHER BOLT WITH DTI ASSEMBLY DETAIL

BRUNSWICK STATION: 369+42.00 -L-

SHEET 4 OF 4

PROJECT NO.

26445 : NOINEE P. Korey Newton

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD INTERMEDIATE CONCRETE GIRDERS

R-5021

COUNTY

SHEET NO

S1-17

(WBL) 1/20/2019 REVISIONS DATE:

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

20-JAN-2019 22:04 Z:\Structures\Plans\Str1\R-5021_SMU_01_PCG_090259.dgn

ASSEMBLED BY: WFP / QTN

CHECKED BY : M. K. BEARD

DRAWN BY: TLA 6/05

CHECKED BY : VC 6/05

DATE: 8/14/18

DATE: II/I8


KMM/GN

MAA/GW MAA/THO


REV. 5/I/06RRR

REV. 10/1/11 REV. 12/17

STD. NO. PCG10

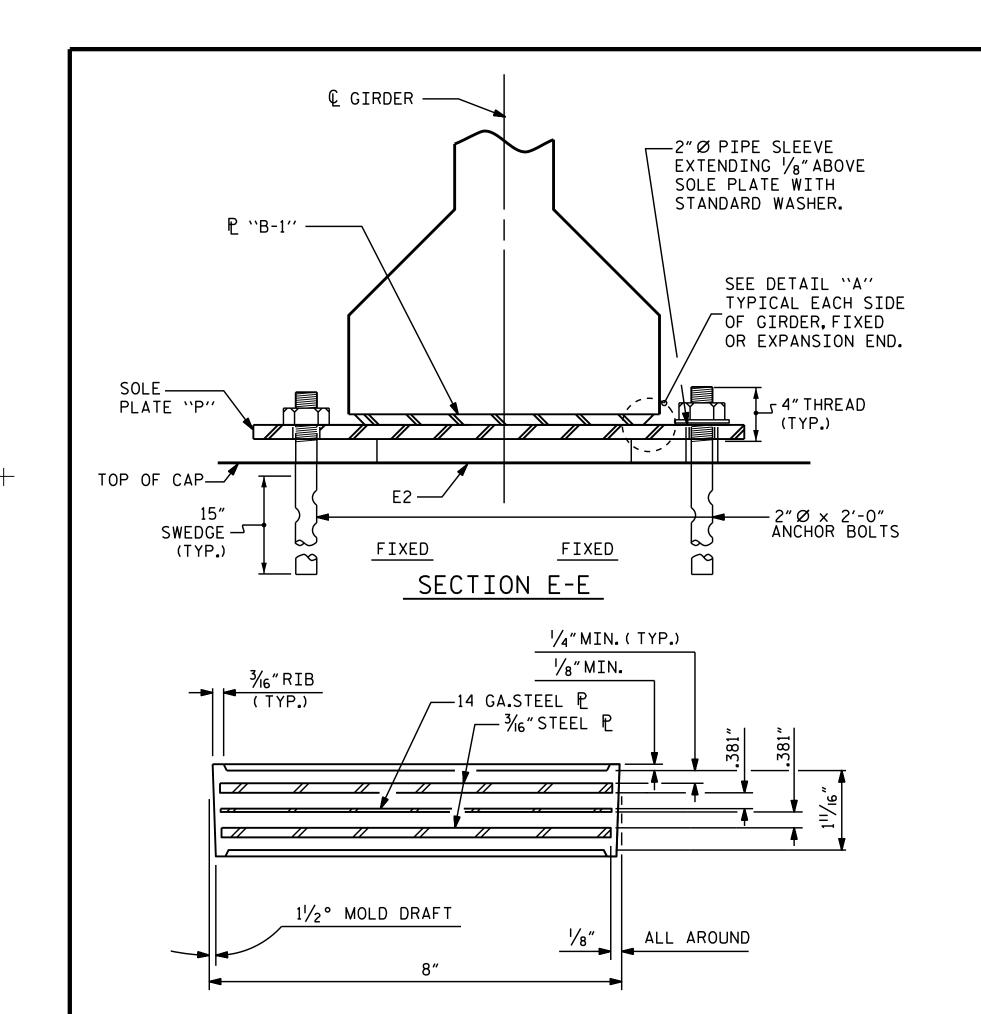

TYPICAL SECTION OF ELASTOMERIC BEARINGS

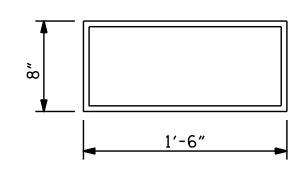

E2 (20 REQ'D)

PLAN VIEW OF ELASTOMERIC BEARING

TYPE III


DETAIL "A"


DATE : 8/14/18
DATE : 11/18


AAC/MAA MAA/TMG MAA/THC

ASSEMBLED BY: WFP / OTN CHECKED BY: M.K.BEARD

DRAWN BY: WJH 8/89 CHECKED BY : CRK 8/89

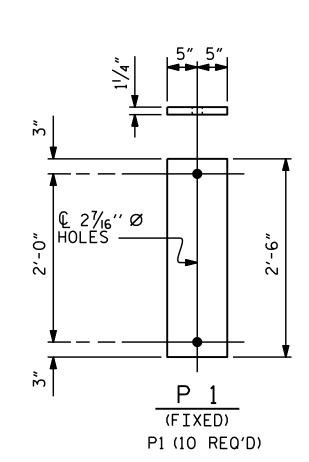

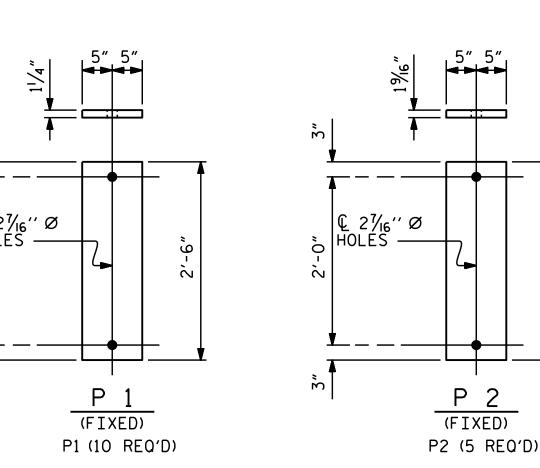


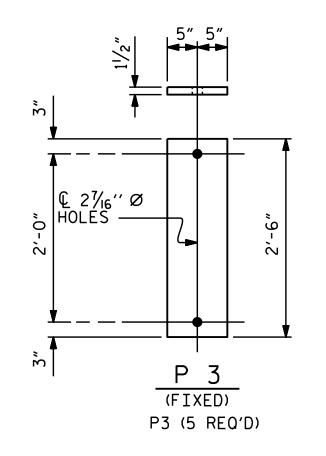


SOLE PLATE DETAILS ("P")

P 2


(FIXED)

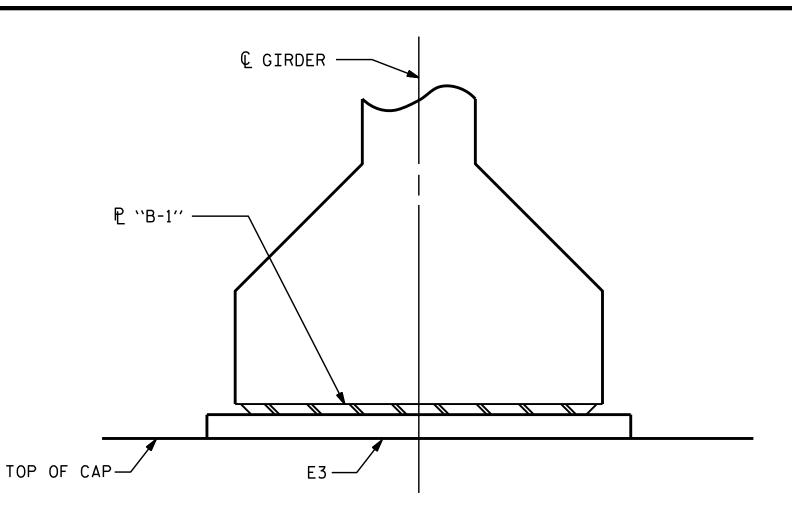

SECTION F-F

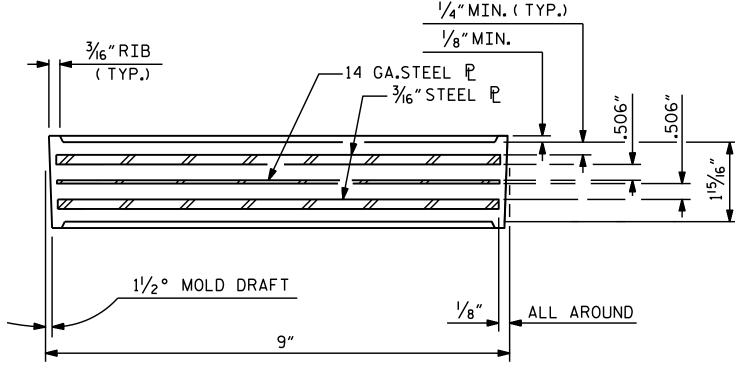


TYPICAL SECTION OF ELASTOMERIC BEARINGS

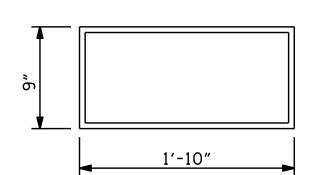

E3 (<u>10</u> REQ'D)

PLAN VIEW OF ELASTOMERIC BEARING

TYPE IV (FOR INTEGRAL END BENTS ONLY)

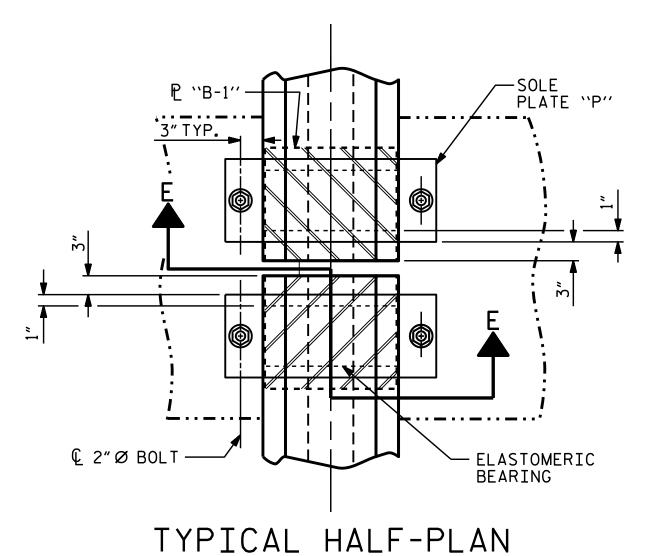

(SHOWING CONTINUOUS BENT)

ELASTOMERIC BEARING ·. _ . . _ · · - · · - · · _ . | . _ · · - · · - · · - · · _ · . _ · · TYPICAL HALF-PLAN

MAXIMUM ALLOWABLE SERVICE LOADS							
D.L.+L.L.(NO IMPACT)							
TYPE III	205 k						
TYPE IV 225 k							

(SHOWING INTEGRAL END BENT)

NOTES

AT ALL FIXED POINTS OF SUPPORT, NUTS FOR ANCHOR BOLTS ARE TO BE TIGHTENED FINGER TIGHT AND THEN BACKED OFF 1/2 TURN. THE THREAD OF THE NUT AND BOLT SHALL THEN BE BÜRRED WITH A SHARP POINTED TOOL.

THE 2"Ø PIPE SLEEVE SHALL BE CUT FROM SCHEDULE 40 PVC PLASTIC PIPE. THE PVC PLASTIC PIPE SHALL MEET THE REQUIREMENTS OF ASTM D1785.

STEEL SOLE PLATES, ANCHOR BOLTS, NUTS, AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

PRIOR TO WELDING, GRIND THE GALVANIZED SURFACE OF THE PORTION OF THE EMBEDDED PLATE AND SOLE PLATE THAT ARE TO BE WELDED. AFTER WELDING, DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

WHEN WELDING THE SOLE PLATE TO THE EMBEDDED PLATE IN THE GIRDER, USE TEMPERATURE INDICATING WAX PENS, OR OTHER SUITABLE MEANS, TO ENSURE THAT THE TEMPERATURE OF THE SOLE PLATE DOES NOT EXCEED 300°F. TEMPERATURES ABOVE THIS MAY DAMAGE THE ELASTOMER.

SOLE PLATE "P", BOLTS, NUTS, WASHERS, AND PIPE SLEEVE SHALL BE INCLUDED IN THE PAY ITEM FOR PRESTRESSED CONCRETE GIRDERS.

ANCHOR BOLTS SHALL MEET THE REQUIREMENTS OF ASTM A449. NUTS SHALL MEET THE REQUIREMENTS OF AASHTO M291-DH OR AASHTO M292-2H. WASHERS SHALL MEET THE REQUIREMENTS OF AASHTO M293. SHOP DRAWINGS ARE NOT REQUIRED FOR ANCHOR BOLT, NUTS AND WASHERS. SHOP INSPECTION IS REQUIRED.


ALL SURFACES OF BEARING PLATES SHALL BE SMOOTH AND STRAIGHT.

THE ELASTOMER IN THE STEEL REINFORCED BEARINGS SHALL HAVE A SHEAR MODULUS OF 0.160 KSI, IN ACCORDANCE WITH AASHTO M251.

FOR STEEL REINFORCED ELASTOMERIC BEARINGS, SEE SPECIAL PROVISIONS.

ALL SOLE PLATES SHALL BE AASHTO M270 GRADE 36.

R-5021 PROJECT NO._ BRUNSWICK COUNTY STATION: 369+42.00 -L-



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

STANDARD ELASTOMERIC BEARING


PRESTRESSED CONCRETE GIRDER SUPERSTRUCTURE (WBL)

REVISIONS DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

STR. #1

SHEET NO

S1-18

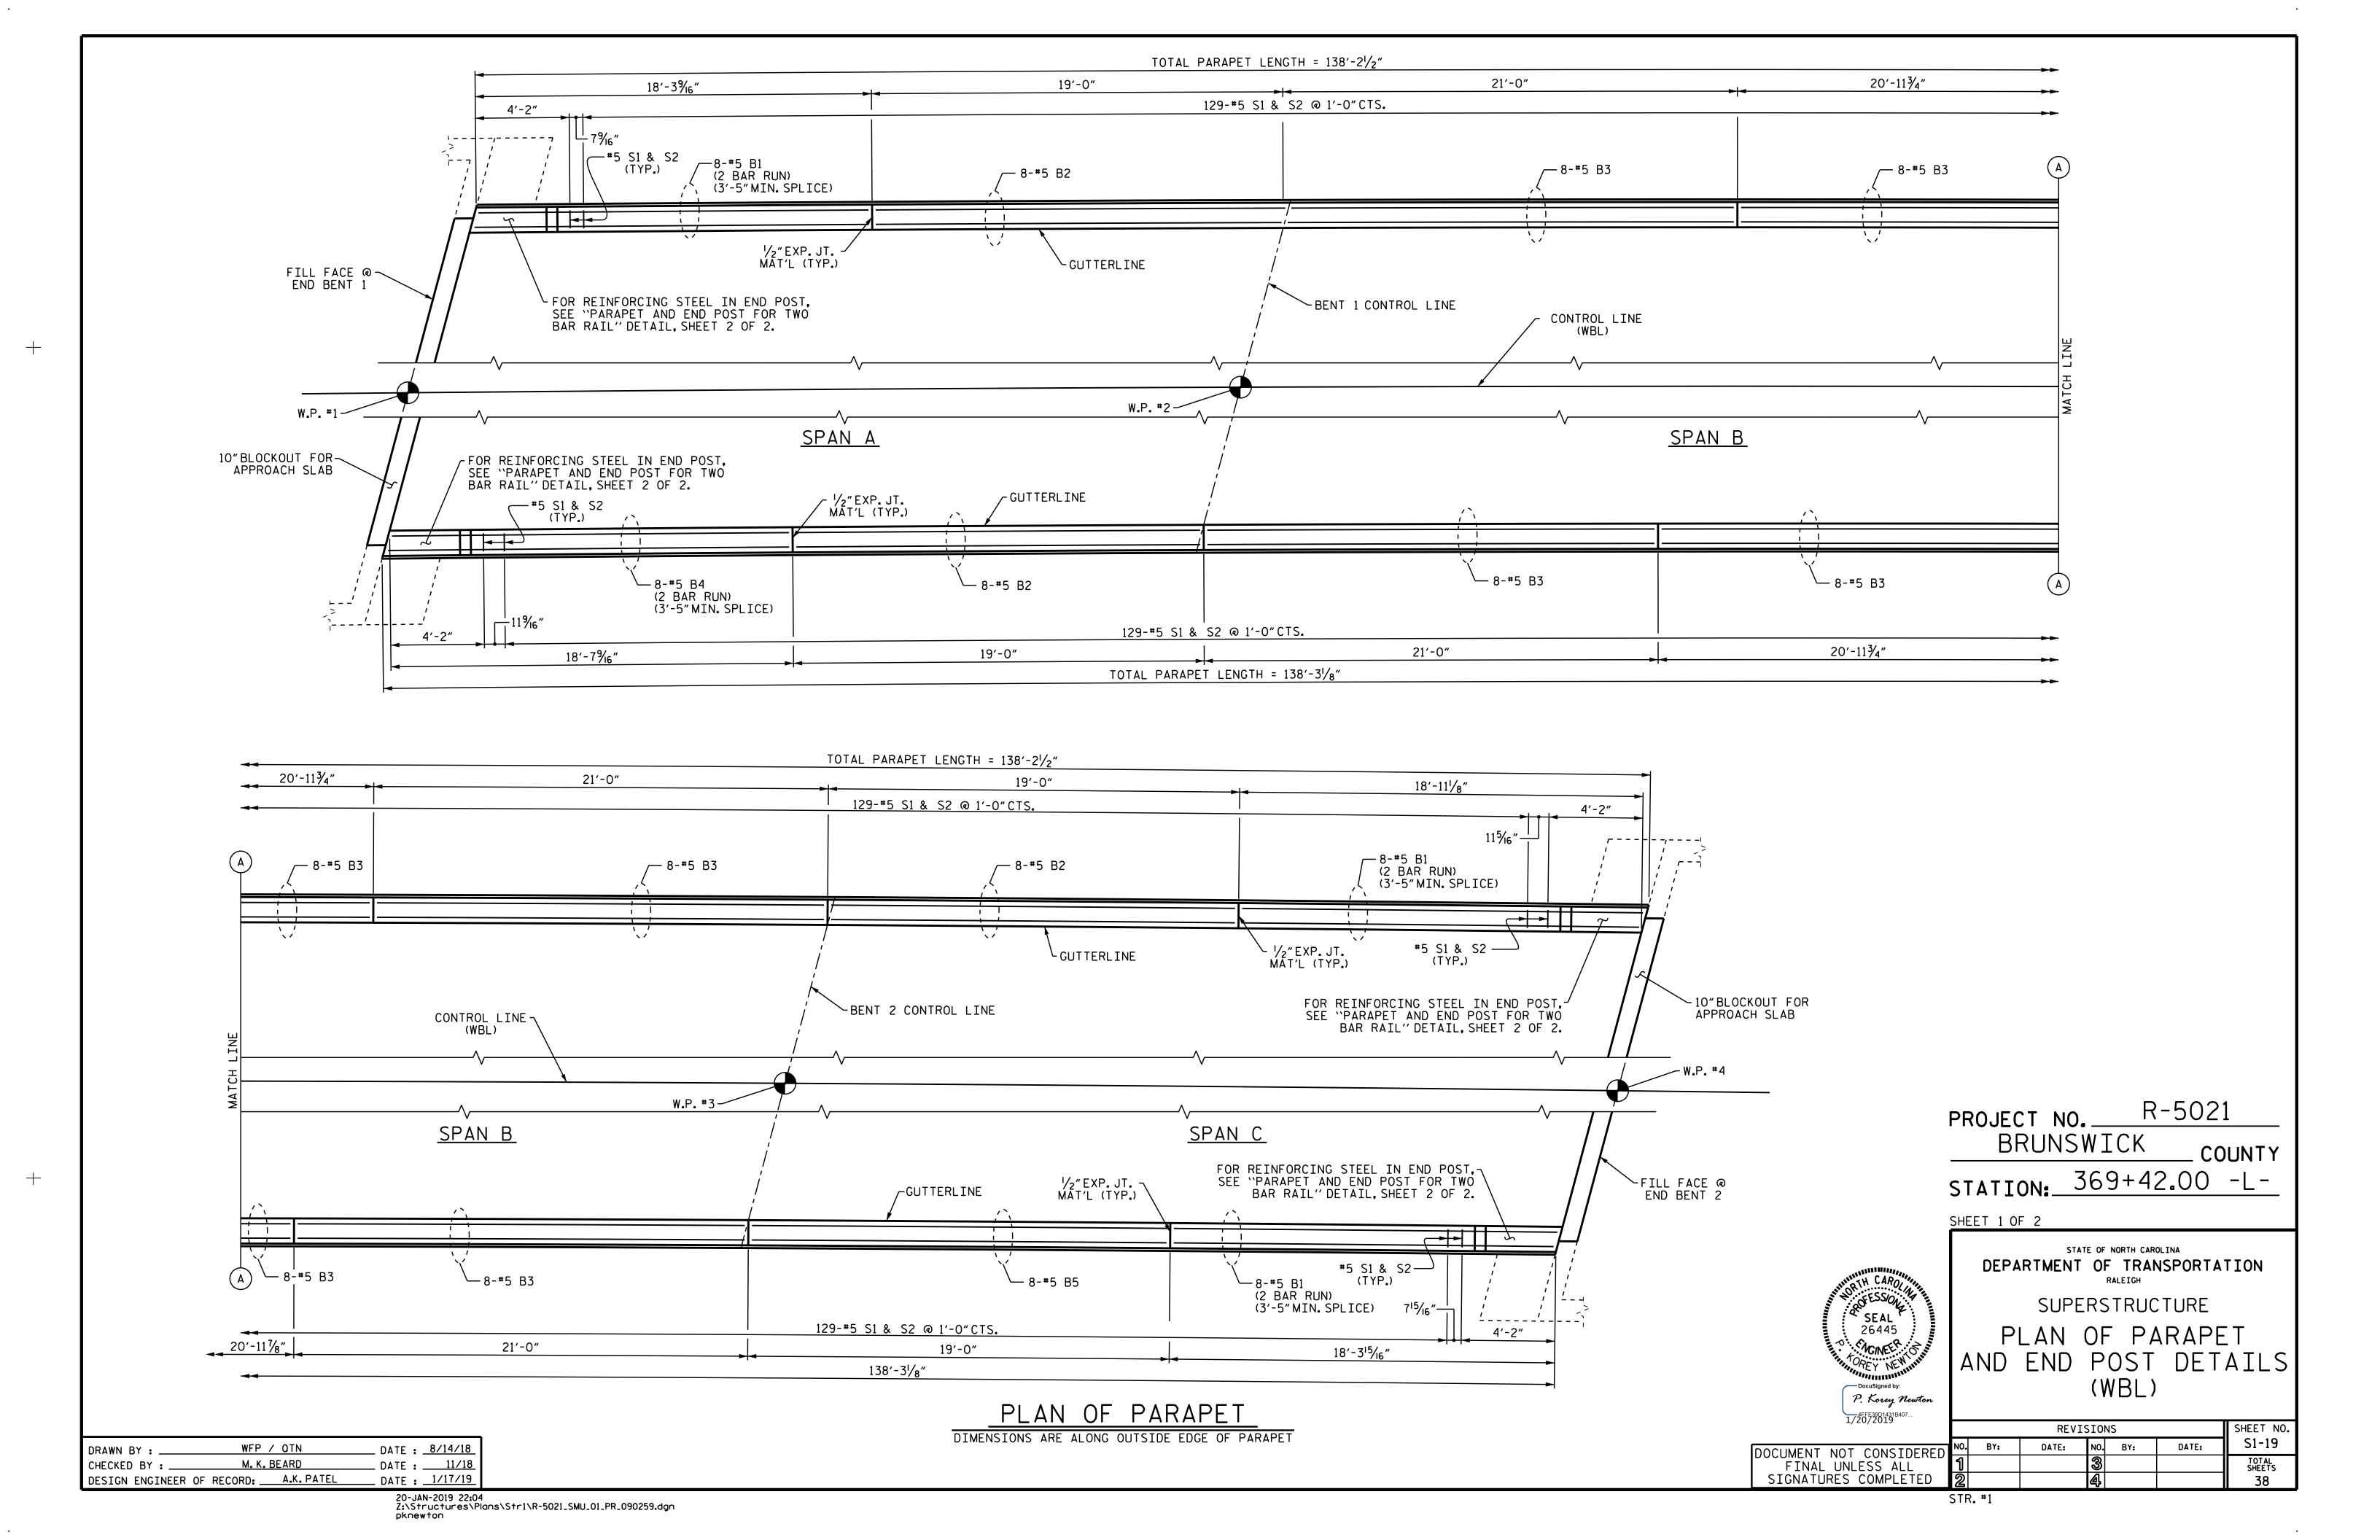

NOTES

THE PARAPET FOR ANY SPAN SHALL NOT BE CAST UNTIL ALL SLAB CONCRETE IN THE SPAN HAS REACHED A MINIMUM COMPRESIVE STRENGTH OF 3000 PSI.


ALL REINFORCING STEEL IN PARAPETS AND END POSTS SHALL BE EPOXY COATED.


THE #5 S1 BARS MAY BE SHIFTED SLIGHTLY IN ORDER TO MAINTAIN A 2" MINIMUM CLEARANCE TO THE $\frac{1}{2}$ EXPANSION JOINT MATERIAL IN THE PARAPET.

FOR DETAILS OF CONCRETE INSERTS IN END POSTS, SEE "RAIL POST SPACINGS AND END OF RAIL DETAILS" SHEET.

FOR DETAILS OF GUARDRAIL ANCHOR ASSEMBLIES, SEE "GUARDRAIL ANCHORAGE FOR METAL RAILS" SHEET.


GROOVED CONTRACTION JOINTS, 1/2" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE PARAPET AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. A CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN PARAPET EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF PARAPET SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.

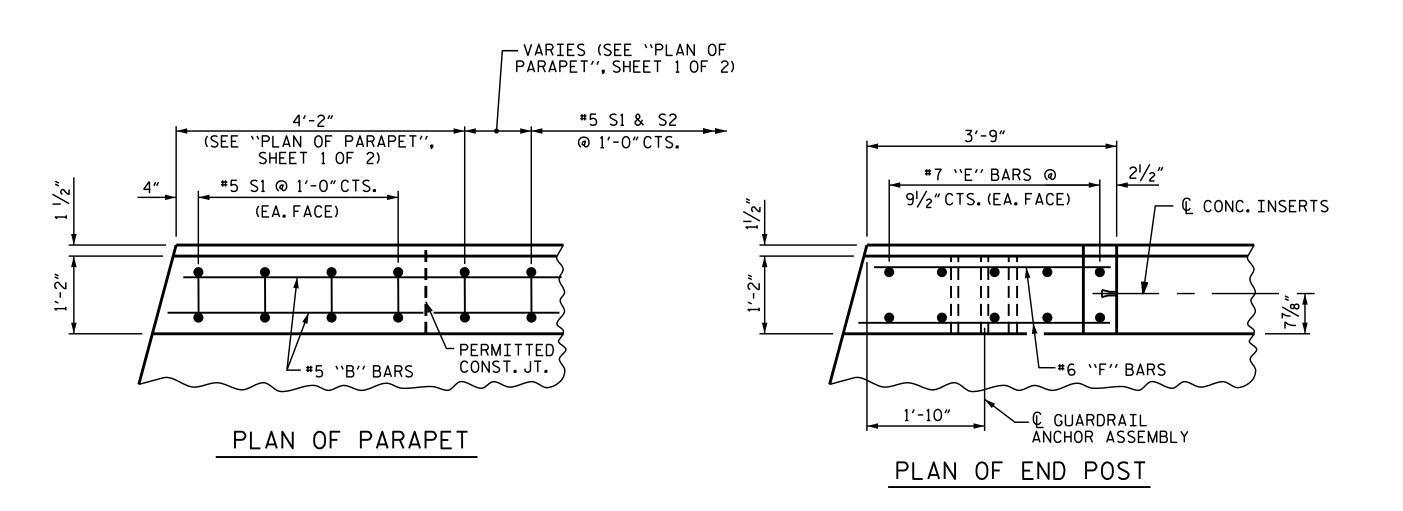


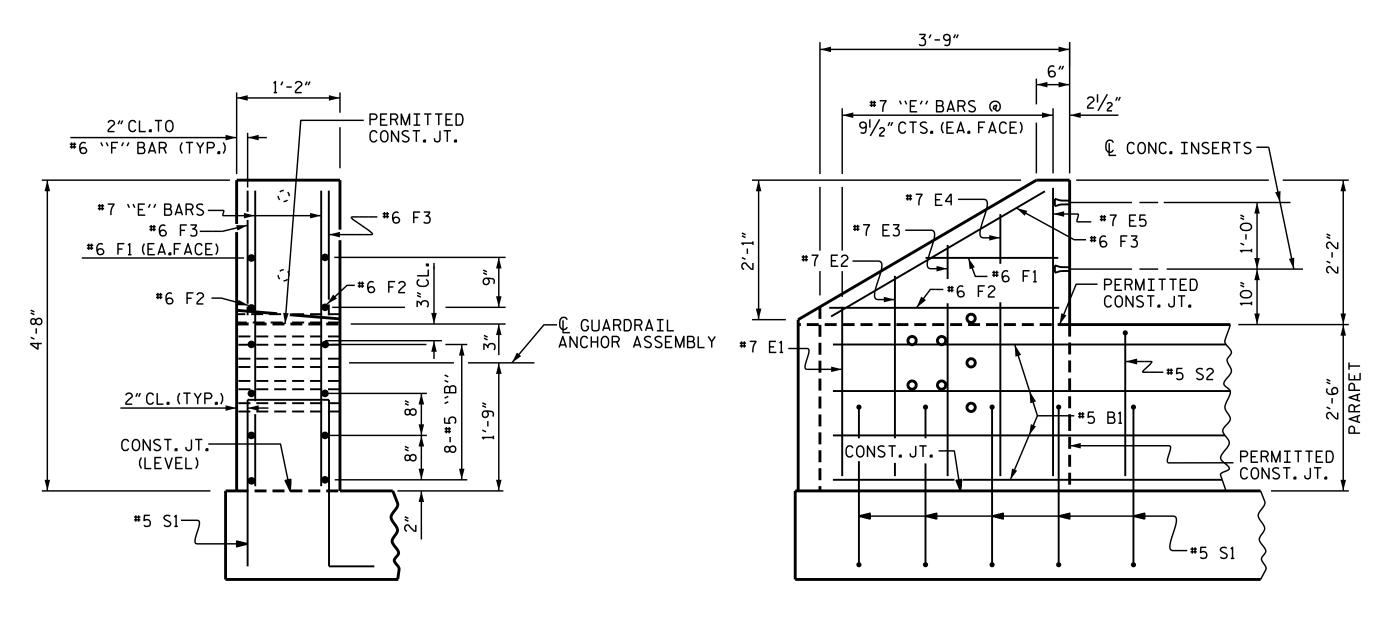


ELEVATION

PARAPET AND END POST FOR TWO BAR RAIL

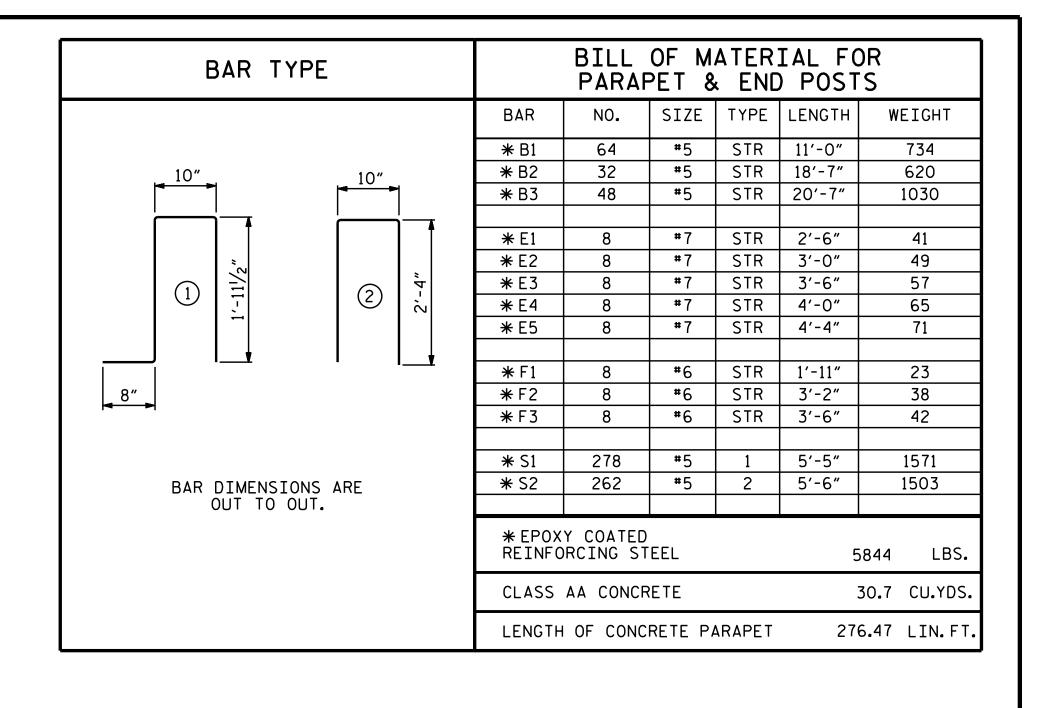

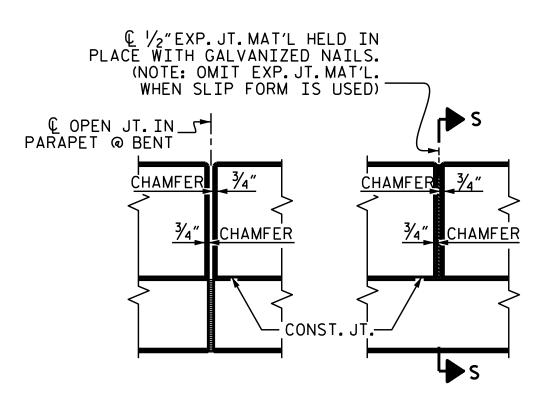

ELEVATION AT EXPANSION JOINTS

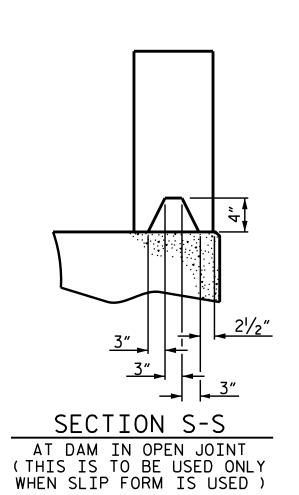

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 2 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE

PLAN OF PARAPET AND END POST DETAILS (WBL)

> SHEET NO S1-20

> > TOTAL SHEETS

DOCUM SIG


Kut Z. W. ayou


1/23/2019	REVISIONS							
MENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:		
FINAL UNLESS ALL	1			3				
GNATURES COMPLETED	2			4				

STR.#1

WFP / QTN _ DATE : <u>8/14/18</u> DRAWN BY : M.K.BEARD _ DATE : ____11/18 CHECKED BY : . DESIGN ENGINEER OF RECORD: A.K. PATEL _ DATE : <u>1/17/19</u>

END VIEW

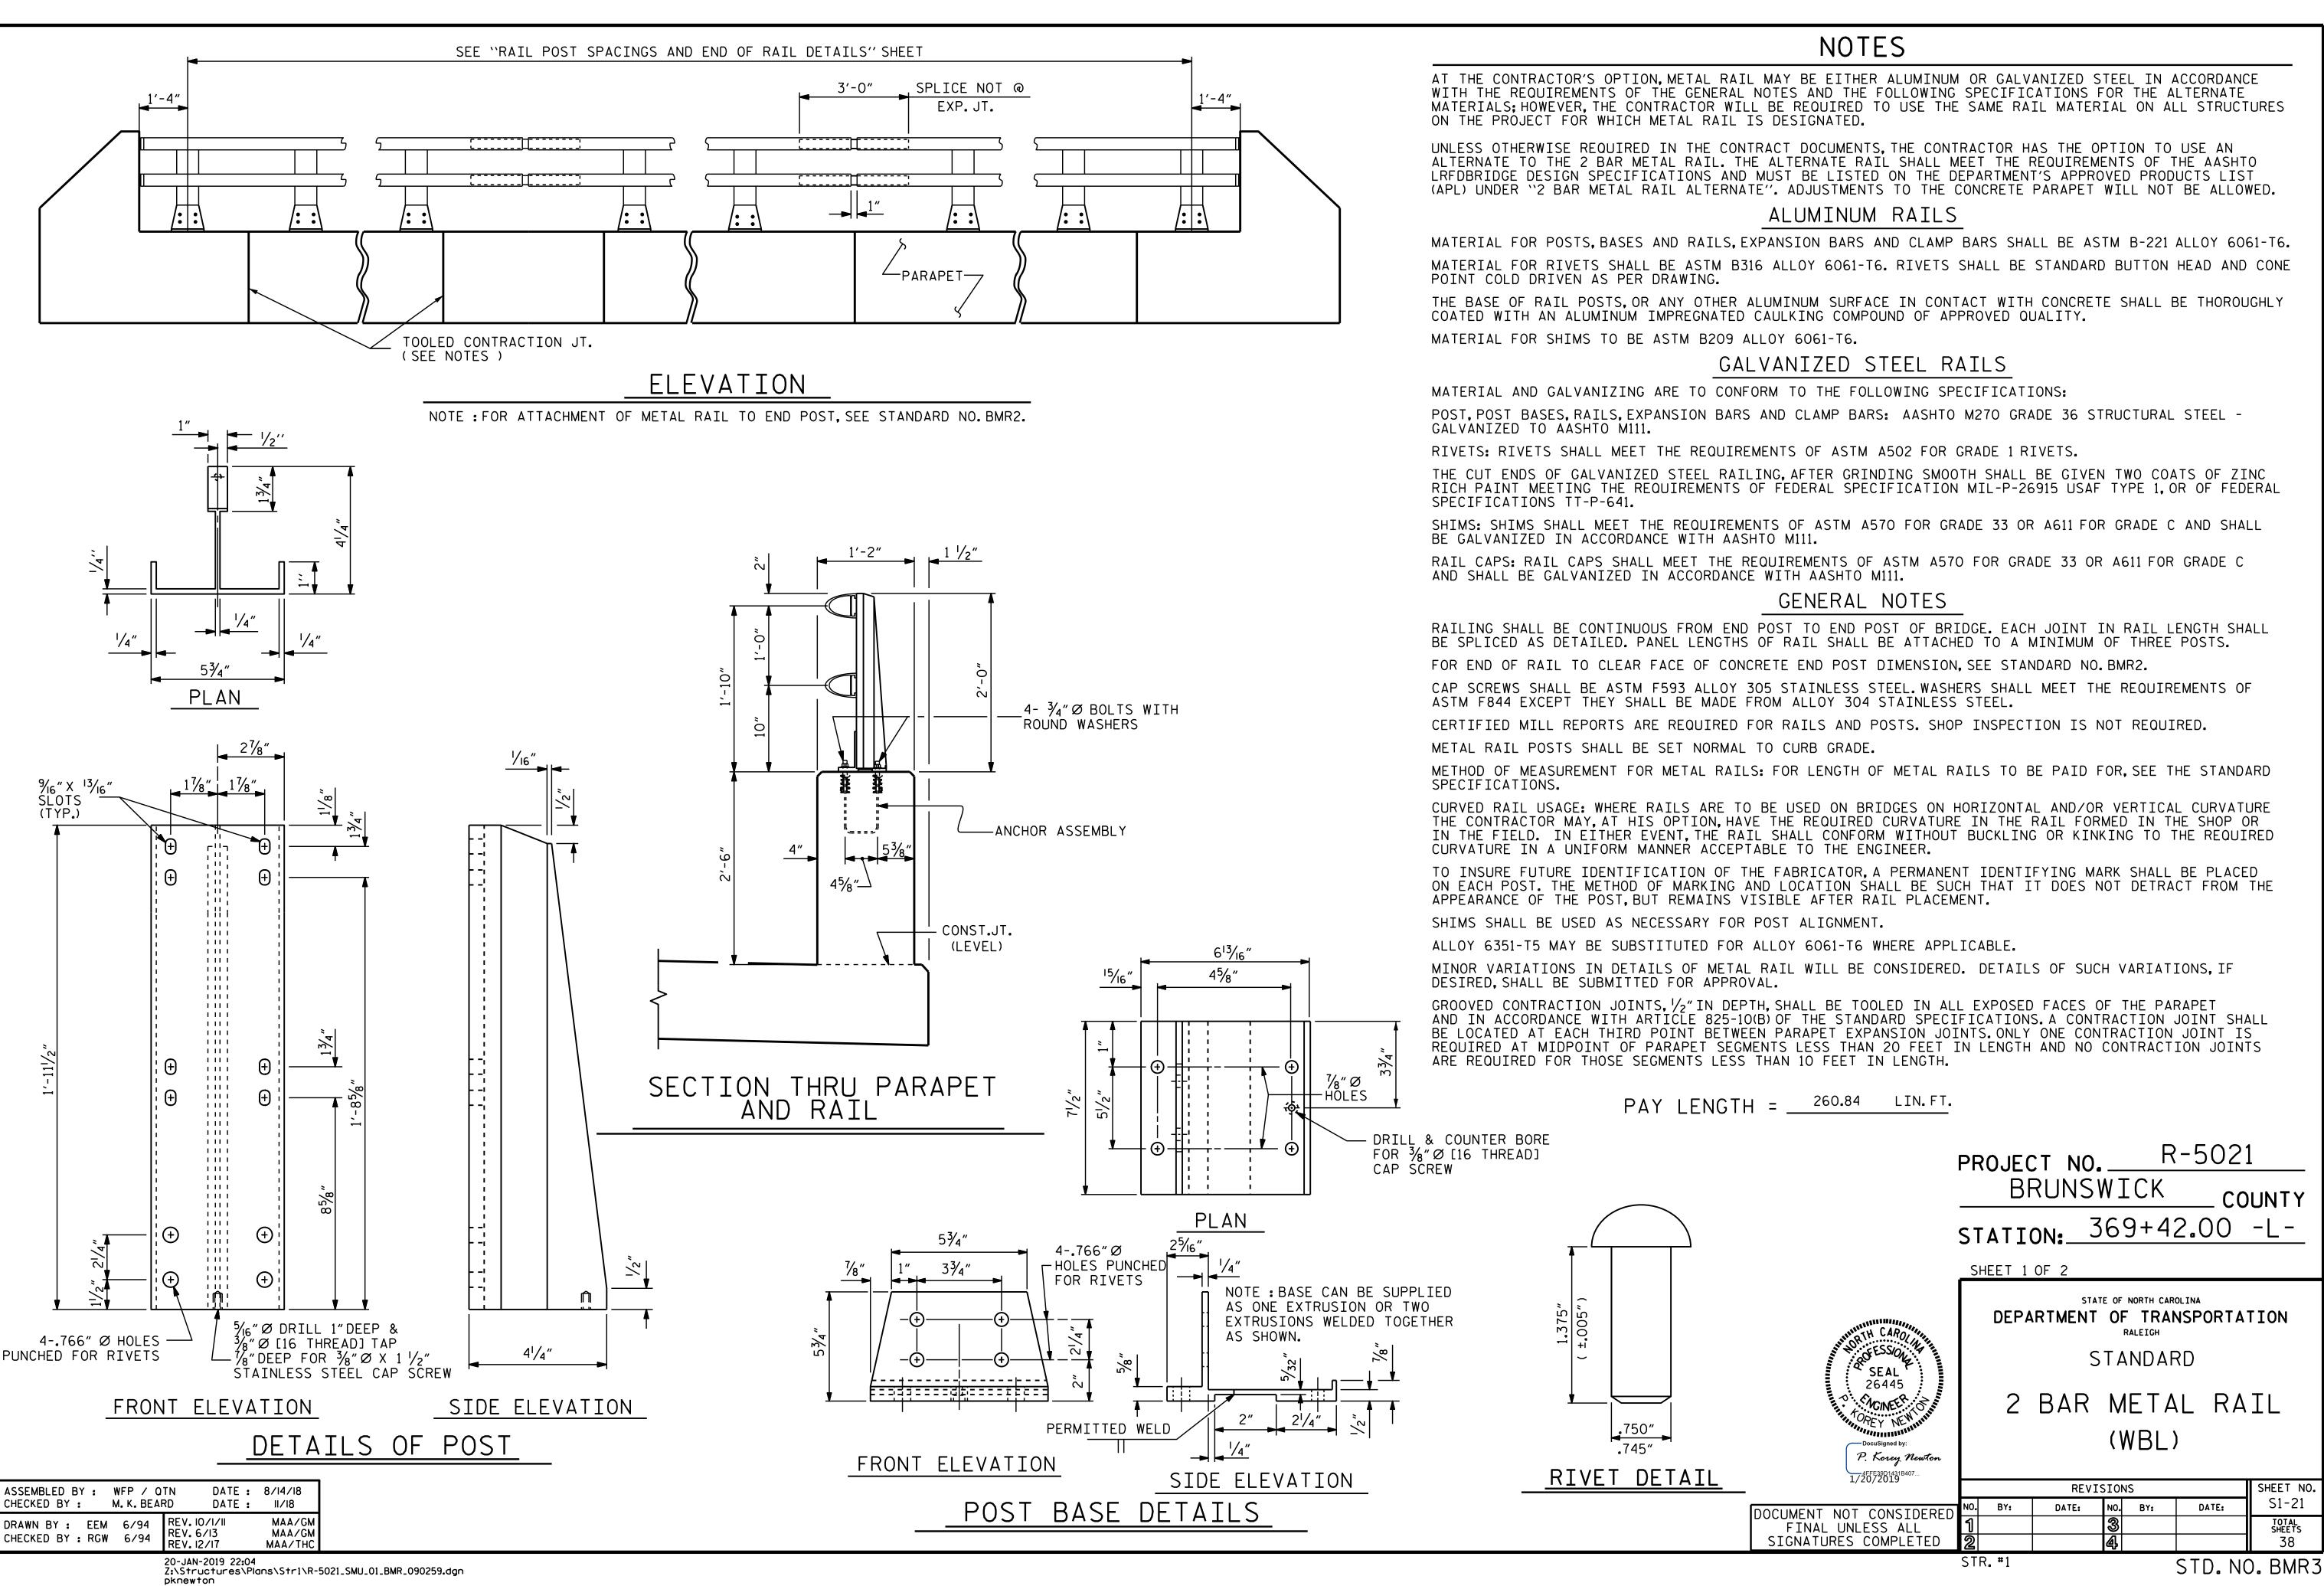

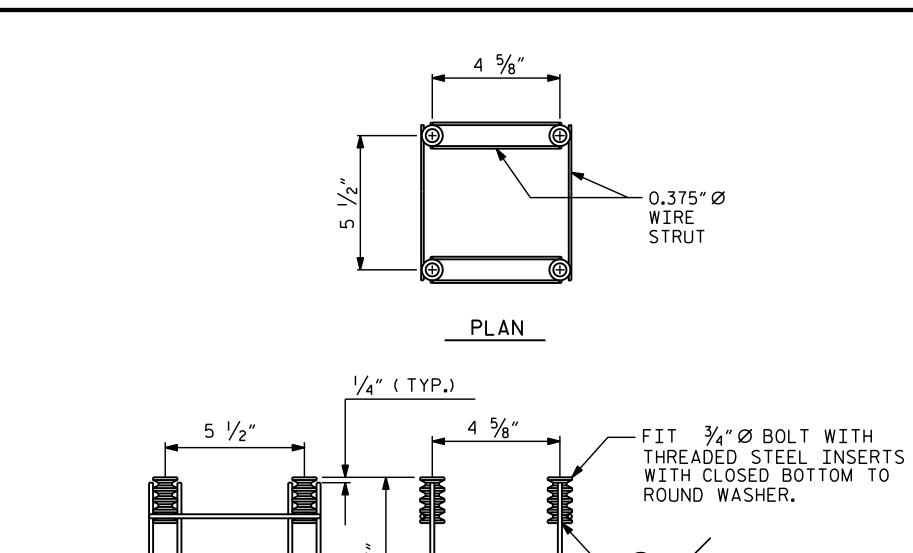

METAL RAIL ANCHOR ASSEMBLY

ELEVATION

SIDE VIEW

(46 ASSEMBLIES REQUIRED)




STRUCTURAL CONCRETE ANCHOR ASSEMBLY


THE STRUCTURAL CONCRETE ANCHOR ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF 2" FOR 3/4" FERRULES.
- B. 4 3/4" Ø X 21/2" BOLTS WITH WASHERS.BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307. BOLTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE 3/4" Ø X 21/2" GALVANIZED BOLTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.
- C. WIRE STRUT SHOWN IN THE CONCRETE ANCHOR ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $7_{16}^{\prime\prime}$ Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.
- D. THE METAL RAIL ANCHOR ASSEMBLIES TO BE HOT DIPPED GALVANIZED TO CONFORM TO REQUIREMENTS OF AASHTO M111.
- E. THE COST OF THE METAL RAIL ANCHOR ASSEMBLY WITH BOLTS AND WASHERS COMPLETE IN PLACE SHALL BE INCLUDED IN THE PRICE BID FOR LINEAR FEET OF METAL RAIL.
- F. BOLTS TO BE TIGHTENED ONE-HALF TURN WITH A WRENCH FROM A FINGER-TIGHT POSITION.


THE CONTRACTOR MAY USE ADHESIVELY ANCHORED ANCHOR BOLTS IN PLACE OF THE METAL RAIL ANCHOR ASSEMBLY. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE 3/4" Ø BOLT IS 10 KIPS. FOR ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS, SEE THE STANDARD SPECIFICATIONS.

WHEN ADHESIVELY ANCHORED ANCHOR BOLTS ARE USED, BOLTS SHALL MEET THE REQUIREMENTS OF ASTM F593 ALLOY 304 STAINLESS STEEL WITH MINIMUM 75,000 PSI ULTIMATE STRENGTH. NUTS SHALL MEET THE REQUIREMENTS OF ASTM F594 ALLOY 304 STAINLESS STEEL AND WASHERS SHALL MEET THE REQUIREMENTS OF ASTM F844 EXCEPT THEY SHALL BE MADE FROM ALLOY 304 STAINLESS STEEL.

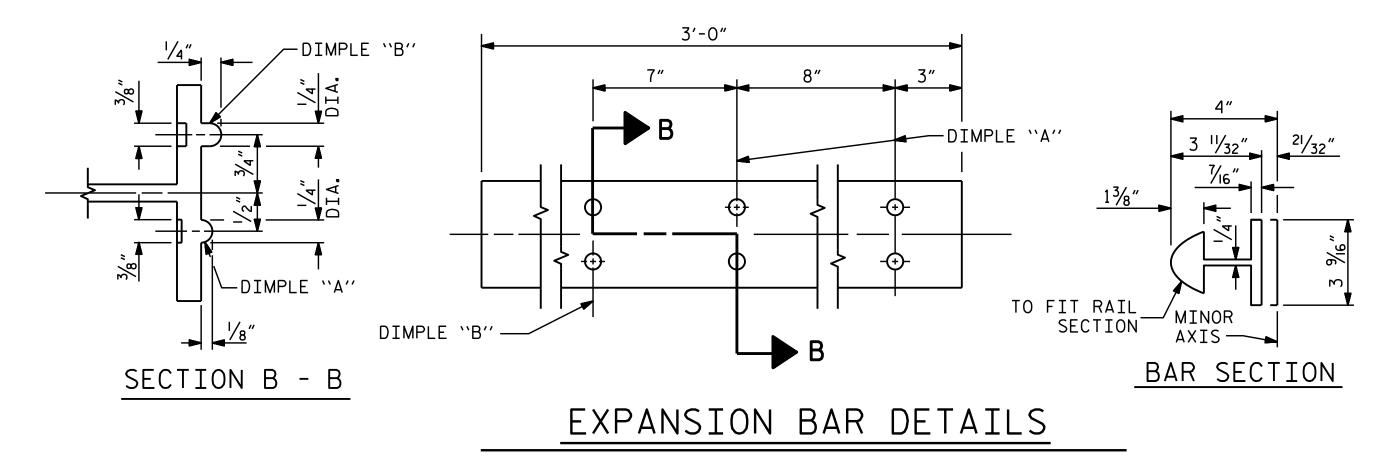


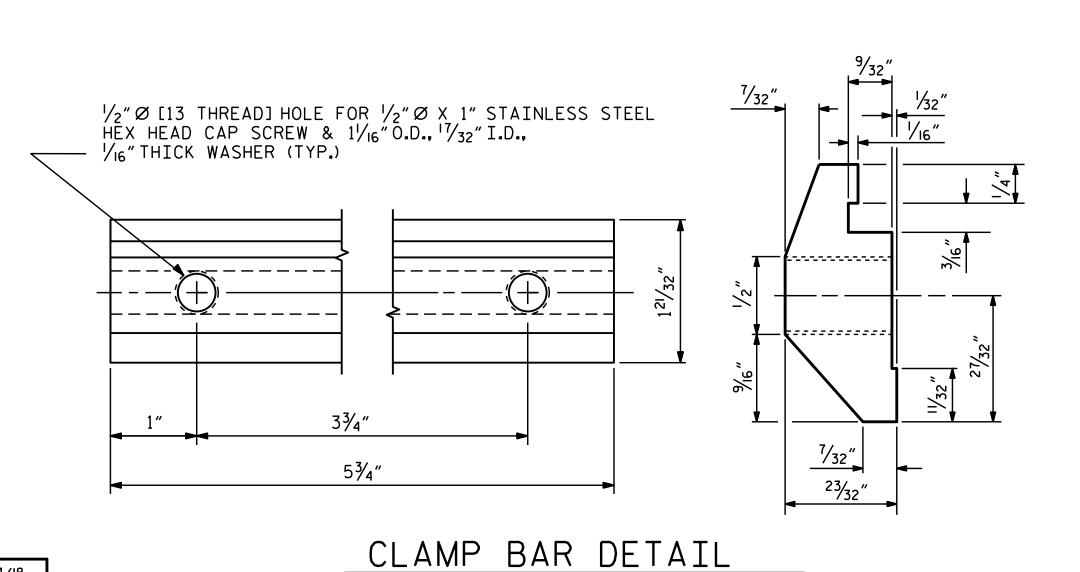


(4 REQUIRED PER POST)

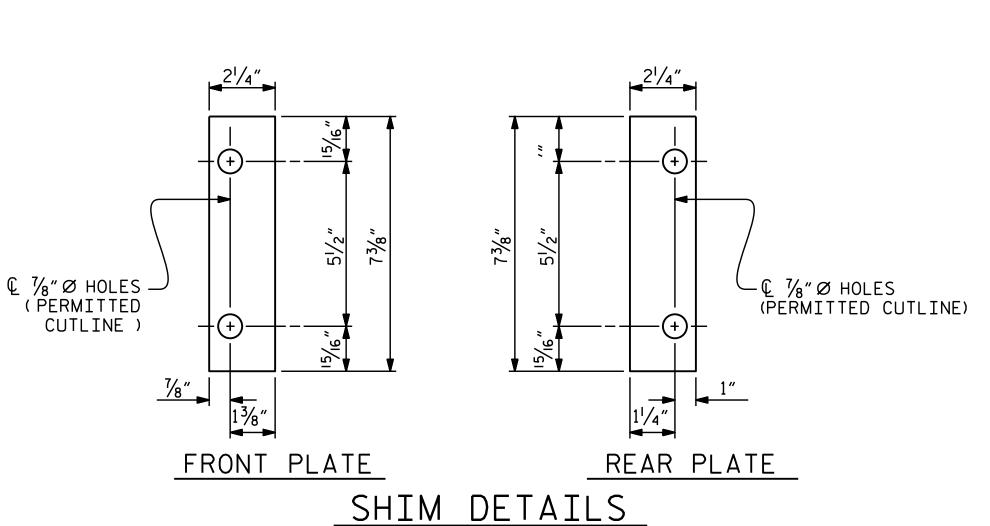


SHIMS MAY BE CUT ALONG PERMITTED CUTLINE OR SLOTTED TO EDGE OF PLATE TO FACILITATE PLACEMENT.

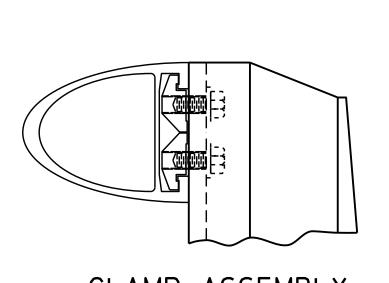

CLAMP ASSEMBLY



RAIL CAP

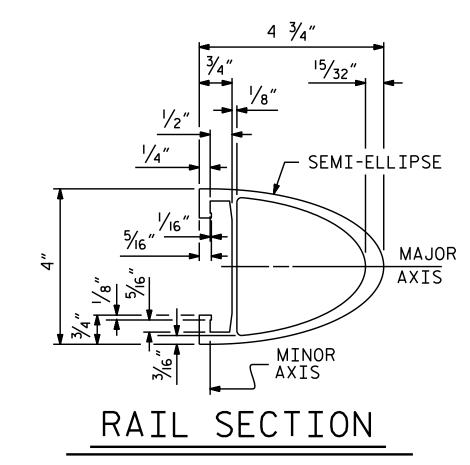

R-5021 PROJECT NO._ BRUNSWICK COUNTY STATION: 369+42.00 -L-

SHEET 2 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

STANDARD

2 BAR METAL RAIL (WBL)

DOCUMENT NOT CONSIDERED	NO.	BY:	
FINAL UNLESS ALL	1		
SIGNATURES COMPLETED	2		
	ST	R.#1	

P. Korey Newton

4FFE39D1431B407...

26445

CHOINEES


1/20/2019		REVISIONS						
OCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-22	
FINAL UNLESS ALL	1			3			TOTAL SHEETS	
SIGNATURES COMPLETED	2			4			38	


MAA/GM MAA/THC

DATE: 8/14/18 DATE: II/I8

ASSEMBLED BY: WFP / QTN CHECKED BY: M.K.BEARD

DRAWN BY : EEM 6/94 REV. 5/1/06R REV. 10/1/II REV. 12/17

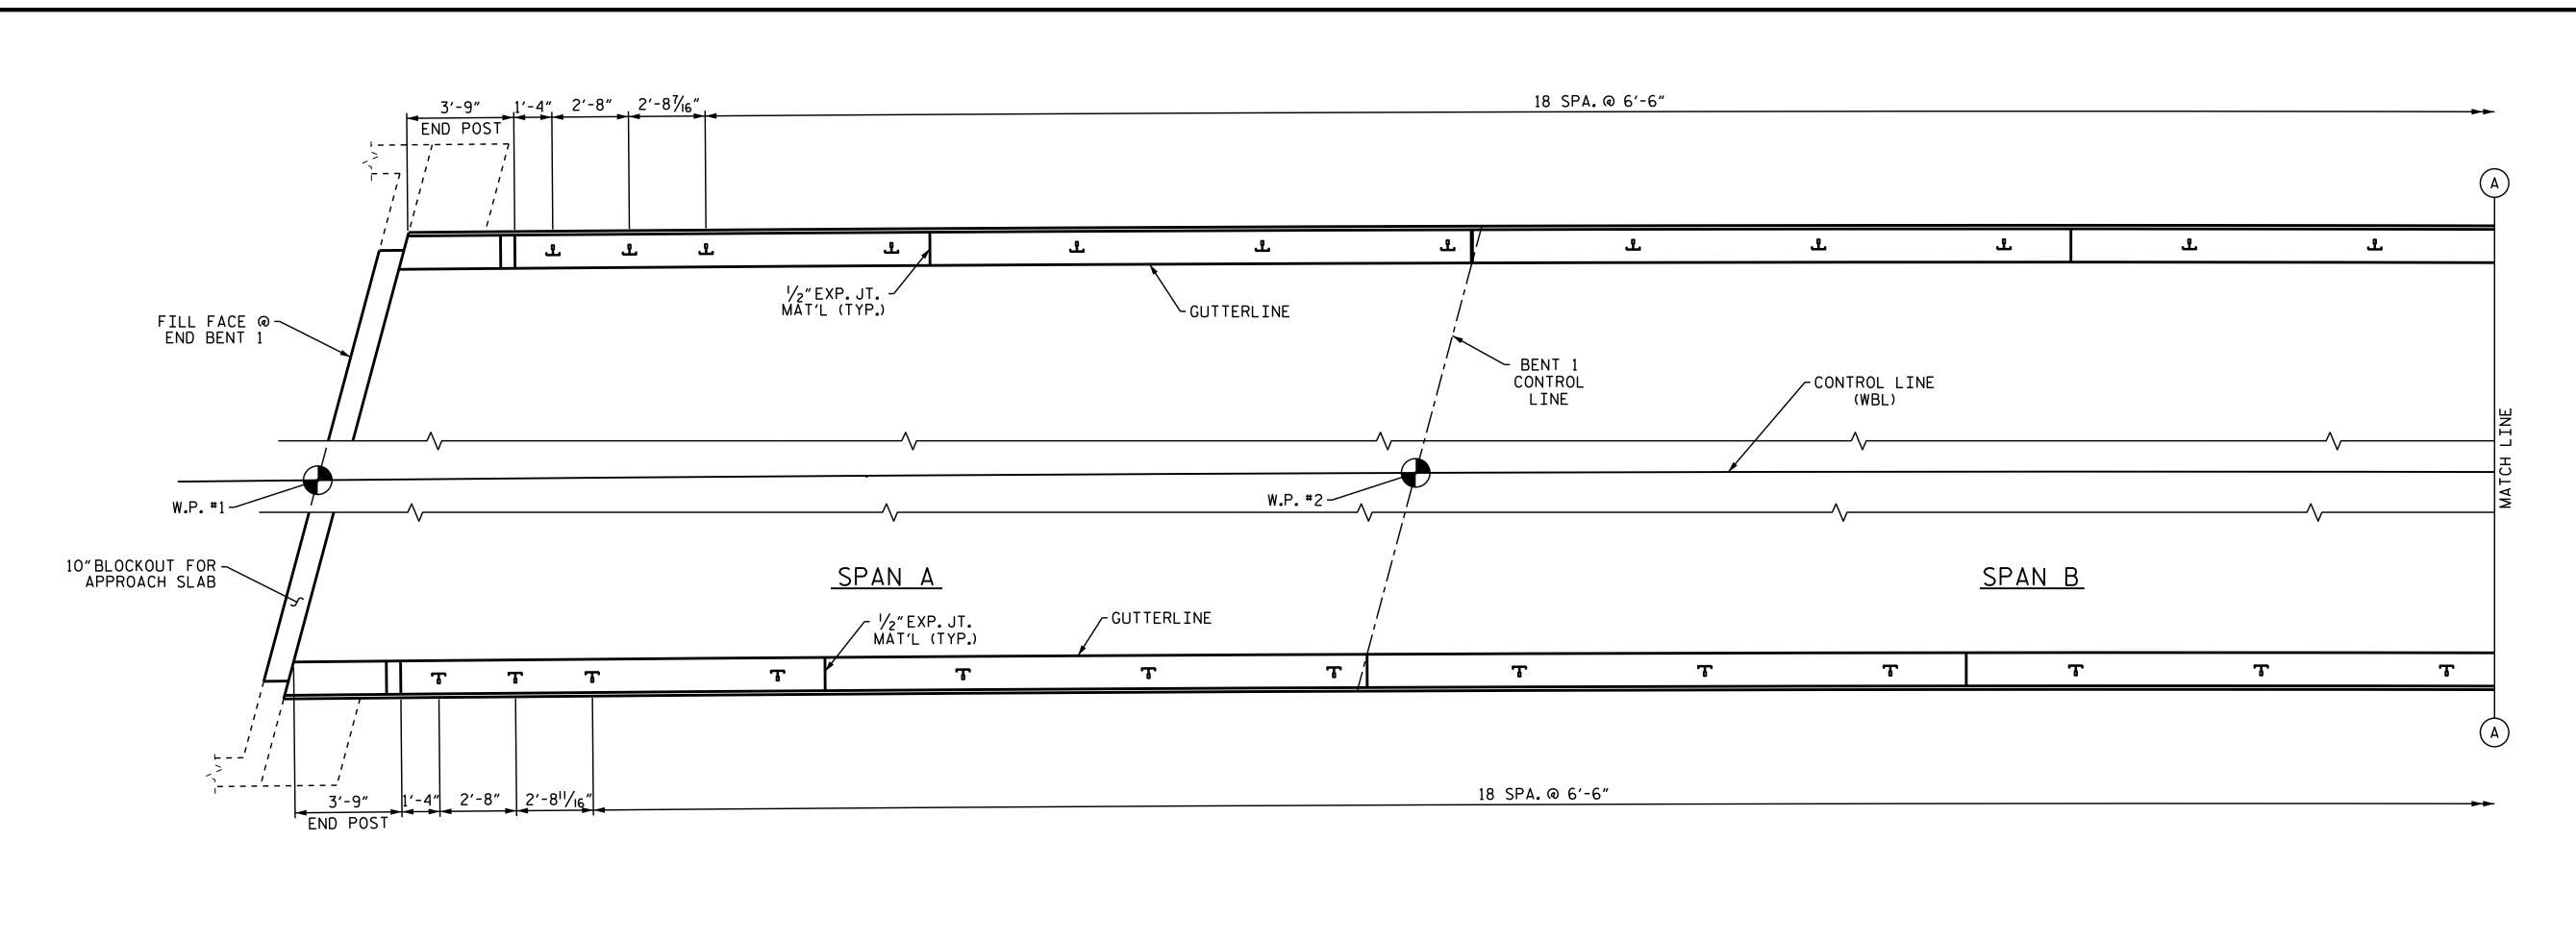

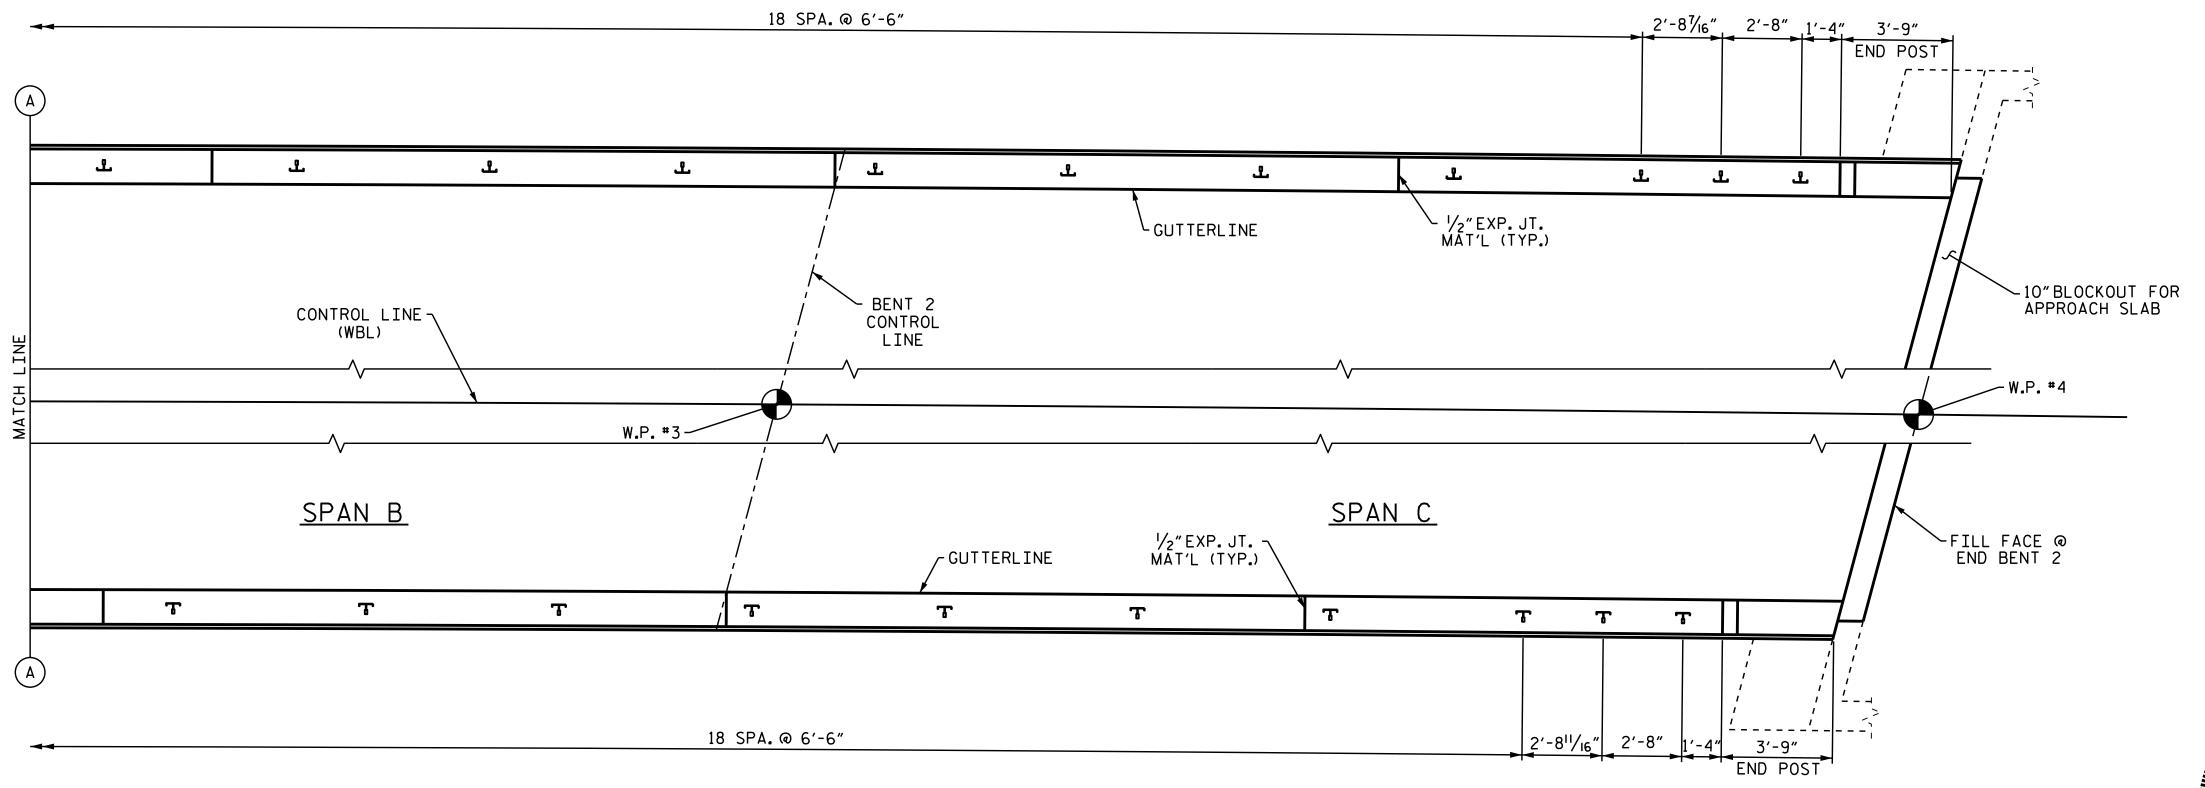

PROJECT NO. R-5021 BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 1 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION SUPERSTRUCTURE TWO BAR METAL RAIL POST SPACINGS AND END POST DETAILS (WBL)

DOCUM F SIG

P. Korey Newton 1/20/2019		(WBL)						
1/20/2019		REVISIONS						
JMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-23	
FINAL UNLESS ALL	1			3			TOTAL SHEETS	
GNATURES COMPLETED	2			4			38	
	STR	. #1						

PLAN OF RAIL POST SPACING

DIMENSIONS ARE ALONG OUTSIDE EDGE OF PARAPET

WFP / QTN _ DATE : <u>8/14/18</u> DRAWN BY : M.K.BEARD CHECKED BY : _ __ DATE : ___11/18__ __ DATE : 1/11/19 DESIGN ENGINEER OF RECORD: A.K.PATEL

STRUCTURAL CONCRETE INSERT

THE STRUCTURAL CONCRETE INSERT ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF $1\frac{1}{2}$ ".
- B. 1 $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH WASHER.BOLT SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307.BOLT AND WASHER SHALL BE GALVANIZED. (AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLT AND WASHER MAY BE USED AS AN ALTERNATE FOR THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " GALVANIZED BOLT AND WASHER. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.)
- C. WIRE STRUT SHOWN IN THE CONCRETE INSERT ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $7/6^{\prime\prime}$ Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.

NOTES

METAL RAIL TO END POST CONNECTION

THE METAL RAIL TO END POST CONNECTION SHALL CONSIST OF THE FOLLOWING COMPONENTS:


- A. $\frac{1}{2}$ " PLATES SHALL CONFORM TO AASHTO M270 GRADE 36 AND SHALL BE GALVANIZED AFTER FABRICATION.
- B. $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT SHALL HAVE A WORKING LOAD SHEAR CAPACITY OF 4800 LBS. THE FERRULES SHALL ENGAGE A $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH 2" O.D. WASHER IN PLACE. THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT SHALL HAVE N. C. THREADS.
- C. CAP SCREWS FOR RAIL ATTACHMENT TO ANGLE SHALL CONFORM TO THE REQUIREMENTS OF ASTM F593 ALLOY 305 STAINLESS STEEL. CAP SCREWS TO BE CENTERED IN SLOTS AT 60°F.
- D. STANDARD CLAMP BARS (SEE METAL RAIL SHEET).
- E. $\frac{1}{2}$ " Ø PIPE SLEEVES (IF REQUIRED) TO BE GALVANIZED.

THE COST OF THE STANDARD CLAMP BARS AND CAP SCREWS USED IN THE METAL RAIL TO END POST CONNECTION SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR LINEAR FEET OF 1 OR 2 BAR METAL RAILS.

THE $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT WITH BOLT SHALL BE ASSEMBLED IN THE SHOP.

THE COST OF THE $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT ASSEMBLY, AND THE $\frac{1}{2}$ " PLATES COMPLETE IN PLACE SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE CONTRACTOR, AT HIS OPTION, MAY USE AN ADHESIVE BONDING SYSTEM IN LIEU OF THE STRUCTURAL CONCRETE INSERT EMBEDDED IN THE END POST. IF THE ADHESIVE BONDING SYSTEM IS USED, THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH WASHER SHALL BE REPLACED WITH A $\frac{3}{4}$ " $\frac{3}{4}$ " BOLT AND 2" O.D. WASHER. ALL SPECIFICATIONS THAT APPLY TO THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT SHALL APPLY TO THE $\frac{3}{4}$ " Ø X 6 $\frac{1}{2}$ " BOLT. FIELD TESTING OF THE ADHESIVE BONDING SYSTEM IS NOT REQUIRED.

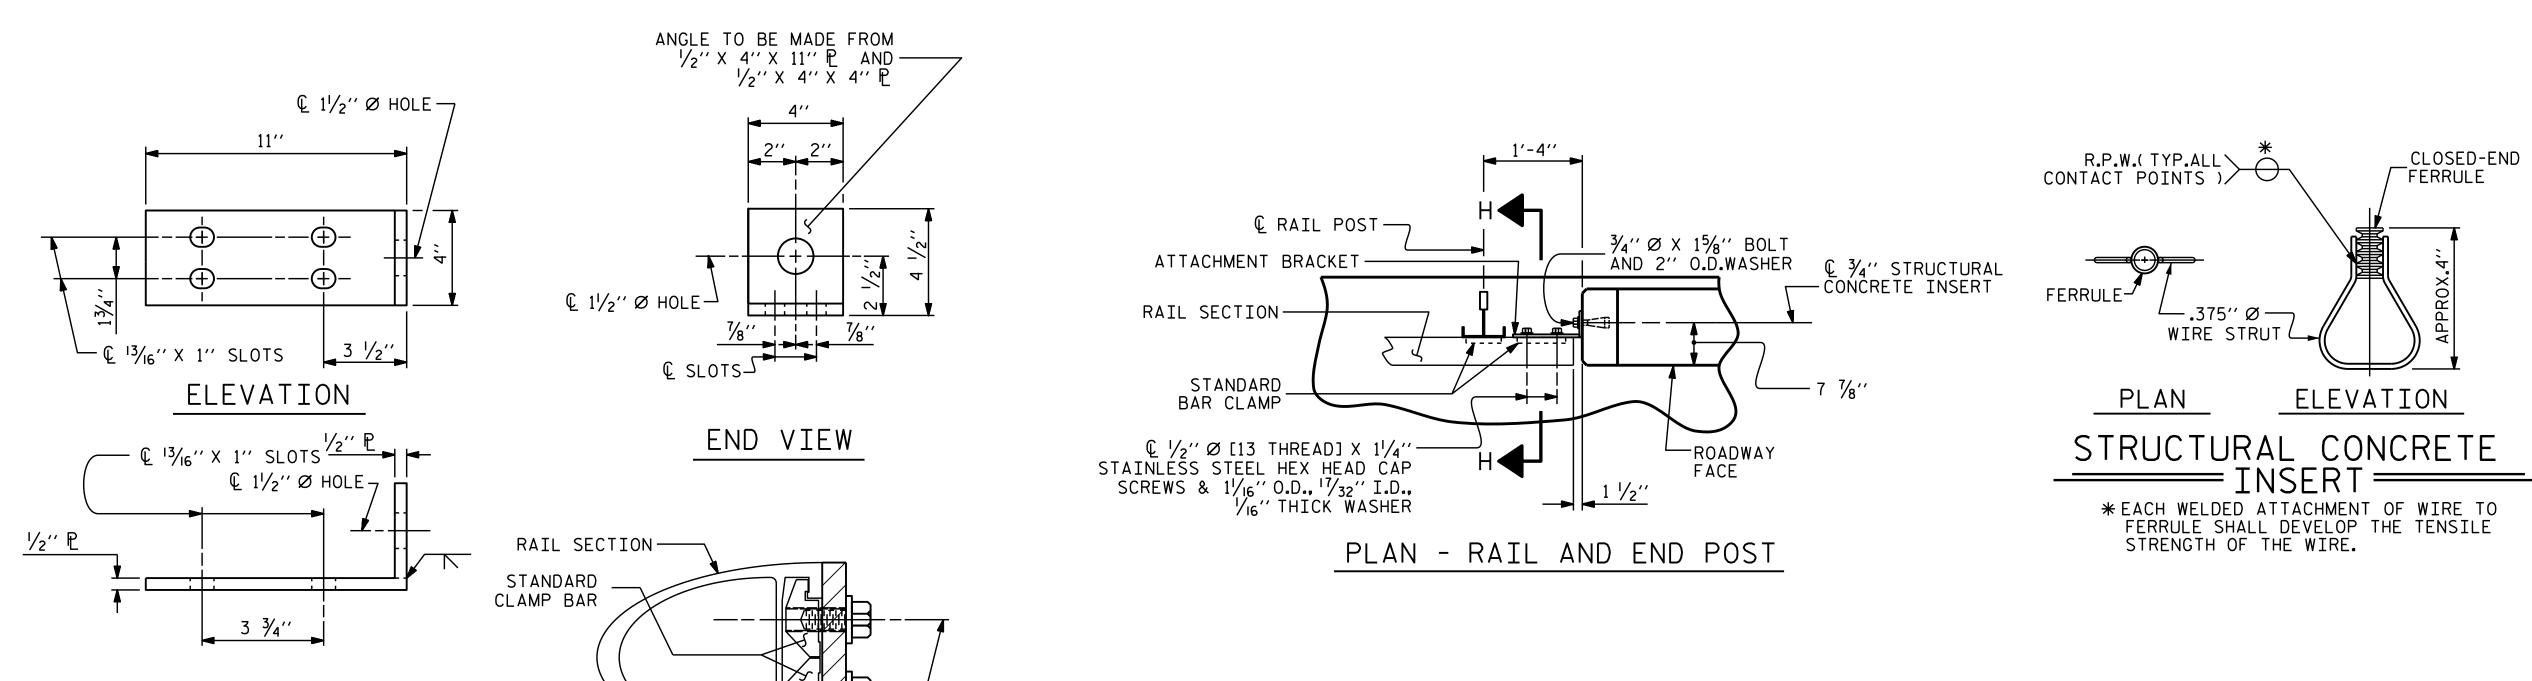

 $\mathbb{Q} /_{2}$ " Ø [13 THREAD] X $1 /_{4}$ "

DETAILS FOR ATTACHING METAL RAIL TO END POST

- STAINLESS STEEL HEX

HEAD CAP SCREWS & $1\frac{1}{16}$ O.D., $1\frac{7}{32}$ I.D., $\frac{1}{16}$ THICK WASHER

SECTION H-H

FIXED

R-5021 PROJECT NO. BRUNSWICK COUNTY 369+42.00 -L-STATION:_

SHEET 2 OF 2

STR.#1

26445 O CONEE!

P. Korey Newton

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD

RAIL POST SPACINGS = AND ====

END OF RAIL DETAILS FOR TWO BAR METAL RAILS

(WBL)

_		N.
- 1	DOCUMENT NOT CONSIDERED -	Ŋ
- 1	DOCUMENT NOT CONSTDENED	_
- 1	FINAL UNLESS ALL	
- 1	SIGNATURES COMPLETED	G
L	SIGNATURES COMILETED	6


1/20/2019 SHEET NO REVISIONS S1-24 DATE: DATE:

CHECKED BY : M. K. BEARD DATE: II/I8 TLA/GM REV. 5/1/06 DRAWN BY: FCJ 1/88 MAA/GM MAA/THC REV. 10/1/11 CHECKED BY : CRK 3/89 REV. 12/17


ASSEMBLED BY: WFP / QTN

DATE: 8/14/18

TOP VIEW

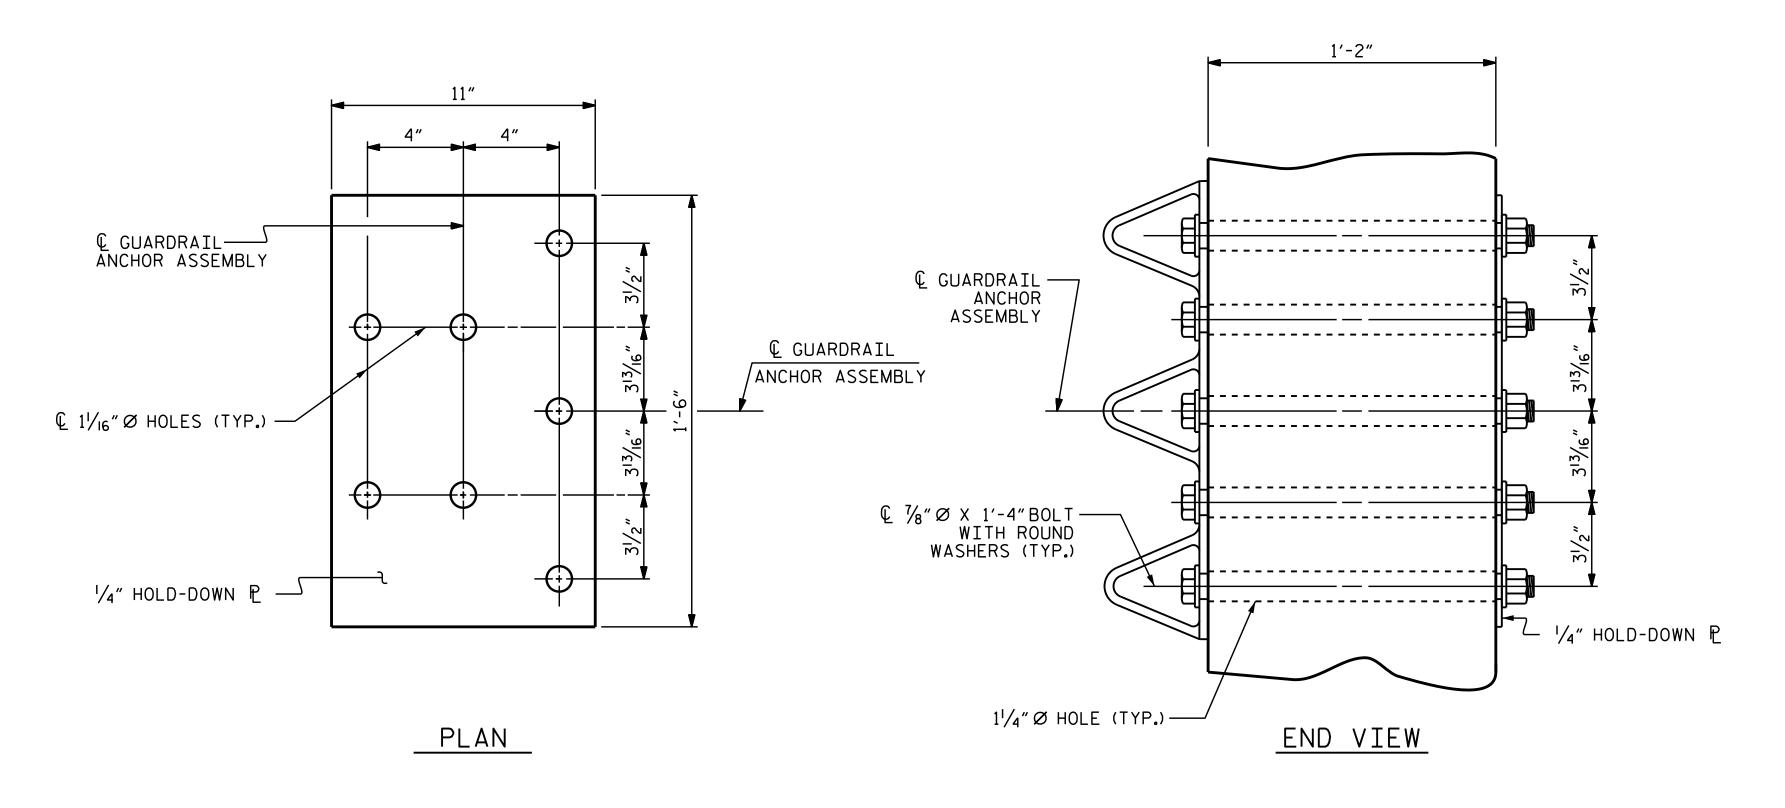

GUARDRAIL ANCHOR ASSEMBLY DETAILS

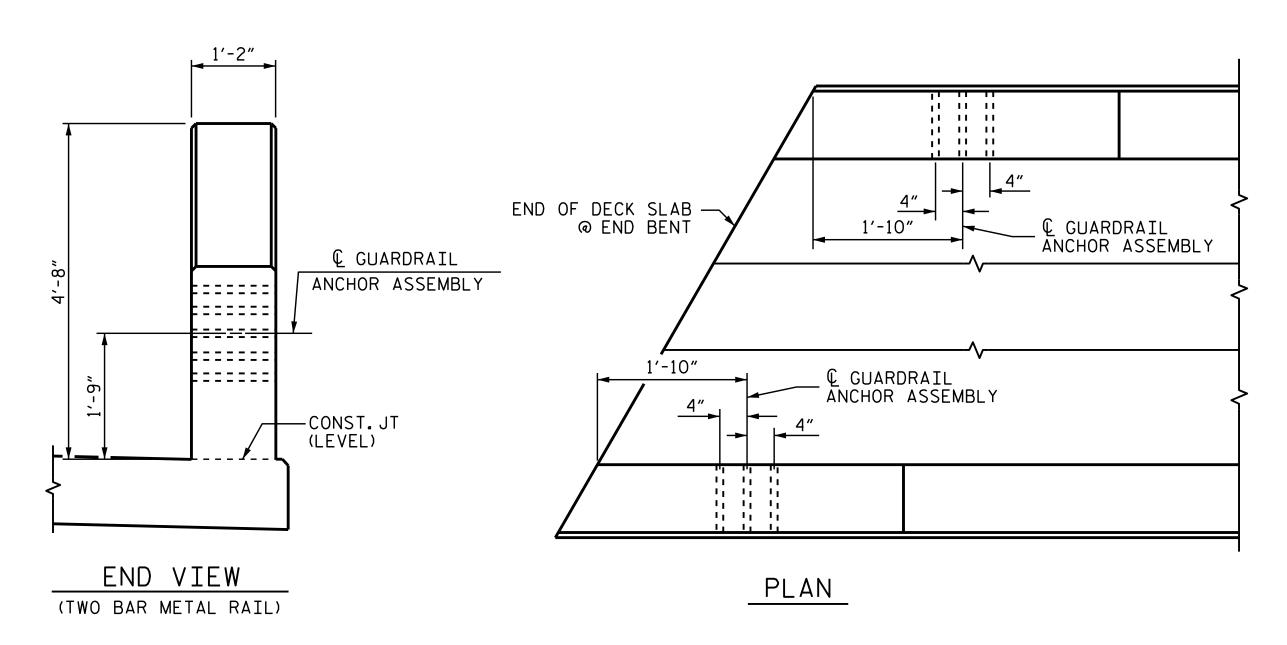

LOCATION OF GUARDRAIL ANCHOR AT END POST

NOTES

THE GUARDRAIL ANCHOR ASSEMBLY SHALL CONSIST OF A $1/4^{\prime\prime}$ HOLD DOWN PLATE AND 7 - $1/8^{\prime\prime}$ Ø BOLTS WITH NUTS AND WASHERS.

THE HOLD-DOWN PLATE SHALL CONFORM TO AASHTO M270 GRADE 36.AFTER FABRICATION, THE HOLD-DOWN PLATE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111.

BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307 AND NUTS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M291. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS, NUTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE \(\frac{7}{8}'' \textcolor{1} \tex


THE GUARDRAIL ANCHOR ASSEMBLY IS REQUIRED AT ALL POINTS WHERE APPROACH GUARDRAIL IS TO BE ATTACHED TO THE END OF THE PARAPET. FOR POINTS OF ATTACHMENT, SEE SKETCH.

AFTER INSTALLATION, THE EXPOSED THREAD OF THE BOLT SHALL BE BURRED WITH A SHARP POINTED TOOL.

THE COST OF THE GUARDRAIL ANCHOR ASSEMBLIES WITH BOLTS, NUTS AND WASHERS COMPLETE IN PLACE, SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE VERTICAL REINFORCING BARS MAY BE SHIFTED SLIGHTLY IN THE END POST TO CLEAR ASSEMBLY BOLTS.


THE 1 $\frac{1}{4}$ " Ø HOLES SHALL BE FORMED OR DRILLED WITH A CORE BIT. IMPACT TOOLS WILL NOT BE PERMITTED. ANY CONCRETE DAMAGED BY THIS WORK SHALL BE REPAIRED TO THE SATISFACTION OF THE ENGINEER.

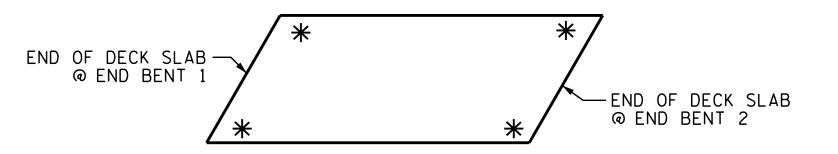

SKETCH SHOWING POINTS OF ATTACHMENT

*LOCATION OF GUARDRAIL ATTACHMENT

PROJECT NO. R-5021
BRUNSWICK COUNTY
STATION: 369+42.00 -L-



DEPARTMENT OF TRANSPORTATION
RALEIGH
STANDARD
GUARDRAIL ANCHORAGE
DETAILS
FOR METAL RAILS
(WBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

		SHEET NO.					
ED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-25
	1			3			TOTAL SHEETS
)	2			4			38

MAA/TMG MAA/THC

MAA/THC

DATE: 8/14/18


DATE: II/I8

REV. 5/18

ASSEMBLED BY: WFP / QTN

CHECKED BY : M. K. BEARD

DRAWN BY: MAA 5/10 CHECKED BY: GM 5/10

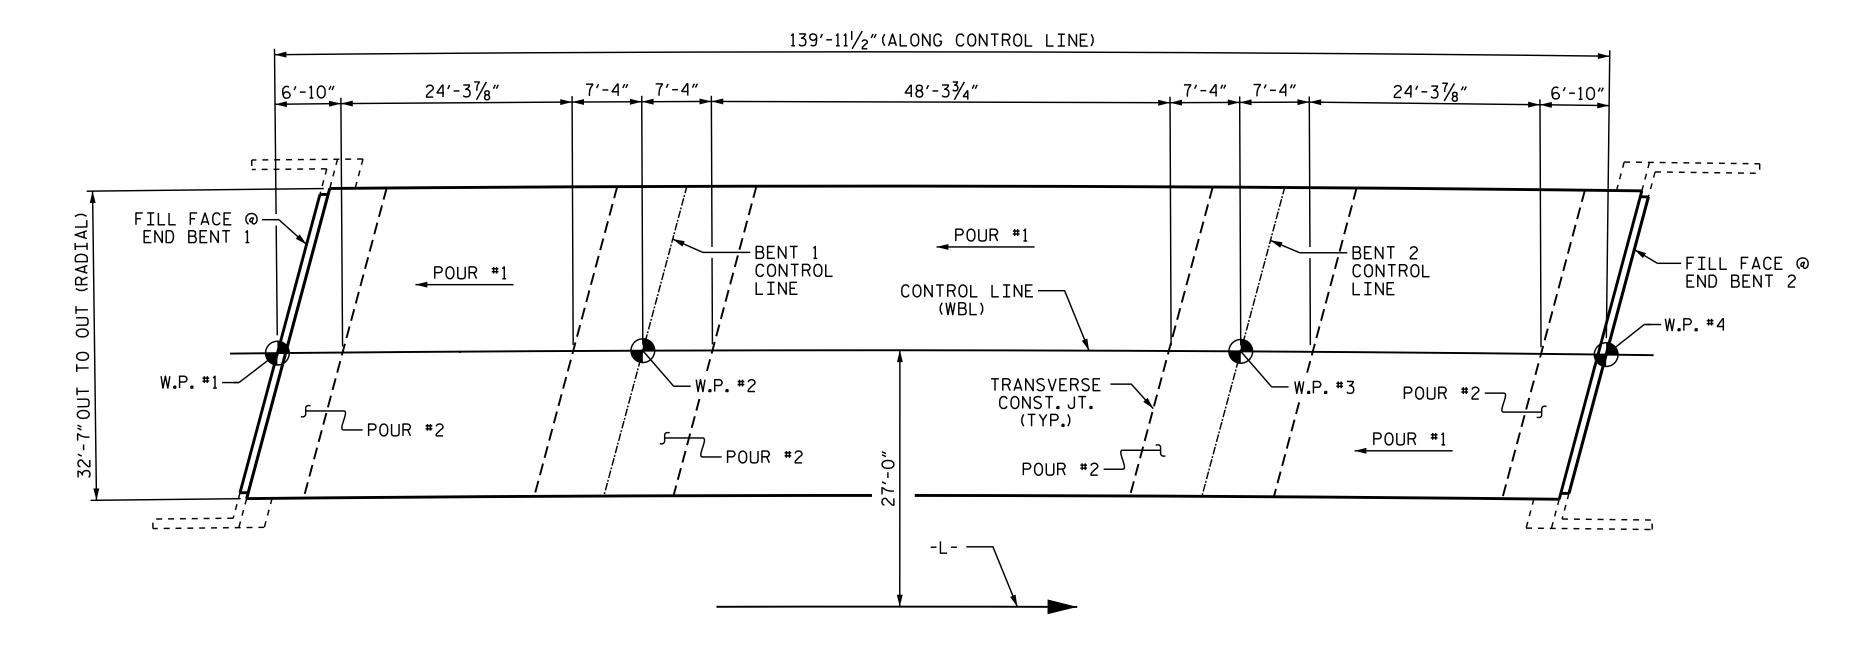

BILL OF MATERIAL -BAR TYPES — NO. SIZE TYPE LENGTH WEIGHT #5 STR 32'-2" 1'-81/2" 8'-0" 184 #4 STR 2'-11" 358 3'-61/2" S2 4'-0" #5 STR 30′-7″ #5 STR 28'-9" #5 | STR | 26'-10" 56 #5 | STR | 25'-0" #5 STR 23'-1" 48 #5 STR 44 21'-3" #5 STR 19′-5″ ***** A108 #5 | STR | 17'-6" 37 2 #5 STR 15′-8″ 33 ***** A110 #5 STR 13'-9" 29 #5 STR ***** A111 11'-11" 25 ***** A112 #5 | STR | 10'-0" 21 ***** A113 #5 STR 8'-2" 17 ***** ∆114 #5 STR 6′-4″ 13 #5 | STR | 4'-5" 9 ***** A116 #5 | STR | 2'-7" #5 30′-10″ ***** ∆117 STR 64 **#**5 28'-11" ***** A118 STR 60 ***** A119 #5 | STR | 27'-1" 56 ***** A120 #5 25'-2" 52 ***** A121 #5 23'-4" 49 **#**5 ***** A122 STR 21′-5″ 45 ***** A123 #5 | STR | 19′-7″ 41 ***** A124 #5 STR 15′-10″ 33 2 #5 | STR | 13'-11" 29 12'-0" 25 ***** A128 10'-2" 21 #5 | STR | 17 8'-3" 6′-5" ***** A130 #5 | STR | 13 ***** A131 #5 | STR 4'-6" ***** A132 #5 | STR | 2'-8" #5 | STR | 47'-9" 132 152 **∗** B2 #5 STR 10′-6″ 1665 **∗** K1 #4 | STR | 39'-7" | 212 **∗** K2 #4 STR 4'-11" 26 **∗** K3 #4 STR 5′-5″ 58 * K4 #4 | STR | 5'-11" 32 2'-0" #4 | STR | * K5 #4 STR 2'-6" 13 #4 STR **∗** K7 2'-3" 4 ***** S1 478 60 #4 11'-11" ***** S2 60 #4 9'-3" 371 **∗** U1 60 | #4 | 2 8'-0" 321 * EPOXY COATED REINF. STEEL = 19,919 LBS ALL BAR DIMENSIONS ARE OUT TO OUT

SUPERSTRUCTURE REINFORCING STEEL LENGTHS ARE BASED ON THE FOLLOWING MINIMUM SPLICE LENGTHS


SUPERSTRUCTURE BAR SLABS, PARAPETS, APPROACH SLABS PARAPETS SIZE AND BARRIER RAILS BARRIER RAILS EPOXY COATED EPOXY COATED UNCOATED UNCOATED 2'-6" 1'-11" 1'-7" 1'-11" 1'-7" 2'-5" 2'-0" 2'-5" 3'-1" 2'-0" 2'-10" 2'-5" 3'-7" 2'-5" 3'-8" #6 4'-2" 2'-9" 4'-9" 3'-2"

— SUPERSTF	RUCTURE BILL O	F MATERIAL —
	CLASS AA CONCRETE	EPOXY COATED REINFORCING STEEL
	(CU.YDS.)	(LBS.)
POUR #1	58.8	
POUR #2	50 . 8	
TOTALS**	109.6	19919

**QUANTITIES FOR CONCRETE PARAPET ARE NOT INCLUDED

GROOVING	BRIDGE	FLC	ORS
APPROACH SLABS	13	03	SQ.FT.
BRIDGE DECK	37.	23	SQ.FT.
TOTAL	50	26	SQ.FT.

PROJECT NO. R-5021 BRUNSWICK _ COUNTY STATION: 369+42.00 -L-



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE BILL OF MATERIAL (WBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

8/16/2021

		SHEET NO						
7	NO.	BY:	DATE:	NO.	BY:	DAT	E:	S1-26
۱	1			3				TOTAL SHEETS
	2			4				38
	STR.	. #1				STD	NΩ	ROM2

STD. NO. BOM2

DATE: 8/2/21

REV. 5/1/06

REV. 10/1/11 REV. 12/17

DATE: 8/2/21

DATE: 8/2/2

TLA/GM

MAA/GM MAA/THC

DESIGN ENGINEER OF RECORD:


ASSEMBLED BY : OTN / PKN

CHECKED BY : M. K. BEARD

DRAWN BY: JMB 5/87

CHECKED BY : SJD 9/87

P.K.NEWTON

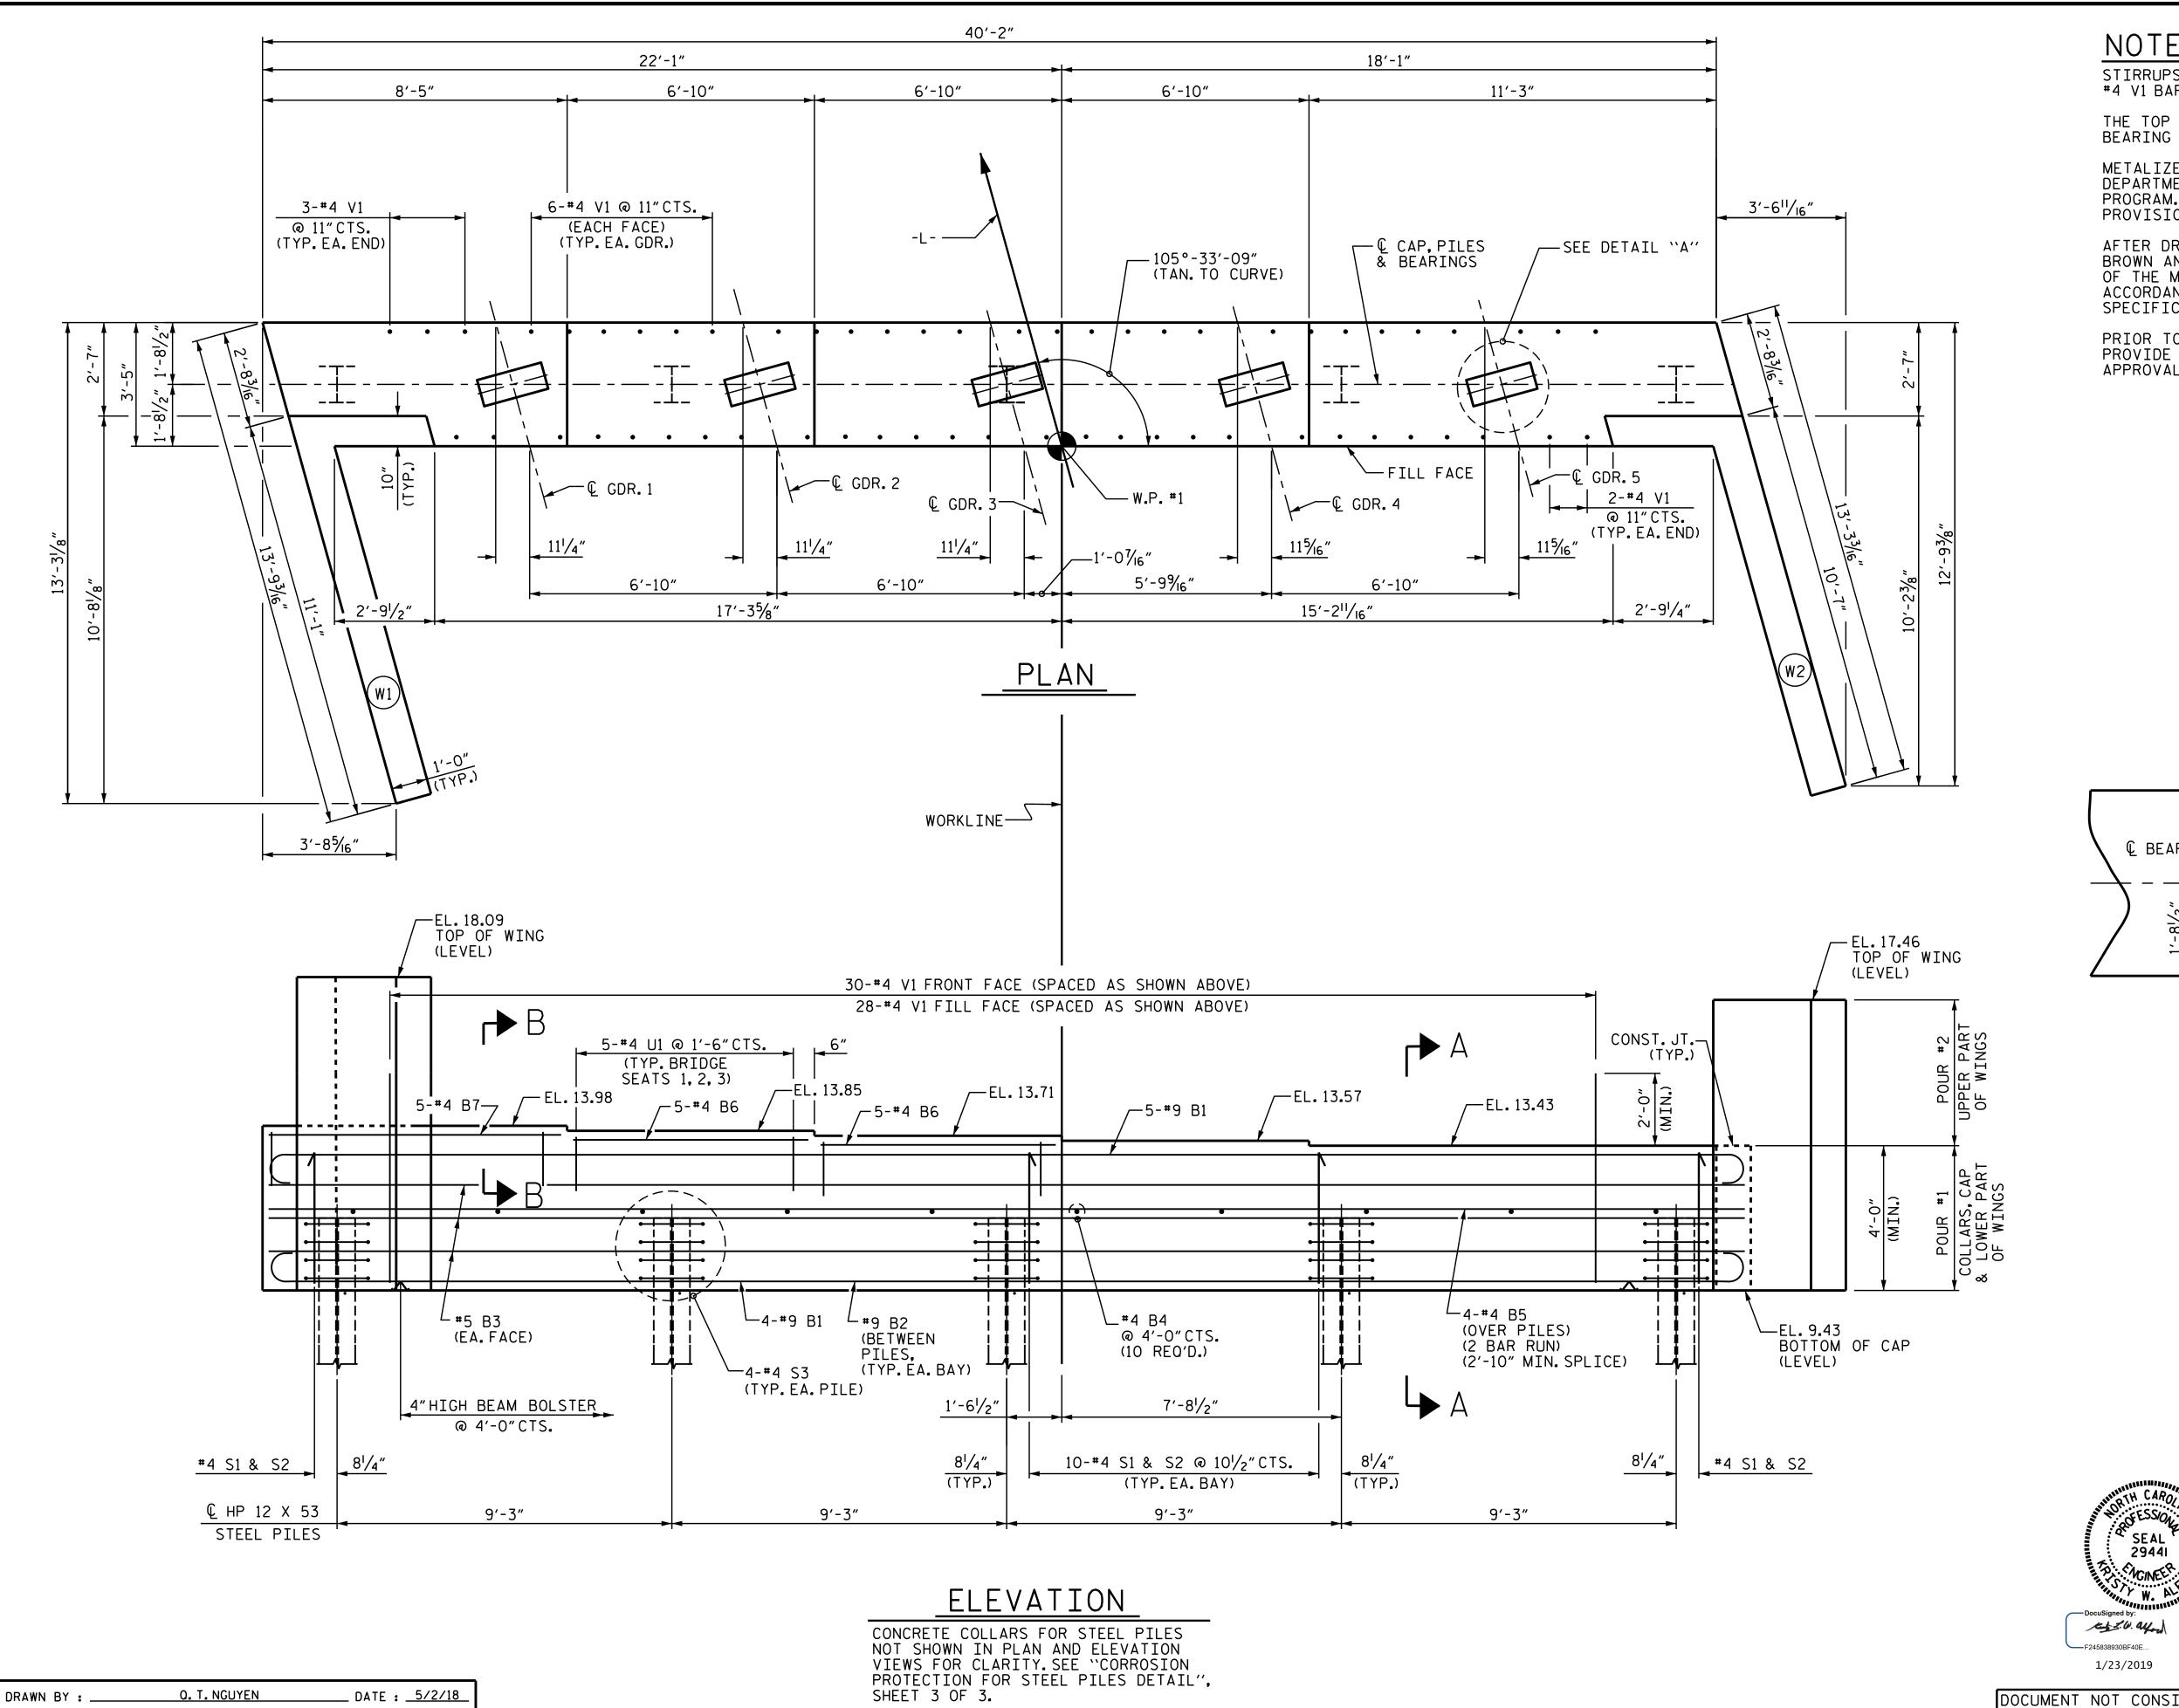

NOTES


STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR #4 V1 BARS.

THE TOP SURFACE OF THE END BENT CAP, EXCEPT THE BEARING AREA, SHALL BE RAKED TO A DEPTH OF 1/4".

METALIZE PILES IN ACCORDANCE WITH TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION)
PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

AFTER DRIVING THE PILES APPLY 1 COAT EACH OF 1080-09 BROWN AND 1080-09 GRAY PAINT TO THE EMBEDDED SECTION OF THE METALLIZED PILE PRIOR TO CONCRETE EMBEDMENT IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS.

PRIOR TO BEGINNING METALLIZATION THE CONTRACTOR WILL PROVIDE METALLIZED SAMPLES TO THE ENGINEER FOR APPROVAL.

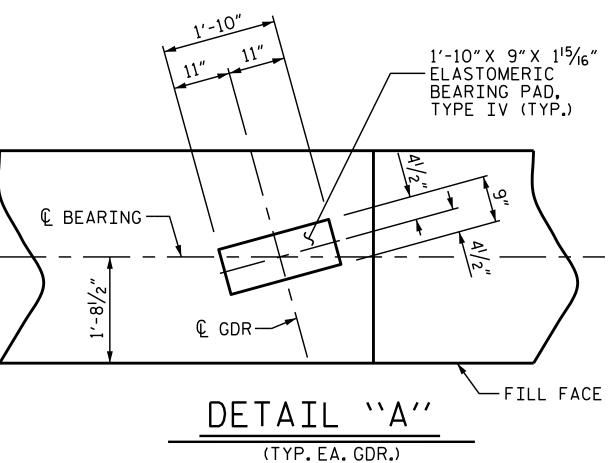

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 1 OF 3

STR. #1

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

SUBSTRUCTURE

INTEGRAL END BENT 1 (WBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

SEAL 29441

SHEET NO. REVISIONS S1-27 DATE: TOTAL SHEETS


23-JAN-2019 08:24
Z:\Structures\Plans\Str1\R-5021_SMU_ 01_E_090259.dgn
kalford


_ DATE : <u>8/18</u>


M.K.BEARD


DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/10/19

CHECKED BY : .

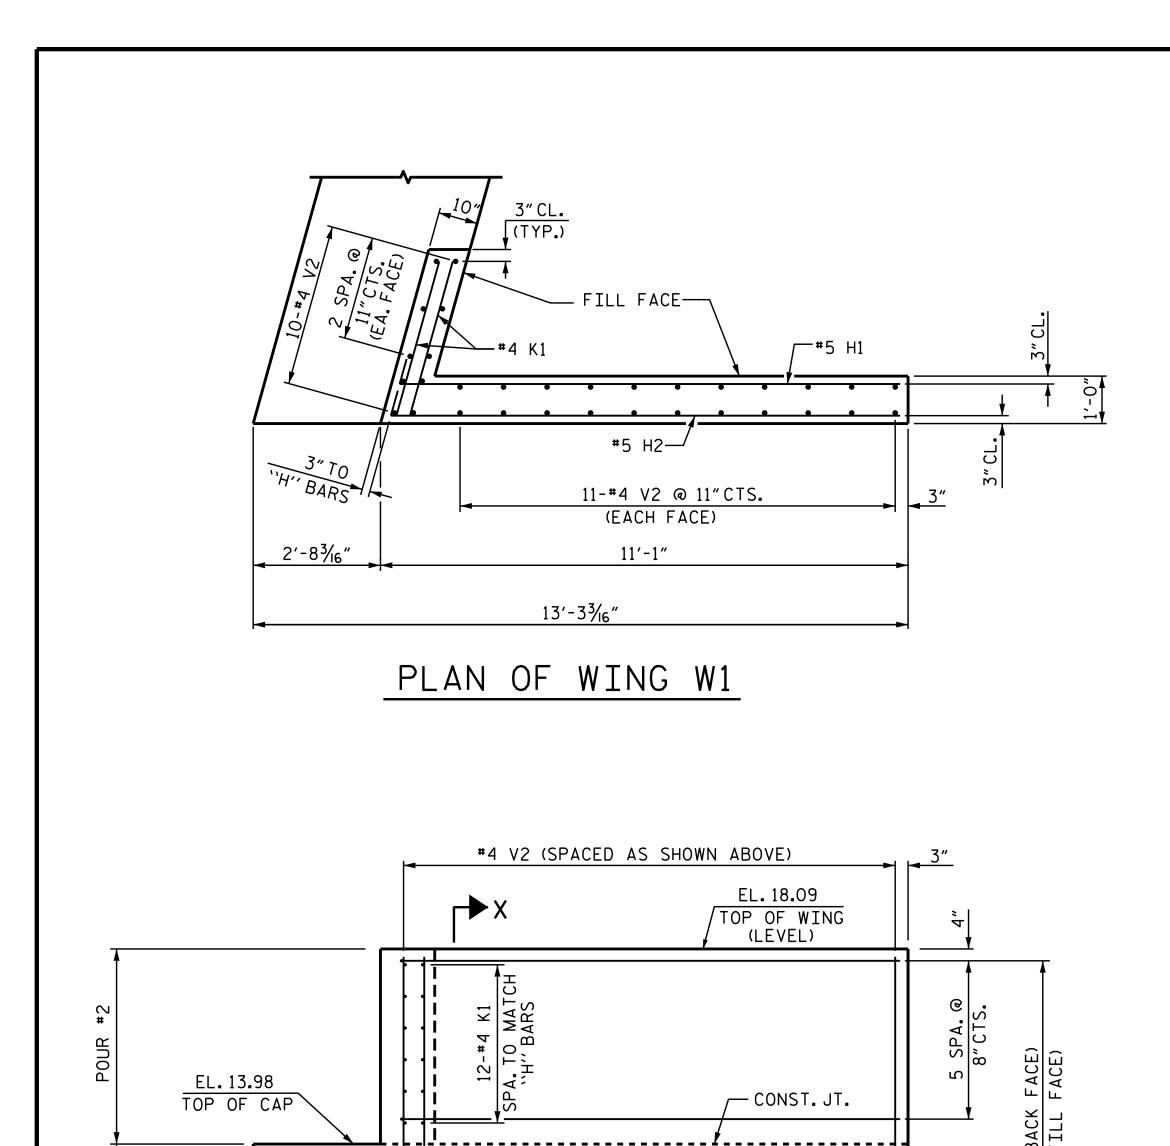

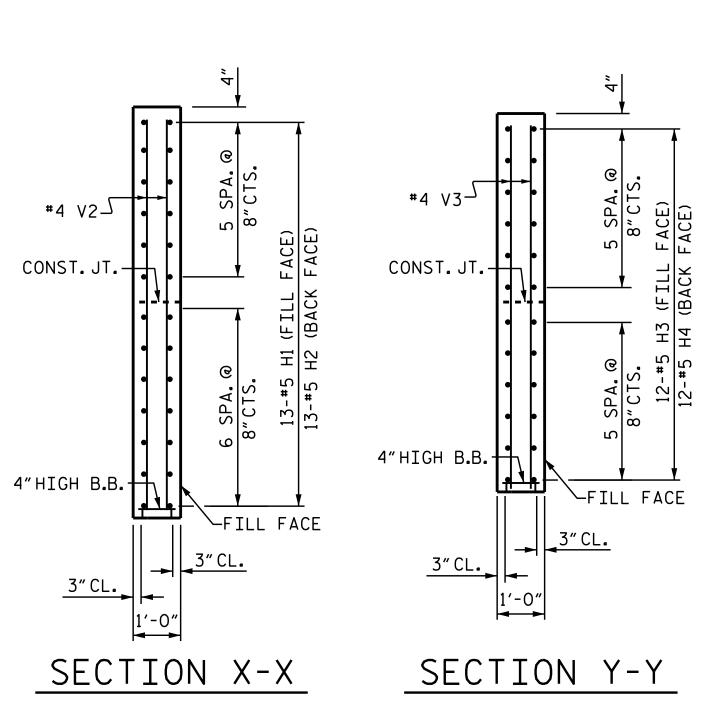

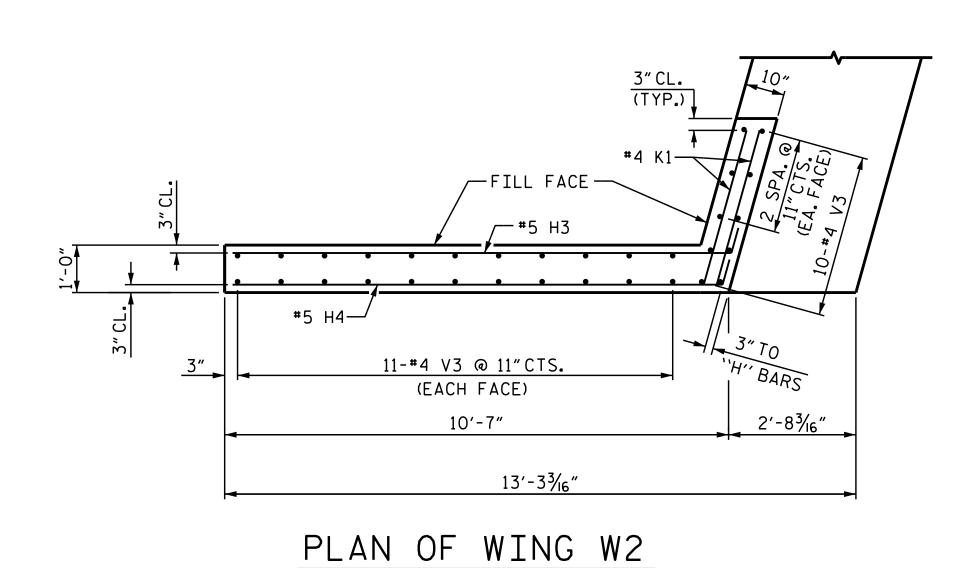

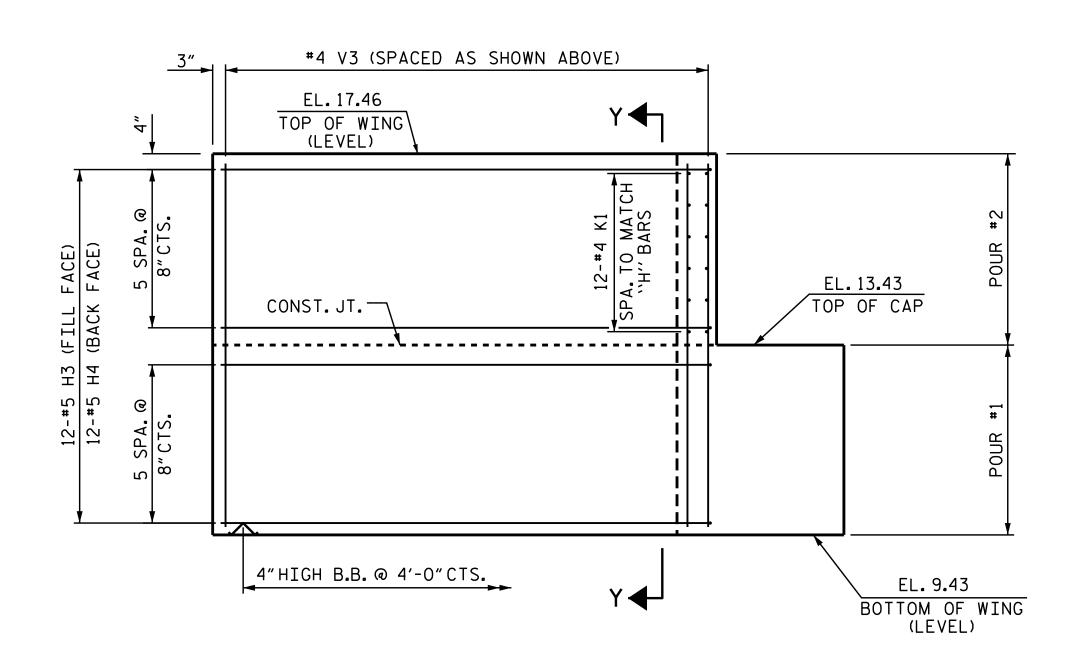

ELEVATION OF WING W2

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SEAL
26445

NOINEER
Docusigned by:

P. Korey Newton
1/20/2019

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

SUBSTRUCTURE
INTEGRAL
END BENT 1
(WBL)

REVISIONS SHEET NO.

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 A 38

STR. #1

SHEET 2 OF 3

DRAWN BY: O.T.NGUYEN

CHECKED BY: M.K.BEARD

DATE: 5/2/18

DATE: 8/18

DESIGN ENGINEER OF RECORD: A.K.PATEL


DATE: 1/10/19


EL. 9.43

BOTTOM OF WING (LEVEL)

ELEVATION OF WING W1

4" HIGH B.B. @ 4'-0" CTS.

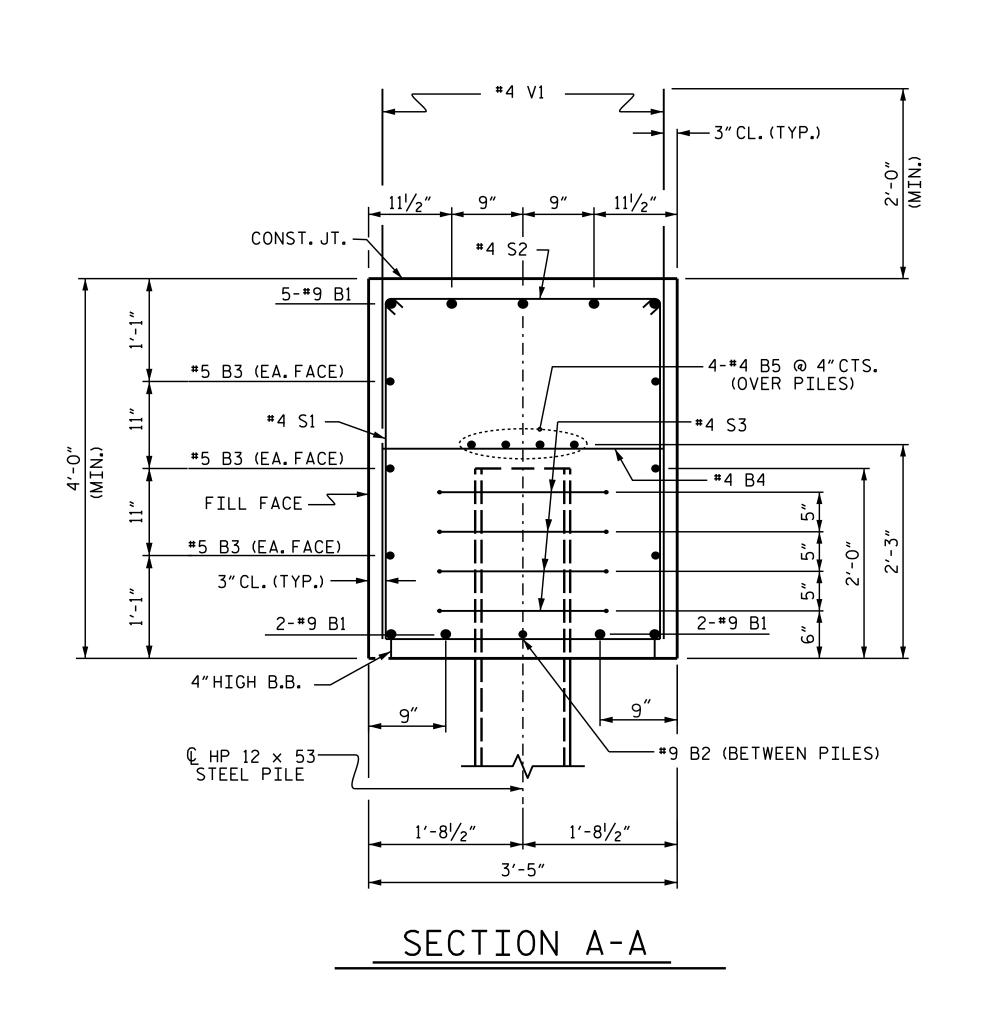

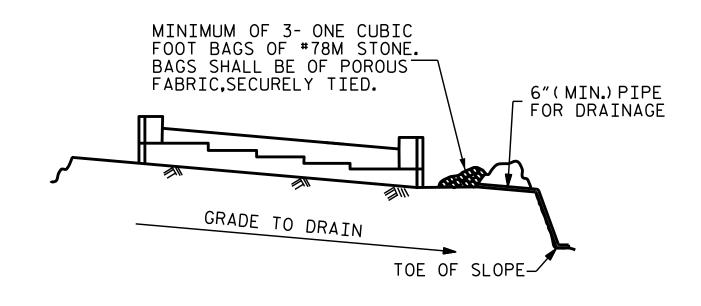



BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL. CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.


BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETER-MINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.

NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

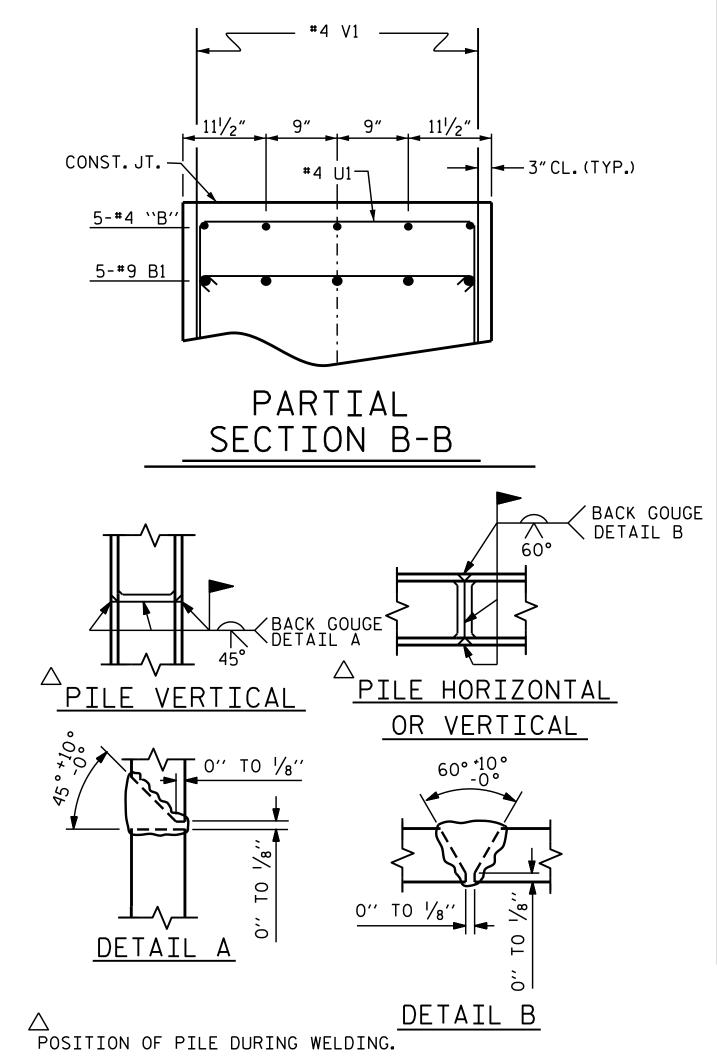

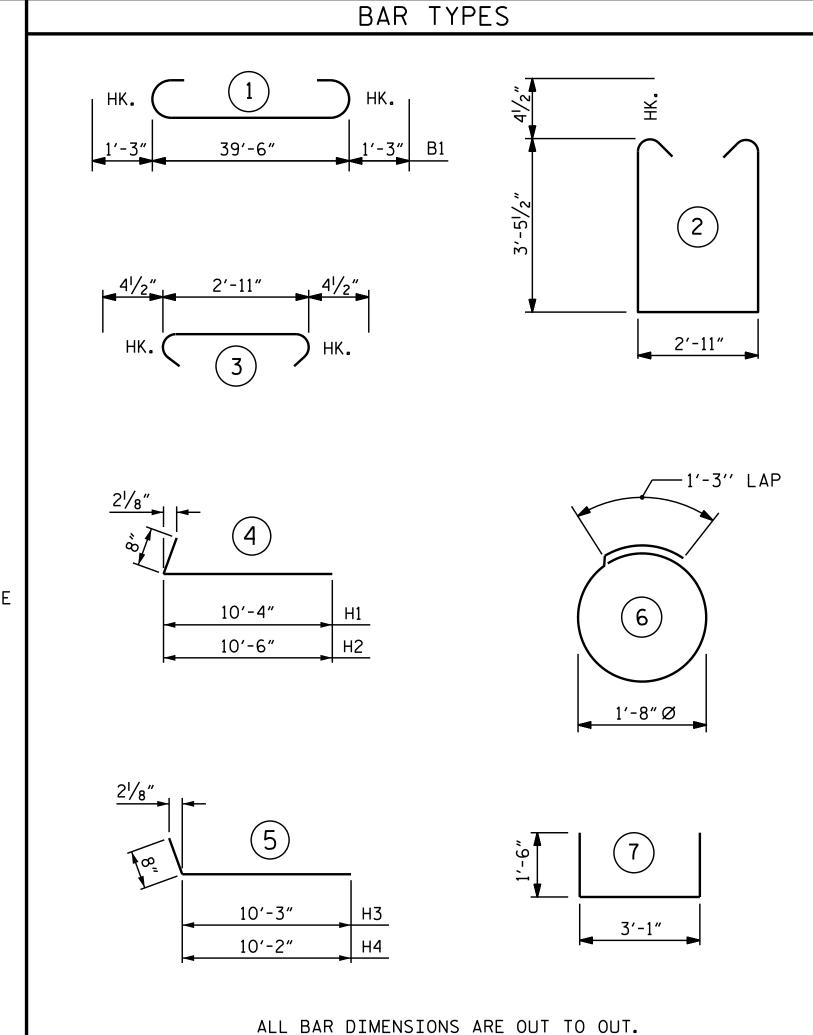


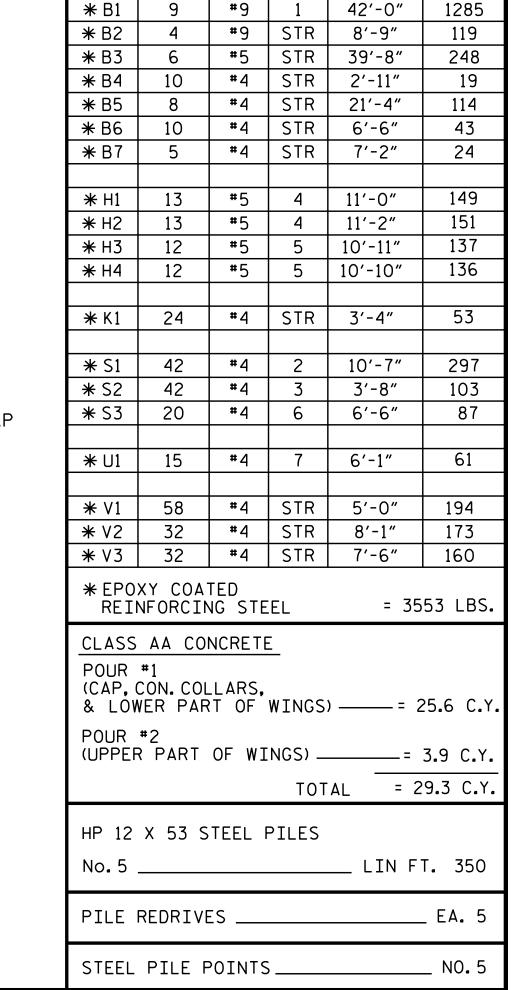


BILL OF MATERIAL

NO. | SIZE | TYPE | LENGTH | WEIGHT

PILE SPLICE DETAILS

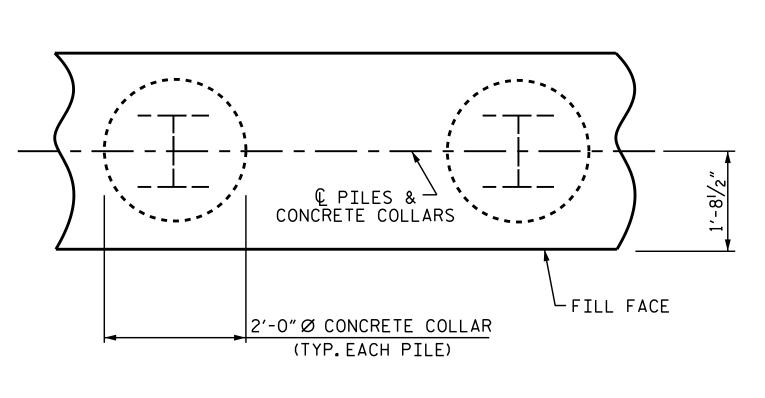

PLAN

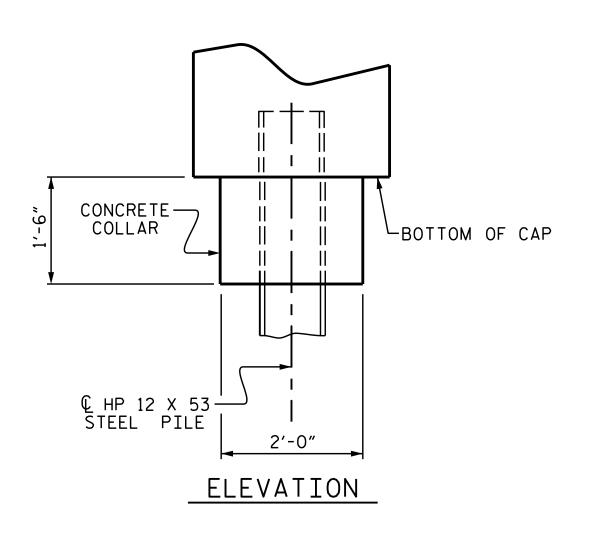

CORROSION PROTECTION FOR STEEL PILES DETAIL

PROJECT NO. R-5021 BRUNSWICK COUNTY 369+42.00 -L-STATION:_

SHEET 3 OF 3

26445

P. Korey Newton

O SUCINEES

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH


> SUBSTRUCTURE INTEGRAL END BENT 1 (WBL)

1/20/2019 **REVISIONS** SHEET NO. S1-29 DATE: DATE: BY: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL TOTAL SHEETS SIGNATURES COMPLETED

STR. #1

_ DATE : <u>5/2/18</u> Q. T. NGUYEN DRAWN BY : _ M.K.BEARD DATE : 8/18 CHECKED BY : ___ _ DATE : 1/10/19 DESIGN ENGINEER OF RECORD: A.K. PATEL


20-JAN-2019 22:04 Z:\Structures\Plans\Str1\R-5021_SMU_ 01_E_090259.dgn

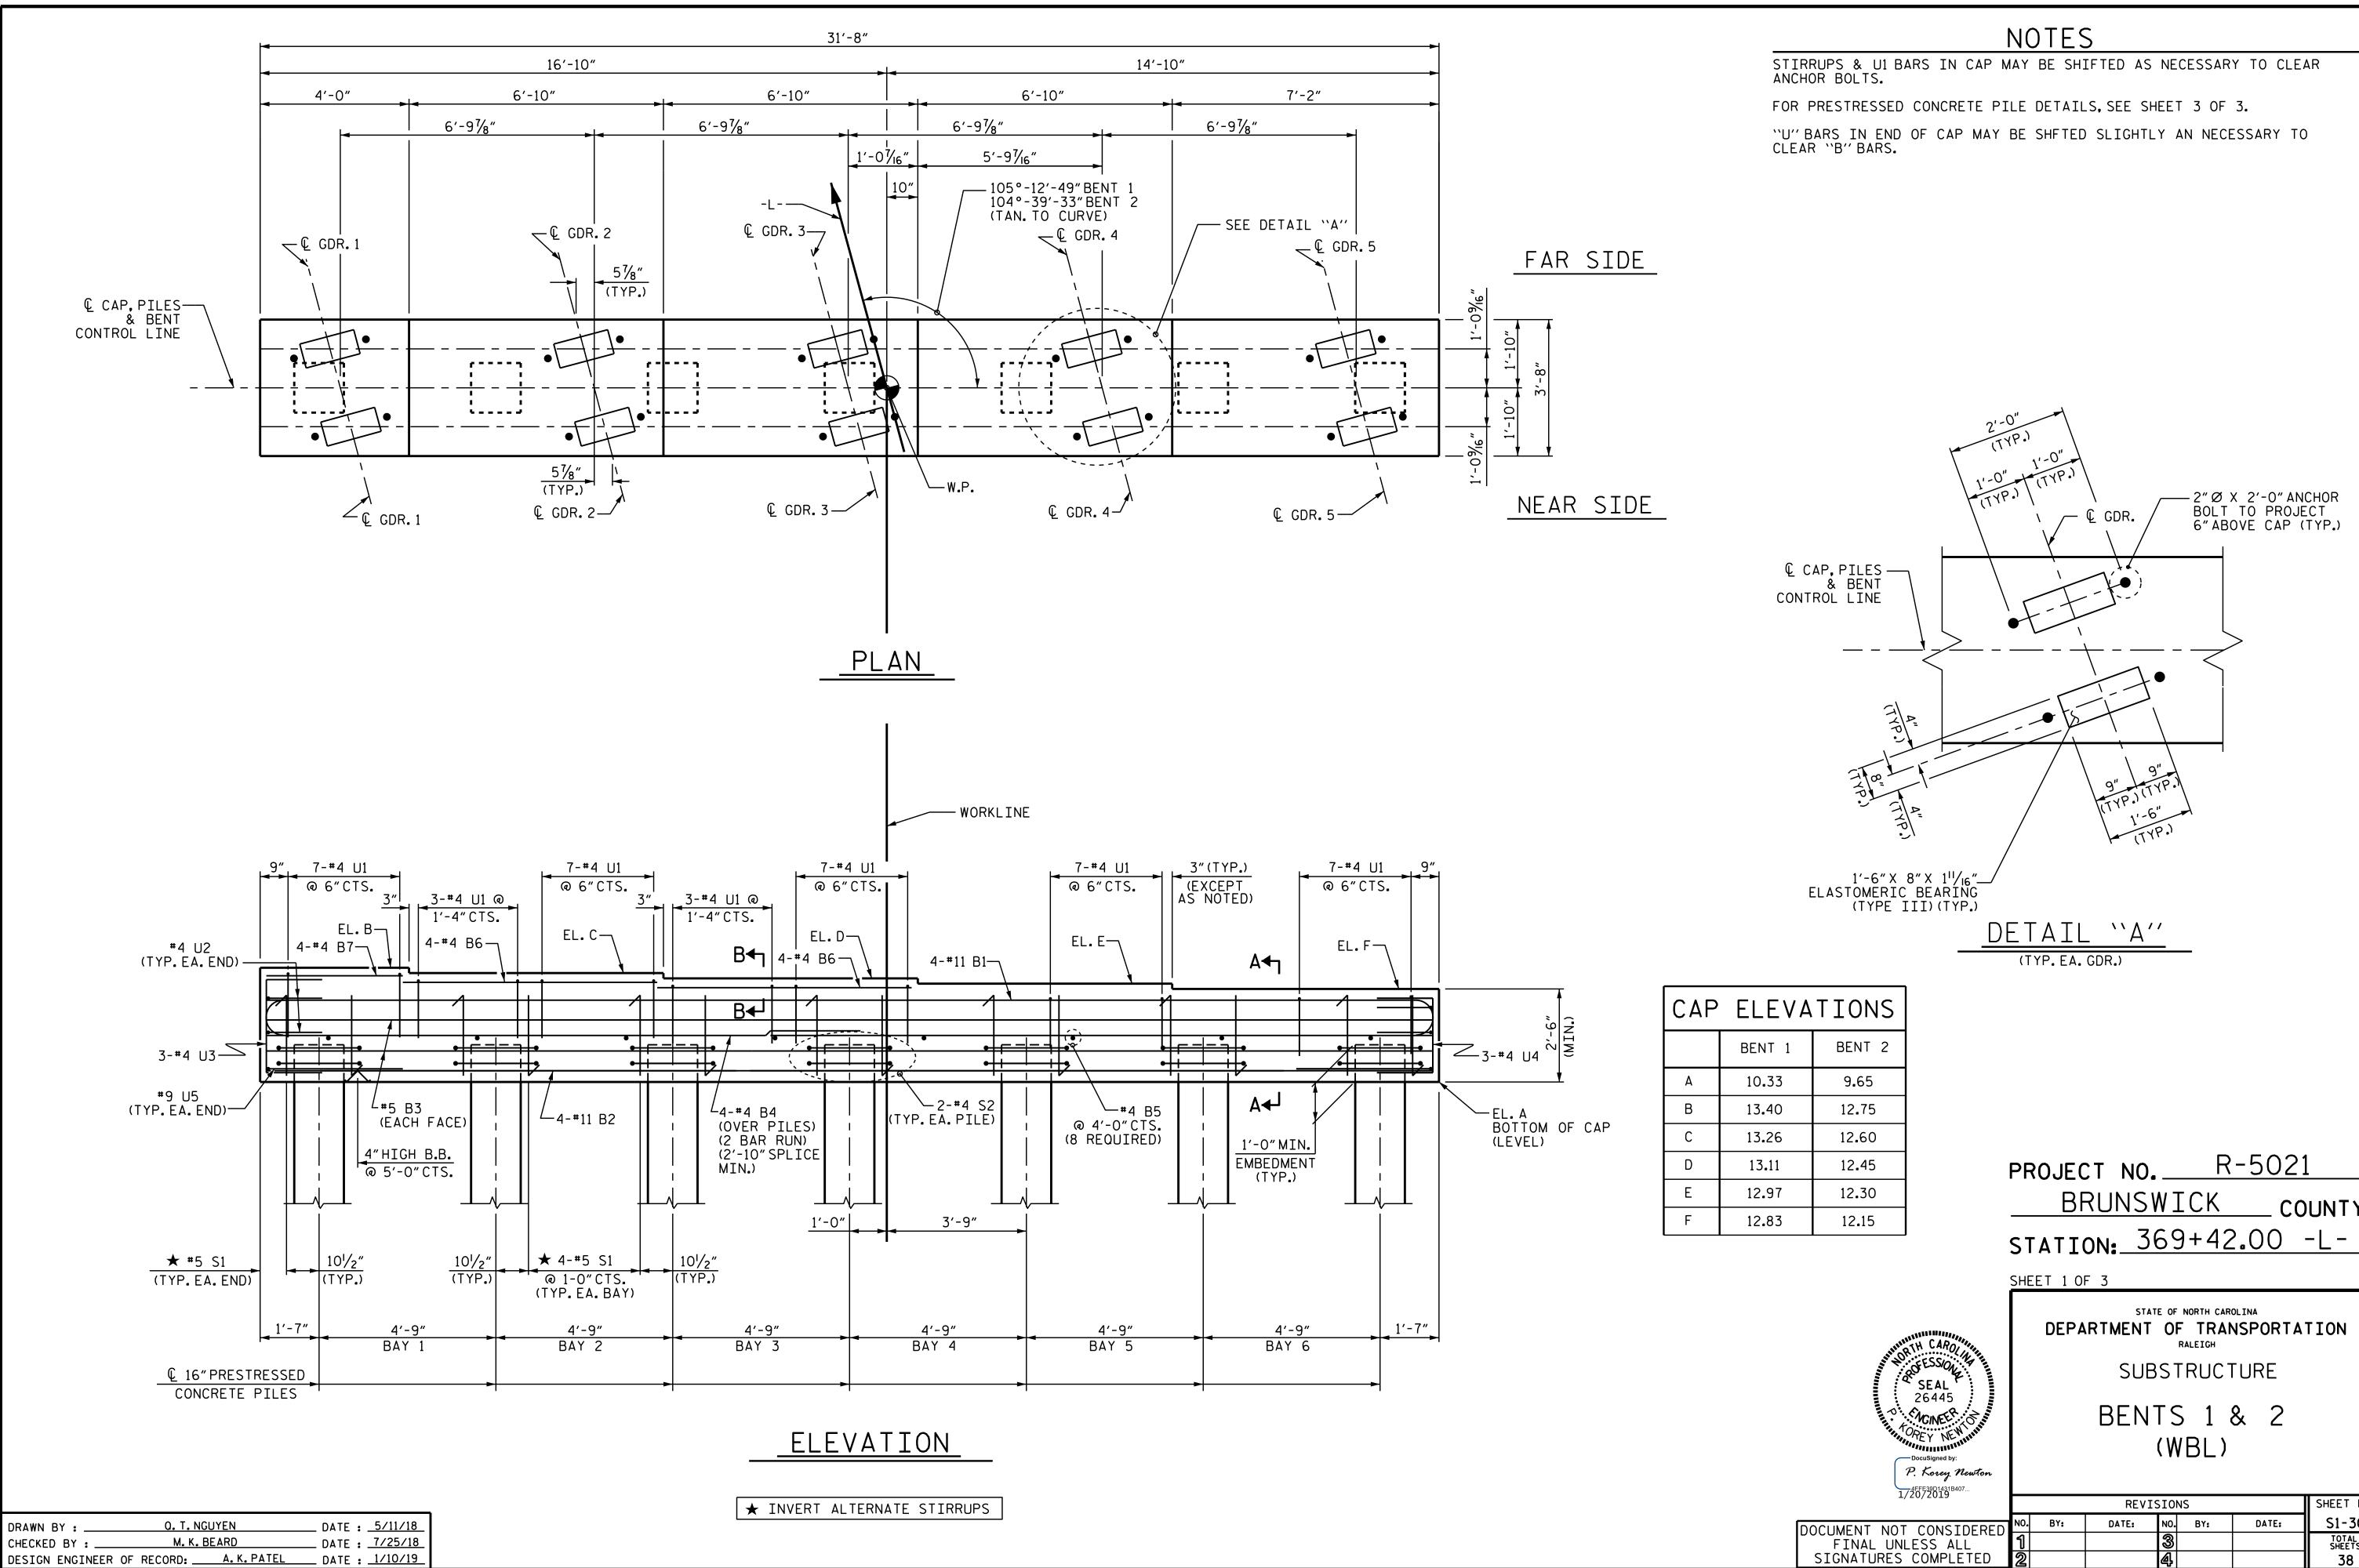


20-JAN-2019 22:04 Z:\Structures\Plans\Str1\R-5021_SMU_01_B_090259.dgn


SHEET NO. S1-30 DATE: TOTAL SHEETS

_ COUNTY

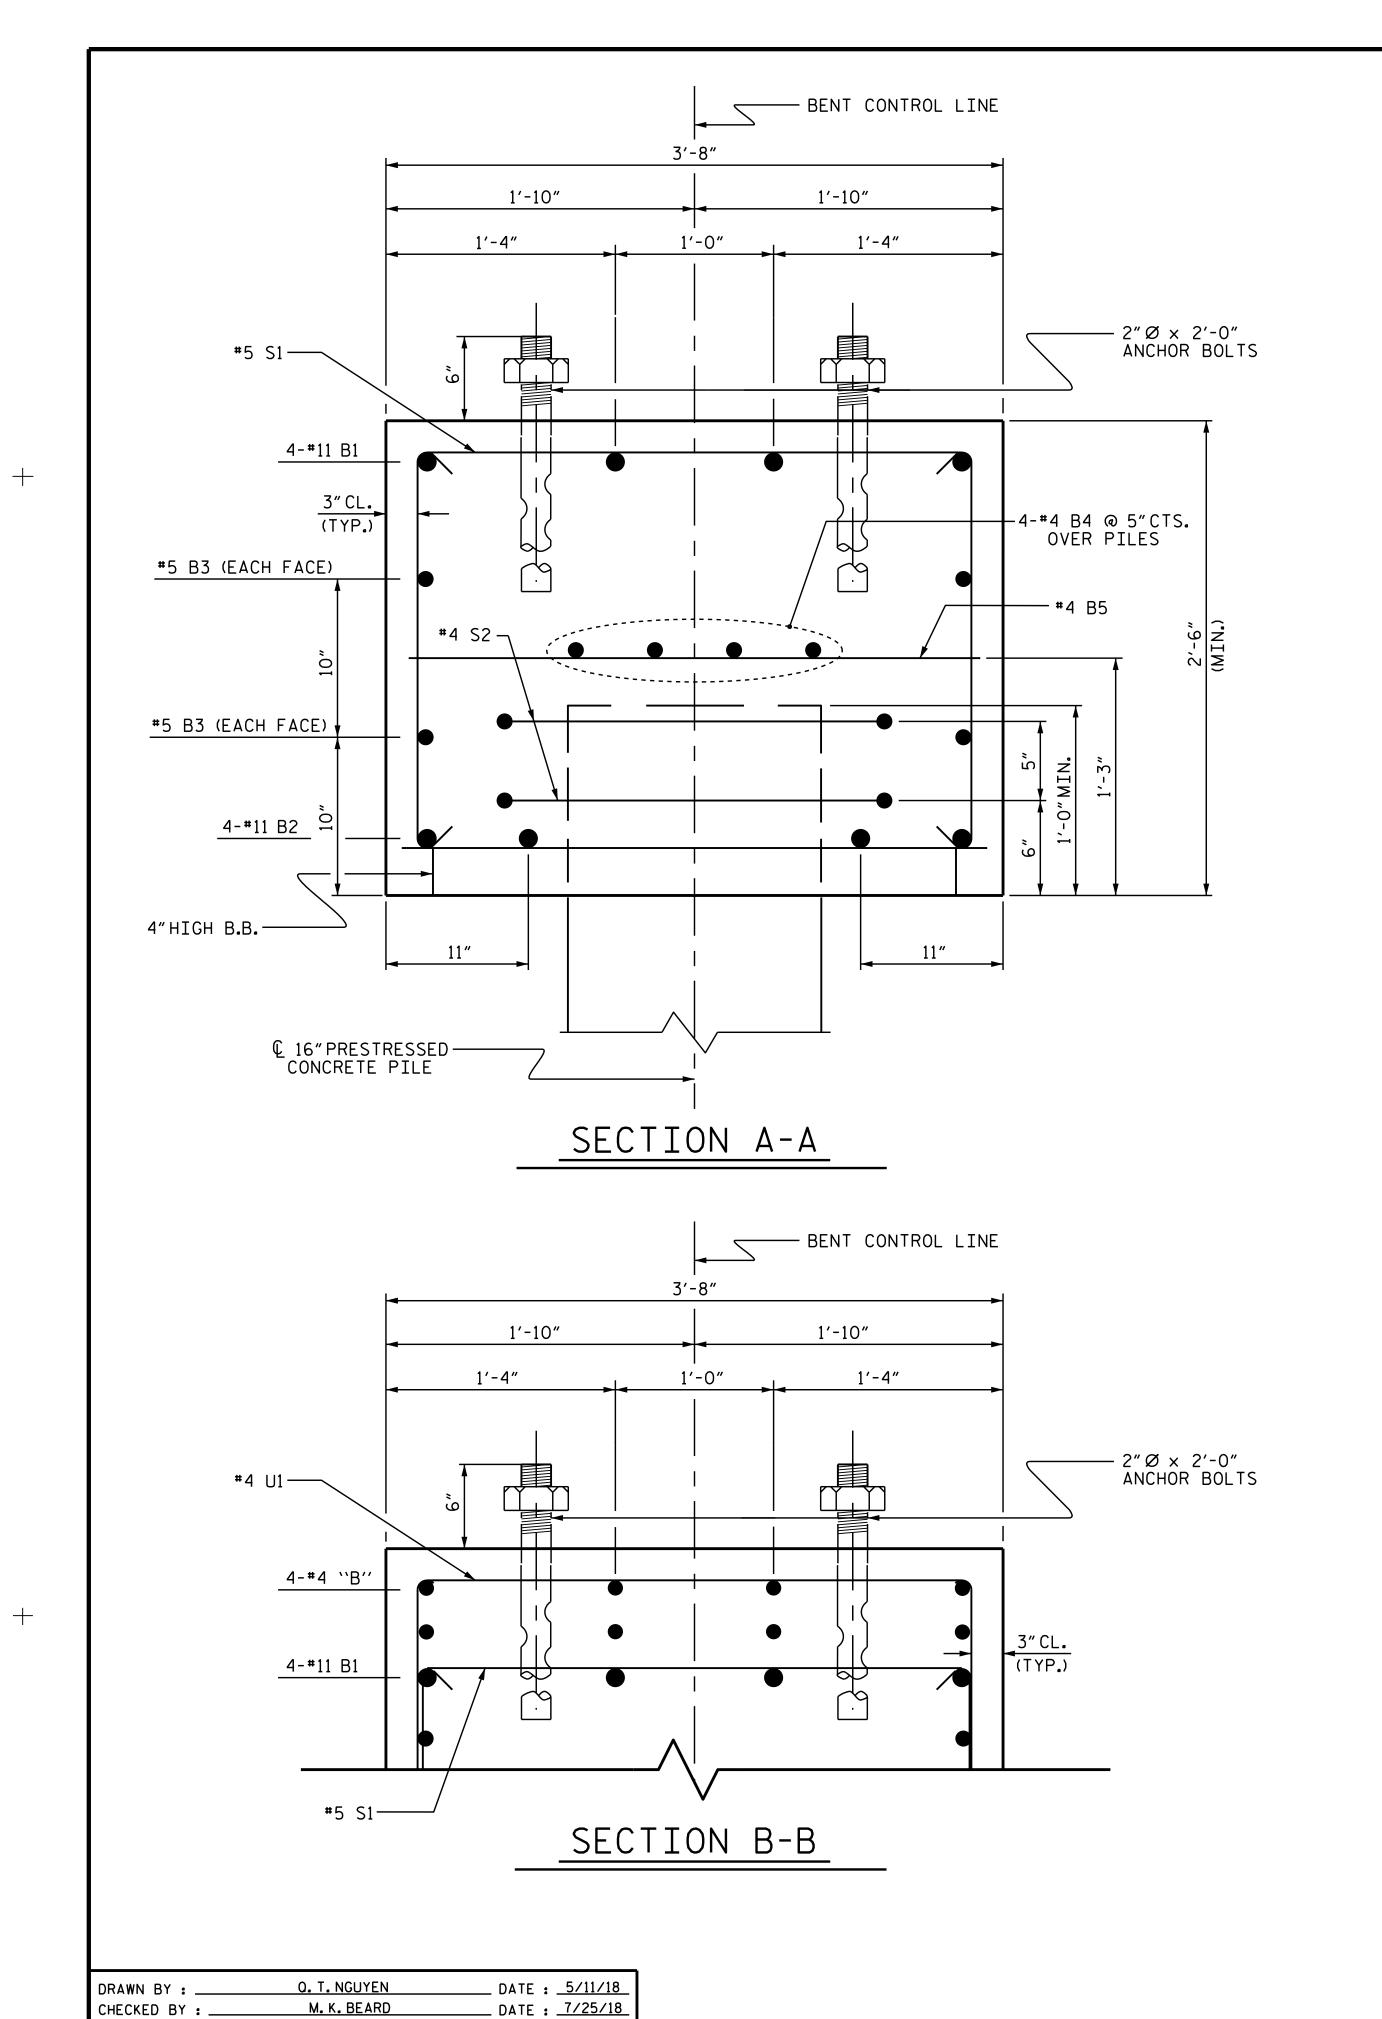

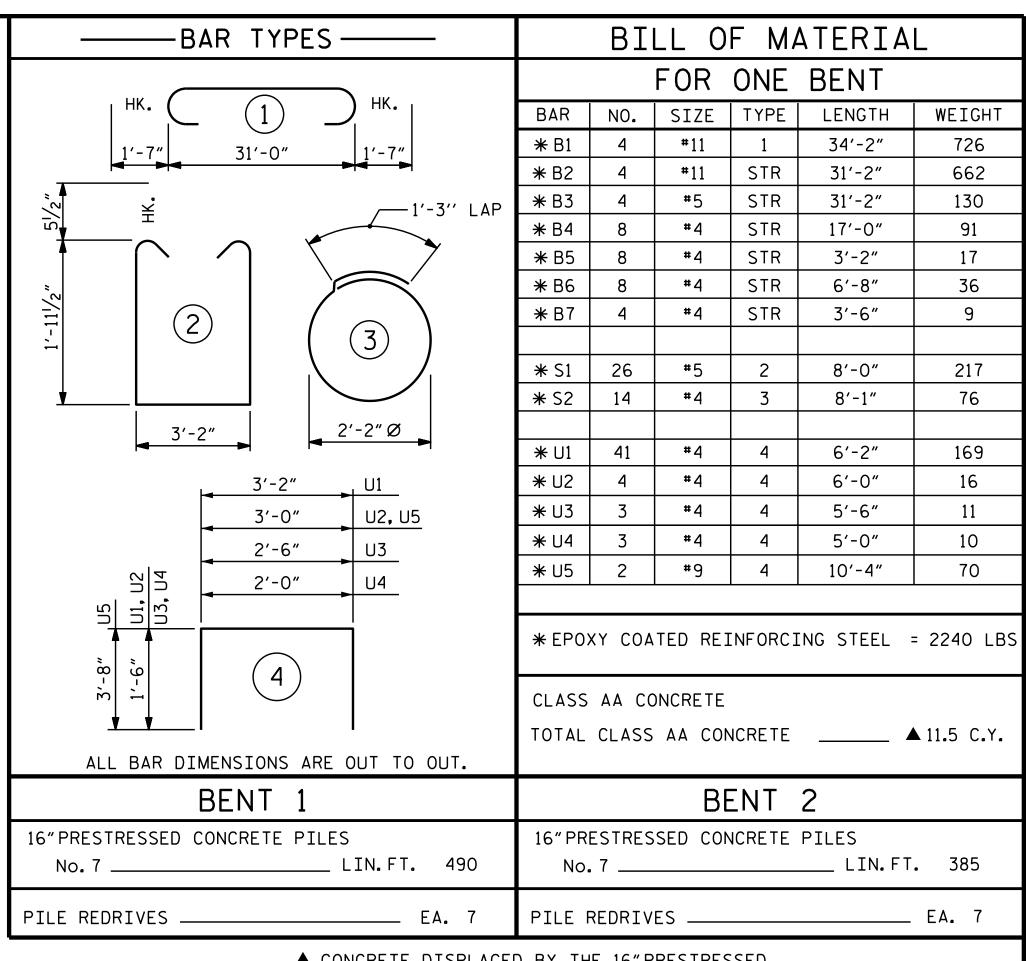

▲ CONCRETE DISPLACED BY THE 16"PRESTRESSED CONCRETE PILES HAS BEEN DEDUCTED FROM THE CONCRETE QUANTITY.

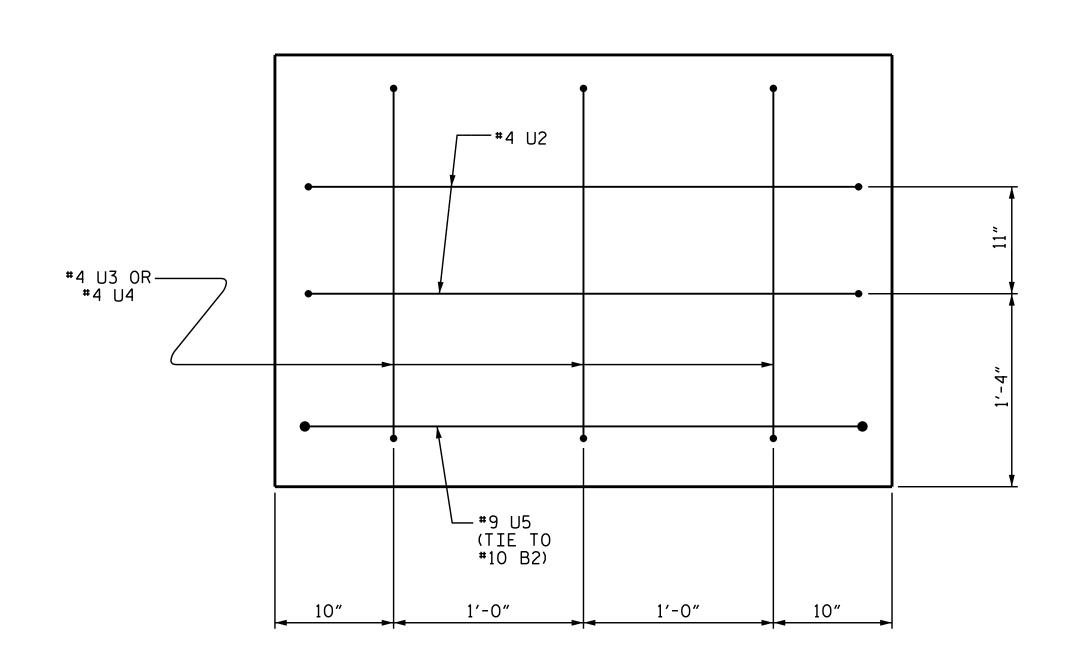

END OF CAP VIEW

PROJECT NO. R-5021 BRUNSWICK __ COUNTY STATION: 369+42.00 -L-

SHEET 2 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUBSTRUCTURE

BENTS 1 & 2 (WBL)


DOCU SI


SEAL 26445

P. Korey Newton

1/20/2019							
1/20/2019			REVI	SION	NS		SHEET NO.
UMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-31
FINAL UNLESS ALL	1			3			TOTAL SHEETS
IGNATURES COMPLETED	2			4			38

DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/10/19

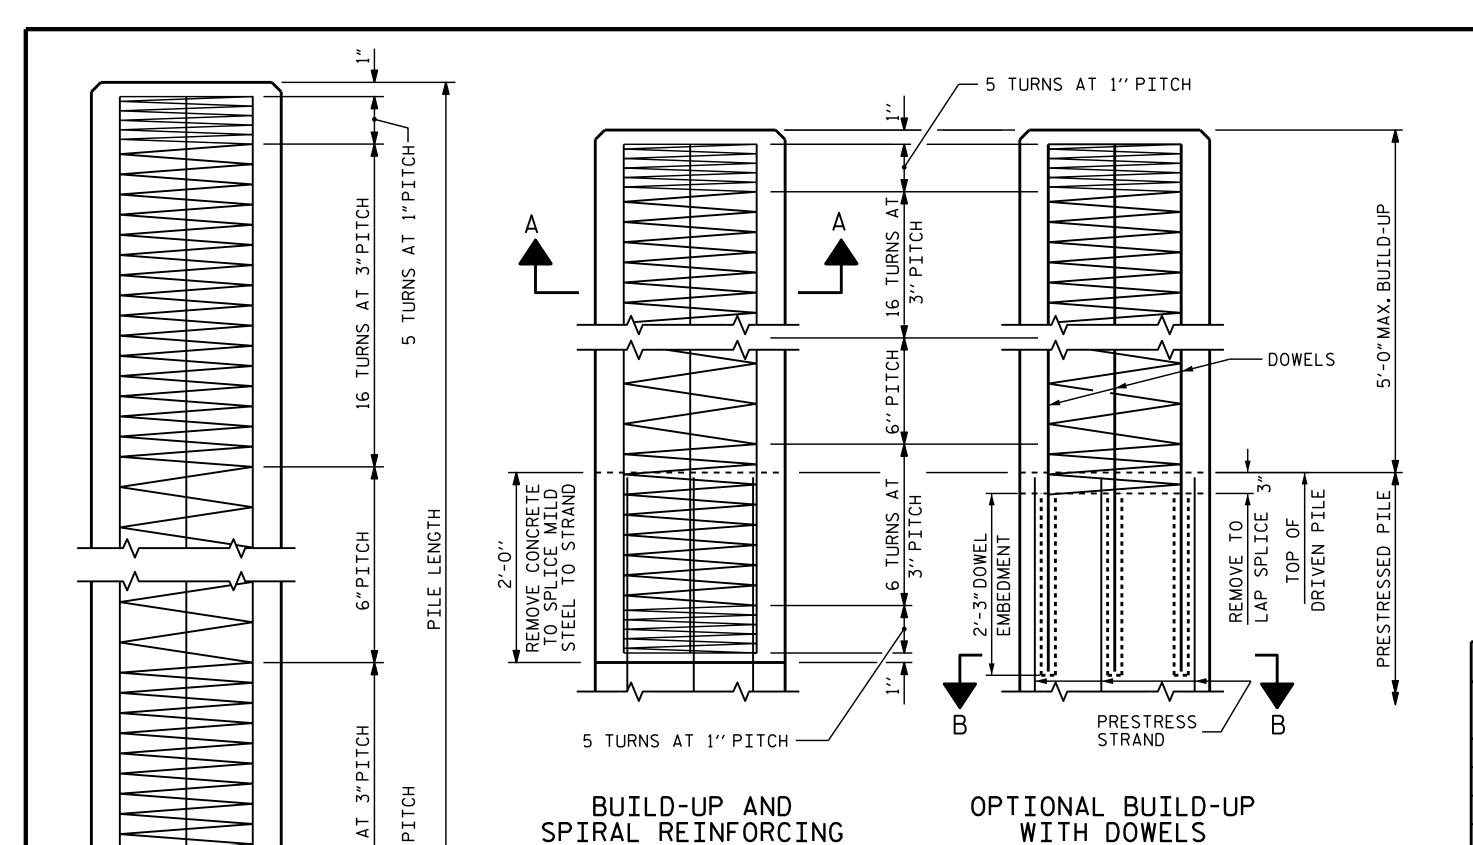

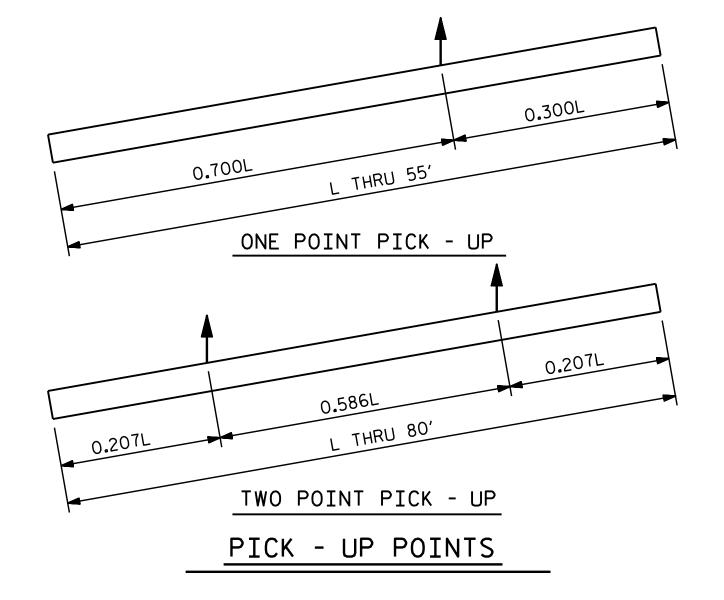

QUANTITIES FOR ONE 16"PRESTRESSED PILE							
	CONCRETE	PILE WT.	ONE POIN	T PICK-UP	TWO POINT PICK-U		
LENGTH	CU. YDS.	TONS	0.300L	0.700L	0.207L	0.586L	
25′-0″	1.63	3.31	7′-6″	17′-6″	5′-2″	14'-8"	
30′-0″	1.96	3.97	9′-0″	21'-0"	6′-2 ^l / ₂ "	17'-7"	
35′-0″	2.29	4.63	10'-6"	24'-6"	7′-3″	20′-6″	
40′-0″	2.61	5.29	12'-0"	28'-0"	8'-3 ¹ / ₂ "	23′-5″	
45'-0"	2.94	5.95	13′-6″	31′-6″	9′-4″	26'-4"	
50′-0″	3.27	6.61	15'-0"	35′-0"	10'-4"	29'-4"	
55′-0″	3 . 59	7.28	16′-6″	38′-6″	11'-41/2"	32′-3″	
60′-0″	3.92	7.94			12′-5″	35′-2"	
65′-0″	4.25	8.60			13′-51/2″	38'-1"	
70′-0″	4 . 57	9.26			14'-6"	41'-0"	
75′-0″	4.90	9.92			15'-61/2"	43'-11"	
80′-0″	5.23	10.58			16′-7"	46′-10″	

NOTES

PRESTRESSED CONCRETE STRENGTH : f'c = 7,500 PSI
BUILD-UP CONCRETE STRENGTH : f'c = 7,500 PSI

STRAND DATA:

SIZE	GRADE	AREA	ULTIMATE STRENGTH	APPLIED PRESTRESS FORCE
1/2′′	270 L.R.	0.153	41,300# PER STRAND	30,980# PER STRAND
0.6"	270 L.R.	0.217	58,600# PER STRAND	43,940# PER STRAND

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS CONFORMING TO AASHTO M203.STRAND SAMPLING REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

AT THE CONTRACTOR'S OPTION, $\frac{1}{2}$ " OR 0.6" STRANDS MAY BE USED IN EITHER STRAND CONFIGURATION SHOWN IN THE TYPICAL SECTION DETAIL. MIXING OF STRAND SIZE IS NOT ALLOWED.

THE SLIP-FORM METHOD OF CASTING PILES WILL NOT BE PERMITTED.

TRANSFER THE LOAD FROM THE ANCHORAGES TO THE PILE AFTER THE CONCRETE HAS ATTAINED A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI.

IF STRAND STRESS IS RELIEVED BY BURNING, THE STRANDS SHALL BE BURNED IN OPPOSITE PAIRS AS INDICATED IN THE TYPICAL PATTERN SHOWN. FOR ANY NUMBER OF STRANDS, BURN IN OPPOSITE PAIRS AND SYMMETRICALLY ABOUT BOTH THE VERTICAL AND HORIZONTAL AXES. STRANDS 1-1 SHALL BE BURNED BEFORE 2-2, ETC. NOT MORE THAN 4 STRANDS, SAY 3-3 AND 4-4, MAY BE BURNED AT ANY ONE SECTION BEFORE THESE SAME PAIRS OF STRANDS ARE BURNED AT BOTH ENDS OF THE BED AND BETWEEN EACH PAIR OF PILES IN THE BED.

PROPOSED DEVICES FOR LIFTING PILES, RECESS DETAILS, AND PATCHING MATERIAL SHALL BE DETAILED IN SHOP DRAWINGS. AFTER ATTACHMENTS HAVE BEEN REMOVED, OPENINGS SHALL BE REPAIRED SUCH THAT THE APPEARANCE OF THE PILE IS UNIFORM.

WHERE CAST-IN-PLACE LIFTING DEVICES ARE NOT USED, PICK-UP POINTS ARE TO BE INDICATED WITH A 2" WIDE BLACK MARK.

DRIVE PILES USING A METHOD APPROVED BY THE ENGINEER, WHEREBY THE HEAD OF THE PILE IS NOT DAMAGED.

DRIVING OF THE BUILT-UP PILE WILL NOT BE PERMITTED UNTIL THE CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF 5,000 PSI AND UNTIL A PERIOD OF SEVEN DAYS HAS ELAPSED SINCE CASTING OF THE BUILD-UP.

DOWEL INSTALLATION FOR OPTIONAL BUILD-UP

GROUT COMPRESSIVE STRENGTH: f'c= 5,000 PSI

BEFORE DRILLING DOWEL HOLES, REMOVE THE UPPER 3"OF CONCRETE FROM THE TOP OF THE PILE WITHOUT DAMAGE TO THE REINFORCING STEEL. THE REMOVAL PLANE SHOULD BE NORMAL TO THE EDGE OF THE PILE.

DOWEL HOLES SHALL BE POSITIONED TO MAINTAIN $\frac{1}{2}$ CLEAR TO ALL EXISTING PRESTRESSING STRANDS IN THE CONCRETE PILE.

FIELD DRILLED HOLES SHALL BE CLEAN AND FREE OF ANY OBSTRUCTIONS BEFORE GROUTING OF DOWELS. DOWEL BARS SHALL BE INSTALLED AND GROUTED WITH AN APPROVED NON-SHRINK GROUT.

THE SPIRAL REINFORCING IN ALL BUILD-UPS SHALL BE W4.0 COLD DRAWN WIRE WHICH SHALL BE SECURED TO THE LONGITUDINAL REINFORCEMENT TO MAINTAIN PITCH.

SHEET 3 OF 3

THE SPIRAL REINFORCING IN THE BUILD-UP AND THE PRESTRESSED CONCRETE PILE SHALL BE SPLICED BY OVERLAPPING A MIN. OF ONE TURN.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

DE

STR. #1

29441

TO CINEER

tut I. W. ayou

DEPARTMENT OF TRANSPORTATION

RALEIGH

STANDARD

STANDARD

16" PRESTRESSED CONCRETE PILE (WBL)

| DOCUMENT NOT CONSIDERED | FINAL UNLESS ALL | SIGNATURES COMPLETED | 2 | REVISIONS | SHEET NO S1-32 | SHEET S1-32 | SHEET NO S1-32 | SHEET NO

SECTION "B-B"

 $1\frac{1}{2}$ " Ø FIELD DRILLED HOLE (TYP.) W/ #8 DOWEL.


TYP.

(AT THE CONTRACTOR'S OPTION, PILE BUILD-UP MAY BE CONSTRUCTED WITH DOWELS.)

PRESTRESS STRAND (TYP.) -

2"CL.

TYP.

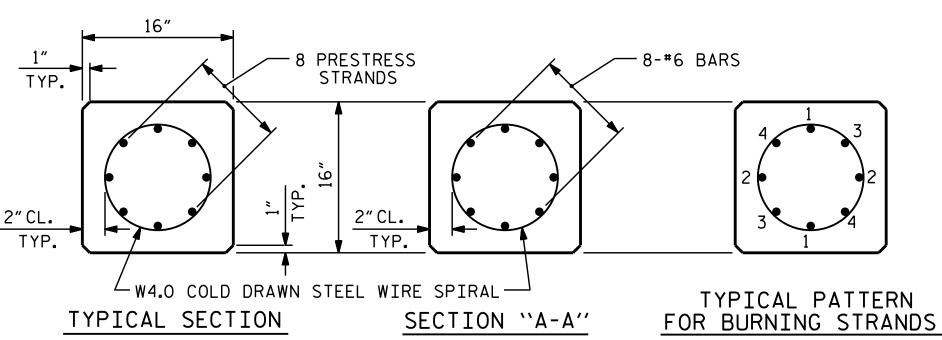

TYPICAL SECTION

8 PRESTRESS
STRANDS

8-#6 BARS

3 1 4 2 2 CL.
TYP.

TYPICAL PATTERN
FOR BURNING STRANDS

1/2" OR 0.6" Ø GRADE 270 L.R. PRESTRESS STRANDS

OR 0.6" Ø GRADE 270 L.R. PRESTRESS STRANDS

ELEVATION

HP 8 × 36 OR W 8 X 35

ELEVATION

HP 8 × 36 OR W 8 X 35

PRESTRESSING STRANDS

NDS

PILE TIP DETAILS

FOR 16" SQUARE PRESTRESSED CONCRETE PILE

ASSEMBLED BY: QTN
CHECKED BY: PKN

DATE: 1/19
DATE: 1/19

DRAWN BY: RH 9/98
CHECKED BY: LES 10/98
REV. IO/I/II
REV. I2/I4
REV. I2/I7
MAA/TMG
REV. I2/I7

CORROSION PROTECTION

PILES SHALL NOT EXCEED 0.40.

THE WATER/CEMENT RATIO FOR PRESTRESSED CONCRETE

ALL BAR SUPPORTS USED IN THE PRESTRESSED CONCRETE PILES, AND ALL INCIDENTAL REINFORCING STEEL SHALL

BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD

PRESTRESSED CONCRETE PILES SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH

THE STANDARD SPECIFICATIONS. THE CONCRETE IN THE

PRESTRESSED CONCRETE PILES SHALL CONTAIN SILICA FUME. SILICA FUME SHALL BE SUBSTITUTED FOR 5%

OF THE PORTLAND CEMENT BY WEIGHT. IF THE OPTION

OF ARTICLE 1024-1 OF THE STANDARD SPECIFICATIONS

TO PARTIALLY SUBSTITUTE CLASS F FLY ASH FOR

FOR THIS SUBSTITUTION AS IT IS CONSIDERED

INCIDENTAL TO THE VARIOUS PAY ITEMS.


PORTLAND CEMENT IS EXERCISED, THEN THE RATE OF

FLY ASH SUBSTITUTION SHALL BE REDUCED TO 1.0 LB OF FLY ASH PER 1.0 LB. NO PAYMENT WILL BE MADE

16′′ □

ELEVATION

SPECIFICATIONS.

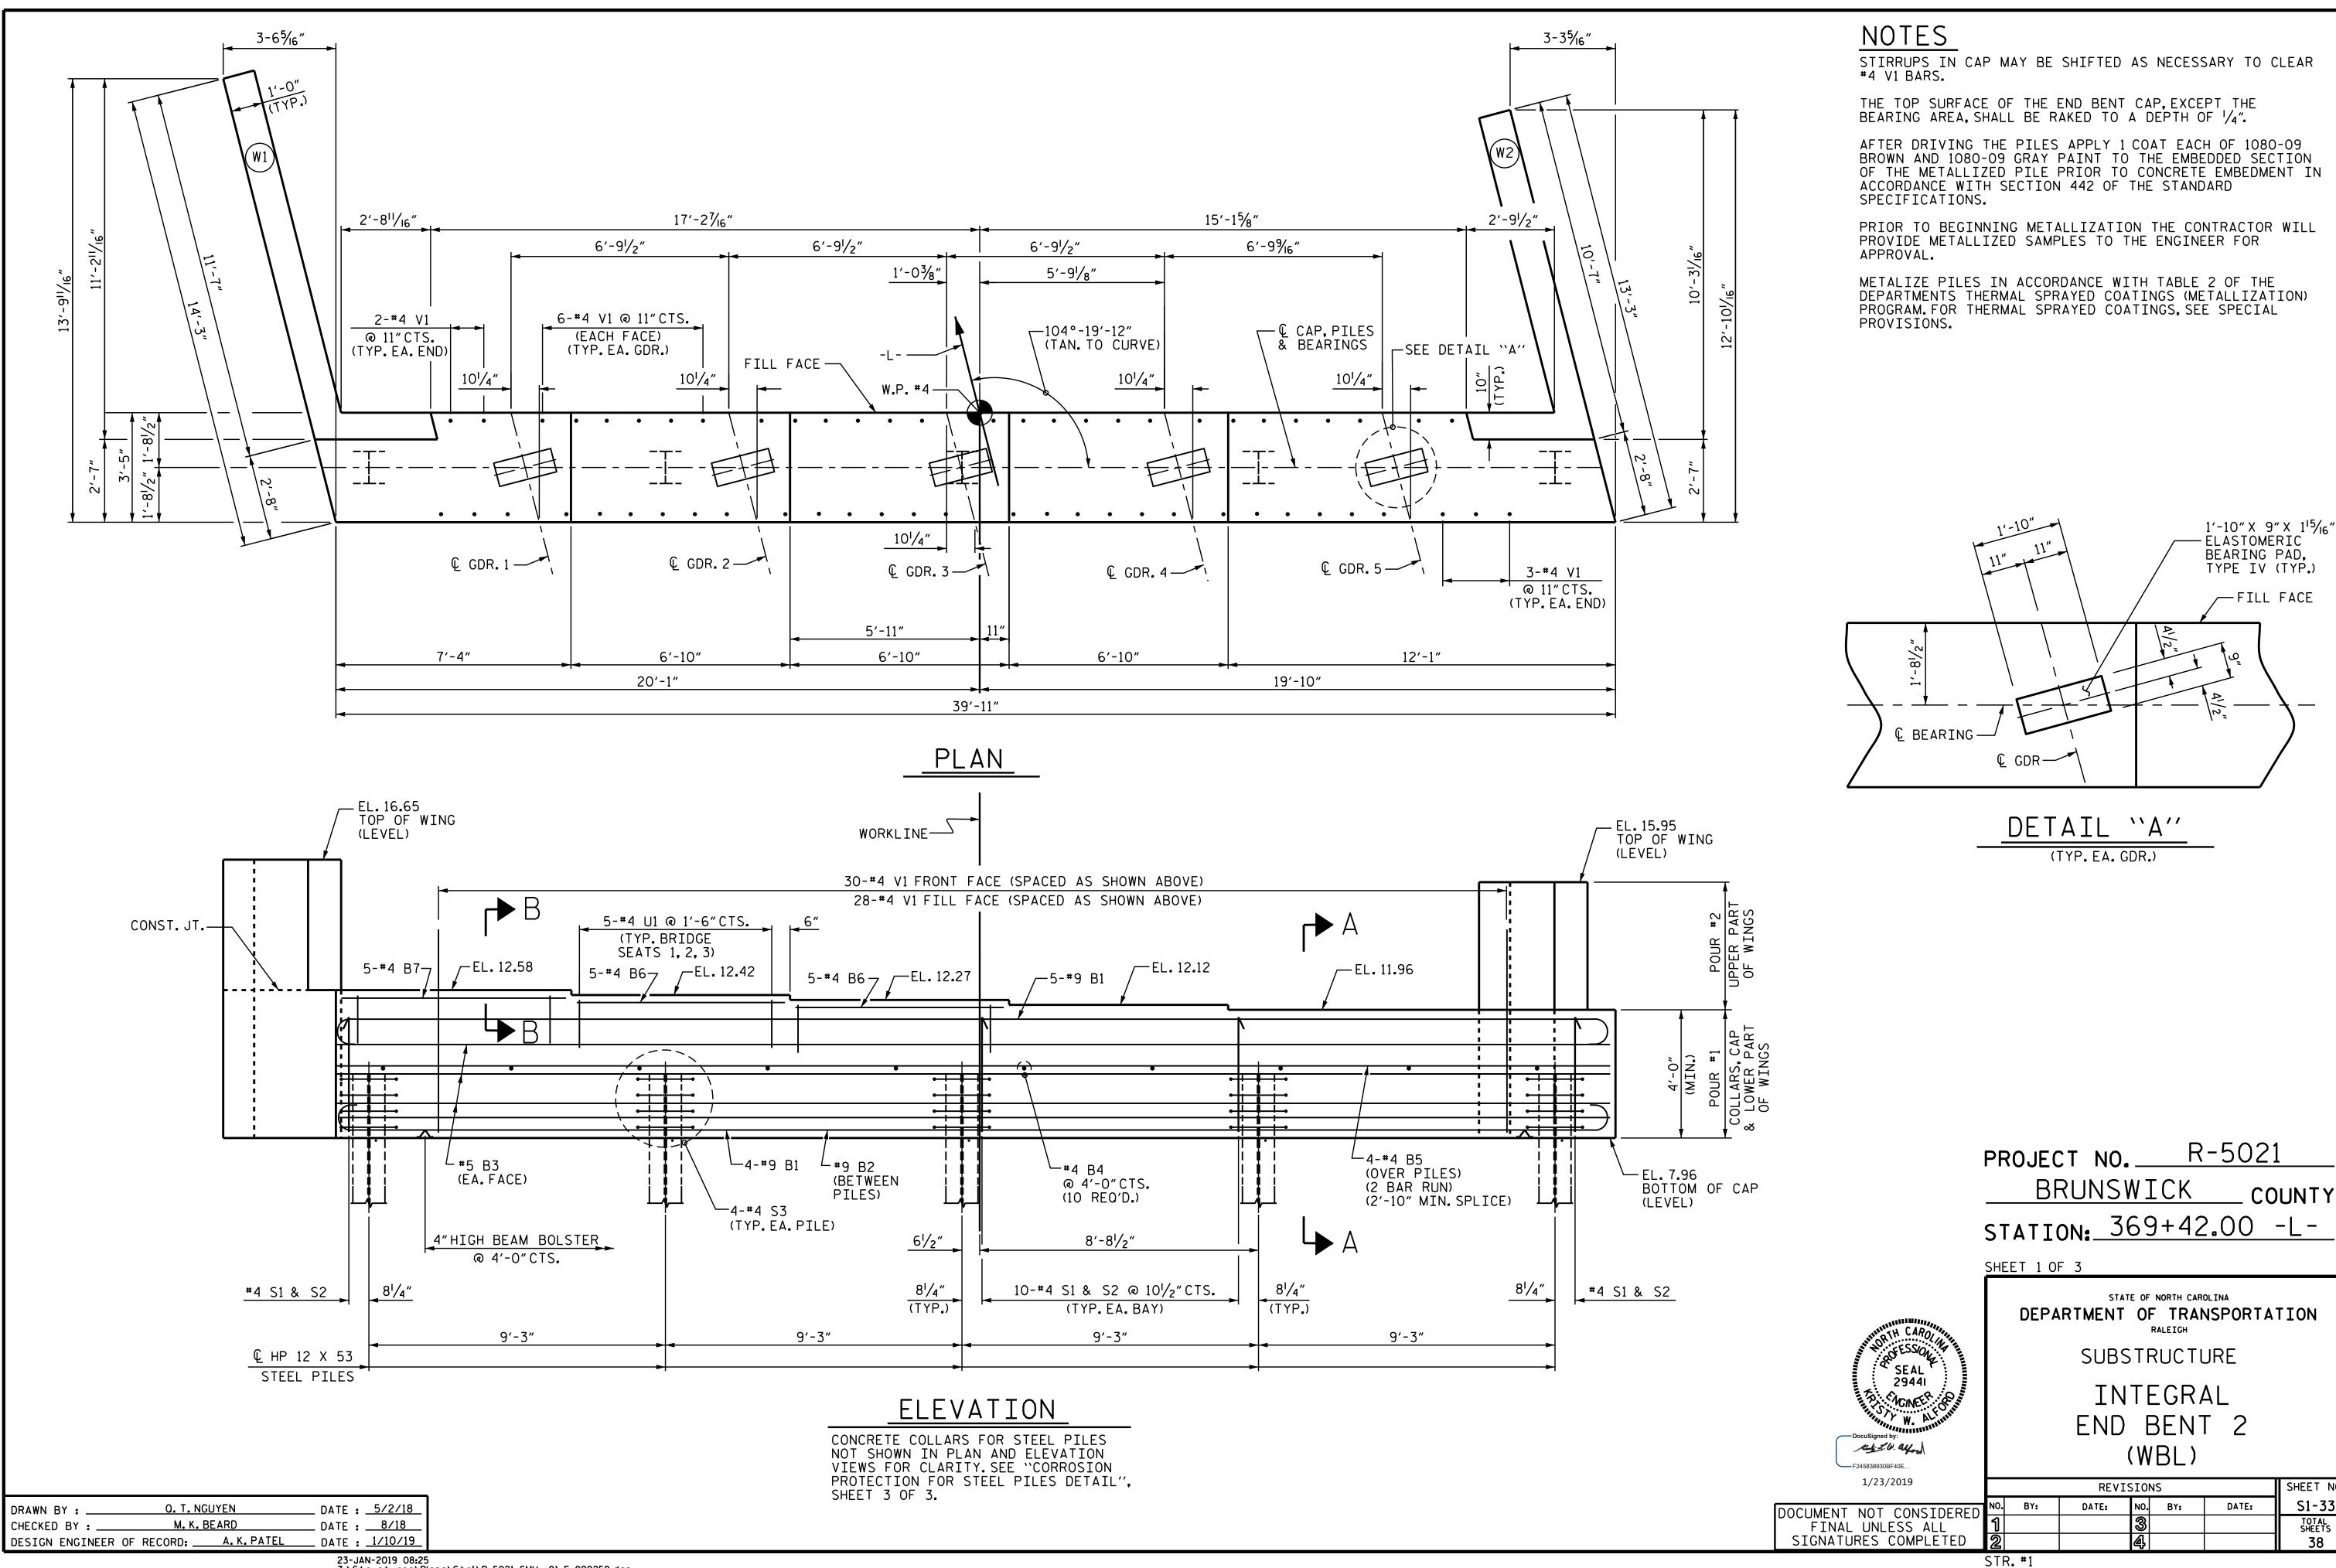


SHEET NO.


S1-33


TOTAL SHEETS

23-JAN-2019 08:25
Z:\Structures\Plans\Str1\R-5021_SMU_ 01_E_090259.dgn
kalford

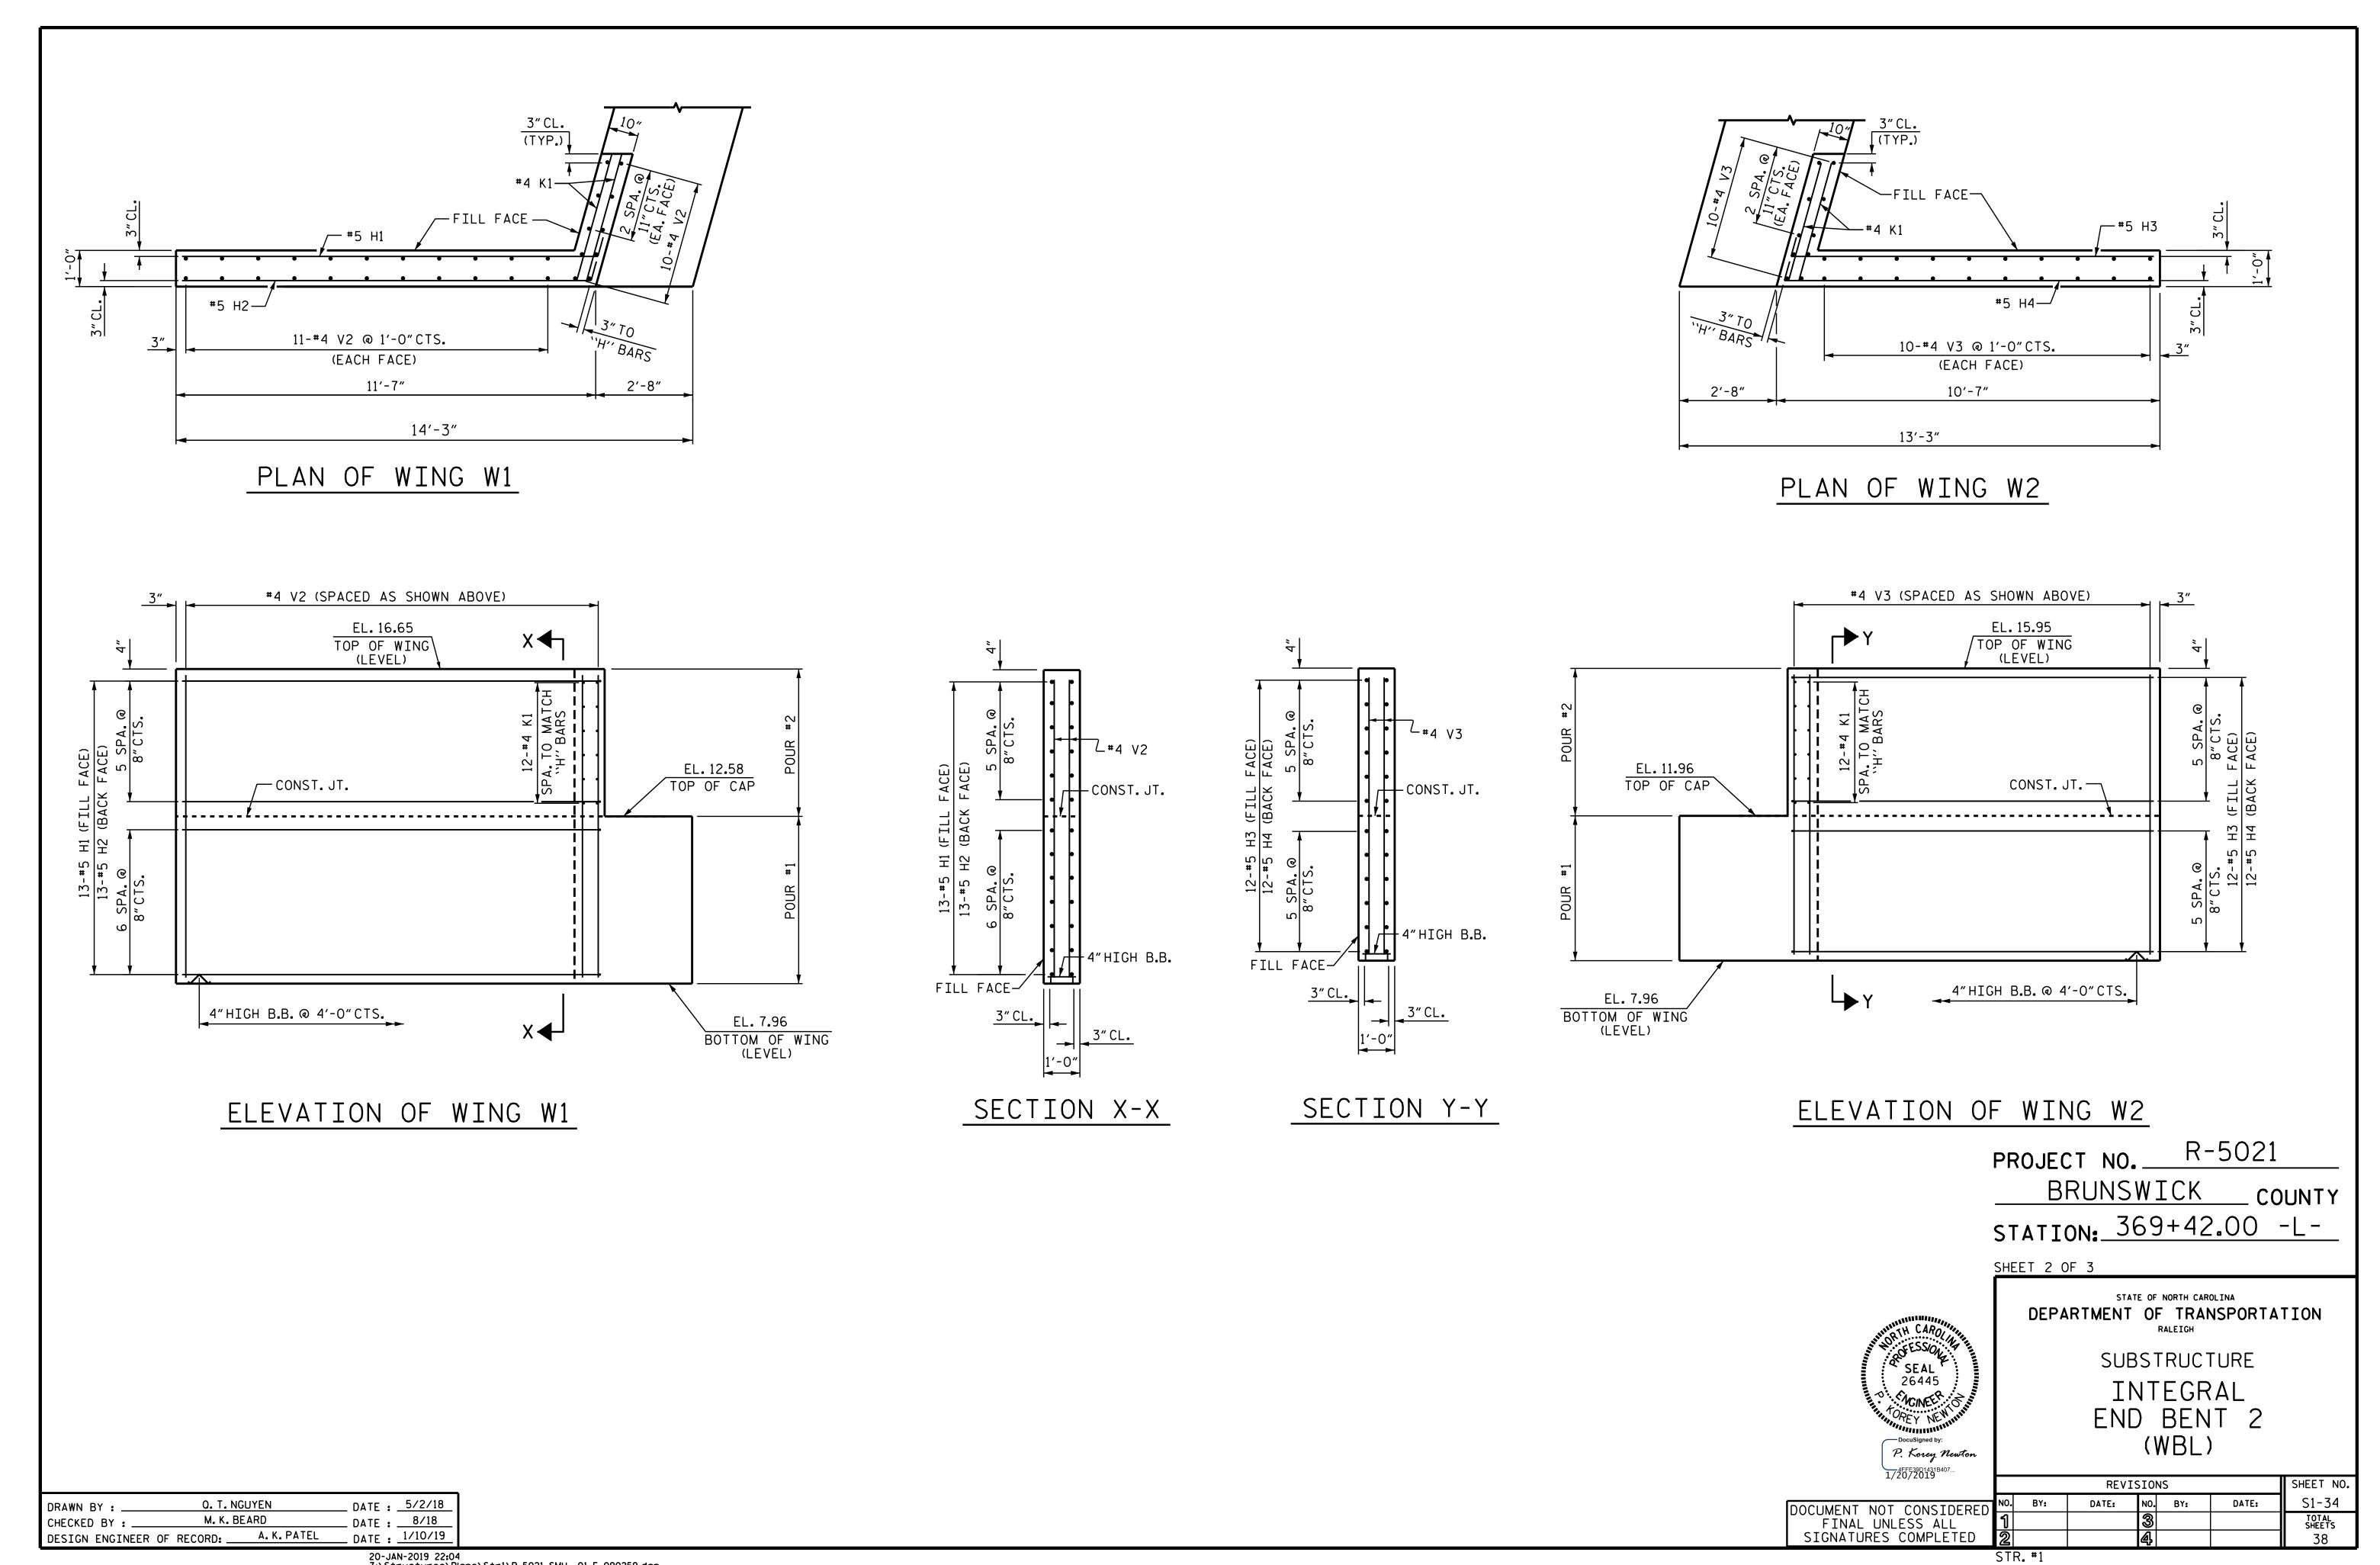

20-JAN-2019 22:04
Z:\Structures\Plans\Str1\R-5021_SMU_ 01_E_090259.dgn
pknewton

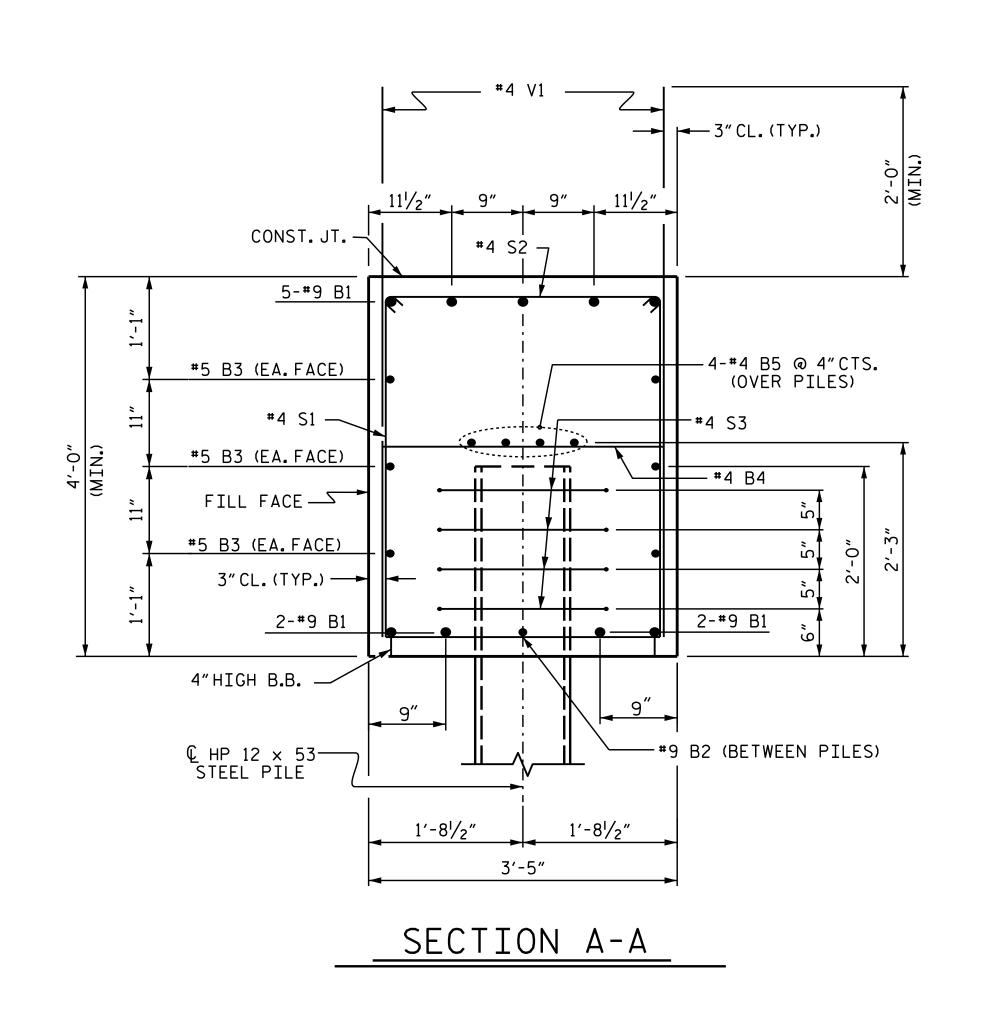

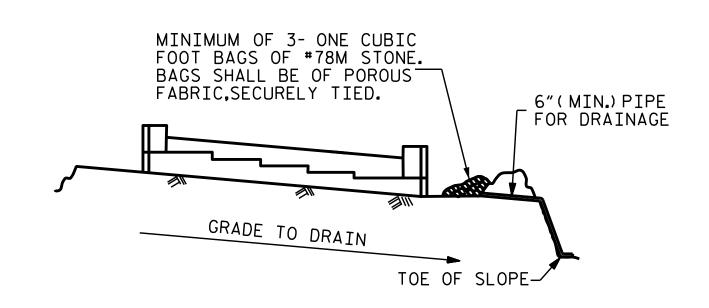



BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL. CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.


BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETER-MINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.

NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

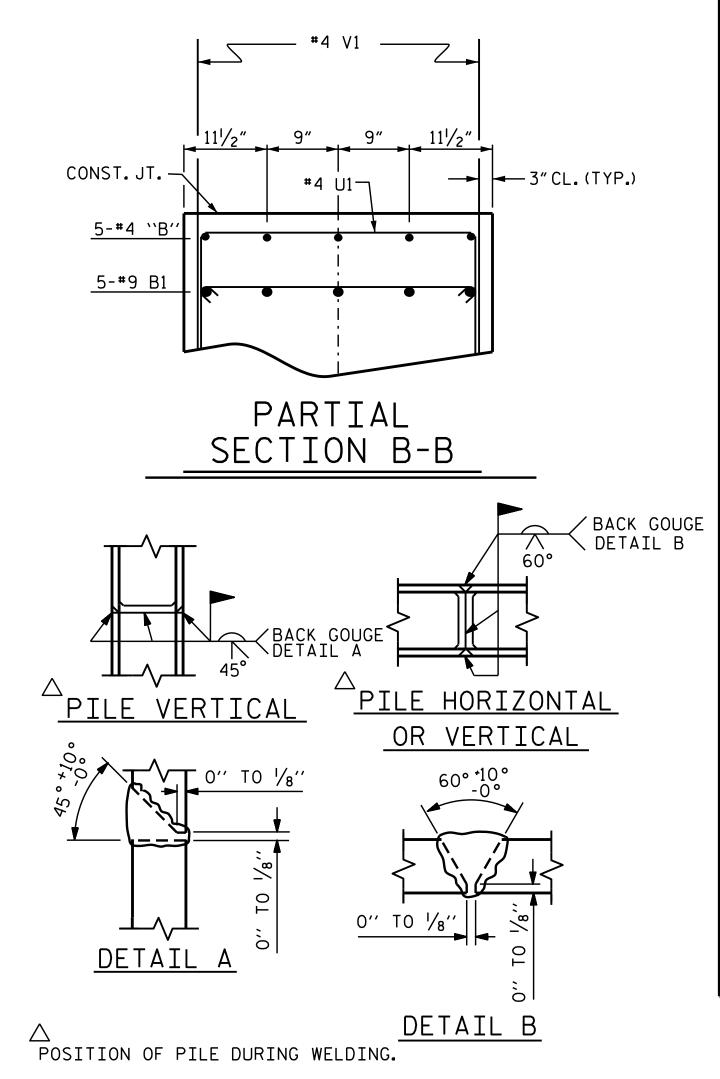


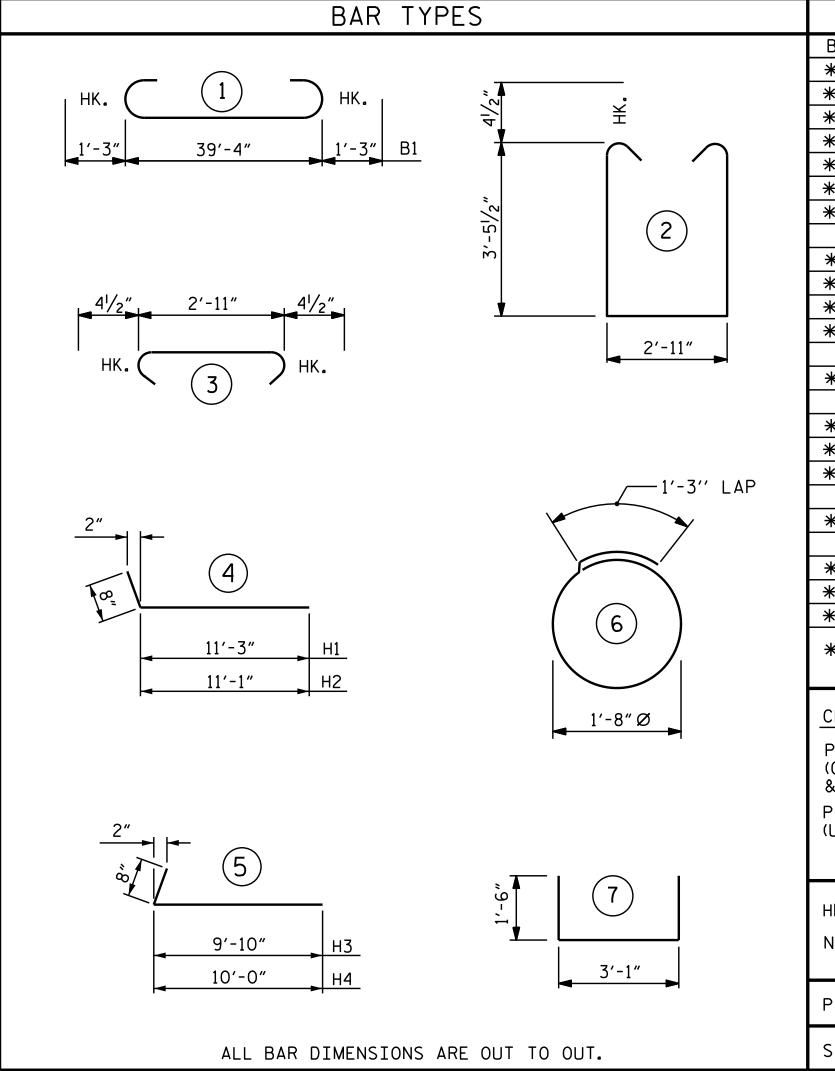

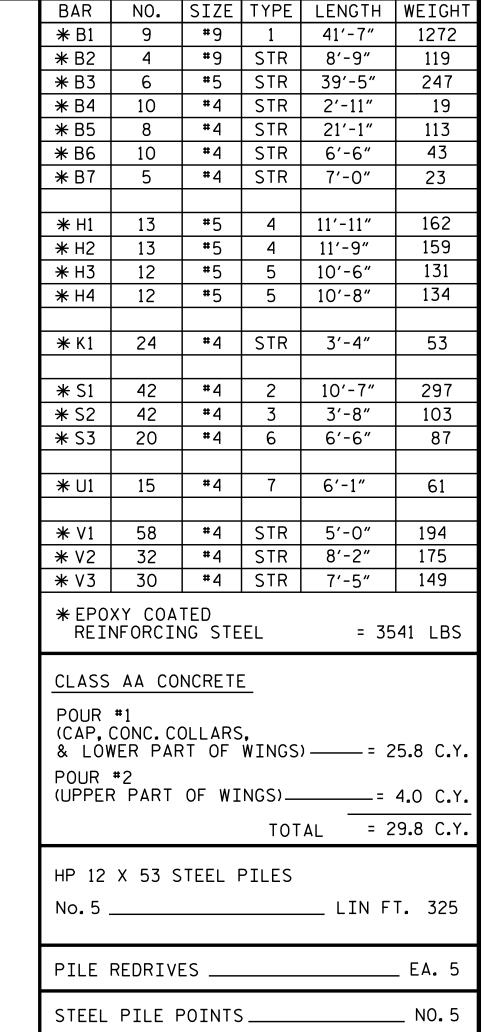


BILL OF MATERIAL

PILE SPLICE DETAILS

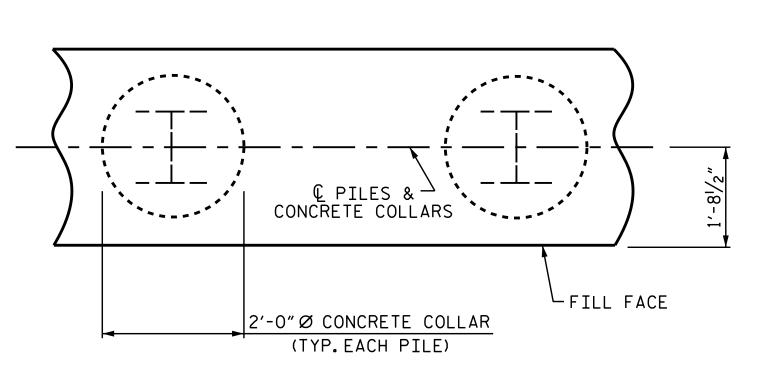

CORROSION PROTECTION FOR STEEL PILES DETAIL

PLAN

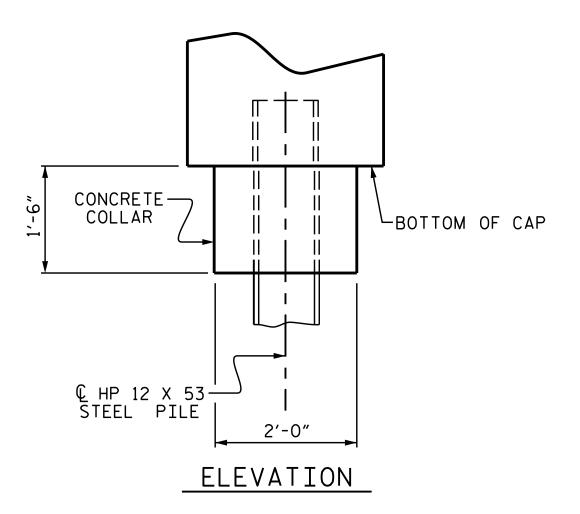

PROJECT NO. R-5021 BRUNSWICK COUNTY 369+42.00 -L-STATION:_

SHEET 3 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH


> SUBSTRUCTURE INTEGRAL END BENT 2 (WBL)

DOCUMENT NOT FINAL UNLI SIGNATURES

26445 O SUCINEES P. Korey Newton 1/20/2019 1/20/2019

20.72010							
20/2019			REV]	1012	NS		SHEET NO.
CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-35
ESS ALL	ป			3			TOTAL SHEETS
COMPLETED	2			4			38
	ST	R.#1					

Q. T. NGUYEN _ DATE : <u>5/2/18</u> DRAWN BY : . M.K.BEARD _ DATE : <u>8/18</u> CHECKED BY : ___ DESIGN ENGINEER OF RECORD: A.K.PATEL _ DATE : 1/10/19

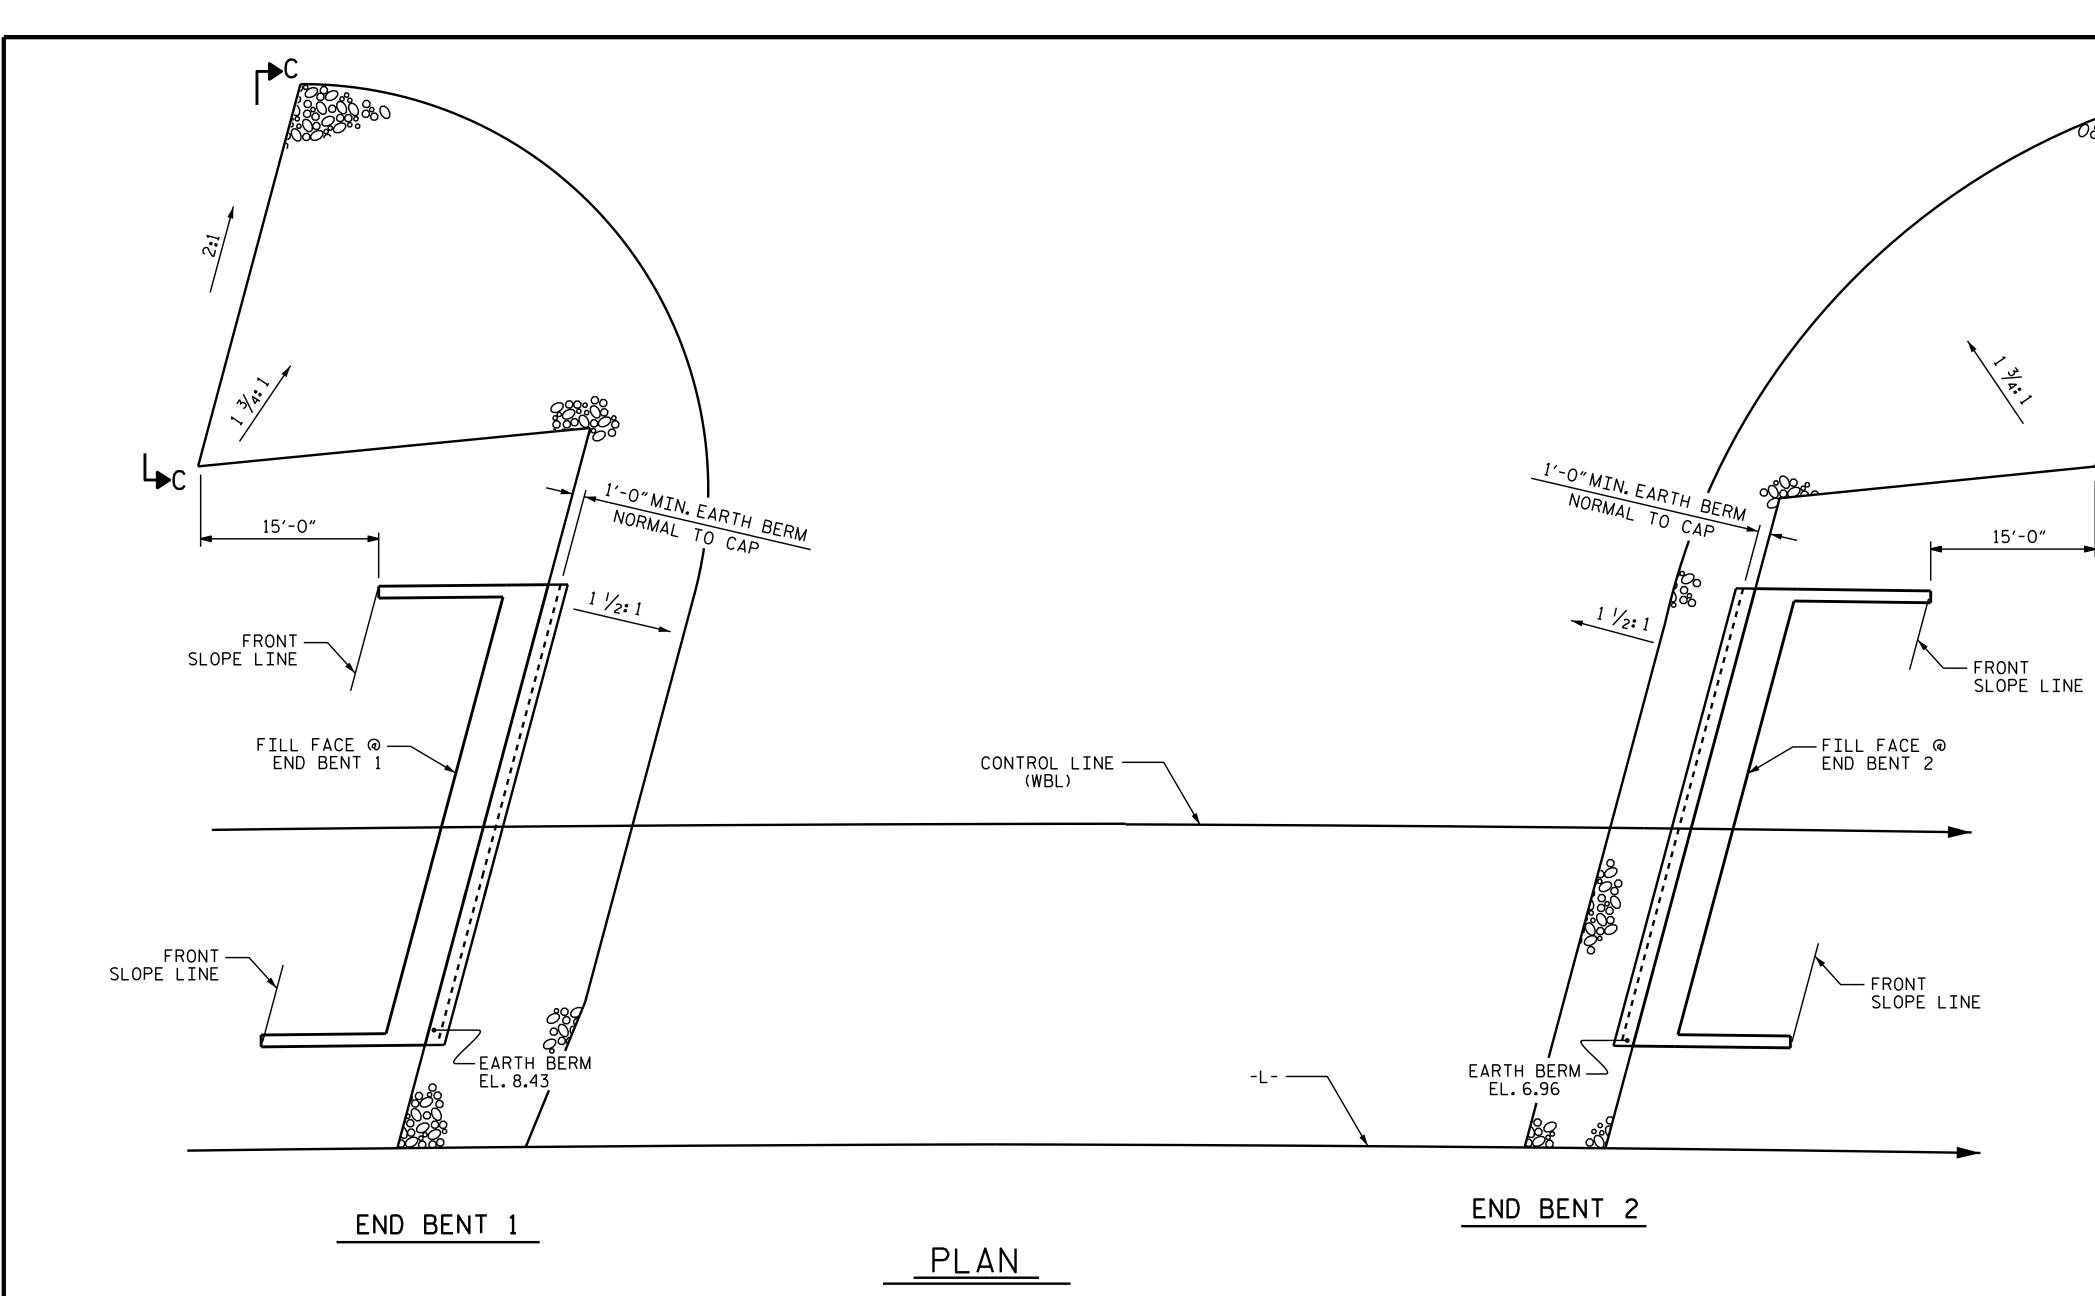

NOTE:

FOR BERM WIDTH DIMENSIONS, SEE GENERAL DRAWING.

ESTIMATED QUANTITIES RIP RAP CLASS II (2'-0"THICK) BRIDGE @ GEOTEXTILE STA.369+42.00 -L-FOR DRAINAGE SQUARE YARDS TONS END BENT 1 170 190 125 140

END BENT 2

EL.10.00

GEOTEXTILE —

SECTION C-C

SLOPE 1 1/2:1

-- GROUND LINE

C◀

PROJECT NO. R-5021 BRUNSWICK _ COUNTY

STATION: 369+42.00 -L-

DocuSigned by:

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
RALEIGH

> RIP RAP DETAILS (WBL)

1 24000000B1 40E							
1/23/2019			REVI	SION	S		SHEET NO
CUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S1-36
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			38

STR.#1


1'-7" MIN. BERM NORMAL TO CAP

EL.10.43 END BENT 1 EL.8.96 END BENT 2 SLOPE 11/2:1 2'-0" GROUND LINE 1'-0"MIN. EARTH BERM
NORMAL TO CAP GEOTEXTILE -

BERM RIP RAPPED

ASSEMBLED BY: G.KOUCHEKI/QTN DATE: 5/18
CHECKED BY: M.K.BEARD DATE: 11/18 MAA/GM MAA/GM MAA/THC REV. 10/1/11 REV. 12/21/11 REV. 12/17 DRAWN BY: REK 1/84 CHECKED BY: RDU 1/84

DOC

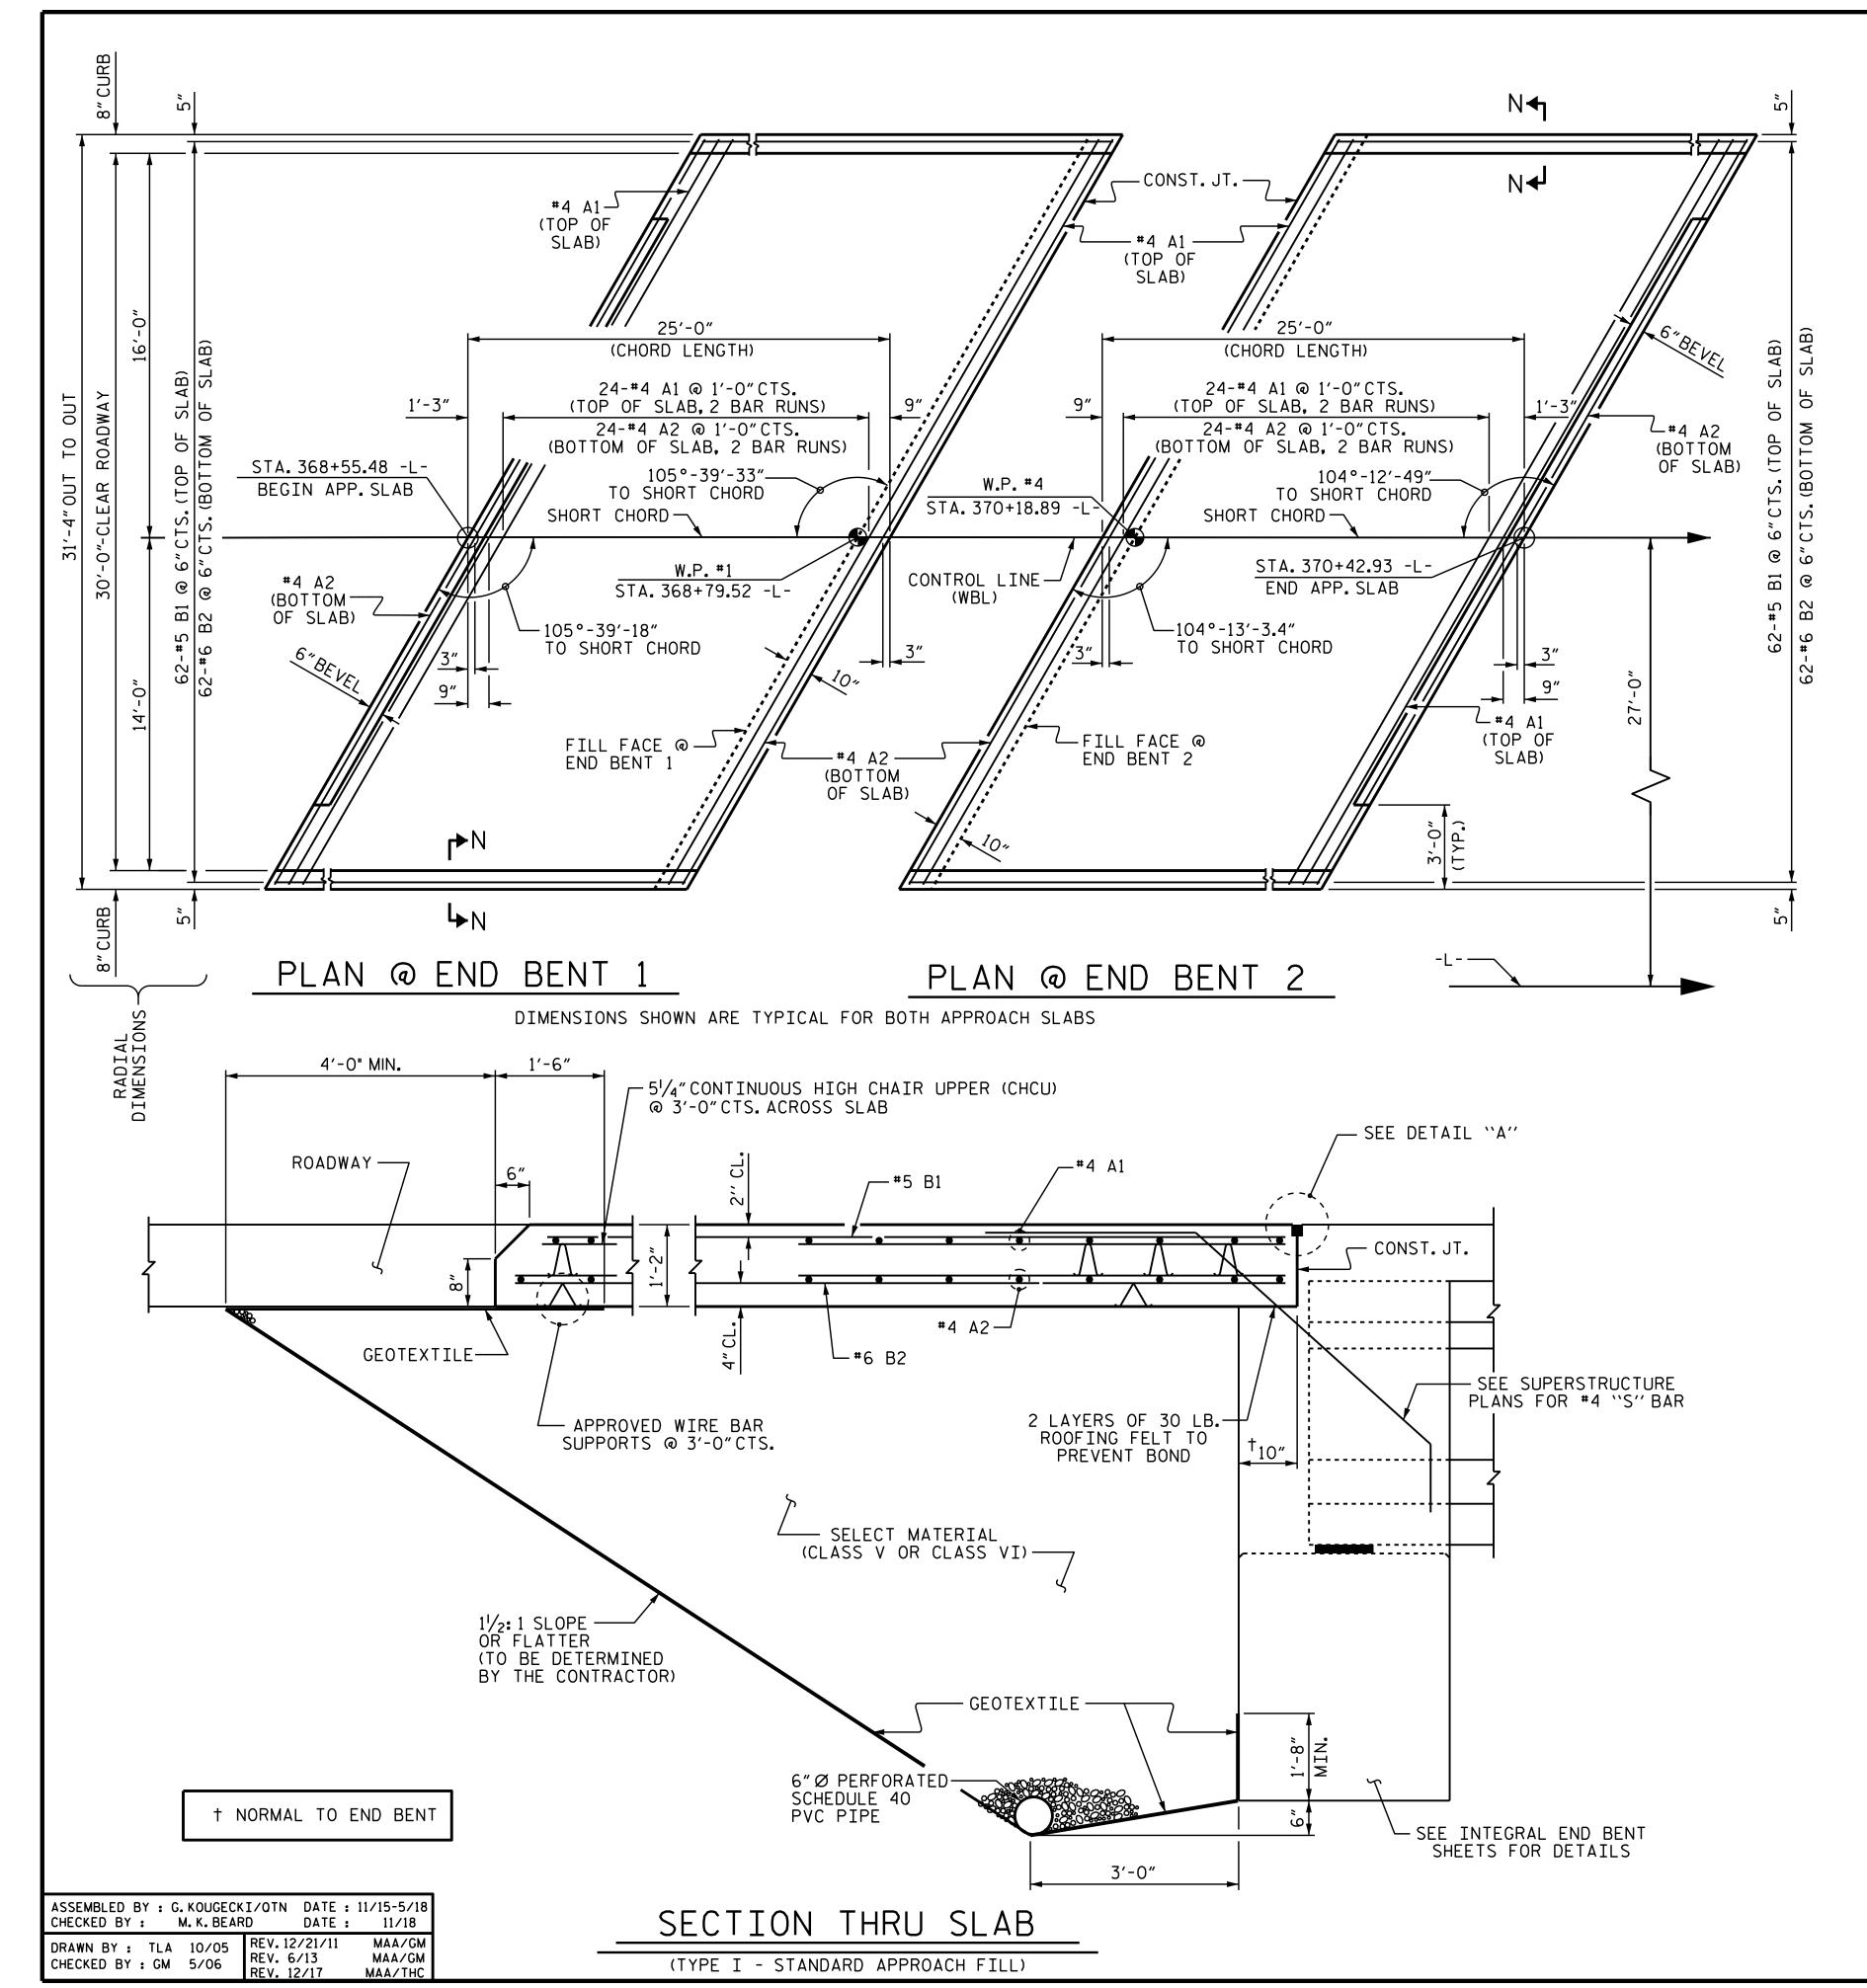

APPROACH SLAB SHALL NOT BE CONSTRUCTED PRIOR TO COMPLETION OF THE BRIDGE DECK.

FOR BRIDGE APPROACH FILL INCLUDING GEOTEXTILE, 6" Ø DRAINAGE PIPE, AND SELECT MATERIAL, SEE ROADWAY PLANS.

GEOTEXTILE SHALL BE TYPE 1 IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS SECTION 1056.

SELECT MATERIAL BACKFILL (CLASS V OR CLASS VI) SHALL BE IN ACCORDANCE WITH STANDARD SPECIFICATIONS SECTION 1016.

SELECT MATERIAL BACKFILL IS TO BE CONTINUOUS ALONG FILL FACE OF BACKWALL FROM OUTSIDE EDGE TO OUTSIDE EDGE OF APPROACH SLAB.

FOR THE 6" Ø DRAINAGE PIPE OUTLET(S), SEE ROADWAY STANDARD DRAWINGS.

AREA BETWEEN THE WINGWALL AND APPROACH SLAB SHALL BE GRADED TO DRAIN THE WATER AWAY FROM THE FILL FACE OF THE BRIDGE AND SHALL BE PAVED. SEE ROADWAY PLANS.

THE JOINT OPENING AT THE APPROACH SLAB/DECK INTERFACE SHALL BE SAWED NO MORE THAN 12 HOURS AFTER THE APPROACH SLAB IS CAST. THE JOINT SHALL BE CLEANED OF ALL DEBRIS BEFORE THE SEALANT IS APPLIED. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE STANDARD SPECIFICATIONS.

AT THE CONTRACTORS OPTION, "TYPE A - ALTERNATE APPROACH FILL" IN LIEU OF "TYPE I - STANDARD APPROACH FILL" MAY BE CONSTRUCTED AT NO ADDITIONAL COST TO THE DEPARTMENT. SEE SHEET 2 OF 2 FOR DETAILS AND NOTES.

ARC OFFSETS ARE NEGLIGIBLE, THEREFORE NOT SHOWN.

	BIL	L OF	MA	TERIAL	
FO	R ON		PPRO REQ'	DACH SI	_AB
BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
* A1	52	#4	STR	16′-5″	580


BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
← A1	52	#4	STR	16′-5″	580
€ A2	52	#4	STR	16′-5″	580
€ B1	63	# 5	STR	24'-0"	1552
€ B2	63	#6	STR	24'-6"	2281
===:					


* EPOXY COATED REINFORCING STEEL 4994 LBS.


35.2 C.Y.

CLASS AA CONCRETE

SPL	ICE LEN	NGTHS
BAR SIZE	EPOXY COATED	UNCOATED
#4	2'-0"	1'-9"
#5	2'-6"	2'-2"
#6	3'-10"	2'-7"

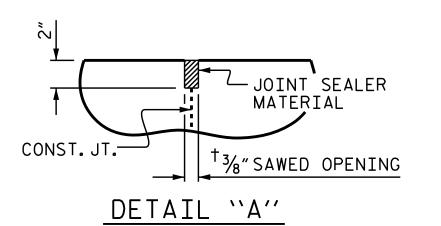

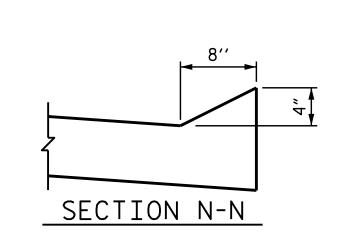

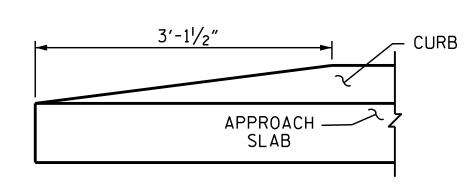

END OF CURB WITHOUT SHOULDER BERM GUTTER

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SEAL 26445

**NONEER OF THE STATE OF THE STA

P. Korey Newton

DEPARTMENT OF TRANSPORTATION
RALEIGH
STANDARD

BRIDGE APPROACH SLAB FOR INTEGRAL ABUTMENT (WBL)

REVISIONS

OCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS

REVISIONS

SHEET NO. BY: DATE: NO. BY: DATE: SIGNATURES COMPLETED

REVISIONS


SHEET NO. S1-37


TOTAL SHEETS


38

38

SHEET 1 OF 2

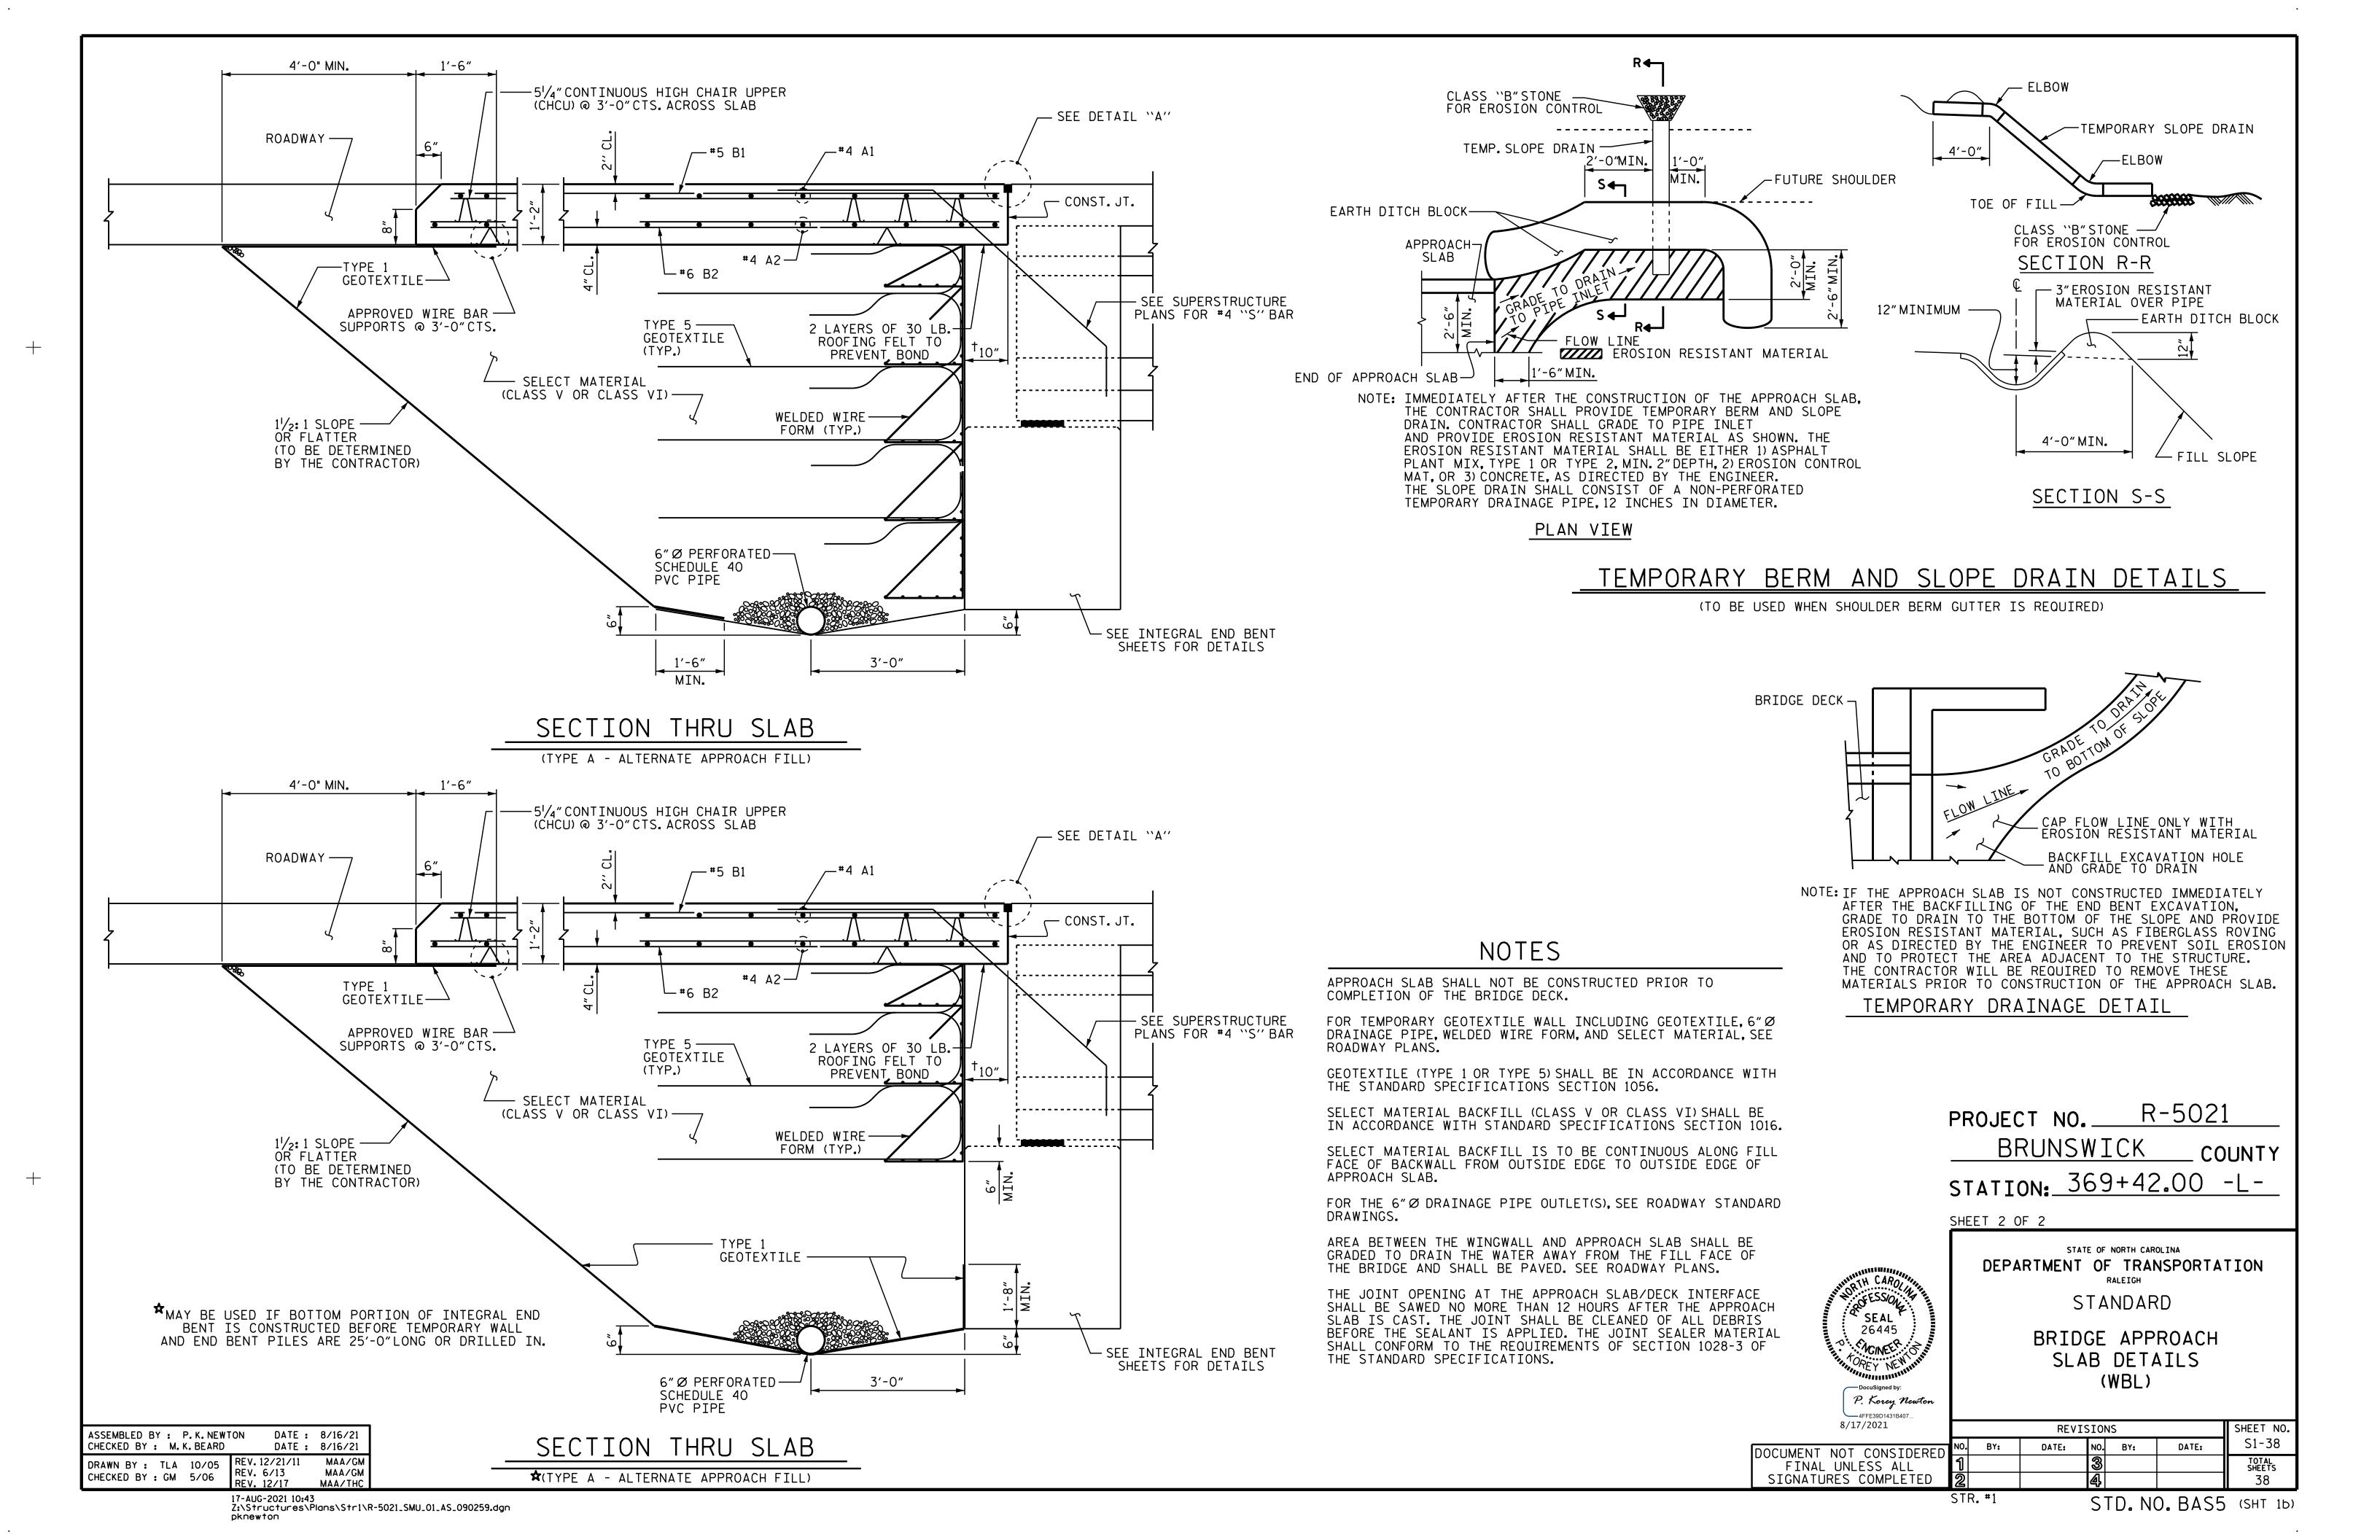

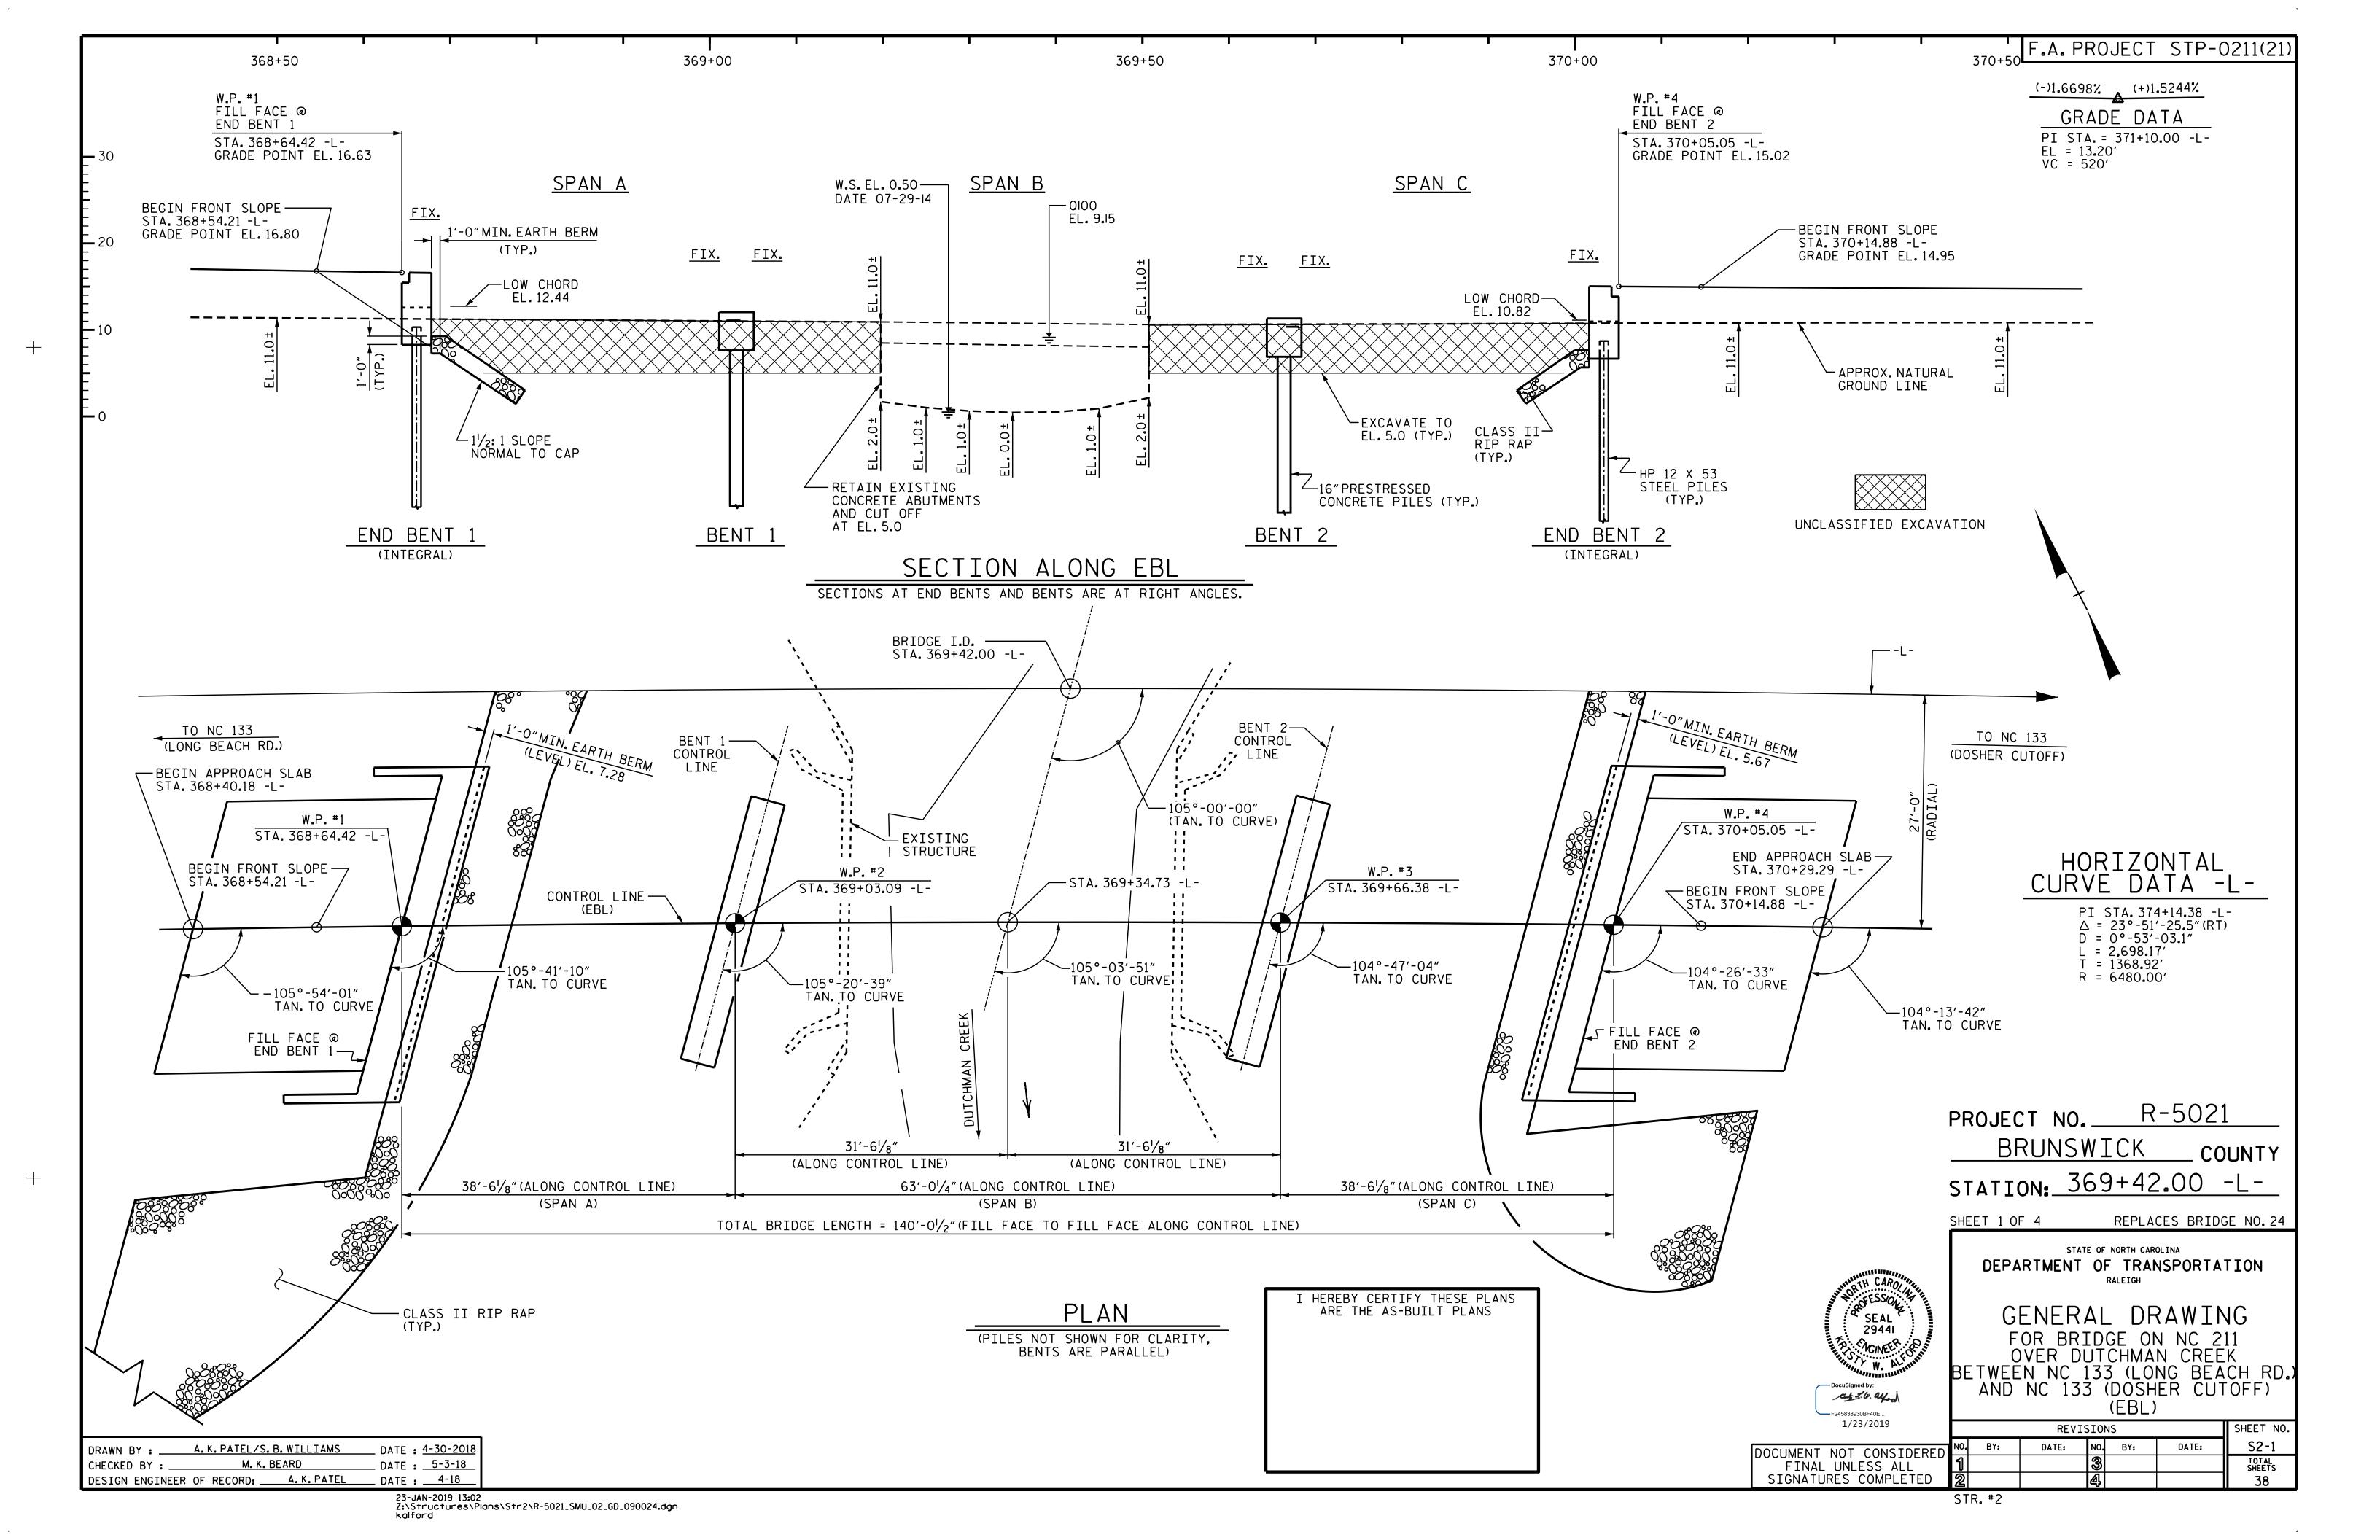

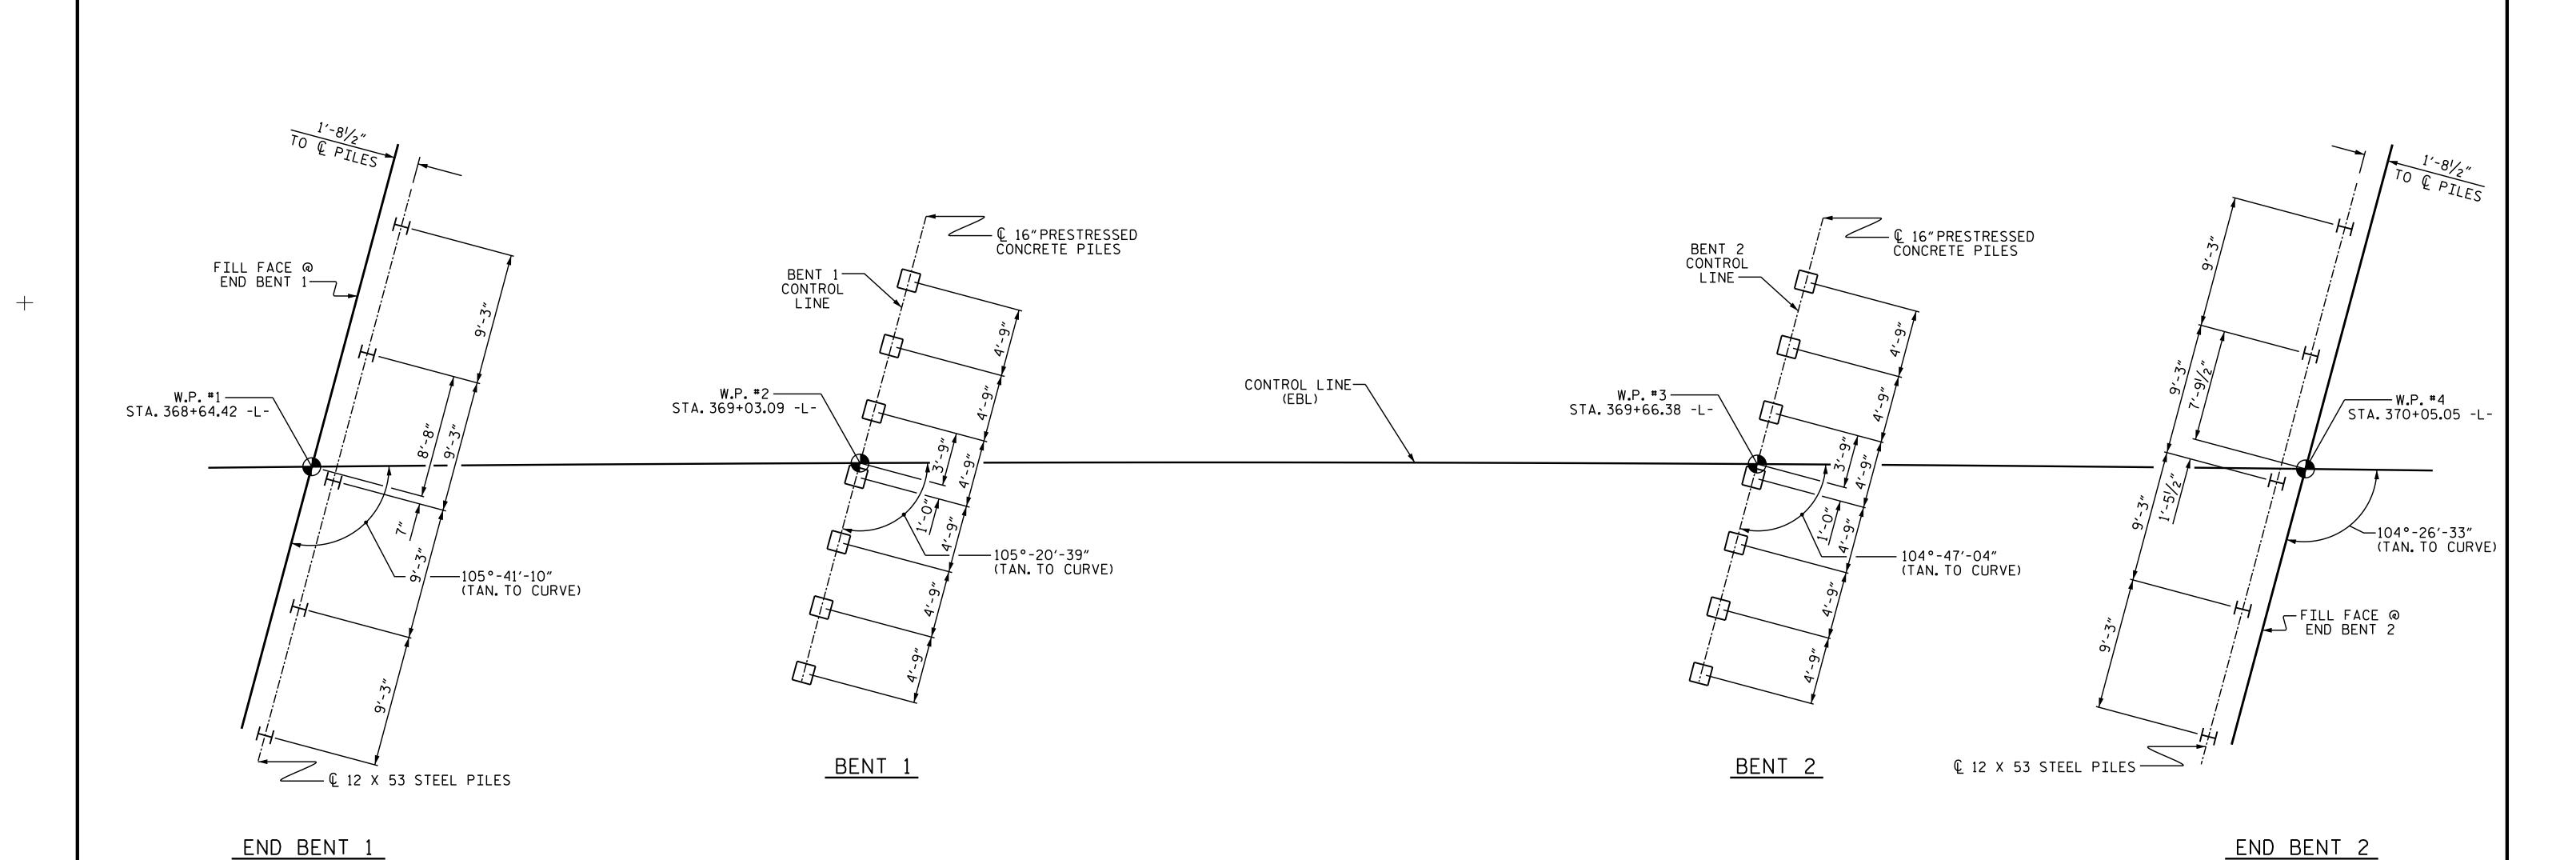

DIMENSIONS LOCATING PILES ARE TO CENTERLINE OF THE PILE AT THE BOTTOM OF THE CAP

FOUNDATION LAYOUT

NOTES

FOR PILES. SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

PILES AT END BENT 1 AND END BENT 2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 90 TONS PER PILE.

DRIVE PILES AT END BENT 1 AND END BENT 2 TO A REQUIRED DRIVING RESISTANCE OF 150 TONS PER PILE.

PILES AT BENT 1 AND BENT 2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 100 TONS PER PILE.

DRIVE PILES AT BENT 1 TO A REQUIRED DRIVING RESISTANCE OF 185 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.

DRIVE PILES AT BENT 2 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE. THIS REQUIRED DRIVING RESISTANCE INCLUDES ADDITIONAL RESISTANCE FOR SCOUR.

STEEL H-PILE POINTS ARE REQUIRED FOR STEEL H-PILES AT END BENT 1 AND END BENT 2. FOR STEEL PILE POINTS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

TESTING PILES WITH THE PDA DURING DRIVING, RESTRIKING OR REDRIVING MAY BE REQUIRED. THE ENGINEER WILL DETERMINE THE NEED FOR PDA TESTING. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

INSTALL PILES AT BENT 1 TO A TIP ELEVATION NO HIGHER THAN -28.0 FEET.

INSTALL PILES AT BENT 2 TO A TIP ELEVATION NO HIGHER THAN -30.0 FEET.

STEEL PILE TIPS ARE REQUIRED FOR PRESTRESSED CONCRETE PILES AT BENTS 1 AND 2. FOR STEEL PILE TIPS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

OBSERVE A ONE MONTH WAITING PERIOD AFTER CONSTRUCTING THE EMBANKMENT, END BENT, AND REINFORCED BRIDGE APPROACH FILL BEFORE BEGINNING APPROACH SLAB CONSTRUCTION AT END BENTS 1 AND 2. FOR BRIDGE WAITING PERIODS, SEE ROADWAY PLANS AND SPECIAL PROVISIONS.

THE SCOUR CRITICAL ELEVATION FOR BENT 1 AND BENT 2 IS ELEVATION -6.0 FEET. SCOUR CRITICAL ELEVATIONS ARE USED TO

MONITOR POSSIBLE SCOUR PROBLEMS DURING THE LIFE OF THE STRUCTURE.

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY

STATION: 369+42.00 -L-

SHEET 2 OF 4

SEAL 3 29441

TO CHEER S

Kut I. W. ayou

245838930BF40F

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

FOR BRIDGE ON NC 211 OVER

DUTCHMAN CREEK BETWEEN NC 133 (LONG BEACH RD.) AND NC 133 (DOSHER CUTOFF) (EBL)

SHEET NO.


S2-2

1/23/2019 REVISIONS DATE: BY: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

STR.#2

23-JAN-2019 13:02 Z:\Structures\Plans\Str2\R-5021_SMU_02_GD_090024.dgn

S.B. WILLIAMS _ DATE : <u>5/18</u> DRAWN BY : _ M.K.BEARD _ DATE : <u>5/24/18</u> CHECKED BY : ___ DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/17/19

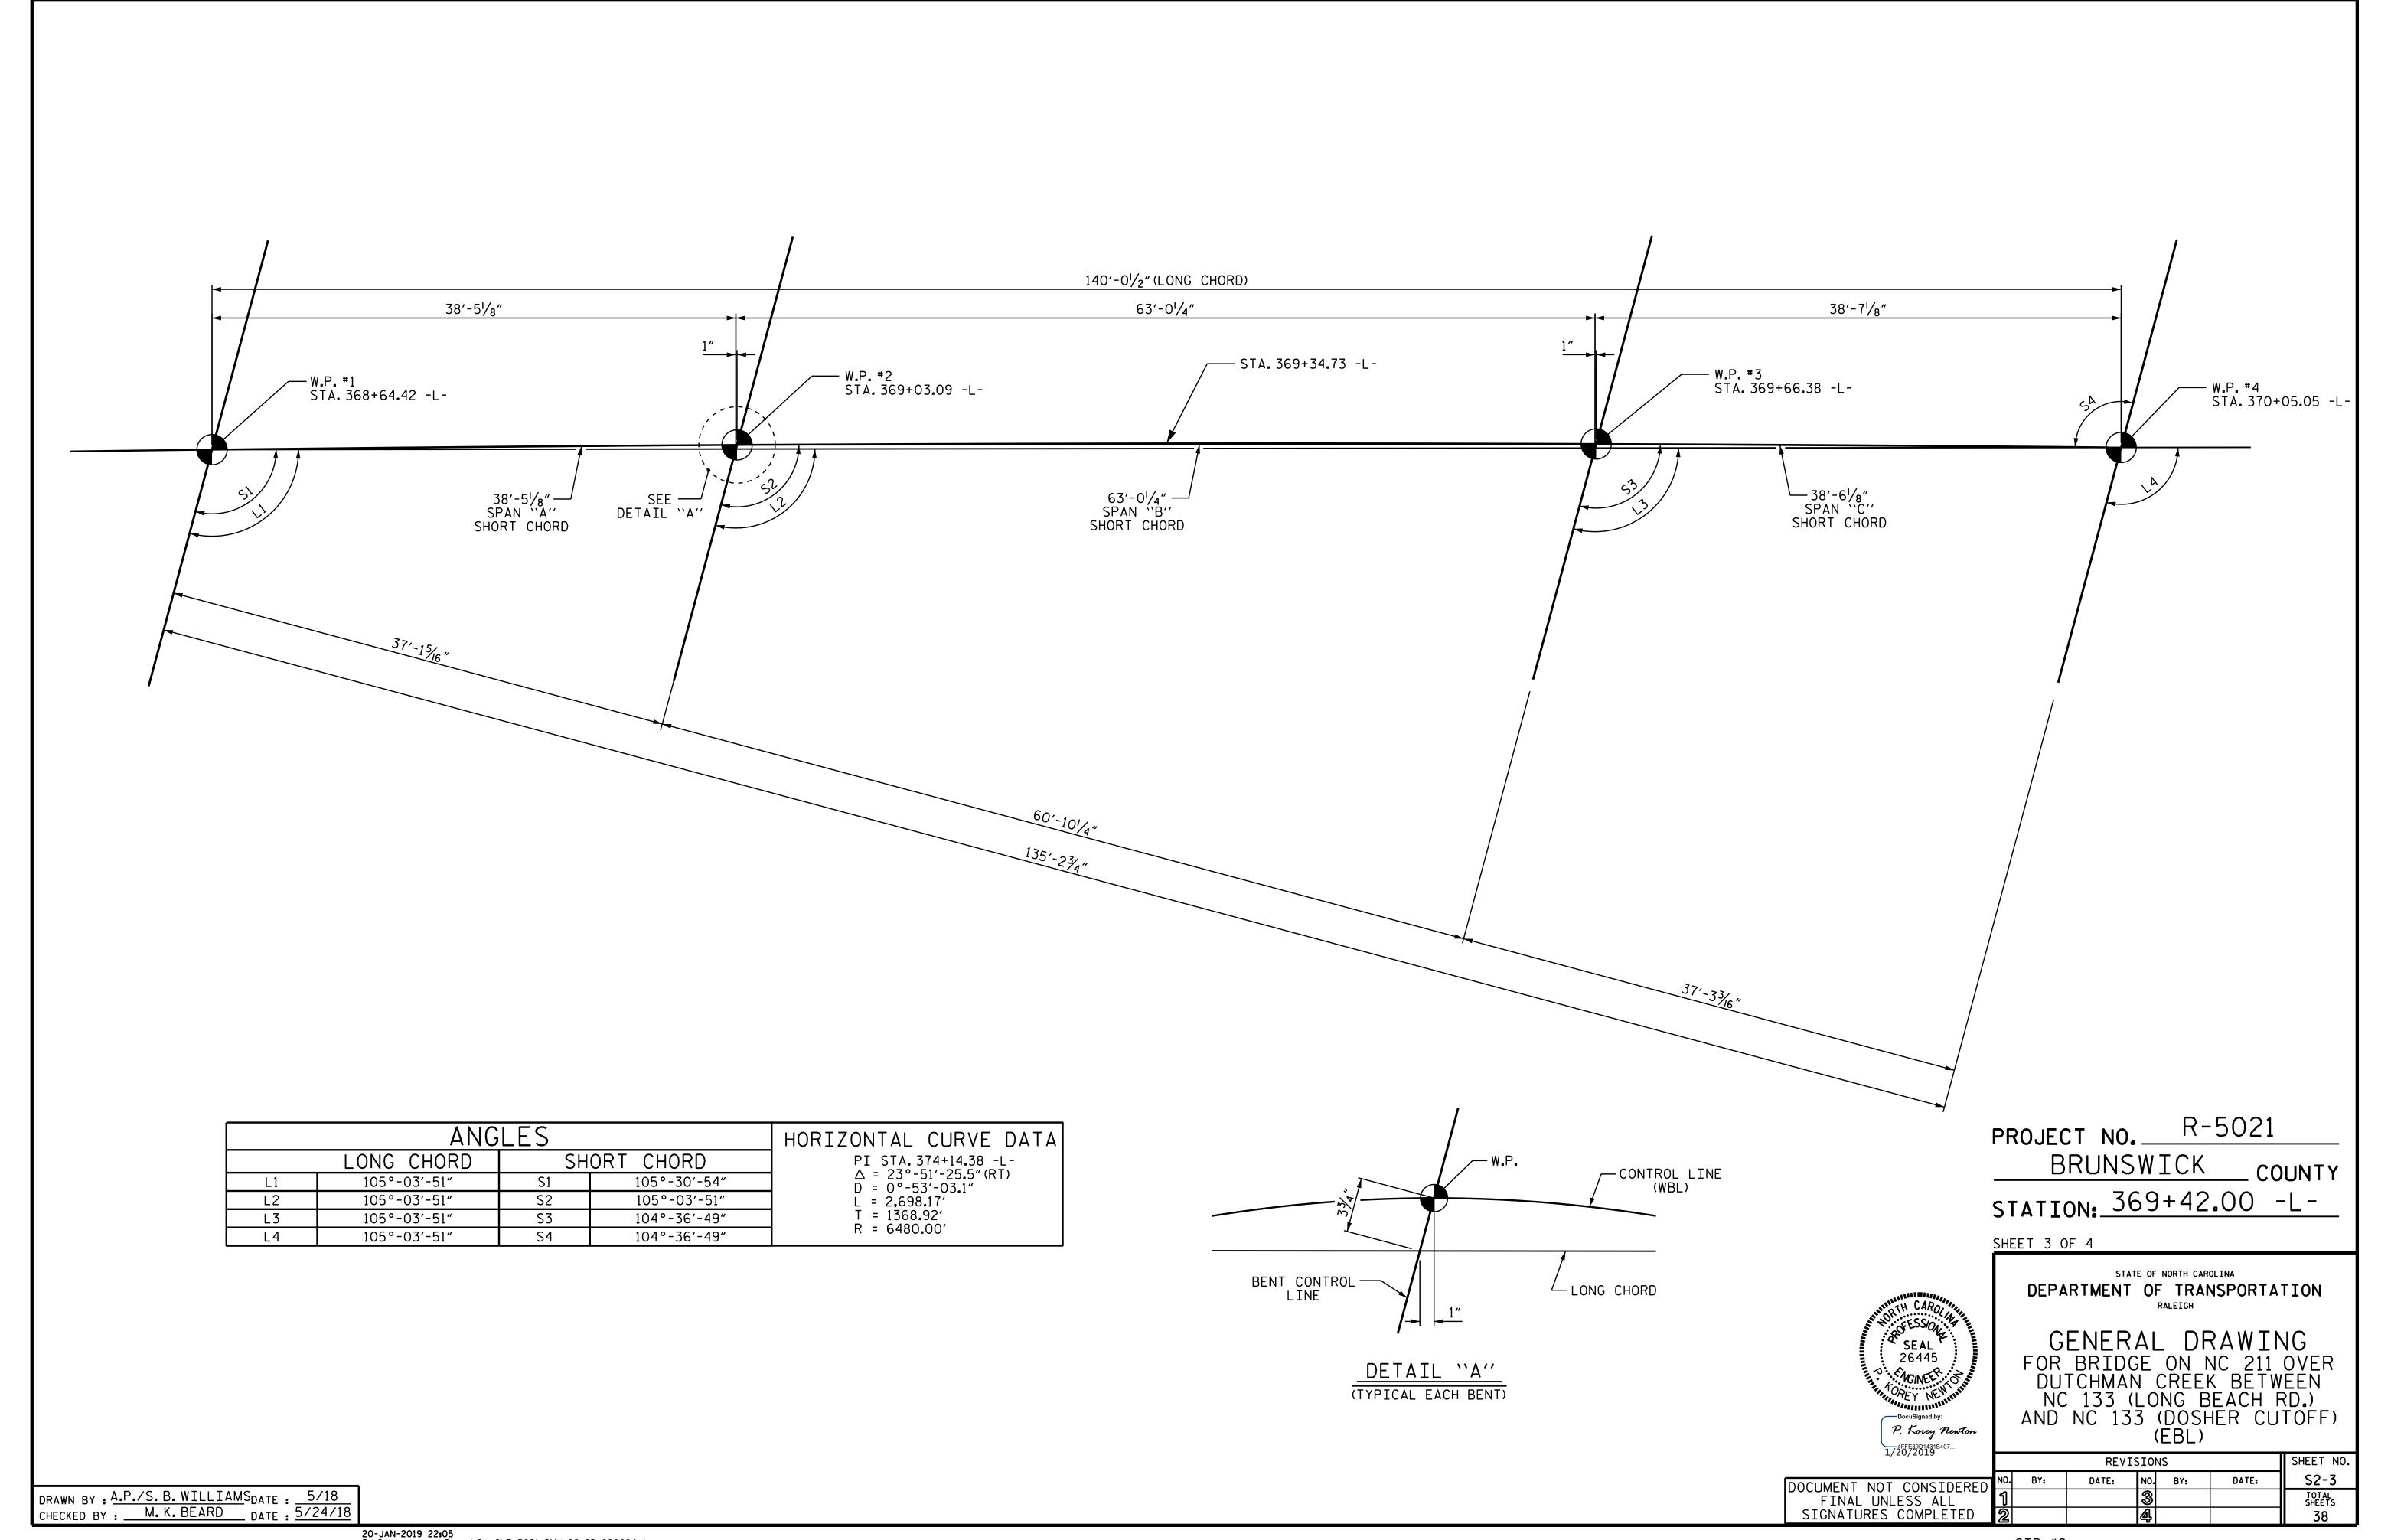

——— TOTAL BILL OF MATERIAL——— PILE DRIVING PILE DRIVING UNCLASSIFIED | REINFORCED GROOVING BRIDGE EPOXY COATED EQUIPMENT EQUIPMENT 1'-2" X 2'-6" RIP RAP GEOTEXTILE REMOVAL OF CLASS AA PRESTRESSED PRESTRESSED FLASTOMERIC HP 12X53 TWO BAR **ASBESTOS** SETUP FOR 16" SETUP FOR **APPROACH** CLASS II CONCRETE BRIDGE REINFORCING EXISTING STRUCTURE CONCRETE STEEL PILES TESTING CONCRETE REDRIVES | METAL RAIL **ASSESSMENT** CONCRETE CONCRETE BEARINGS STRUCTURE PRESTRESSED HP 12 X 53 POINTS EXCAVATION DECK SLAB FLOORS SLABS PARAPET (2'-0" THICK) DRAINAGE STEEL GIRDERS PILES STEEL PILES CONCRETE PILES NO. LIN. FT. LUMP SUM EACH LUMP SUM SQ.FT. SQ.FT. CU. YDS. LUMP SUM LBS. EACH EACH NO. | LIN. FT. | NO. | LIN. FT. EACH LIN.FT. LIN.FT. SQ. YDS. LUMP SUM LUMP SUM EACH TONS 680.9 SUPERSTRUCTURE 5028 261.02 276.63 LUMP SUM 3519 325 130 END BENT 1 29.6 145 490 BENT 1 2239 BENT 2 2239 350 END BENT 2 LUMP SUM 29.6 325 120 135 LUMP SUM 4507 UMP SUM 11510 680.9 840 10 650 10 24 276.63 280 LUMP SUM LUMP SUM LUMP SUM 5028 82.2 14 261.02 TOTAL

BM #R5021-10 - 24"ROD WITH ALUMINIUM CAP. STA. 365+04.81 -L-, 39.66' RIGHT, EL. 18.37 PROPOSED GUARDRAIL TOE PROTECTION (ROADWAY DETAIL (ROADWAY DETAIL & PAY ITEM) (TYP.) — & PAY ITEM) BRIDGE ID. STA. 369+42.00 -L-**永** CONTROL LINE -(WBL) TO NC 133 (DOSHER CUTOFF) — PROPOSED -CONTROL LINE EXISTING STRUCTURE BRIDGE (EBL) -105°-00′-00″ TAN. TO CURVE -4'LAT.BASE DITCH FOR UTILITY INFORMATION. SEE UTILITY CLASS "I" RIP-RAP PLANS AND SPECIAL PROVISIONS. (ROADWAY DETAIL * * & PAY ITEM) (TYP.) LOCATION SKETCH

HYDRAULIC DATA

DESIGN DISCHARGE ____ = 2300 CFS
FREQUENCY OF DESIGN DISCHARGE_= 50 YRS.
DESIGN HIGH WATER ELEVATION __= 8.9 FT.
DRAINAGE AREA ____ = 5.2 SQ. MI.
BASE DISCHARGE (Q100) ___ = 2500 CFS
BASE HIGH WATER ELEVATION __= 9.15 FT.

OVERTOPPING FLOOD DATA

OVERTOPPING DISCHARGE _____ = 2900+ CFS FREQUENCY OF OVERTOPPING FLOOD _ = 500+ YRS. OVERTOPPING FLOOD ELEVATION _ = 16.37 FT.

ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.

THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS.

THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.

FOR OTHER DESIGN DATA AND GENERAL NOTES, SEE SHEET SN.

FOR EROSION CONTROL MEASURES SEE EROSION CONTROL PLANS.

THIS STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH "HEC 18 - EVALUATING SCOUR AT BRIDGES".

AFTER SERVING AS A TEMPORARY STRUCTURE, THE EXISTING STRUCTURE, CONSISTING OF 1 SPAN @ 31'-0" WITH A CLEAR ROADWAY WIDTH OF 28'-11" AND REINFORCED CONCRETE DECK GIRDERS WITH 3" AWS ON REINFORCED CONCRETE ABUTMENTS SHALL BE REMOVED. THE EXISTING BRIDGE IS PRESENTLY NOT POSTED FOR LOAD LIMIT. SHOULD THE STRUCTURAL INTEGRITY OF THE BRIDGE DETERIORATE DURING THE CONSTRUCTION OF THE PROPOSED BRIDGE, A LOAD LIMIT MAY BE POSTED AND MAY BE REDUCED AS FOUND NECESSARY DURING THE LIFE OF THE PROJECT.

THE SUBSTRUCTURE OF THE EXISTING BRIDGE INDICATED ON THE PLANS IS FROM THE BEST INFORMATION AVAILABLE. THIS INFORMATION IS SHOWN FOR THE CONVENIENCE OF THE CONTRACTOR. THE CONTRACTOR SHALL HAVE NO CLAIM WHATSOEVER AGAINST THE DEPARTMENT OF TRANSPORTATION FOR ANY DELAYS OR ADDITIONAL COST INCURRED BASED ON DIFFERENCES BETWEEN THE EXISTING BRIDGE SUBSTRUCTURE SHOWN ON THE PLANS AND THE ACTUAL CONDITIONS AT THE PROJECT SITE.

REMOVAL OF THE EXISTING BRIDGE SHALL BE PERFORMED IN A MANNER THAT PREVENTS DEBRIS FROM FALLING INTO THE WATER. THE CONTRACTOR SHALL SUBMIT DEMOLITION PLANS FOR REVIEW AND REMOVE THE BRIDGE IN ACCORDANCE WITH ARTICLE 402-2 OF THE STANDARD SPECIFICATIONS.

ALL METALIZED SURFACES SHALL RECEIVE A SEAL COATING AS SPECIFIED IN TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

METALIZE PILES IN ACCORDANCE WITH TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

AFTER DRIVING THE PILES APPLY 1 COAT EACH OF 1080-09 BROWN AND 1080-09 GRAY PAINT TO THE EMBEDDED SECTION OF THE METALLIZED PILE PRIOR TO CONCRETE EMBEDMENT IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS.

THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE SAMPLE BARS SHOULD COME FROM STEEL ACTUALLY USED IN THE PROJECT AND THE SAMPLE BARS SHOULD BE REPLACED BY SPLICED BARS AS SPECIFIED IN THE SAMPLE BAR REPLACEMENT CHART. PAYMENT FOR THE SAMPLE BARS AND REPLACEMENT REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.

PRESTRESSED CONCRETE GIRDERS ARE DESIGNED FOR O PSI TENSION IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

PRECAST PANELS SHALL BE DESIGNED FOR AN ALLOWABLE TENSILE STRESS OF O PSI IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

THE WATER/CEMENT RATIO FOR CONCRETE PILES SHALL NOT EXCEED 0.40.



NOTES

PRIOR TO BEGINNING METALLIZATION THE CONTRACTOR WILL PROVIDE METALLIZED SAMPLES TO THE ENGINEER FOR APPROVAL.

NEEDLE BEAMS WILL NOT BE ALLOWED UNLESS OTHERWISE CALLED FOR ON THE PLANS OR APPROVED BY THE ENGINEER.

FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY. SEE SPECIAL PROVISIONS.

FOR ASBESTOS ASSESSMENT FOR BRIDGE DEMOLITION AND RENOVATION ACTIVITIES, SEE SPECIAL PROVISIONS.

PRESTRESSED CONCRETE GIRDERS, PRECAST DECK PANELS, AND PRESTRESSED CONCRETE PILES SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.

CLASS AA CONCRETE SHALL BE USED IN ALL CAST-IN-PLACE END BENT AND BENT CAPS AND SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR.

ALL BAR SUPPORTS AND ALL INCIDENTAL REINFORCING STEEL SHALL BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

THE CONCRETE IN THE END BENT AND BENT CAPS, AND PRESTRESSED CONCRETE PILES OF BENTS 1 & 2 SHALL CONTAIN SILICA FUME. SILICA FUME SHALL BE SUBSTITUTED FOR 5% OF THE PORTLAND CEMENT BY WEIGHT. IF THE OPTION OF ARTICLE 1024-1 OF THE STANDARD SPECIFICATIONS TO PARTIALLY SUBSTITUTE CLASS F FLY ASH FOR PORTLAND CEMENT IS EXERCISED, THEN THE RATE OF FLY ASH SUBSTITUTION SHALL BE REDUCED TO 1.0 LB OF FLY ASH PER 1.0 LB OF CEMENT. NO PAYMENT WILL BE MADE FOR THIS SUBSTITUTION AS IT IS CONSIDERED INCIDENTAL TO THE VARIOUS PAY ITEMS.

THIS STRUCTURE CONTAINS THE NECESSARY CORROSION PROTECTION REQUIRED FOR A CORROSIVE SITE.

THE MATERIAL SHOWN IN THE CROSS-HATCHED AREA SHALL BE EXCAVATED FOR A DISTANCE OF 34 FT. EACH SIDE OF CENTERLINE ROADWAY AT END BENT 1 AND 55 FT. EACH SIDE OF CENTERLINE ROADWAY AT END BENT 2 AS DIRECTED BY THE ENGINEER. THIS WORK WILL BE PAID FOR AT THE CONTRACT LUMP SUM PRICE FOR UNCLASSIFIED STRUCTURE EXCAVATION. SEE SECTION 412 OF THE STANDARD SPECIFICATIONS.

SAMPLE BAR REPLACEMENT SIZE LENGTH 6'-2" #4 7'-4" #5 8'-6" #6 9'-8" 10'-10" 12'-0" #9 13'-2" **#**10 14'-6" #11 15′-10″

NOTE: SAMPLE BAR REPLACEMENT LENGTHS BASED ON 30"(SAMPLE LENGTH) PLUS TWO SPLICE LENGTHS AND fy = 60ksi. PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SHEET 4 OF 4

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

GENERAL DRAWING

FOR BRIDGE ON NC 211

OVER DUTCHMAN CREEK

BETWEEN NC 133 (LONG BEACH RD.

AND NC 133 (DOSHER CUTOFF)

(EBL)

SHEET NO.

S2-4

TOTAL SHEETS

DATE:

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 REVISIONS

NO. BY: DATE: NO. BY:

3
4

23-JAN-2019 13:02 Z:\Structures\Plans\Str2\R-5021_SMU_02_GD_090024.dgn kalford

DATE : 5/3/18

DRAWN BY: _____A.K.PATEL/S.B.WILLIAMS ____ DATE: _4/30/18

DESIGN ENGINEER OF RECORD: A.K. PATEL DATE: 1/17/19

CHECKED BY: M.K.BEARD

LOAD AND RESISTANCE FACTOR RATING (LRFD) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS STRENGTH I LIMIT STATE SERVICE III LIMIT STATE MOMENT SHEAR MOMENT DISTRIBUTION FACTORS (DF) ROLLING RATING GIRDER MINIMUN RATING (RF) GIRDER CONT DIST, LEFT SPAN DIST, LEFT SPAN DIST, LEFT SPAN 0.674 1.77 17.833 10.698 1.02 30.422 N/A 1.02 1.75 С 0.748 1.91 0.80 0.643 EL HL-93(Inv)2.30 0.748 2.47 HL-93(0pr) N/A 1.35 0.674 2.3 17.833 10.698 DESIGN LOAD 46.801 0.674 2.29 14.266 2.16 0.643 1.30 36.000 1.30 0.748 0.80 30.422 HS-20(Inv) 1.75 С 24.962 EL RATING 100.834 0.748 36.000 2.80 HS-20(0pr) 1.35 0.674 2.97 С 14.266 2.80 24.962 N/A 13.500 38.081 0.674 0.748 5.14 30.422 17.833 24.962 0.643 2.82 2.82 1.4 5.1 С 0.80 SNSH EL 42.998 0.674 4.24 0.748 4.05 2.15 30.422 20.000 14.266 24.962 0.80 0.643 SNGARBS2 2.15 1.4 С 0.674 0.748 30.422 22.000 2.06 45.247 14.266 3.93 24.962 0.643 2.06 SNAGRIS2 4.18 С 0.80 27.250 2.55 0.748 2.60 30.422 38.288 0.674 17.833 0.643 SNCOTTS3 1.41 1.4 24.962 0.80 1.41 SNAGGRS4 34.925 1.19 41.644 0.674 2.34 17.833 0.748 2.45 24.962 0.643 1.19 30.422 0.80 35.550 41.408 0.674 2.27 17.833 0.748 2.66 24.962 0.643 1.16 30.422 1.17 С SNS5A 1.4 0.80 EL 43.004 30.422 0.674 2.18 17.833 2.56 0.643 1.08 SNS6A 39.950 1.08 1.4 С 0.748 24.962 0.80 43.067 2.65 30.422 SNS7B 42.000 1.03 0.674 2.08 С 17.833 0.748 24.962 0.80 0.643 1.03 EL LEGAL LOAD TNAGRIT3 33.000 1.32 43.395 0.674 17.833 0.748 2.95 24.962 0.643 30.422 1.4 2.69 С 0.80 1.31 EL RATING 1.32 TNT4A 33.075 1.32 43.756 1.4 0.674 2.72 С 17.833 0.748 2.71 24.962 0.80 0.643 EL 30.422 45.312 2.33 0.748 30.422 TNT6A 41.600 1.09 1.4 0.674 С 17.833 2.63 24.962 0.80 0.643 1.09 EL 46.148 0.674 2.41 0.748 30.422 42.000 1.10 С 17.833 2.57 24.962 0.80 0.643 1.10 TNT7A 48.171 0.674 0.748 2.47 0.643 30.422 42.000 1.15 1.4 2.4 С 17.833 24.962 0.80 1.15 TNT7B EL 2.36 14.266 43.000 1.08 46.589 0.674 С 0.748 2.40 24.962 0.643 1.08 30.422 TNAGRIT4 1.4 0.80 2.58 1.02 45.812 0.674 2.21 17.833 0.748 0.643 1.02 30.422 TNAGT5A 45.000 24.962 0.80 1.4 С

LOAD FACTORS:

	DESIGN LOAD RATING	LIMIT STATE	γ_{DC}	$\gamma_{\sf DW}$
		STRENGTH I	1.25	1.50
	FACTORS	SERVICE III	1.00	1.00

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:


EL 30.422

- (#) CONTROLLING LOAD RATING
- 1 DESIGN LOAD RATING (HL-93)
- 2 DESIGN LOAD RATING (HS-20)
- 3 LEGAL LOAD RATING **
- ** SEE CHART FOR VEHICLE TYPE

GIRDER LOCATION

- I INTERIOR GIRDER
- EL EXTERIOR LEFT GIRDER
- ER EXTERIOR RIGHT GIRDER

R-5021 PROJECT NO.____ BRUNSWICK _ COUNTY



STATION: 369+42.00 -L-

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD LRFR SUMMARY FOR PRESTRESSED CONCRETE GIRDERS (NON-INTERSTATE TRAFFIC) (EBL)

1/20/2019 SHEET NO REVISIONS S2-5 DATE:

35'-8" 60'-10¹/₄" 35'-8" (SPAN A BRG. TO BRG.) (SPAN C BRG. TO BRG.) (SPAN B BRG. TO BRG.) END BENT 2 BENT 2 END BENT 1 BENT 1

1.00 45.119 1.4 0.674 2.14 C I 17.833 0.748 2.25 A I 24.962 0.80 0.643 1.00

LRFR SUMMARY

DESIGN ENGINEER OF RECORD: P.K.NEWTON DATE : 7/31/17

ASSEMBLED BY : P.K. NEWTON CHECKED BY : A.K. PATEL DATE: 7/28/17 REV. II/I2/08RR MAA/GM DRAWN BY : MAA 1/08 REV. 10/1/11

CHECKED BY : GM/DI 2/08

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


20-JAN-2019 22:05 Z:\Structures\Plans\Str2\R-5021_SMU_02_LRFR_090024.dgn


45.000


TNAGT5B

STR.#2


STD. NO. LRFR1

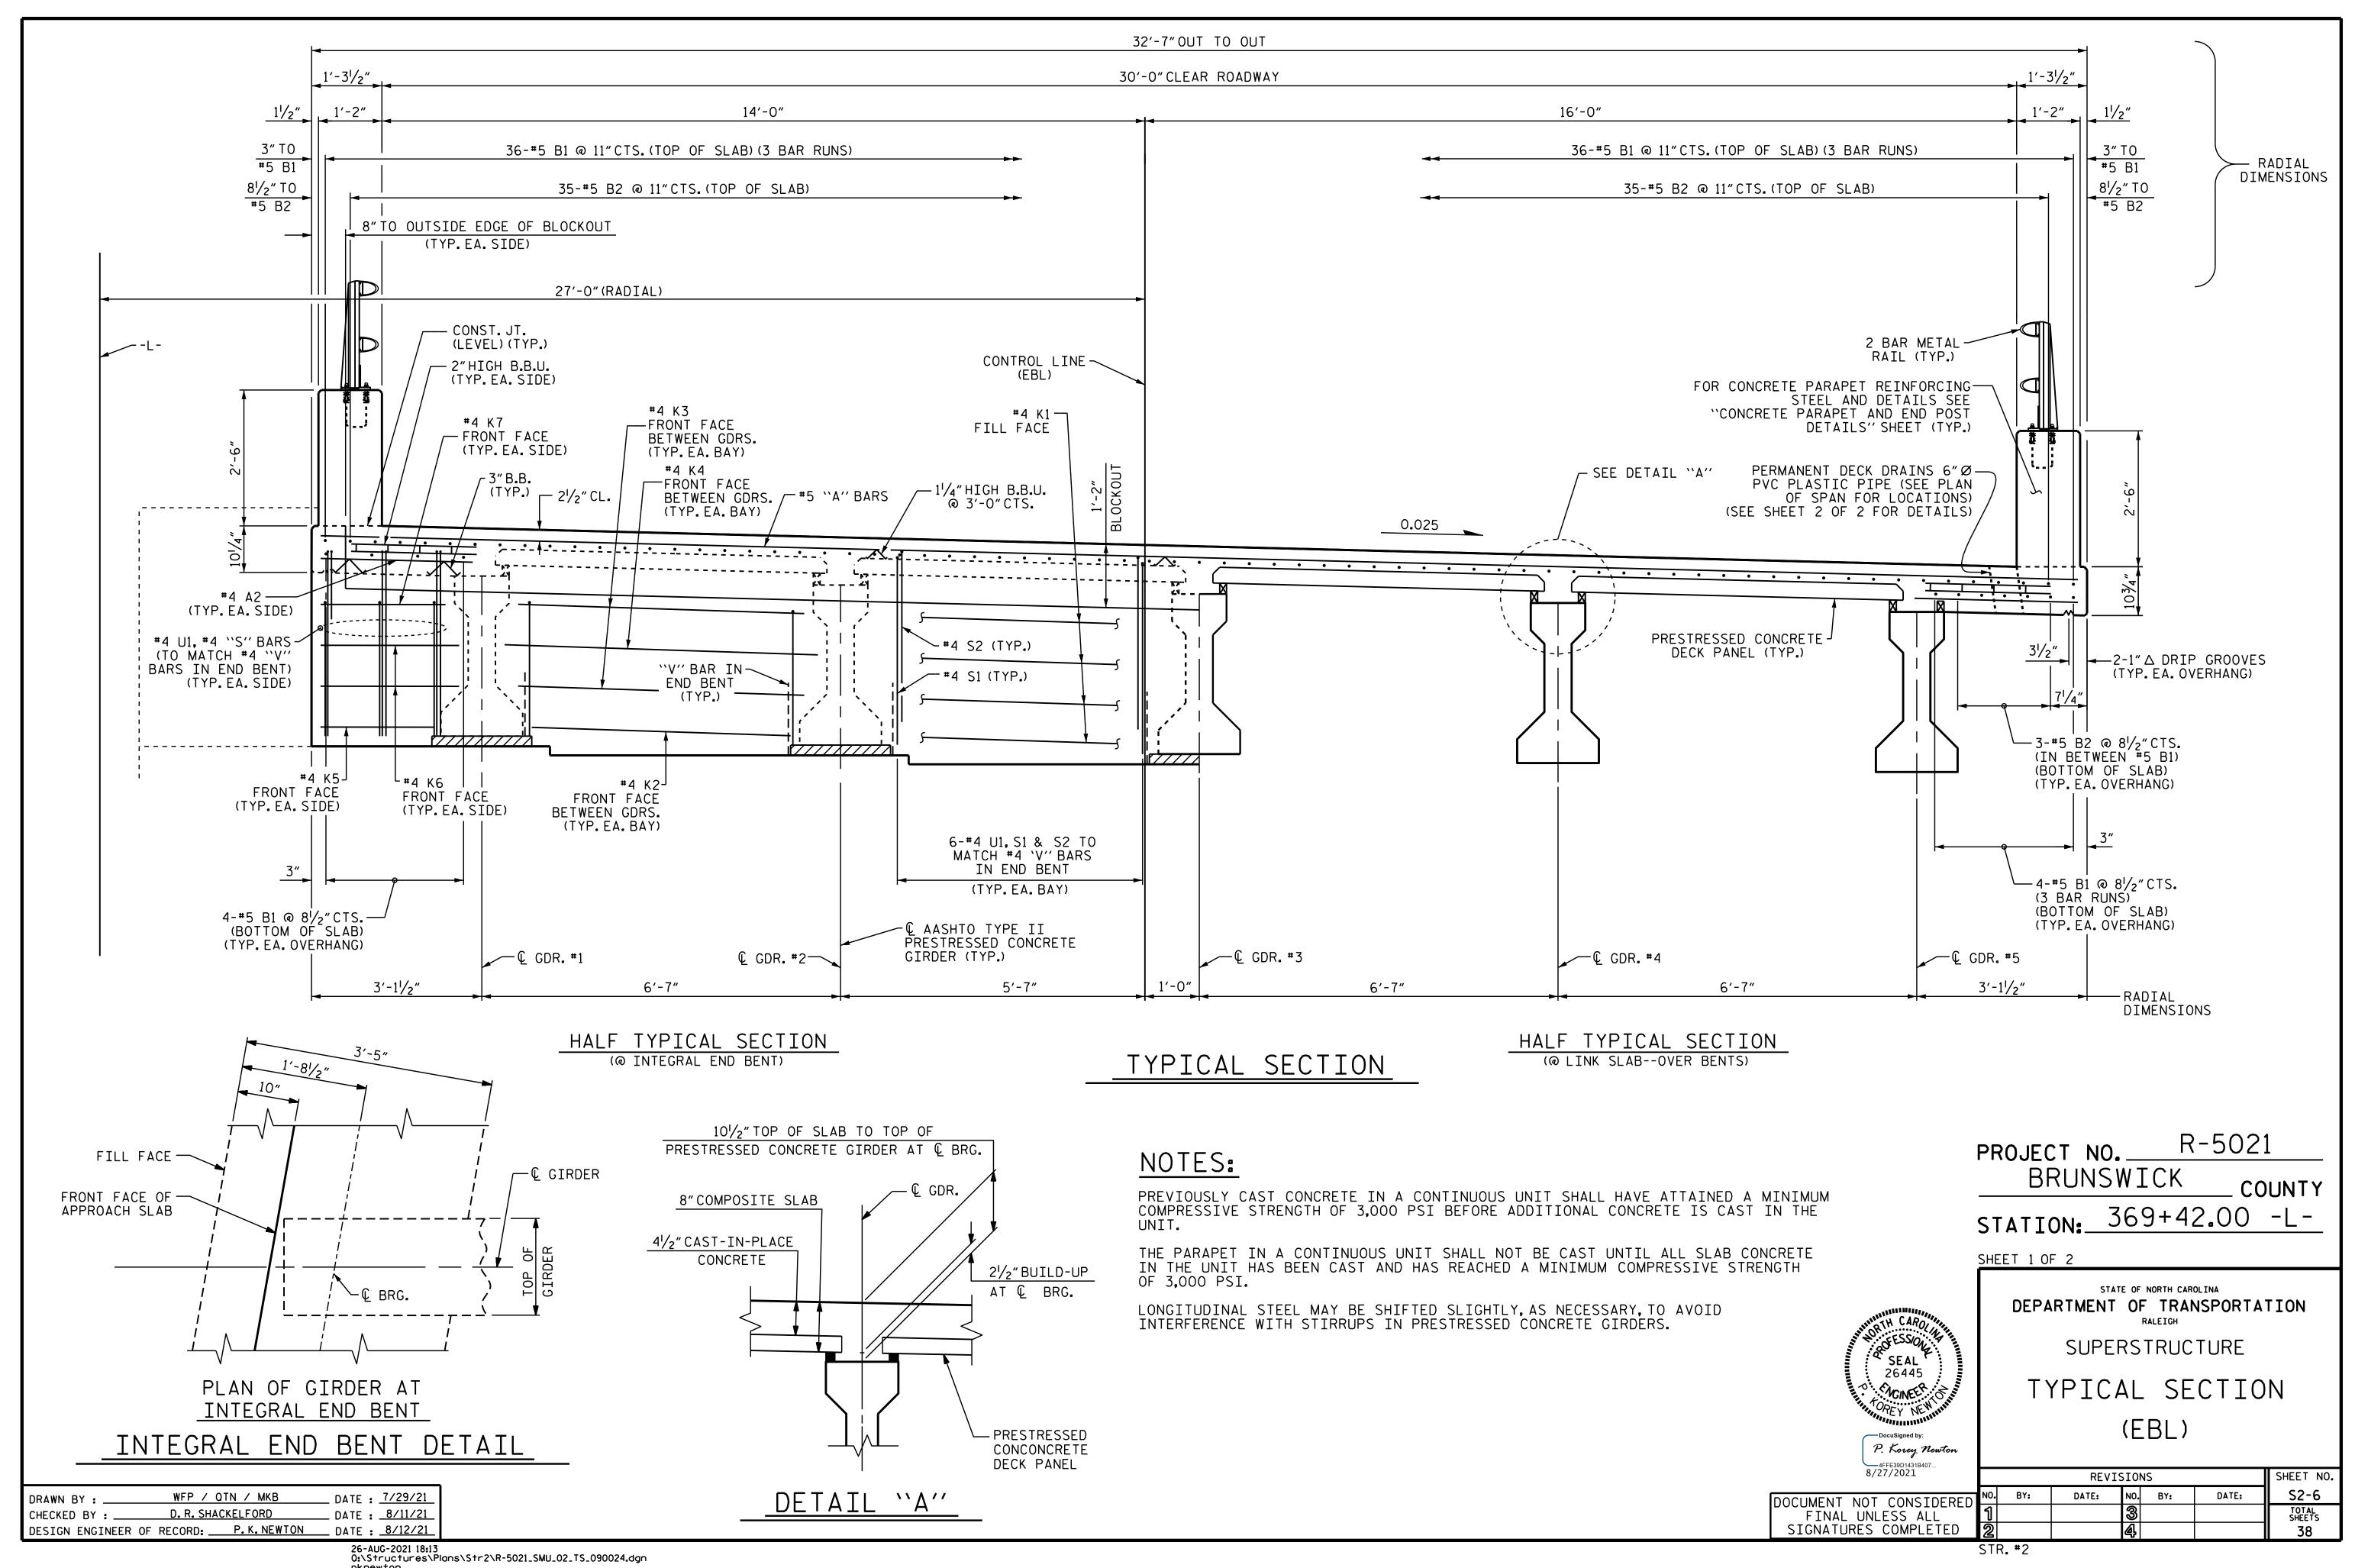


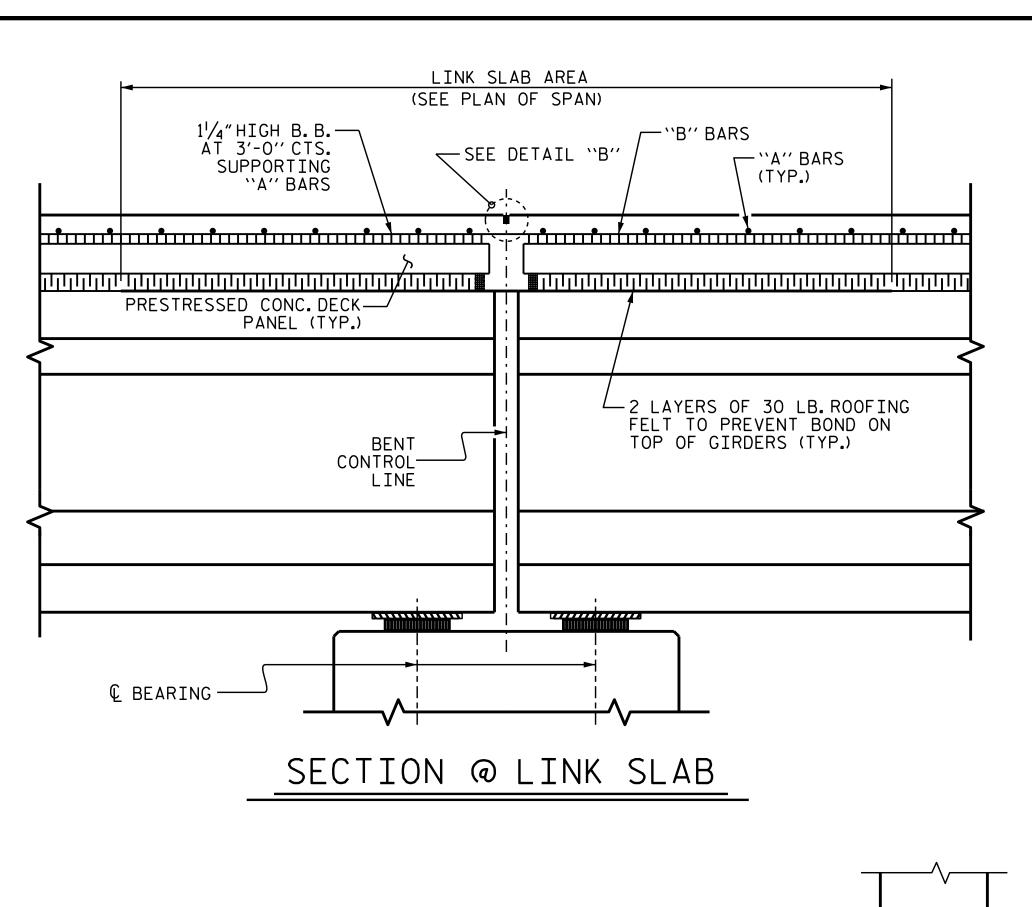


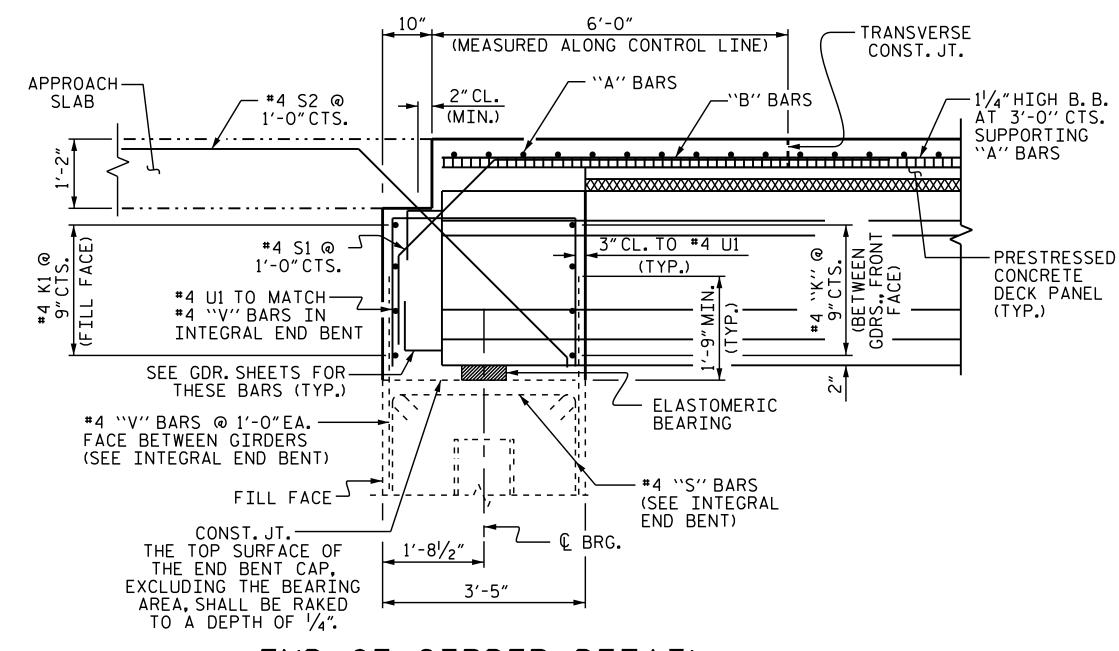

OF GIRDER DETAIL AT INTEGRAL END BENT

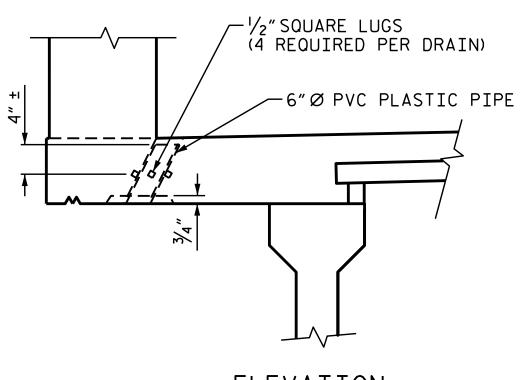

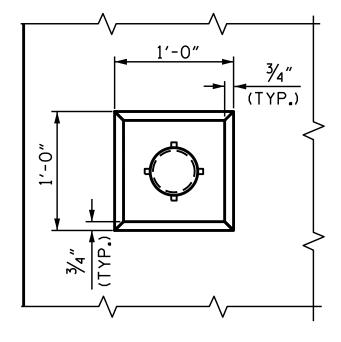

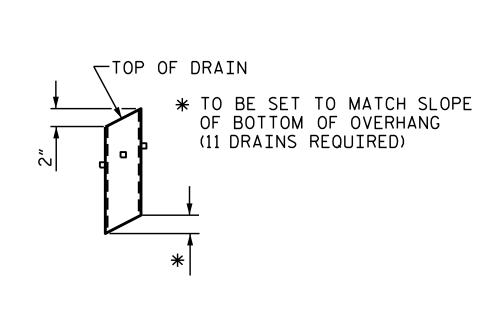

PIPE DETAIL

SECTION AT INTERMEDIATE DIAPHRAGM

__``A'' BARS

6'-7"(RADIAL)

TYPICAL SECTION AT

INTERMEDIATE DIAPHRAGM

(TYP. EA. BAY IN SPAN B)

— ``A'' BARS

-PRESTRESSED CONCRETE

L 6"X 6"X 1/2" ANGLE OR BENT

6" X 6" X ½" ₽

DECK PANEL (TYP.)

MC 12×31

 $-2^{1/2}$ " CL.

• • • • • • •

PRESTRESSED-

DECK PANEL

ℚ GDR.

"B" BARS —

CONCRETE

MC 12 X 31—

(TYP.)

"B" BARS

— 1 1/4" HIGH B.B. AT 3'-0" CTS.

SUPPORTING "A" BARS

R-5021

369+42.00 -L-

STATE OF NORTH CAROLINA

RALEIGH

COUNTY

(TYP.)


ELEVATION

PLAN OF RECESS

TOP OF FLOOR DRAINS TO BE SET 3/8" BELOW SURFACE OF SLAB. 4 - 1#2"SQUARE LUGS TO BE GLUED TO THE P.V.C. PLASTIC PIPE AT EQUAL SPACES AROUND THE PIPE DRAIN APPROXIMATELY 4" FROM THE TOP OF THE PIPE.

THE 6" Ø PVC PLASTIC PIPE AND FITTINGS SHALL BE SCHEDULE 40 AND CONFORM TO ASTM D1785.

DRAIN DETAILS

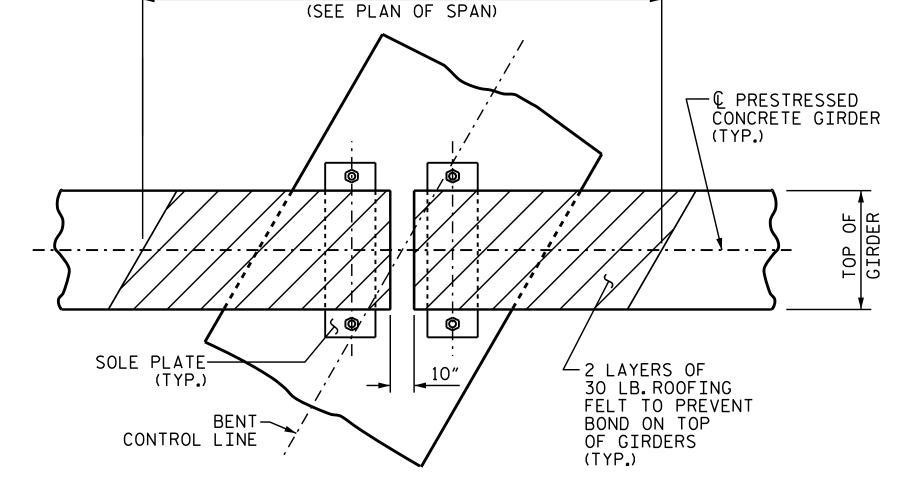


** LINK SLAB AREA

PLAN OF LINK SLAB

** THE TOP OF GIRDER IN THE REGION OF THE LINK SLAB SHALL BE SMOOTH (NOT RAKED) AND FREE OF STIRRUPS, DECK FORMWORK ATTACHMENTS, AND OVERHANG FALSEWORK/FORMWORK ATTACHMENTS.


-JOINT SEALER MATERIAL 3/8" SAWED OPENING DETAIL "B" A $1\frac{1}{2}$ DEEP. $\frac{3}{8}$ WIDE CONTRACTION JOINT AT THE BENT CONTROL LINE SHALL BE SAWED WITHIN 24 HOURS OF POURING THE LINK SLAB DECK. THE JOINT SHALL BE FILLED WITH JOINT SEALER MATERIAL. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE

STANDARD SPECIFICATIONS.

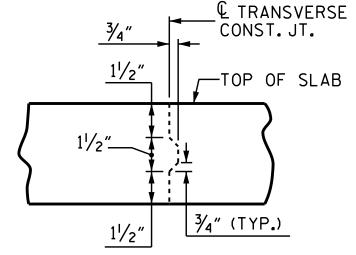

TRANSVERSE CONSTRUCTION JOINT DETAIL

NOTE: REINFORCING STEEL IN SLAB NOT SHOWN.
LONGITUDINAL REINFORCING STEEL SHALL BE CONTINUOUS THRU JOINT

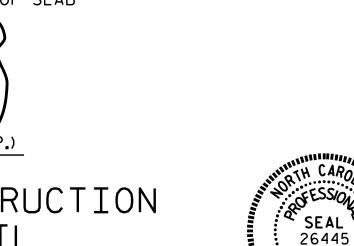

SHEET 2 OF 2 DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE

BRUNSWICK

TYPICAL SECTION (EBL) P. Korey Newton

DOCL SI

. NOINEEP

8/16/2021			REVIS	SIO	NS		SHEE
UMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S
FINAL UNLESS ALL	1			3			T C SH
IGNATURES COMPLETED	2			4			
	STI	₹. #2					

PROJECT NO.

STATION:_


WFP / QTN / MKB _ DATE : 7/29/21 DRAWN BY : D. R. SHACKELFORD _ DATE : <u>8/11/21</u> CHECKED BY : _ DESIGN ENGINEER OF RECORD: P.K. NEWTON DATE: 8/12/21

DECK PANEL SUPPORTS

THE CONTRACTOR SHALL PROVIDE THE DECK PANEL SUPPORT SYSTEM SHOWN OR HE MAY SUBMIT A DECK PANEL SUPPORT SYSTEM OF HIS OWN DESIGN TO THE ENGINEER FOR APPROVAL.

POLYSTYRENE SUPPORT SYSTEM

- 1. ALL POLYSTYRENE SHALL BE DOW STYROFOAM 60 HIGH-LOAD, UC INDUSTRIES FOAMULAR 600 OR APPROVED EQUAL.
- 2. THE POLYSTYRENE SUPPORT SYSTEM SHALL CONSIST OF ONE LAYER WITH A MINIMUM WIDTH OF 11/2" AND A MAXIMUM WIDTH OF 2". THE POLYSTYRENE SHALL HAVE 1/2" X 1/2" WIDE SLOTS OR 1/2" DIAMETER HOLES AT 4'-0" CENTERS STAGGERED ALONG THE TOP AND BOTTOM.
- 3. THE POLYSTYRENE MAY BE CUT AND PLACED ON EDGE AS NECESSARY TO MATCH THE REQUIRED BUILDUP PROFILE ALONG THE GIRDER.
- 4. ADHESIVE, AS APPROVED BY THE ENGINEER, SHALL BE APPLIED TO THE TOP OF THE GIRDER IN A CONTINUOUS BEAD AND IN SUFFICIENT AMOUNT TO PREVENT THE POLYSTYRENE FROM BLOWING OUT AND TO PREVENT GAPS FROM FORMING BETWEEN THE POLYSTYRENE AND THE GIRDER. PRIOR TO PLACEMENT OF THE DECK PANELS, THE ADHESIVE SHALL ALSO BE APPLIED TO THE TOP OF THE POLYSTYRENE.
- 5. CONCRETE-FILLED BUCKETS, STACKS OF DECK PANELS, BUNDLED REINFORCING BARS OR OTHER HEAVY CONCENTRATED LOADS WILL NOT BE PERMITTED ON THE DECK PANEL ONCE THE PANEL HAS BEEN PLACED ON THE POLYSTYRENE SUPPORT SYSTEM.

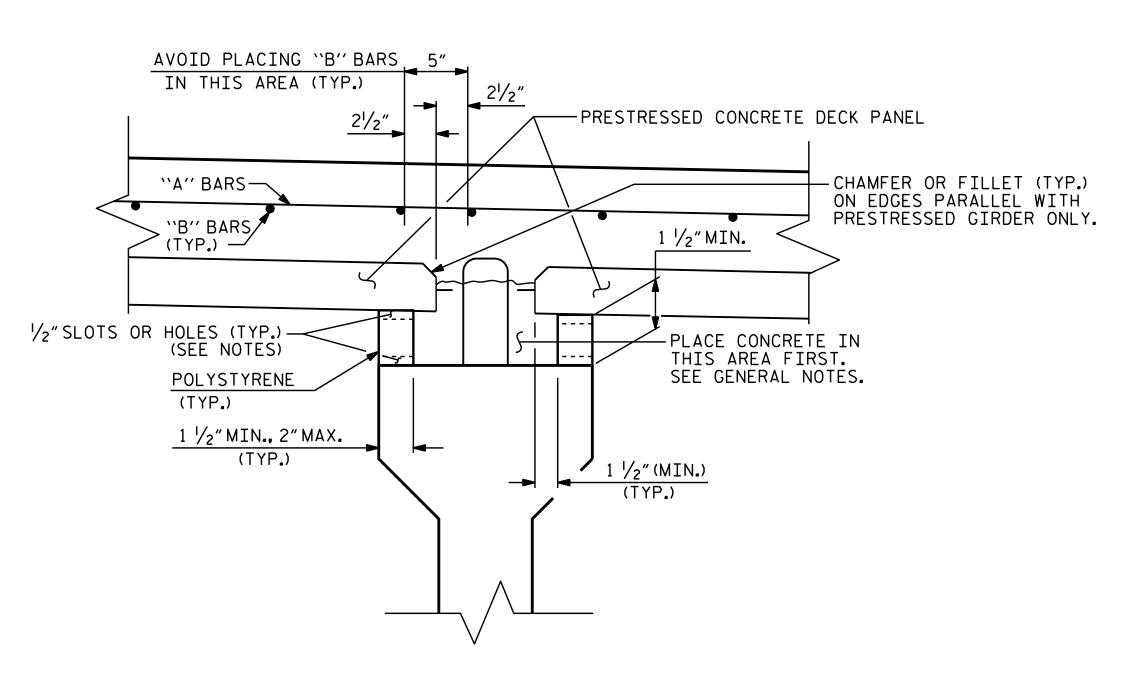


POLYSTYRENE SUPPORT

ASSEMBLED BY: WFP / QTN DATE: 8/15/18 CHECKED BY : M. K. BEARD DATE: II/I8 TLA/GM REV. 5/I/06R DRAWN BY : ELR 1/92 REV. 10/1/11 MAA/GM CHECKED BY : GRP 4/92 MAA/THO

GENERAL NOTES

- 1. THE DESIGN COMPRESSIVE STRENGTH (f'c) FOR THE CONCRETE IN PRESTRESSED PANELS SHALL BE 5000 PSI MINIMUM AT 28 DAYS. COMPRESSIVE STRENGTH OF CONCRETE AT TIME OF RELEASE OF STRANDS SHALL BE 4000 PSI MINIMUM.
- 2. THE PRECAST PRESTRESSED PANEL SHALL HAVE A THICKNESS OF 3 $\frac{1}{2}$ " WITH THE PRESTRESSED STRANDS LOCATED AT HALF THE DEPTH OF THE PANEL.
- 3. FOR SKEWED SPANS, TRAPEZOIDAL CLOSURE PANELS SHALL HAVE A MINIMUM WIDTH OF 2 FEET ON THE SHORT SIDE.
- 4. ALL PRESTRESSING STRANDS SHALL EXTEND 2" BEYOND THE PANEL EDGES.
- 5. SHEAR REINFORCING OF 0.60 SQ. INCHES OF REINFORCING STEEL PER 10 SQ. FEET OF PANEL SURFACE SHALL BE PROVIDED IN THE PANEL TO ENSURE COMPOSITE ACTION BETWEEN PANEL AND THE CAST-IN-PLACE CONCRETE. SHEAR REINFORCEMENT SHALL BE MADE OF WELDED WIRE HAVING A MINIMUM YIELD STRENGTH OF 60 KSI.
- 6. SHEAR REINFORCEMENT AND LIFTING DEVICES SHALL BE CONSTRUCTED AND PLACED SO AS TO AVOID ANY INTERFERENCE WITH REINFORCING STEEL IN THE CAST-IN-PLACE DECK SLAB AND TO ALLOW FOR PROPER CONCRETE CONSOLIDATION IN THE DECK PANEL.
- 7. SHIFT LONGITUDINAL "B" BARS AS NECESSARY TO OBTAIN A MINIMUM CLEAR DISTANCE OF 2 1/2" TO THE RIGHT OR LEFT OF THE EDGE OF THE DECK PANEL. IF, IN SHIFTING TO OBTAIN THIS CLEARANCE, THE "B" BAR INTERFERES WITH THE STIRRUP IN THE TOP OF THE GIRDER THE "B" BAR MAY BE ELIMINATED.
- 8. WHEN CASTING THE DECK, PLACE CONCRETE FIRST OVER THE GIRDERS IN CONTINUOUS STRIPS A MINIMUM OF THREE PANEL LENGTHS AHEAD OF THE REST OF THE CONCRETE. CAREFULLY VIBRATE THE CONCRETE OVER THE GIRDERS SO THAT CONCRETE COMPLETELY FILLS THE AREA UNDER THE DECK PANEL OVERHANGS. THEN PLACE AND VIBRATE THE REMAINING DECK CONCRETE.
- 9. PRECAST PANELS SHALL BE DESIGNED FOR AN ALLOWABLE TENSILE STRESS OF O PSI IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.
- 10. PRECAST PANELS SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.
- 11. ALL BAR SUPPORTS AND INCIDENTAL REINFORCING STEEL USED IN THE PRECAST PANELS SHALL BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

R-5021 PROJECT NO. ____ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-




STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH


STANDARD


PRECAST PRESTRESSED CONCRETE DECK PANELS (EBL)


DOCUM F SIGN

1/20/2019			REVIS	SIO	NS		SHEET NO.
MENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S2-8
INAL UNLESS ALL	1			3		_	TOTAL SHEETS
NATURES COMPLETED	2			4			38

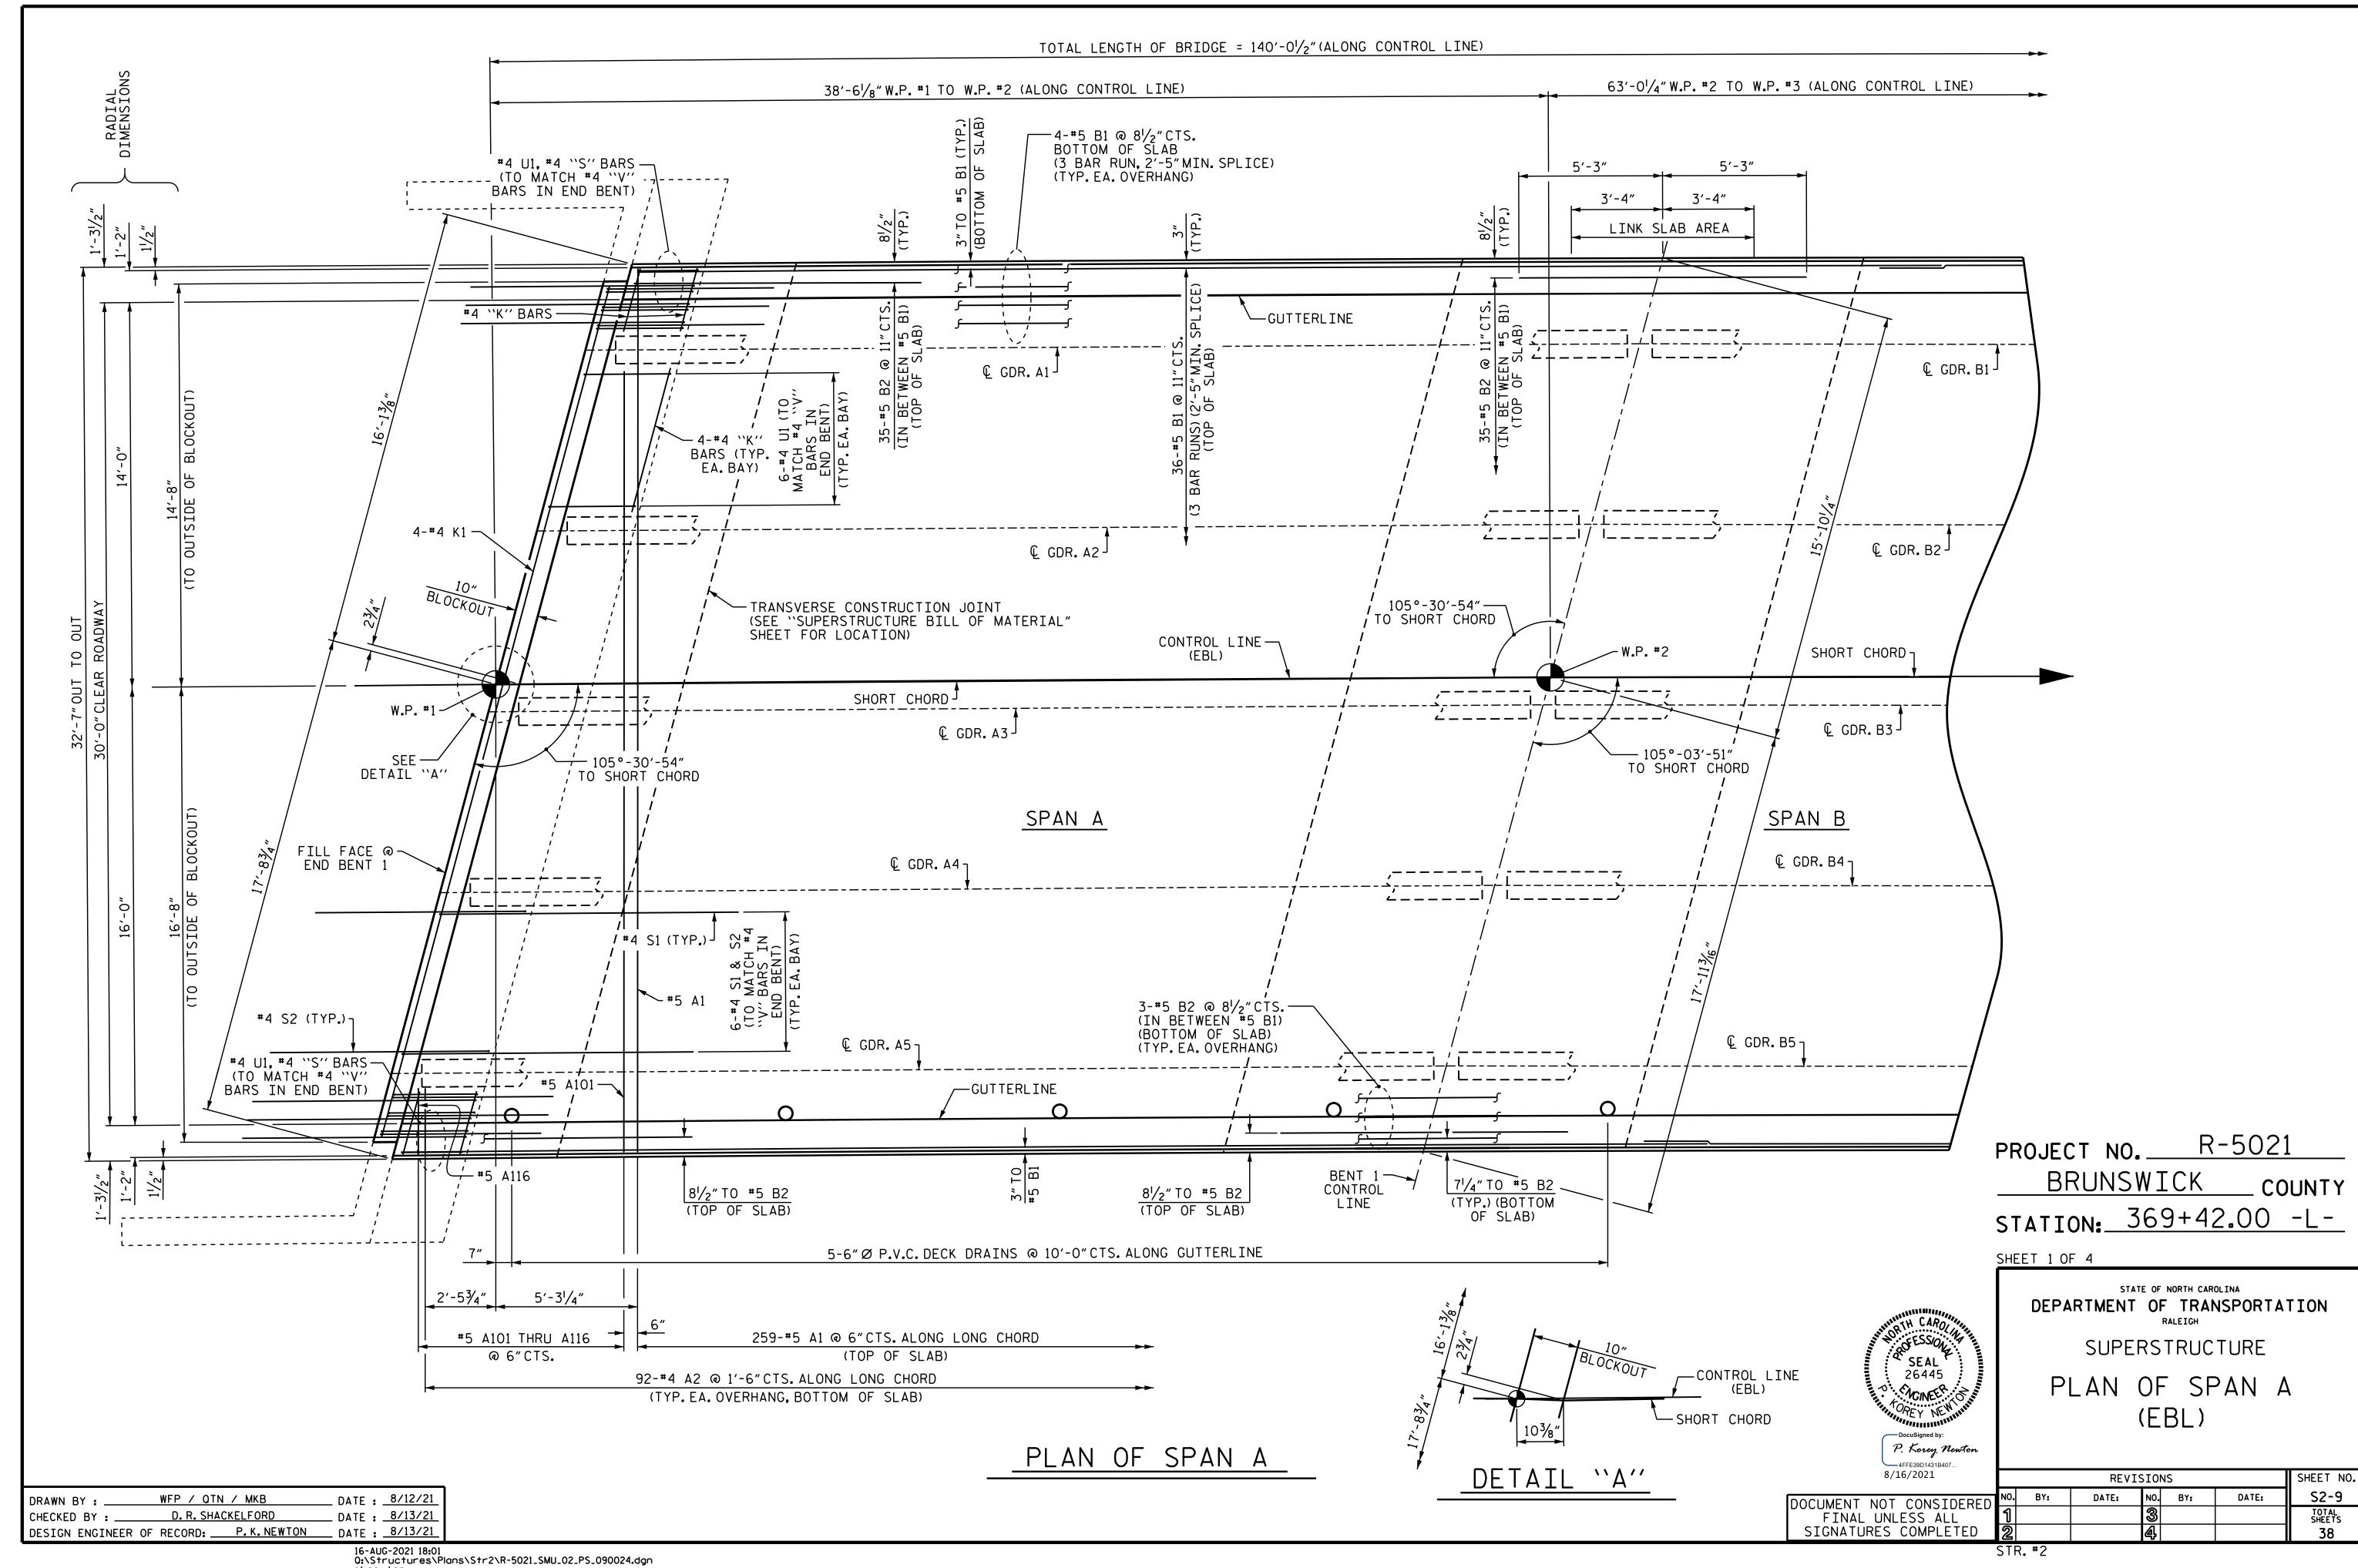


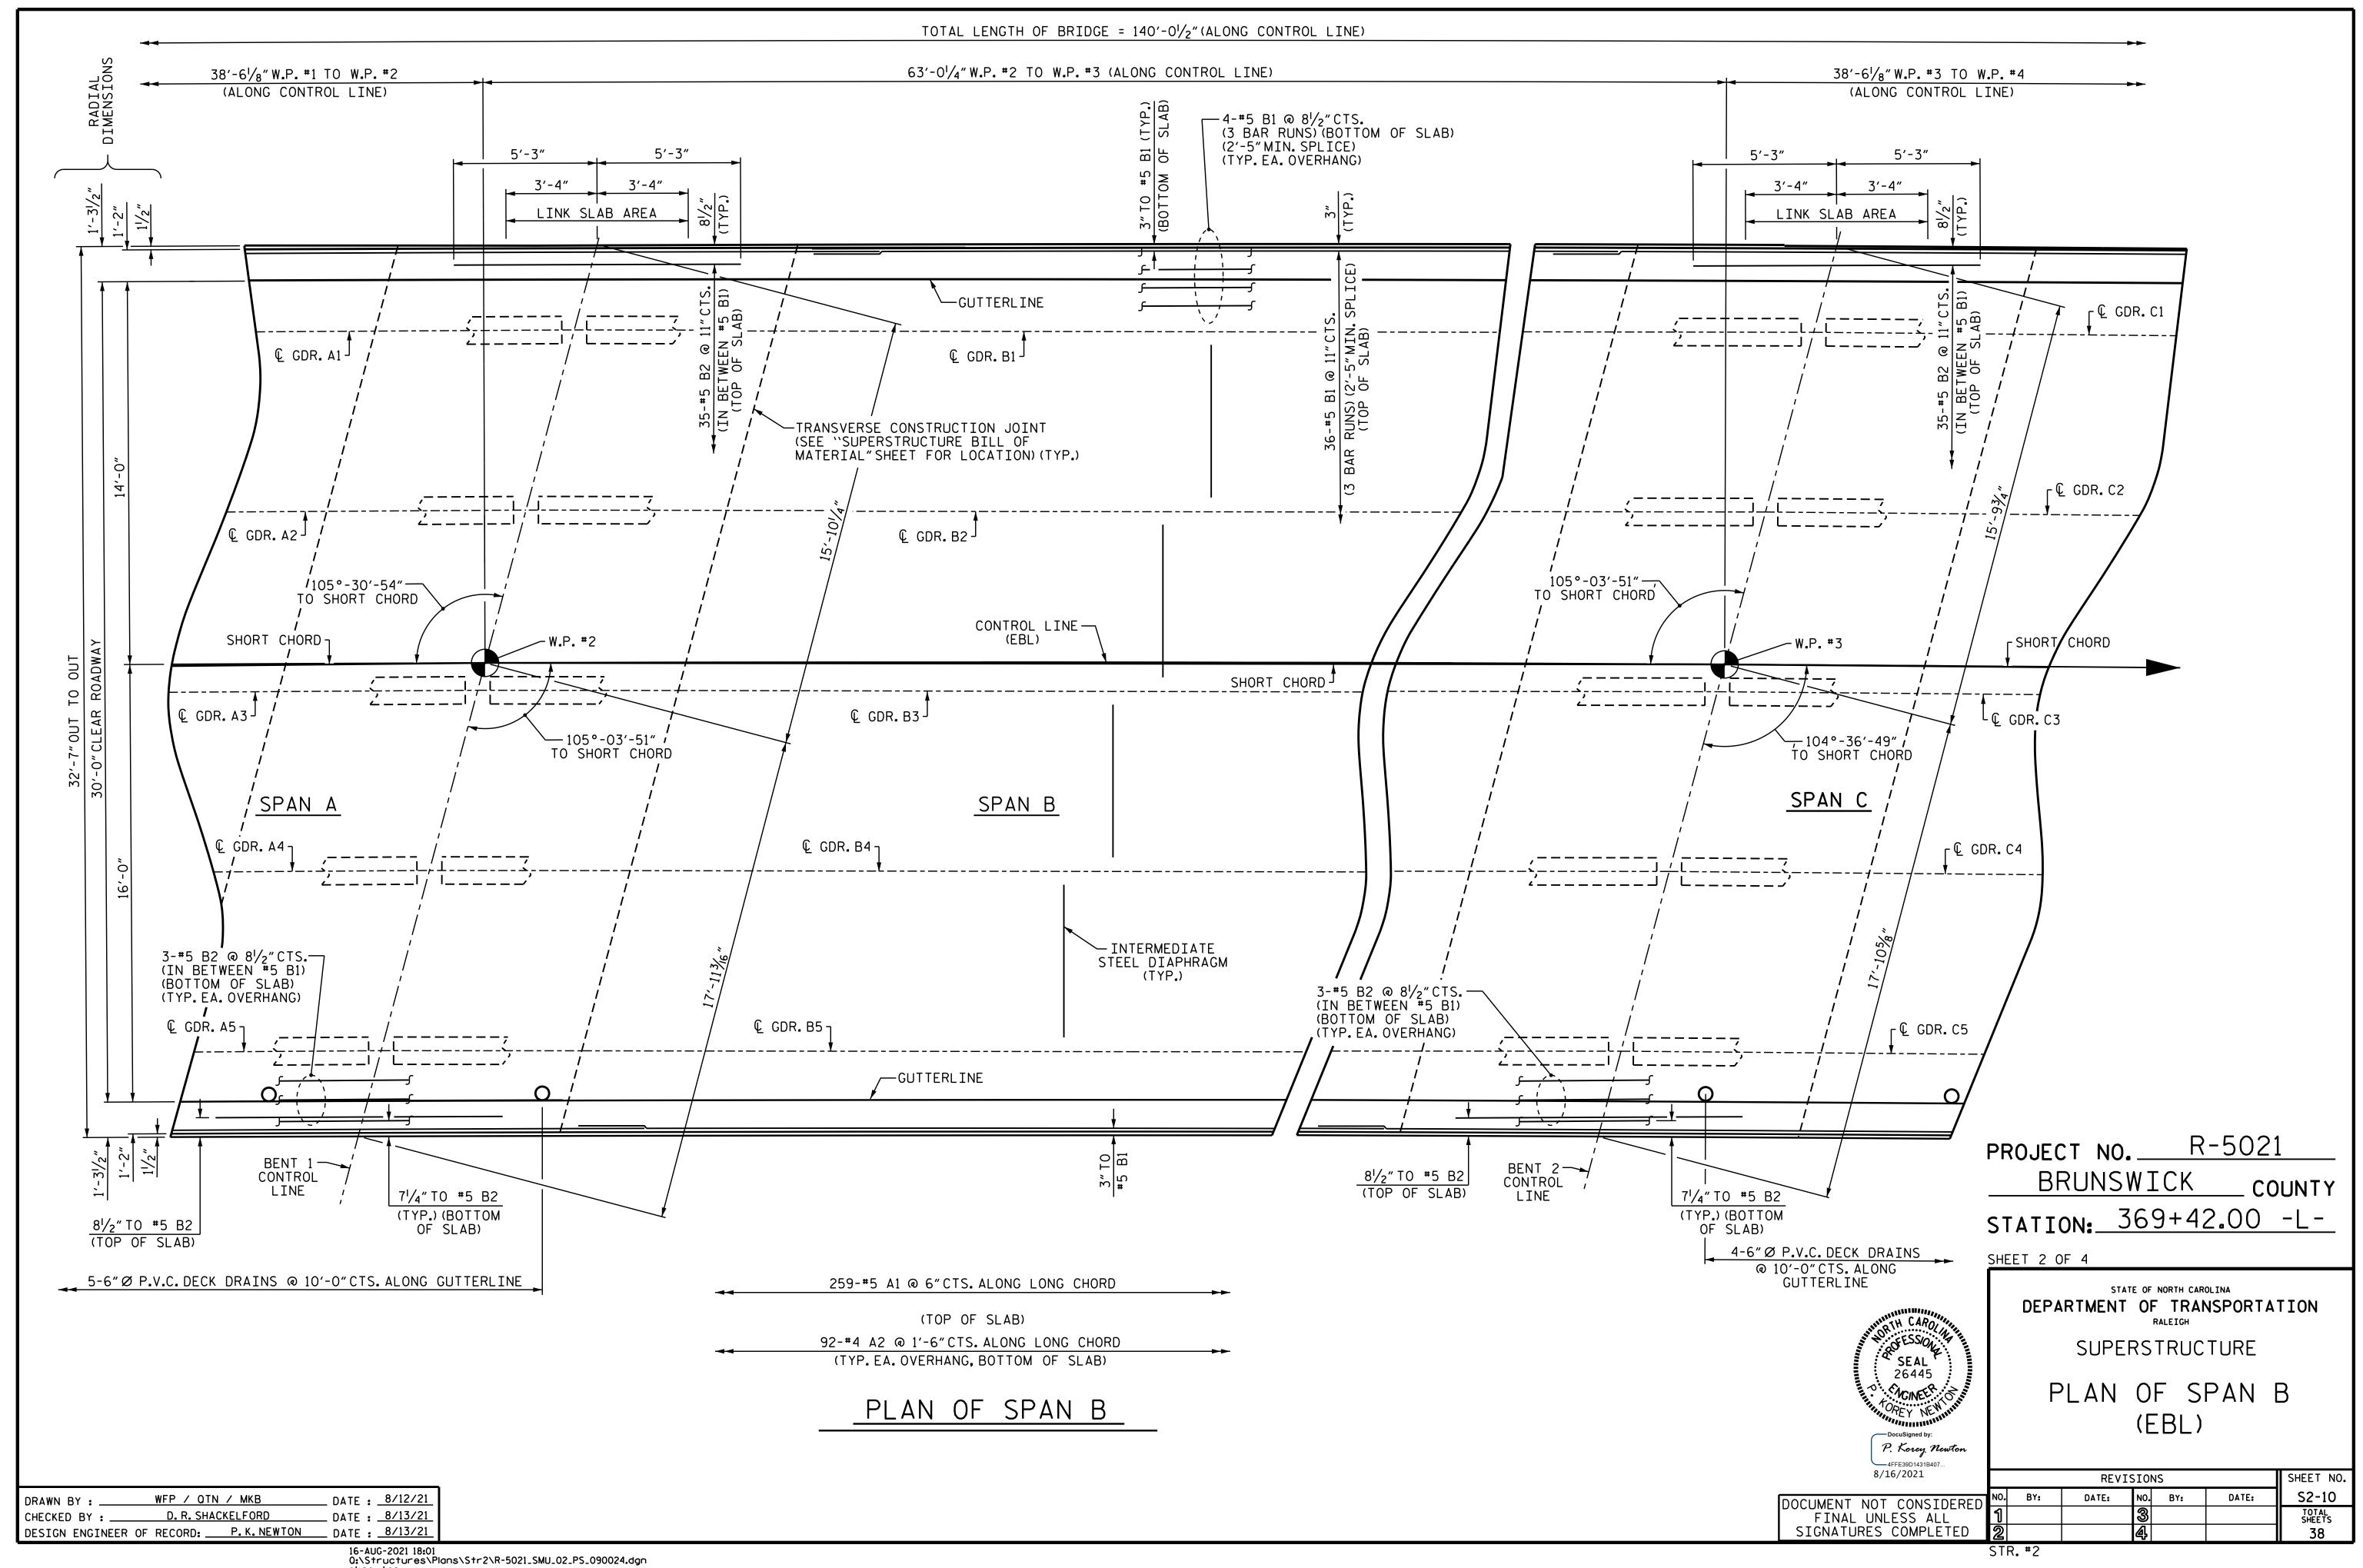


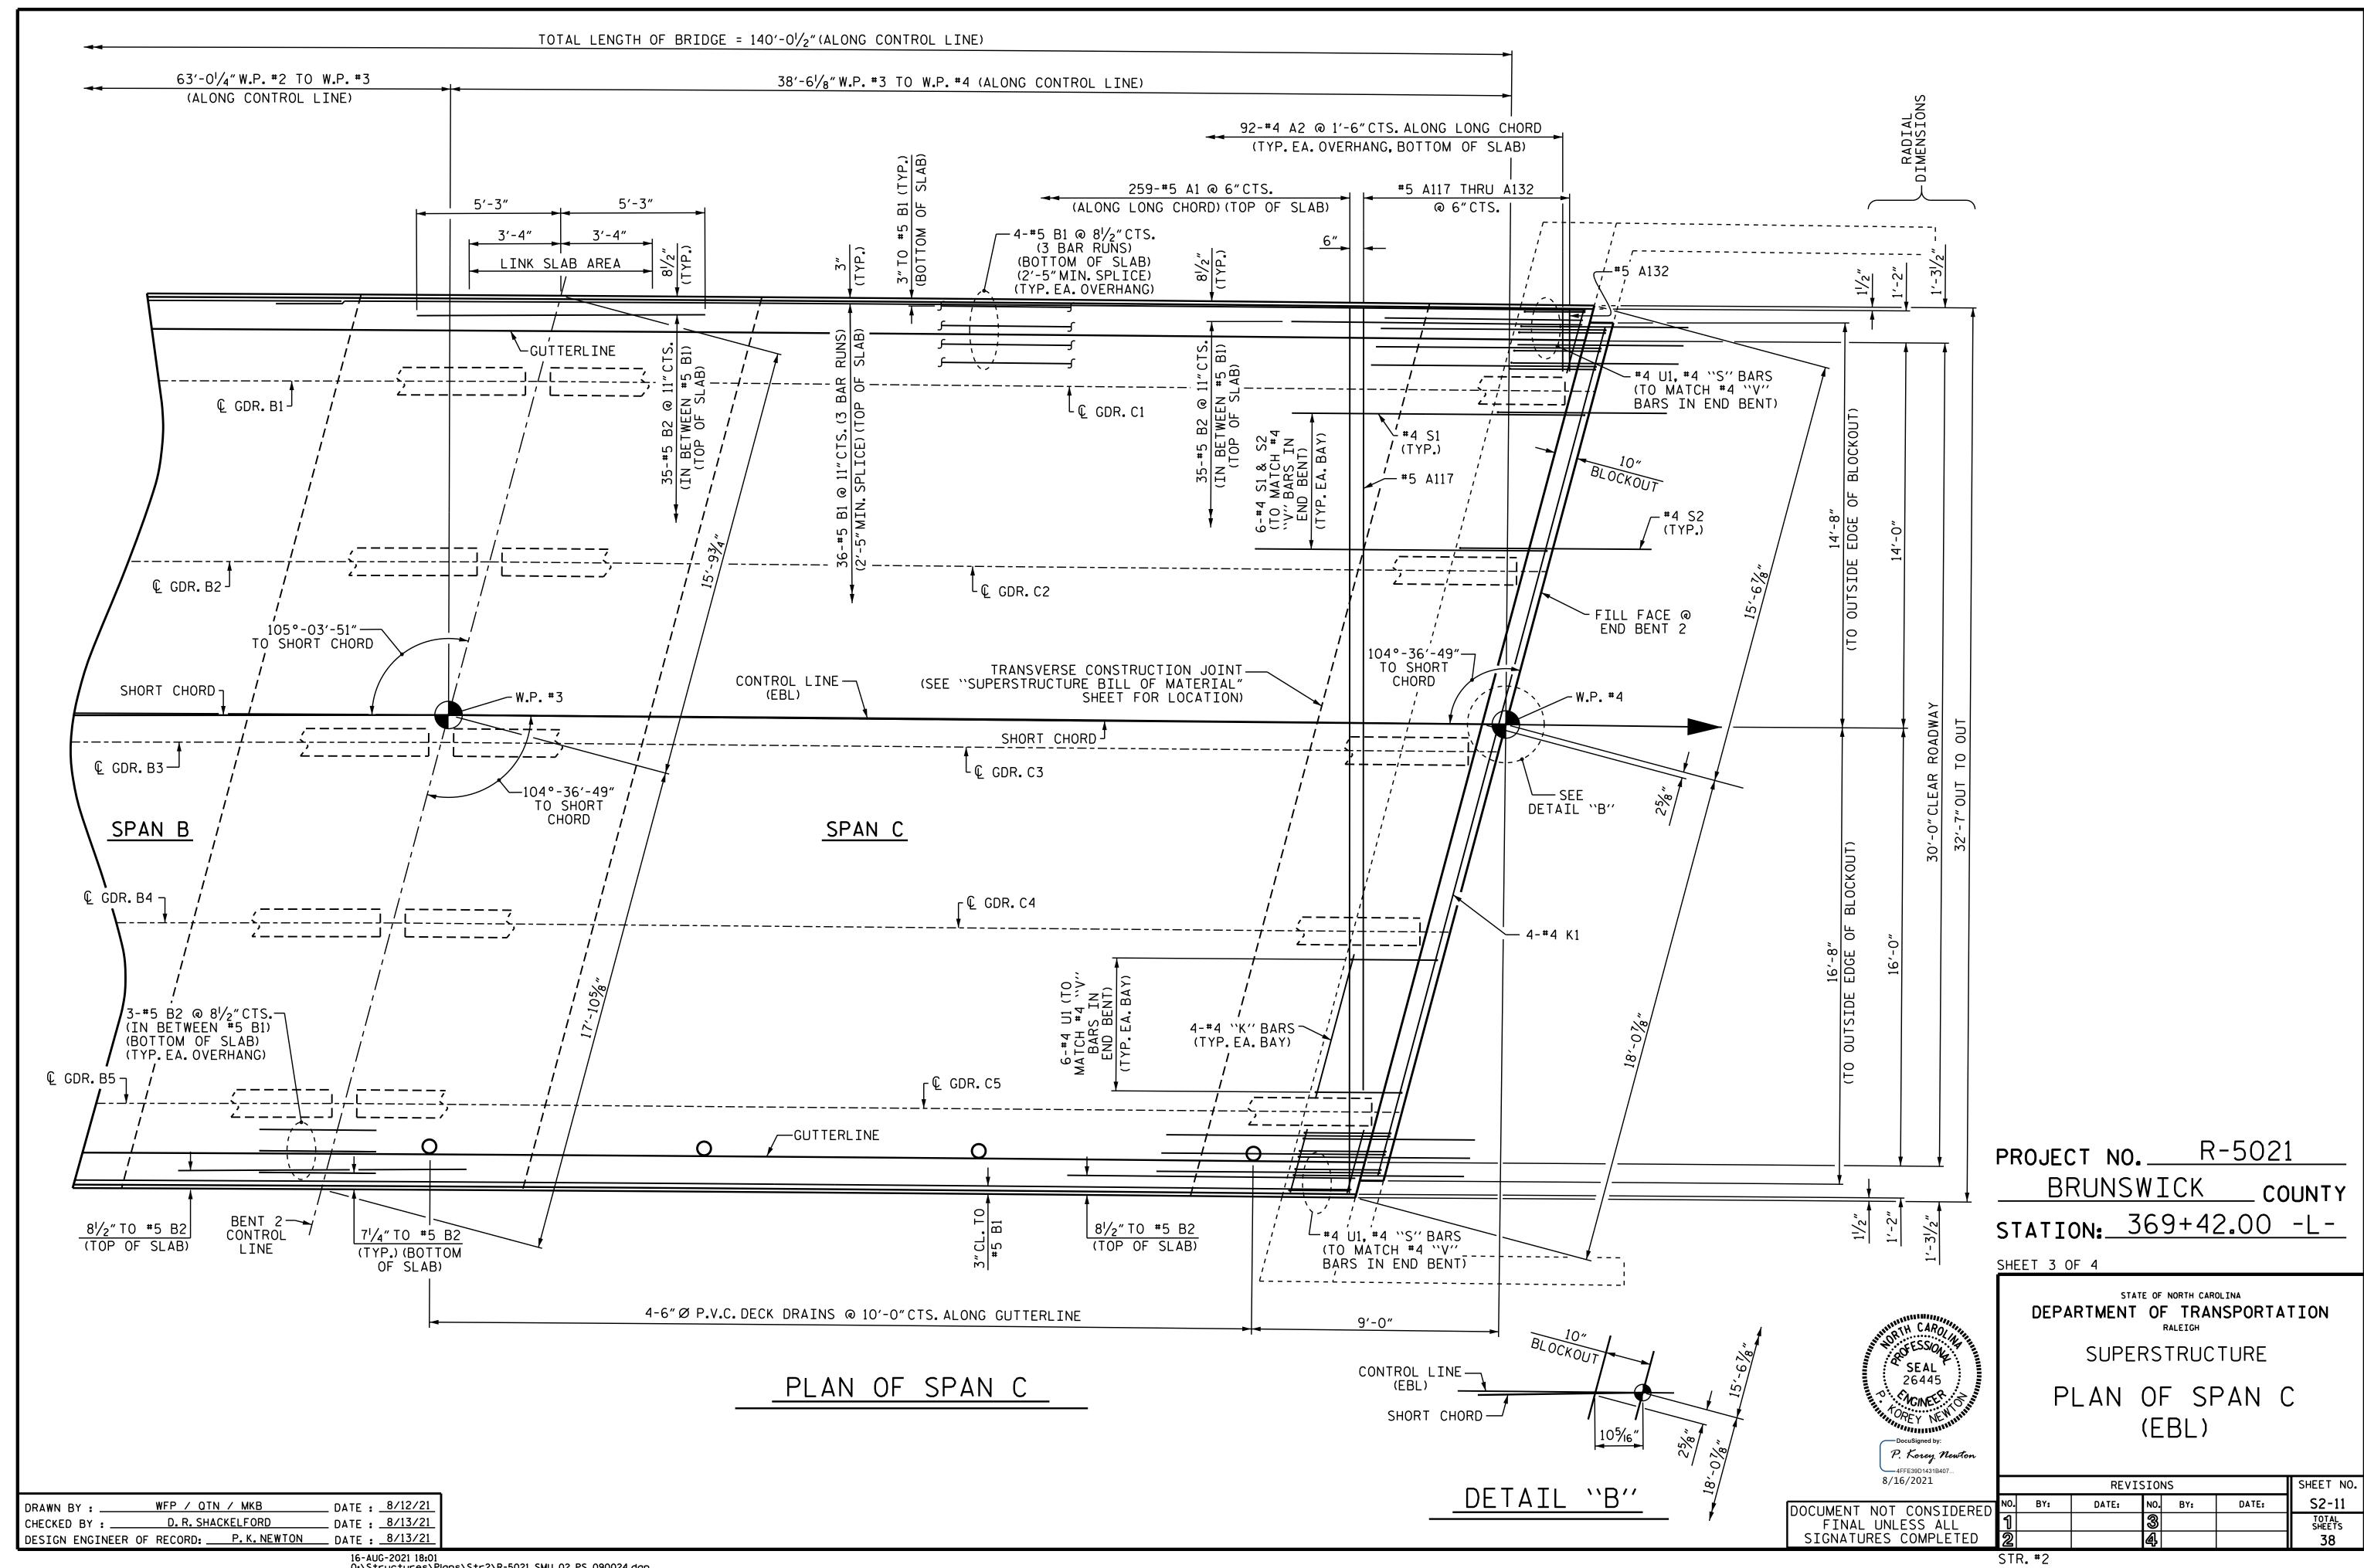


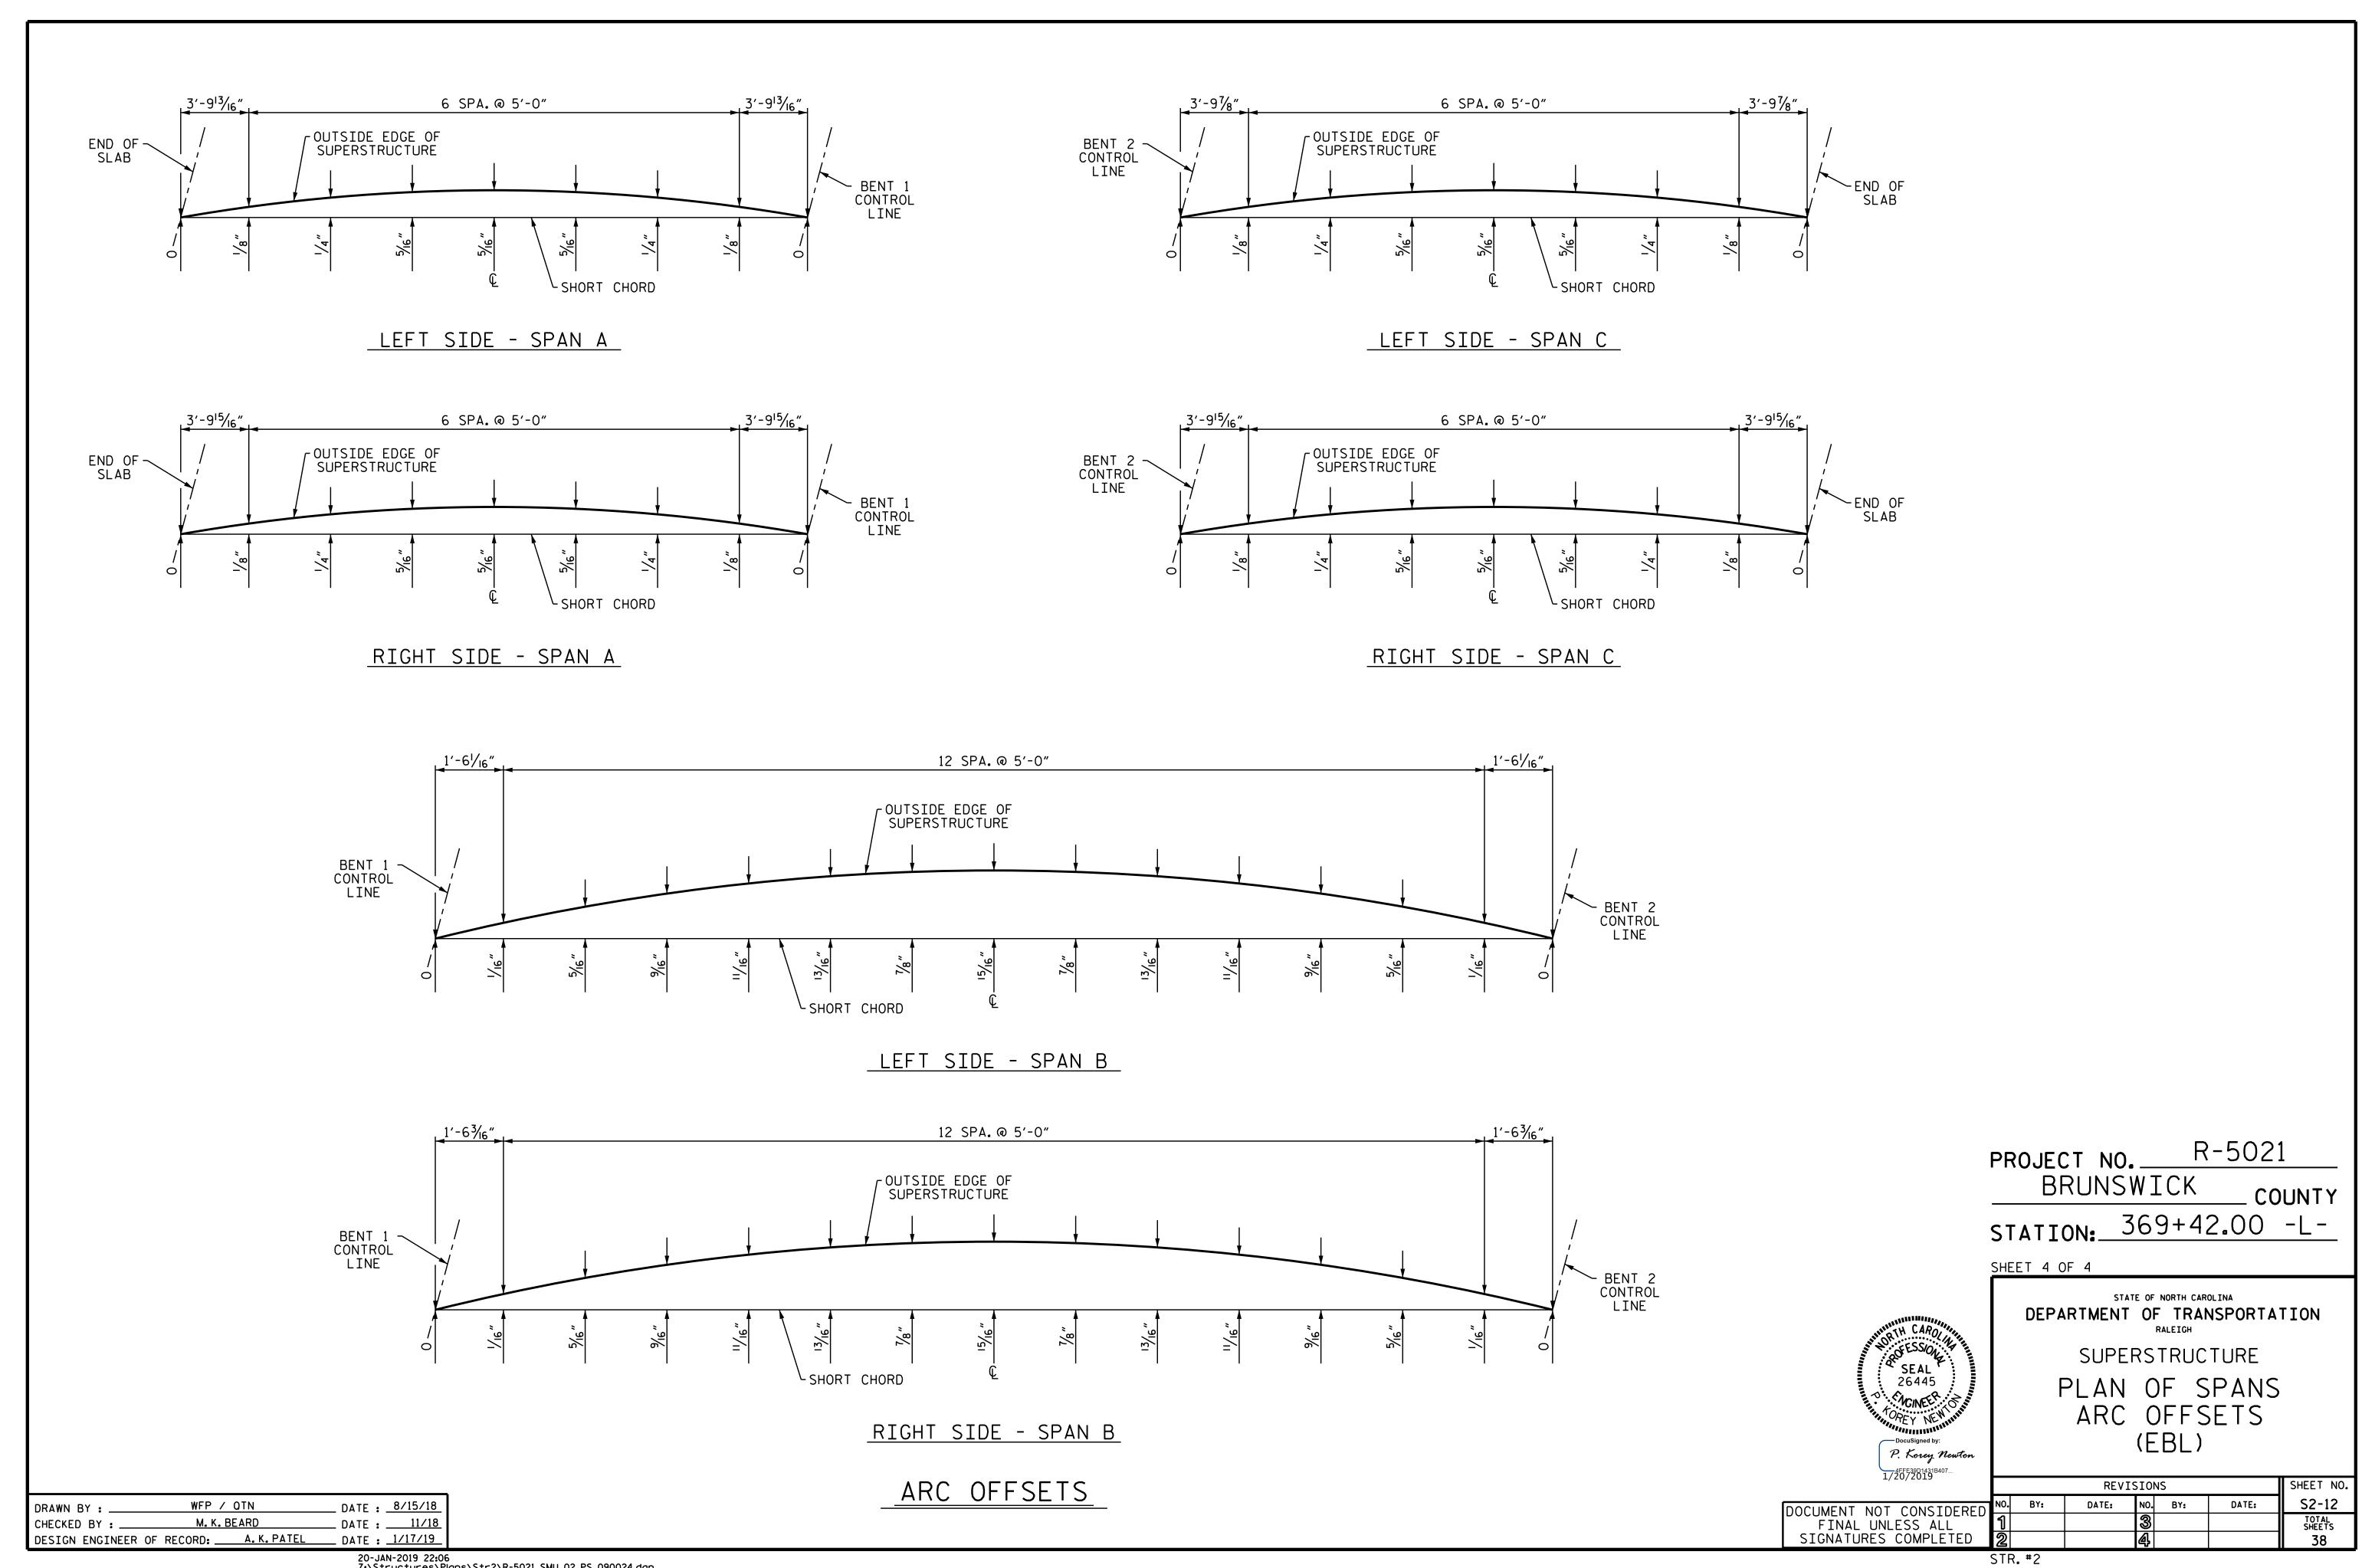

20-JAN-2019 22:06
Z:\Structures\Plans\Str2\R-5021_SMU_02_PS_090024.dgn
pknewton

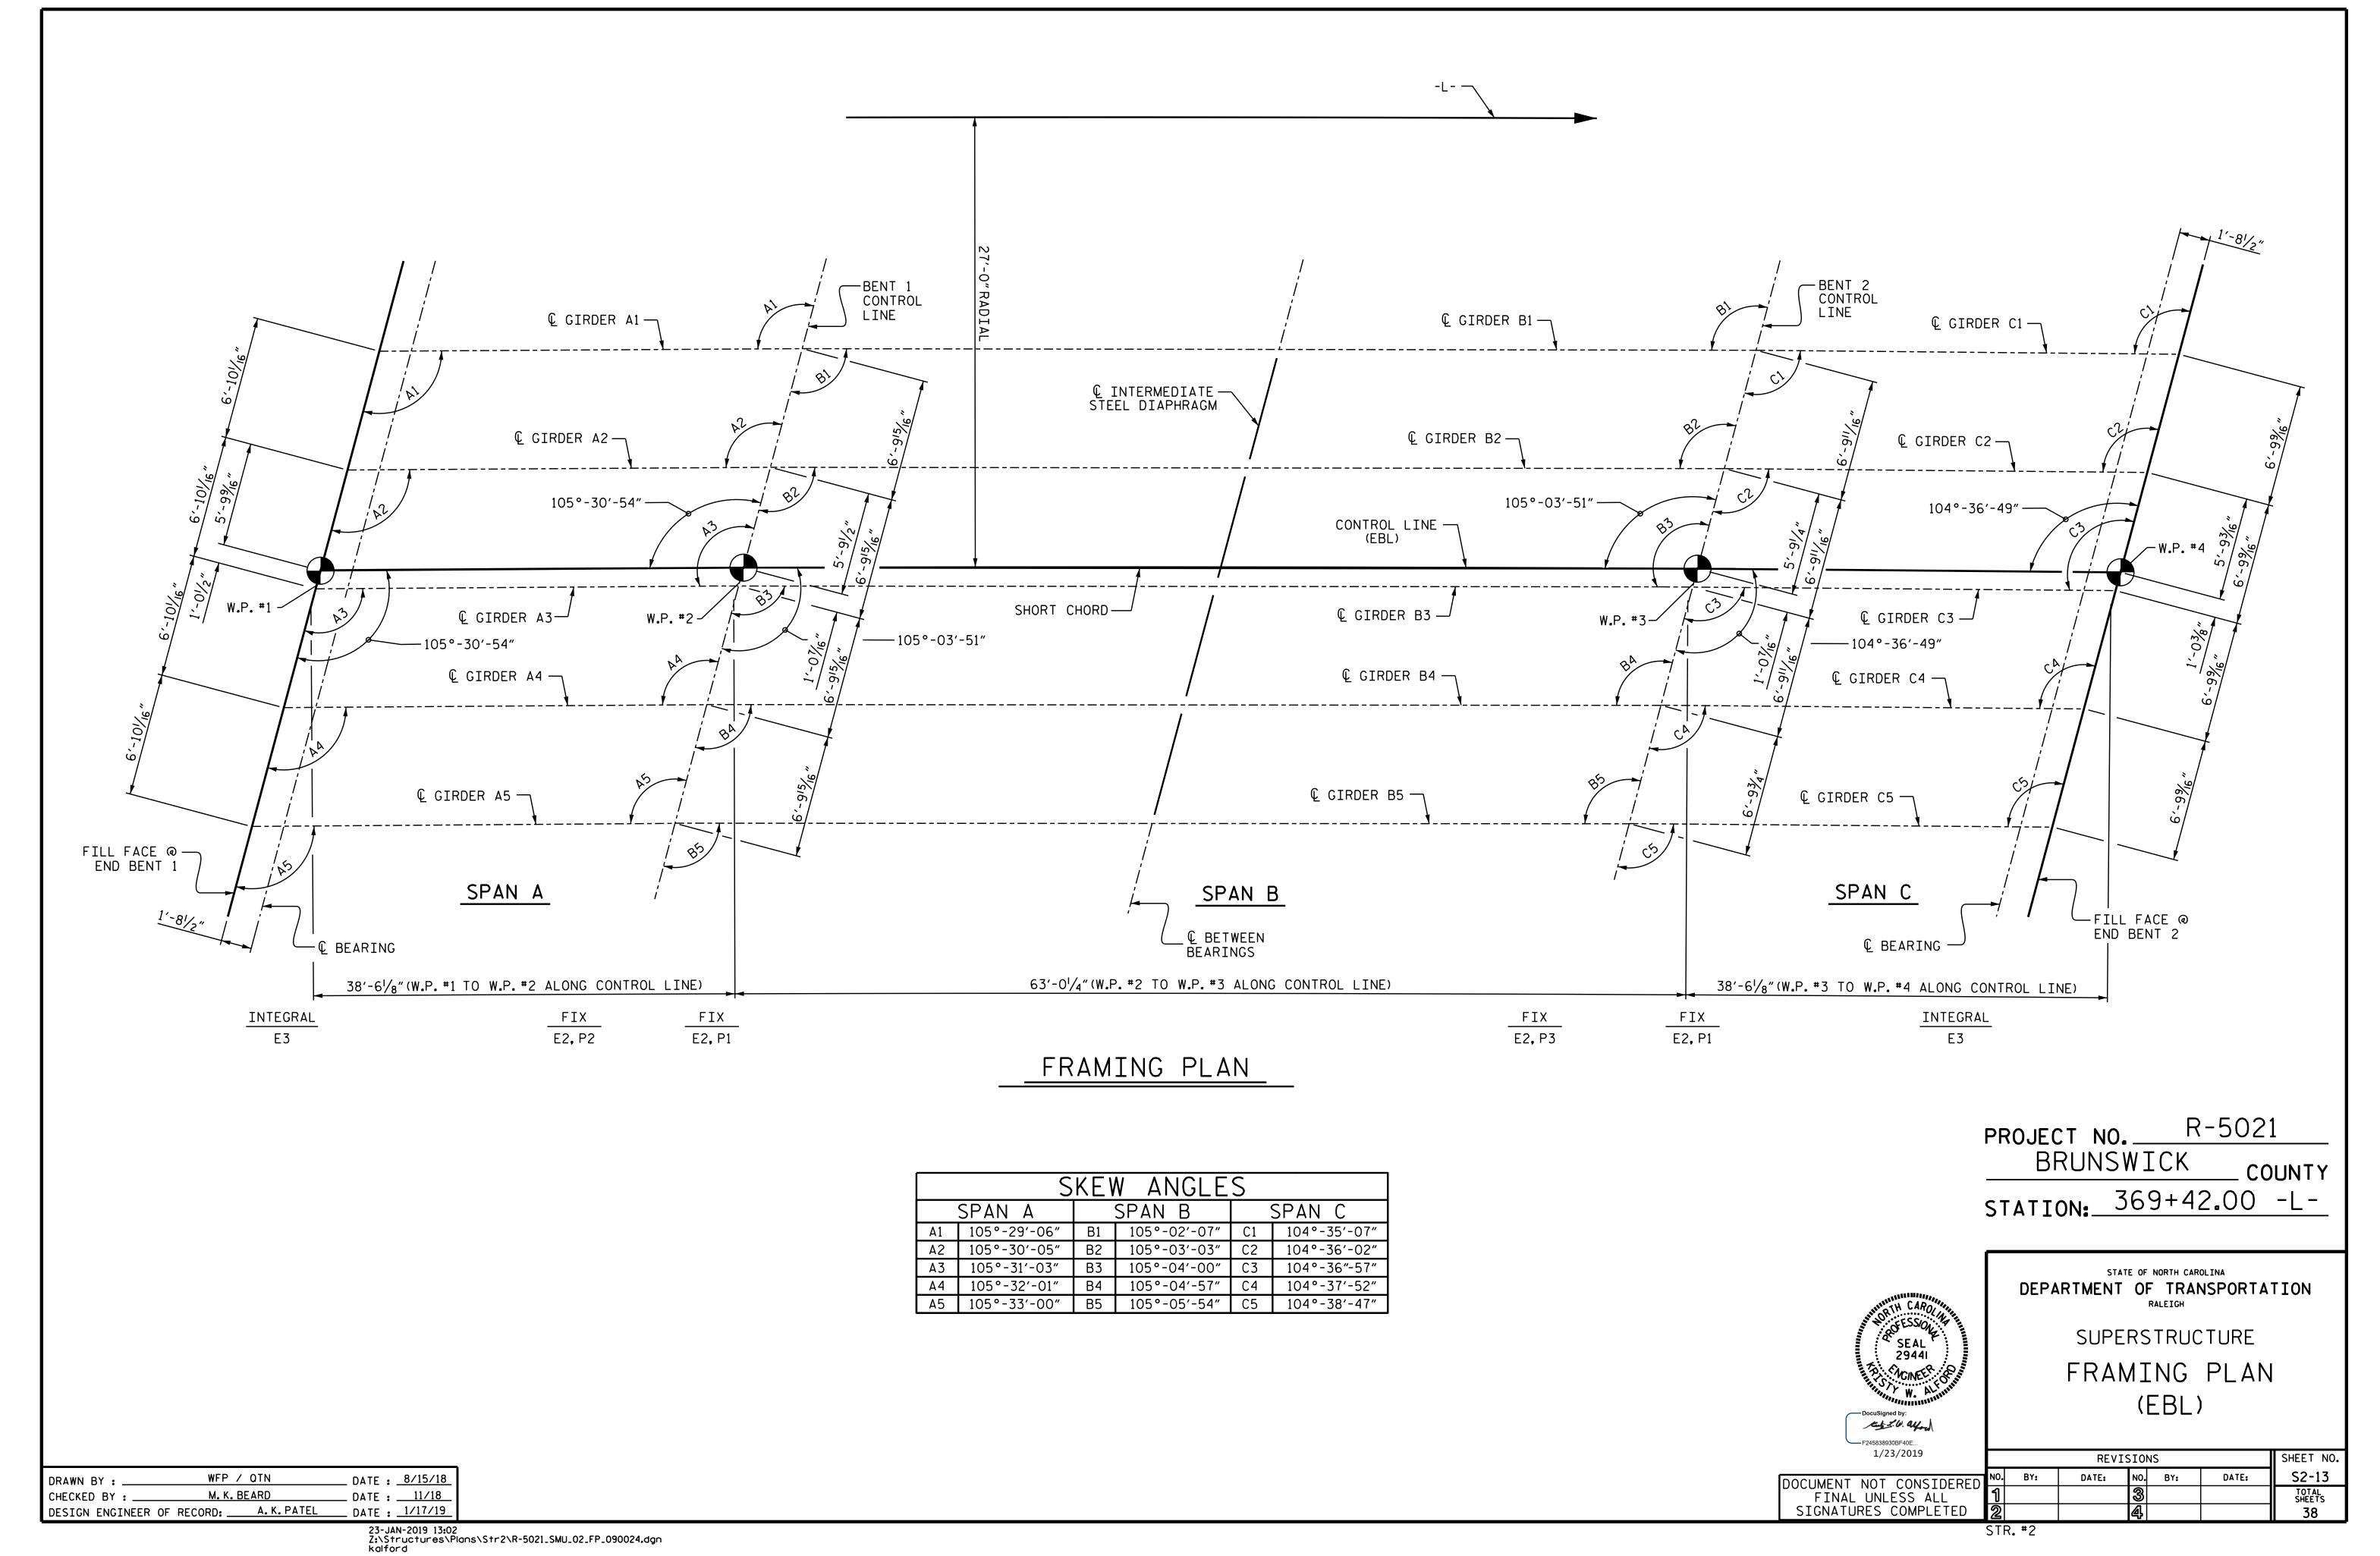

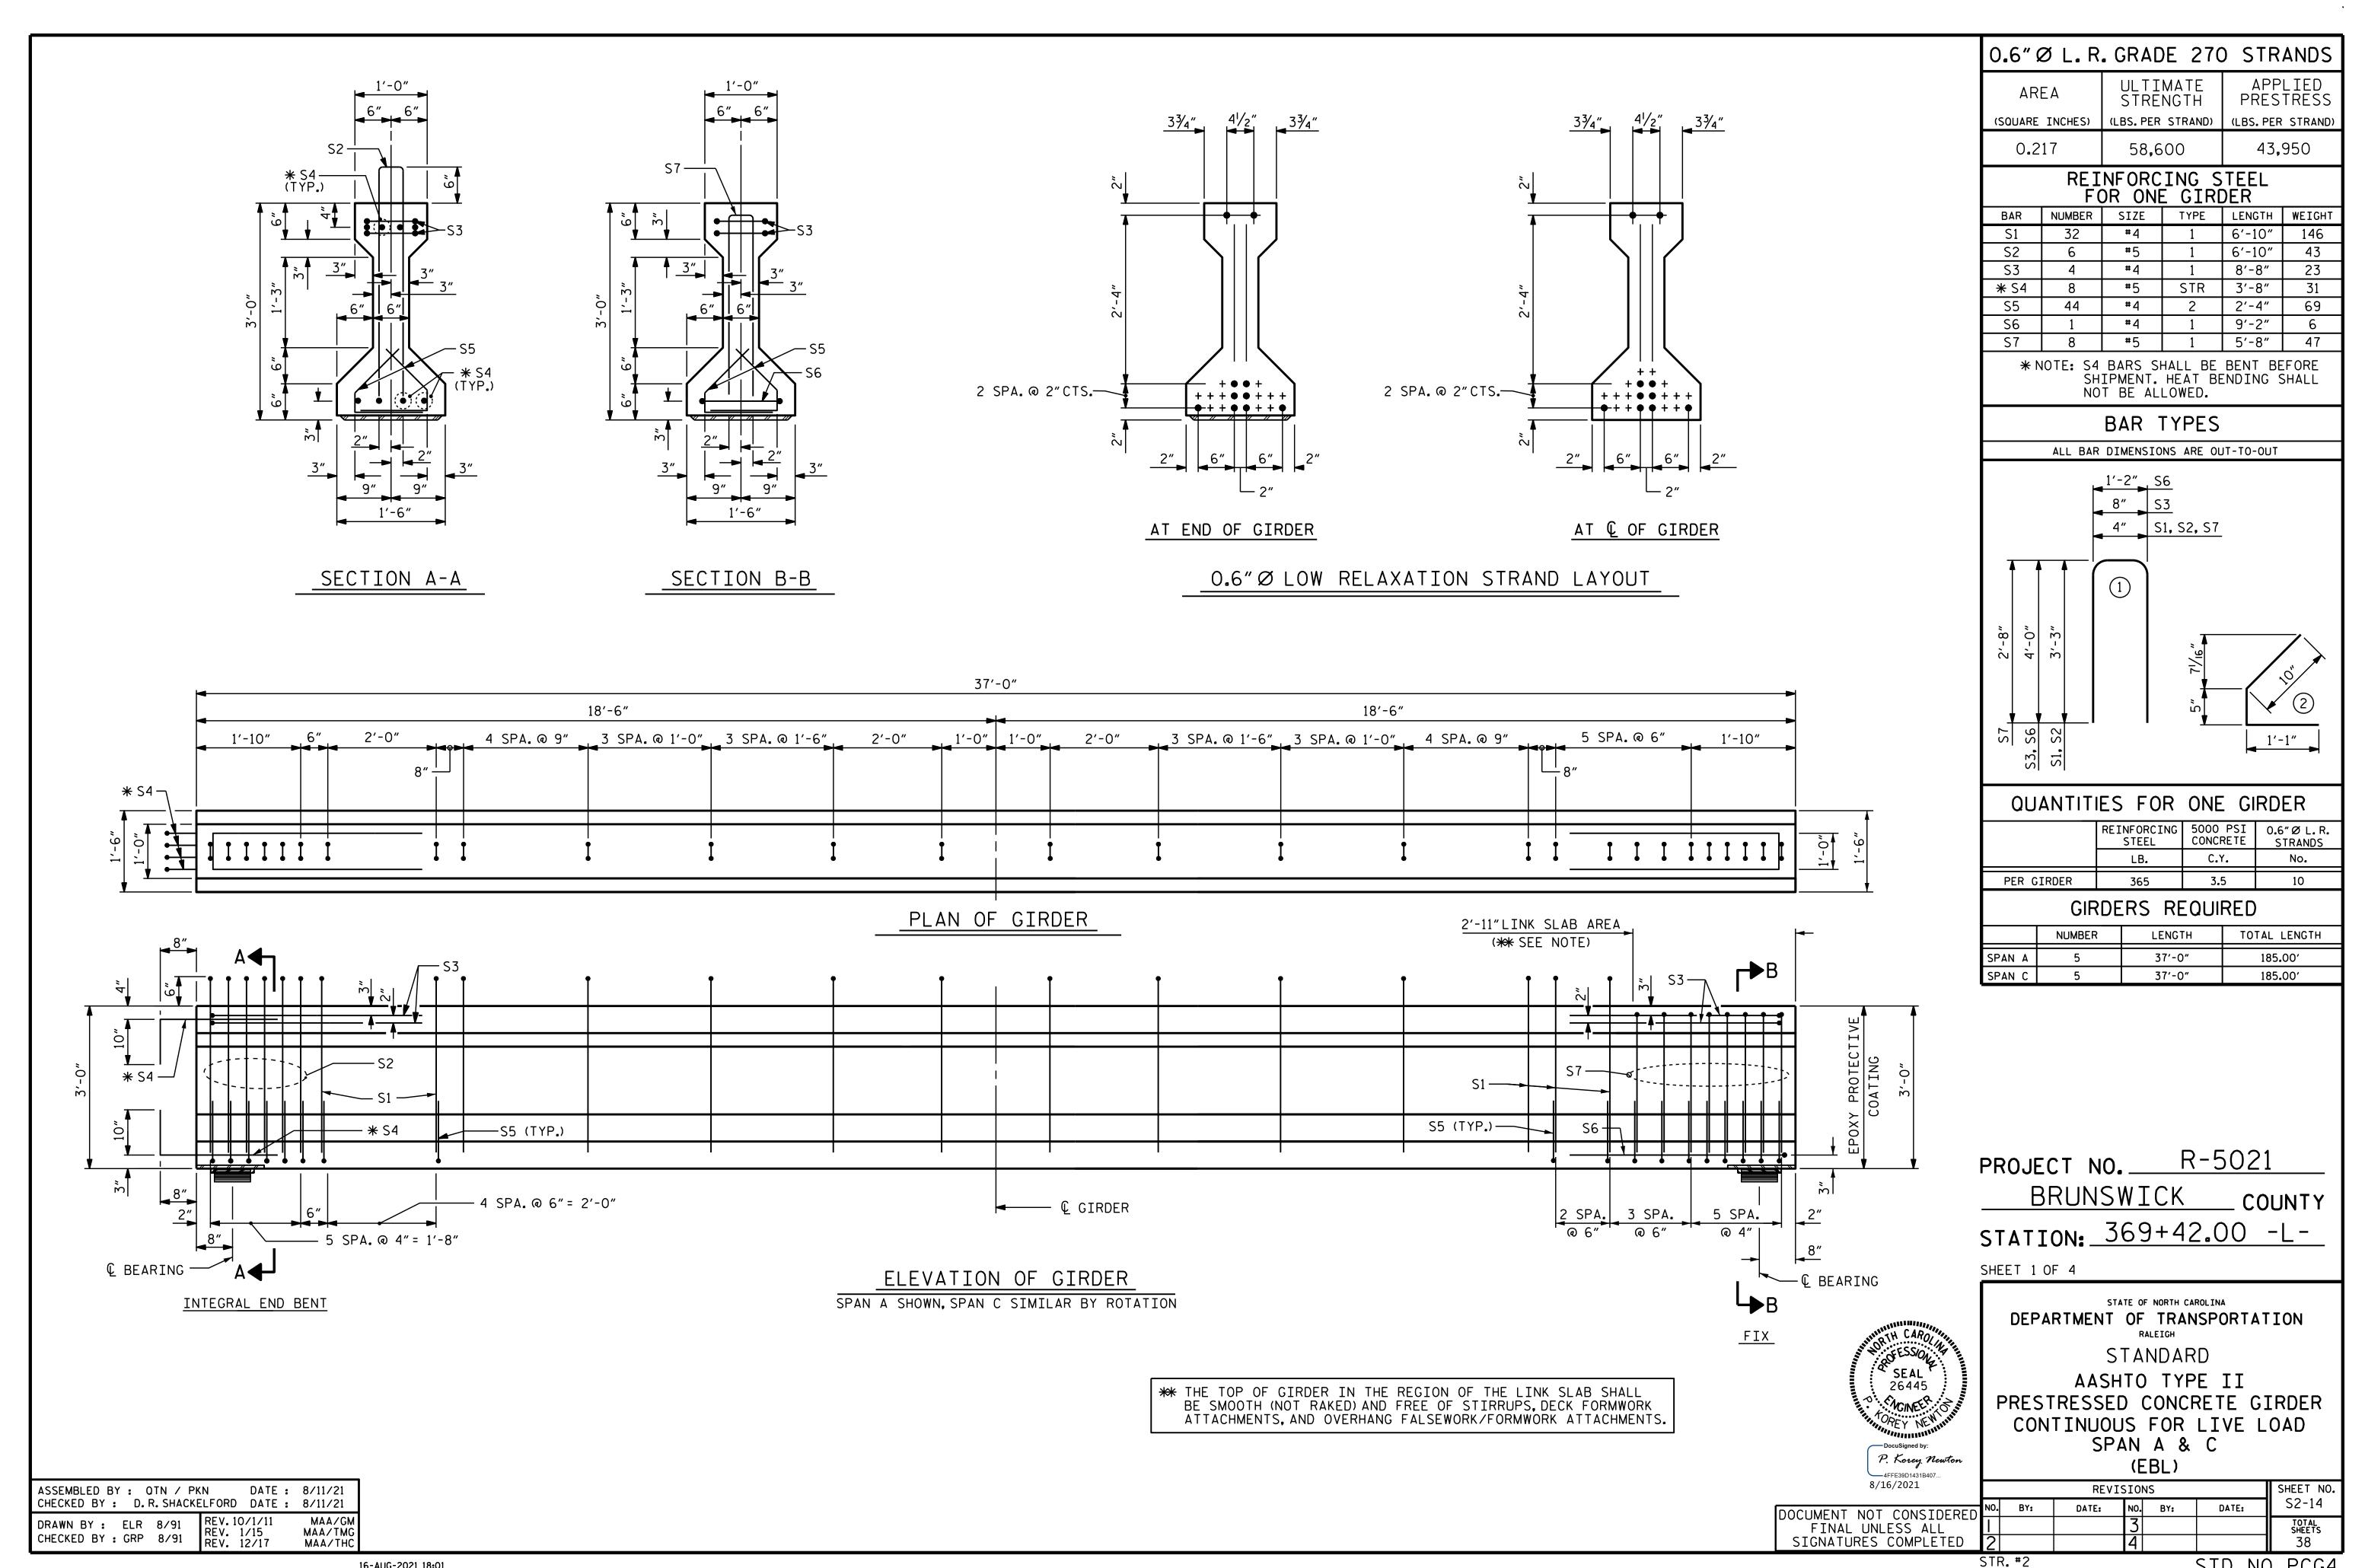

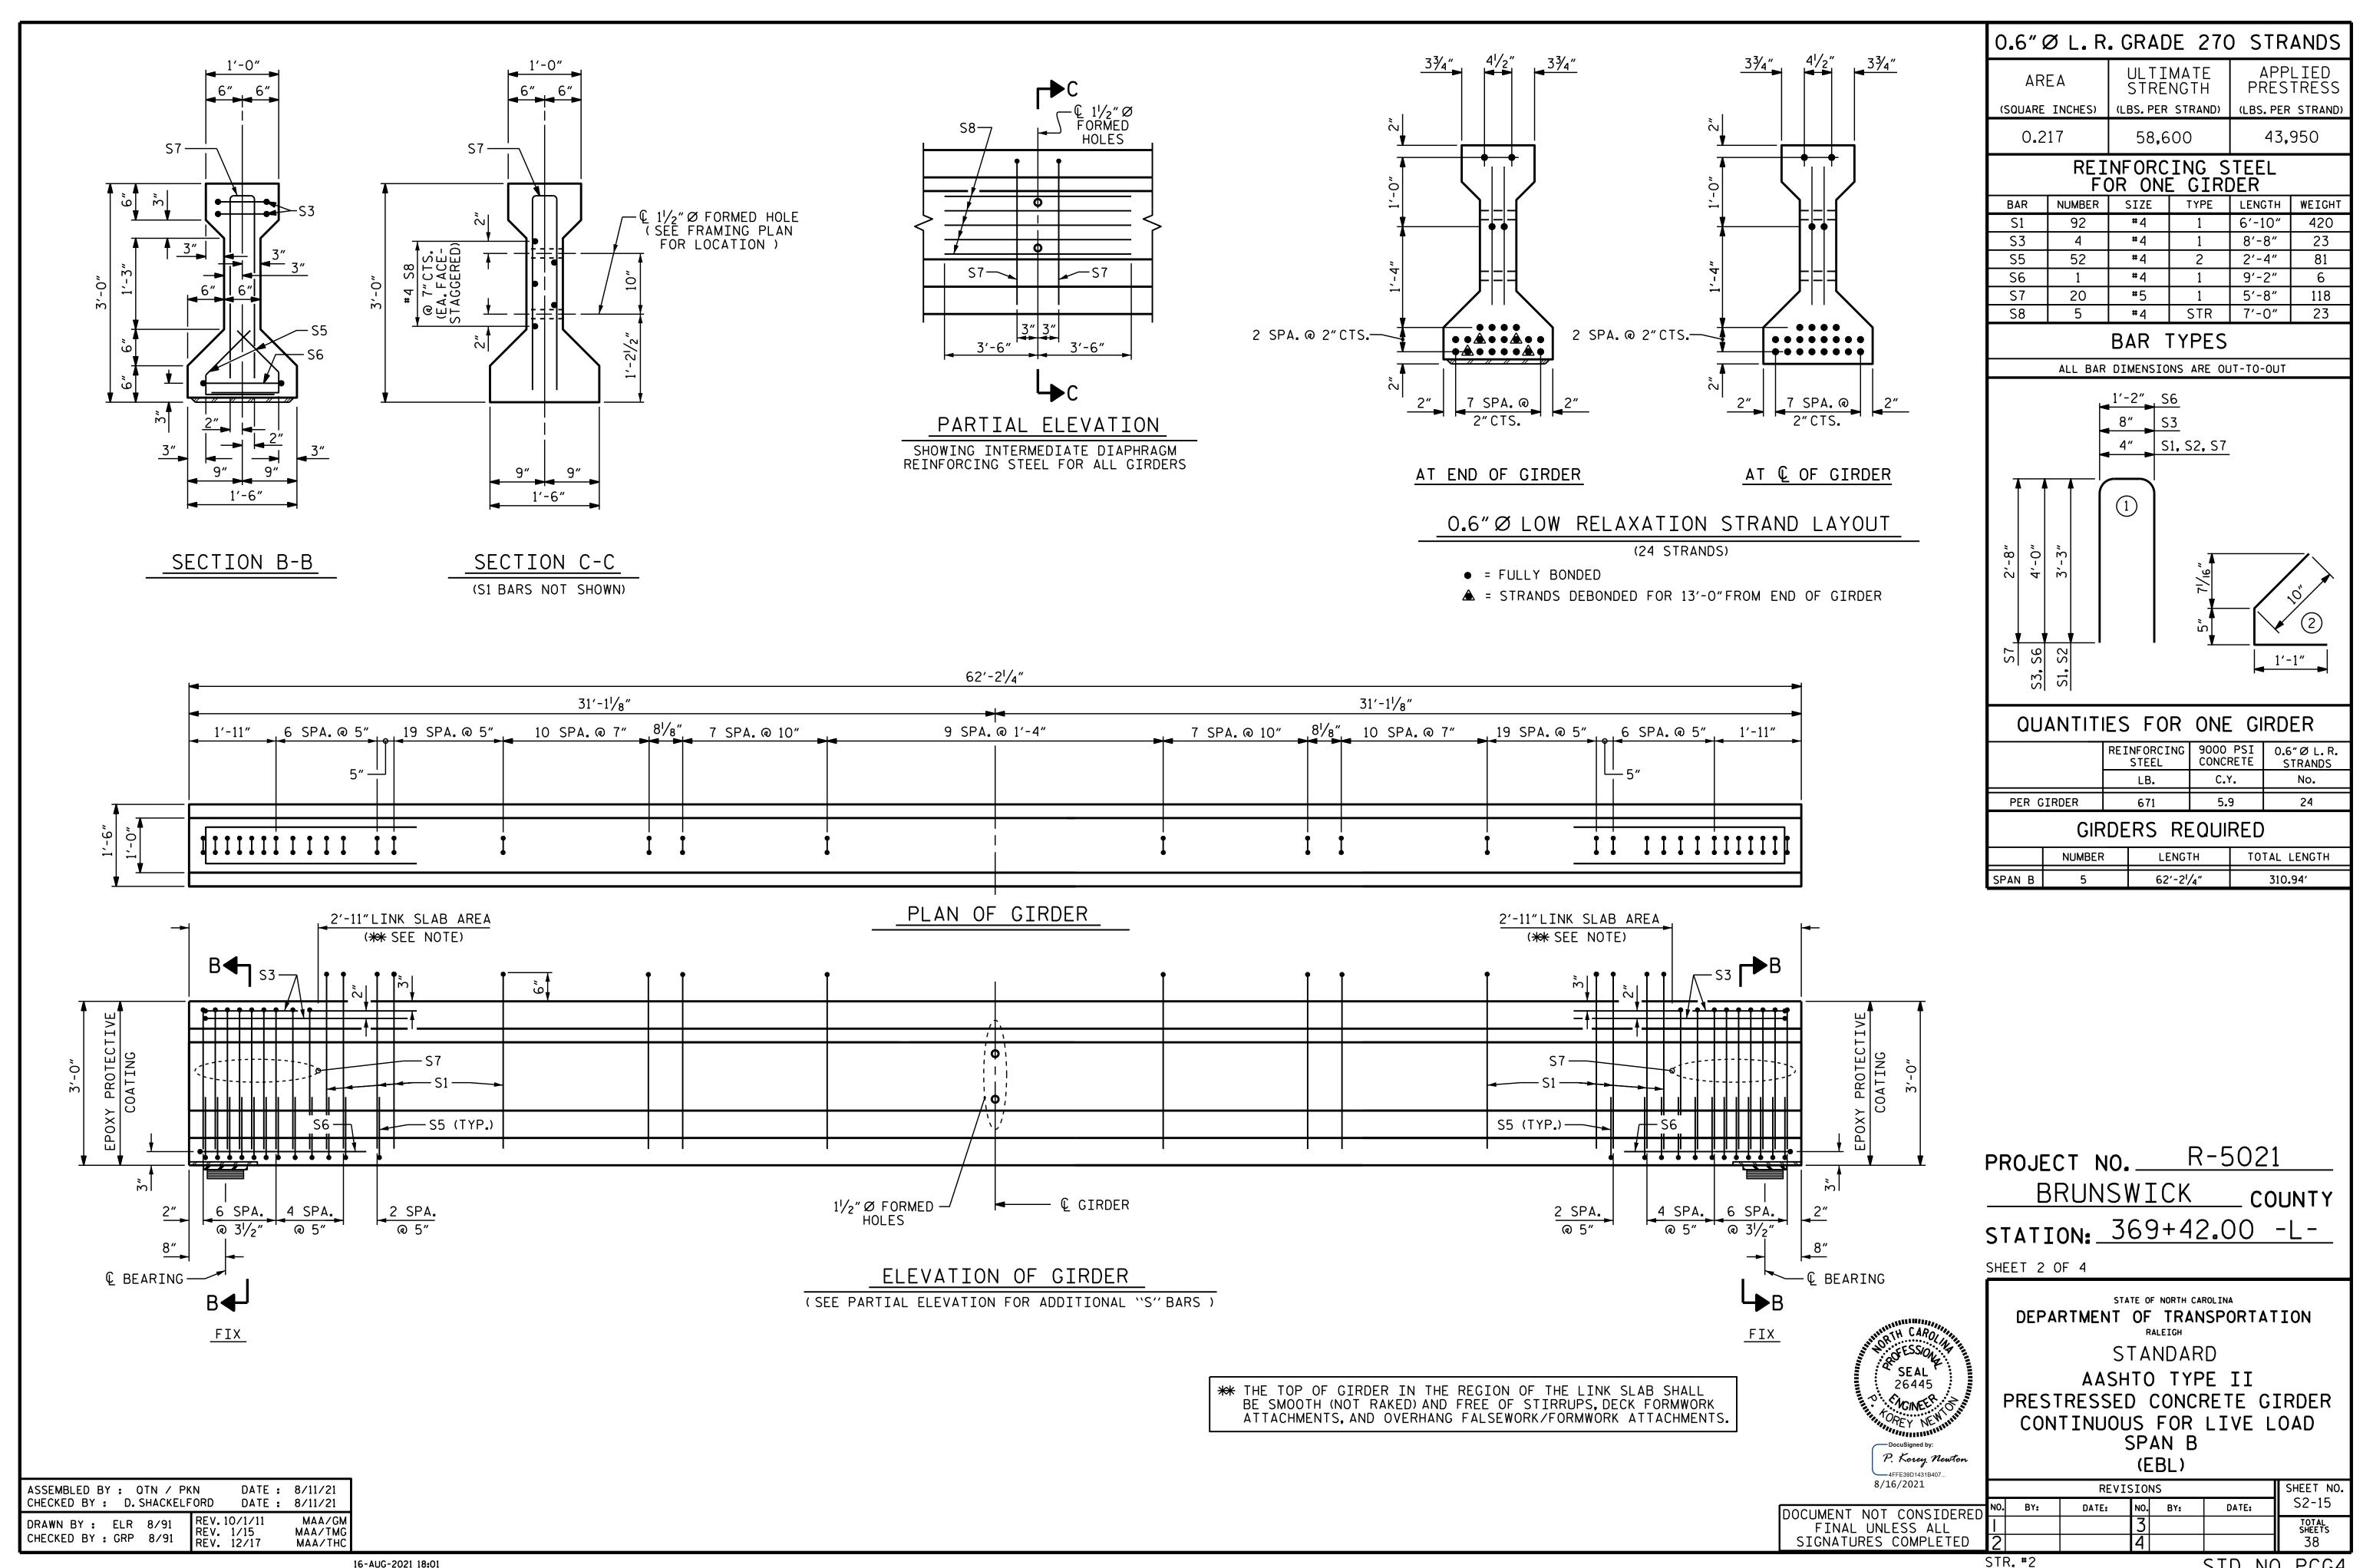

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL SHALL BE GRADE 60.

APPLY EPOXY PROTECTIVE COATING TO END OF GIRDER SURFACES INDICATED IN ELEVATION VIEW.

EMBEDDED PLATE "B-1" SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ANCHOR STUDS SHALL CONFORM TO AASHTO M169 GRADES 1010 THROUGH 1020 OR APPROVED EQUAL, AND SHALL MEET THE TYPE "B" REQUIREMENTS OF SUBSECTION 7.3 OF THE ANSI/AASHTO/AWS D1.5 BRIDGE WELDING CODE.

AT ENDS OF GIRDERS TO BE EMBEDDED IN CONCRETE DIAPHRAGMS OR END WALLS, PRESTRESSING STRANDS MAY EXTEND A MAXIMUM OF 2"BEYOND THE GIRDER ENDS. OTHERWISE, PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE GIRDER ENDS.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE GIRDER SHALL BE DONE WHEN CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 4000 PSI FOR SPANS A AND C, AND 7400 PSI FOR SPAN B.


THE TOP SURFACE OF THE GIRDER, EXCLUDING THE OUTSIDE 4", SHALL BE RAKED TO A DEPTH OF 1/4".

PRESTRESSED CONCRETE GIRDERS SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

PRESTRESSED CONCRETE GIRDERS ARE DESIGNED FOR O PSI TENSION IN THE PRECOMPRESSED TENSILE ZONE UNDER ALL LOADING CONDITIONS.

—————DEAD LOAD DEFLECTION TABLE FOR GIRDERS————											
	S	PANS	A & (`							
O.6"Ø LOW RELAXATION					GIRD	ERS 1	& 5				
TENTH POINTS	0	.1	. 2	. 3	. 4	. 5	. 6	.7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.010	0.019	0.026	0.031	0.033	0.031	0.026	0.019	0.010	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	0	0.004	0.008	0.010	0.012	0.013	0.012	0.010	0.008	0.004	0
FINAL CAMBER	0	1/16"	1/8"	3/16"	1/4"	1/4"	1/4"	3/16"	1/8"	1/16"	0
	S	PANS	A & (,							
0.6"Ø LOW RELAXATION					GIRD	ERS 2	- 4				
TENTH POINTS	0	.1	. 2	. 3	. 4	. 5	.6	.7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.010	0.019	0.026	0.031	0.033	0.031	0.026	0.019	0.010	0
* DEFLECTION DUE TO SUPERIMPOSED D.L. 🕴	0	0.004	0.007	0.010	0.012	0.012	0.012	0.010	0.007	0.004	0
FINAL CAMBER	0	1/16"	1/8"	3/16"	1/4"	1/4"	1/4"	³ / ₁₆ "	1/8"	1/16"	0
		SPAI	N B								
O.6"Ø LOW RELAXATION					GIRD	ERS 1	& 5				
TENTH POINTS	0	.1	. 2	. 3	.4	. 5	. 6	.7	.8	.9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.049	0.093	0.128	0.149	0.157	0.149	0.128	0.093	0.049	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	0	0.026	0.048	0.066	0.078	0.081	0.078	0.066	0.048	0.026	0
FINAL CAMBER	0	5/16"	9/16"	3/4"	7/8"	7∕ ₈ "	7/8"	3/4"	9/16"	5/16"	0
		SPAI	N B								
O.6"Ø LOW RELAXATION					GIRD	ERS 2	- 4				
TENTH POINTS	0	.1	. 2	.3	.4	. 5	.6	.7	.8	. 9	0
CAMBER (GIRDER ALONE IN PLACE)	0	0.049	0.093	0.128	0.149	0.157	0.149	0.128	0.093	0.049	0
* DEFLECTION DUE TO SUPERIMPOSED D.L.	0	0.025	0.048	0.065	0.076	0.080	0.076	0.065	0.048	0.025	0
FINAL CAMBER	0	5/16"	%6″	3/4"	7/8"	15/16"	7/8"	3/4"	%6"	5/16"	0

* INCLUDES FUTURE WEARING SURFACE
ALL VALUES ARE SHOWN IN FEET (DECIMAL FORM), EXCEPT "FINAL CAMBER", WHICH IS GIVEN IN INCHES (FRACTION FORM).

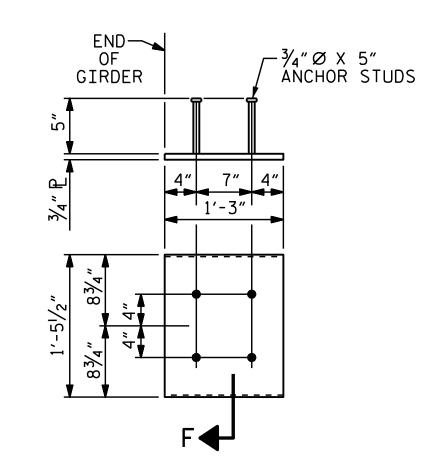

EMBEDDED PLATE "B-1" DETAILS FOR AASHTO TYPE II GIRDER (2 REQ'D PER GIRDER)

₩ 3/4" BEVEL EDGE

(SEE NOTES)

R-5021 PROJECT NO. ____ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 3 OF 4

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

STANDARD


PRESTRESSED CONCRETE GIRDER CONTINUOUS FOR LIVE LOAD DETAILS (EBL)

DOCUMEN FINA SIGNA

tate 2.0. aford


F245838930BF40E							
1/23/2019			REVI	SIONS	,		SHEET NO.
NT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S2-16
NAL UNLESS ALL	1			3			TOTAL SHEETS
ATURES COMPLETED	2			4			38


ASSEMBLED BY: WFP / QTN DATE: 8/14/18 CHECKED BY: M.K.BEARD DATE: 11/18 DRAWN BY: ELR 11/91 REV. 1/15 CHECKED BY: GRP 11/91 REV. 2/15 REV. 12/17 MAA/TMG MAA/TMG MAA/THC

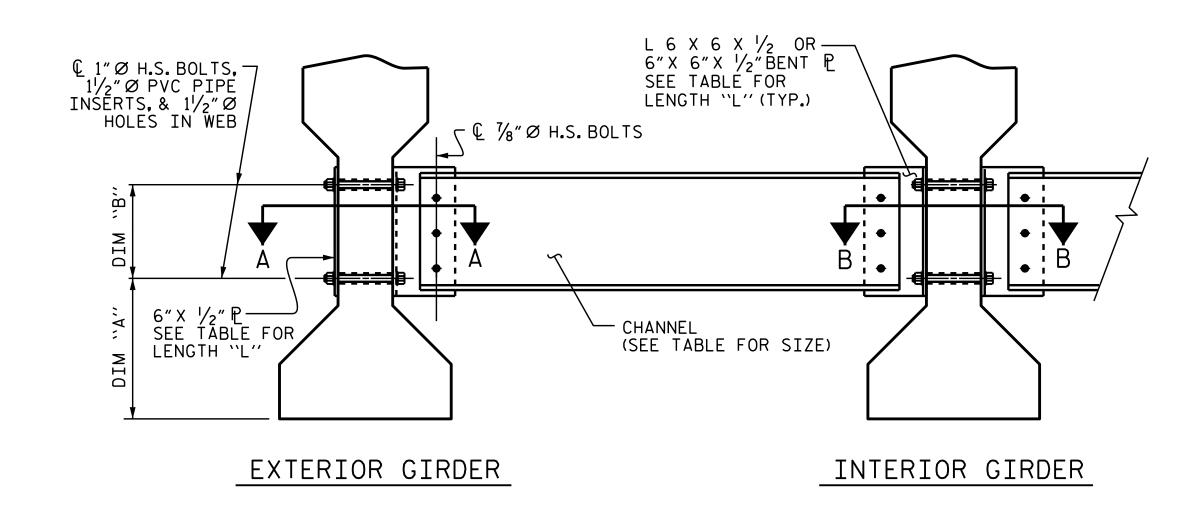

(TYPE II GIRDER SHOWN)

SECTION AT INTERMEDIATE DIAPHRAGM

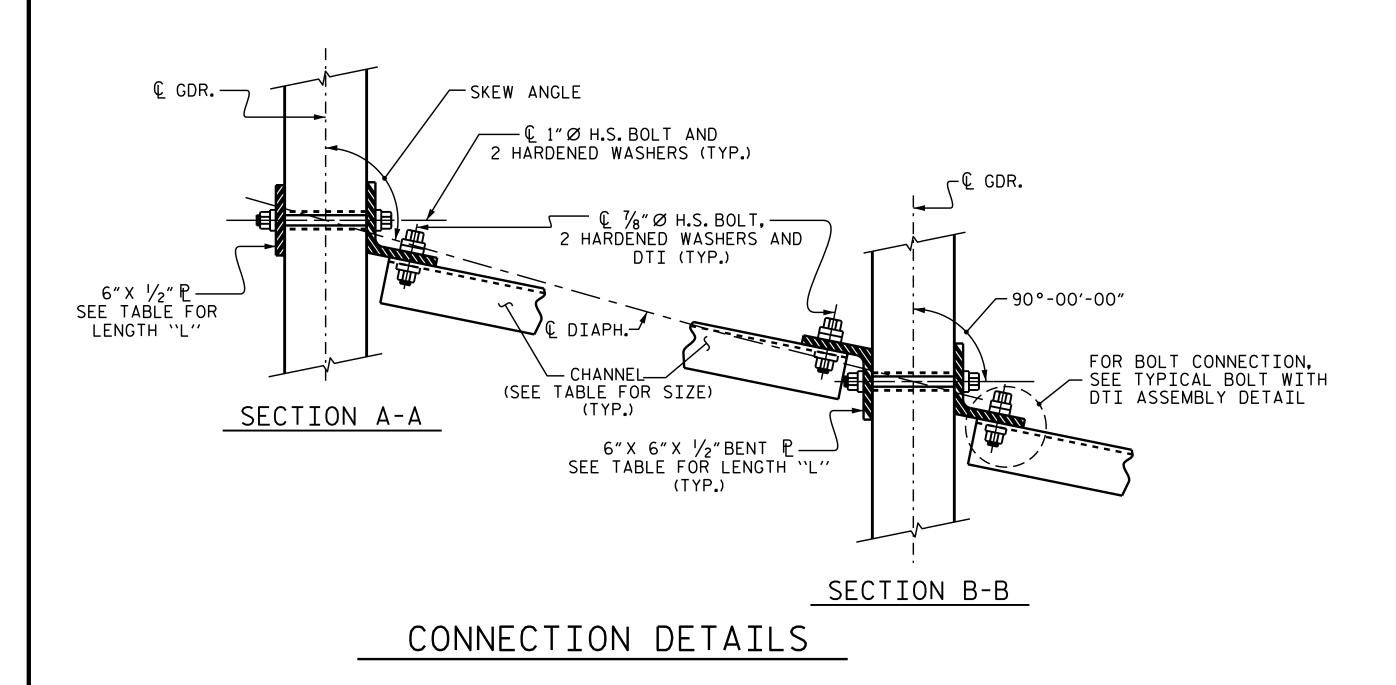

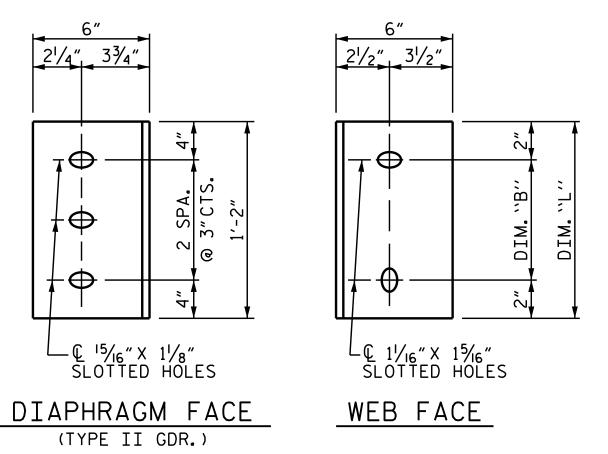

CONNECTOR PLATE DETAILS


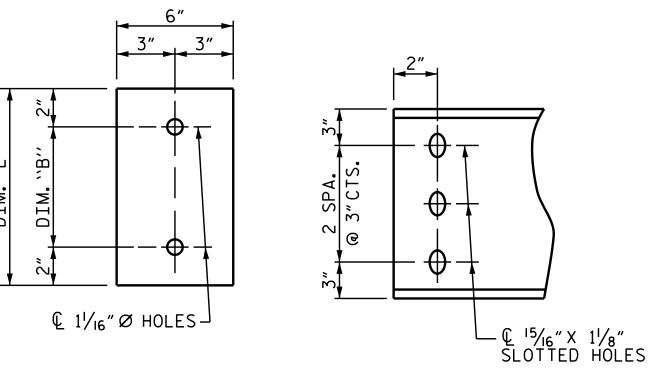


PLATE DETAILS

CHANNEL END (TYPE II GDR.)

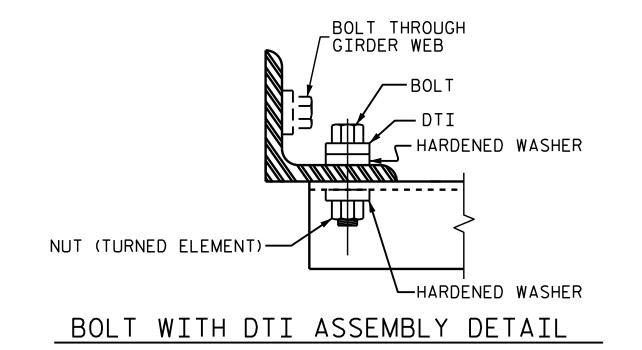

STRUCTURAL STEEL NOTES

ALL INTERMEDIATE DIAPHRAGM STEEL AND CONNECTOR PLATES SHALL BE AASHTO M270 GRADE 50 OR APPROVED EQUAL.

TENSION ON THE ASTM A325 BOLTS THROUGH THE CHANNEL MEMBER SHALL BE CALIBRATED USING DIRECT TENSION INDICATOR WASHERS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

TENSION ON THE ASTM A449 BOLTS THROUGH THE GIRDER WEB SHALL BE SNUG TIGHTENED FOLLOWED BY AN ADDITIONAL 1/4 TURN.

THE PLATES, BENT PLATES, CHANNELS, AND ANGLES SHALL BE METALLIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. FOR THERMAL SPRAYED COATINGS (METALLIZATION), SEE SPECIAL PROVISIONS.

FOR METALLIZATION, APPLY AN 8 MIL THICK 99.99 PERCENT PERCENT 1350 ALUMINUM (W-A1-1350) THERMAL SPRAYED COATING WITH A 0.5 MIL THICK SEAL COAT TO ALL PLATES, BENT PLATES, CHANNELS, ANGLES, AND PLATE WASHERS IN ACCORDANCE WITH THE THERMAL SPRAYED COATINGS SPECIAL PROVISION AND SECTION 442 OF THE STANDARD SPECIFICATIONS.

GALVANIZE THE HIGH STRENGTH BOLTS, NUTS, WASHERS AND DIRECT TENSION INDICATORS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

USE AN ASTM F436 HARDENED WASHER WITH STANDARD AND SLOTTED HOLES UNDER EACH BOLT HEAD AND NUT.

FOR BOLTS THROUGH THE GIRDER WEB, PROVIDE SUFFICIENT LENGTH OF THREADS ON ALL BOLTS TO ACCOMMODATE WASHERS AND THE THICKNESS OF CONNECTING MEMBER PLUS AT LEAST 1/4" PROJECTION BEYOND THE NUT.

INTERMEDIATE DIAPHRAGM ASSEMBLY SHALL COMPLY WITH SECTION 1072 OF THE STANDARD SPECIFICATIONS.

SUBMIT TWO SETS OF WORKING DRAWINGS FOR THE INTERMEDIATE DIAPHRAGM ASSEMBLY FOR REVIEW, COMMENTS AND ACCEPTANCE. AFTER REVIEW, COMMENTS, AND ACCEPTANCE, SUBMIT SEVEN SETS FOR DISTRIBUTION.

IN THE EXTERIOR BAYS, PLACE TEMPORARY STRUTS BETWEEN PRESTRESSED GIRDERS ADJACENT TO THE STEEL DIAPHRAGMS. STRUTS SHALL REMAIN IN PLACE 3 DAYS AFTER CONCRETE IS PLACED.


THE COST OF THE STEEL DIAPHRAGMS AND ASSEMBLIES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE GIRDERS.

TABLE

GIRDER TYPE	CHANNEL SIZE	DIM "A"	DIM "B"	DIM "L"	
II	MC 12 × 31	1'-21/2"	10"	1′-2″	

R-5021 PROJECT NO. BRUNSWICK COUNTY STATION: 369+42.00 -L-

SHEET 4 OF 4



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD INTERMEDIATE CONCRETE GIRDERS

(EBL) 1/20/2019 SHEET NO REVISIONS DATE:

STR. #2

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

S2-17

ASSEMBLED BY: WFP / QTN

CHECKED BY : M. K. BEARD

DRAWN BY: TLA 6/05

CHECKED BY : VC 6/05

DATE: 8/14/18


DATE: II/I8

KMM/GN


MAA/GW MAA/THO

REV. 5/I/06RRR

REV. 10/1/11 REV. 12/17

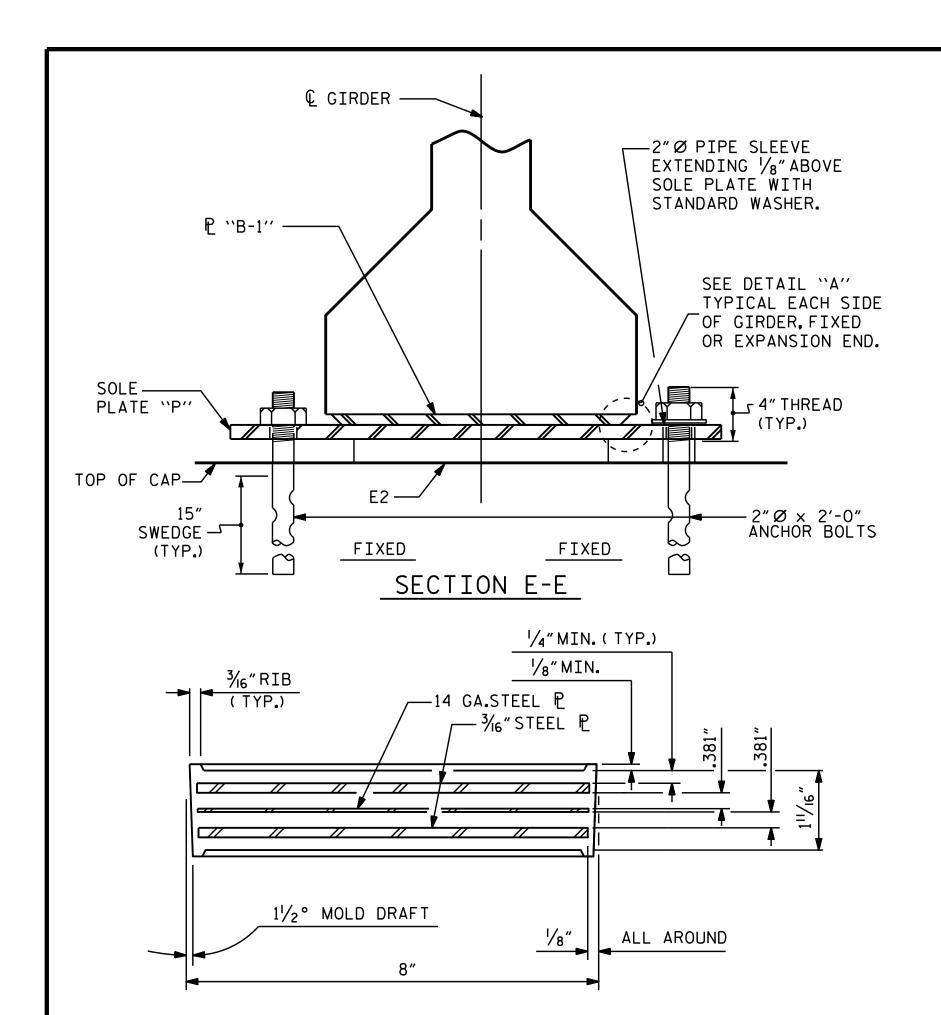

TYPICAL SECTION OF ELASTOMERIC BEARINGS

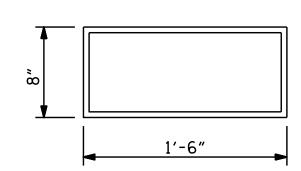

E2 (20 REQ'D)

PLAN VIEW OF ELASTOMERIC BEARING

TYPE III


DETAIL "A"


DATE : 8/14/18
DATE : 11/18


AAC/MAA MAA/TMG MAA/THC

ASSEMBLED BY: WFP / OTN CHECKED BY: M.K.BEARD


DRAWN BY: WJH 8/89 CHECKED BY : CRK 8/89

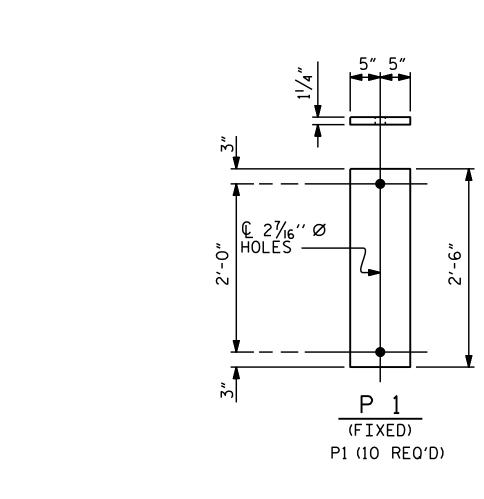

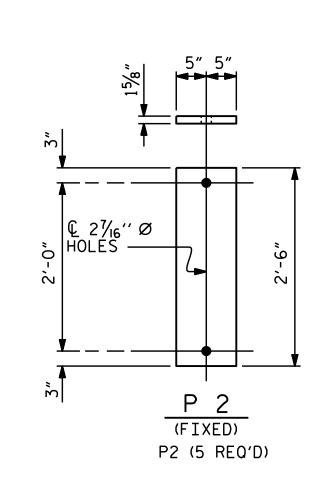


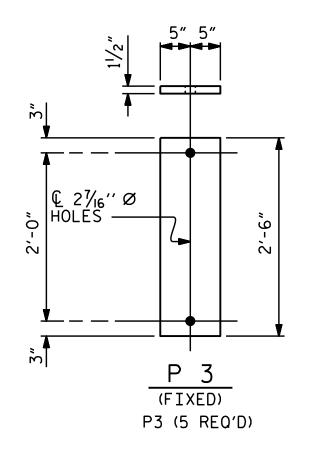


SOLE PLATE DETAILS ("P")

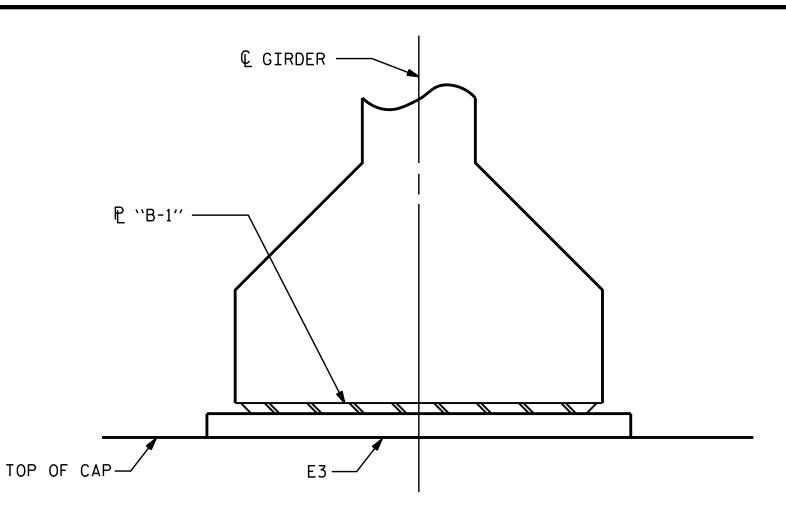

SECTION F-F

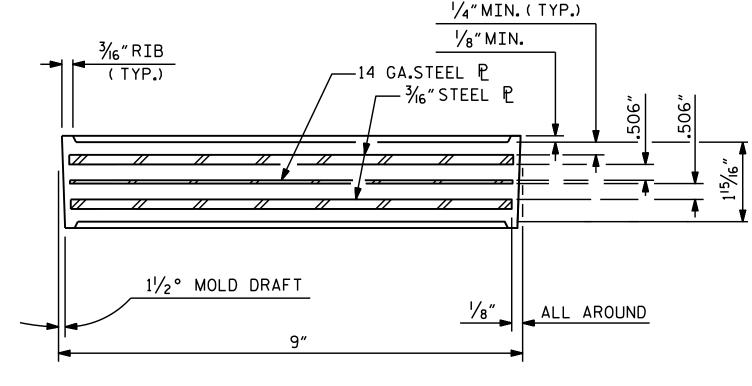


TYPICAL SECTION OF ELASTOMERIC BEARINGS

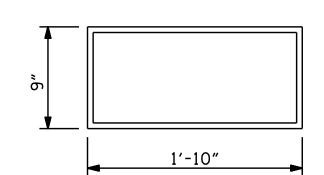


E3 (<u>10</u> REQ'D)

PLAN VIEW OF ELASTOMERIC BEARING

TYPE IV (FOR INTEGRAL END BENTS ONLY)

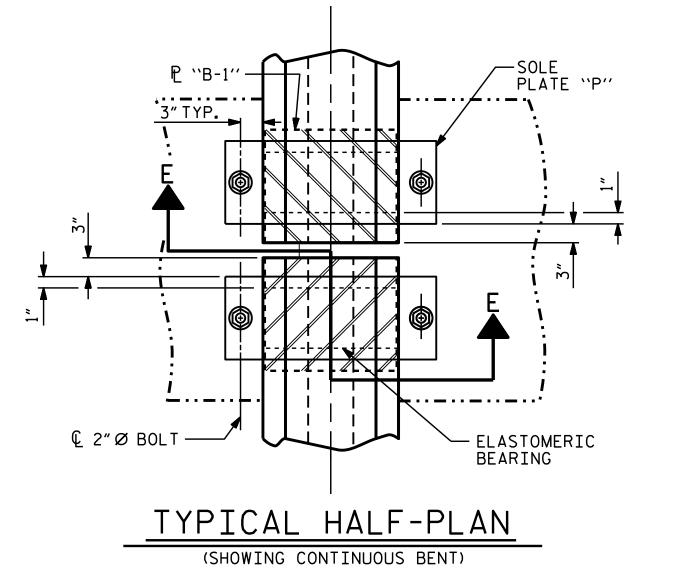

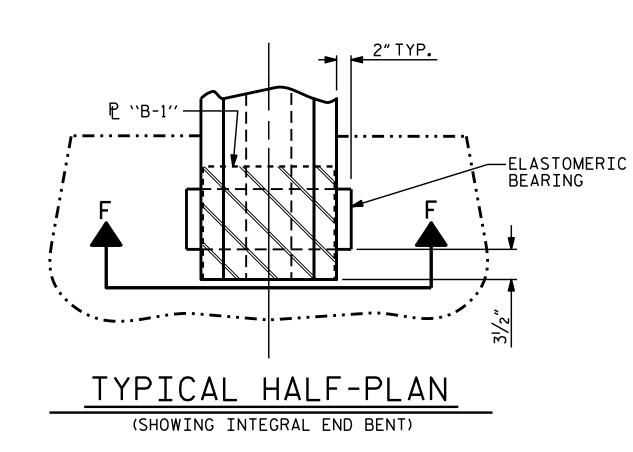

<u> </u>							
MAXIMUM ALLOWABLE SERVICE LOADS							
D.L.+L.L. (N	O IMPACT)						
TYPE III	205 k						
TYPE TV	225 6						

NOTES

AT ALL FIXED POINTS OF SUPPORT, NUTS FOR ANCHOR BOLTS ARE TO BE TIGHTENED FINGER TIGHT AND THEN BACKED OFF 1/2 TURN. THE THREAD OF THE NUT AND BOLT SHALL THEN BE BURRED WITH A SHARP POINTED TOOL.

THE 2"Ø PIPE SLEEVE SHALL BE CUT FROM SCHEDULE 40 PVC PLASTIC PIPE. THE PVC PLASTIC PIPE SHALL MEET THE REQUIREMENTS OF ASTM D1785.

STEEL SOLE PLATES, ANCHOR BOLTS, NUTS, AND WASHERS SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

PRIOR TO WELDING, GRIND THE GALVANIZED SURFACE OF THE PORTION OF THE EMBEDDED PLATE AND SOLE PLATE THAT ARE TO BE WELDED. AFTER WELDING, DAMAGED GALVANIZED SURFACES SHALL BE REPAIRED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

WHEN WELDING THE SOLE PLATE TO THE EMBEDDED PLATE IN THE GIRDER, USE TEMPERATURE INDICATING WAX PENS, OR OTHER SUITABLE MEANS, TO ENSURE THAT THE TEMPERATURE OF THE SOLE PLATE DOES NOT EXCEED 300°F. TEMPERATURES ABOVE THIS MAY DAMAGE THE ELASTOMER.

SOLE PLATE "P", BOLTS, NUTS, WASHERS, AND PIPE SLEEVE SHALL BE INCLUDED IN THE PAY ITEM FOR PRESTRESSED CONCRETE GIRDERS.

ANCHOR BOLTS SHALL MEET THE REQUIREMENTS OF ASTM A449. NUTS SHALL MEET THE REQUIREMENTS OF AASHTO M291-DH OR AASHTO M292-2H. WASHERS SHALL MEET THE REQUIREMENTS OF AASHTO M293. SHOP DRAWINGS ARE NOT REQUIRED FOR ANCHOR BOLT, NUTS AND WASHERS. SHOP INSPECTION IS REQUIRED.


ALL SURFACES OF BEARING PLATES SHALL BE SMOOTH AND STRAIGHT.

THE ELASTOMER IN THE STEEL REINFORCED BEARINGS SHALL HAVE A SHEAR MODULUS OF 0.160 KSI, IN ACCORDANCE WITH AASHTO M251.

FOR STEEL REINFORCED ELASTOMERIC BEARINGS, SEE SPECIAL PROVISIONS.

ALL SOLE PLATES SHALL BE AASHTO M270 GRADE 36.

TYPE IV 225 k PROJECT NO._



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

STATION: 369+42.00 -L-

BRUNSWICK

R-5021

COUNTY

STANDARD

ELASTOMERIC BEARING DETAILS —


PRESTRESSED CONCRETE GIRDER SUPERSTRUCTURE (EBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

STR.#2

1/20/2019

REVISIONS SHEET NO S2-18

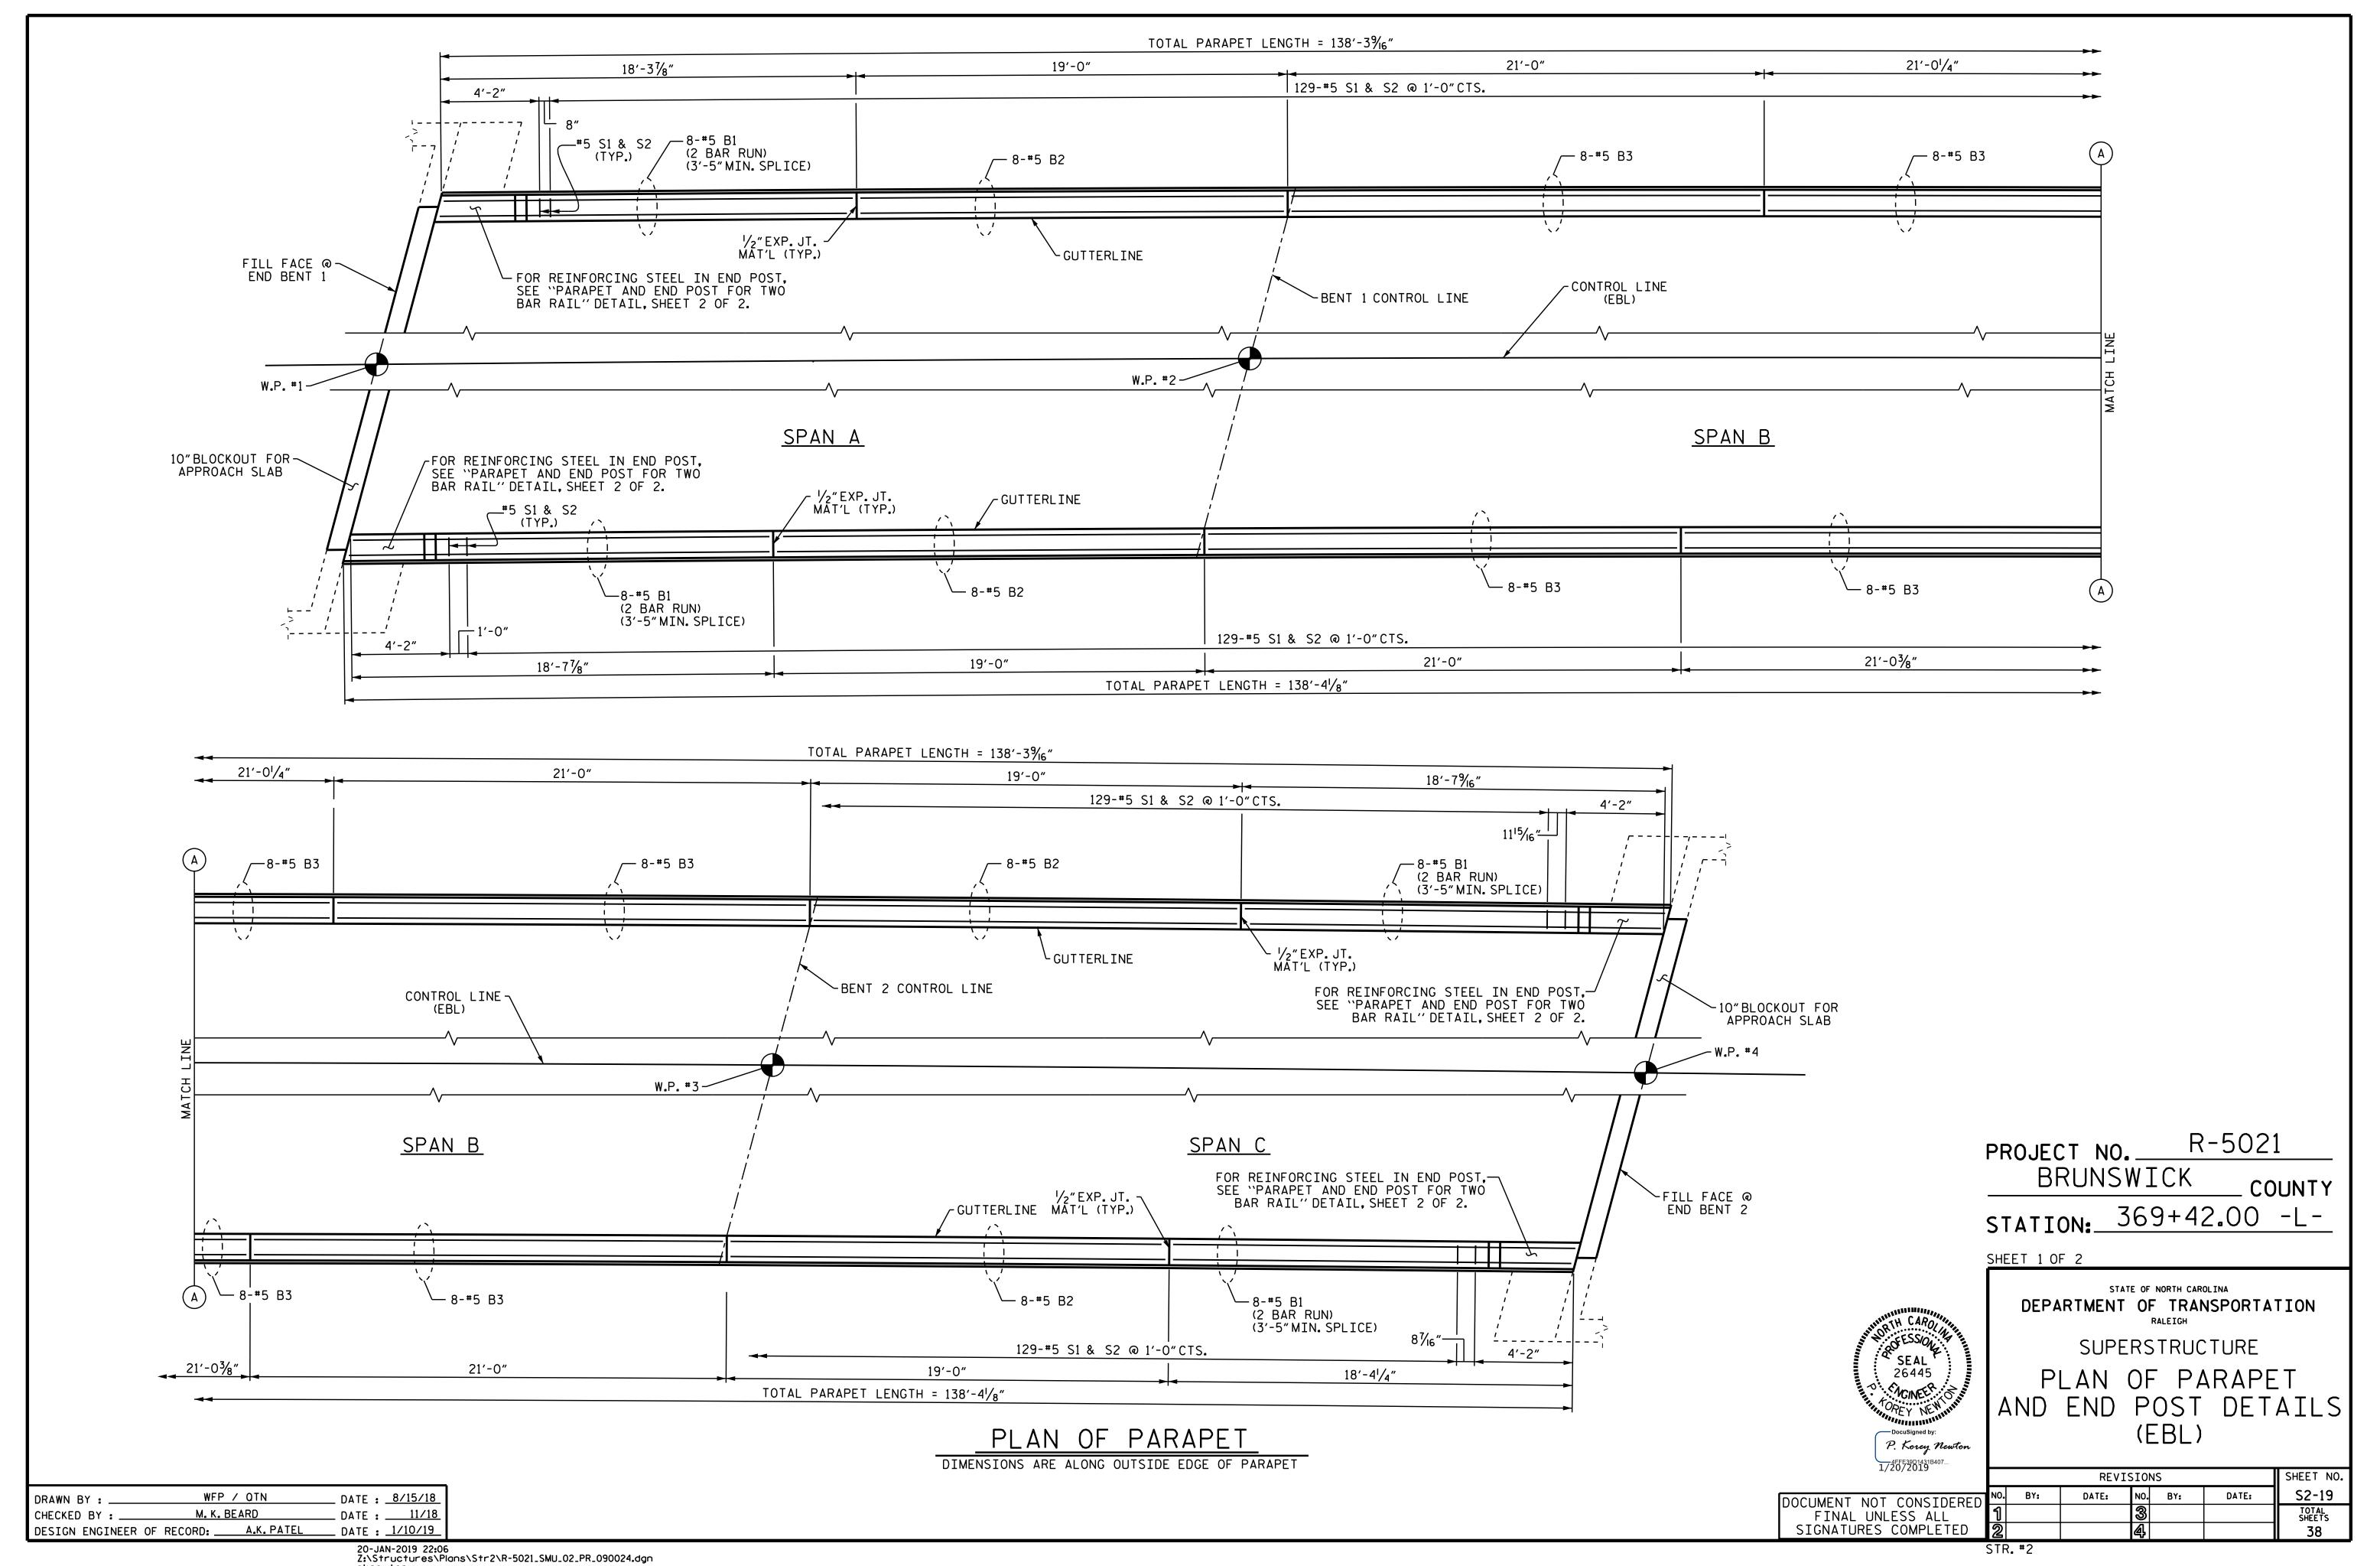

THE PARAPET FOR ANY SPAN SHALL NOT BE CAST UNTIL ALL SLAB CONCRETE IN THE SPAN HAS REACHED A MINIMUM COMPRESIVE STRENGTH OF 3000 PSI.


ALL REINFORCING STEEL IN PARAPETS AND END POSTS SHALL BE EPOXY COATED.


THE #5 S1 BARS MAY BE SHIFTED SLIGHTLY IN ORDER TO MAINTAIN A 2" MINIMUM CLEARANCE TO THE $\frac{1}{2}$ EXPANSION JOINT MATERIAL IN THE PARAPET.

FOR DETAILS OF CONCRETE INSERTS IN END POSTS. SEE "RAIL POST SPACINGS AND END OF RAIL DETAILS" SHEET.

FOR DETAILS OF GUARDRAIL ANCHOR ASSEMBLIES, SEE "GUARDRAIL ANCHORAGE FOR METAL RAILS" SHEET.


GROOVED CONTRACTION JOINTS, 1/2" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE PARAPET AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. A CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN PARAPET EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF PARAPET SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.

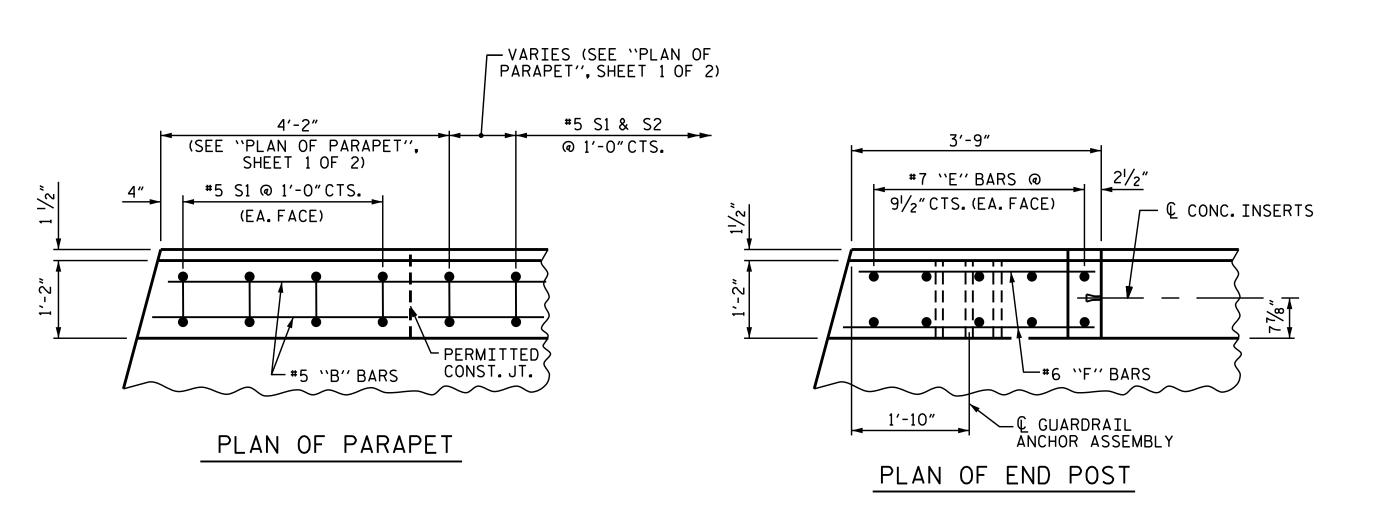


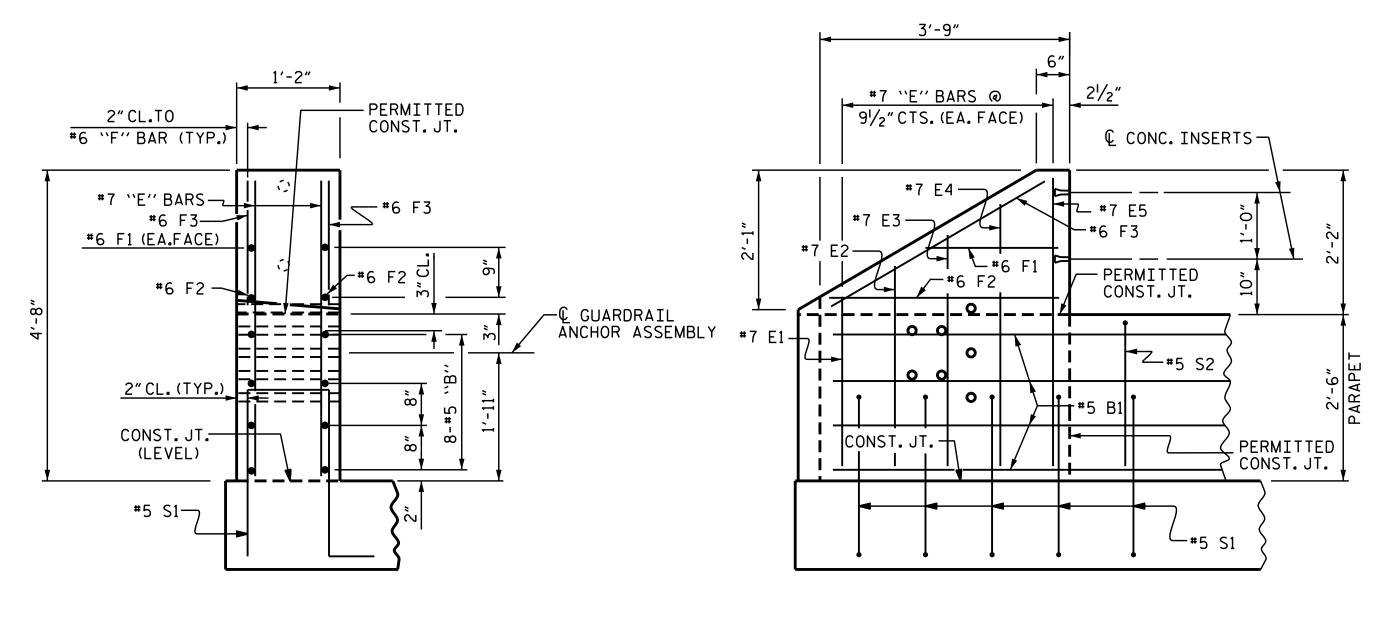


ELEVATION

PARAPET AND END POST FOR TWO BAR RAIL

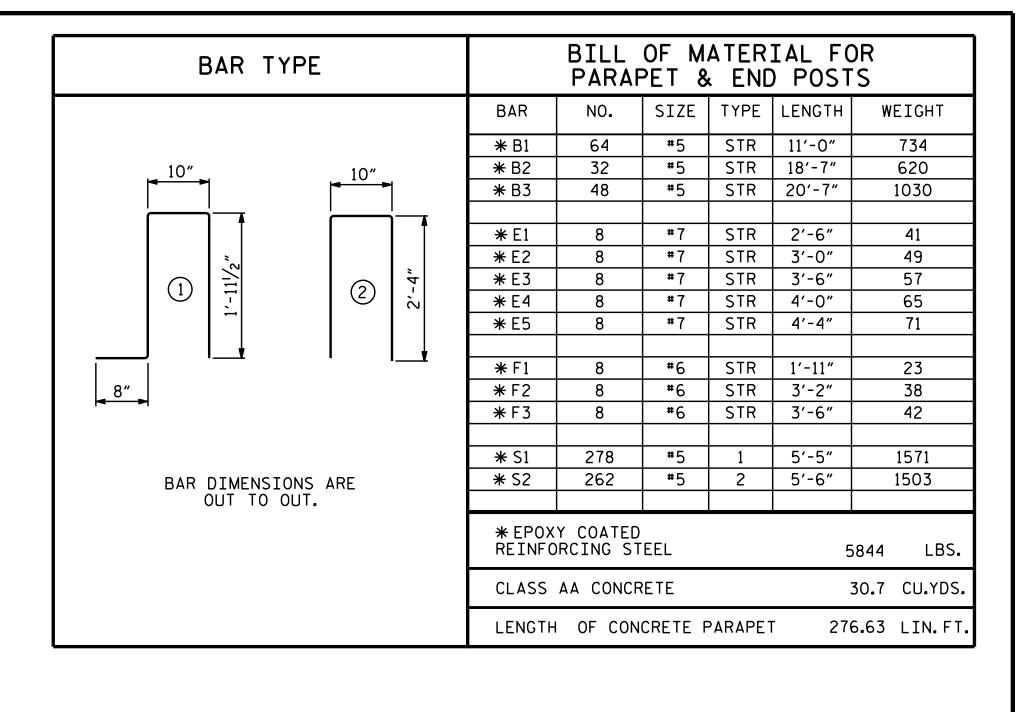

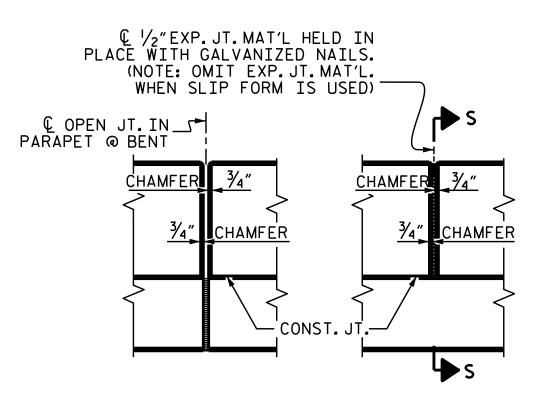

ELEVATION AT EXPANSION JOINTS

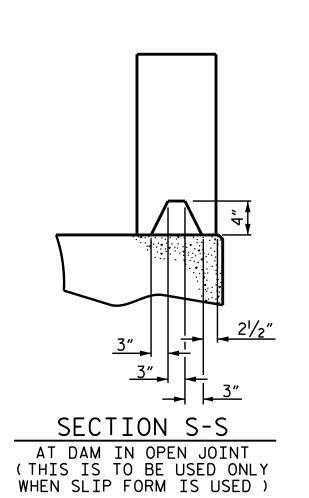

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 2 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE

PLAN OF PARAPET AND END POST DETAILS (EBL)

SHEET NO.

S2-20

REVISIONS DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

	SEAL 26445 NONET NEW MINISTRALE	
	— DocuSigned by: P. Korey Newton	
(4FFE39D1431B407 1/20/2019	

20-JAN-2019 22:06 Z:\Structures\Plans\Str2\R-5021_SMU_02_PR_090024.dgn

END VIEW

_ DATE : <u>8/15/18</u>

_ DATE : ____11/18

_ DATE : <u>1/10/19</u>


WFP / QTN


M.K.BEARD

DESIGN ENGINEER OF RECORD: A.K. PATEL

DRAWN BY :

CHECKED BY : .

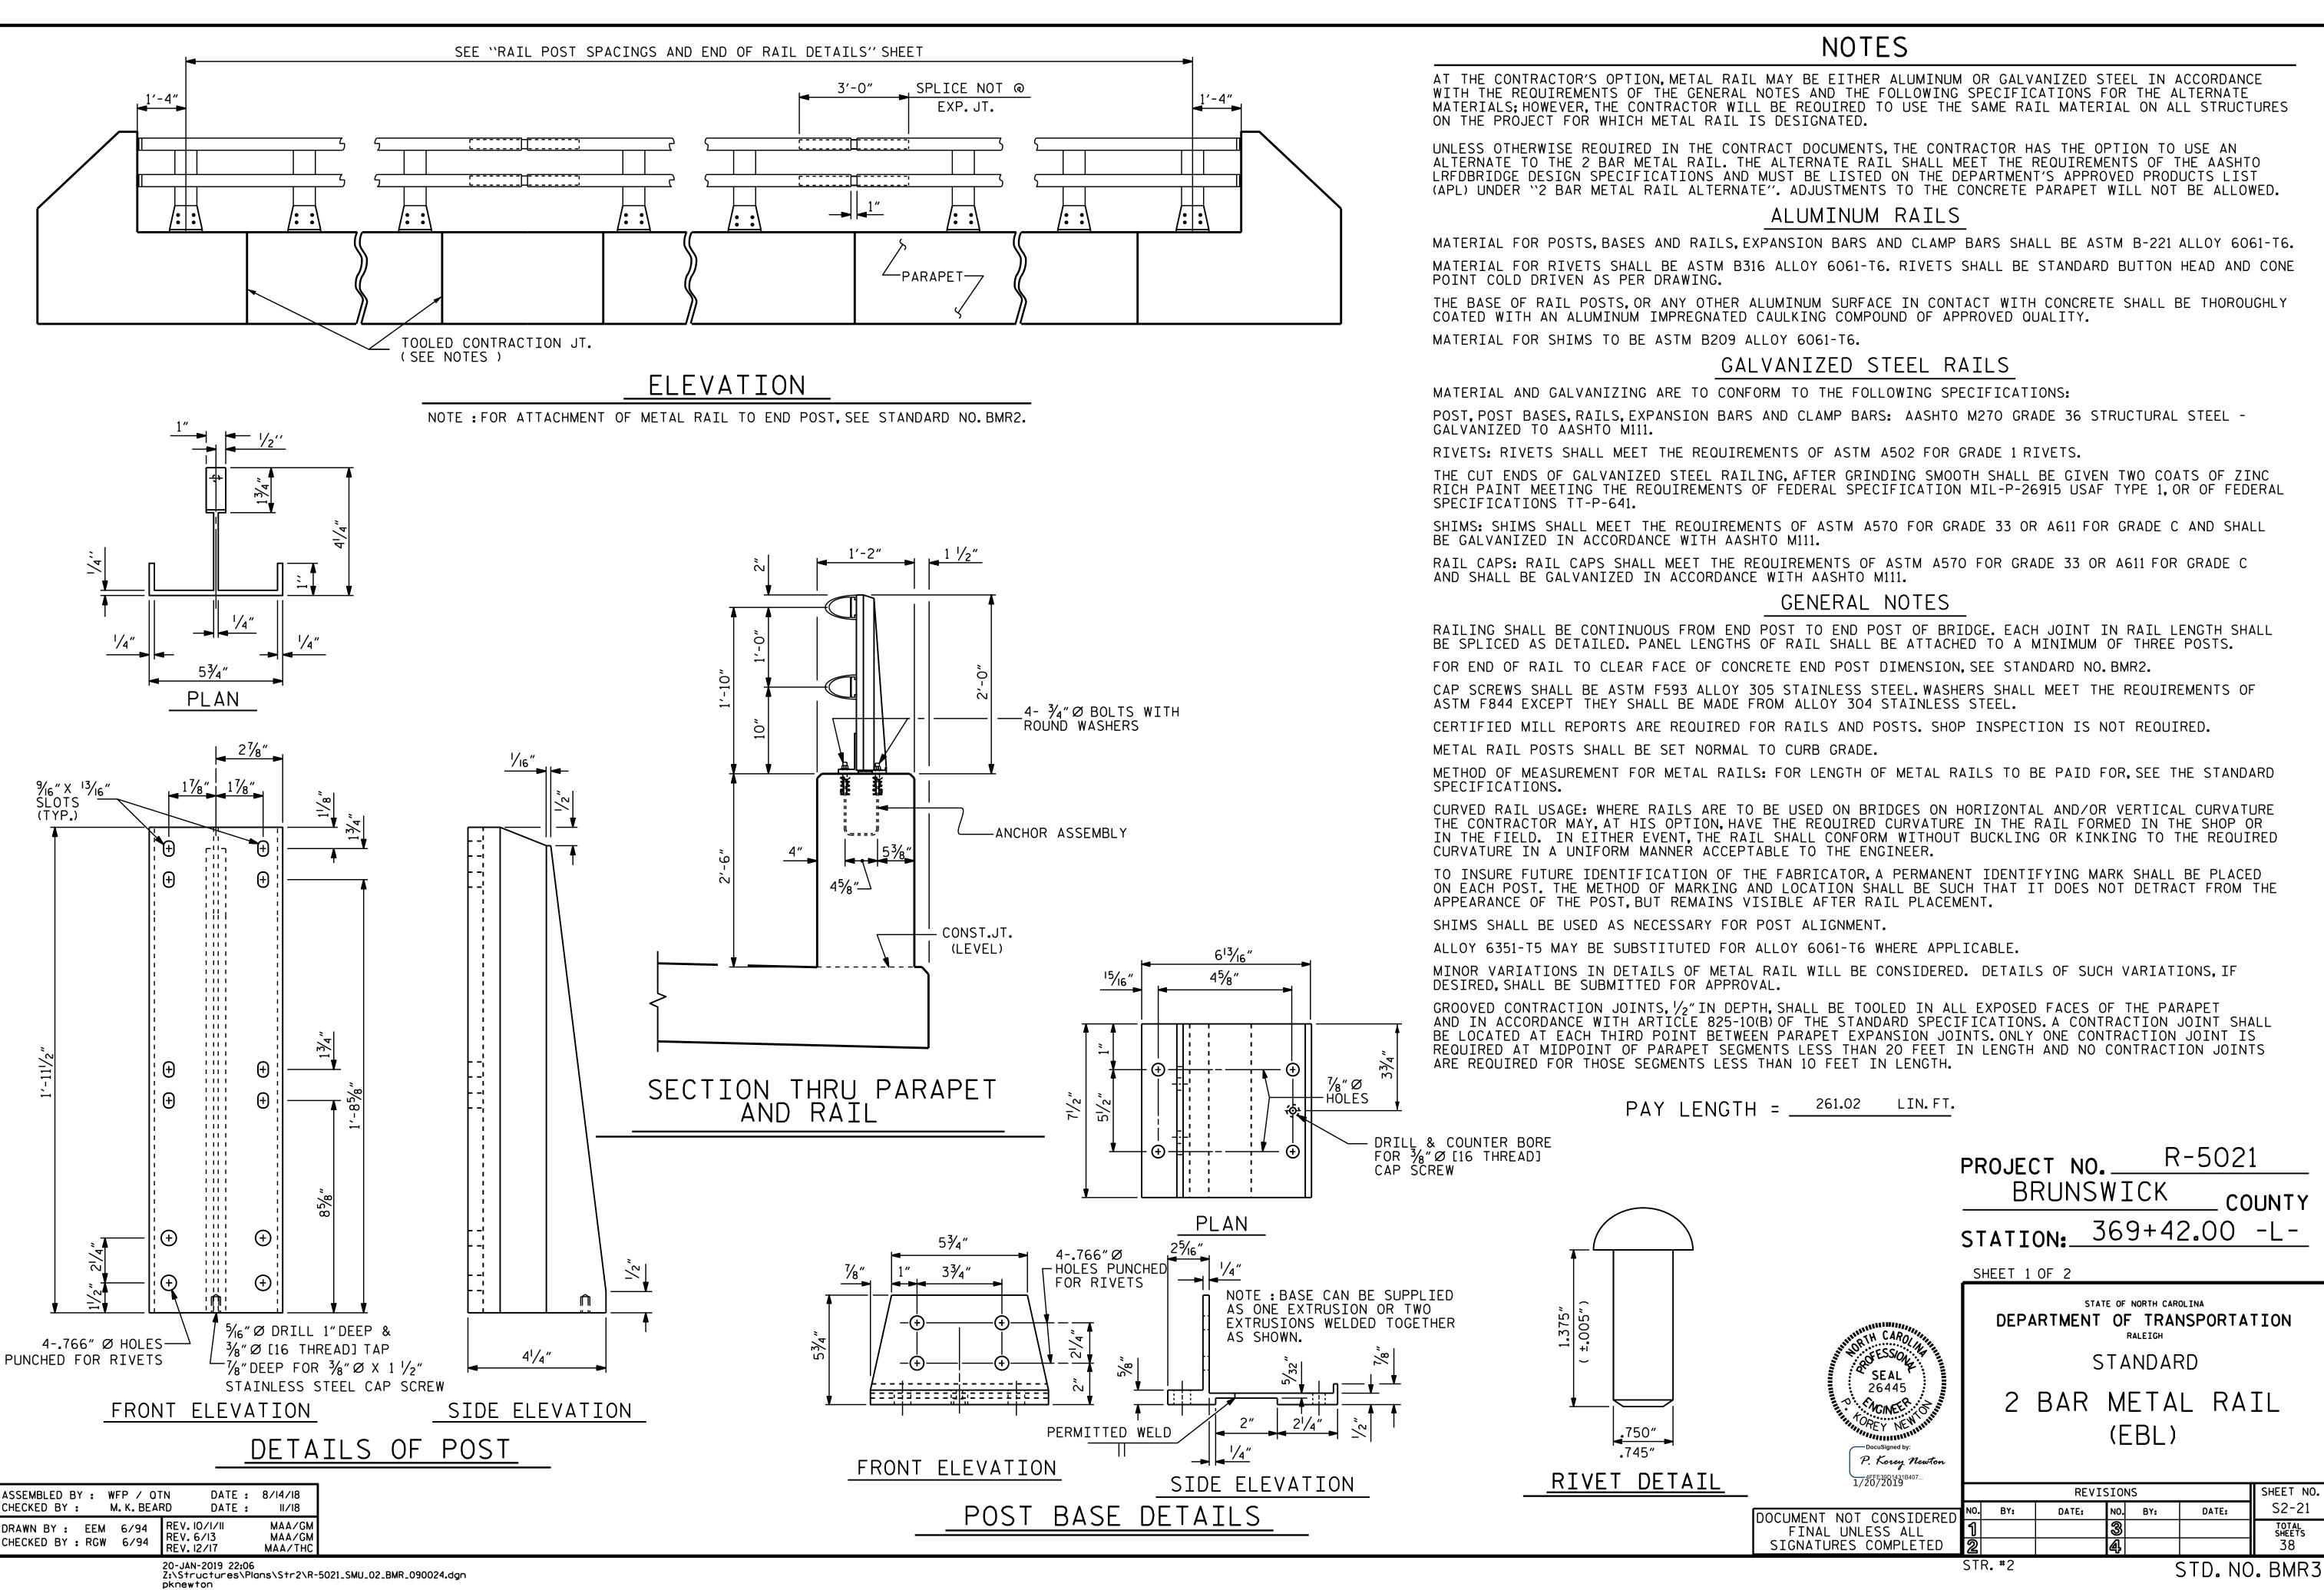

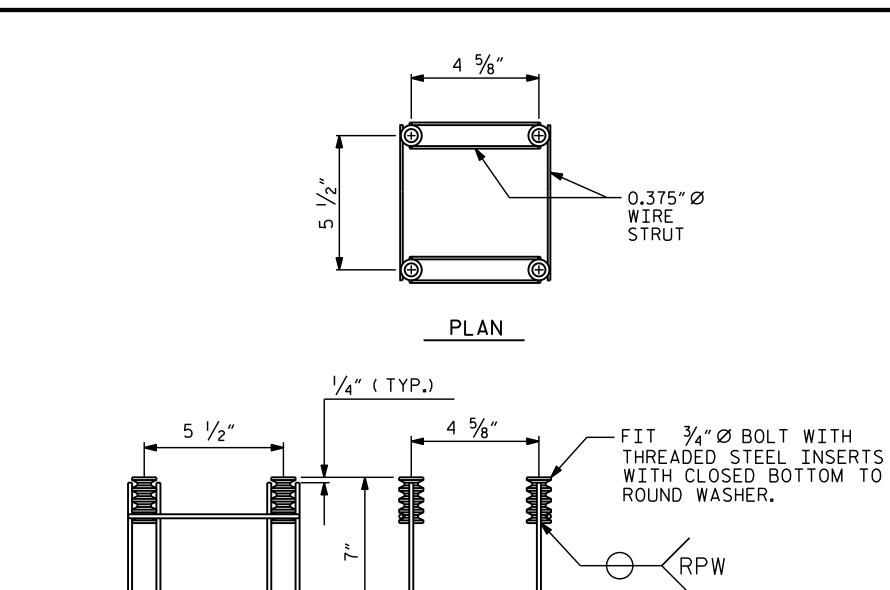

4-BOLT METAL RAIL ANCHOR ASSEMBLY

SIDE VIEW

(46 ASSEMBLIES REQUIRED)

ELEVATION

NOTES


STRUCTURAL CONCRETE ANCHOR ASSEMBLY


THE STRUCTURAL CONCRETE ANCHOR ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF 2" FOR 3/4" FERRULES.
- B. 4 3/4" Ø X 21/2" BOLTS WITH WASHERS.BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307. BOLTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE 3/4" Ø X 21/2" GALVANIZED BOLTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.
- C. WIRE STRUT SHOWN IN THE CONCRETE ANCHOR ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $7_{16}^{\prime\prime}$ Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.
- D. THE METAL RAIL ANCHOR ASSEMBLIES TO BE HOT DIPPED GALVANIZED TO CONFORM TO REQUIREMENTS OF AASHTO M111.
- E. THE COST OF THE METAL RAIL ANCHOR ASSEMBLY WITH BOLTS AND WASHERS COMPLETE IN PLACE SHALL BE INCLUDED IN THE PRICE BID FOR LINEAR FEET OF METAL RAIL.
- F. BOLTS TO BE TIGHTENED ONE-HALF TURN WITH A WRENCH FROM A FINGER-TIGHT POSITION.

THE CONTRACTOR MAY USE ADHESIVELY ANCHORED ANCHOR BOLTS IN PLACE OF THE METAL RAIL ANCHOR ASSEMBLY. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE 3/4" Ø BOLT IS 10 KIPS. FOR ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS, SEE THE STANDARD SPECIFICATIONS.


WHEN ADHESIVELY ANCHORED ANCHOR BOLTS ARE USED, BOLTS SHALL MEET THE REQUIREMENTS OF ASTM F593 ALLOY 304 STAINLESS STEEL WITH MINIMUM 75,000 PSI ULTIMATE STRENGTH. NUTS SHALL MEET THE REQUIREMENTS OF ASTM F594 ALLOY 304 STAINLESS STEEL AND WASHERS SHALL MEET THE REQUIREMENTS OF ASTM F844 EXCEPT THEY SHALL BE MADE FROM ALLOY 304 STAINLESS STEEL.

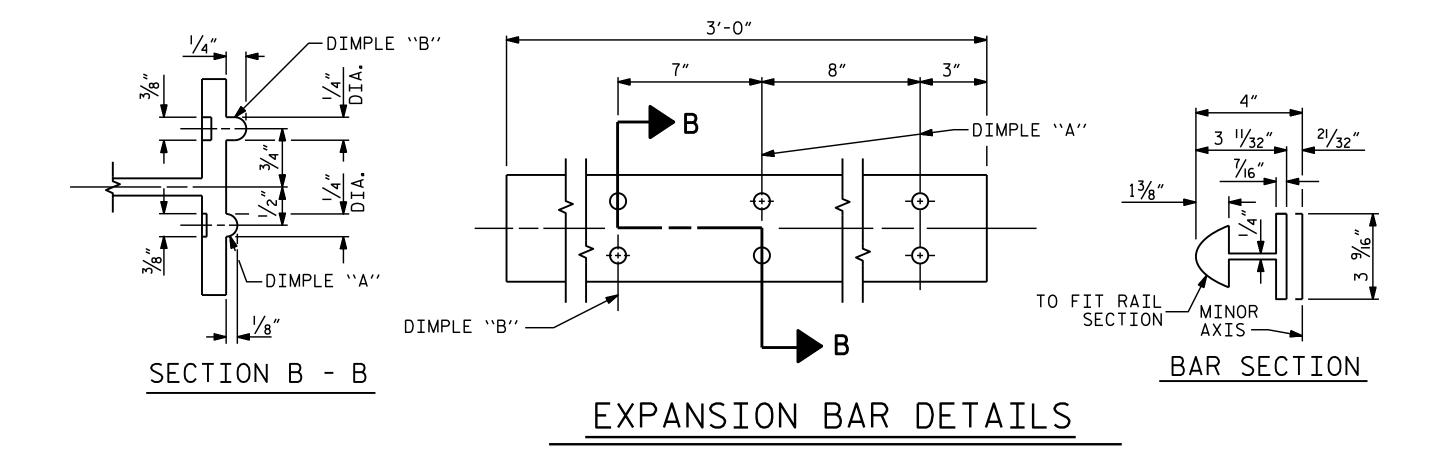

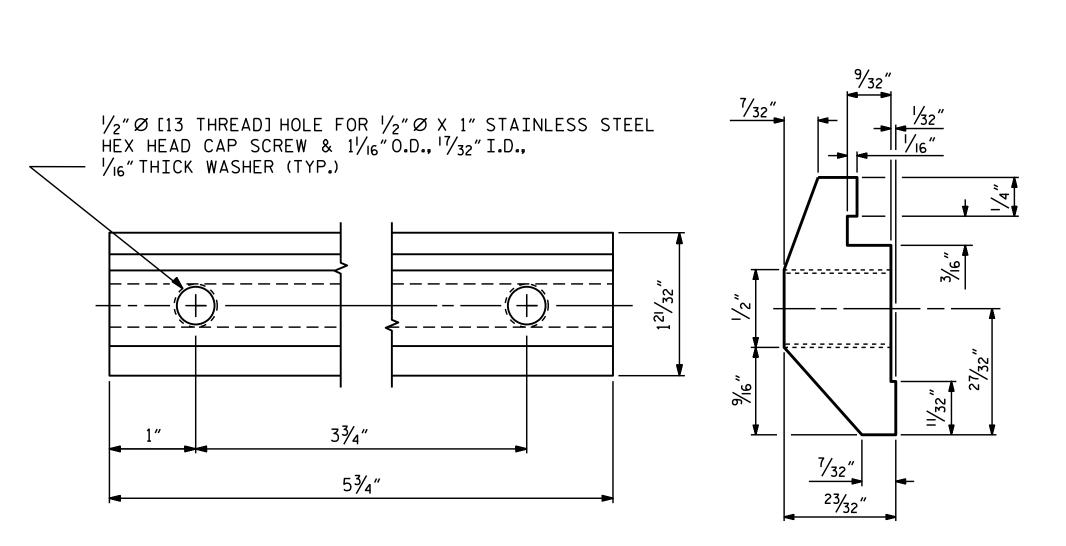


CLAMP BAR DETAIL


(4 REQUIRED PER POST)

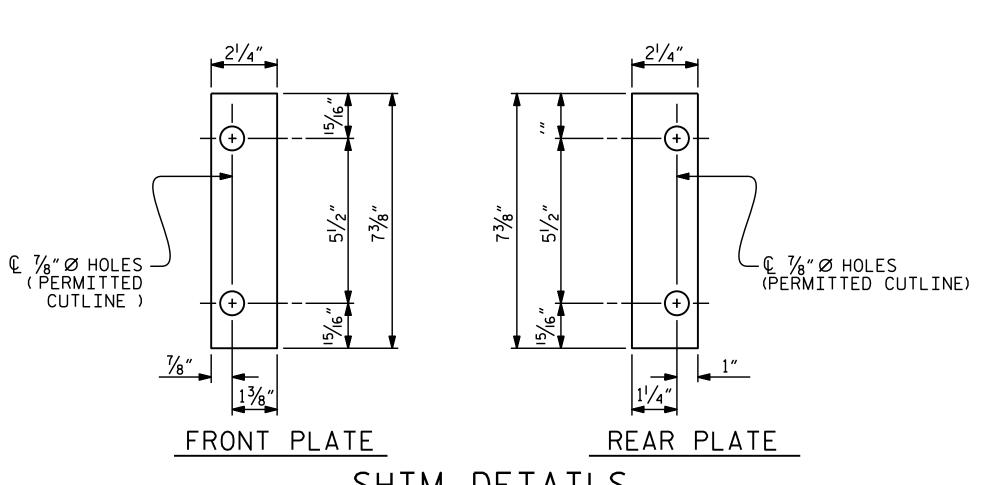


SHIM DETAILS SHIMS MAY BE CUT ALONG PERMITTED CUTLINE OR SLOTTED TO EDGE OF PLATE TO FACILITATE PLACEMENT.

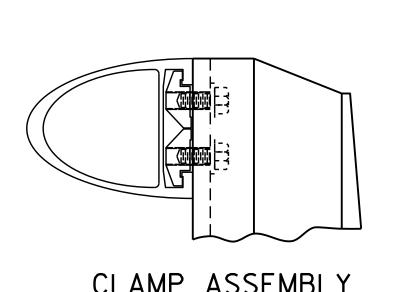

CLAMP ASSEMBLY



RAIL CAP

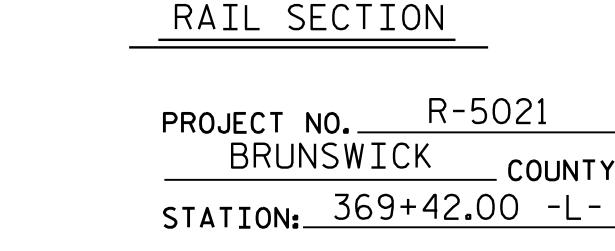

SHEET 2 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

4 3/4"

_MINOR \\AXIS

-SEMI-ELLIPSE

MAJOR

AXIS

R-5021

COUNTY

STANDARD

2 BAR METAL RAIL (EBL)

1/20/2019	REVISIONS				SHEET NO.		
OCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S2-22
FINAL UNLESS ALL	1			8			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			38
	ST	R.#2				STD NO) RMR4

26445

P. Korey Newton


4FFE39D1431B407..


MAA/GM MAA/THC

DATE: 8/14/18 DATE : 11/18

ASSEMBLED BY: WFP / OTN CHECKED BY: M.K.BEARD

DRAWN BY : EEM 6/94 REV. 5/1/06R CHECKED BY : RGW 6/94 REV. 10/1/II

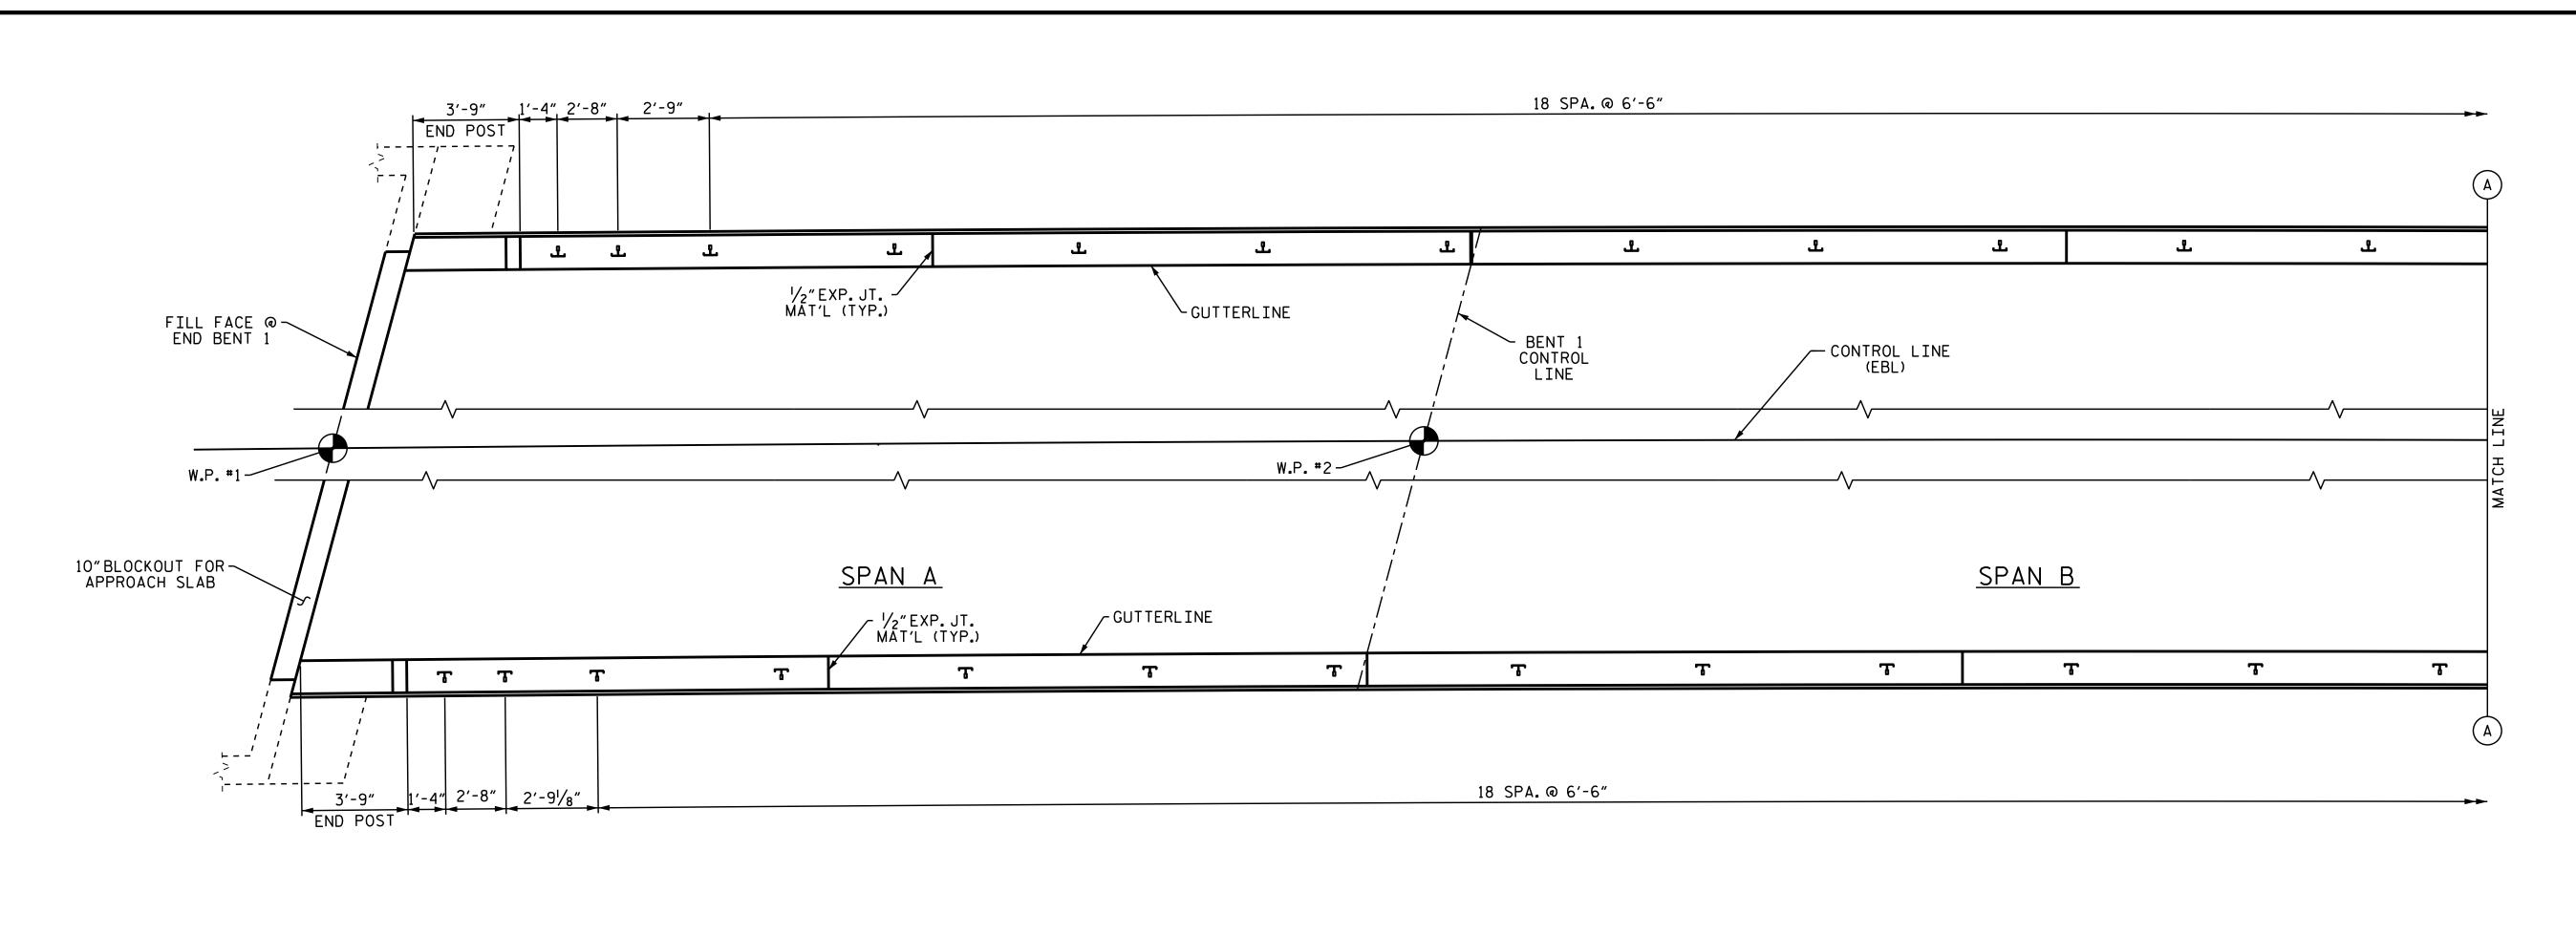

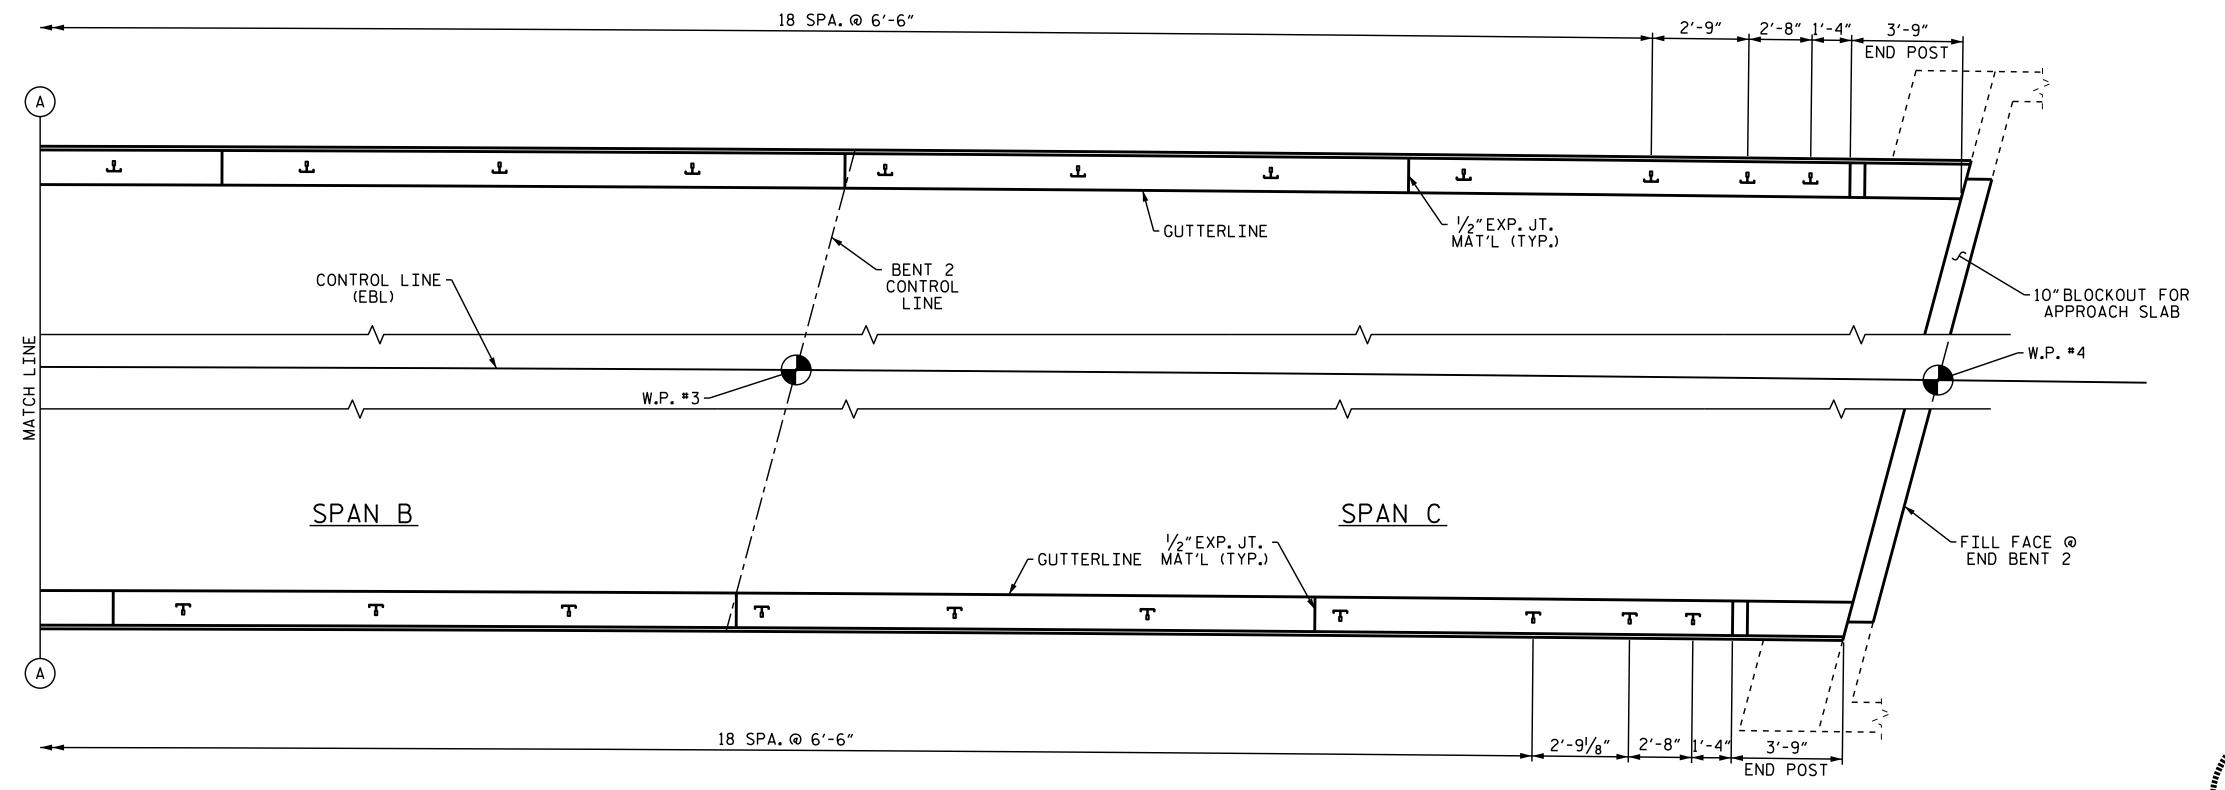

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

SHEET 1 OF 2

DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE

TWO BAR METAL

RAIL POST SPACINGS

AND END POST DETAILS

(EBL)

SHEET NO.

S2-23

T/20/2019 REVISIONS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 4

SEAL 26445

P. Korey Newton

PLAN OF RAIL POST SPACING

DIMENSIONS ARE ALONG OUTSIDE EDGE OF PARAPET

DRAWN BY: WFP / OTN DATE: 8/15/18

CHECKED BY: M.K.BEARD DATE: 11/18

DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/10/19

20-JAN-2019 22:06
Z:\Structures\Plans\Str2\R-5021_SMU_02_BMR_090024.dgn
pknewton

STR. #2

STRUCTURAL CONCRETE INSERT

THE STRUCTURAL CONCRETE INSERT ASSEMBLY SHALL CONSIST OF THE FOLLOWING COMPONENTS:

- A. FERRULES SHALL BE MADE FROM STEEL MEETING THE REQUIREMENTS OF AASHTO M169, GRADE 12L14 AND SHALL HAVE A MINIMUM LENGTH OF THREADS OF $1\frac{1}{2}$ ".
- B. 1 $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH WASHER.BOLT SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307.BOLT AND WASHER SHALL BE GALVANIZED. (AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLT AND WASHER MAY BE USED AS AN ALTERNATE FOR THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " GALVANIZED BOLT AND WASHER. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.)
- C. WIRE STRUT SHOWN IN THE CONCRETE INSERT ASSEMBLY DETAIL IS THE MINIMUM ALLOWABLE SIZE AND SHALL HAVE A MINIMUM TENSILE STRENGTH OF 100,000 PSI. AS AN OPTION, A $\frac{7}{16}$ " Ø WIRE STRUT WITH A MINIMUM TENSILE STRENGTH OF 90,000 PSI IS ACCEPTABLE.

NOTES

METAL RAIL TO END POST CONNECTION

THE METAL RAIL TO END POST CONNECTION SHALL CONSIST OF THE FOLLOWING COMPONENTS:


- A. $\frac{1}{2}$ " PLATES SHALL CONFORM TO AASHTO M270 GRADE 36 AND SHALL BE GALVANIZED AFTER FABRICATION.
- B. $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT SHALL HAVE A WORKING LOAD SHEAR CAPACITY OF 4800 LBS. THE FERRULES SHALL ENGAGE A $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH 2" O.D. WASHER IN PLACE. THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT SHALL HAVE N. C. THREADS.
- C. CAP SCREWS FOR RAIL ATTACHMENT TO ANGLE SHALL CONFORM TO THE REQUIREMENTS OF ASTM F593 ALLOY 305 STAINLESS STEEL. CAP SCREWS TO BE CENTERED IN SLOTS AT 60°F.
- D. STANDARD CLAMP BARS (SEE METAL RAIL SHEET).
- E. $\frac{1}{2}$ " Ø PIPE SLEEVES (IF REQUIRED) TO BE GALVANIZED.

THE COST OF THE STANDARD CLAMP BARS AND CAP SCREWS USED IN THE METAL RAIL TO END POST CONNECTION SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR LINEAR FEET OF 1 OR 2 BAR METAL RAILS.

THE $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT WITH BOLT SHALL BE ASSEMBLED IN THE SHOP.

THE COST OF THE $\frac{3}{4}$ " STRUCTURAL CONCRETE INSERT ASSEMBLY, AND THE $\frac{1}{2}$ " PLATES COMPLETE IN PLACE SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE CONTRACTOR, AT HIS OPTION, MAY USE AN ADHESIVE BONDING SYSTEM IN LIEU OF THE STRUCTURAL CONCRETE INSERT EMBEDDED IN THE END POST. IF THE ADHESIVE BONDING SYSTEM IS USED, THE $\frac{3}{4}$ " Ø X $1\frac{5}{8}$ " BOLT WITH WASHER SHALL BE REPLACED WITH A $\frac{3}{4}$ " $\frac{3}{4}$ " BOLT AND 2" O.D. WASHER. ALL SPECIFICATIONS THAT APPLY TO THE $\frac{3}{4}$ " $\frac{3}{4}$ " BOLT SHALL APPLY TO THE $\frac{3}{4}$ " $\frac{3}{4}$ " BOLT. FIELD TESTING OF THE ADHESIVE BONDING SYSTEM IS NOT REQUIRED.

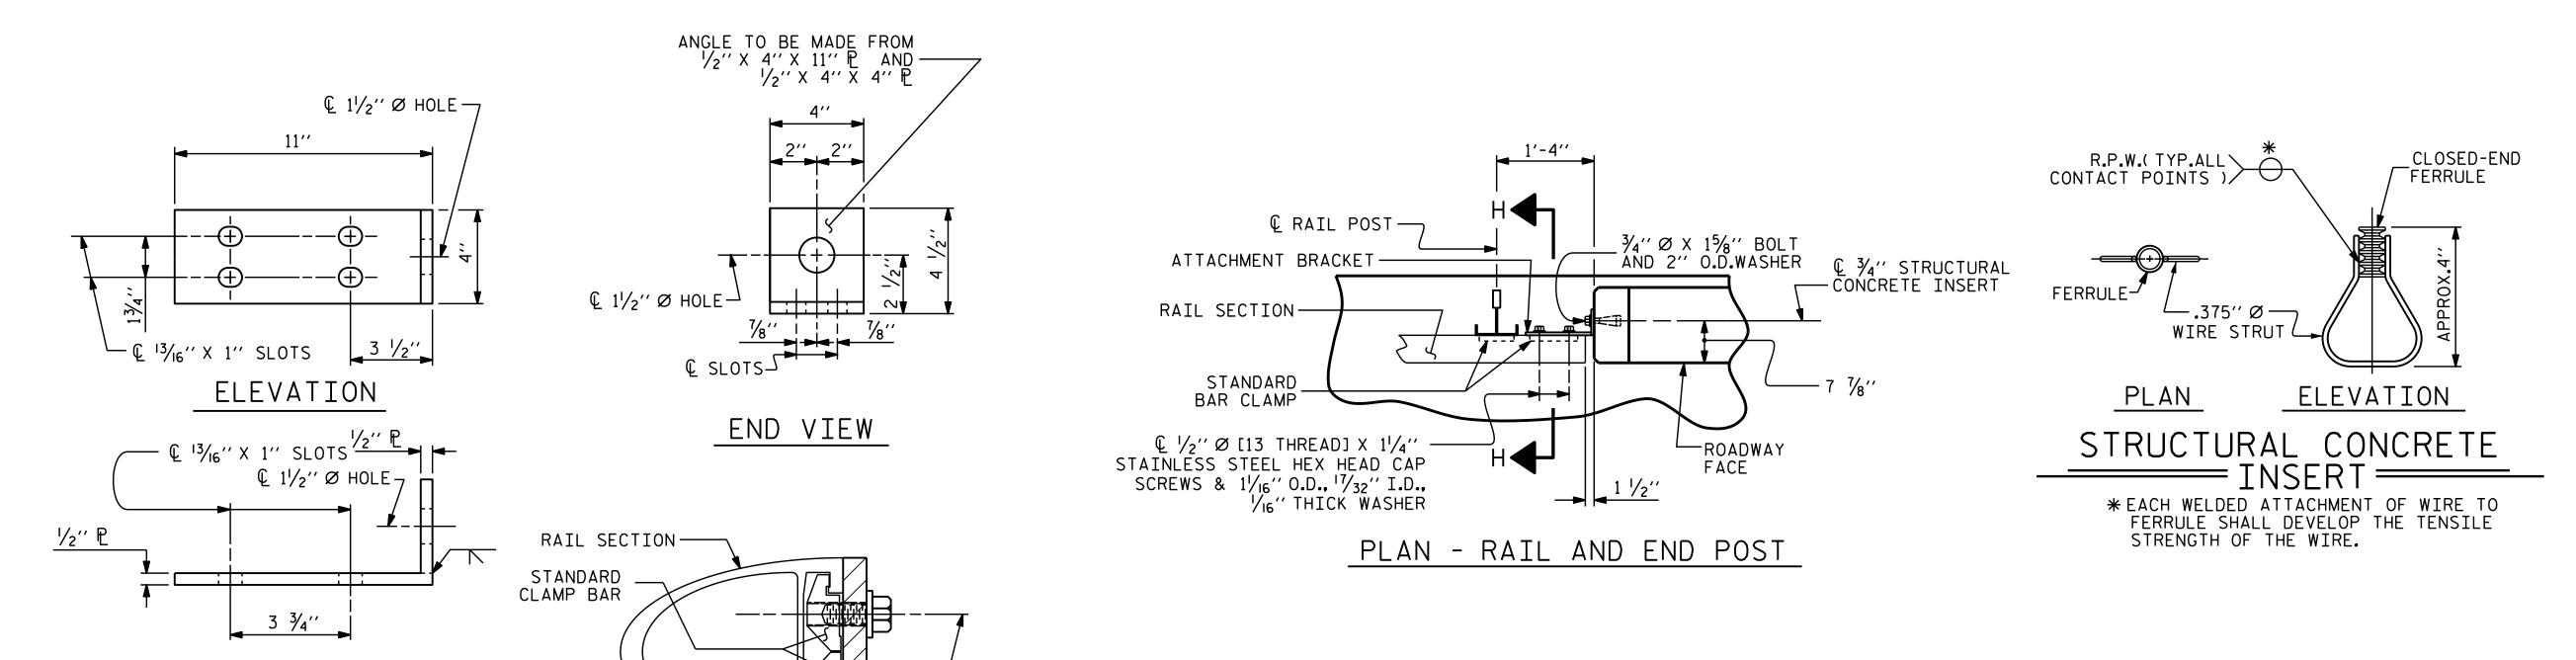

R-5021 PROJECT NO. BRUNSWICK COUNTY 369+42.00 -L-STATION:_

26445

P. Korey Newton

S SUCINEES

SHEET 2 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH STANDARD

RAIL POST SPACINGS = AND =

END OF RAIL DETAILS FOR TWO BAR METAL RAILS (EBL)

4FFE39D1431B407... REVISIONS S2-24 DATE: DATE: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

FIXED

SECTION H-H

DETAILS FOR ATTACHING METAL RAIL TO END POST

 $\mathbb{Q} /_{2}$ " Ø [13 THREAD] X $1/_{4}$ "


- STAINLESS STEEL HEX

HEAD CAP SCREWS & $1\frac{1}{16}$ O.D., $\frac{17}{32}$ I.D., $\frac{1}{16}$ THICK WASHER

ASSEMBLED BY: WFP / QTN DATE: 8/15/18 CHECKED BY : M.K. BEARD DATE: II/I8 TLA/GM REV. 5/1/06 DRAWN BY: FCJ I/88 MAA/GM MAA/THC REV. 10/1/11 CHECKED BY : CRK 3/89 REV. 12/17

20-JAN-2019 22:06 Z:\Structures\Plans\Str2\R-5021_SMU_02_BMR_090024.dgn

TOP VIEW

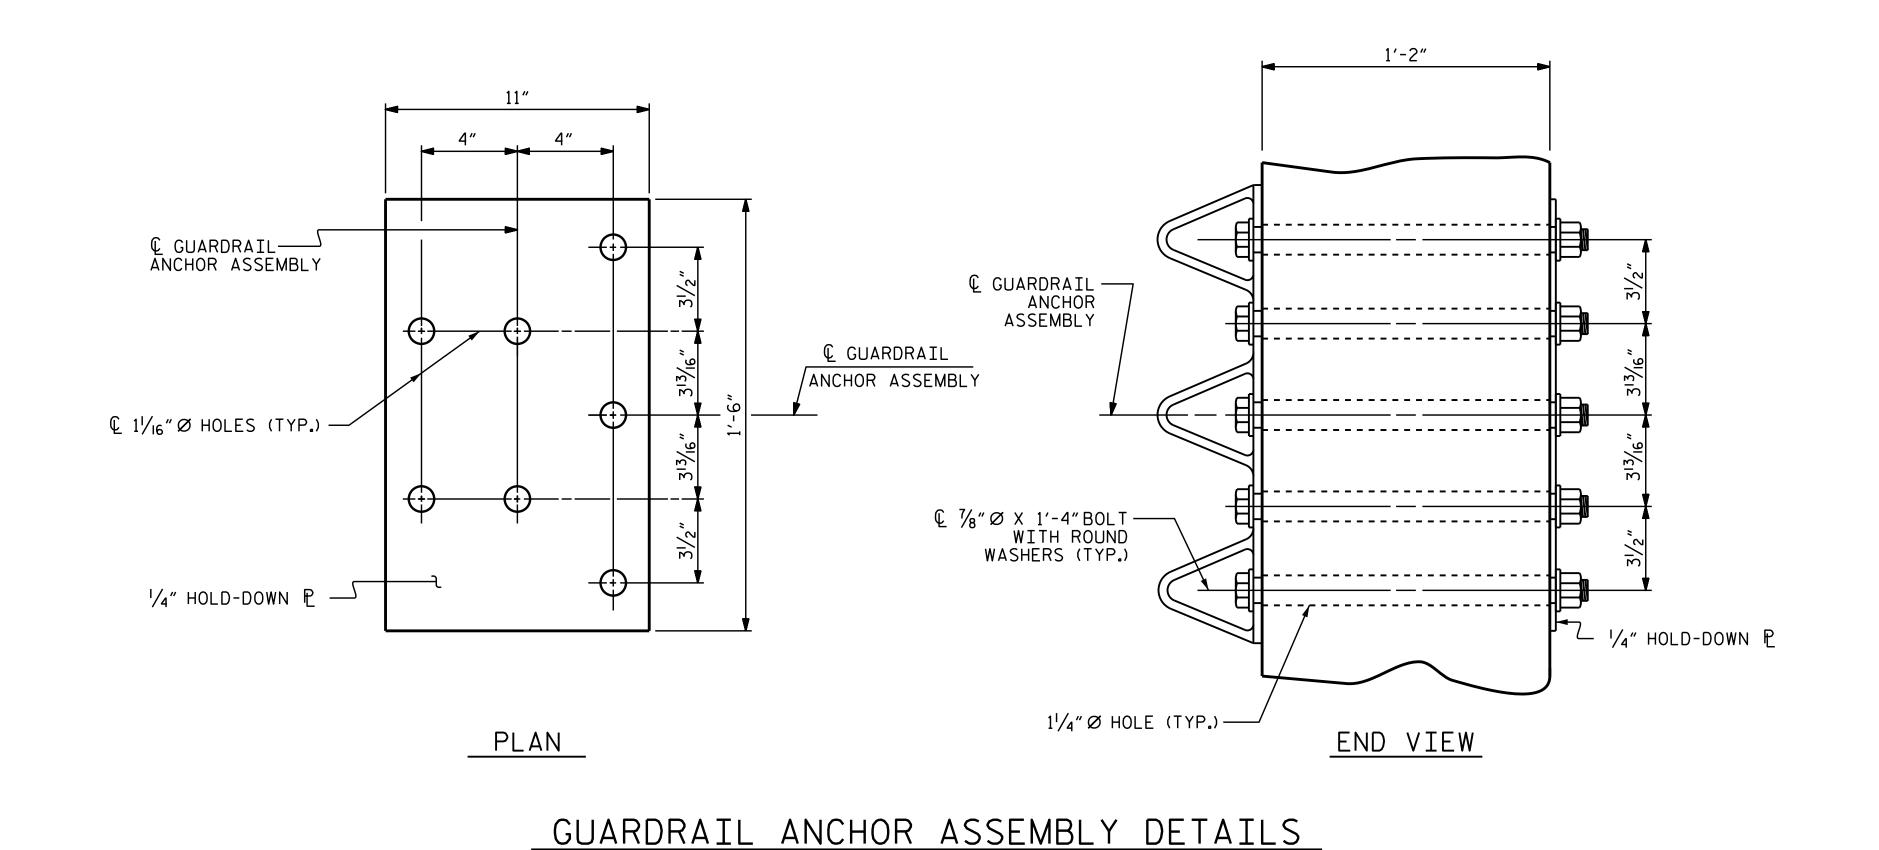

1'-2"

END VIEW

(TWO BAR METAL RAIL)

€ GUARDRAIL

ANCHOR ASSEMBLY

— CONST. JT (LEVEL) END OF DECK SLAB -@ END BENT

LOCATION OF GUARDRAIL ANCHOR AT END POST

GUARDRAIL
ANCHOR ASSEMBLY

_ € GUARDRAIL ANCHOR ASSEMBLY

PLAN

THE GUARDRAIL ANCHOR ASSEMBLY SHANO TO SIST OF A 1/4" HOLD DOWN PLATE AND 7 - 1/8" Ø BOLTS WITH NUTS AND WASHERS.

THE HOLD-DOWN PLATE SHALL CONFORM TO AASHTO M270 GRADE 36.AFTER FABRICATION, THE HOLD-DOWN PLATE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111.

BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307 AND NUTS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M291. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED. AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS, NUTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE ½" Ø GALVANIZED BOLTS, NUTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.


THE GUARDRAIL ANCHOR ASSEMBLY IS REQUIRED AT ALL POINTS WHERE APPROACH GUARDRAIL IS TO BE ATTACHED TO THE END OF THE PARAPET. FOR POINTS OF ATTACHMENT, SEE SKETCH.

AFTER INSTALLATION, THE EXPOSED THREAD OF THE BOLT SHALL BE BURRED WITH A SHARP POINTED TOOL.

THE COST OF THE GUARDRAIL ANCHOR ASSEMBLIES WITH BOLTS, NUTS AND WASHERS COMPLETE IN PLACE, SHALL BE INCLUDED IN THE VARIOUS PAY ITEMS.

THE VERTICAL REINFORCING BARS MAY BE SHIFTED SLIGHTLY IN THE END POST TO CLEAR ASSEMBLY BOLTS.


THE 1 $\frac{1}{4}$ " Ø HOLES SHALL BE FORMED OR DRILLED WITH A CORE BIT. IMPACT TOOLS WILL NOT BE PERMITTED. ANY CONCRETE DAMAGED BY THIS WORK SHALL BE REPAIRED TO THE SATISFACTION OF THE ENGINEER.

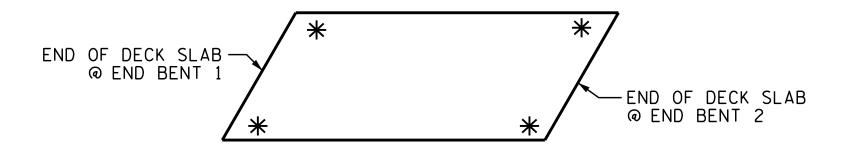

SKETCH SHOWING POINTS OF ATTACHMENT

*LOCATION OF GUARDRAIL ATTACHMENT

PROJECT NO. R-5021
BRUNSWICK COUNTY
STATION: 369+42.00 -L-



DEPARTMENT OF TRANSPORTATION
STANDARD

GUARDRAIL ANCHORAGE
DETAILS
FOR METAL RAILS
(EBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED 2 STR. #2

REVISIONS

NO. BY: DATE: NO. BY: DATE: \$2-25

1 3 TOTAL SHEETS
2 4 38

CHECKED BY: M.K.BEARD DATE: II/I8


DRAWN BY: MAA 5/IO REV. I/I5 MAA/TMG REV. I2/I7 MAA/THC REV. 5/I8 MAA/THC


ASSEMBLED BY : WFP / QTN

20-JAN-2019 22:06 Z:\Structures\Plans\Str2\R-5021_SMU_02_BMR_090024.dgn

DATE: 8/14/18

STD. NO. GRA3

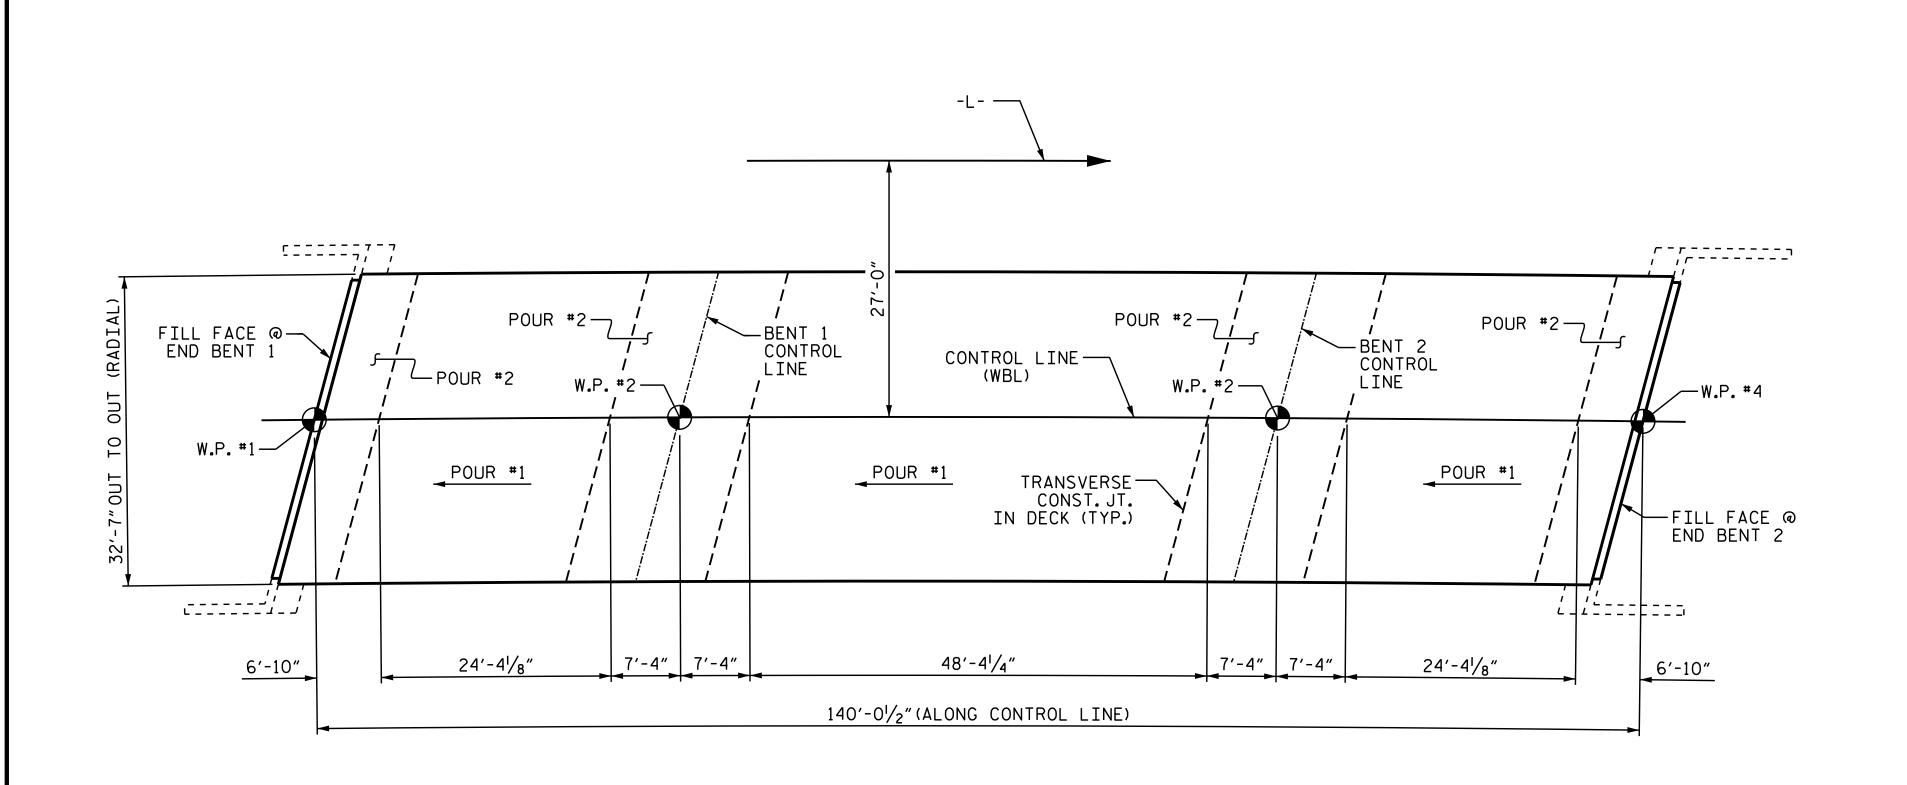

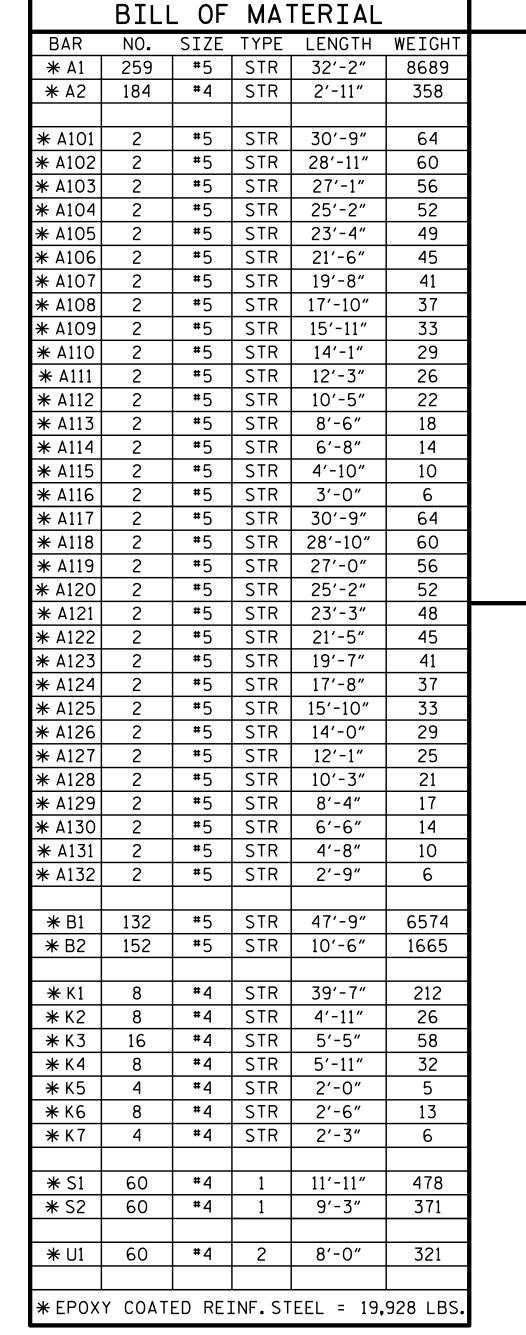

R-5021 PROJECT NO.____ BRUNSWICK COUNTY STATION: 369+42.00 -L-

-BAR TYPES —

ALL BAR DIMENSIONS ARE OUT TO OUT

8'-0"

4'-0"

(2)

S2

1'-81/2"

3'-61/2"


SUPERSTRUCTURE REINFORCING STEEL LENGTHS ARE BASED ON THE FOLLOWING MINIMUM SPLICE LENGTHS

SUPERSTRUCTURE EXCEPT APPROACH SLABS, PARAPET, **PARAPET** APPROACH SLABS AND SIZE AND BARRIER RAIL BARRIER RAIL EPOXY COATED UNCOATED EPOXY COATED UNCOATED 2'-6" 2'-5" 3'-7" 2'-5" 3'-8" 4'-9"

— SUPERSTF	RUCTURE BILL O	F MATERIAL —
	CLASS AA CONCRETE	EPOXY COATED REINFORCING STEEL
	(CU.YDS.)	(LBS.)
POUR #1	58 . 9	
POUR #2	50 . 8	
TOTALS**	109.7	19928

**QUANTITIES FOR CONCRETE PARAPET ARE NOT INCLUDED

GROOVING	BRIDGE FL	00RS
APPROACH SLABS	1303	SQ.FT.
BRIDGE DECK	3725	SQ.FT.
TOTAL	5028	SQ.FT.



STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE BILL OF MATERIAL (EBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

8/16/2021

		SHEET NO.				
١.	BY:	DATE:	NO.	BY:	DATE:	S2-26
			3			TOTAL SHEETS
)			4			38

16-AUG-2021 18:01 Z:\Structures\Plans\Str2\R-5021_SMU_02_B0M_090024.dgn

DATE: 8/12/21

TLA/GM

MAA/GM MAA/THC

DESIGN ENGINEER OF RECORD:

DRAWN BY: JMB 5/87

CHECKED BY : SJD 9/87


P.K.NEWTON

ASSEMBLED BY : QTN / MKB / PKN DATE : 8/12/21 CHECKED BY : D.R. SHACKELFORD DATE : 8/12/21

REV. 5/1/06

REV. 10/1/11 REV. 12/17

STD. NO. BOM2

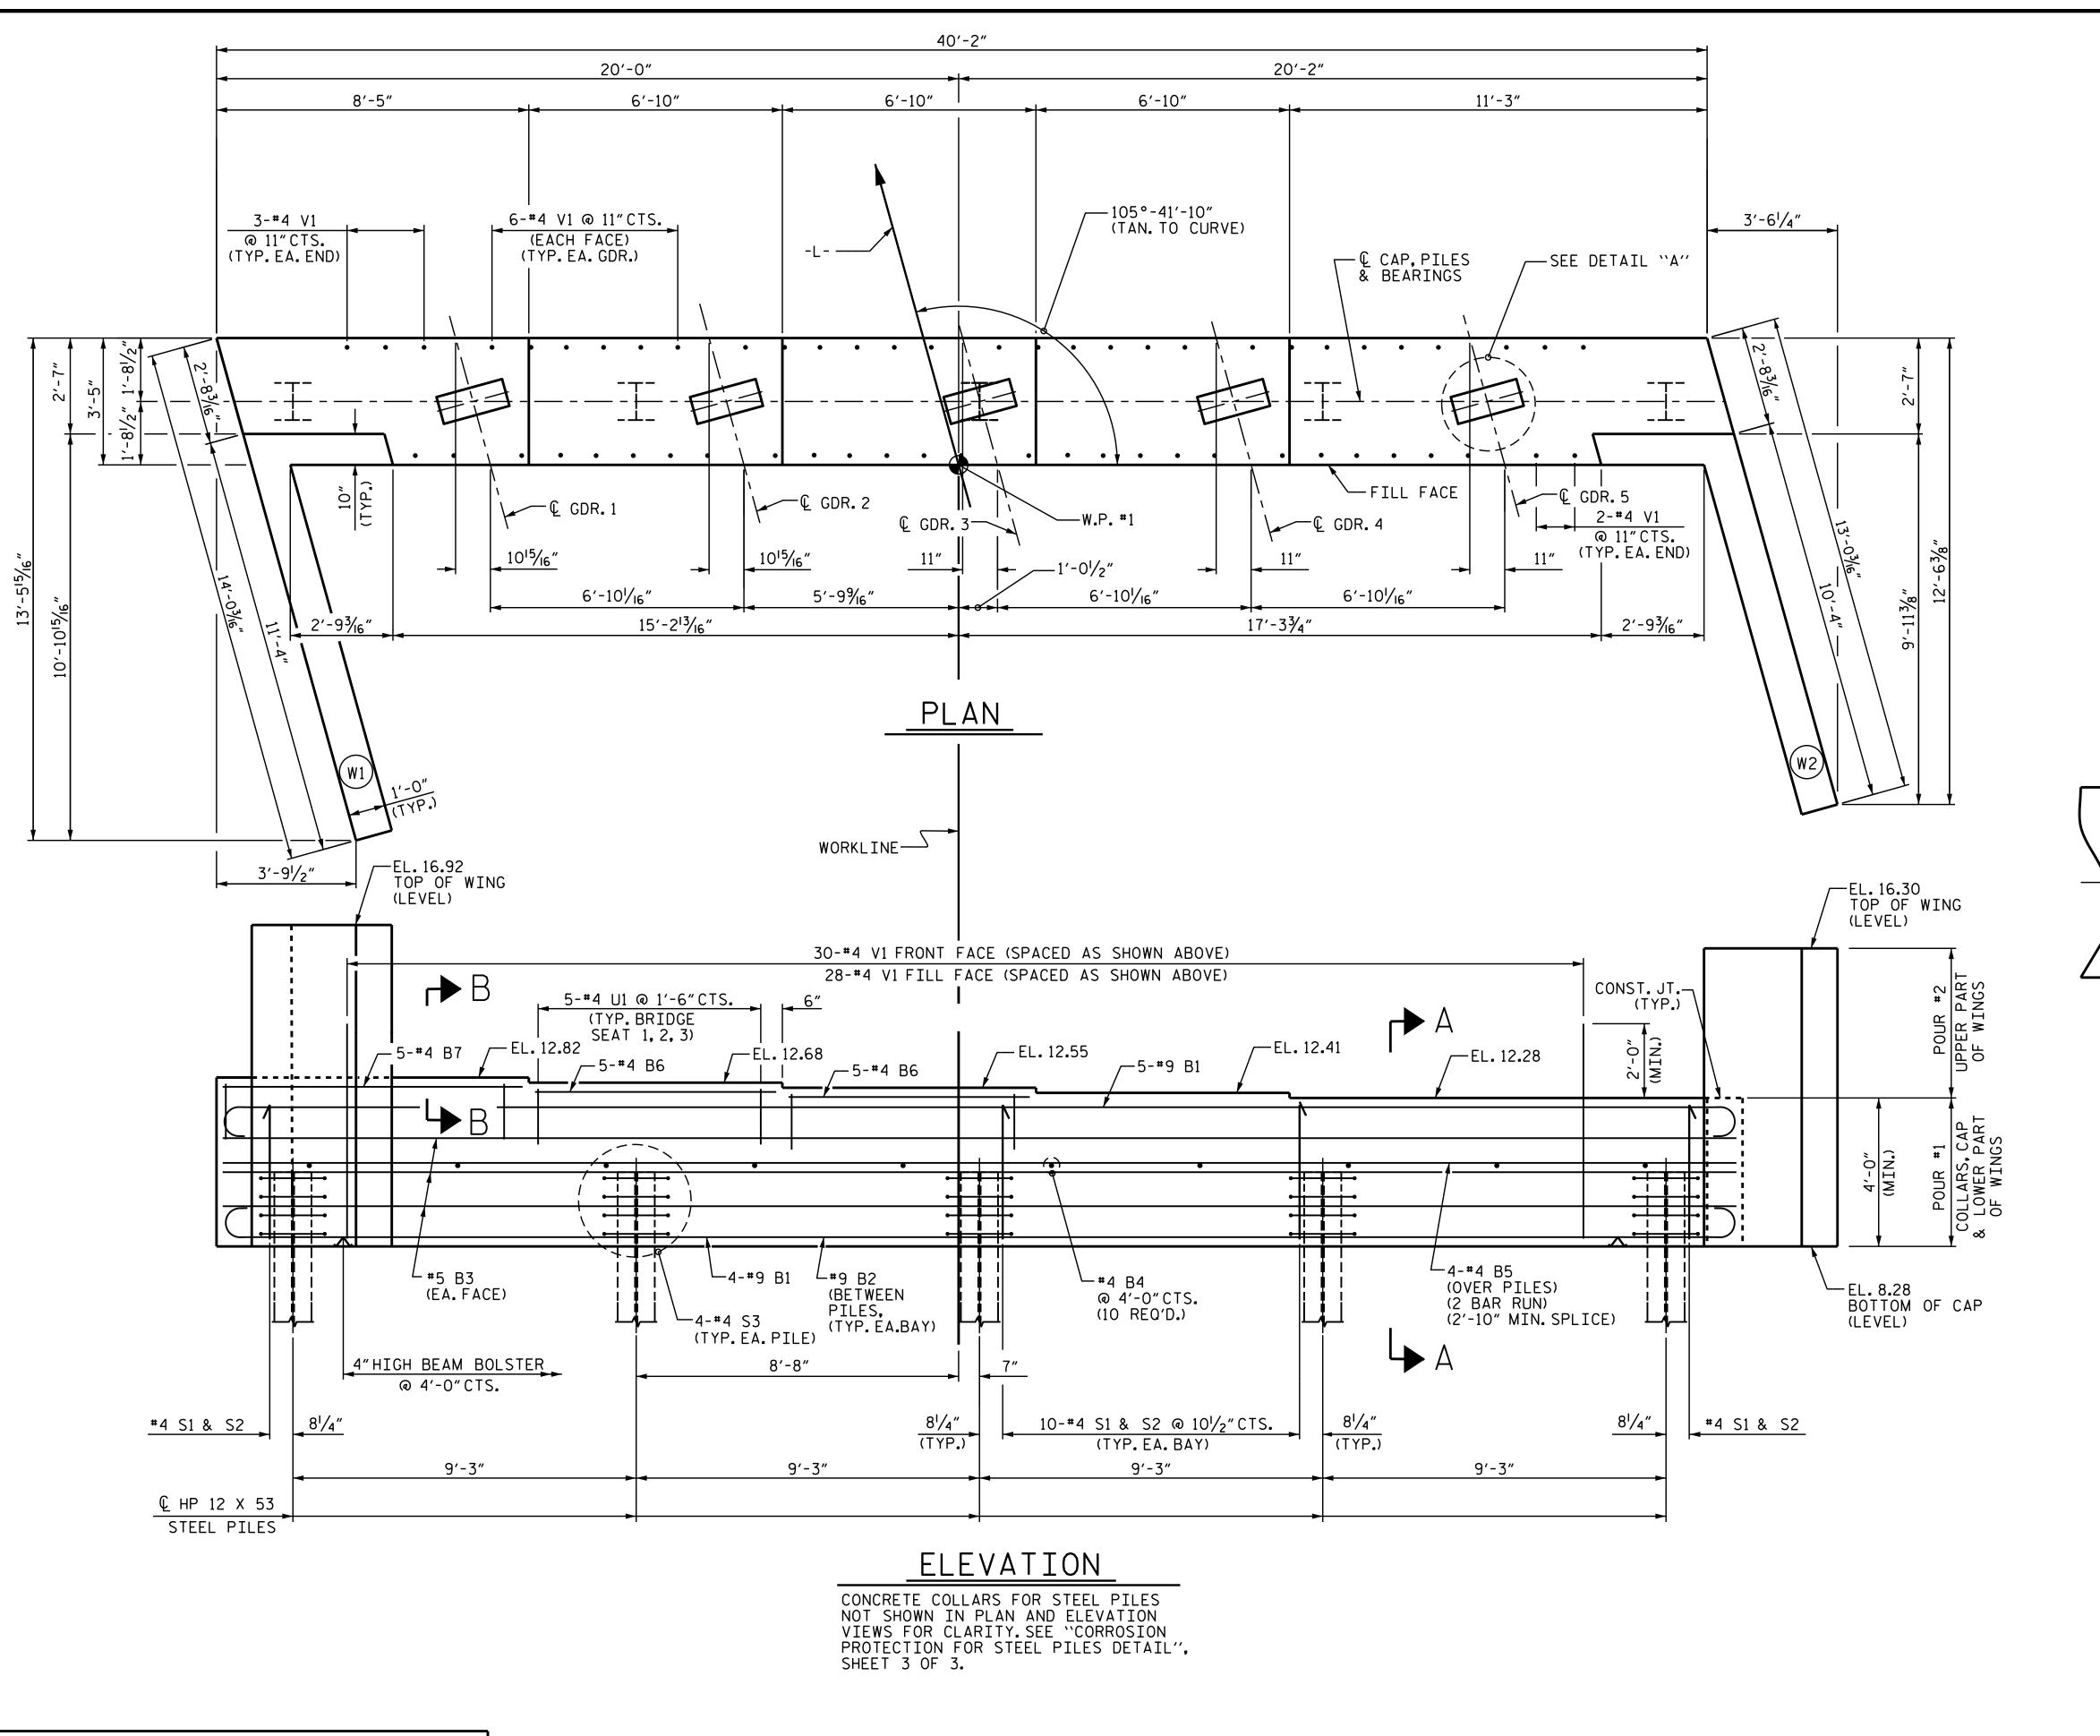


STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR #4 V1 BARS.

THE TOP SURFACE OF THE END BENT CAP, EXCEPT THE BEARING AREA, SHALL BE RAKED TO A DEPTH OF 1/4".

METALIZE PILES IN ACCORDANCE WITH TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

AFTER DRIVING THE PILES APPLY 1 COAT EACH OF 1080-09 BROWN AND 1080-09 GRAY PAINT TO THE EMBEDDED SECTION OF THE METALLIZED PILE PRIOR TO CONCRETE EMBEDMENT IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS.

PRIOR TO BEGINNING METALLIZATION THE CONTRACTOR WILL PROVIDE METALLIZED SAMPLES TO THE ENGINEER FOR APPROVAL.

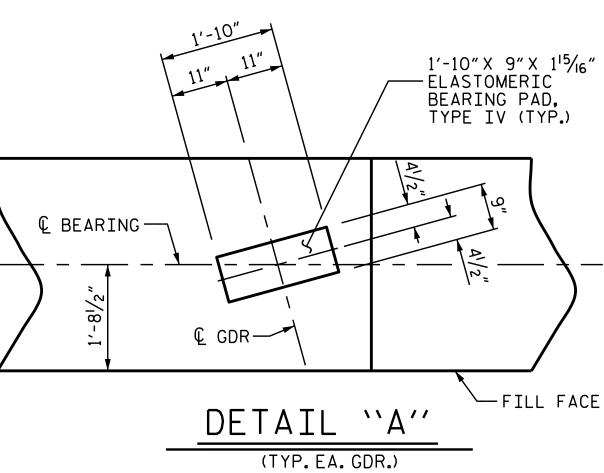

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

> STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

RALEIGH

SUBSTRUCTURE

INTEGRAL

SHEET 1 OF 3

SEAL 29441 TO SUCINEER

the 2.0. ayou 245838930BF40E... 1/23/2019

END BENT 1 (EBL)

STR. #2

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

SHEET NO. REVISIONS S2-27 DATE:

_ DATE : <u>5/17/18</u>

_ DATE : <u>8/18</u>


Q. T. NGUYEN


M.K.BEARD


DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/10/19

DRAWN BY :

CHECKED BY : .

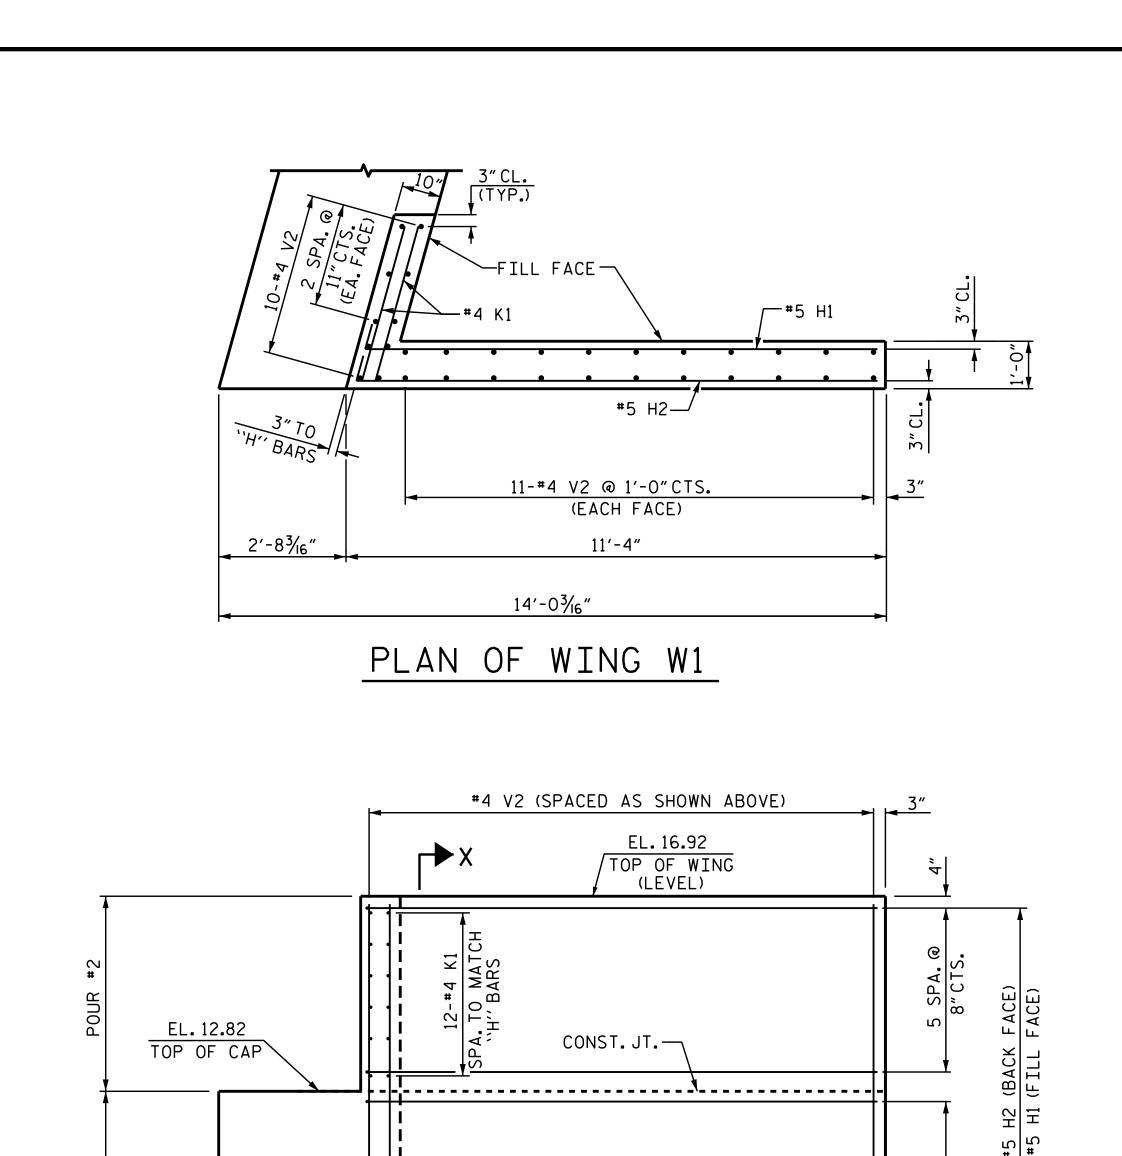

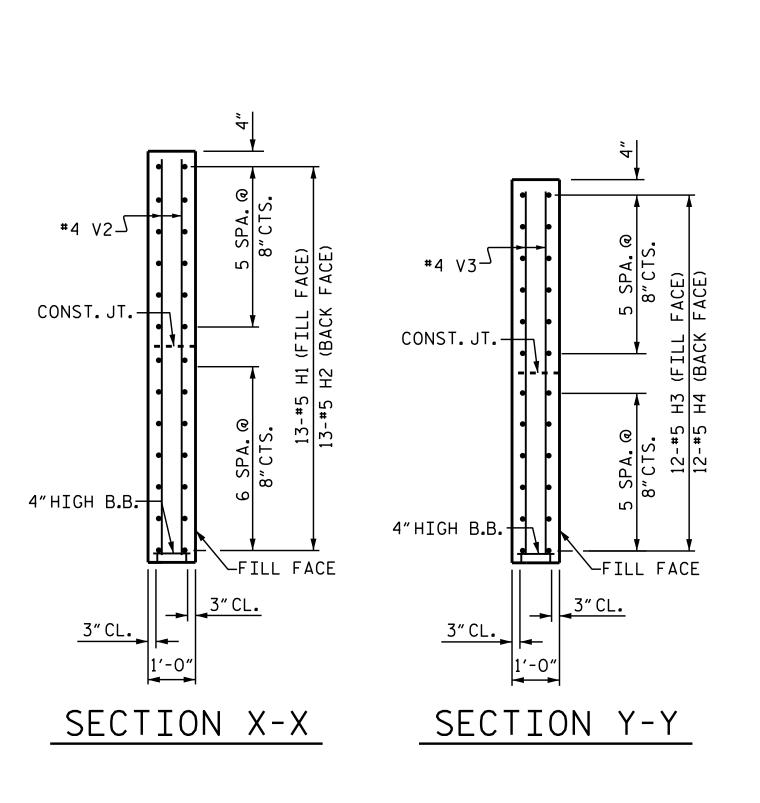

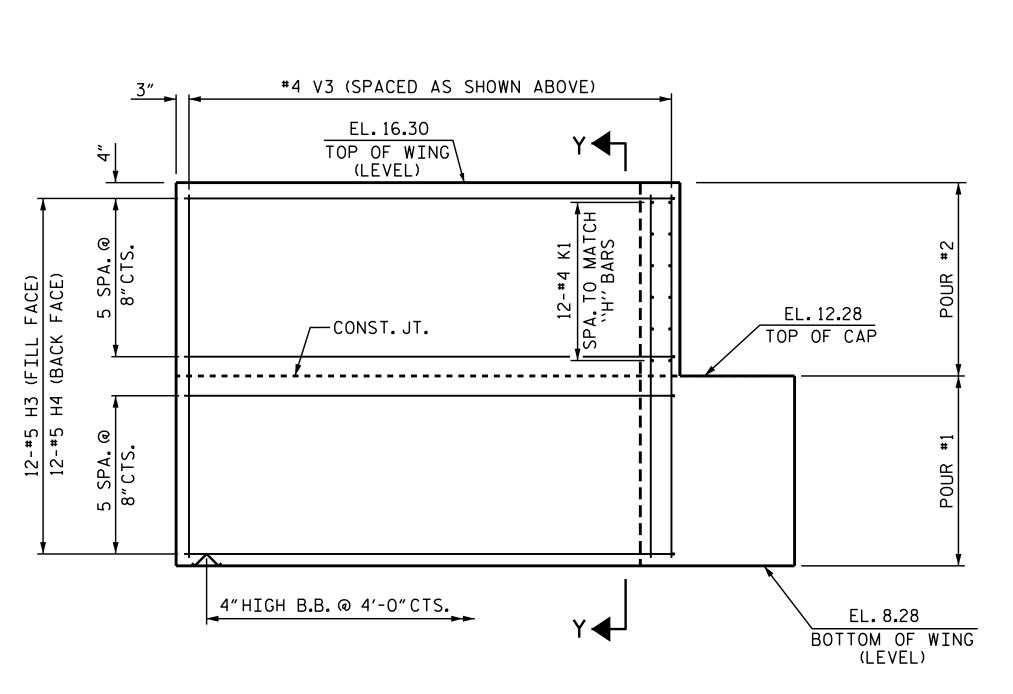

FILL FACE —

13′-0³/₁₆"

PLAN OF WING W2

10-#4 V3 @ 1'-0"CTS.

(EACH FACE)

10'-4"

ELEVATION OF WING W2

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 369+42.00 -L-

2′-83/16″

SEAL 26445

Docusigned by:

P. Korey Newton

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

SUBSTRUCTURE
INTEGRAL
END BENT 1
(EBL)

SHEET 2 OF 3

DRAWN BY: O.T.NGUYEN

CHECKED BY: M.K.BEARD

DATE: 5/17/18

DESIGN ENGINEER OF RECORD: A.K.PATEL


DATE: 1/10/19


EL.8.28

BOTTOM OF WING (LEVEL)

ELEVATION OF WING W1

4"HIGH B.B. @ 4'-0"CTS.

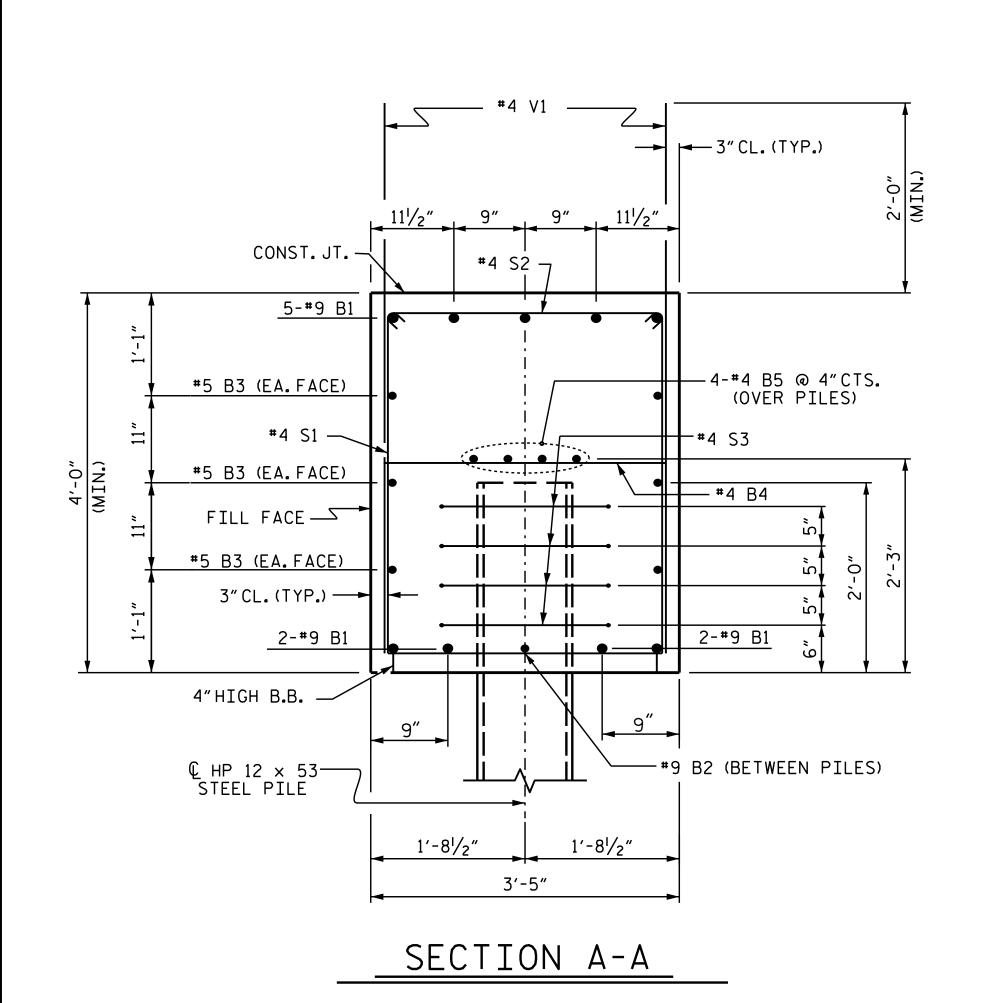

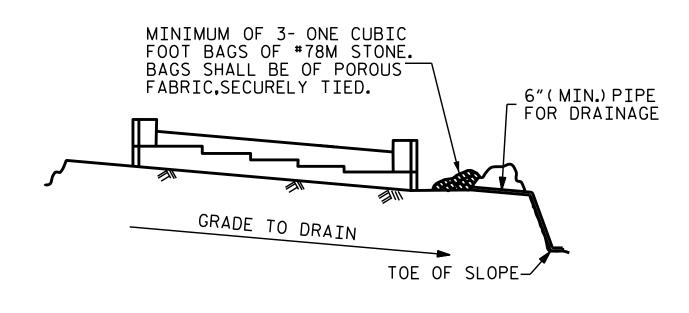



BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL, CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.

BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETER-MINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.


NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

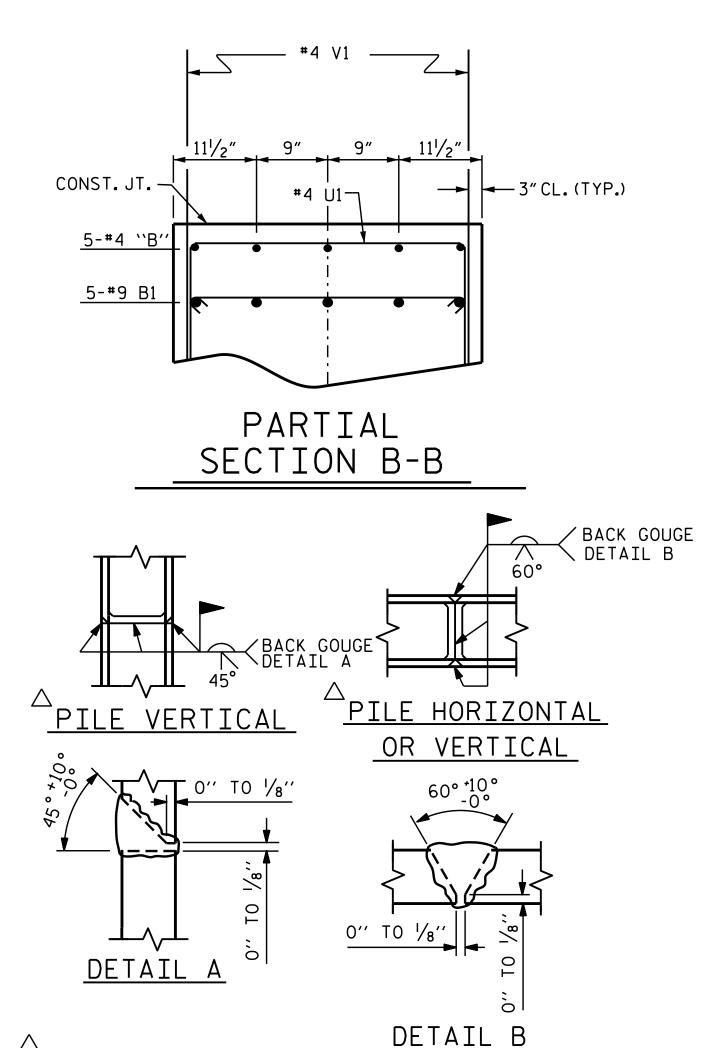

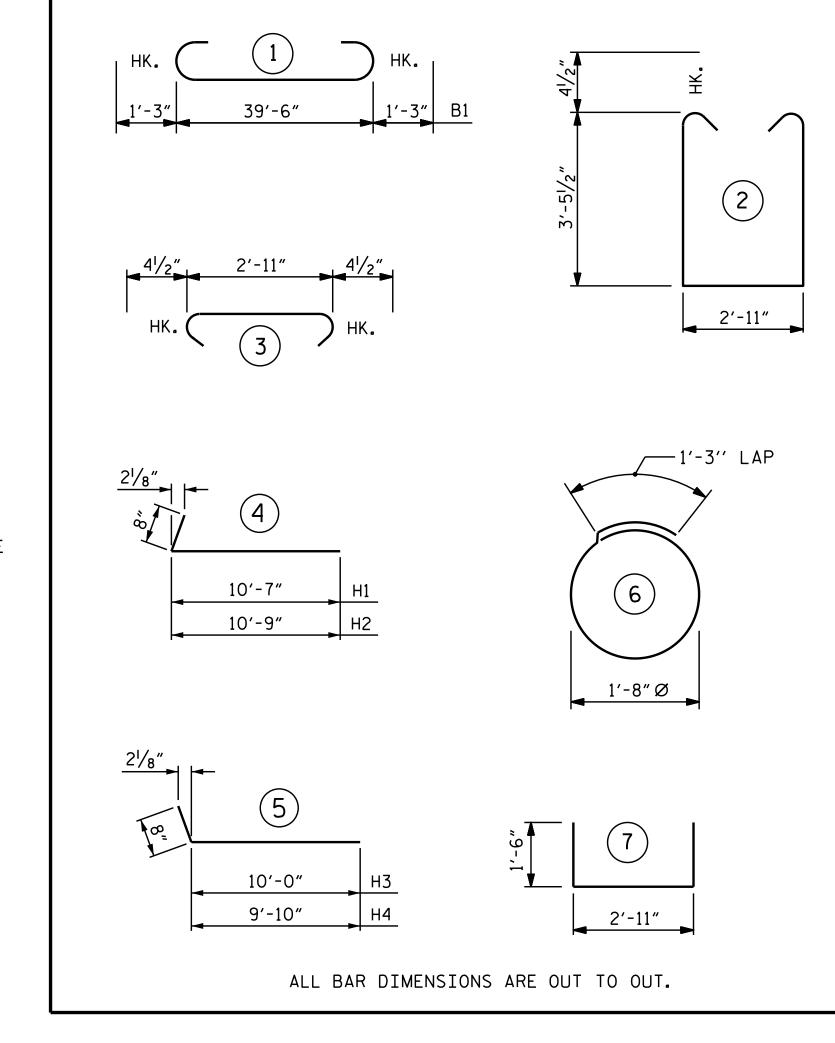

BAR TYPES

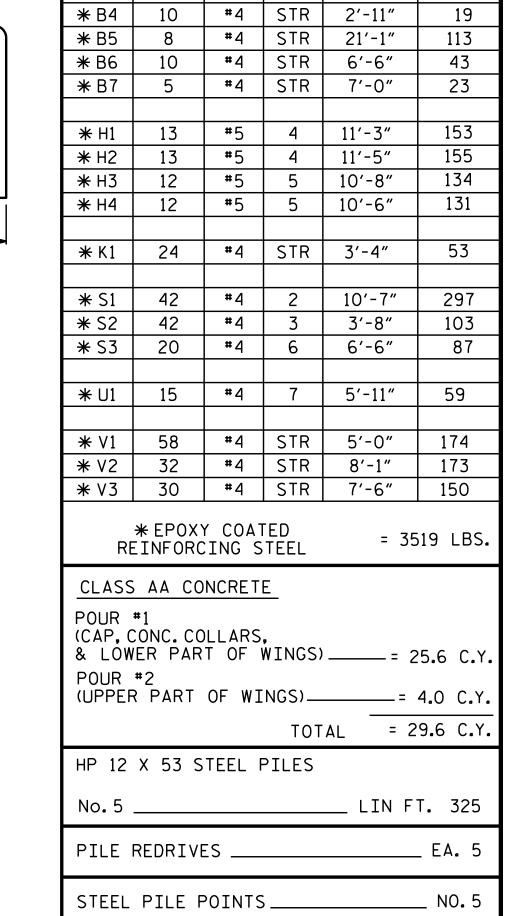

OF MATERIAL

NO. | SIZE | TYPE | LENGTH | WEIGHT

STR

#5 | STR | 39'-8"


42'-0"

119


248

PILE SPLICE DETAILS

POSITION OF PILE DURING WELDING.

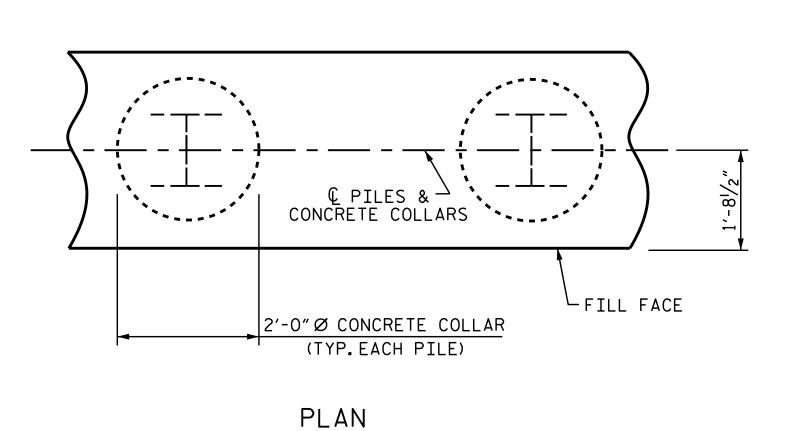

CORROSION PROTECTION FOR STEEL PILES DETAIL

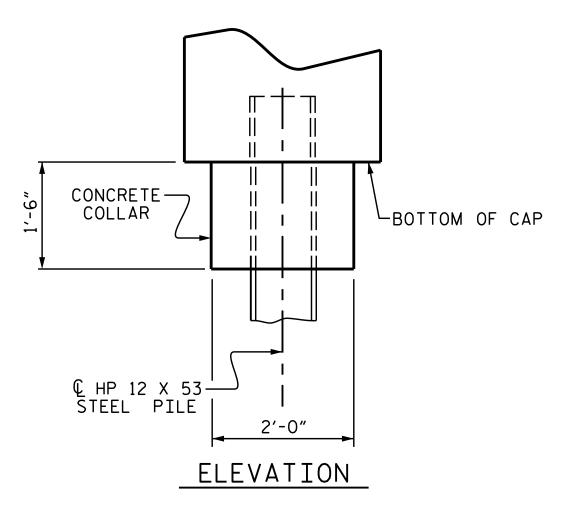

PROJECT NO. R-5021 BRUNSWICK COUNTY 369+42.00 -L-STATION:_

SHEET 3 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

> SUBSTRUCTURE INTEGRAL END BENT 1 (EBL)

1/20/2019 **REVISIONS** SHEET NO. S2-29 DATE: DATE: TOTAL SHEETS


Q. T. NGUYEN _ DATE : <u>5/17/18</u> DRAWN BY : . M.K.BEARD _ DATE : <u>8/18</u> CHECKED BY : . DESIGN ENGINEER OF RECORD: A.K. PATEL __ DATE : 1/10/19

20-JAN-2019 22:06 Z:\Structures\Plans\Str2\R-5021_SMU_ 02_E_090024.dgn


26445 O MOINEER P. Korey Newton


DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

STR. #2

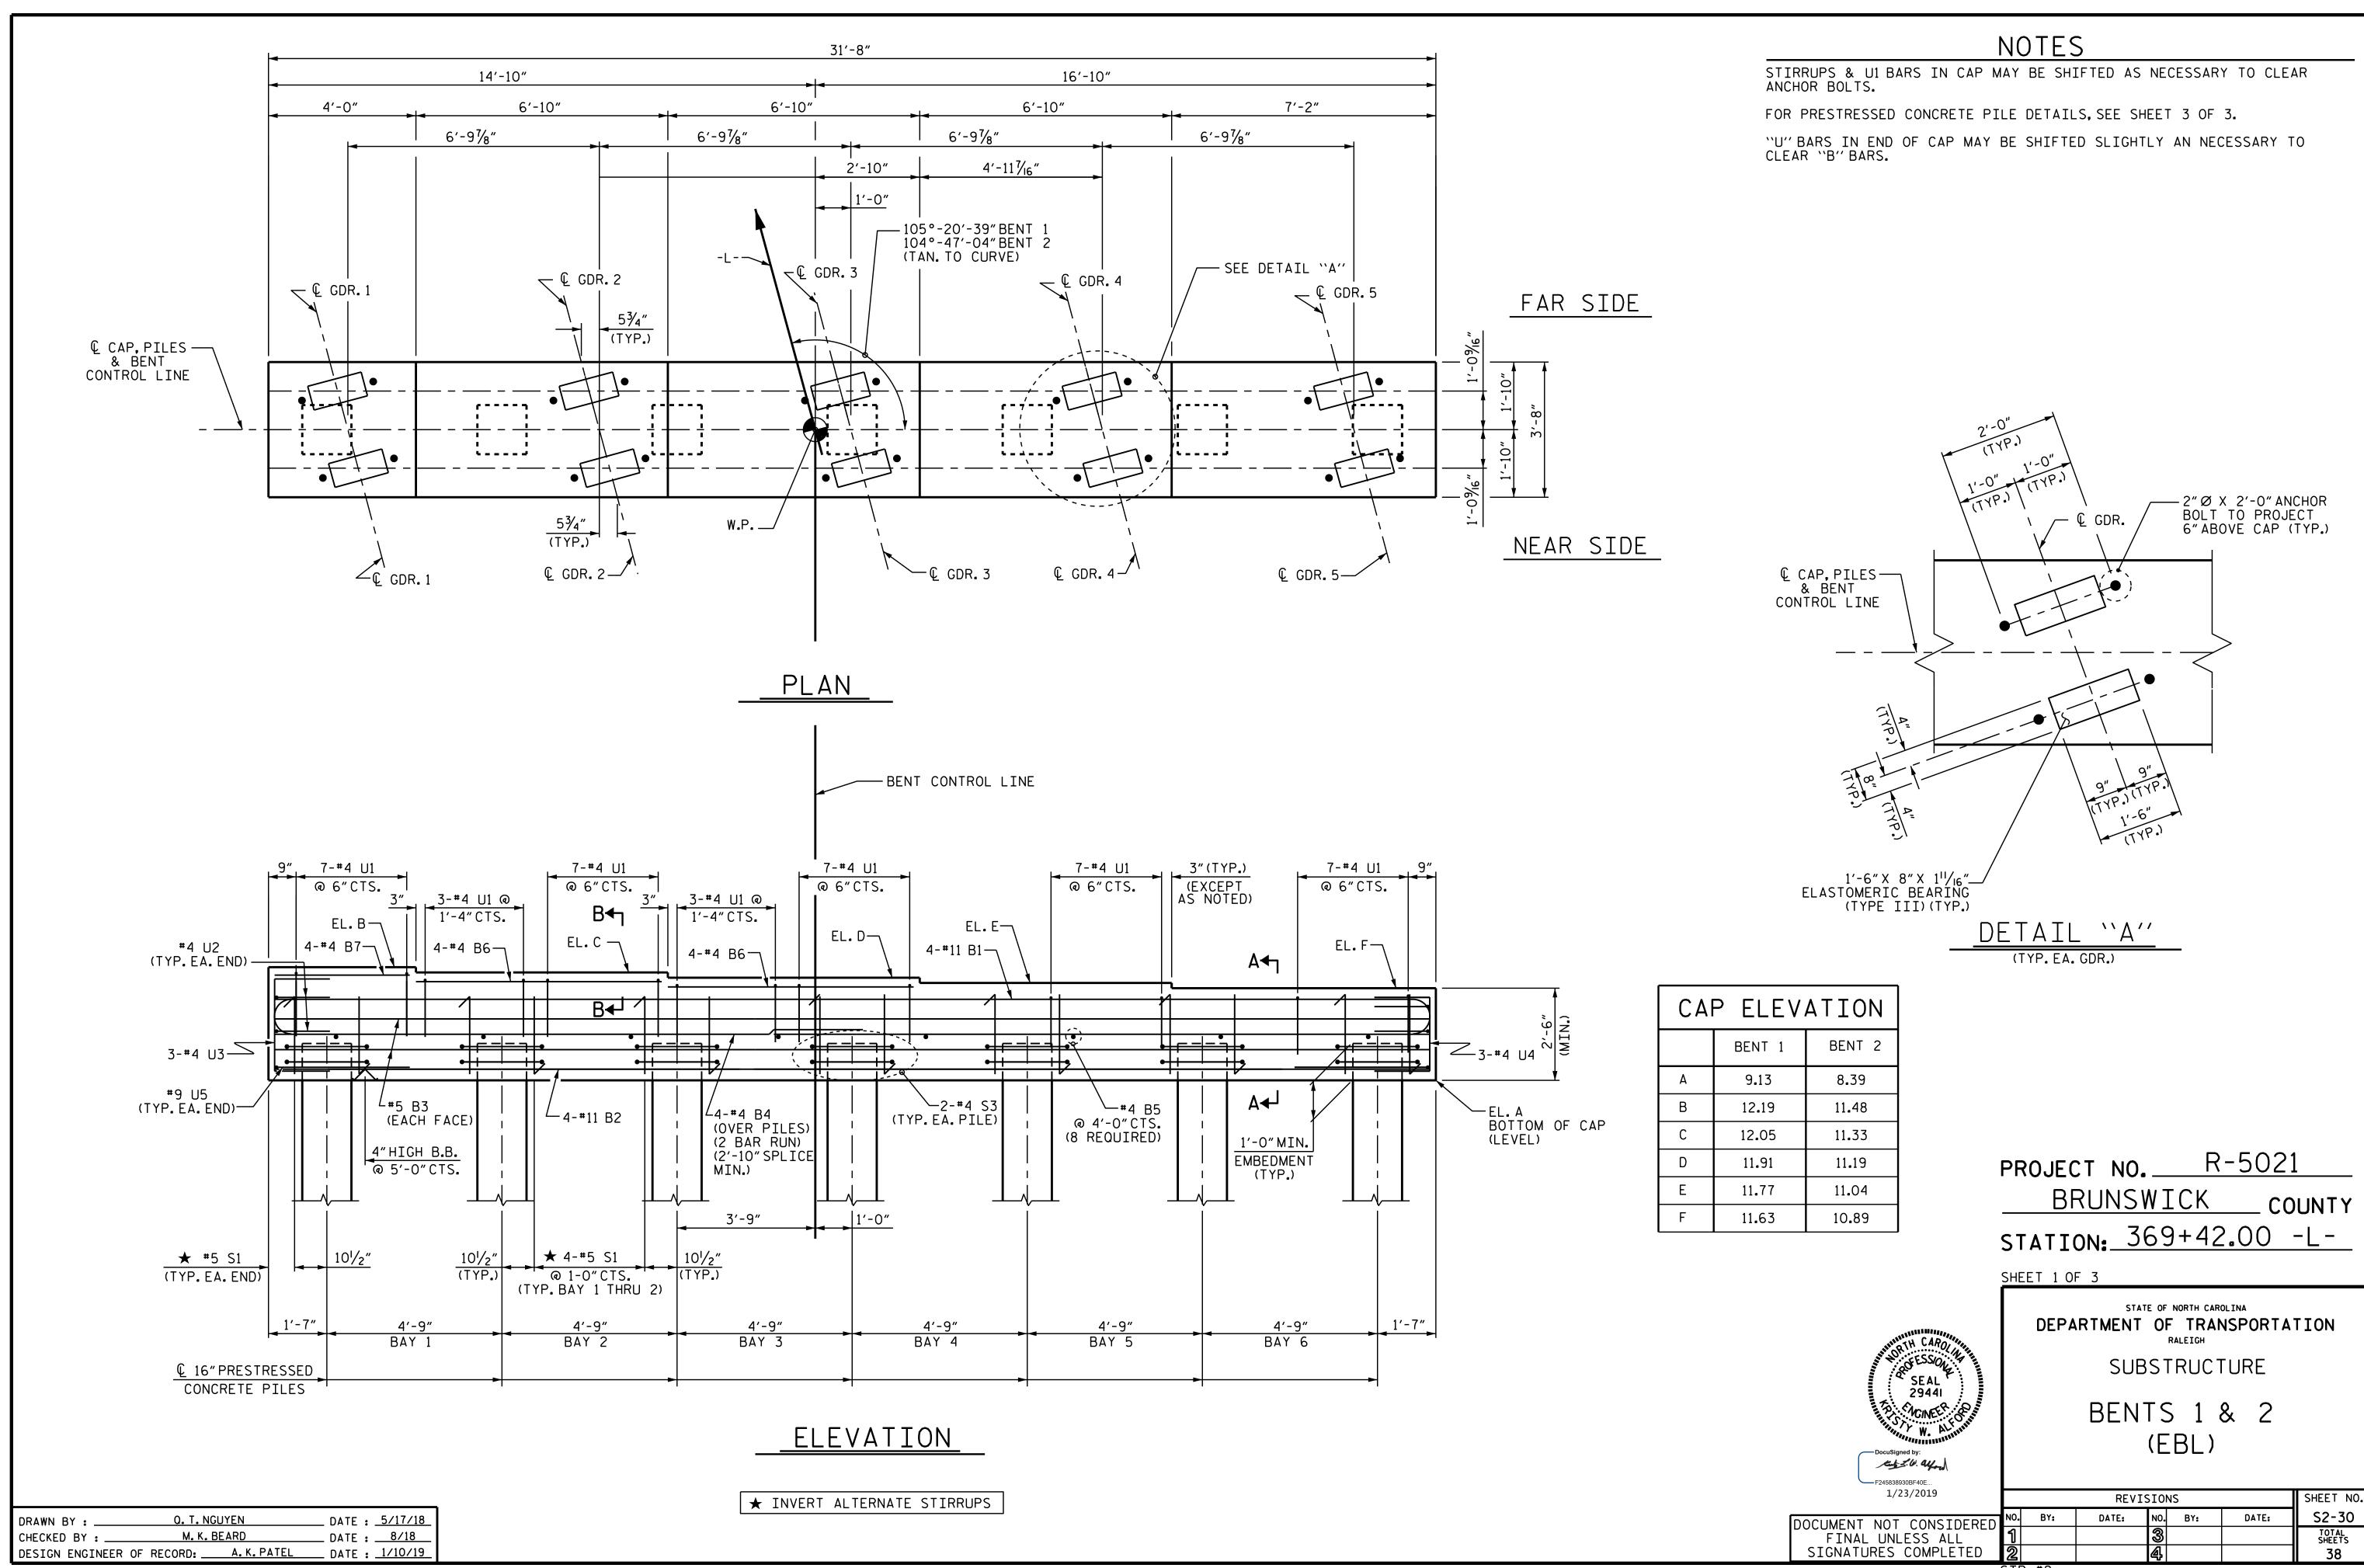


23-JAN-2019 13:03
Z:\Structures\Plans\Str2\R-5021_SMU_02_B_090024.dgn
kalford

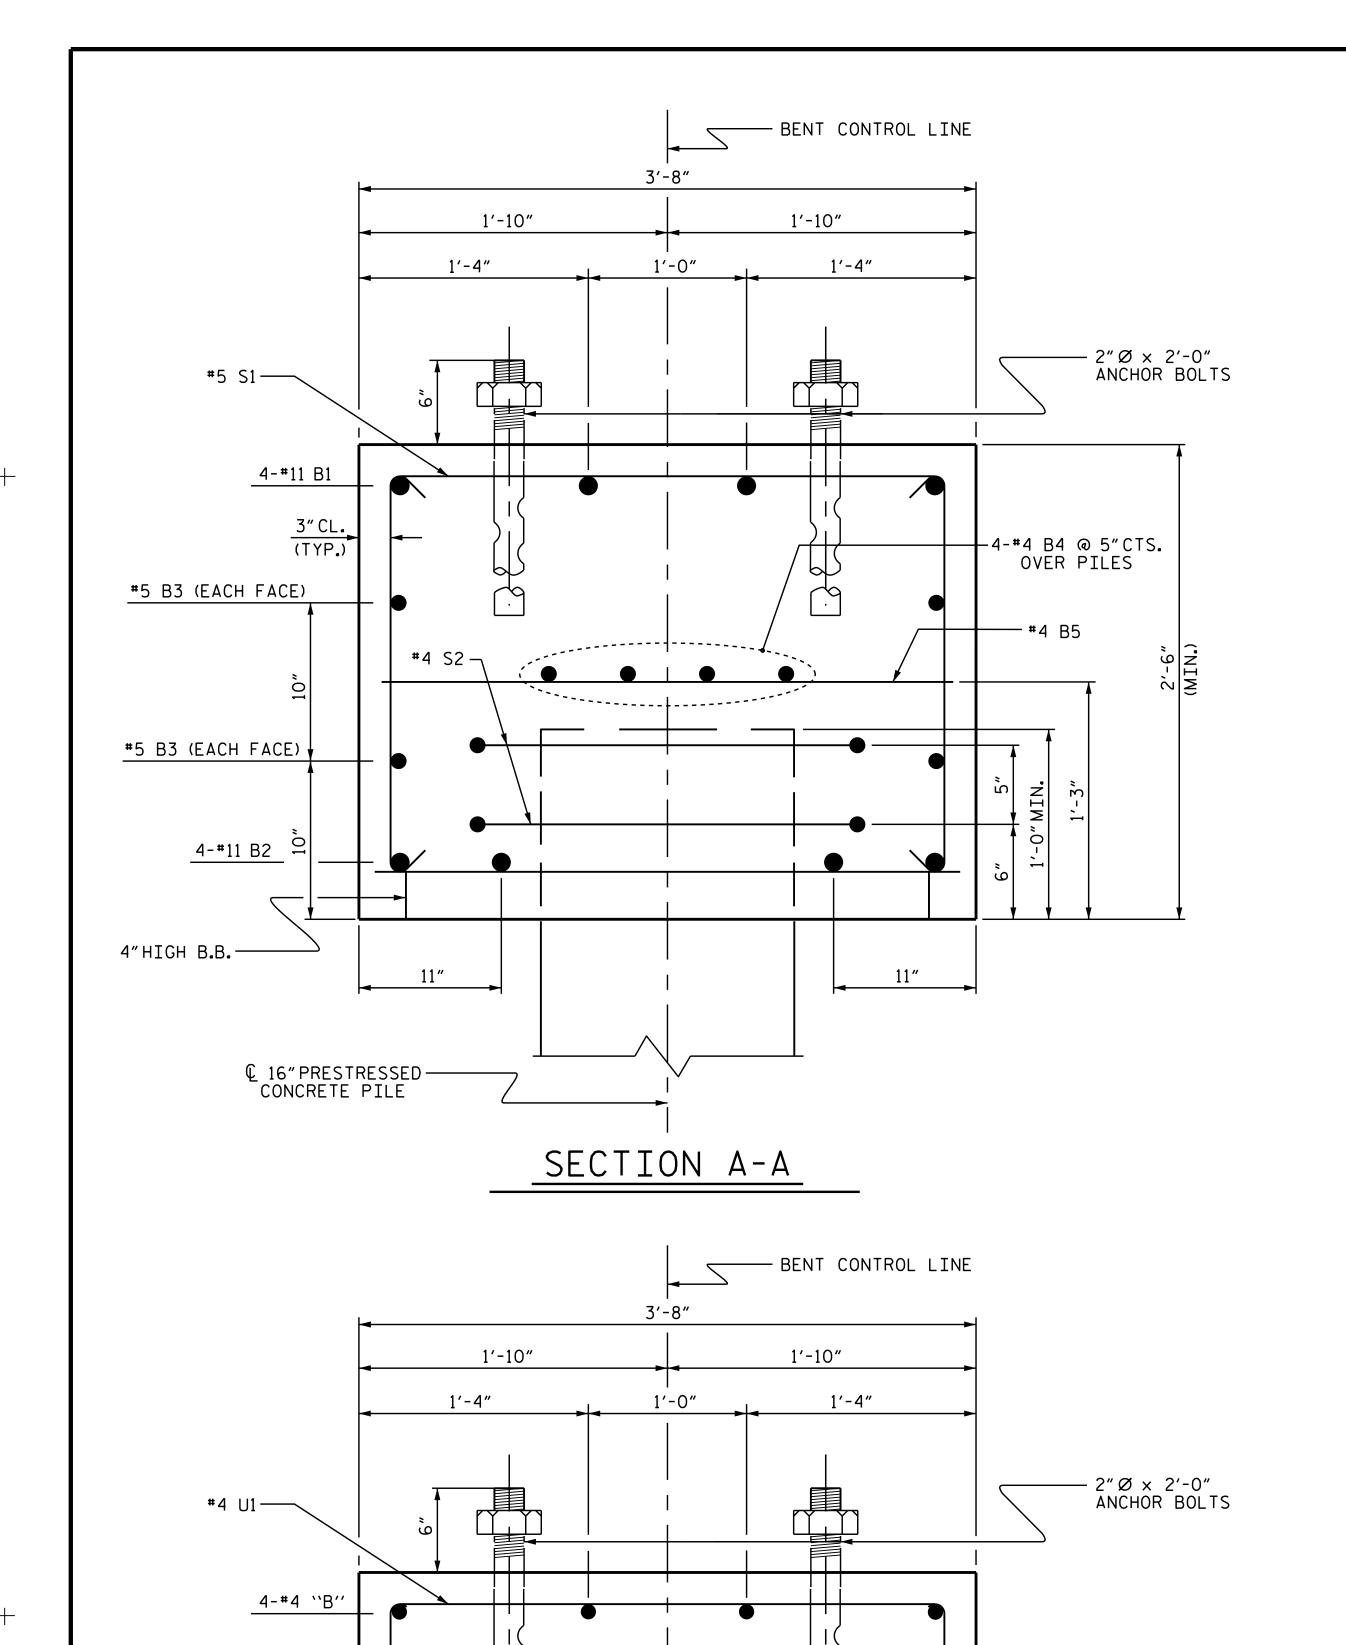

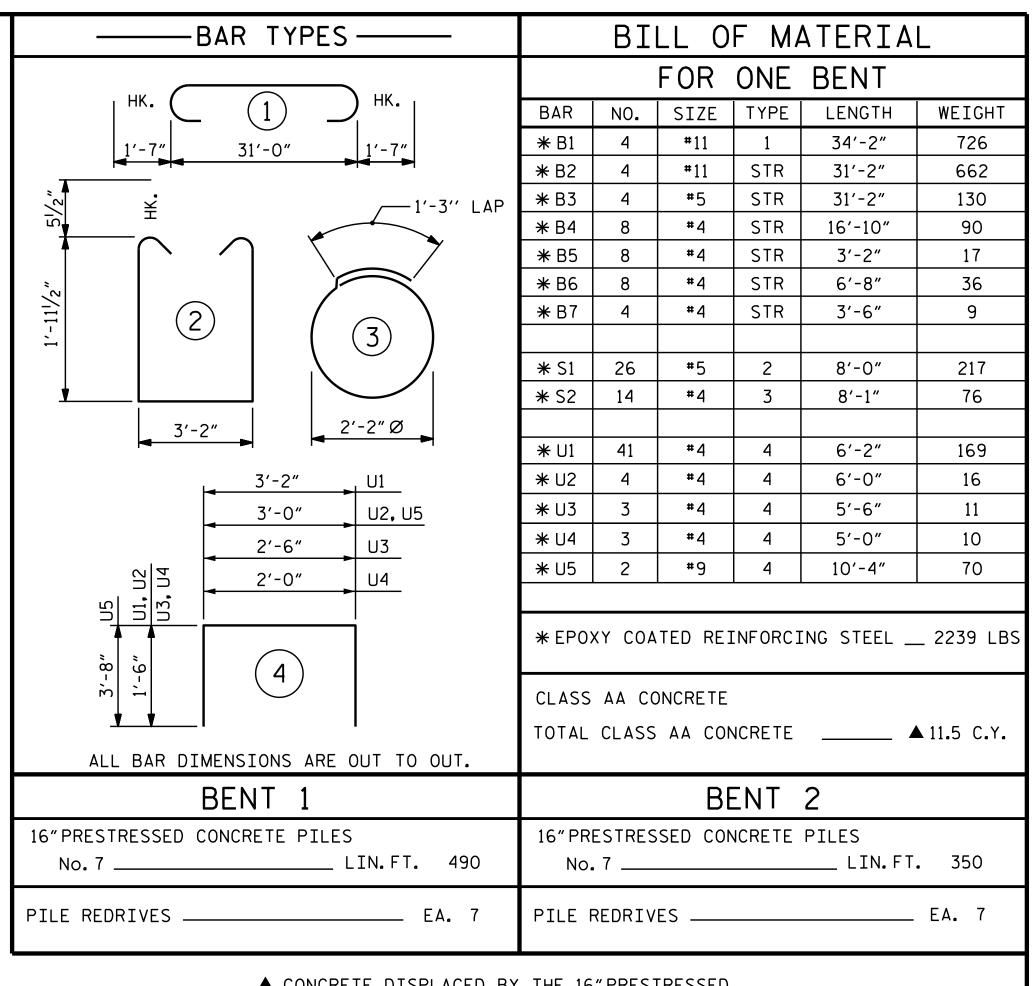

▲ CONCRETE DISPLACED BY THE 16"PRESTRESSED CONCRETE PILES HAS BEEN DEDUCTED FROM THE CONCRETE QUANTITY.

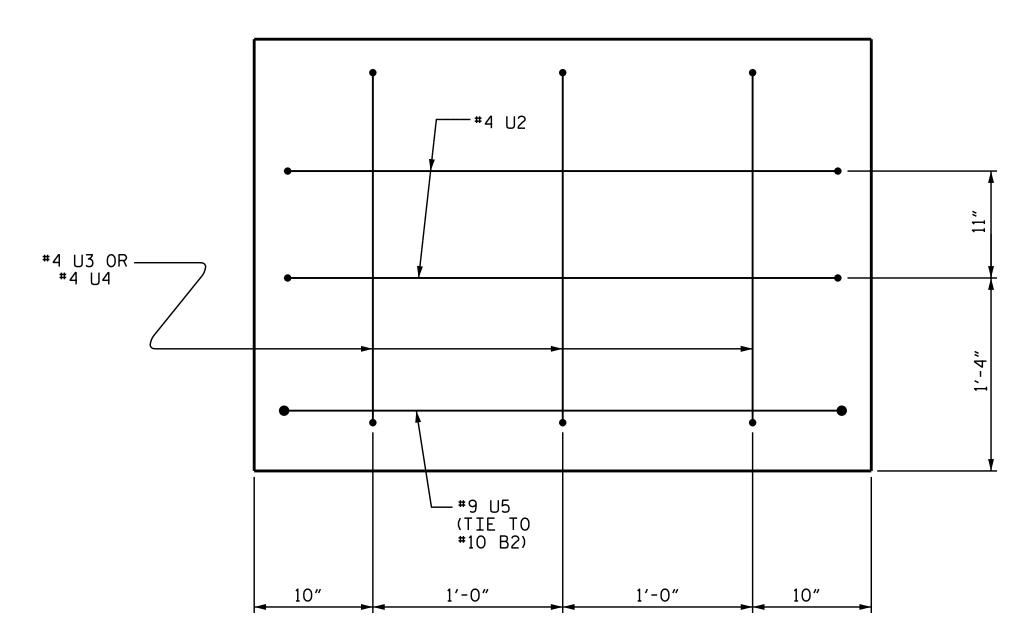

END OF CAP VIEW

R-5021 PROJECT NO.____ BRUNSWICK __ COUNTY STATION: 369+42.00 -L-

SHEET 2 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUBSTRUCTURE

BENTS 1 & 2 (EBL)

4FFE39D1431B407... 1/20/2019 SHEET NO. REVISIONS S2-31 DATE: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

_ DATE : <u>5/17/18</u> Q. T. NGUYEN DRAWN BY : M.K.BEARD __ DATE : <u>8/18</u> CHECKED BY : _ DESIGN ENGINEER OF RECORD: A.K.PATEL DATE: 1/10/19


#5 S1---

4-#11 B1

P. Korey Newton

SECTION B-B

3" CL. (TYP.)

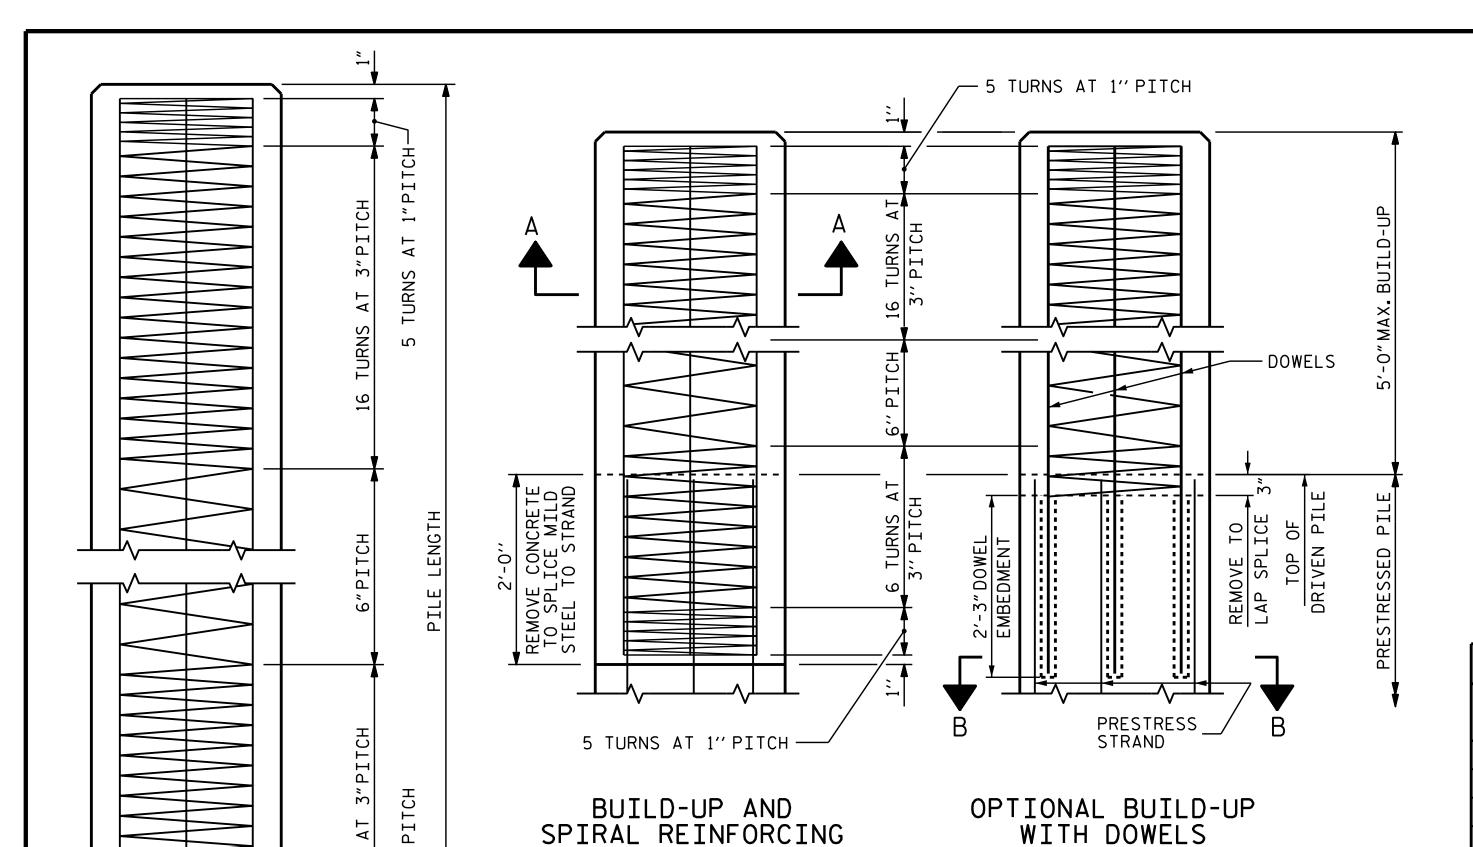

ONE POINT PICK - UP TWO POINT PICK - UP PICK - UP POINTS

QUANTITIES FOR ONE 16"PRESTRESSED PILE						
	CONCRETE	PILE WT.	ONE POINT PICK-UP		TWO POIN	T PICK-UP
LENGTH	CU. YDS.	TONS	0.300L	0.700L	0.207L	0.586L
25′-0″	1.63	3. 31	7′-6″	17′-6″	5′-2″	14'-8"
30′-0″	1.96	3 . 97	9′-0″	21'-0"	6′-2 ^l / ₂ "	17'-7"
35′-0"	2.29	4.63	10'-6"	24′-6″	7′-3″	20′-6″
40'-0"	2.61	5.29	12'-0"	28'-0"	8'-3 ¹ / ₂ "	23′-5″
45'-0"	2.94	5.95	13′-6″	31'-6"	9′-4″	26'-4"
50′-0″	3.27	6.61	15′-0″	35′-0"	10'-4"	29'-4"
55′-0"	3.59	7.28	16′-6″	38′-6″	11'-41/2"	32′-3″
60′-0″	3.92	7.94			12′-5″	35′-2″
65′-0″	4.25	8.60			13′-51/2″	38'-1"
70′-0″	4 . 57	9.26			14'-6"	41'-0"
75′-0"	4.90	9.92			15′-61/2″	43′-11″
80'-0"	5.23	10.58			16′-7″	46′-10″

OR W 8 X 35

ELEVATION - W4.O COLD DRAWN STEEL WIRE SPIRAL HP 8 \times 36 \longrightarrow OR W 8 X 35 - PRESTRESSING STRANDS SECTION B-B

PILE TIP DETAILS FOR 16" SQUARE PRESTRESSED CONCRETE PILE

ASSEMBLED BY : QTN DATE : 1/19 CHECKED BY : PKN DATE : 1/19 MAA/GM REV. 10/1/11 DRAWN BY: RH 9/98 CHECKED BY: LES 10/98 REV. 12/14 REV. 12/17 MAA/TM(

CORROSION PROTECTION

PILES SHALL NOT EXCEED 0.40.

THE WATER/CEMENT RATIO FOR PRESTRESSED CONCRETE

ALL BAR SUPPORTS USED IN THE PRESTRESSED CONCRETE PILES, AND ALL INCIDENTAL REINFORCING STEEL SHALL

BE EPOXY COATED IN ACCORDANCE WITH THE STANDARD

PRESTRESSED CONCRETE PILES SHALL CONTAIN CALCIUM NITRITE CORROSION INHIBITOR IN ACCORDANCE WITH

THE STANDARD SPECIFICATIONS. THE CONCRETE IN THE

PRESTRESSED CONCRETE PILES SHALL CONTAIN SILICA FUME. SILICA FUME SHALL BE SUBSTITUTED FOR 5%

OF THE PORTLAND CEMENT BY WEIGHT. IF THE OPTION

OF ARTICLE 1024-1 OF THE STANDARD SPECIFICATIONS

TO PARTIALLY SUBSTITUTE CLASS F FLY ASH FOR

FOR THIS SUBSTITUTION AS IT IS CONSIDERED

INCIDENTAL TO THE VARIOUS PAY ITEMS.

PORTLAND CEMENT IS EXERCISED, THEN THE RATE OF

FLY ASH SUBSTITUTION SHALL BE REDUCED TO 1.0 LB OF FLY ASH PER 1.0 LB. NO PAYMENT WILL BE MADE

16′′ □

ELEVATION


SPECIFICATIONS.

MAA/THO

SECTION "B-B" (AT THE CONTRACTOR'S OPTION, PILE BUILD-UP MAY BE CONSTRUCTED WITH DOWELS.)

11/2" Ø FIELD DRILLED HOLE (TYP.)W/ #8 DOWEL.

TYP.

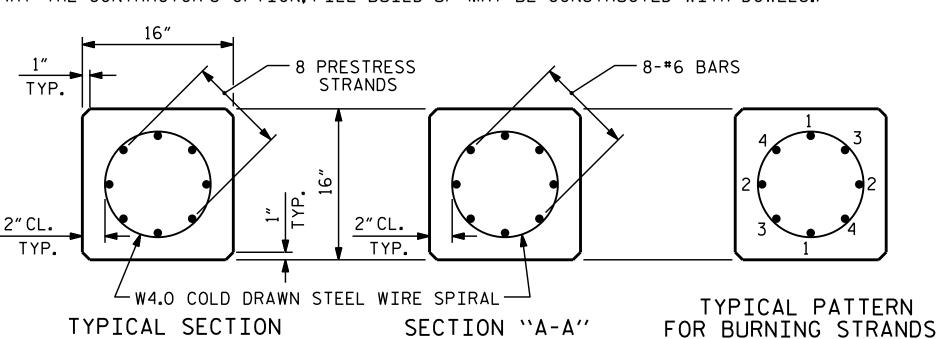


PRESTRESS STRAND (TYP.) -

2" CL.

TYP.

OR 0.6" Ø GRADE 270 L.R. PRESTRESS STRANDS

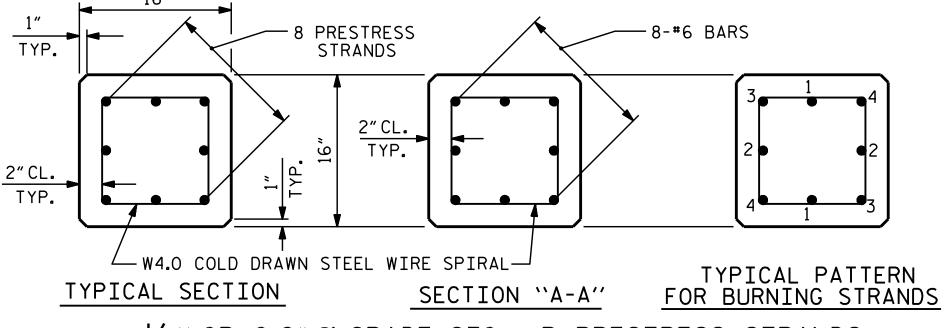

1/2" OR 0.6" Ø GRADE 270 L.R. PRESTRESS STRANDS

NOTES

PRESTRESSED CONCRETE STRENGTH : f'c = 7,500 PSI BUILD-UP CONCRETE STRENGTH : f'c = 7,500 PSI

STRAND DATA:

SIZE	GRADE	AREA	ULTIMATE STRENGTH	APPLIED PRESTRESS FORCE
1/2′′	270 L.R.	0.153	41,300# PER STRAND	30,980# PER STRAND
0.6"	270 L.R.	0.217	58,600# PER STRAND	43,940# PER STRAND

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS CONFORMING TO AASHTO M203. STRAND SAMPLING REQUIREMENTS SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

AT THE CONTRACTOR'S OPTION, $\frac{1}{2}$ " OR 0.6" STRANDS MAY BE USED IN EITHER STRAND CONFIGURATION SHOWN IN THE TYPICAL SECTION DETAIL. MIXING OF STRAND SIZE IS NOT ALLOWED.

THE SLIP-FORM METHOD OF CASTING PILES WILL NOT BE PERMITTED.

TRANSFER THE LOAD FROM THE ANCHORAGES TO THE PILE AFTER THE CONCRETE HAS ATTAINED A MINIMUM COMPRESSIVE STRENGTH OF 4,000 PSI.

IF STRAND STRESS IS RELIEVED BY BURNING, THE STRANDS SHALL BE BURNED IN OPPOSITE PAIRS AS INDICATED IN THE TYPICAL PATTERN SHOWN. FOR ANY NUMBER OF STRANDS, BURN IN OPPOSITE PAIRS AND SYMMETRICALLY ABOUT BOTH THE VERTICAL AND HORIZONTAL AXES.

STRANDS 1-1 SHALL BE BURNED BEFORE 2-2, ETC. NOT MORE THAN 4 STRANDS, SAY 3-3 AND 4-4, MAY BE BURNED AT ANY ONE SECTION BEFORE THESE SAME PAIRS OF STRANDS ARE BURNED AT BOTH ENDS OF THE BED AND BETWEEN EACH PAIR OF PILES IN THE BED.

PROPOSED DEVICES FOR LIFTING PILES, RECESS DETAILS, AND PATCHING MATERIAL SHALL BE DETAILED IN SHOP DRAWINGS. AFTER ATTACHMENTS HAVE BEEN REMOVED, OPENINGS SHALL BE REPAIRED SUCH THAT THE APPEARANCE OF THE PILE IS UNIFORM.

WHERE CAST-IN-PLACE LIFTING DEVICES ARE NOT USED, PICK-UP POINTS ARE TO BE INDICATED WITH A 2" WIDE BLACK MARK.

DRIVE PILES USING A METHOD APPROVED BY THE ENGINEER, WHEREBY THE HEAD OF THE PILE IS NOT DAMAGED.

DRIVING OF THE BUILT-UP PILE WILL NOT BE PERMITTED UNTIL THE CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF 5.000 PSI AND UNTIL A PERIOD OF SEVEN DAYS HAS ELAPSED SINCE CASTING OF THE BUILD-UP.

DOWEL INSTALLATION FOR OPTIONAL BUILD-UP

GROUT COMPRESSIVE STRENGTH: f'c= 5,000 PSI

BEFORE DRILLING DOWEL HOLES, REMOVE THE UPPER 3"OF CONCRETE FROM THE TOP OF THE PILE WITHOUT DAMAGE TO THE REINFORCING STEEL. THE REMOVAL PLANE SHOULD BE NORMAL TO THE EDGE OF THE PILE.

DOWEL HOLES SHALL BE POSITIONED TO MAINTAIN 1/2" CLEAR TO ALL EXISTING PRESTRESSING STRANDS IN THE CONCRETÉ PILE.

FIELD DRILLED HOLES SHALL BE CLEAN AND FREE OF ANY OBSTRUCTIONS BEFORE GROUTING OF DOWELS. DOWEL BARS SHALL BE INSTALLED AND GROUTED WITH AN APPROVED NON-SHRINK GROUT.

THE SPIRAL REINFORCING IN ALL BUILD-UPS SHALL BE W4.0 COLD DRAWN WIRE WHICH SHALL BE SECURED TO THE LONGITUDINAL REINFORCEMENT TO MAINTAIN PITCH.

THE SPIRAL REINFORCING IN THE BUILD-UP AND THE PRESTRESSED CONCRETE PILE SHALL BE SPLICED BY OVERLAPPING A MIN. OF ONE TURN.

> R-5021 PROJECT NO. ___ BRUNSWICK COUNTY STATION: 369+42.00 -L-

SHEET 3 OF 3

STR. #2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

STANDARD

16" PRESTRESSED CONCRETE PILE (EBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

29441


P. MICINEER

tup I. W. ayou

1/23/2019

245838930BF40F

SHEET NO REVISIONS S2-32 DATE: DATE: BY:

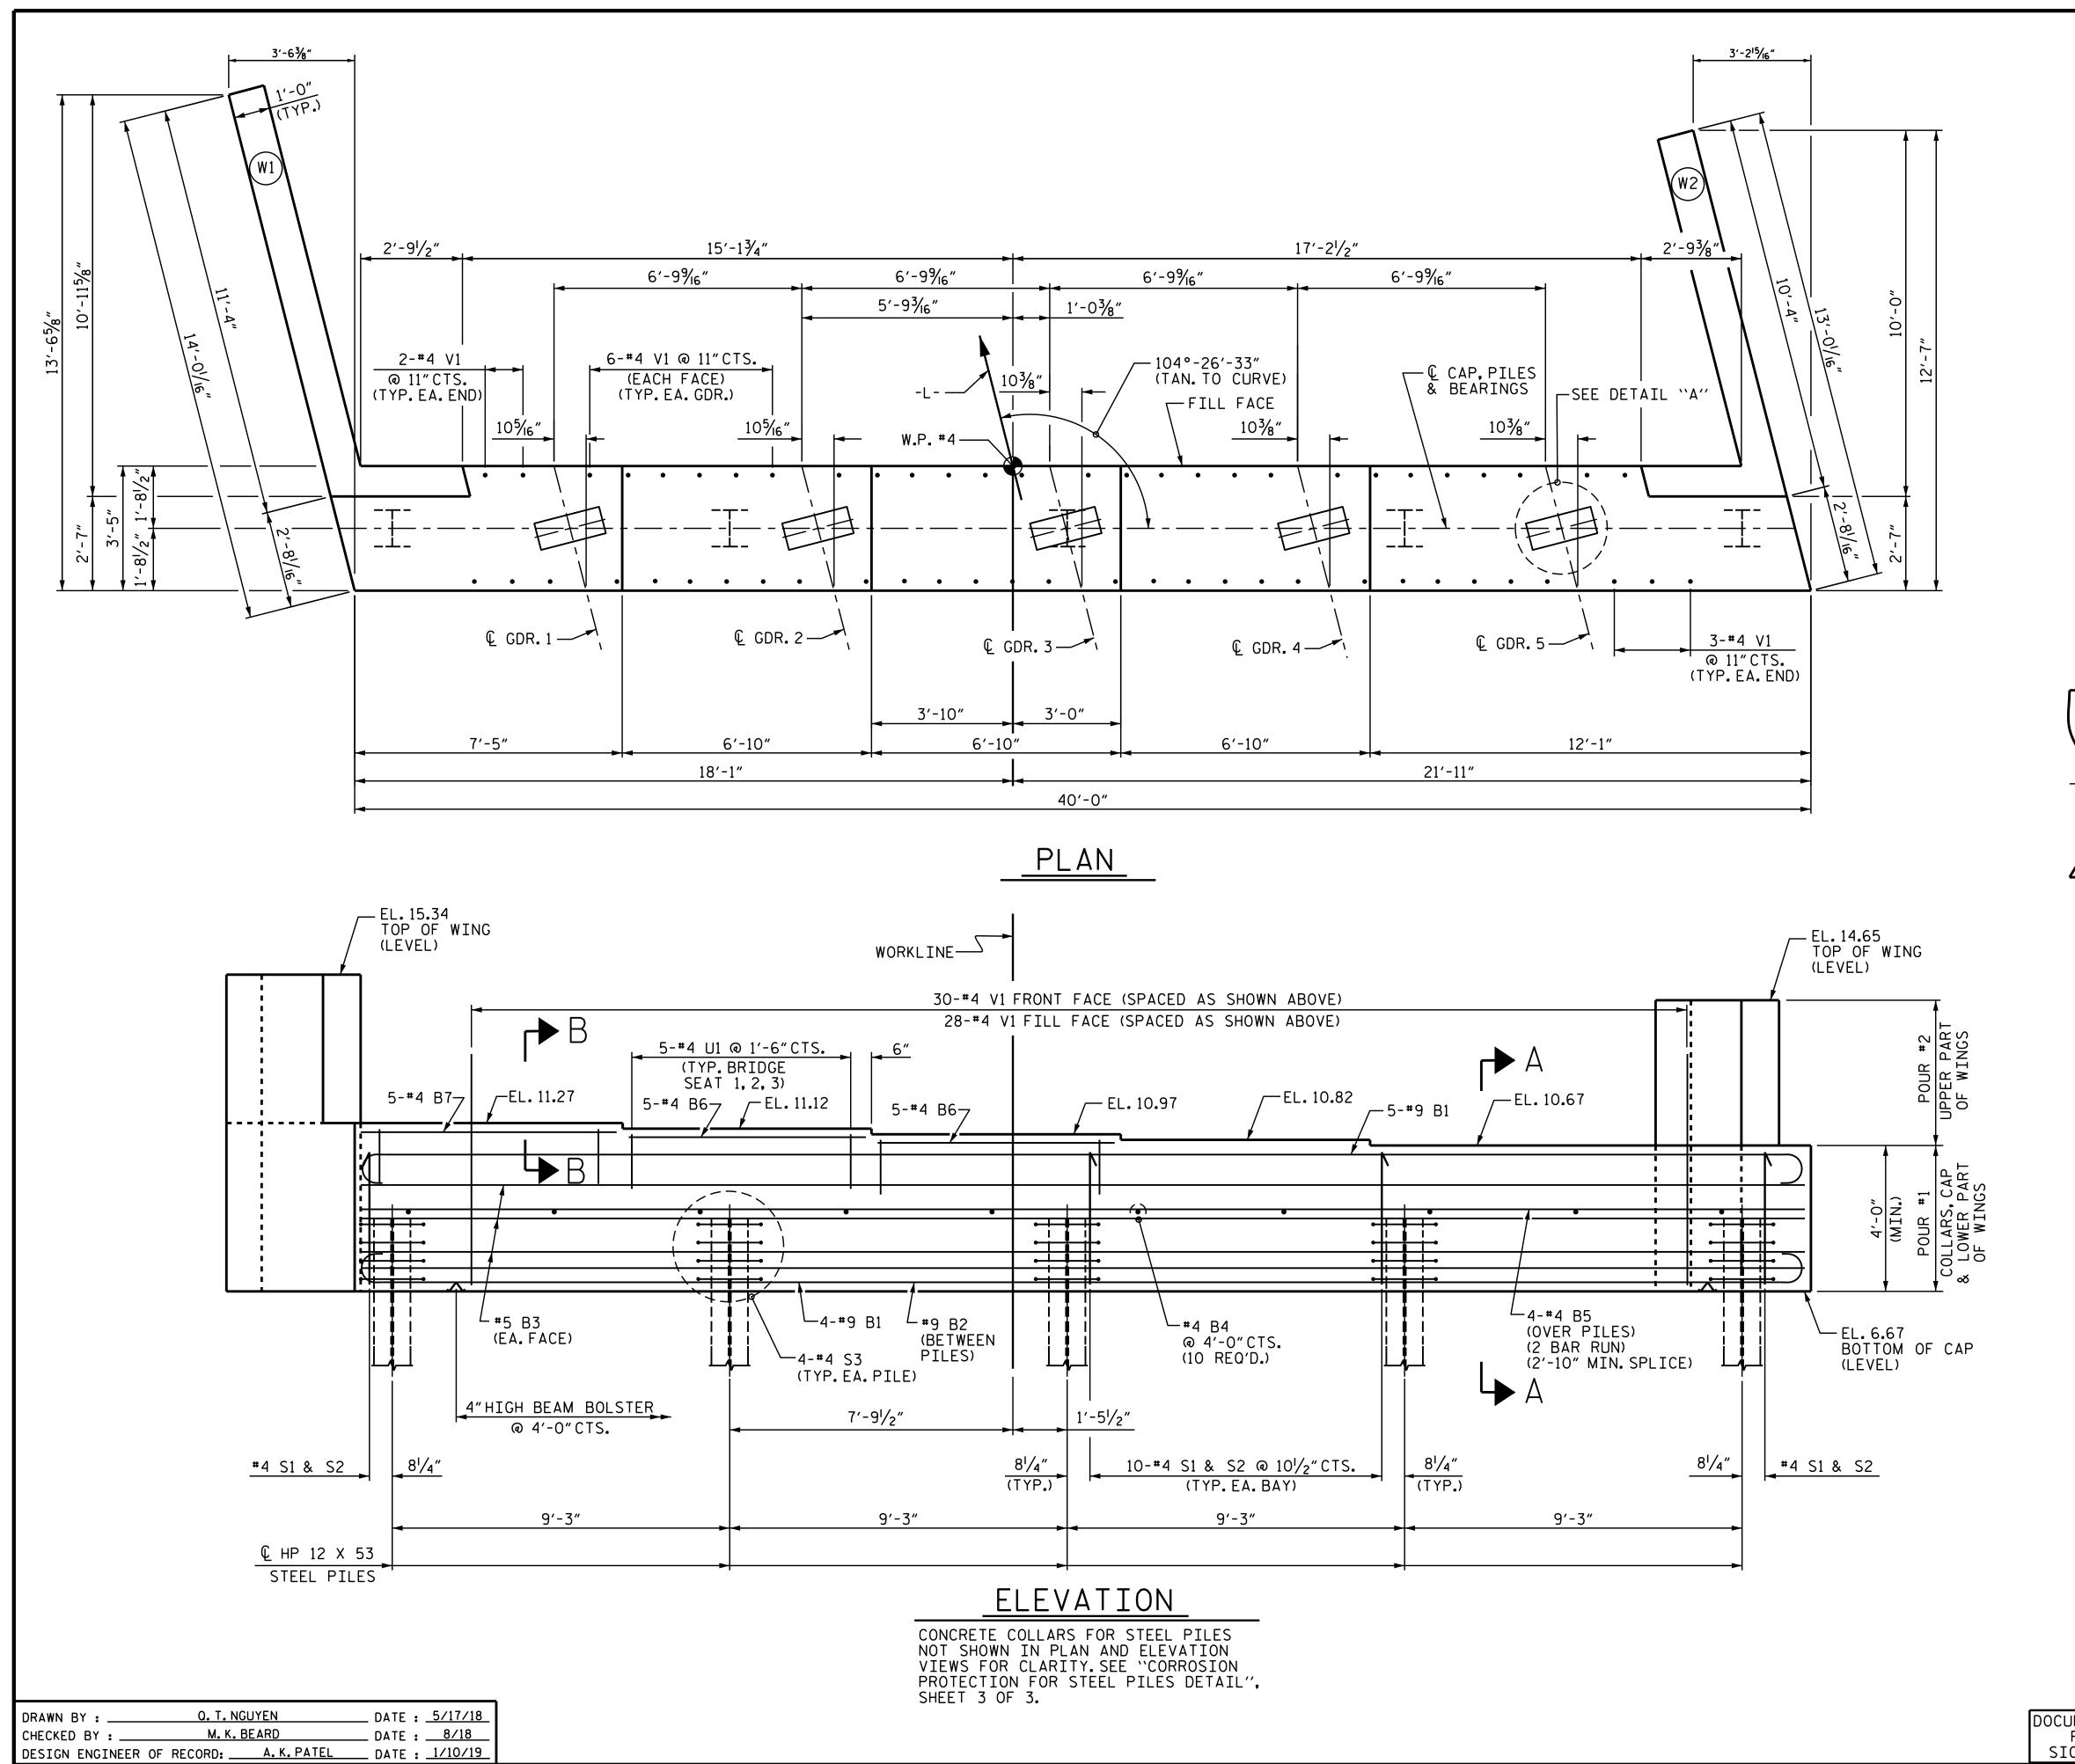

NOTES


STIRRUPS IN CAP MAY BE SHIFTED AS NECESSARY TO CLEAR #4 V1 BARS.

THE TOP SURFACE OF THE END BENT CAP, EXCEPT THE BEARING AREA, SHALL BE RAKED TO A DEPTH OF 1/4".

AFTER DRIVING THE PILES APPLY 1 COAT EACH OF 1080-09 BROWN AND 1080-09 GRAY PAINT TO THE EMBEDDED SECTION OF THE METALLIZED PILE PRIOR TO CONCRETE EMBEDMENT IN ACCORDANCE WITH SECTION 442 OF THE STANDARD SPECIFICATIONS.

PRIOR TO BEGINNING METALLIZATION THE CONTRACTOR WILL PROVIDE METALLIZED SAMPLES TO THE ENGINEER FOR APPROVAL.

METALIZE PILES IN ACCORDANCE WITH TABLE 2 OF THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM. FOR THERMAL SPRAYED COATINGS, SEE SPECIAL PROVISIONS.

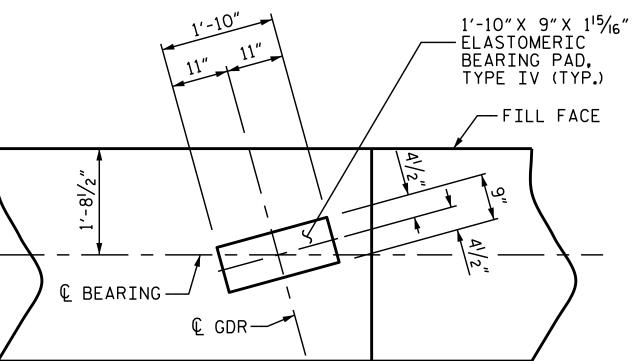

R-5021 PROJECT NO. ____ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 1 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

SUBSTRUCTURE

INTEGRAL END BENT 2 (EBL)

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED


SEAL 29441

TO CHOINEEP


the 2.0. ayou


1/23/2019 SHEET NO. REVISIONS S2-33 DATE: TOTAL SHEETS

STR.#2

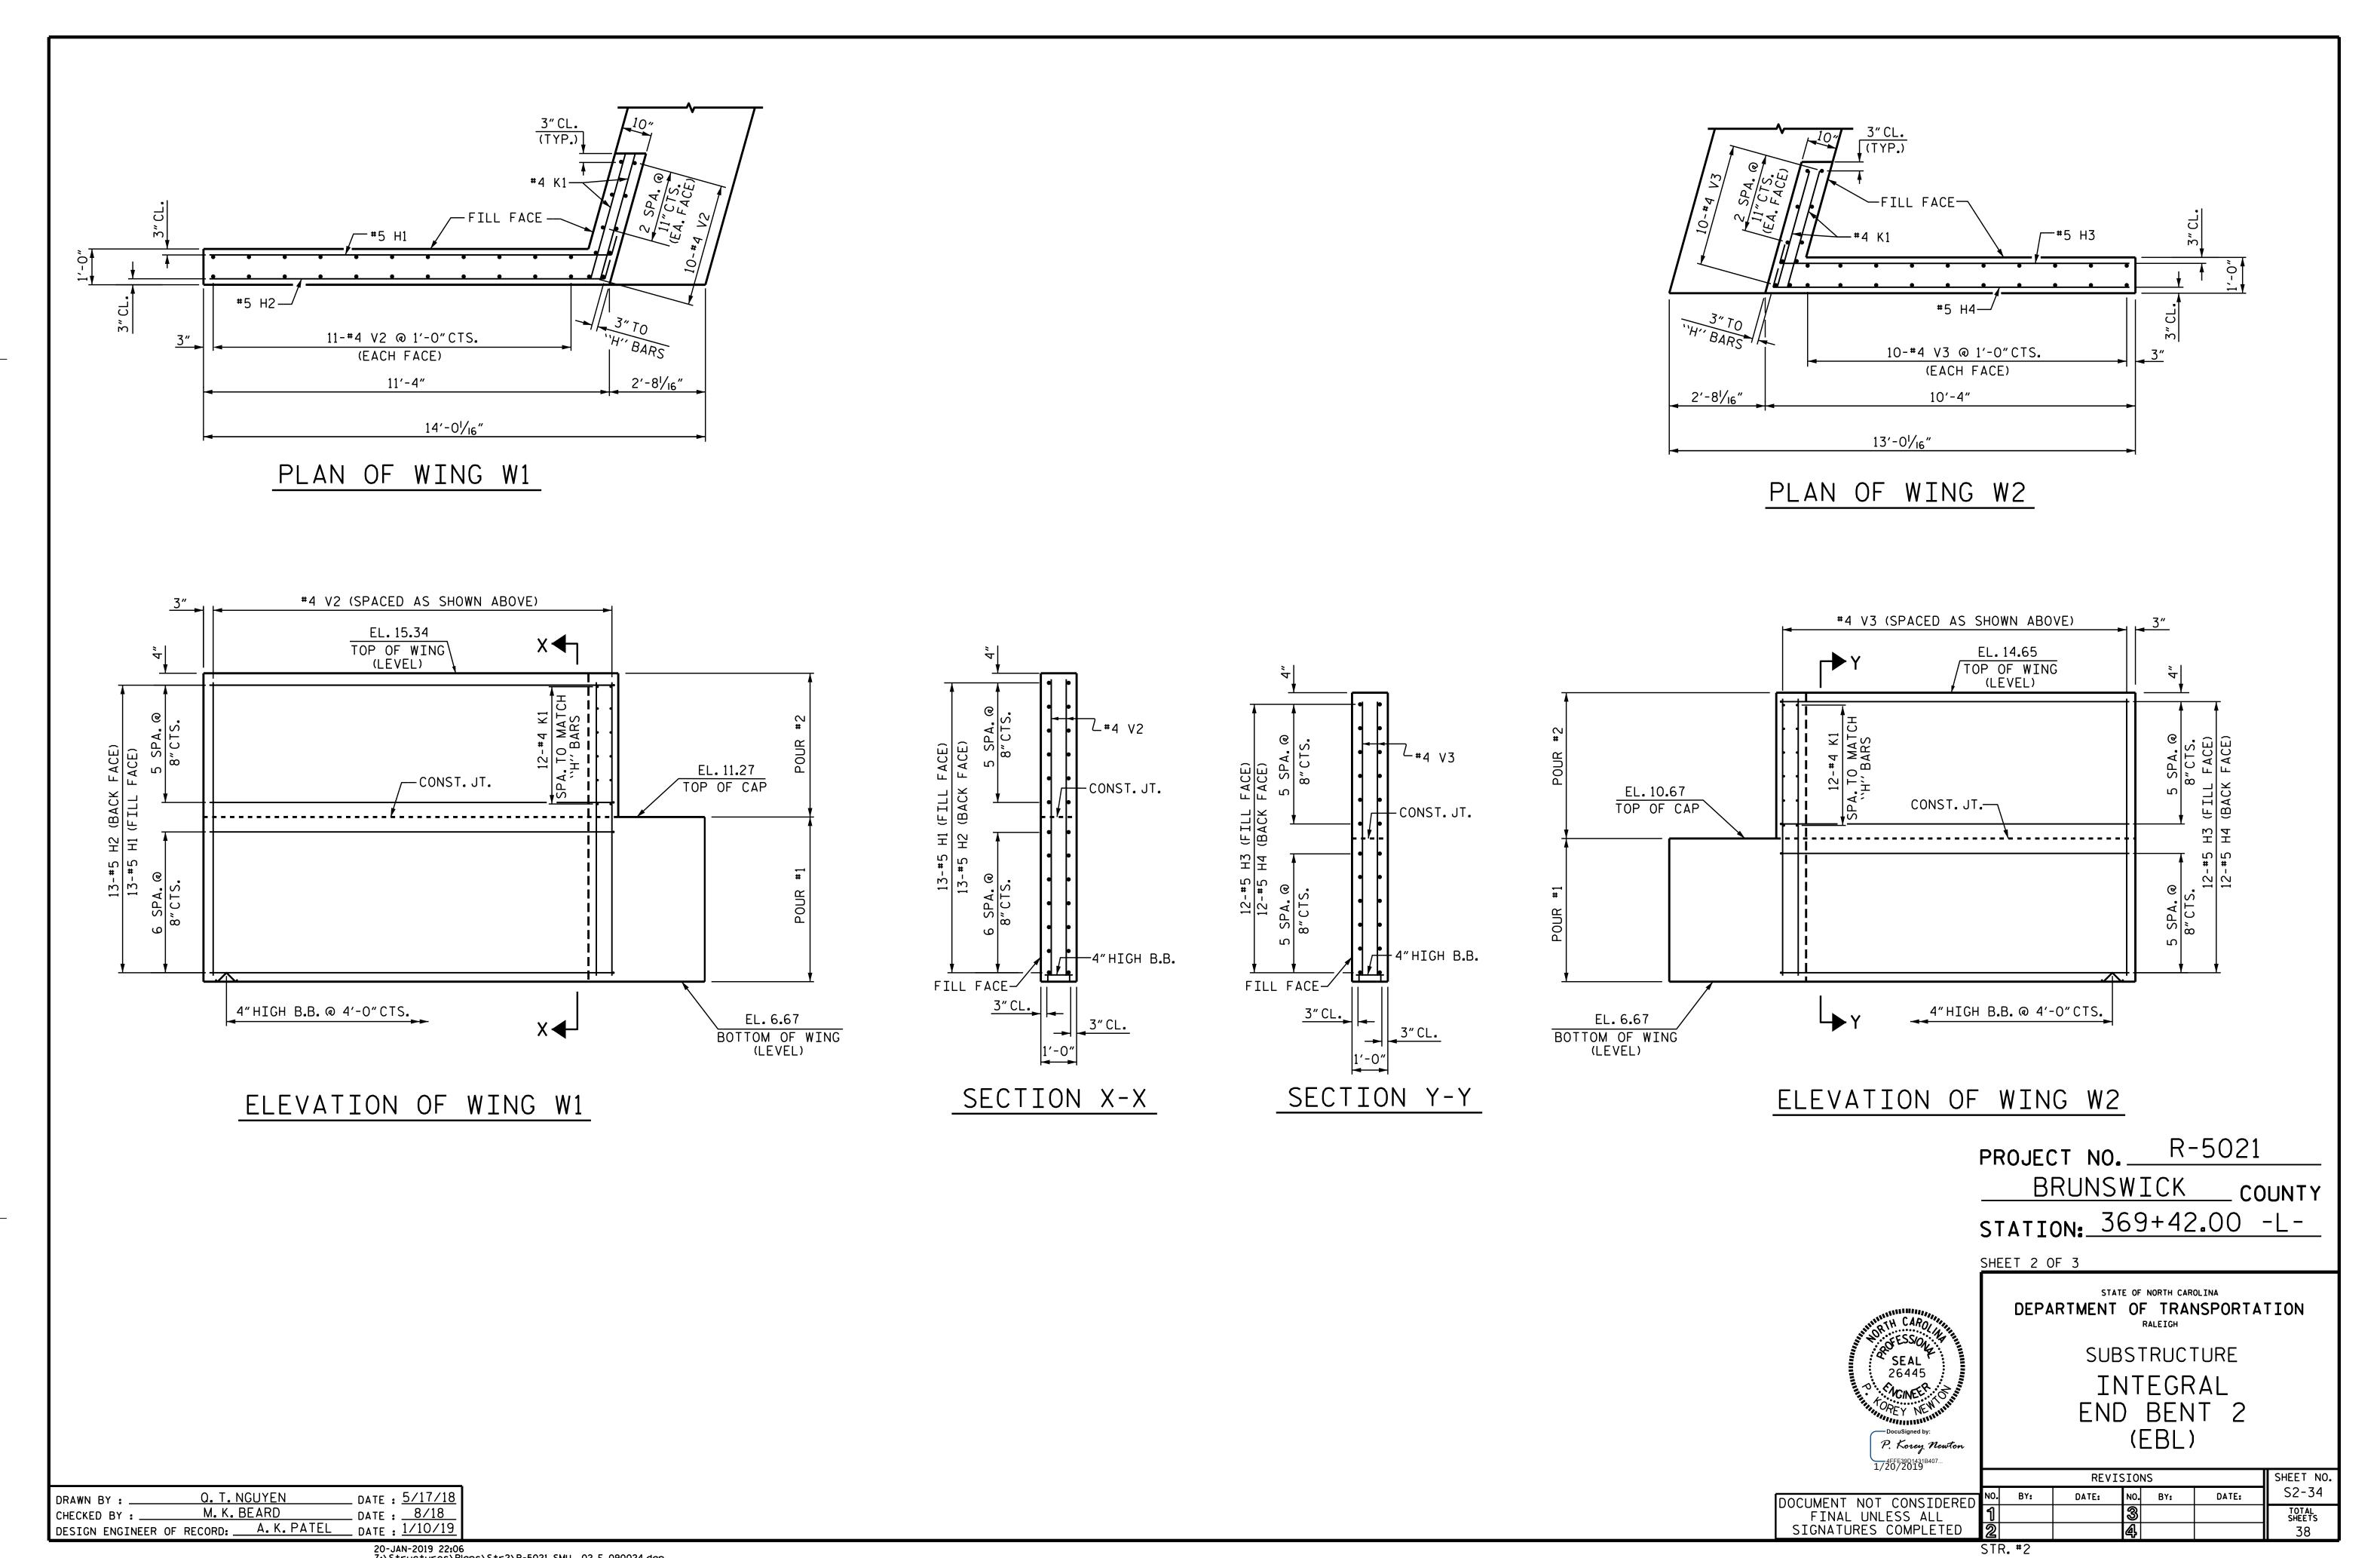

20-JAN-2019 22:06
Z:\Structures\Plans\Str2\R-5021_SMU_ 02_E_090024.dgn
pknewton

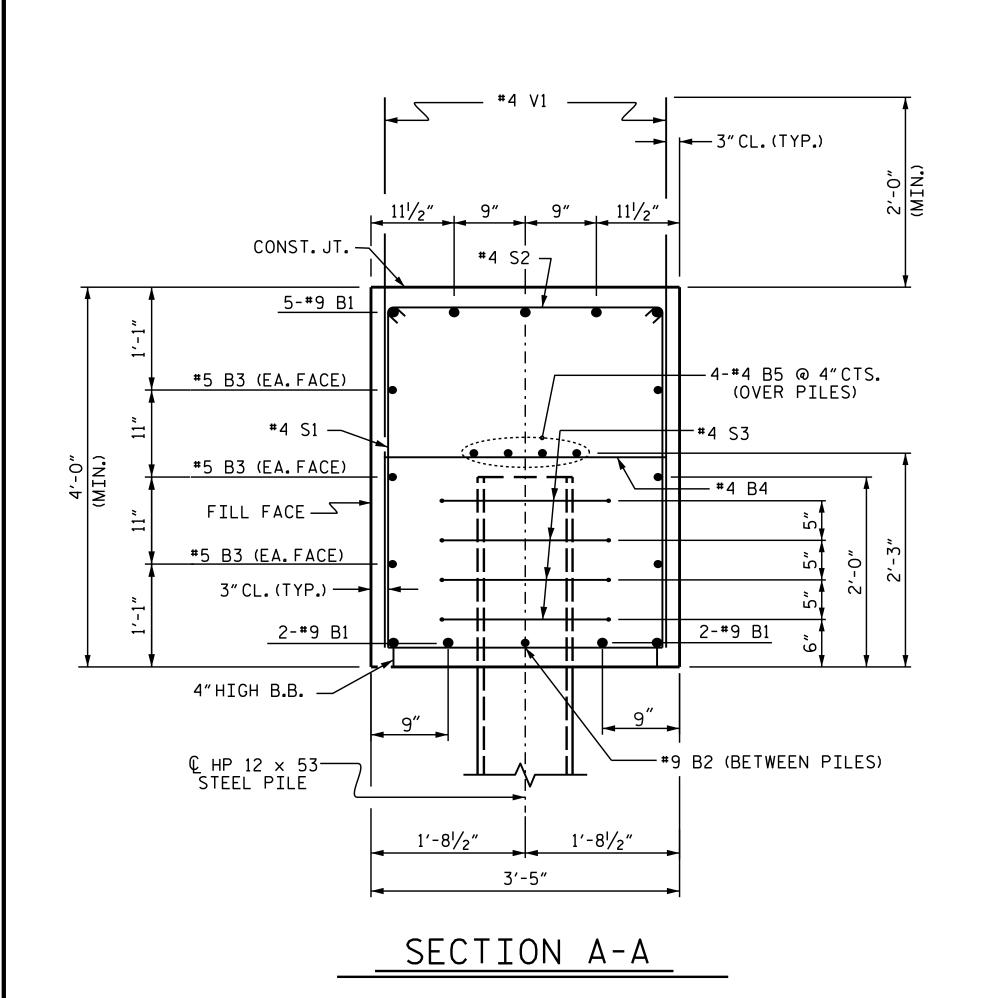

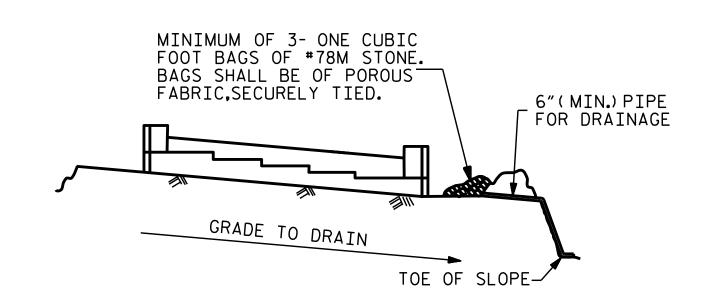


BAGGED STONE AND PIPE SHALL BE PLACED IMMEDIATELY AFTER COMPLETION OF END BENT EXCAVATION. PIPE MAY BE EITHER CONCRETE, CORRUGATED STEEL, CORRUGATED ALUMINUM ALLOY, OR CORRUGATED PLASTIC. PERFORATED PIPE WILL NOT BE ALLOWED.

BAGGED STONE SHALL REMAIN IN PLACE UNTIL THE ENGINEER DIRECTS THAT IT BE REMOVED. THE CONTRACTOR SHALL REMOVE AND DISPOSE OF SILT ACCUMULATIONS AT BAGGED STONE WHEN SO DIRECTED BY THE ENGINEER. BAGS SHALL BE REMOVED AND REPLACED WHENEVER THE ENGINEER DETER-MINES THAT THEY HAVE DETERIORATED AND LOST THEIR EFFECTIVENESS.


NO SEPARATE PAYMENT WILL BE MADE FOR THIS WORK AND THE ENTIRE COST OF THIS WORK SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR THE SEVERAL PAY ITEMS.

TEMPORARY DRAINAGE AT END BENT

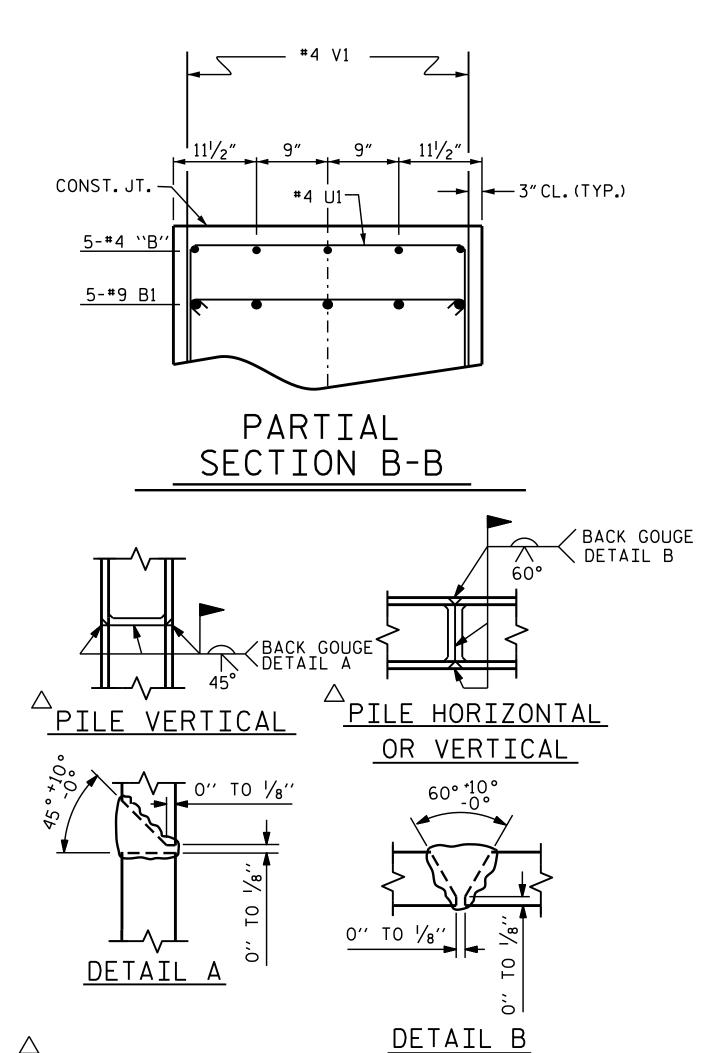


PILE SPLICE DETAILS

POSITION OF PILE DURING WELDING.

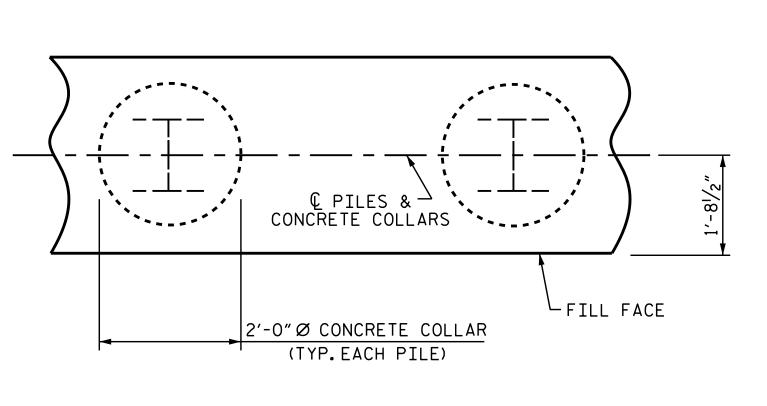

PLAN

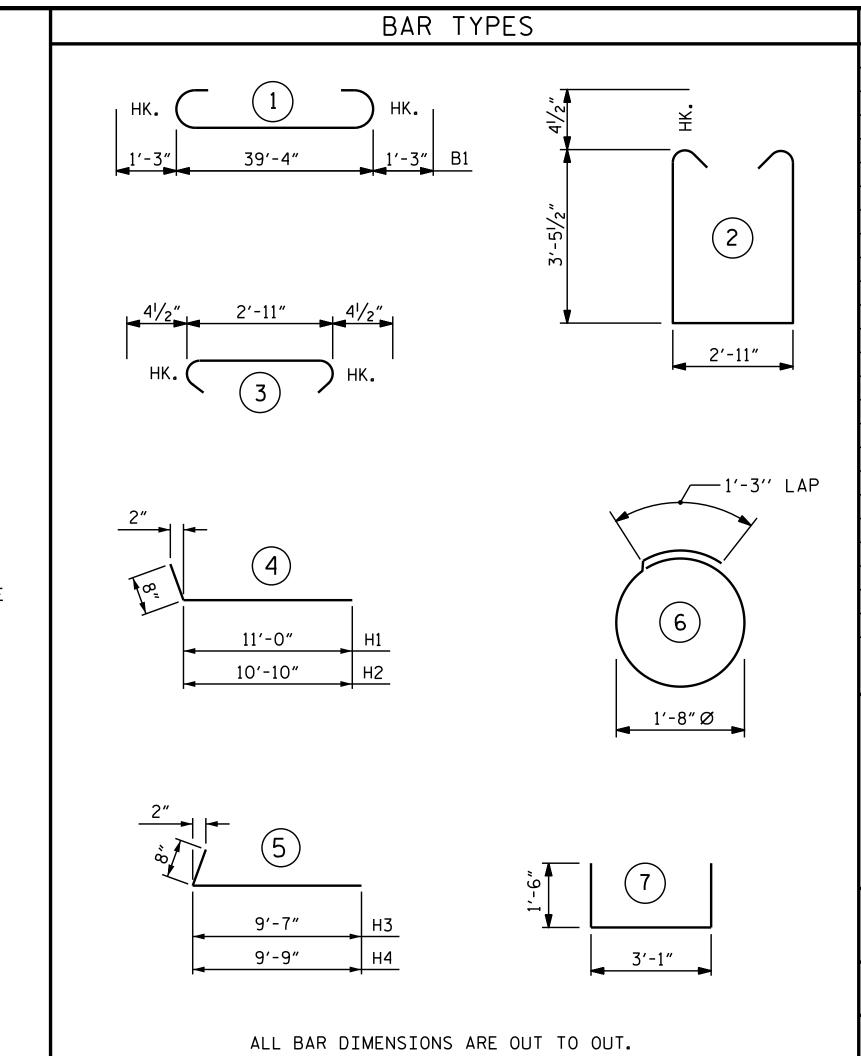

*B7 | 5 | #4 | STR | 7′-0" 23 158 *H1 | 13 | #5 | 4 | 11'-8" 13 #5 156 4 12 | #5 | 5 | 128 **∗** H3 10′-3″ 130 12 | #5 | 5 10′-5″ 53 *K1 | 24 | #4 | STR | 3'-4" 42 | #4 | 2 10'-7" 297 #4 42 103 3 3′-8" * S3 20 | #4 | 6 6′-6″ 87 5'-11" * U1 15 | #4 | 7 59 58 | #4 | STR | 5'-0" * V1 194 32 | #4 | STR | 8'-2" 175 ***** ∨2 | * V3 | 30 | #4 | STR | 7′-5″ 149 * EPOXY COATED = 3513 LBS. REINFORCING STEEL CLASS AA CONCRETE (CAP, CONC. COLLARS, & LOWER PART OF WINGS) = 25.7 C.Y. (UPPER PART OF WINGS) = 3.9 C.Y. TOTAL = 29.6 C.Y.HP 12 X 53 STEEL PILES __ LIN FT. 325 PILE REDRIVES EA. 5 __ NO.5 STEEL PILE POINTS.

BILL OF MATERIAL

#9 STR

#4 | STR |

#4 STR

#4 STR

NO. | SIZE | TYPE | LENGTH | WEIGHT

#5 | STR | 39'-6"

41′-10″

21'-2"


6′-6″

119

247

19

22

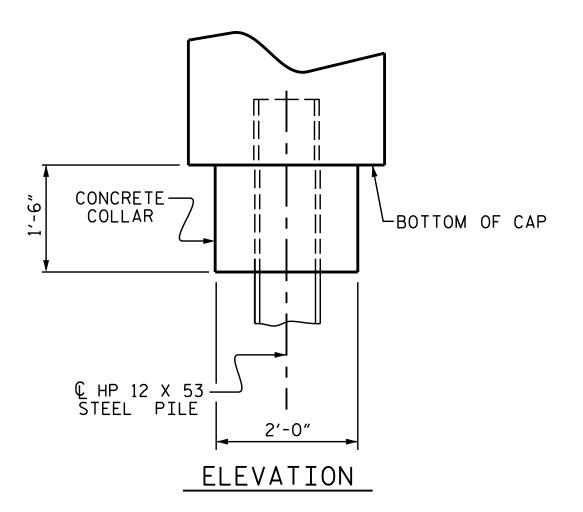

CORROSION PROTECTION FOR STEEL PILES DETAIL



369+42.00 -L-STATION:_ SHEET 3 OF 3 STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION RALEIGH

COUNTY

PROJECT NO. R-5021

BRUNSWICK


SUBSTRUCTURE INTEGRAL END BENT 2 (EBL)

REVISIONS SHEET NO. S2-35 DATE: DATE: DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED BY: TOTAL SHEETS


STR. #2

Q. T. NGUYEN _ DATE : <u>5/17/18</u> DRAWN BY : M.K.BEARD _ DATE : <u>8/18</u> CHECKED BY : . DESIGN ENGINEER OF RECORD: A.K. PATEL __ DATE : 1/10/19

20-JAN-2019 22:06 Z:\Structures\Plans\Str2\R-5021_SMU_ 02_E_090024.dgn

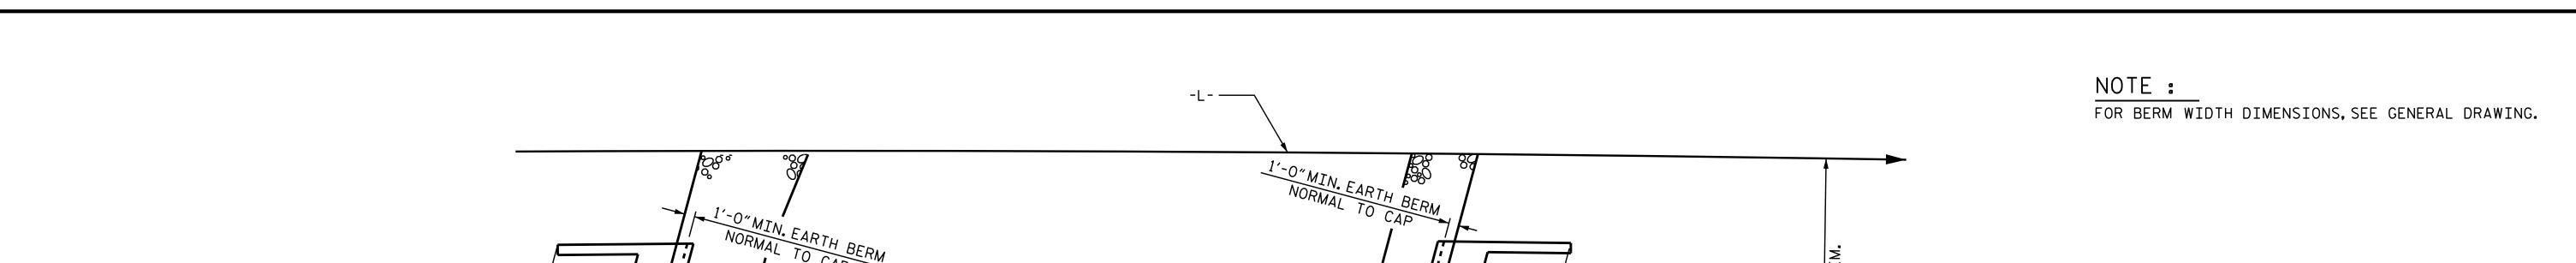


END BENT 2

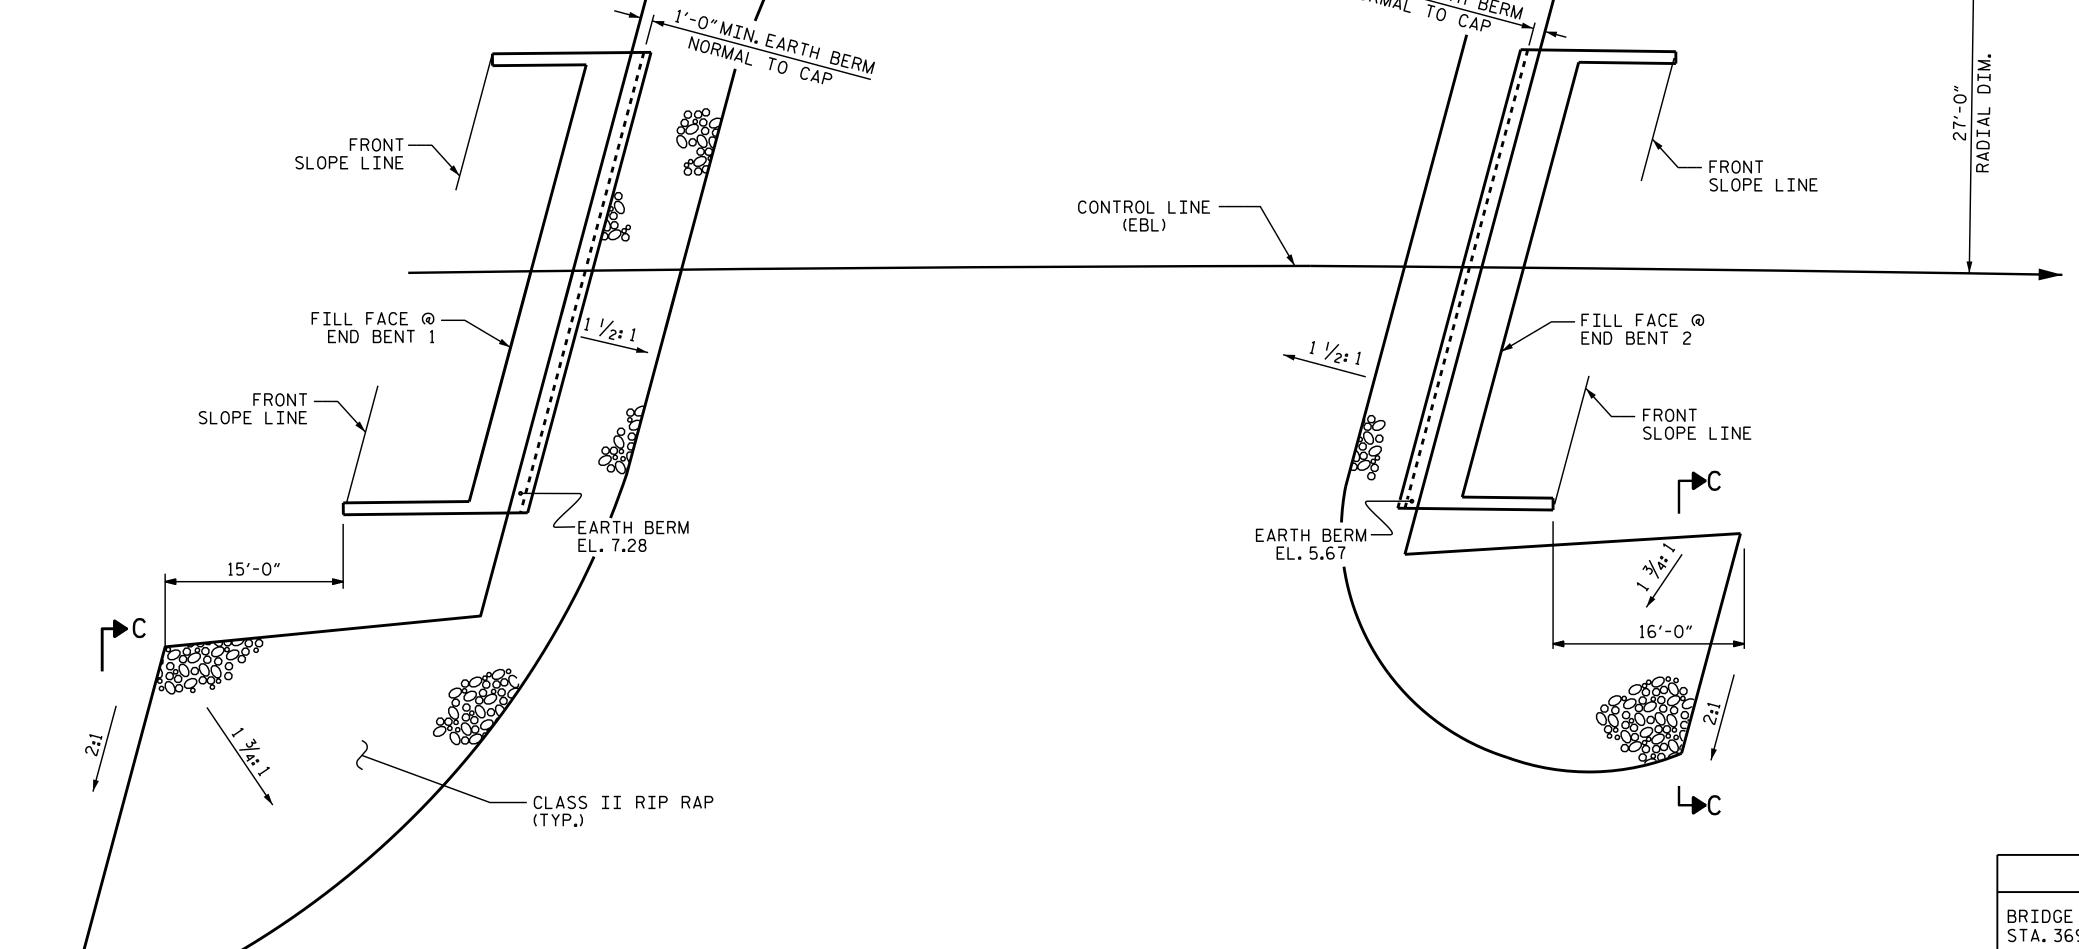

<u>PLAN</u>

ESTIMATED QUANTITIES RIP RAP CLASS II (2'-0"THICK) BRIDGE @ GEOTEXTILE STA.369+42.00 -L-FOR DRAINAGE SQUARE YARDS TONS END BENT 1 130 145 END BENT 2 120 135

P. Korey Newton

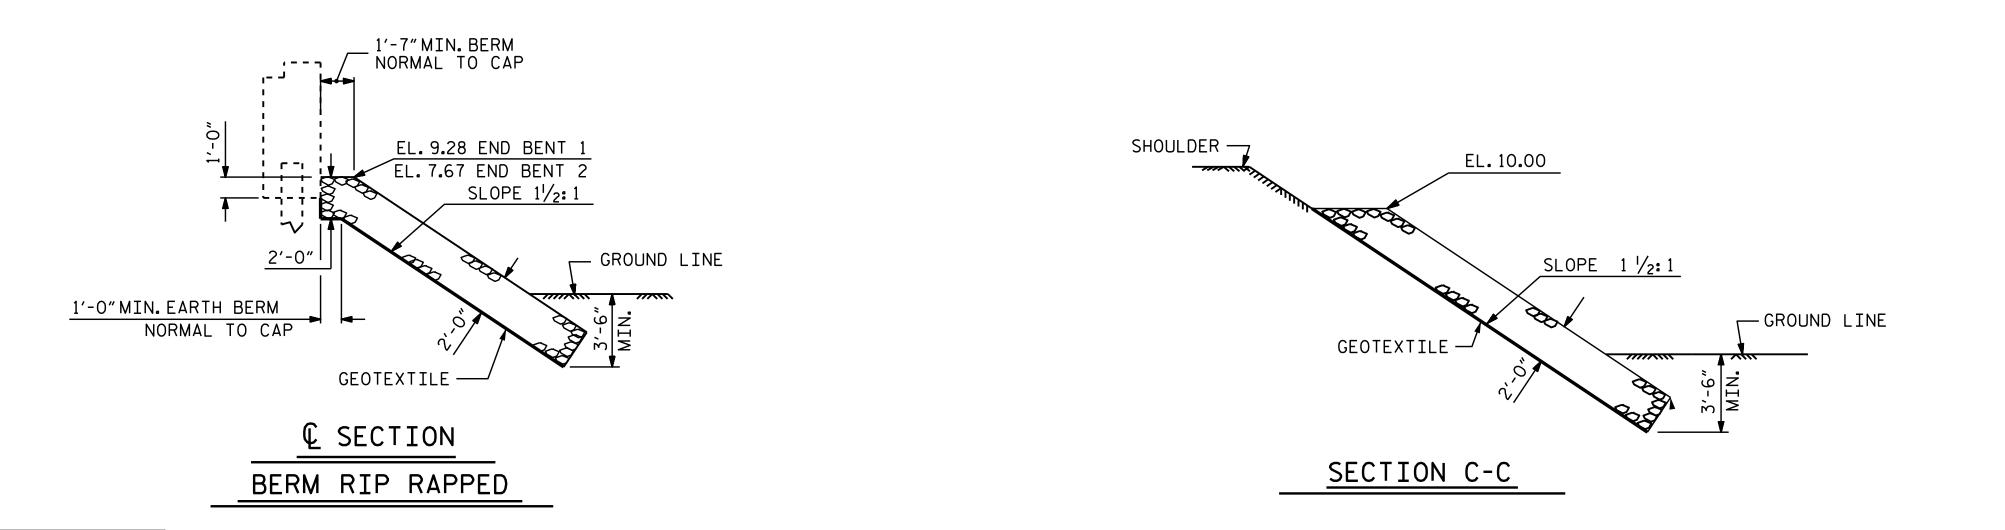

R-5021 PROJECT NO.__ BRUNSWICK __ COUNTY STATION: 369+42.00 -L-

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
RALEIGH

> RIP RAP DETAILS (EBL)


1/20/2019							
1/20/2019			REVI	SION	S		SHEET NO.
OCUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S2-36
FINAL UNLESS ALL	1			3			TOTAL SHEETS
SIGNATURES COMPLETED	2			4			38
	STI	R.#2				CTD 1	VO RR1

MAA/GM MAA/GM MAA/THC

ASSEMBLED BY: G.KOUCHEKI/QTN DATE: 5/18
CHECKED BY: M.K.BEARD DATE: 11/18

DRAWN BY: REK 1/84 CHECKED BY: RDU 1/84

END BENT 1

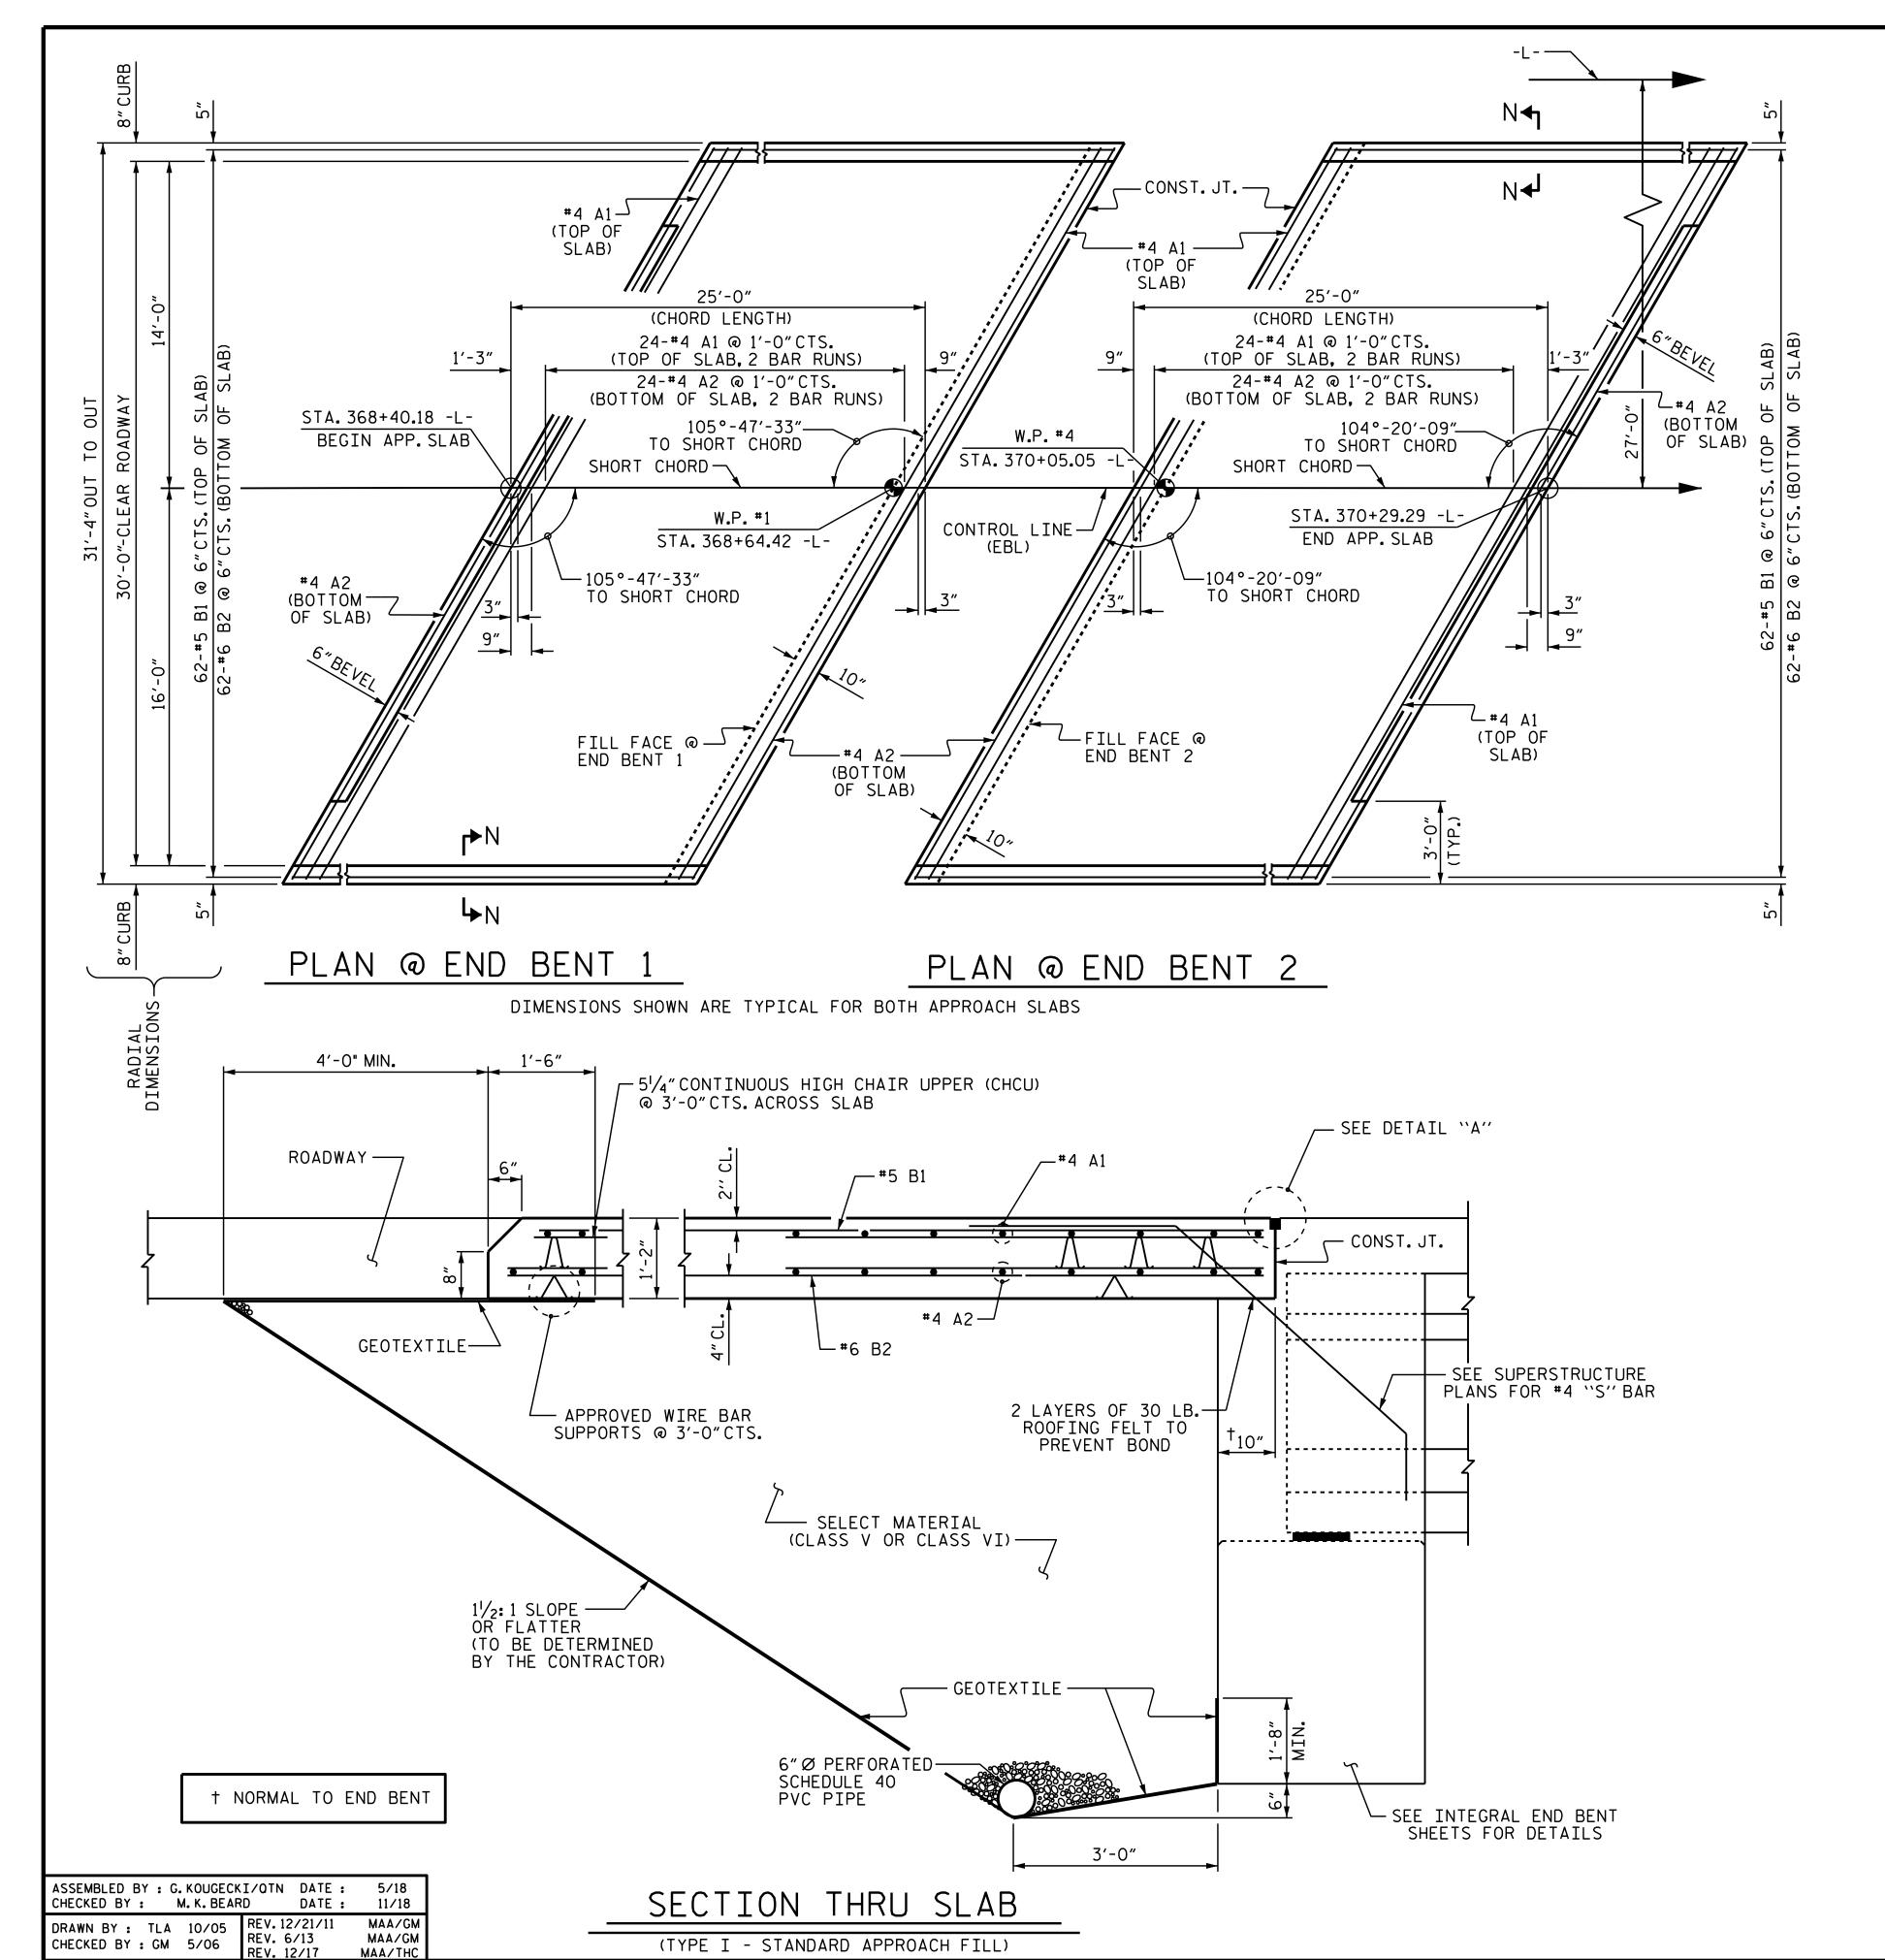

NOTES

APPROACH SLAB SHALL NOT BE CONSTRUCTED PRIOR TO COMPLETION OF THE BRIDGE DECK.

FOR BRIDGE APPROACH FILL INCLUDING GEOTEXTILE, 6" Ø DRAINAGE PIPE, AND SELECT MATERIAL, SEE ROADWAY PLANS.

GEOTEXTILE SHALL BE TYPE 1 IN ACCORDANCE WITH THE STANDA SPECIFICATIONS SECTION 1056.

SELECT MATERIAL BACKFILL (CLASS V OR CLASS VI) SHALL BE ACCORDANCE WITH STANDARD SPECIFICATIONS SECTION 1016.

SELECT MATERIAL BACKFILL IS TO BE CONTINUOUS ALONG FILL FACE OF BACKWALL FROM OUTSIDE EDGE TO OUTSIDE EDGE OF APPROACH SLAB.

FOR THE 6" Ø DRAINAGE PIPE OUTLET(S), SEE ROADWAY STANDARD DRAWINGS.

AREA BETWEEN THE WINGWALL AND APPROACH SLAB SHALL BE GRADED TO DRAIN THE WATER AWAY FROM THE FILL FACE OF THE BRIDGE AND SHALL BE PAVED. SEE ROADWAY PLANS.

THE JOINT OPENING AT THE APPROACH SLAB/DECK INTERFACE SHALL BE SAWED NO MORE THAN 12 HOURS AFTER THE APPROACH SLAB IS CAST. THE JOINT SHALL BE CLEANED OF ALL DEBRIS BEFORE THE SEALANT IS APPLIED. THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF SECTION 1028-3 OF THE STANDARD SPECIFICATIONS.

AT THE CONTRACTORS OPTION, "TYPE A - ALTERNATE APPROACH FILL" IN LIEU OF "TYPE I - STANDARD APPROACH FILL" MAY BE CONSTRUCTED AT NO ADDITIONAL COST TO THE DEPARTMENT. SEE SHEET 2 OF 2 FOR DETAILS AND NOTES.

ARC OFFSETS ARE NEGLIGIBLE, THEREFORE NOT SHOWN.

		BIL	L OF	MA	TERIAL	-					
_	BILL OF MATERIAL FOR ONE APPROACH SLAB (2 REQ'D) BAR NO. SIZE TYPE LENGTH WEIGHT * A1 52 *4 STR 16'-5" 580 * A2 52 *4 STR 16'-5" 580 * B1 63 *5 STR 24'-0" 1552 * B2 63 *6 STR 24'-6" 2281										
	BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT					
	* ∆1	52	#4	STR	16′-5″	580					
ARD	* A2	52	#4	STR	16′-5″	580					
ARU						WEIGHT 580 580 1552					
	* B1	63	#5	STR	24'-0"	1552					
IN	★ B2	63	#6	STR	24'-6"	2281					
L	* EPOX	Y COA	TED		400	4					


REINFORCING STEEL


CLASS AA CONCRETE


SPL	ICE LEN	NGTHS
BAR SIZE	EPOXY COATED	UNCOATED
#4	2'-0"	1'-9"
#5	2'-6"	2'-2"
#6	3′-10″	2'-7"

4994 LBS.

35.2 C.Y.

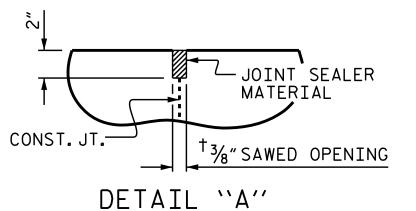

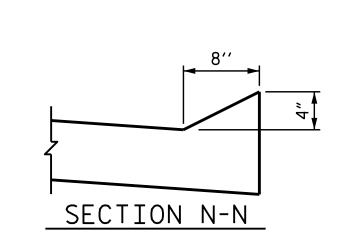

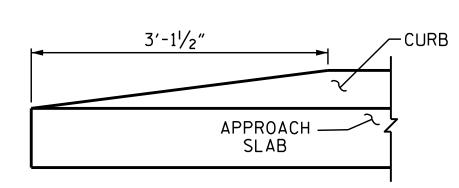

END OF CURB WITHOUT SHOULDER BERM GUTTER

R-5021 PROJECT NO._ BRUNSWICK _ COUNTY STATION: 369+42.00 -L-

SHEET 1 OF 2

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION RALEIGH

STANDARD

BRIDGE APPROACH SLAB FOR INTEGRAL ABUTMENT (EBL)


1/20/2019	10 SHEETS							
CUMENT NOT CONSIDERED	NO.	BY:	DATE:	NO.	BY:	DATE:	S2-37	
FINAL UNLESS ALL	1			3			TOTAL SHEETS	
IGNATURES COMPLETED	2			4			38	


26445

P. Korey Newton


4FFE39D1431B407..

" NGINEER

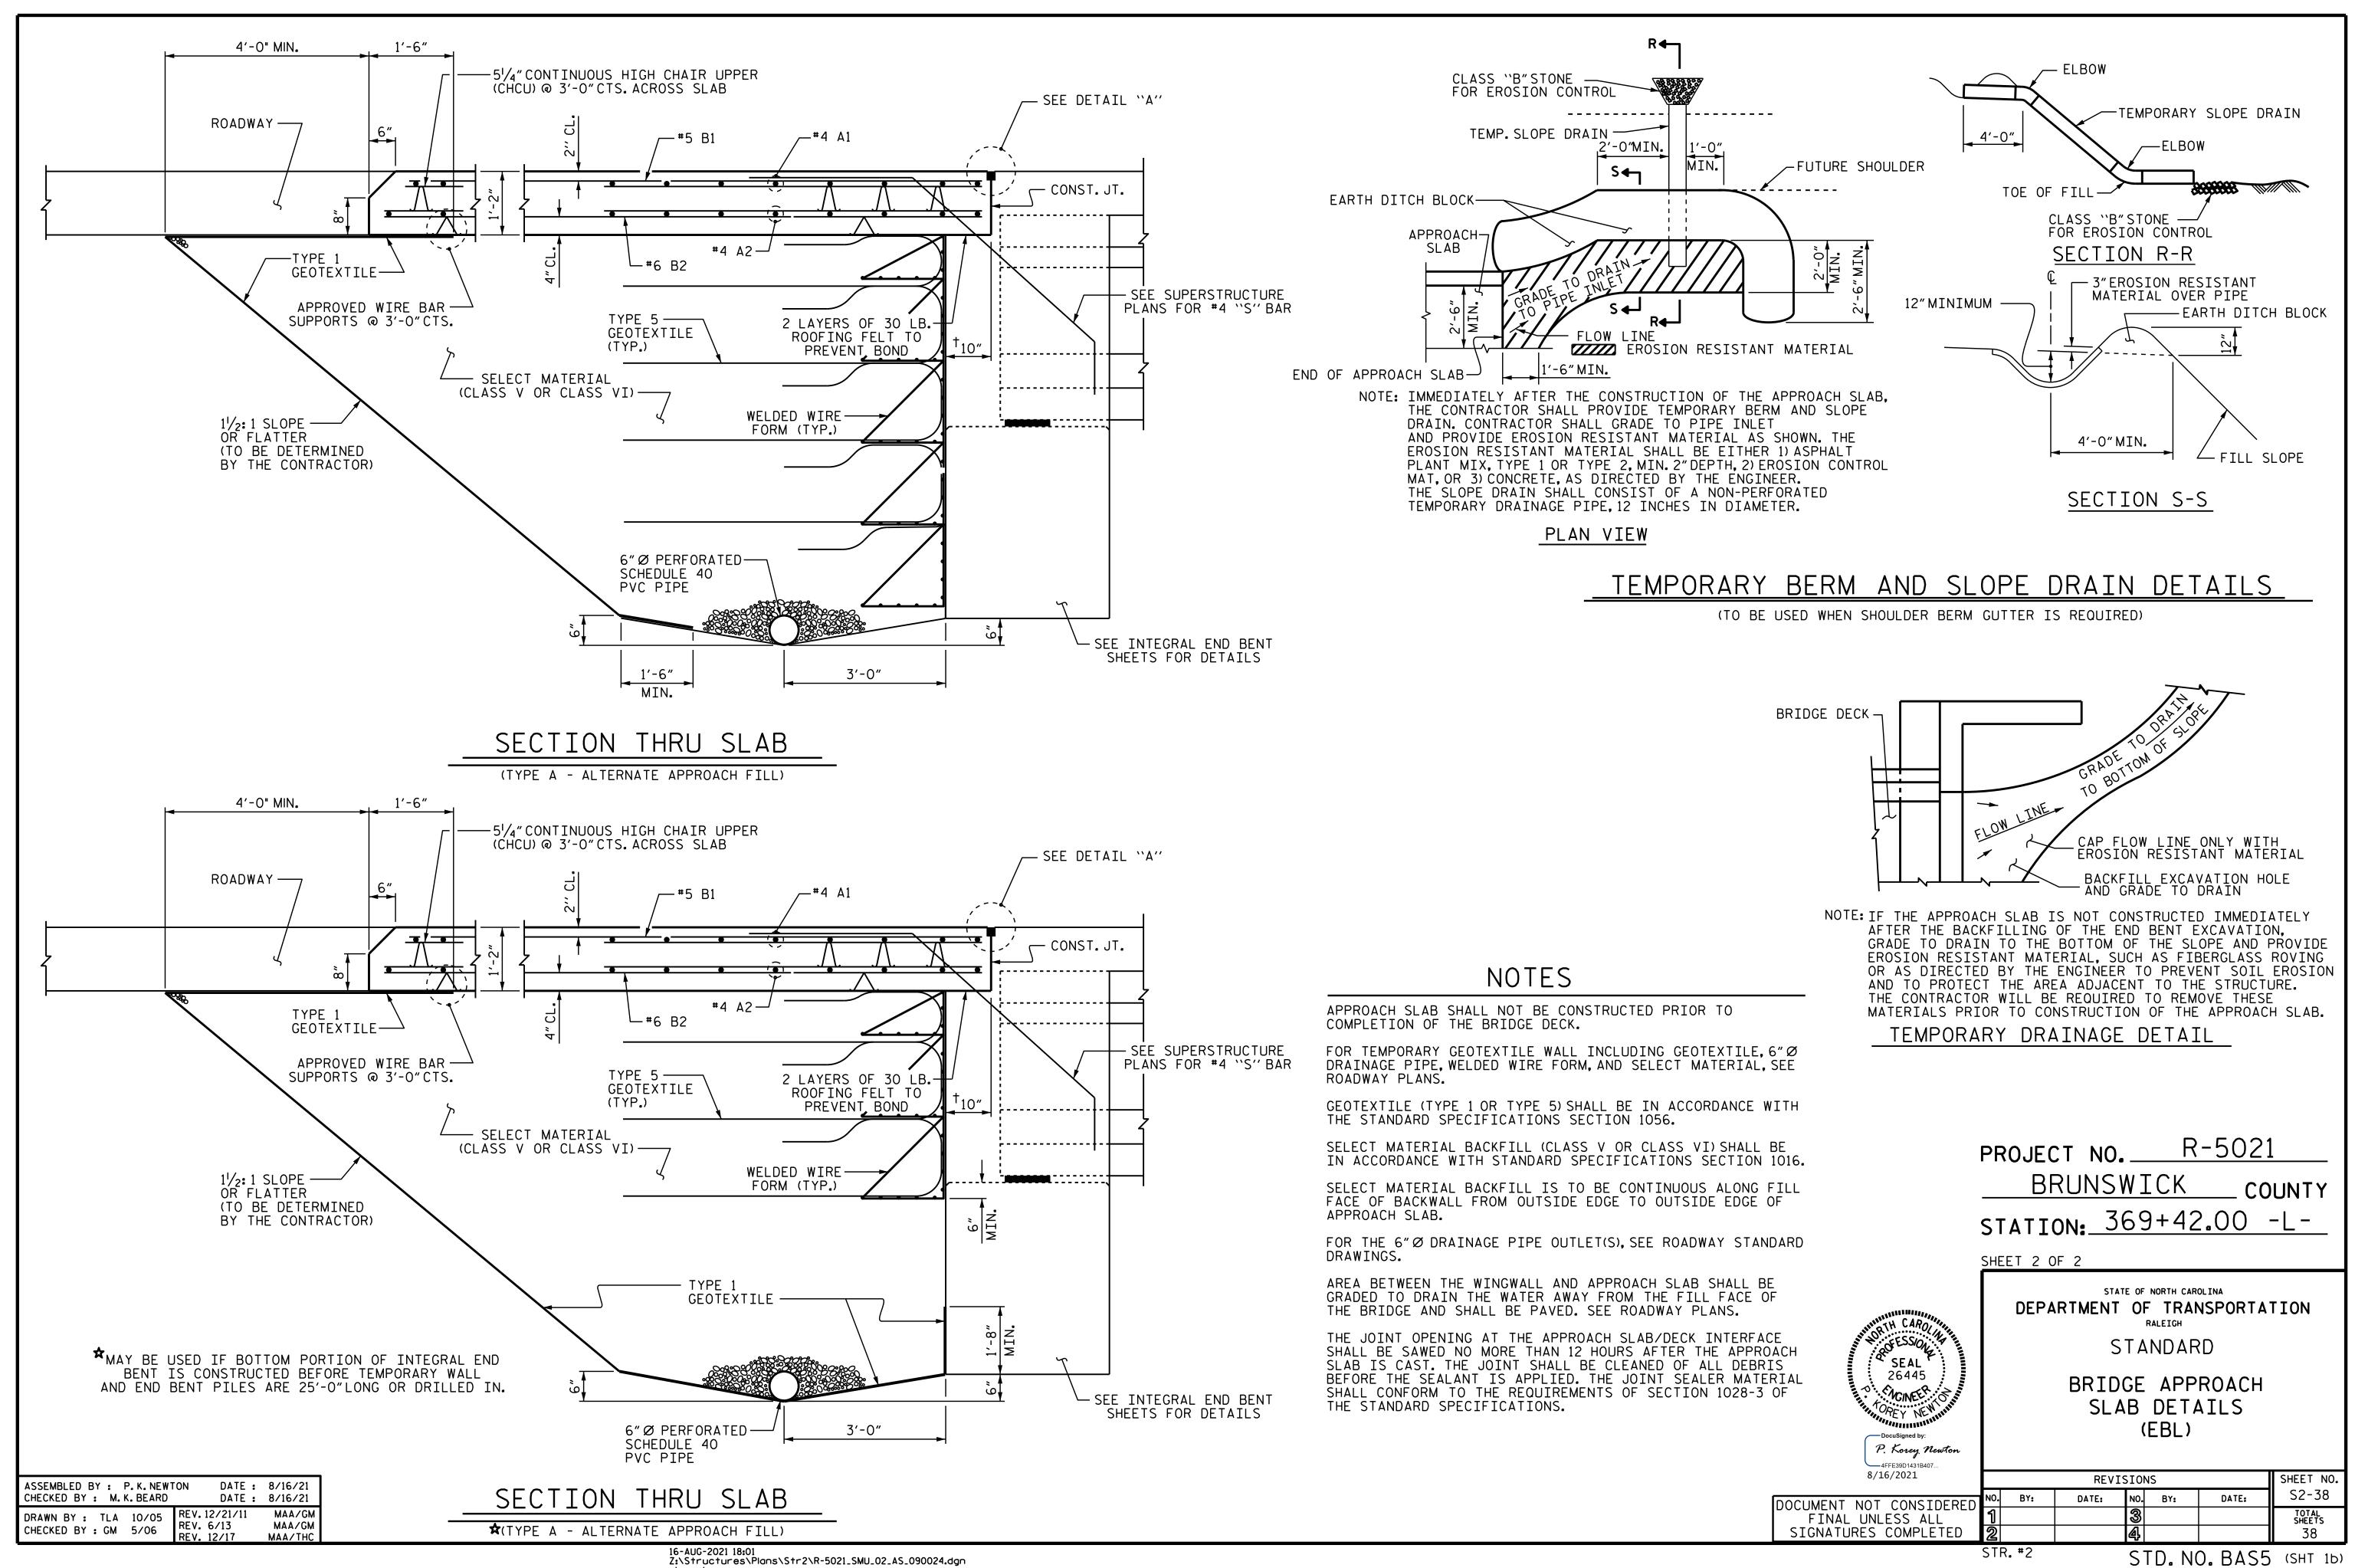

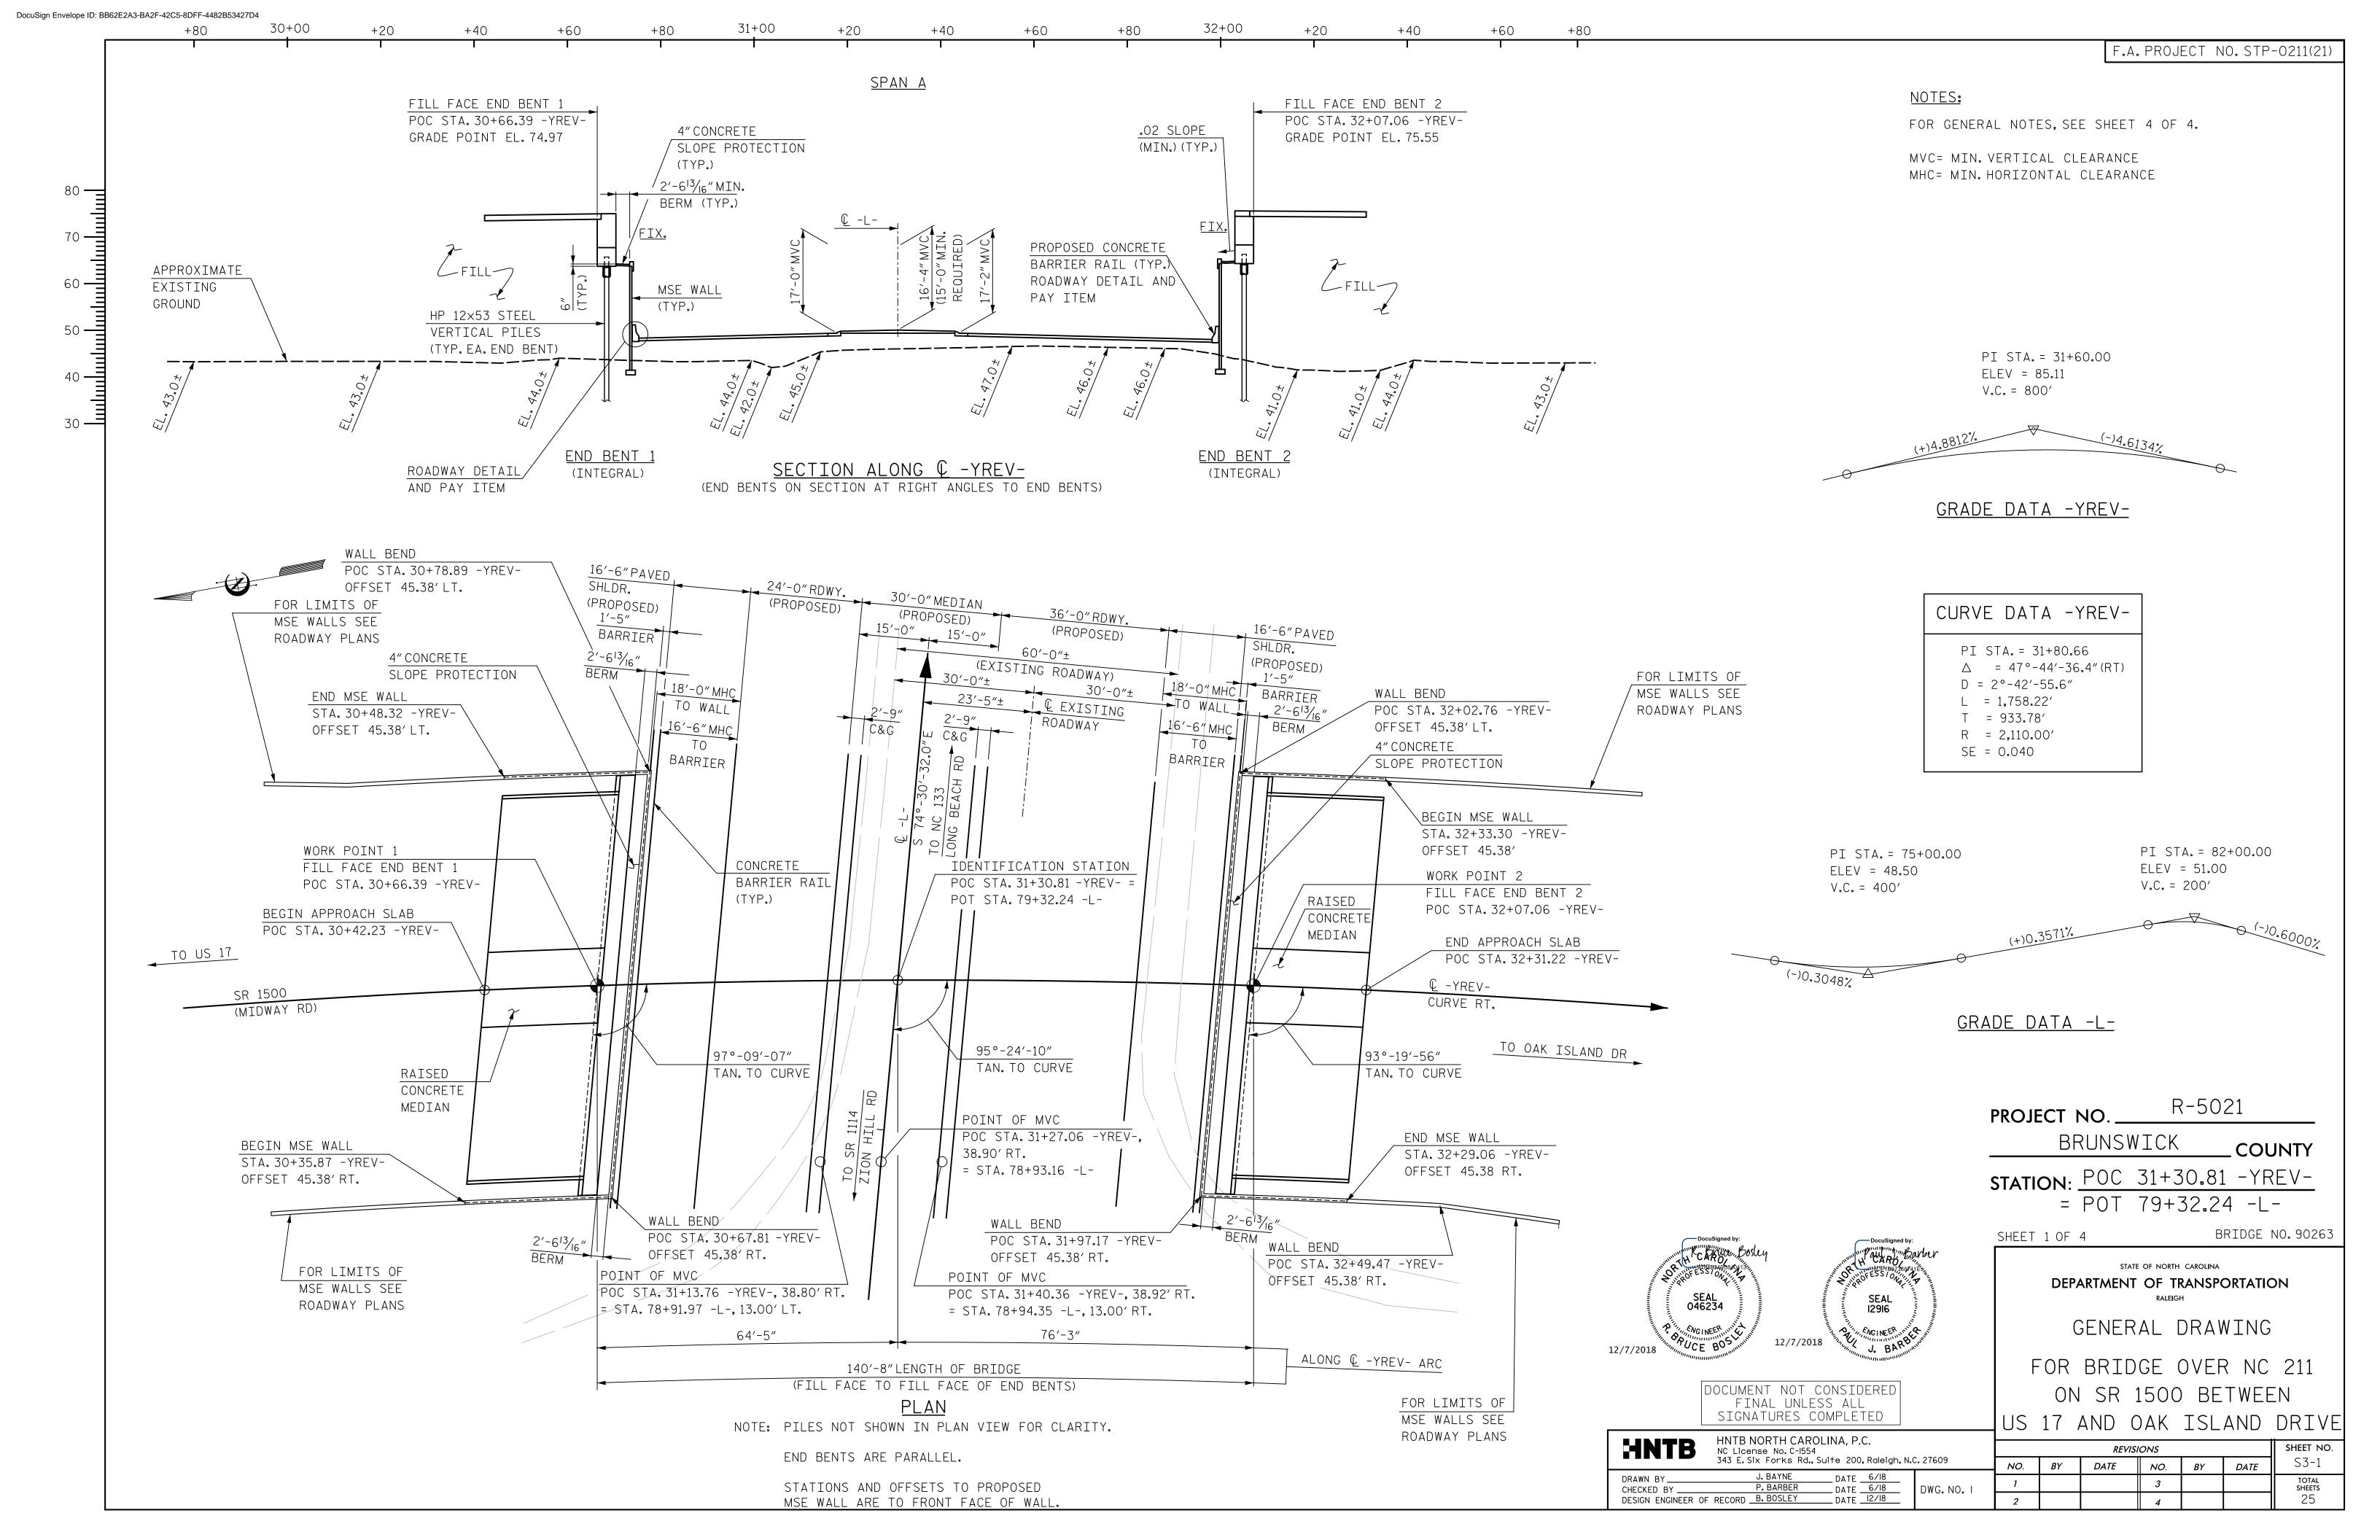



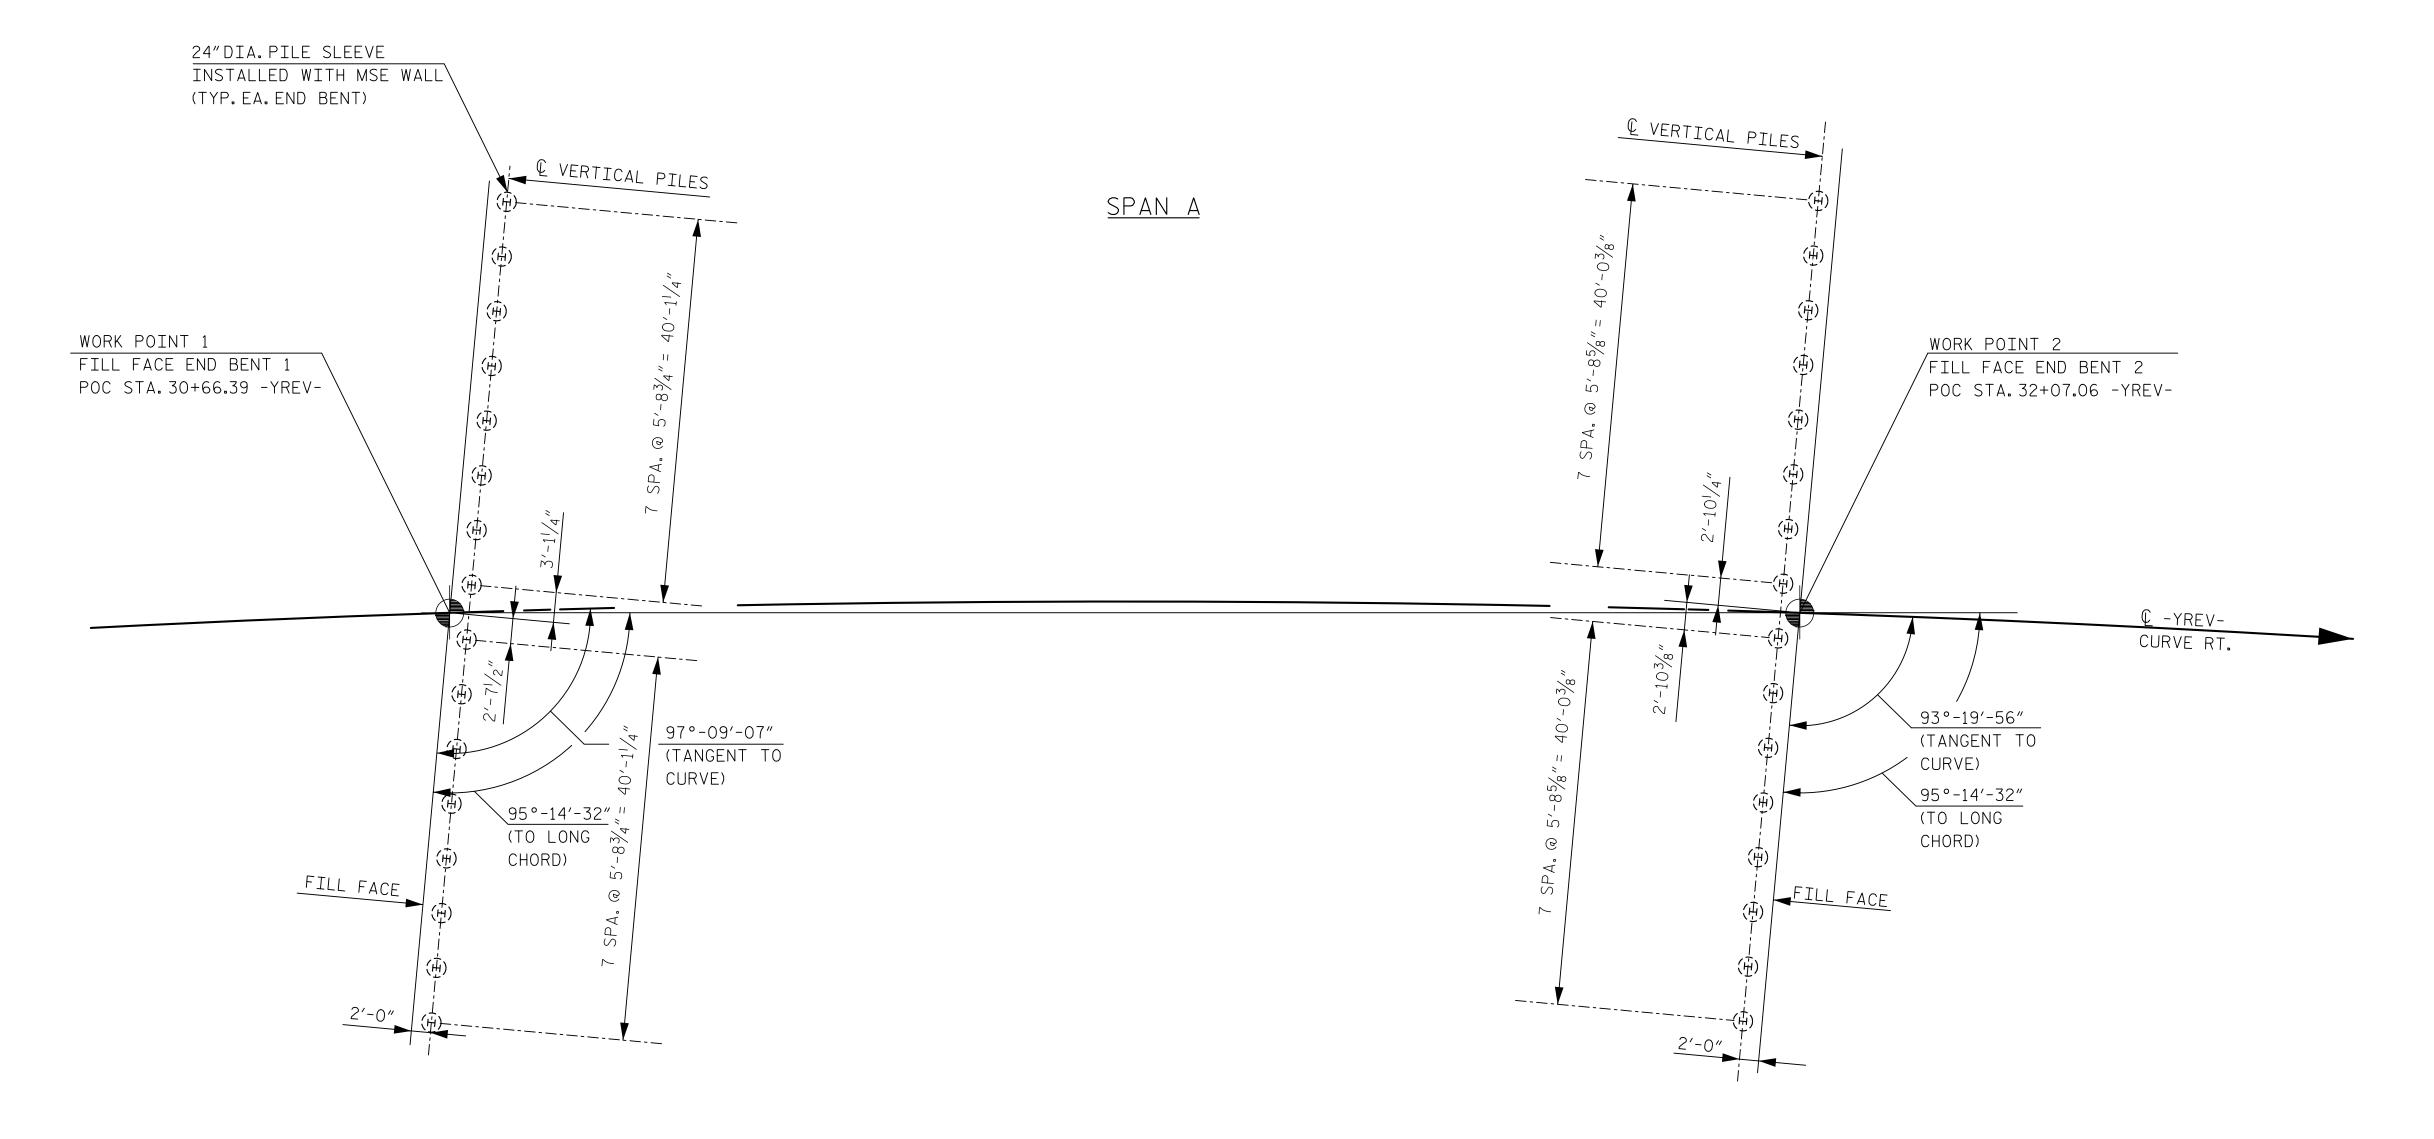

FOUNDATION NOTES:

FOR PILES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

PILES AT END BENT NO.1 AND END BENT NO.2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 120 TONS PER PILE.

END BENT 1

DRIVE PILES AT END BENT NO.1 AND END BENT NO.2 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE.

STEEL H-PILE POINTS ARE REQUIRED FOR STEEL H-PILES AT END BENT NO.1 AND END BENT NO. 2. FOR STEEL PILE POINTS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

TESTING PILES WITH THE PDA DURING DRIVING, RESTRIKING OR REDRIVING MAY BE REQUIRED. THE ENGINEER WILL DETERMINE THE NEED FOR PDA TESTING. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

OBSERVE A 1 MONTH WAITING PERIOD AFTER CONSTRUCTING THE MECHANICALLY STABILIZED EARTH (MSE) ABUTMENT WALL TO WITHIN 1 FT OF THE BOTTOM OF CAP ELEVATION BEFORE BEGINNING END BENT CONSTRUCTION AT END BENT NO.1 AND END BENT NO.2. FOR BRIDGE WAITING PERIODS, SEE ROADWAY PLANS AND SECTION 235 OF THE STANDARD SPECIFICATIONS.

FOUNDATION LAYOUT PLAN

ALL DIMENSIONS ARE PARALLEL OR NORMAL TO FILL FACES AT END BENTS.


ALL PILE DIMENSIONS ARE TO CENTERS OF PILES.

PILES AT END BENT 1 AND END BENT 2 ARE HP 12x53 STEEL PILES.


FOR FOUNDATION ELEVATIONS AND DETAILS, SEE END BENT SHEETS.

R-5021 PROJECT NO. ___ BRUNSWICK _ COUNTY

STATION: POC 31+30.81 -YREV-



END BENT 2



|DOCUMENT NOT CONSIDERED|

SHEET 2 OF 4


STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION


GENERAL DRAWING FOUNDATION LAYOUT

FINAL UNLESS ALL SIGNATURES COMPLETED HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609 A. GOFF
CHECKED BY B. BOSLEY
DESIGN ENGINEER OF RECORD B. BOSLEY

DATE 6/18
DATE 6/18
DATE 12/18

SHEET NO. **REVISIONS** S3-2 NO. BY DATE NO. BY DATE total sheets 25 DWG. NO. 2

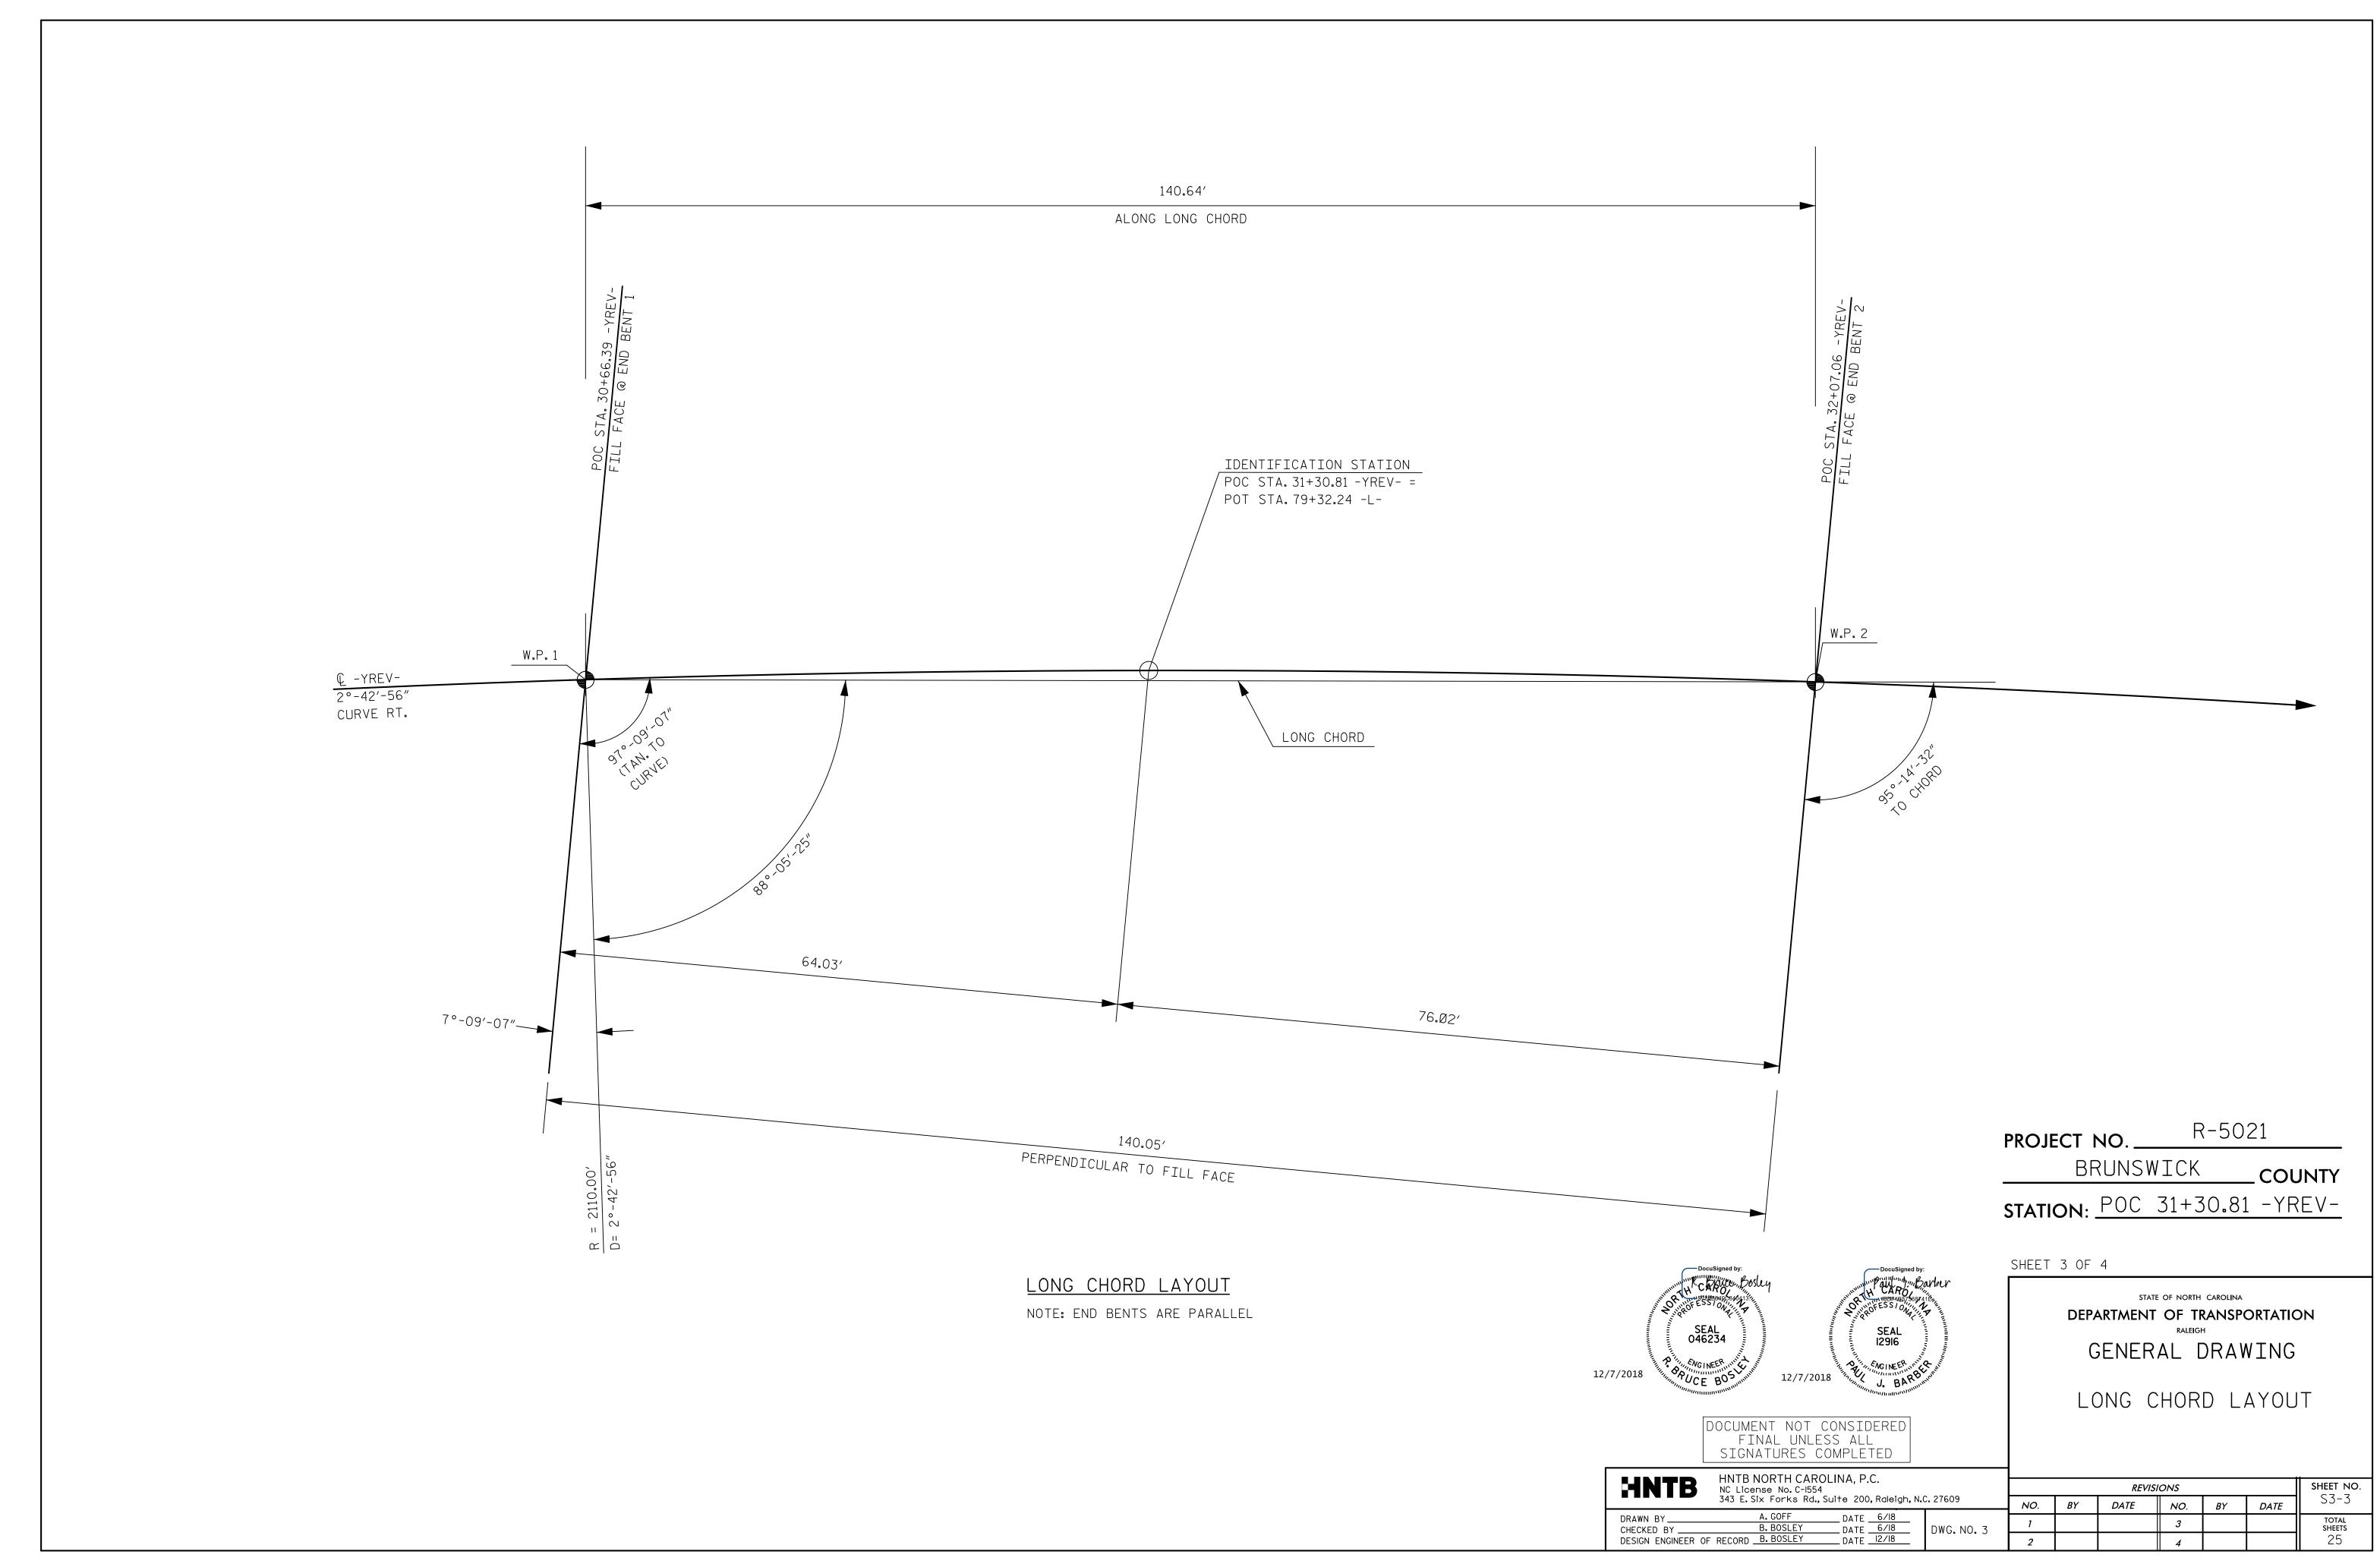

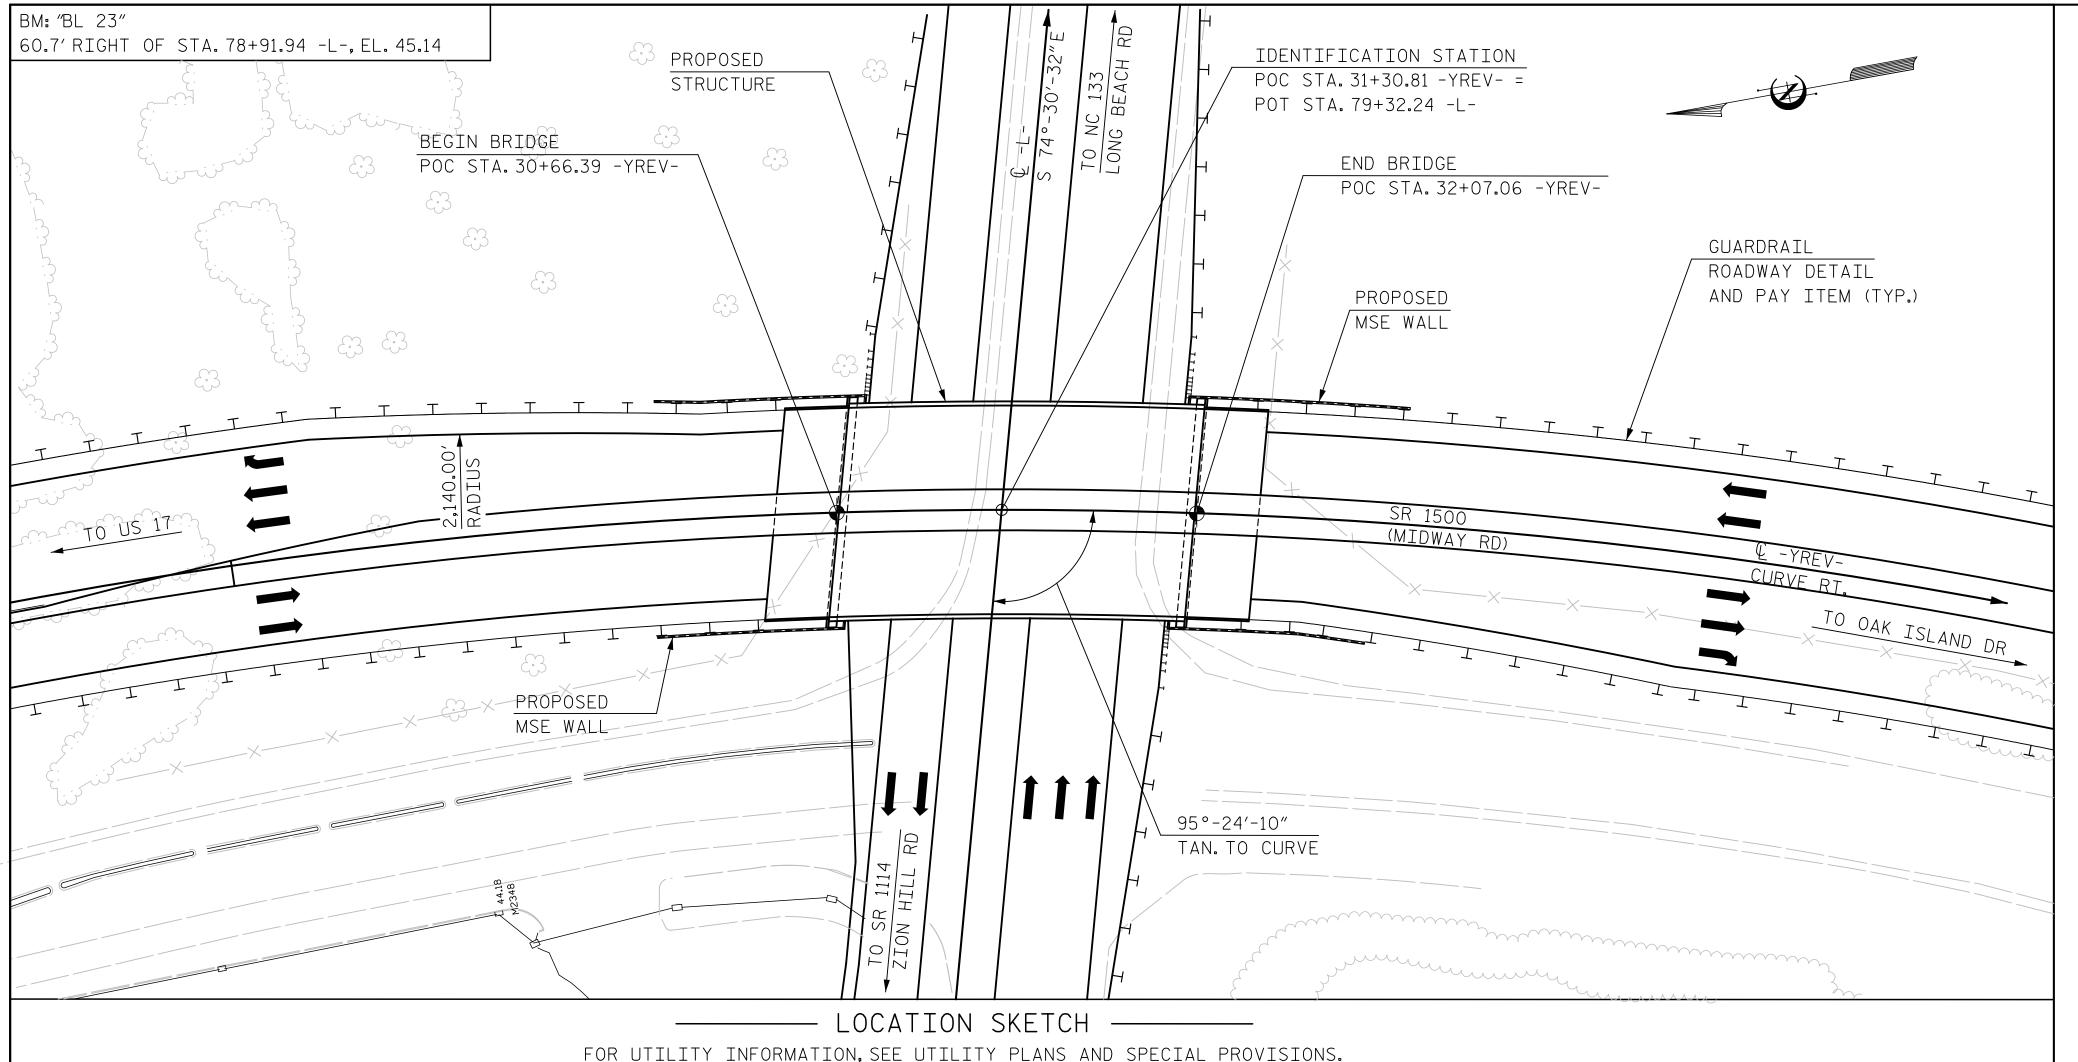

BRIDGE

APPROACH

SLABS,

STATION POC

31+30.81 -YREV-

LUMP SUM

LUMP SUM

LUMP SUM

REINFORCED

CONCRETE

DECK SLAB

SQ.FT.

11,740.0

11,740.0

PDA

TESTING

EA.

SUPERSTRUCTURE

END BENT

TOTAL

END BENT 2

GROOVING

BRIDGE

FLOORS

SQ.FT.

11,236.0

11,236.0

CLASS A

CONCRETE

CU. YDS.

54.2

53.9

108.1

TOTAL BILL OF MATERIAL

REINFORCING

STEEL

LBS.

9,931.0

9,890.0

19,821.0

MODIFIED

72"

PRESTRESSED

CONCRETE

GIRDERS

9 1,242.8

1,242.8

NO. L.F.

PILE DRIVING

EQUIPMENT

SETUP FOR

HP 12X53

STEEL PILES

EA.

16

16

32

HP 12X53

STEEL

PILES

L.F.

1,440.0

1,440.0

32 | 2,880.0

NO.

16

STEEL PILE

POINTS

EA.

32

PILE

REDRIVES

EA.

16

GENERAL NOTES

ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.

FOR OTHER DESIGN DATA AND GENERAL NOTES. SEE SHEET SN.

FOR EROSION CONTROL MEASURES SEE EROSION CONTROL PLANS.

THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN

SPECIFICATIONS.

REMOVABLE FORMS MAY BE USED IN LIEU OF METAL STAY-IN-PLACE FORMS IN ACCORDANCE

WITH ARTICLE
420-3 OF THE STANDARD SPECIFICATIONS.

FOR MAINTENANCE AND PROTECTION OF TRAFFIC BENEATH PROPOSED STRUCTURE, SEE SPECIAL PROVISIONS.

THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE SAMPLE BARS SHOULD COME FROM STEEL ACTUALLY USED IN THE PROJECT AND THE SAMPLE BARS SHOULD BE REPLACED BY SPLICED BARS AS SPECIFIED IN THE SAMPLE BAR REPLACEMENT CHART. PAYMENT FOR THE SAMPLE BARS AND REPLACEMENT REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.

NEEDLE BEAMS WILL NOT BE ALLOWED UNLESS OTHERWISE CALLED FOR ON THE PLANS OR APPROVED BY THE ENGINEER.

FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.

FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.

FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.

THE ELEVATION(S) AND CLEARANCE(S) SHOWN ON THE PLANS AT THE POINT(S) OF MINIMUM VERTICAL CLEARANCE ARE FROM THE BEST INFORMATION AVAILABLE.PRIOR TO BEGINNING BRIDGE CONSTRUCTION, VERIFY THE ELEVATION(S) ON THE EXISTING PAVEMENT AND CHECK THE CLEARANCE.REPORT ANY VARIATIONS TO THE ENGINEER.ANY PLAN REVISIONS NECESSARY TO ACHIEVE THE REQUIRED MINIMUM VERTICAL CLEARANCE WILL BE PROVIDED BY THE DEPARTMENT.

FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.

ELASTOMERIC

BEARINGS

LUMP SUM

LUMP SUM

LUMP SUM

THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.

	E BAR CEMENT
SIZE	LENGTH
#3	6'-2"
#4	7′-4″
#5	8′-6″
#6	9′-8″
#7	10'-10"
#8	12'-0"
#9	13′-2″
#10	14'-6"
#11	15′-10″

NOTE:
SAMPLE BAR REPLACEMENT
LENGTHS BASED ON 30"
(SAMPLE LENGTH) PLUS
TWO SPLICE LENGTHS
AND fy = 60ksi.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

SHEET 4 OF 4

Docusigned by:

| Both 180 B B 57368741E...

| The state of the state

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

SEAL 12916

4"

SLOPE

PROTECTION

SQ. YD.

34.0

33.0

67.0

CONCRETE

BARRIER

RAIL

L.F.

278.0

278.0

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

GENERAL DRAWING

LOCATION SKETCH, GENERAL NOTES, AND TOTAL BILL OF MATERIALS

	LINTE NORTH CARC	NINA D.C								
HNTB	HNTB NORTH CARC	·				REVISI	ONS			SHEET NO.
	343 E.Six Forks Rd.,	Suite 200, Raleigh, N	I.C. 27609	NO.	BY	DATE	NO.	BY	DATE	S3-4
DRAWN BY CHECKED BY	A. GOFF B. BOSLEY	DATE <u>6/18</u> DATE 6/18	DWG. NO. 4	1			3			TOTAL SHEETS
DESIGN ENGINEER O	F RECORD B.BOSLEY	DATE 12/18		2			4			25

LOAD AND RESISTANCE FACTOR RATING (LRFR) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS STRENGTH I LIMIT STATE SERVICE III LIMIT STATE MOMENT SHEAR MOMENT DISTI FACT DIST, LEFT SPAN IST IST ACT IVE ACT DIS LEF SPA T < N/A 1.75 0.87 1.38 ER 68.3 0.954 1.32 13.1 0.80 0.87 1.05 68.3 HL-93 (INVENTORY) 1.05 EL 68.3 0.954 HL-93 (OPERATING) 1.35 0.87 1.79 ER 1.75 DESIGN N/A 1.75 13.1 N/A LOAD 57.2 68.3 1.96 68.3 1.59 0.954 RATING HS-20 (INVENTORY 36.000 1.75 0.87 2.09 ER 13.1 0.80 0.87 1.59 EL 2.59 HS-20 (OPERATING) 36.000 2.59 93.2 1.35 0.87 2.71 ER 68.3 0.954 13.1 N/A SNSH 13.500 3.90 52.6 1.40 0.87 ER 68.3 0.954 6.49 13.1 0.80 0.87 3.90 68.3 6.42 EL 68.3 0.954 SNGARBS2 2.77 55.4 1.40 0.87 4.55 ER 4.45 68.3 20.000 13.1 0.80 0.87 2.77 EL 68.3 4.08 2.56 0.954 SNAGRIS2 22.000 2.56 56.3 1.40 0.87 4.22 ER 13.1 0.80 0.87 EL 68.3 52.8 27.250 1.94 0.87 3.19 68.3 0.954 0.80 68.3 SNCOTTS3 1.40 ER 3.16 13.1 0.87 1.94 SNAGGRS4 34.925 1.56 54.4 1.40 0.87 2.58 ER 68.3 0.954 2.52 13.1 0.80 0.87 1.56 68.3 EL 2.52 1.53 54.4 1.40 0.87 ER 68.3 0.954 2.51 1.53 68.3 SNS5A 35.550 13.1 0.80 0.87 EL 68.3 0.954 2.25 SNS6A 39.950 1.38 55.1 1.40 0.87 2.28 ER 0.80 0.87 1.38 EL 68.3 13.1 68.3 68.3 55.4 LEGAL LOAD 0.87 0.954 0.80 0.87 SNS7B 42.000 1.40 2.17 ER 2.17 13.1 1.32 68.3 2.73 68.3 ER TNAGRIT3 33.000 1.68 55.4 1.40 0.87 2.77 0.954 13.1 0.80 0.87 1.68 EL 1.68 55.5 1.40 0.87 ER 68.3 0.954 2.69 1.68 68.3 TNT4A 33.075 2.77 13.1 0.80 0.87 EL 41.600 1.36 56.5 1.40 0.87 ER 68.3 0.954 2.25 0.80 0.87 1.36 EL 68.3 TNT6A 2.23 13.1 68.3 1.35 0.87 2.23 68.3 0.954 2.22 0.80 TNT7A 42.000 56.7 1.40 ER 13.1 0.87 1.35 68.3 68.3 TNT7B 42.000 1.38 57.9 1.40 0.87 2.26 ER 0.954 2.14 13.1 0.80 0.87 1.38 EL --68.3 TNAGRIT4 43.000 1.33 57.1 1.40 0.87 2.18 ER 0.954 2.08 0.80 0.87 1.33 EL 68.3 TNAGRT5A 45.000 56.7 1.40 0.87 2.07 ER 68.3 0.954 2.02 0.80 0.87 1.26 EL 68.3 1.26

68.3

ER

0.954

1.98

0.80

END BENT 2

13.1

0.87

1.25

LOAD FACTORS:

DESIGN LOAD RATING	LIMIT STATE	γ_{DC}	$\gamma_{\sf DW}$
RATING	STRENGTH I	1.25	1.50
FACTORS	SERVICE III	1.00	1.00

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:

(#) CONTROLLING LOAD RATING

1 DESIGN LOAD RATING (HL-93)

 $\langle 2 \rangle$ DESIGN LOAD RATING (HS-20)

 $\langle 3 \rangle$ LEGAL LOAD RATING **

** SEE CHART FOR VEHICLE TYPE


GIRDER LOCATION

I - INTERIOR GIRDER

EL - EXTERIOR LEFT GIRDER

ER - EXTERIOR RIGHT GIRDER

R-5021 PROJECT NO. _ BRUNSWICK COUNTY **STATION**: POC 31+30.81 -YREV-

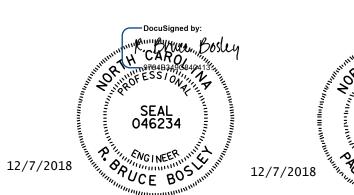

68.3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

NO.

STANDARD

LRFR SUMMARY FOR PRESTRESSED (NON-INTERSTATE TRAFFIC)

REVISIONS

BY DATE NO. BY DATE

DESIGN ENGINEER OF RECORD B.BOSLEY DATE 12/18

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB	HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609							
DRAWN BY	L. WATERS	DATE 6/18						
CHECKED BY	B. BOSLEY	DATE 6/18	DWG. NO. 5					

total sheets 25 STD. NO. LRFR1

SHEET NO.

S3-5

ASSEMBLED BY : LLW DATE : 12/17 CHECKED BY: RBB DATE : 12/17 DRAWN BY: MAA 1/08 REV. 11/12/08RR MAA/GM CHECKED BY : GM/DI 2/08

END BENT 1

TNAGRT5B

45.000

1.25

56.2


1.40


0.87

2.06

136′-8″


LRFR SUMMARY

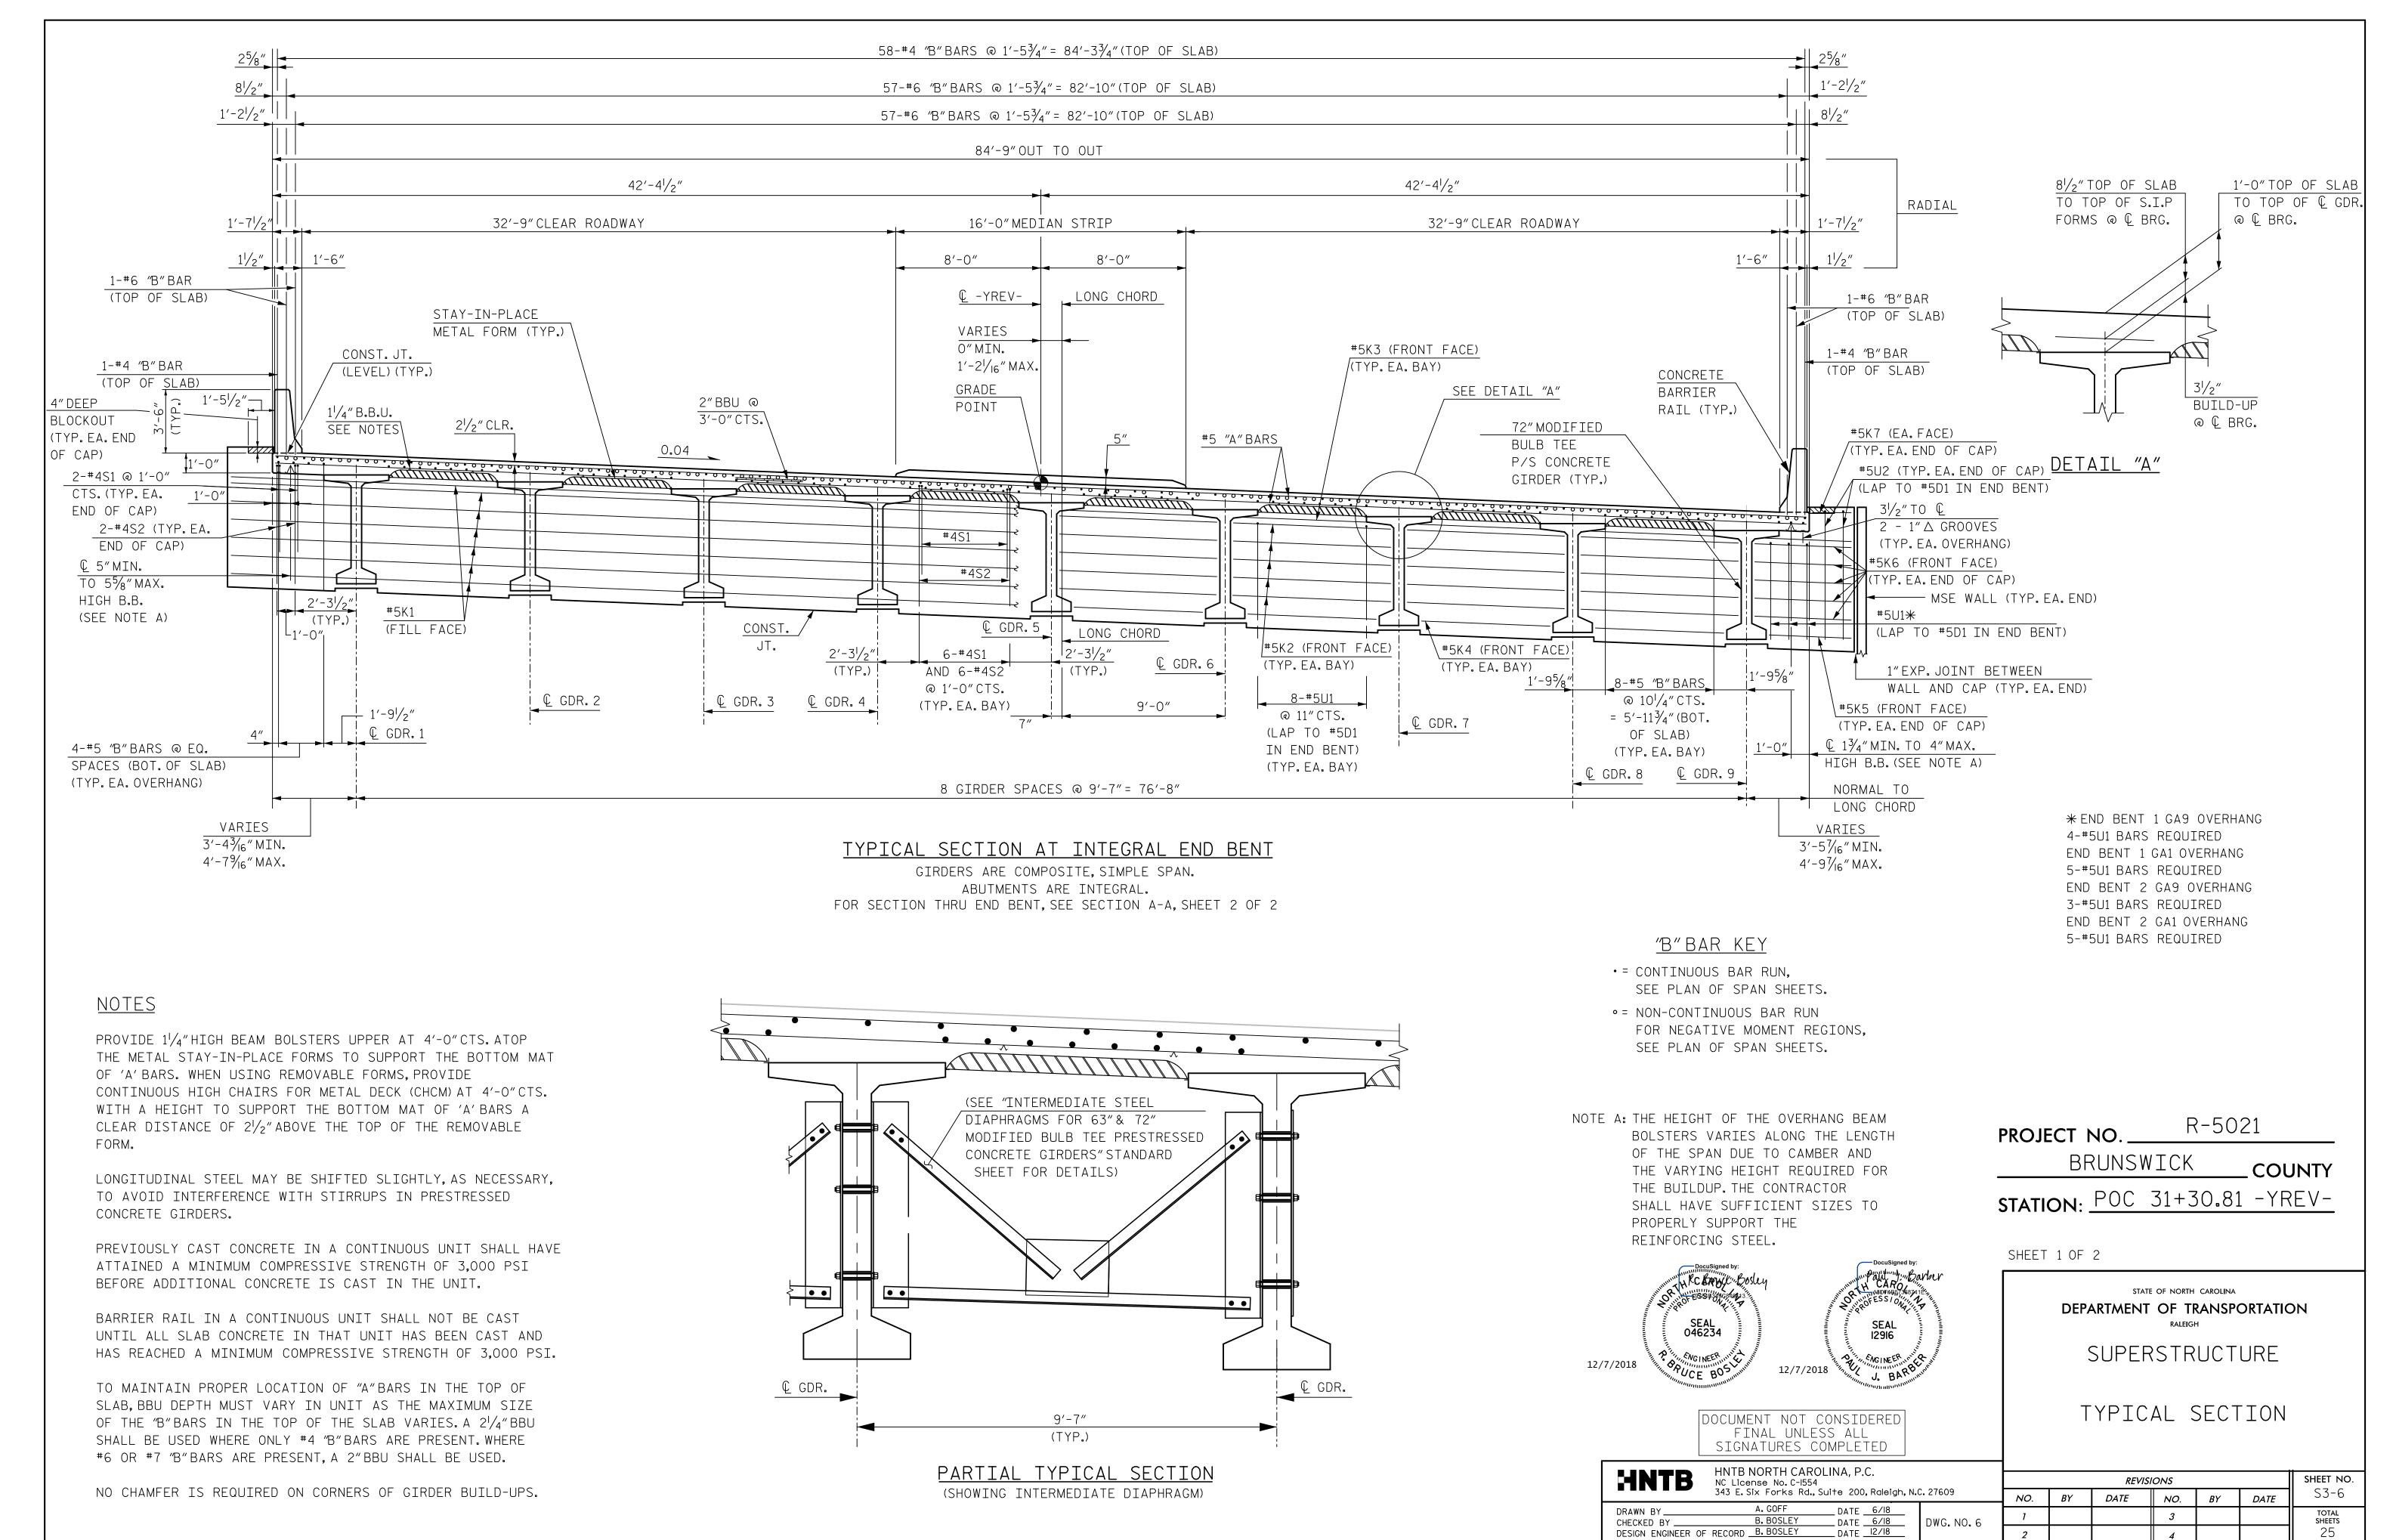

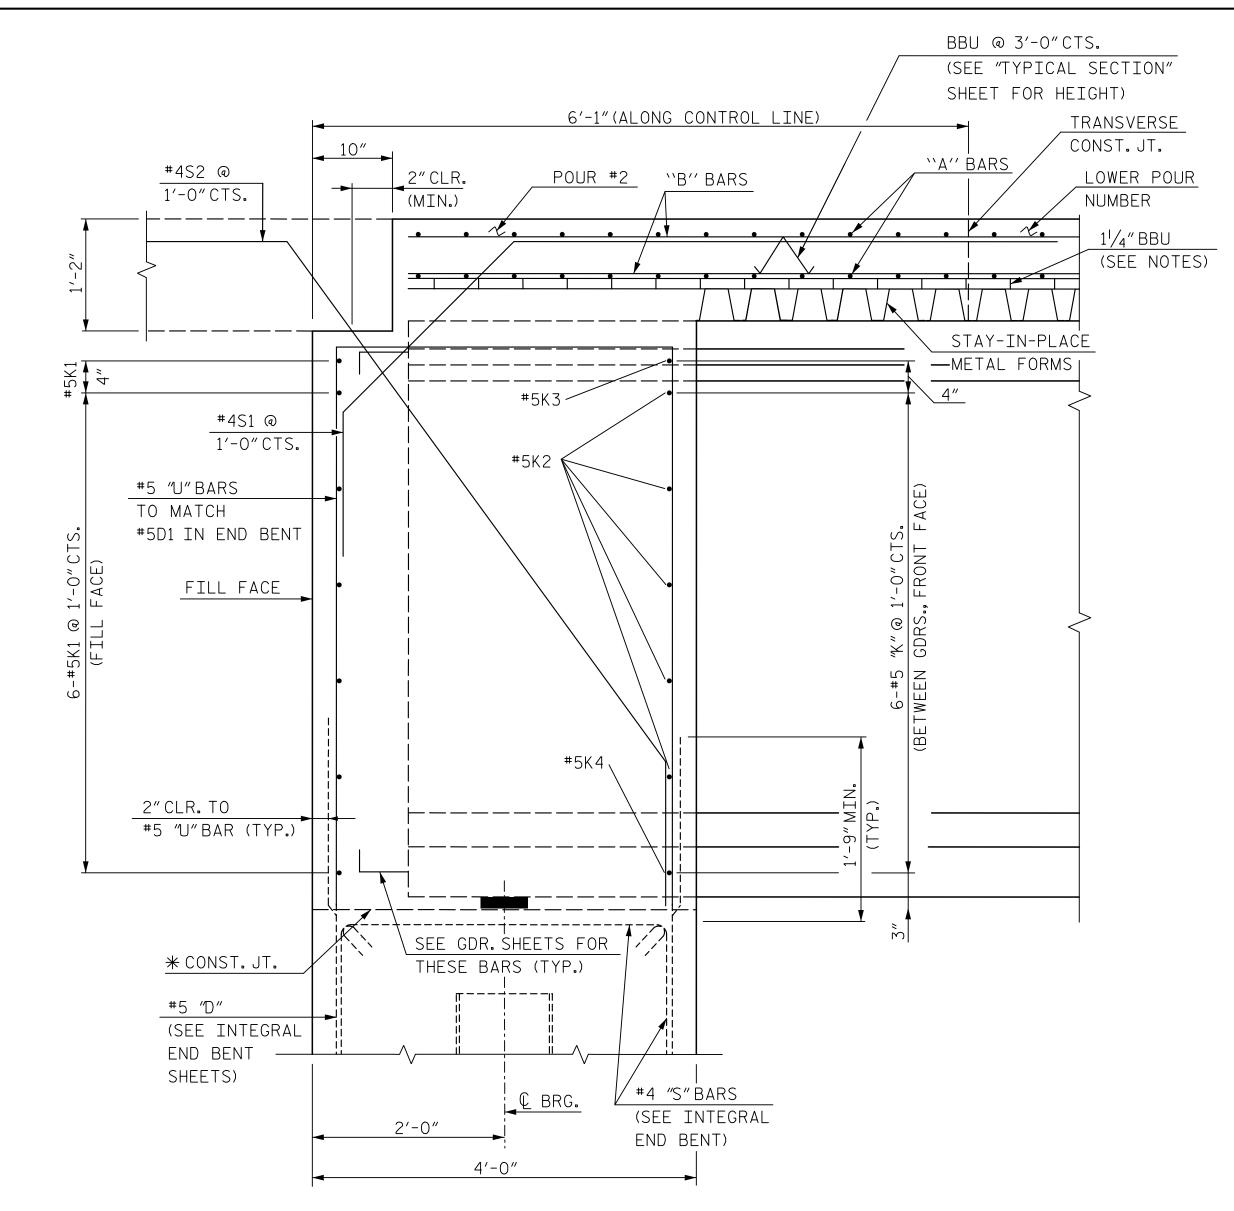


SECTION A-A (END BENT 1 SHOWN, END BENT 2 SIMILAR)

* THE TOP SURFACE OF THE END BENT CAP EXCLUDING THE BEARING AREA SHALL BE RAKED TO A DEPTH OF 1/4".

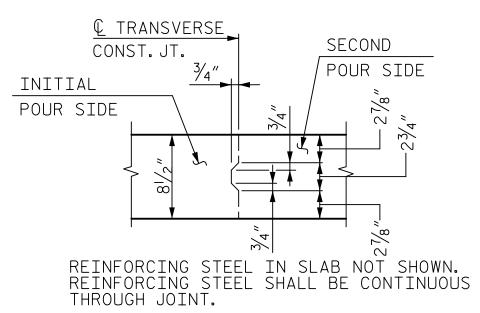

TRANSVERSE CONSTRUCTION
JOINT DETAIL

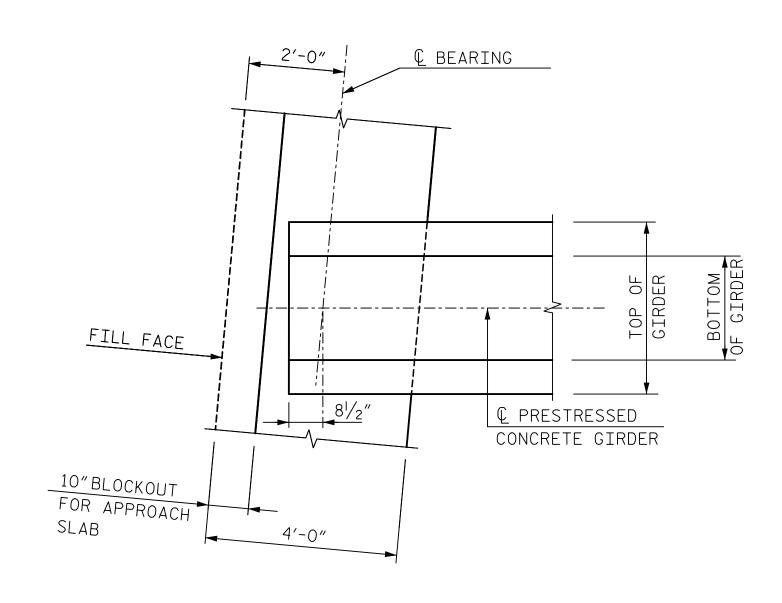


PLAN OF GIRDER AT INTEGRAL END BENT 1
(END BENT 2 SIMILAR)

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

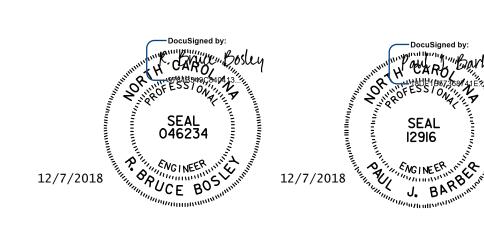

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL

SIGNATURES COMPLETED


SHEET 2 OF 2


STATE OF NORTH CAROLINA


DEPARTMENT OF TRANSPORTATION
RALEIGH


SUPERSTRUCTURE
TYPICAL SECTION
DETAILS

			ł						
HNTE	HNTB NORTH CAROLINA, P.C. NC License No. C-1554				REVIS	IONS			SHEET NO.
	343 E. Six Forks Rd., Suite 200, Raleigh, N.	C. 27609	NO.	BY	DATE	NO.	BY	DATE	S3-7
DRAWN BY CHECKED BY	A. GOFF DATE 6/18 J. ELKINS DATE 6/18	DWG. NO. 7	7			3			TOTAL SHEETS
DESIGN ENGINEE		B W O E Y O E	2			4			25

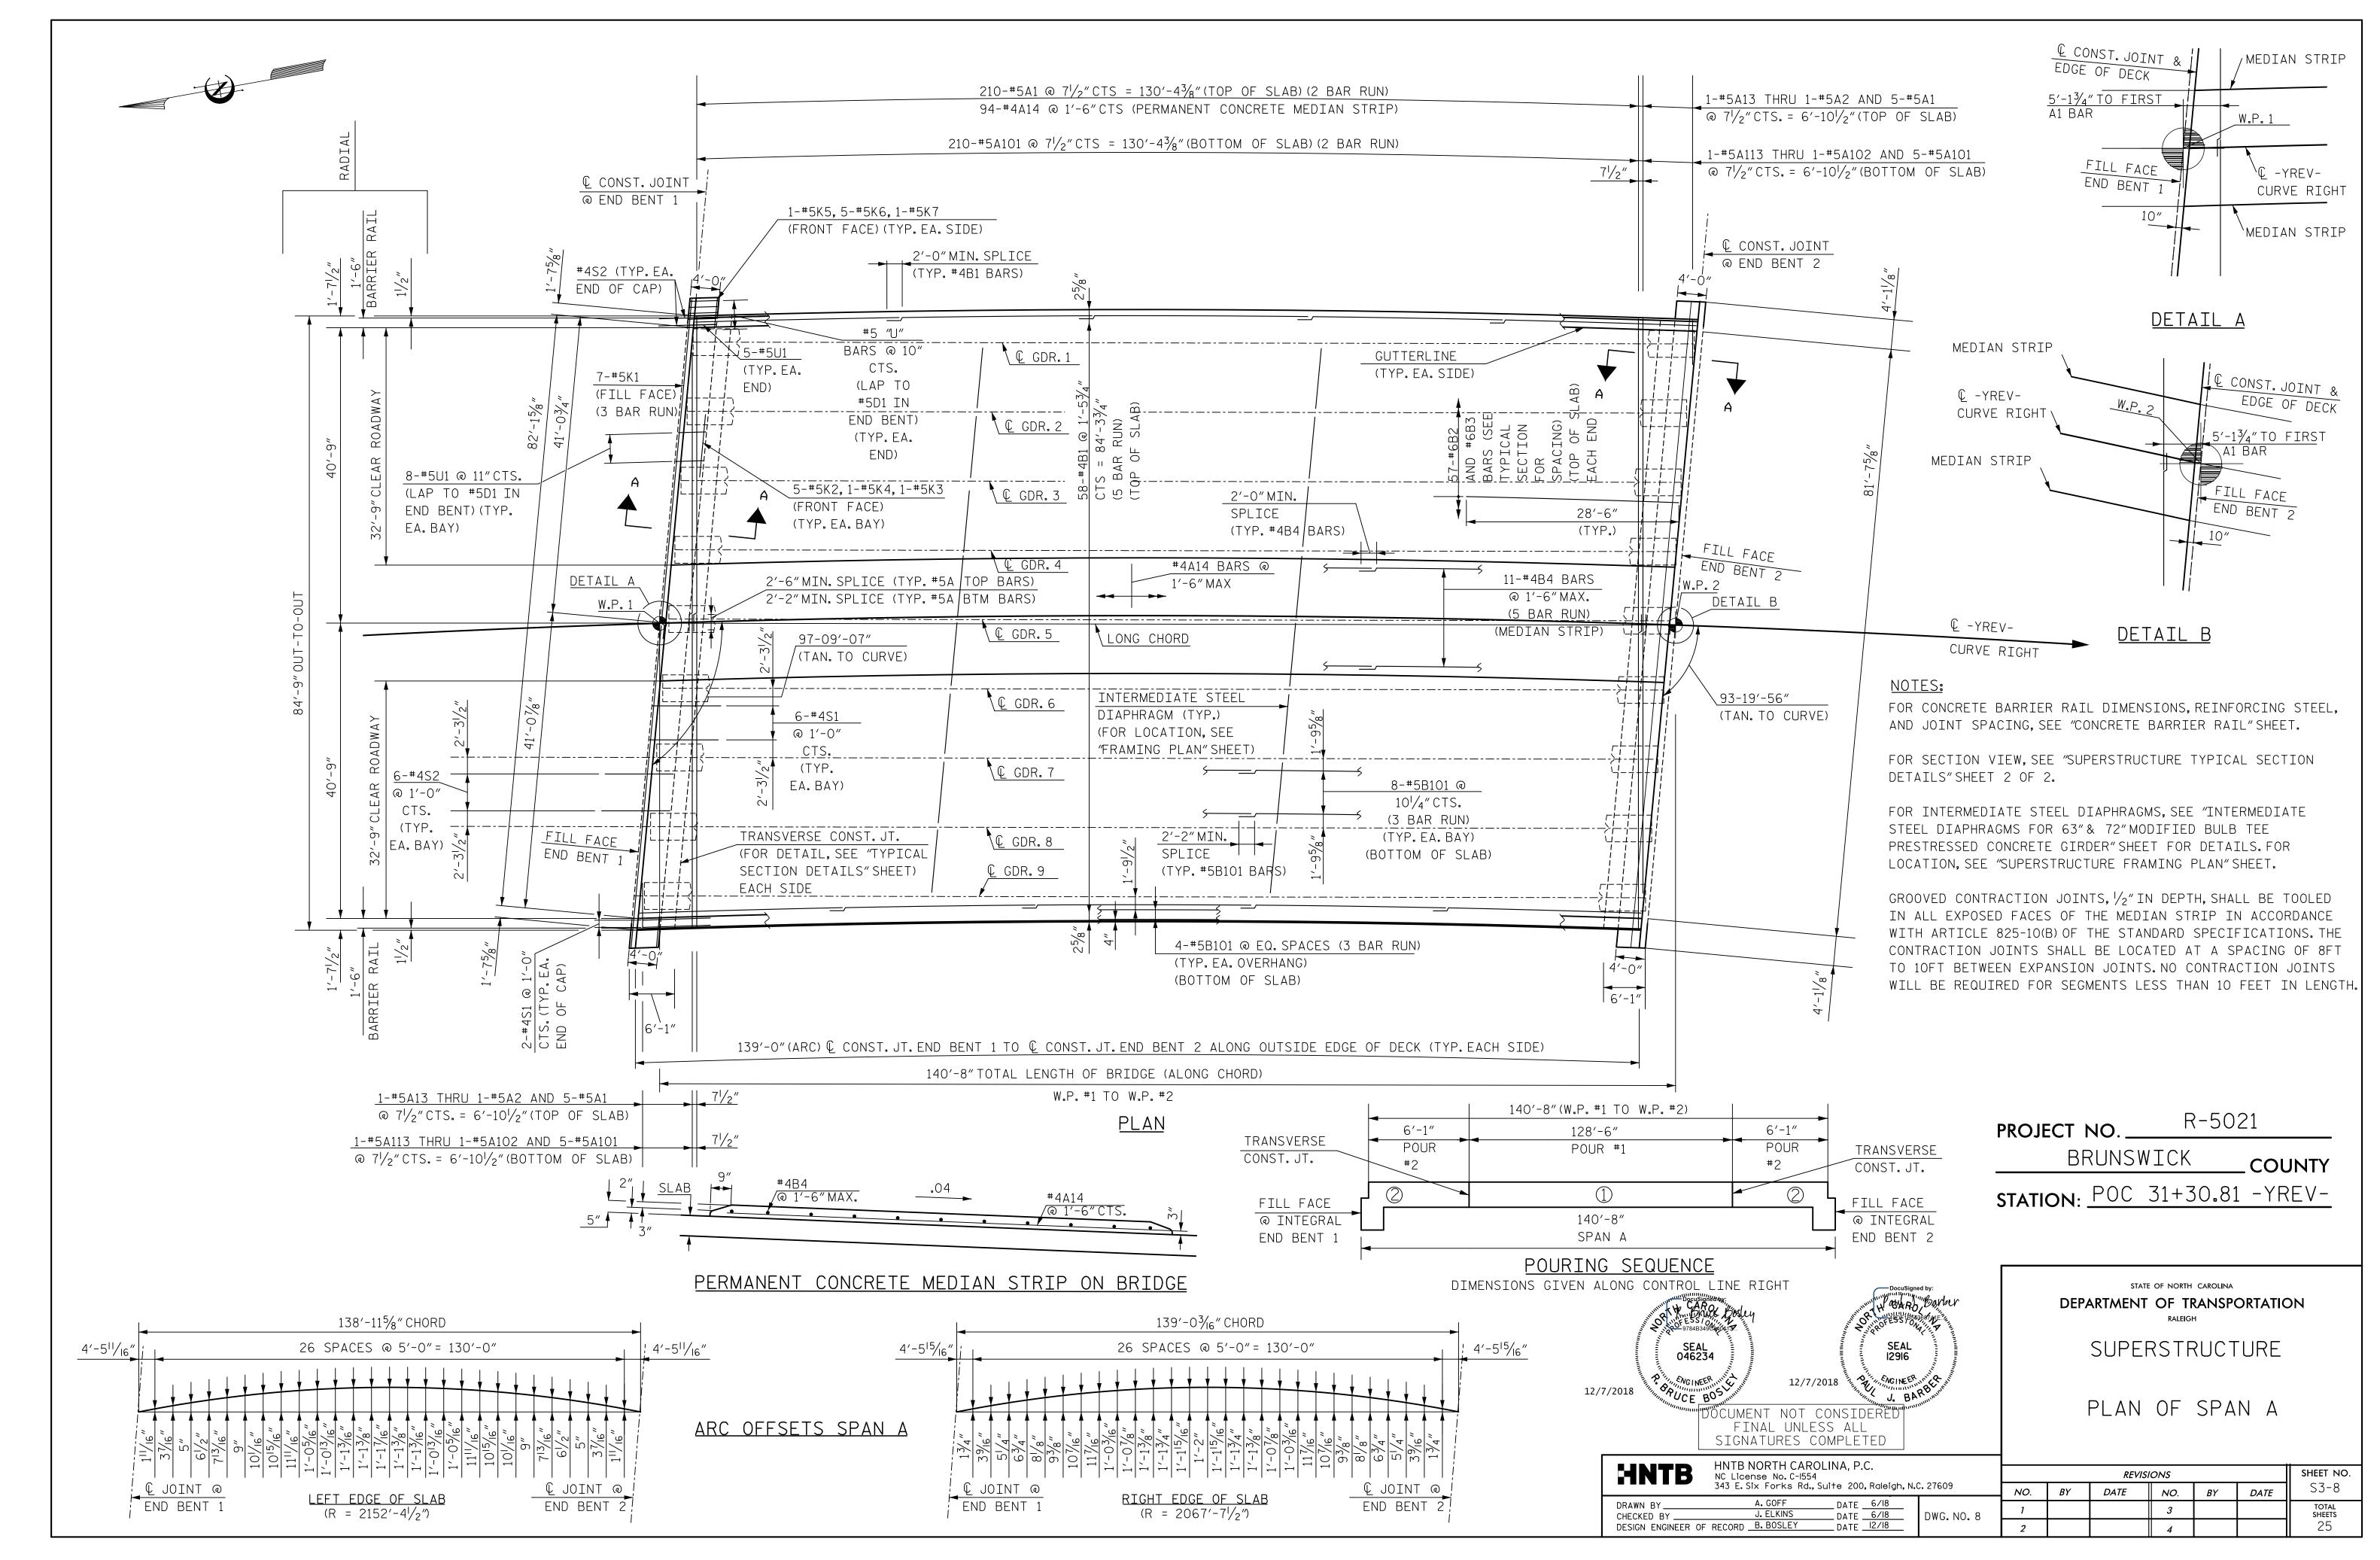

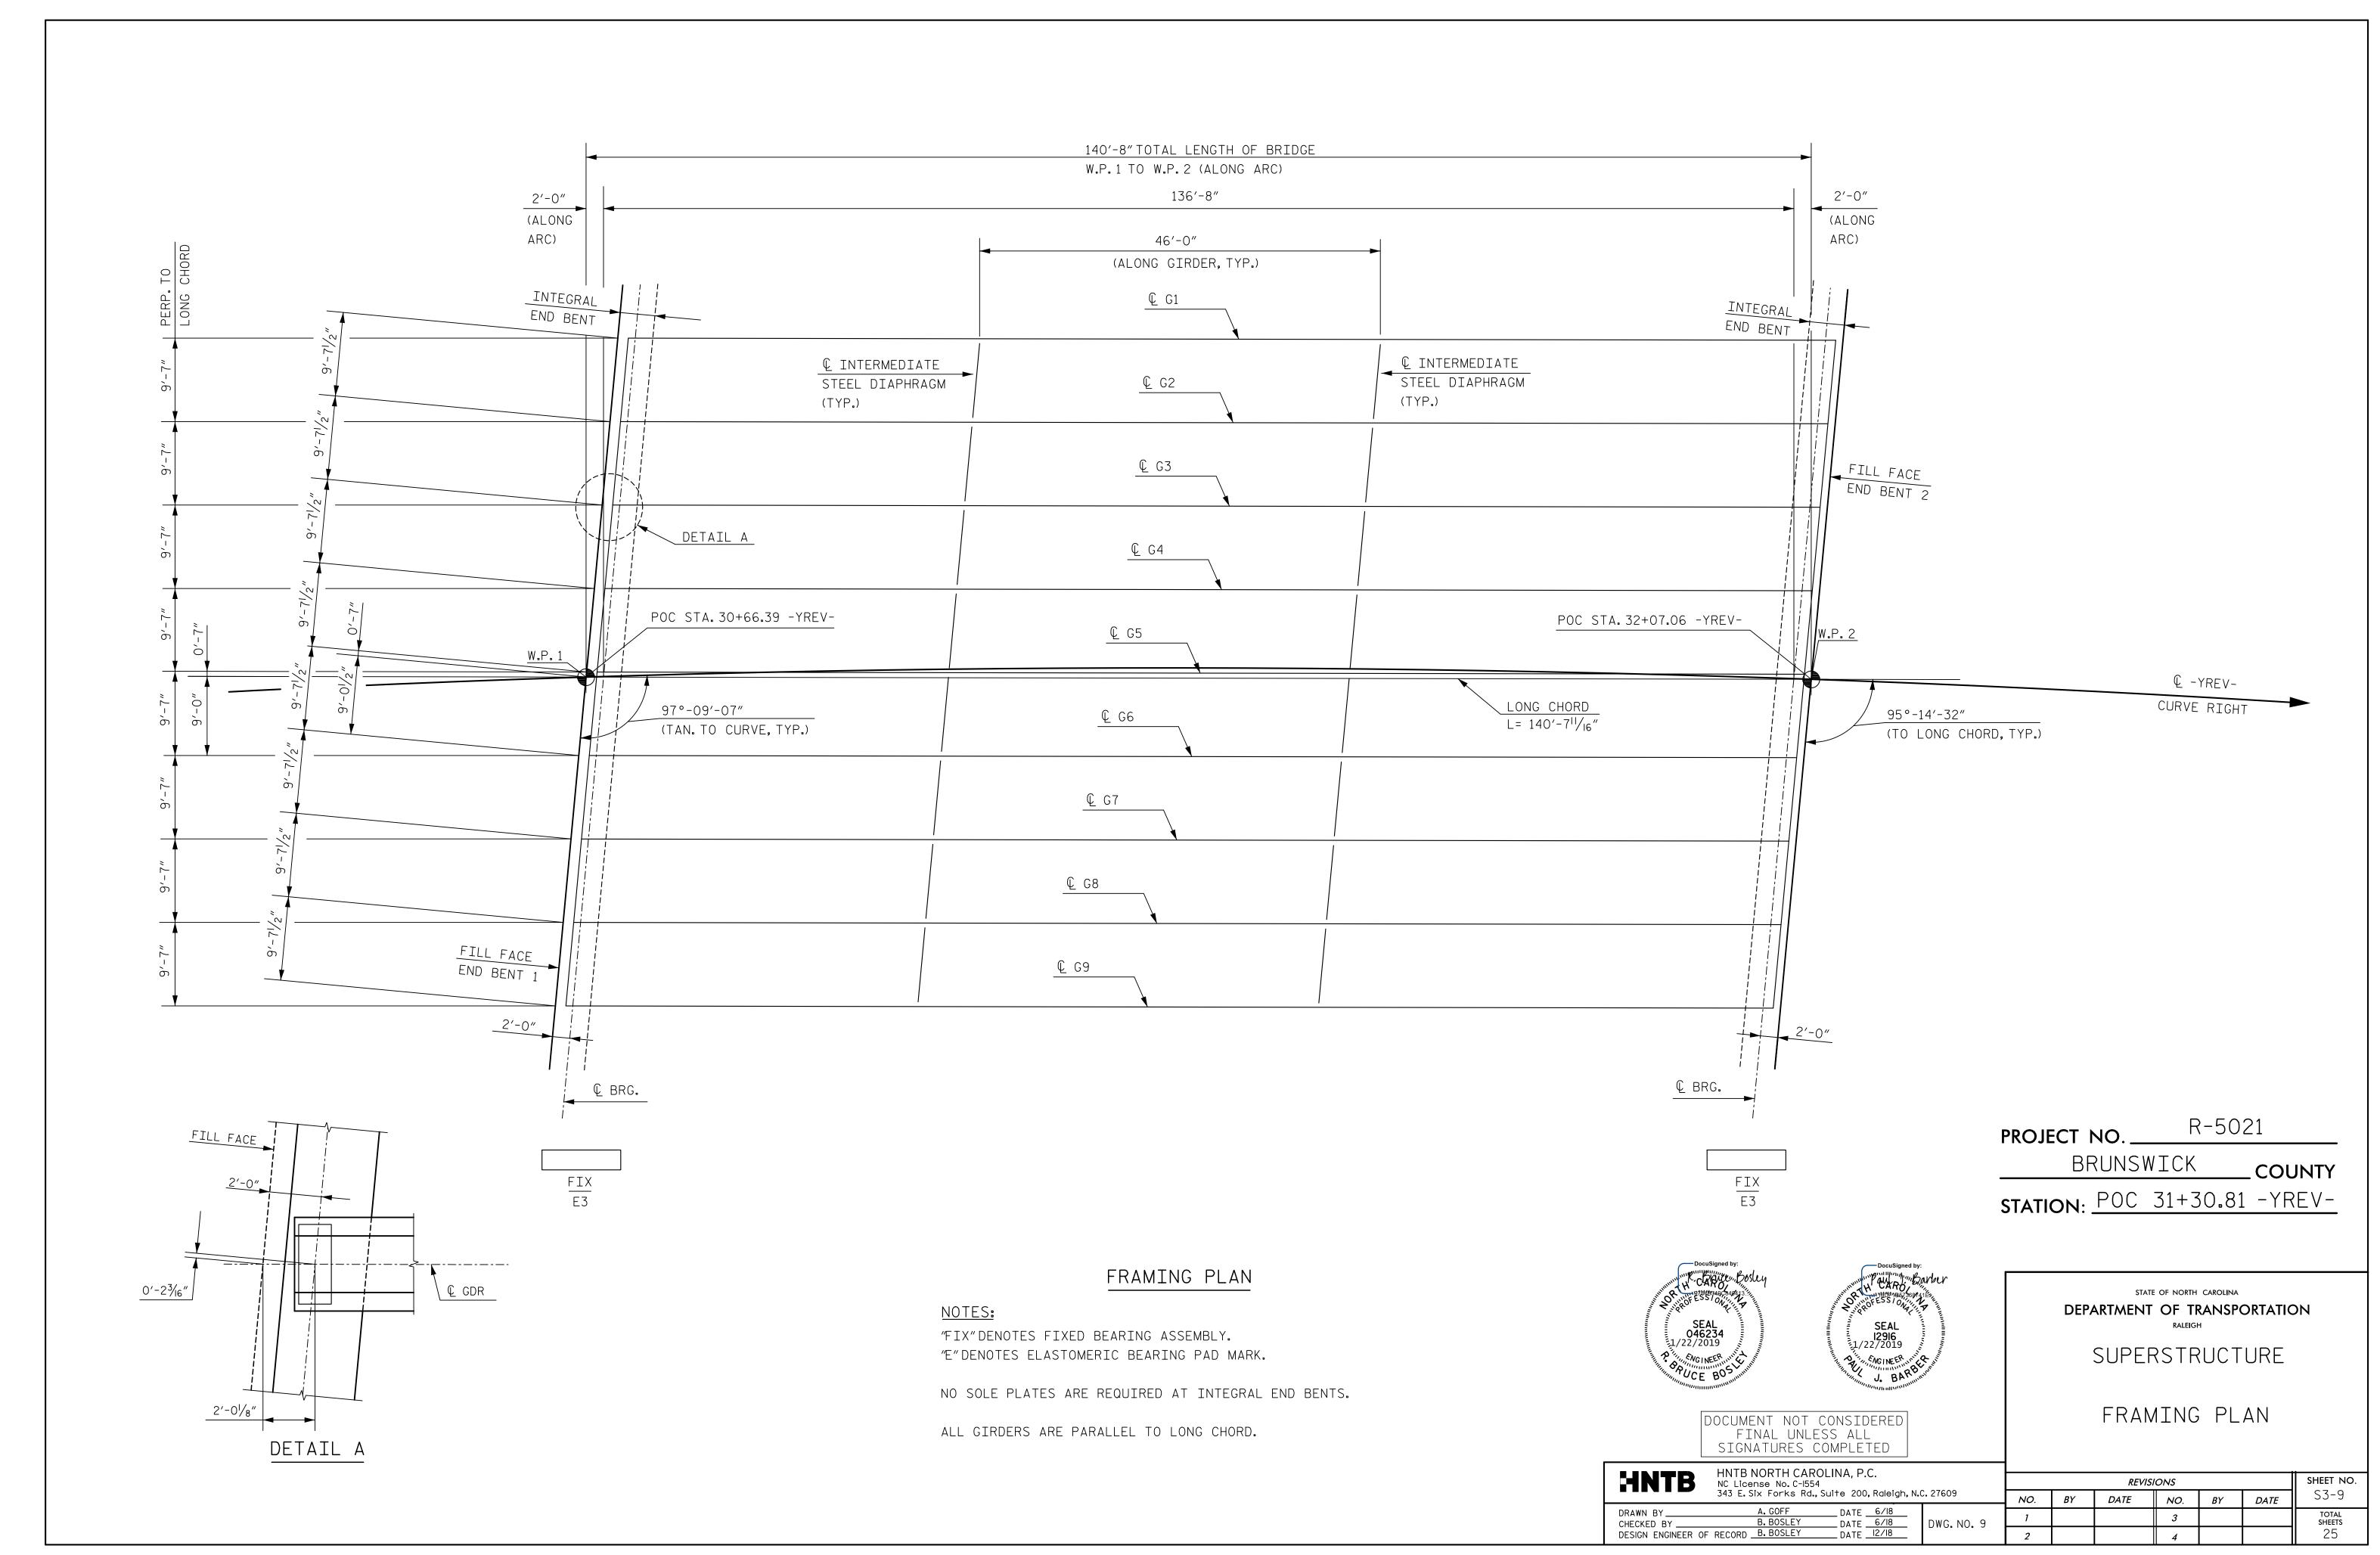

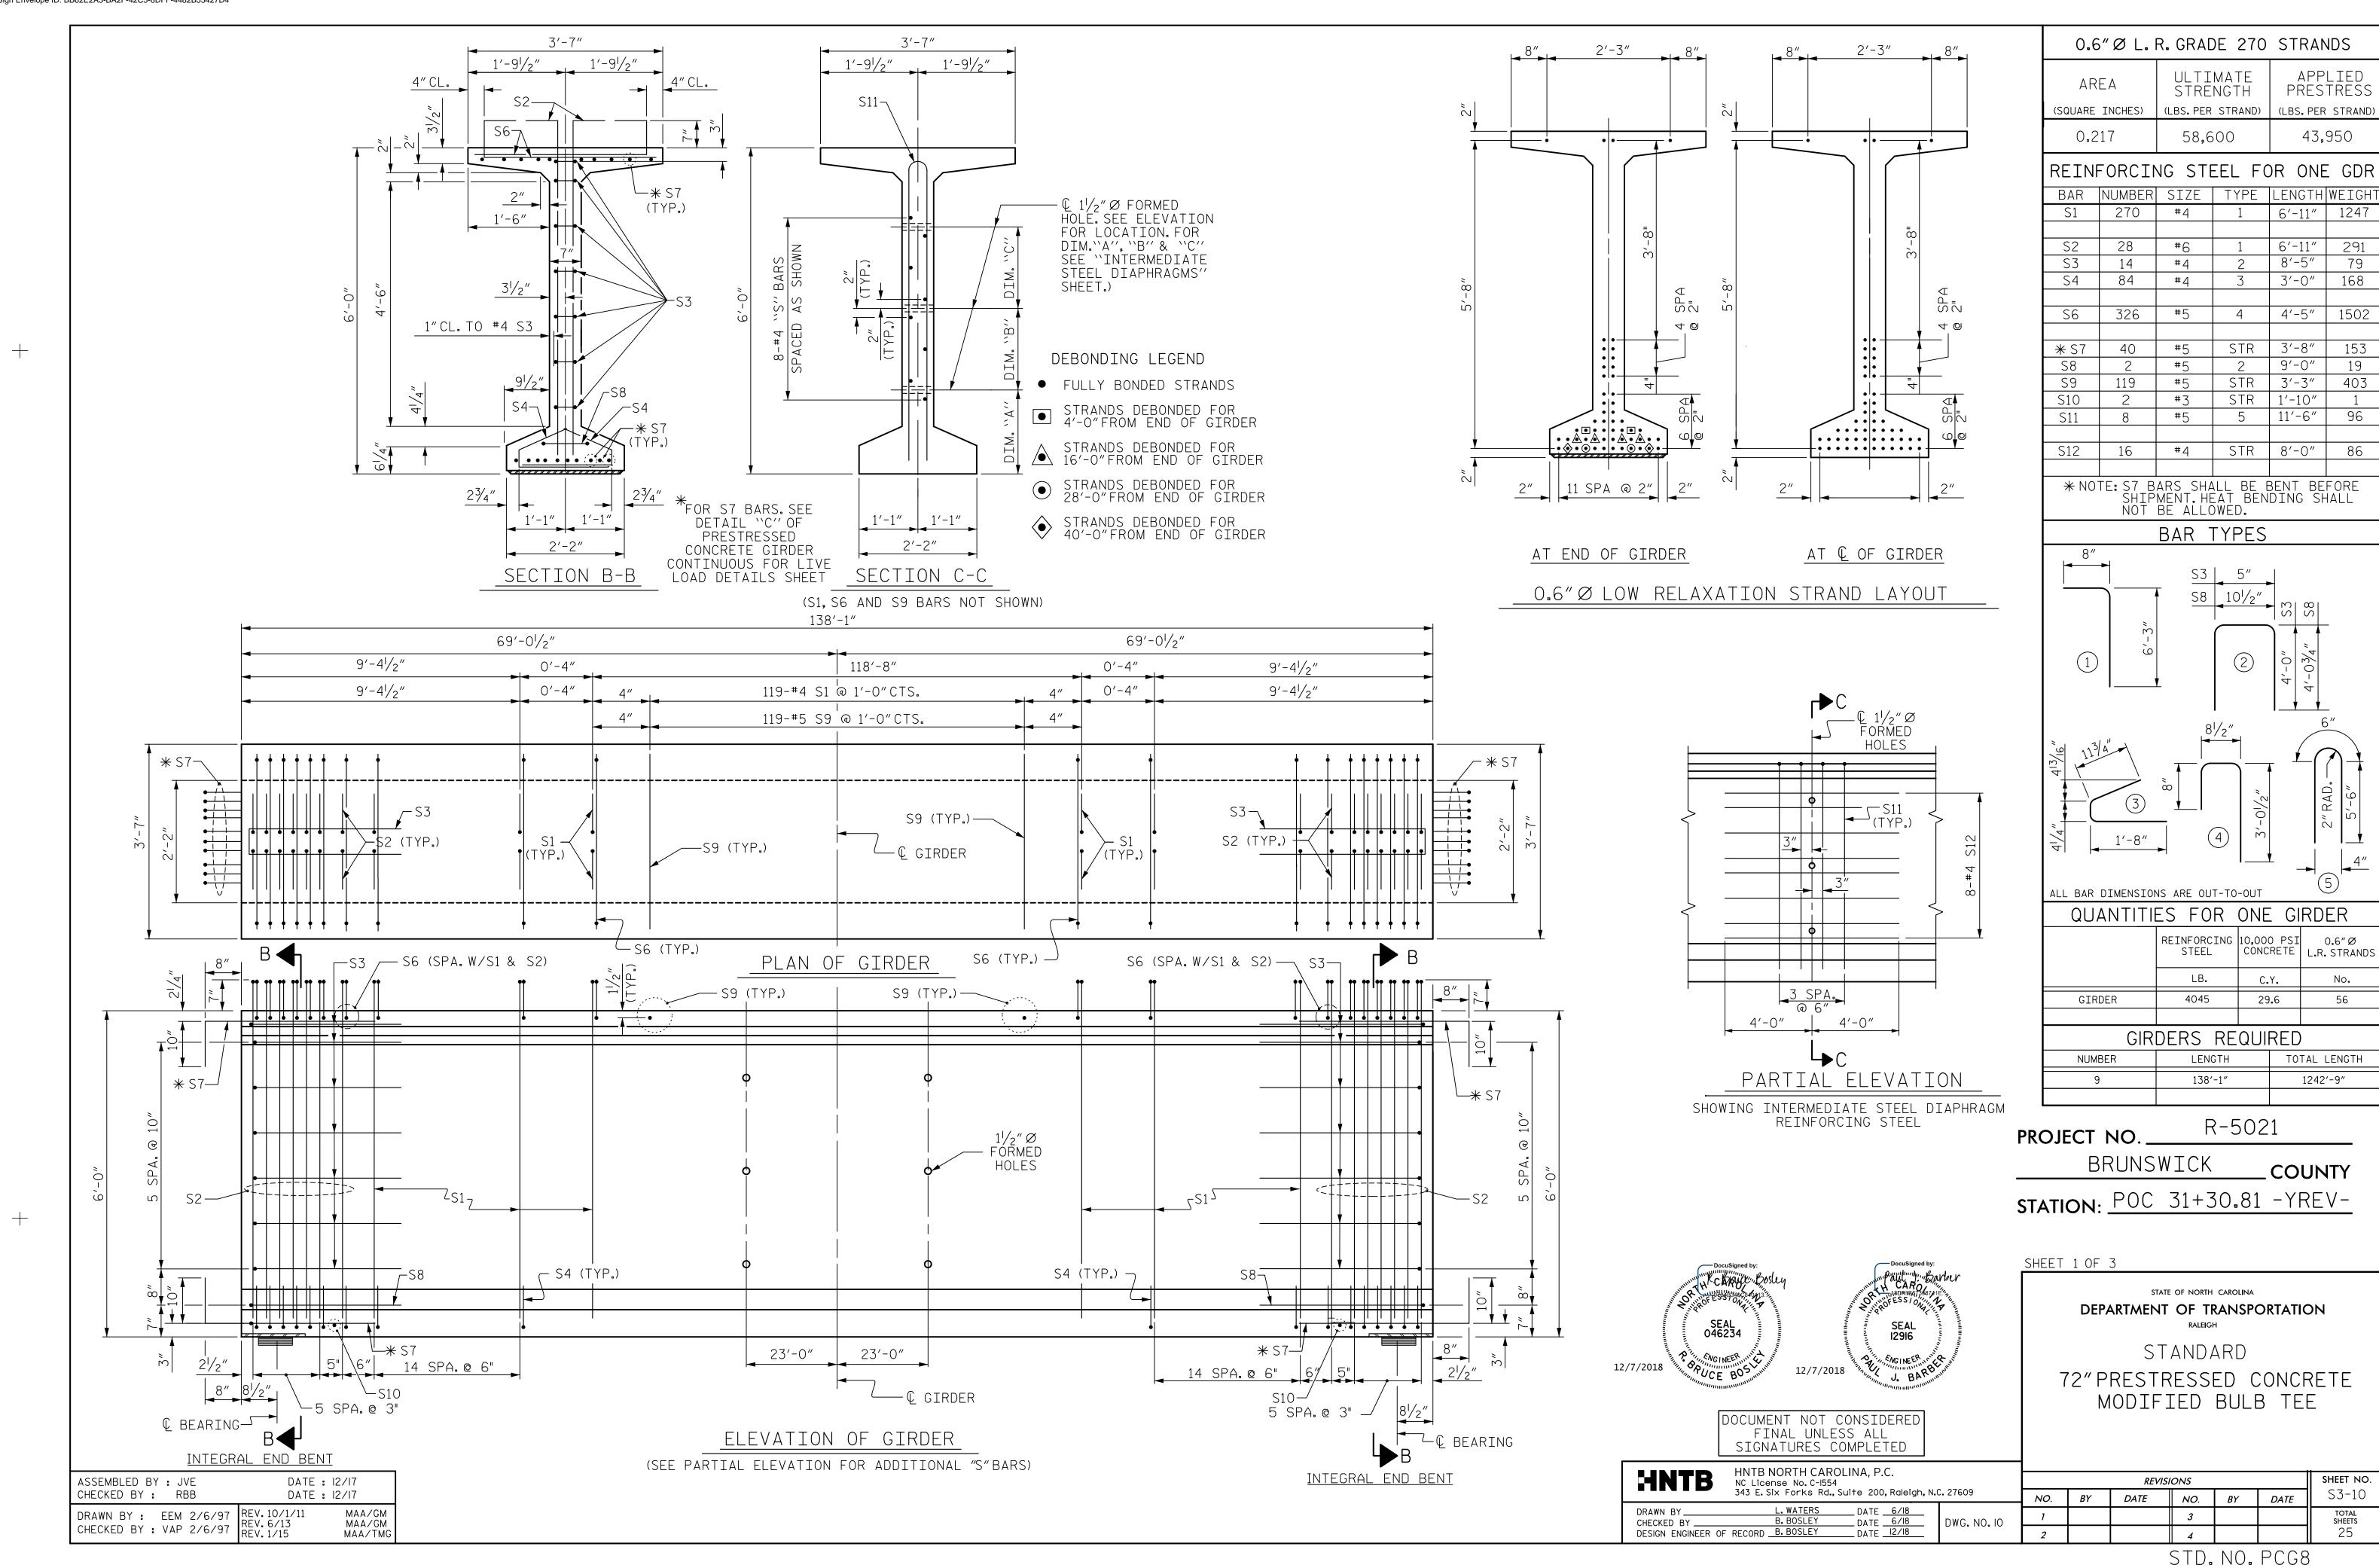

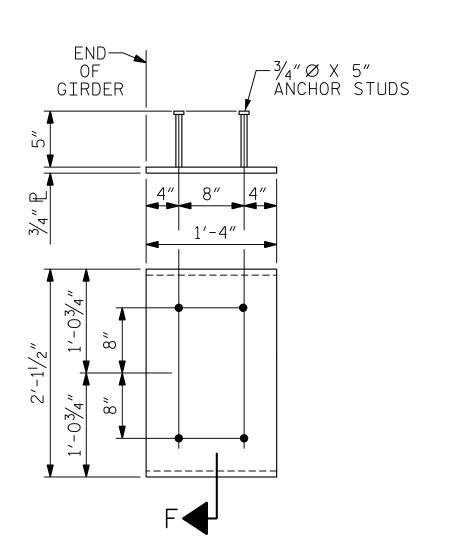


EMBEDDED PLATE "B-1" DETAILS FOR 72" MODIFIED BULB TEES

(2 REQ'D PER GIRDER)

→ ¾"BEVEL EDGE

SECTION "F"

(SEE NOTES)

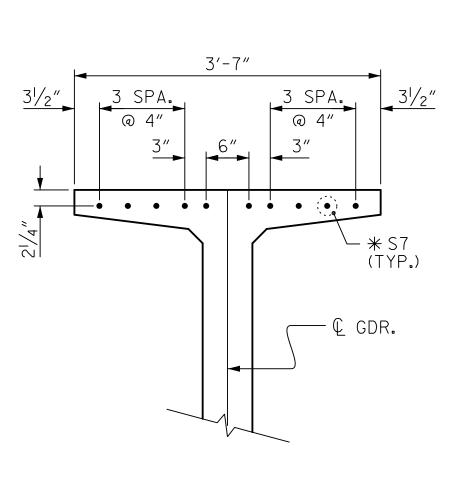

DETAIL "B" (FOR 72" MODIFIED BULB TEES)

└ Ç GIRDER ____S7 (TYP.) 2'-2"

> DETAIL ''C" (FOR 72" MODIFIED BULB TEES)

> > 12/7/2018

R-5021 PROJECT NO. _ BRUNSWICK COUNTY **STATION**: POC 31+30.81 -YREV-

SHEET 2 OF 3

NOTES

EMBEDDED PLATE "B-1" SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD

EQUAL, AND SHALL MEET THE TYPE "B" REQUIREMENTS OF SUBSECTION 7.3 OF THE

AT ENDS OF GIRDERS TO BE EMBEDDED IN CONCRETE DIAPHRAGMS OR END WALLS,

PRESTRESSING STRANDS MAY EXTEND A MAXIMUM OF 2" BEYOND THE GIRDER ENDS. OTHERWISE, PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE GIRDER ENDS.

CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 7,700 PSI.

ANCHORS MAY BE NECESSARY IN THE PRESTRESSED CONCRETE GIRDER.

FLANGE OF THE 63" AND 72" MODIFIED BULB TEES ONLY.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE GIRDER SHALL BE DONE WHEN

DEPENDING ON THE TYPE OF SYSTEM USED TO SUPPORT THE DECK SLAB FORMS, PRESET

THE TOP SURFACE OF THE GIRDER, EXCLUDING THE OUTSIDE 4", SHALL BE RAKED TO A

A 2" × 2" CHAMFER IS ALLOWED AT THE INTERSECTION OF THE WEB AND THE BOTTOM

IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL SHALL BE GRADE 60.

ANSI/AASHTO/AWS D1.5 BRIDGE WELDING CODE.

SPECIFICATIONS.

DEPTH OF 1/4".

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE

ANCHOR STUDS SHALL CONFORM TO AASHTO M169 GRADES 1010 THROUGH 1020 0R APPROVED

12/7/2018 12/7/2018

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

STANDARD

PRESTRESSED CONCRETE GIRDER CONTINUOUS FOR LIVE LOAD DETAILS

FINAL UNLESS ALL SIGNATURES COMPLETED HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609 DATE 6/18
DATE 6/18
DATE 12/18 DWG. NO. II

DOCUMENT NOT CONSIDERED

REVISIONS SHEET NO. S3-11 NO. BY DATE BY DATE NO. total sheets 25

STD. NO. PCG9



DATE : 5/18 ASSEMBLED BY : LLW DATE : 5/18 CHECKED BY : JVE MAA/GM MAA/TMG MAA/TMG DRAWN BY: ELR 11/91 CHECKED BY: GRP 11/91

Ĺ GDR.──

SECTION A-A

DATE : 12/17

DATE : 12/17

MAA/GM

ADDED II/23/09R

WITH 11/16' Ø \
HOLES SEE ____
TABLE FOR

LENGTH "L" (TYP.)

ASSEMBLED BY : JVE

CHECKED BY: RBE

DRAWN BY: RWW II/09

CHECKED BY: GM II/09

/ SKEW ANGLE

— € 1"Ø H.S. BOLT AND

2 HARDENED WASHERS (TYP.)

© DIAPH.-


—— (£ 7%"Ø H.S.BOLT, —— 2 hardened washers and DTI (TYP.)

8"X 6"X 1/2" BENT ₽——)
SEE TABLE FOR LENGTH "L"

(TYP.)

 $-L 3 X 3 X \frac{5}{16}$

CONNECTION DETAILS

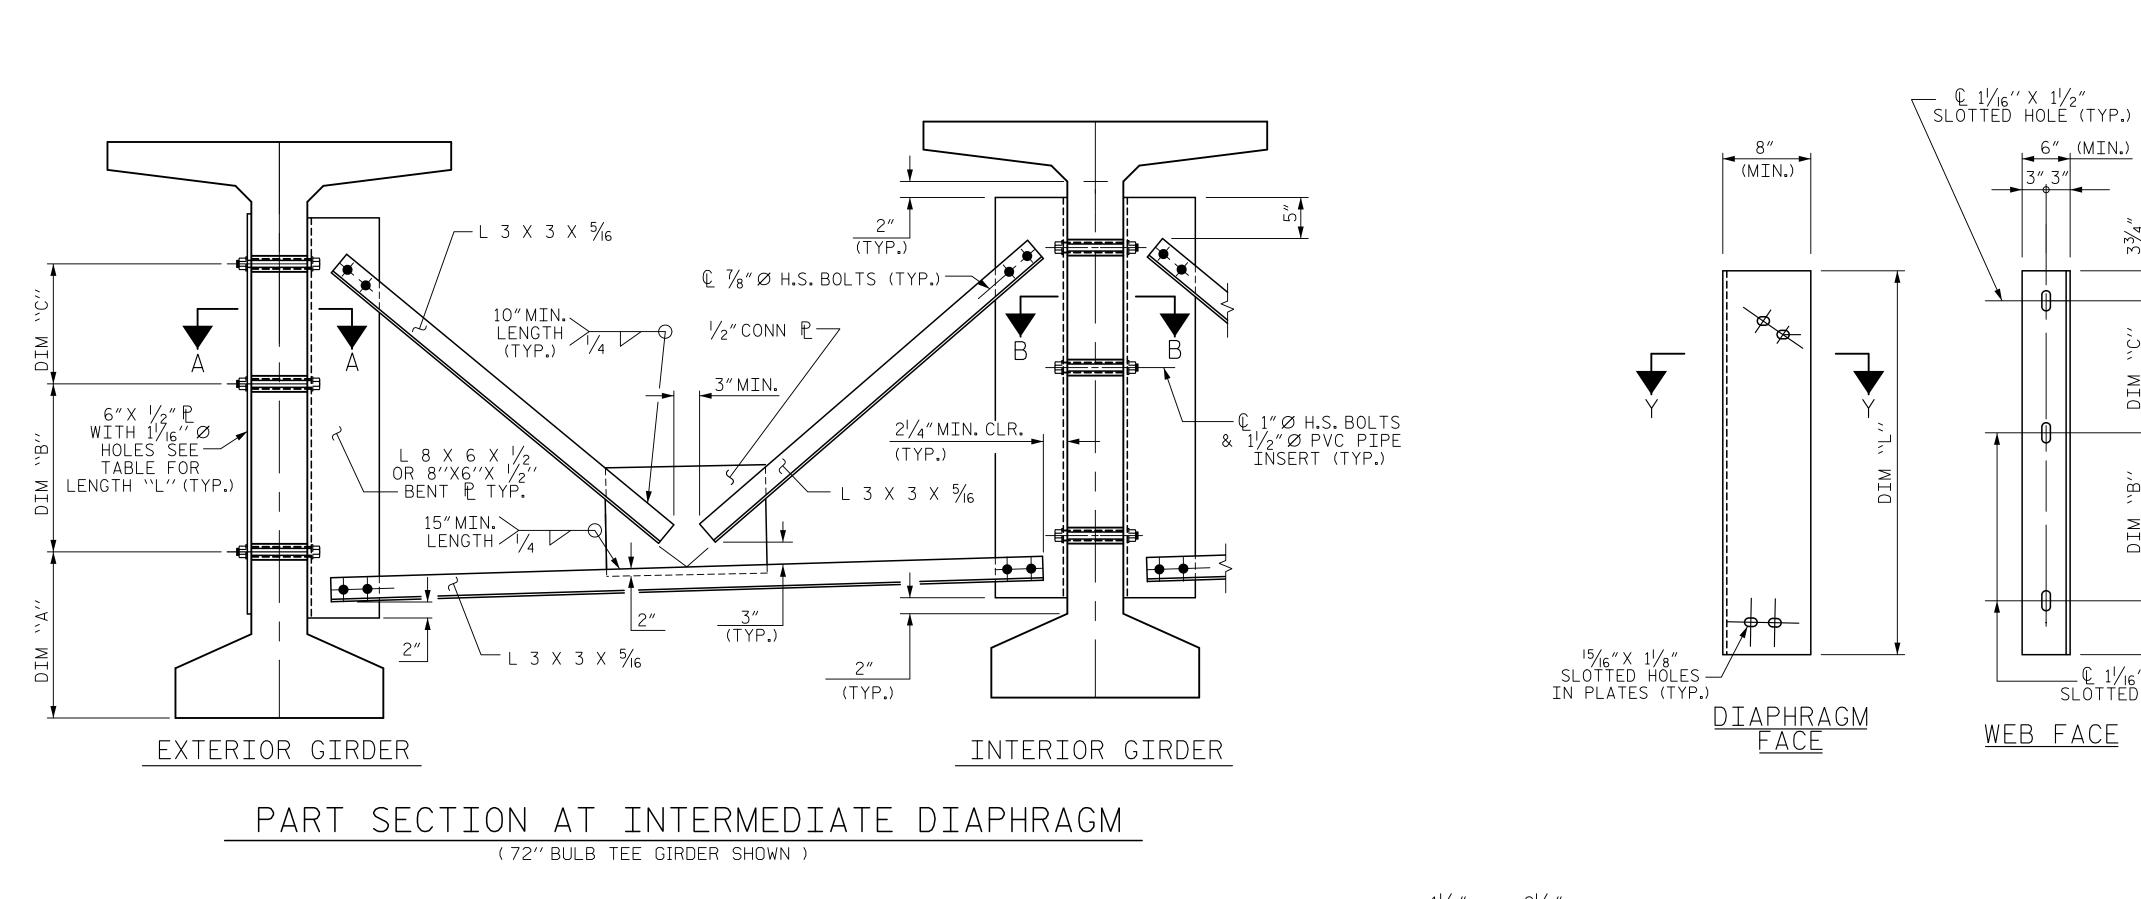

←£ GDR.

SECTION B-B

-90°-00′-00″

FOR BOLT CONNECTION
SEE TYPICAL BOLT WITH
DTI ASSEMBLY DETAIL

STRUCTURAL STEEL NOTES

ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL INTERMEDIATE DIAPHRAGM STEEL AND CONNECTOR PLATES SHALL BE AASHTO M270 GRADE 50 OR APPROVED EQUAL.

TENSION ON THE ASTM A325 BOLTS THROUGH THE ANGLE MEMBER SHALL BE CALIBRATED USING DIRECT TENSION INDICATOR WASHERS IN

TENSION ON THE ASTM A449 BOLTS THROUGH THE GIRDER WEB SHALL BE SNUG TIGHTENED FOLLOWED BY AN ADDITIONAL 1/4 TURN.

THE PLATES, BENT PLATES, AND ANGLES SHALL BE GALVANIZED OR METALLIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. FOR THERMAL SPRAYED COATINGS (METALLIZATION), SEE SPECIAL PROVISIONS.

FOR METALLIZATION, APPLY A THERMAL SPRAYED COATING WITH A SEAL COAT TO ALL STEEL DIAPHRAGM SURFACES IN ACCORDANCE WITH THE DEPARTMENTS THERMAL SPRAYED COATINGS (METALLIZATION) PROGRAM, THERMAL SPRAYED COATINGS SPECIAL PROVISION AND SECTION 442 OF THE STANDARD SPECIFICATIONS.

GALVANIZE THE HIGH STRENGTH BOLTS, NUTS, WASHERS AND DIRECT TENSION INDICATORS IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

USE AN ASTM F436 HARDENED WASHER WITH STANDARD AND SLOTTED HOLES UNDER EACH BOLT HEAD AND NUT.

FOR BOLTS THROUGH THE GIRDER WEB, PROVIDE SUFFICIENT LENGTH OF THREADS ON ALL BOLTS TO ACCOMMODATE WASHERS AND THE THICKNESS OF CONNECTING MEMBER PLUS AT LEAST $\frac{1}{4}$ "PROJECTION BEYOND THE NUT.

INTERMEDIATE DIAPHRAGM ASSEMBLY SHALL COMPLY WITH SECTION 1072 OF THE STANDARD SPECIFICATIONS.

SUBMIT TWO SETS OF WORKING DRAWINGS FOR THE INTERMEDIATE DIAPHRAGM ASSEMBLY FOR REVIEW, COMMENTS AND ACCEPTANCE. AFTER REVIEW, COMMENTS, AND ACCEPTANCE, SUBMIT SEVEN SETS FOR DISTRIBUTION.

IN THE EXTERIOR BAYS, PLACE TEMPORARY STRUTS BETWEEN PRESTRESSED GIRDERS ADJACENT TO THE STEEL DIAPHRAGMS. STRUTS SHALL REMAIN IN PLACE 3 DAYS AFTER CONCRETE IS PLACED.

THE COST OF THE STEEL DIAPHRAGMS AND ASSEMBLIES SHALL BE INCLUDED IN THE UNIT PRICE BID FOR PRESTRESSED CONCRETE GIRDERS.

TABLE

GIRDER TYPE	DIM "A"	DIM "B"	DIM "C"	DIM "L"
72" BULB TEE	1'-4 ¹ / ₄ "	1'-9 /4"	1'-9 /4"	4'-2''

└─ 1 "MIN.RAD. $-\mathbb{Q} \ 1 \frac{1}{16} \% \text{ HOLES}$ SECTION Y-Y

ANGLE END (L 3 X 3 X $\frac{5}{16}$)


CONNECTOR PLATE DETAIL

WEB FACE

6" (MIN.)

DIM

3" 3"

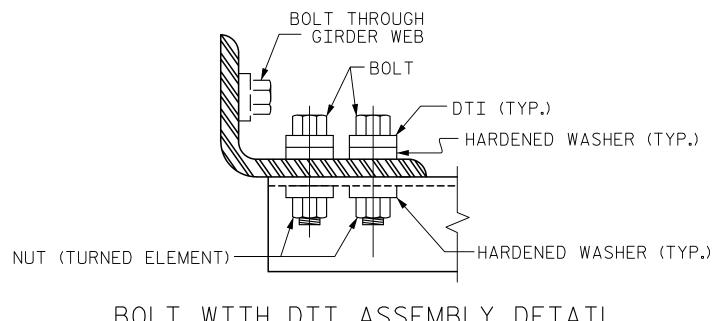

BOLT WITH DTI ASSEMBLY DETAIL

R-5021 PROJECT NO. BRUNSWICK COUNTY **STATION**: POC 31+30.81 -YREV-

SHEET 3 OF 3

STATE OF NORTH CAROLINA

REVISIONS

BY DATE

NO.

DEPARTMENT OF TRANSPORTATION STANDARD INTERMEDIATE STEEL DIAPHRAGMS

FOR 72" MODIFIED BULB TEE PRESTRESSED CONCRETE GIRDERS

HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609 DATE 6/18
DATE 6/18
DATE 12/18 DWG. NO. 12 CHECKED BY ___ DESIGN ENGINEER OF RECORD B. BOSLEY

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

12/7/2018

046234

12/7/2018

Paud Ro Barbu

SEAL 12916

NO. BY DATE

SHEET NO.


S3-12

DATE : 12/17 DATE : 12/17


REV.5/I/O6 TLA/GM REV.10/I/II MAA/GM REV.6/I3 AAC/MAA

ASSEMBLED BY: ADG CHECKED BY: RBB


DRAWN BY: EEM 2/97 CHECKED BY: VAP 2/97

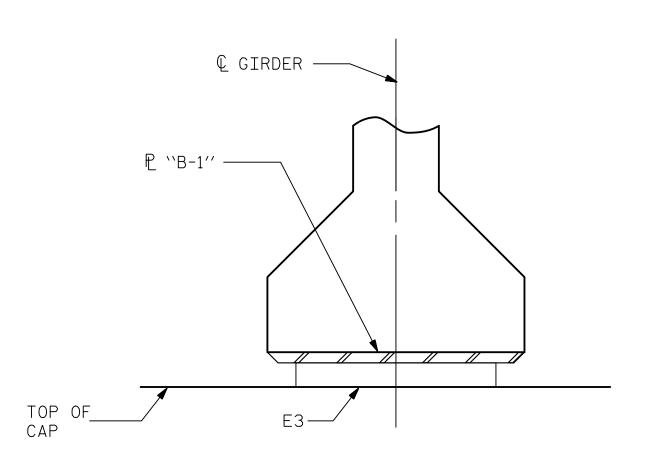


FIXED SECTION D-D

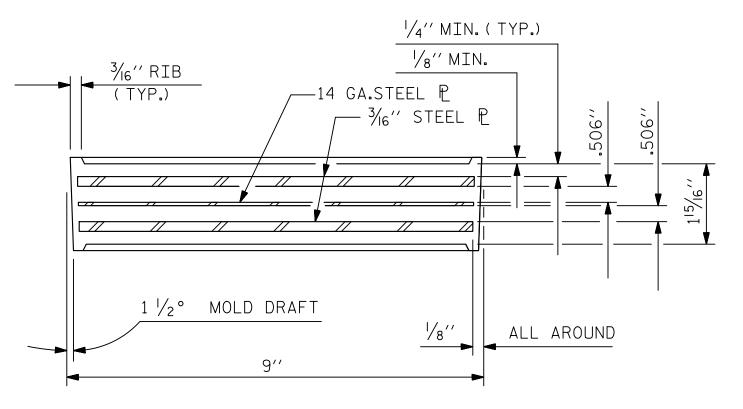

TYPICAL SECTION OF ELASTOMERIC BEARINGS



PLAN VIEW OF ELASTOMERIC BEARING

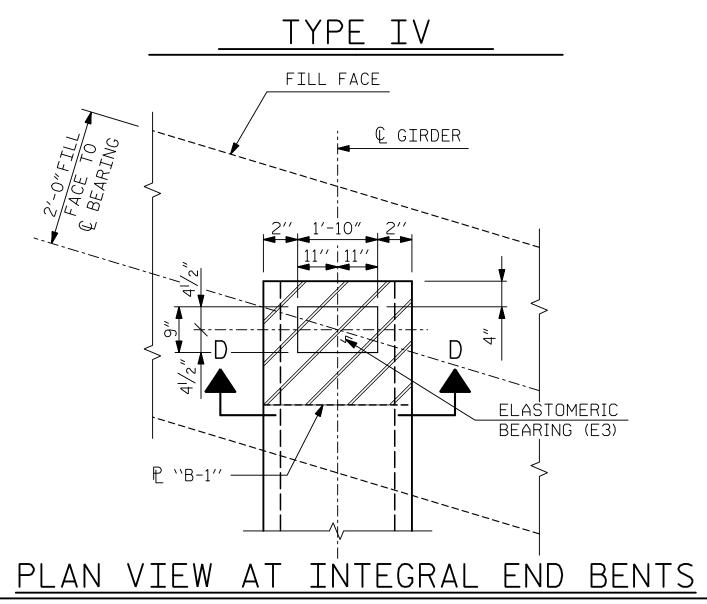

(END BENT 1 SHOWN, END BENT 2 SIMILAR BY ROTATION)

NOTES

THE ELASTOMER IN THE STEEL REINFORCED BEARINGS SHALL HAVE A SHEAR MODULUS OF Ø.160 KSI, IN ACCORDANCE WITH AASHTO M251.


FOR STEEL REINFORCED ELASTOMERIC BEARINGS, SEE SPECIAL PROVISIONS.

FOR BEARING LOCATIONS, SEE "FRAMING PLAN" SHEET.

MAXIMUM ALLOWABLE SERVICE LOADS D.L.+L.L.(NO IMPACT) TYPE IV 225**.**0 k

R-5021 PROJECT NO. ___ BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

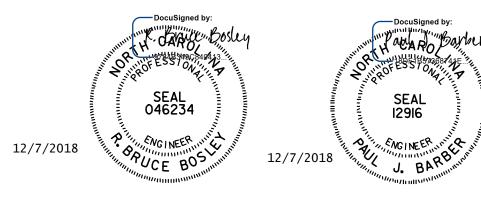

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB	HNTB NORTH CAROL NC License No. C-1554 343 E. Six Forks Rd., Su	·	C. 27609
DRAWN BY	A. GOFF	_ DATE <u>6/18</u>	
CHECKED BY	B. BOSLEY	_ DATE <u>6/18</u>	DWG. NO. 13
DESIGN ENGINEER OF	RECORD B. BOSLEY	_ DATE <u> 12/18</u>	

DEPARTMENT OF TRANSPORTATION STANDARD ELASTOMERIC BEARING

STATE OF NORTH CAROLINA

——— DETAILS ————
PRESTRESSED CONCRETE GIRDER SUPERSTRUCTURE

SHEET NO. **REVISIONS** S3-13 NO. BY DATE NO. BY DATE total sheets 25

			DEAD LOAD DEFLECTION TABLE FOR SPAN A																			
0.6" Ø LOW RELAXATION STRANDS			GIRDER 1																			
TWENTIETH POINTS		0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00
CAMBER (GIRDER ALONE IN PLACE)	†	0.000	0.061	0.120	0.175	0.227	0.272	0.310	0.341	0.363	0.377	0.381	0.377	0.363	0.341	0.310	0.272	0.227	0.175	0.120	0.061	0.000
DEFLECTION DUE TO SUPERIMPOSED D.L.	* ∤	0.000	0.045	0.089	0.133	0.173	0.208	0.239	0.263	0.281	0.292	0.295	0.292	0.281	0.263	0.239	0.208	0.173	0.132	0.089	0.045	0.000
FINAL CAMBER	Å	0	3/16	3/8	1/2	5/8	3/4	7/8	15/16	1	1	11/16	1	1	15/16	7/8	3/4	5/8	1/2	3/8	3/16	0

			DEAD LOAD DEFLECTION TABLE FOR SPAN A																			
0.6" Ø LOW RELAXATION STRANDS											G]	IRDER 2	2 AND 8	3								
TWENTIETH POINTS		0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00
CAMBER (GIRDER ALONE IN PLACE)	†	0.000	0.061	0.120	0.175	0.227	0.272	0.310	0.341	0.363	0.377	0.381	0.377	0.363	0.341	0.310	0.272	0.227	0.175	0.120	0.061	0.000
DEFLECTION DUE TO SUPERIMPOSED D.L.	* ∤	0.000	0.045	0.088	0.131	0.171	0.206	0.236	0.260	0.278	0.289	0.292	0.289	0.278	0.260	0.236	0.206	0.171	0.131	0.088	0.044	0.000
FINAL CAMBER	†	0	3/16	3/8	1/2	11/16	13/16	7/8	15/16	1	11/16	11/16	11/16	1	15/16	7/8	13/16	11/16	1/2	3/8	³ / ₁₆	0


									DEA	D LOAI) DEFL	LECTIO	on tae	BLE FC	R SPA	N A						
0.6" Ø LOW RELAXATION STRANDS											G.	IRDER 3	3 AND 7	7								
TWENTIETH POINTS		0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00
CAMBER (GIRDER ALONE IN PLACE)	†	0.000	0.061	0.120	0.175	0.227	0.272	0.310	0.341	0.363	0.377	0.381	0.377	0.363	0.341	0.310	0.272	0.227	0.175	0.120	0.061	0.000
DEFLECTION DUE TO SUPERIMPOSED D.L.	* ∤	0.000	0.044	0.087	0.129	0.168	0.202	0.232	0.256	0.273	0.284	0.287	0.284	0.273	0.256	0.232	0.202	0.168	0.129	0.087	0.044	0.000
FINAL CAMBER	A	0	3/16	3/8	9/16	11/16	13/16	15/16	1	11/16	11/8	11/8	11/8	11/16	1	15/16	13/16	11/16	9/16	3/8	3/16	0

									DEA	D LOAI	D DEFL	ECTIO)n tae	BLE FC	R SPA	.N А						
0.6" Ø LOW RELAXATION STRANDS											GIF	RDER 4,	5 AND	6								
TWENTIETH POINTS		0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00
CAMBER (GIRDER ALONE IN PLACE)	†	0.000	0.061	0.120	0.175	0.227	0.272	0.310	0.341	0.363	0.377	0.381	0.377	0.363	0.341	0.310	0.272	0.227	0.175	0.120	0.061	0.000
DEFLECTION DUE TO SUPERIMPOSED D.L.	*↓	0.000	0.047	0.093	0.138	0.180	0.216	0.248	0.274	0.292	0.304	0.307	0.304	0.292	0.274	0.248	0.216	0.180	0.138	0.093	0.047	0.000
FINAL CAMBER	Å	0	3/16	5/16	7/16	9/16	11/16	3/4	13/16	7/8	7/8	7/8	7/8	7/8	13/16	3/4	11/16	9/16	7/16	5/16	3/16	0

			DEAD LOAD DEFLECTION TABLE FOR SPAN A																			
0.6"Ø LOW RELAXATION STRANDS												GIRDE	ER 9									
TWENTIETH POINTS		0.00	0.05	0.10	0.15	0.20	0.25	0.30	0.35	0.40	0.45	0.50	0.55	0.60	0.65	0.70	0.75	0.80	0.85	0.90	0.95	1.00
CAMBER (GIRDER ALONE IN PLACE)	†	0.000	0.061	0.120	0.175	0.227	0.272	0.310	0.341	0.363	0.377	0.381	0.377	0.363	0.341	0.310	0.272	0.227	0.175	0.120	0.061	0.000
DEFLECTION DUE TO SUPERIMPOSED D.L.	* ∤	0.000	0.044	0.087	0.129	0.168	0.203	0.233	0.256	0.274	0.284	0.287	0.284	0.274	0.256	0.233	0.203	0.168	0.129	0.087	0.044	0.000
FINAL CAMBER	A	0	3/16	3/8	9/16	11/16	13/16	15/16	1	11/16	11/8	11/8	11/8	11/16	1	15/16	13/16	11/16	9/16	3/8	3/16	0

* INCLUDES FUTURE WEARING SURFACE IN SUPERIMPOSED DEAD LOAD ALL VALUES ARE SHOWN IN FEET (DECIMAL FORM), EXCEPT ''FINAL CAMBER '', WHICH IS GIVEN IN INCHES (FRACTION FORM).

R-5021 PROJECT NO. ___ BRUNSWICK _ COUNTY **STATION**: POC 31+30.81 -YREV-

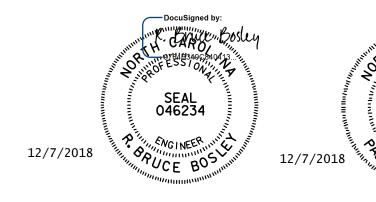

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB NORTH CAROLINA, P.C.


NC License No. C-1554


343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609

SHEET NO. **REVISIONS** S3-14 NO. BY DATE NO. BY DATE DRAWN BY L. WATERS DATE 6/18
CHECKED BY B. BOSLEY DATE 6/18
DESIGN ENGINEER OF RECORD B. BOSLEY DATE 12/18 total sheets 25 DWG. NO. 14

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE GIRDER DEAD LOAD DEFLECTIONS AND CAMBER

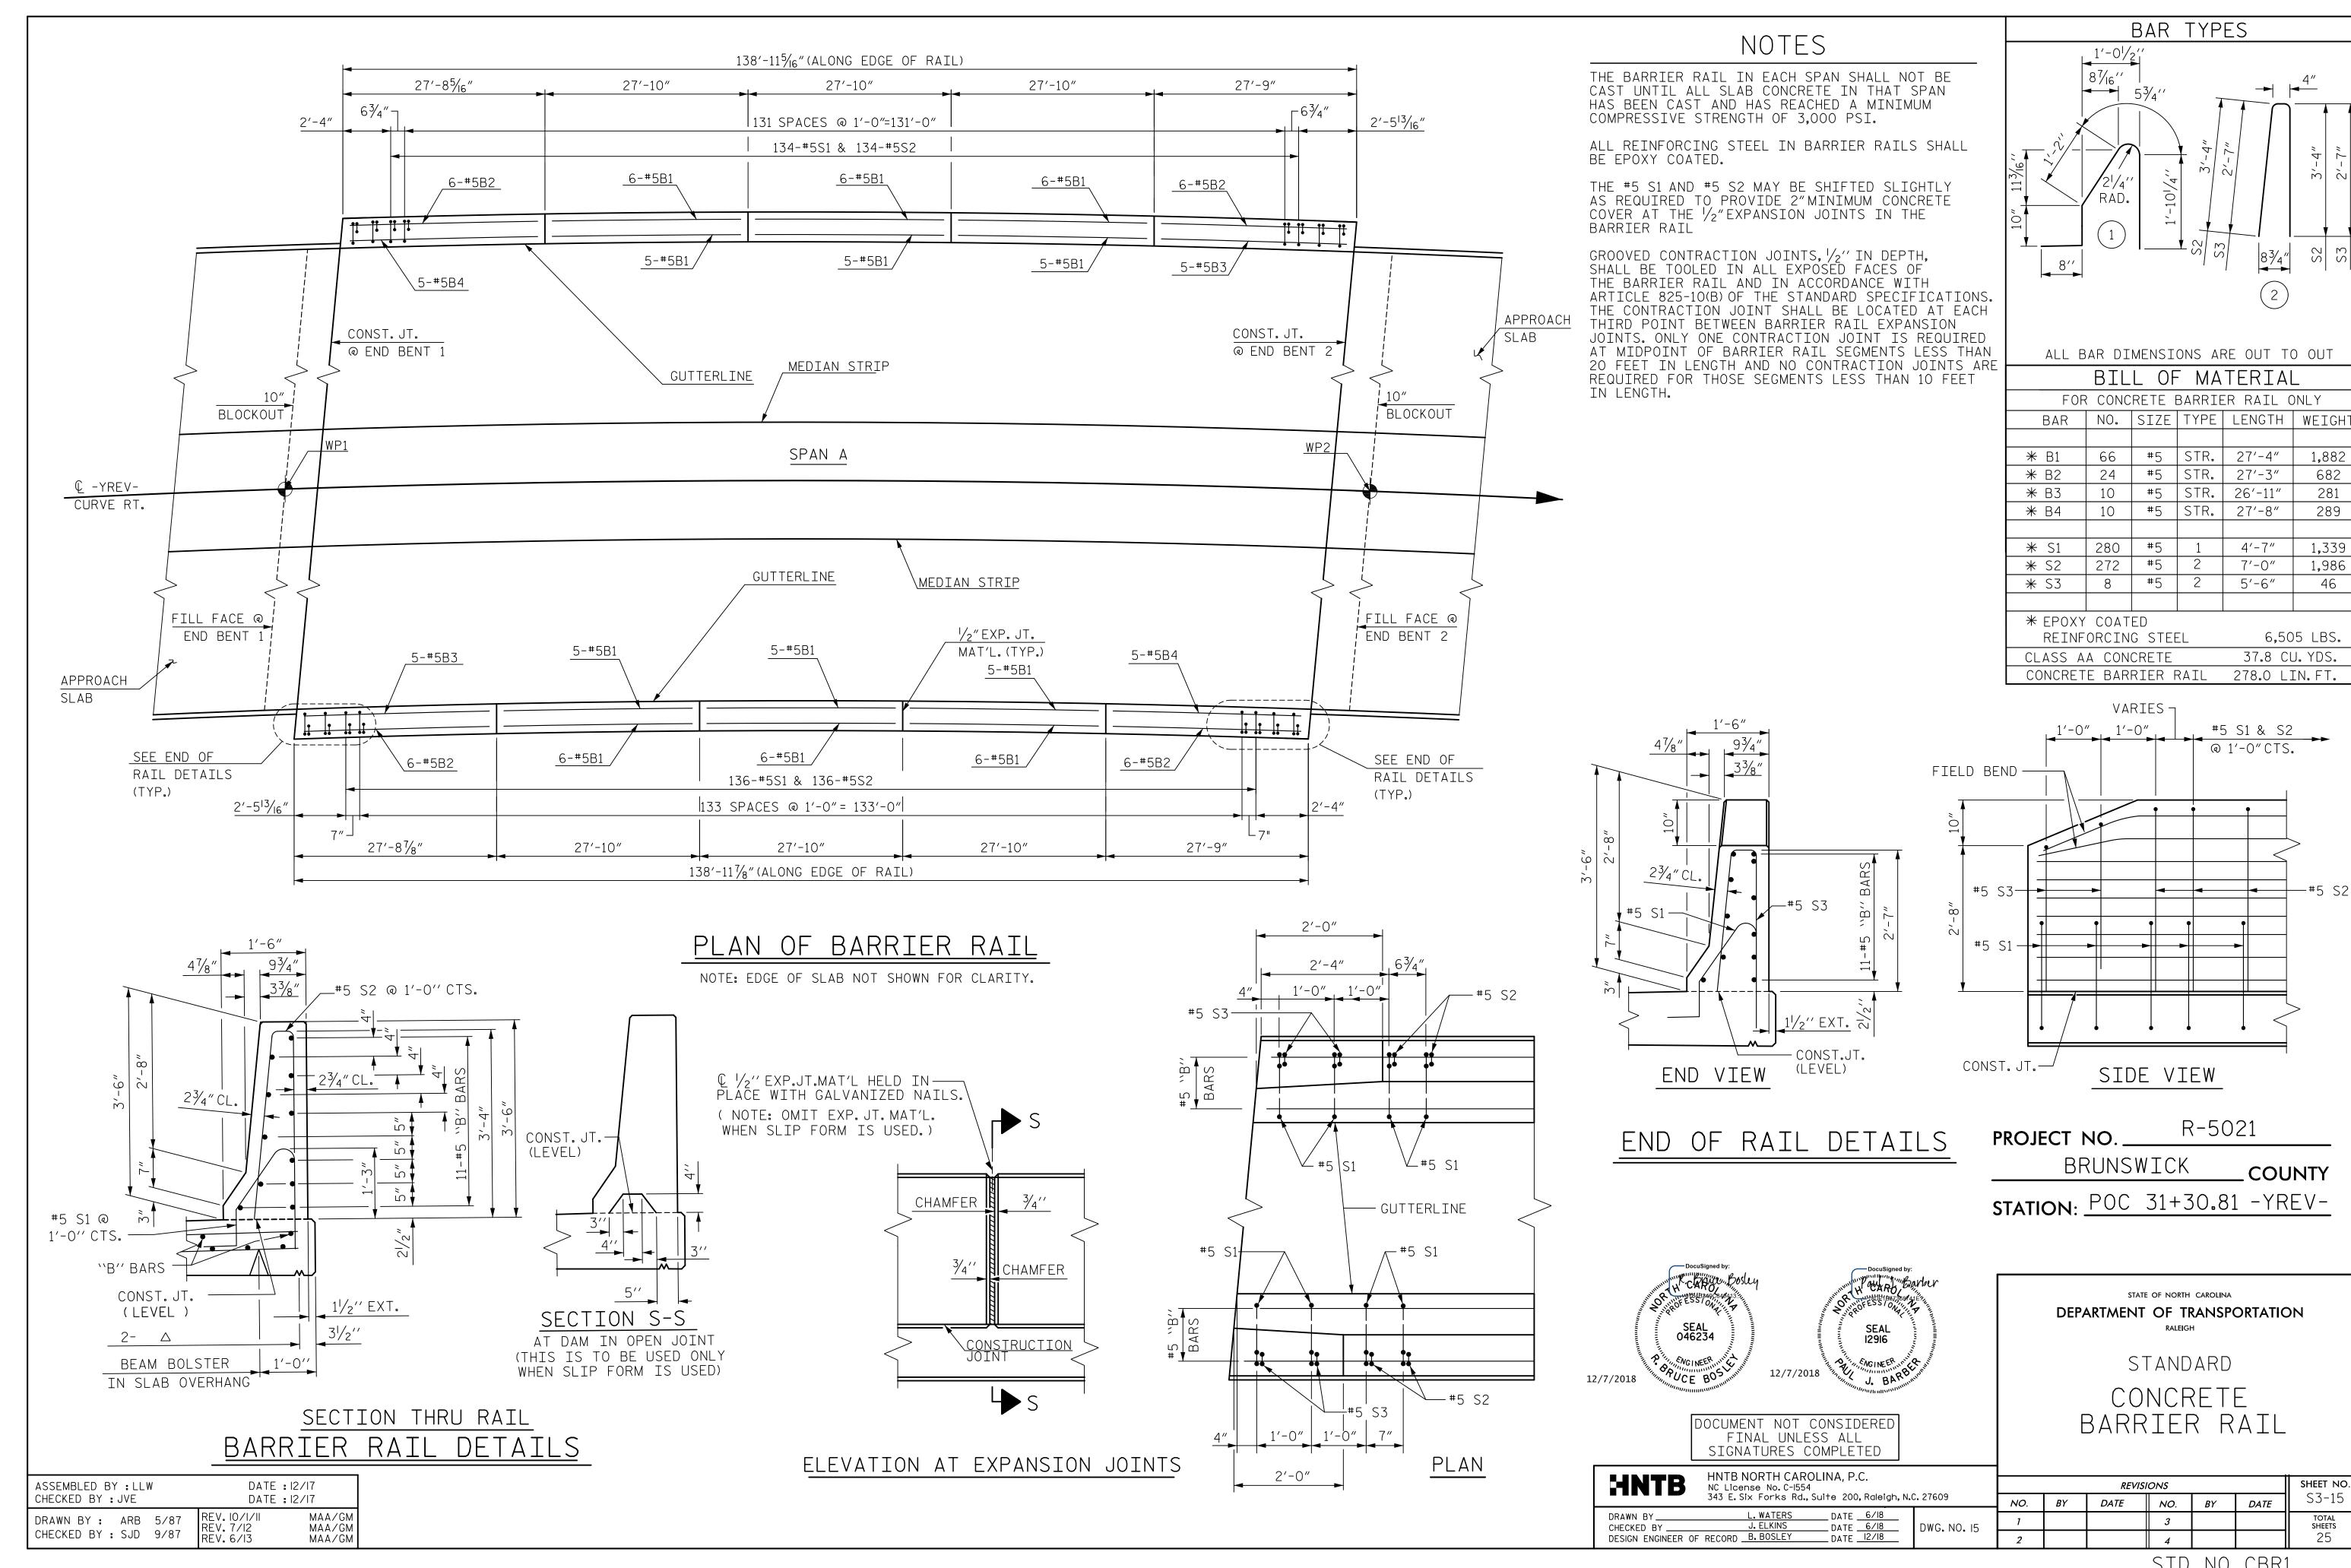

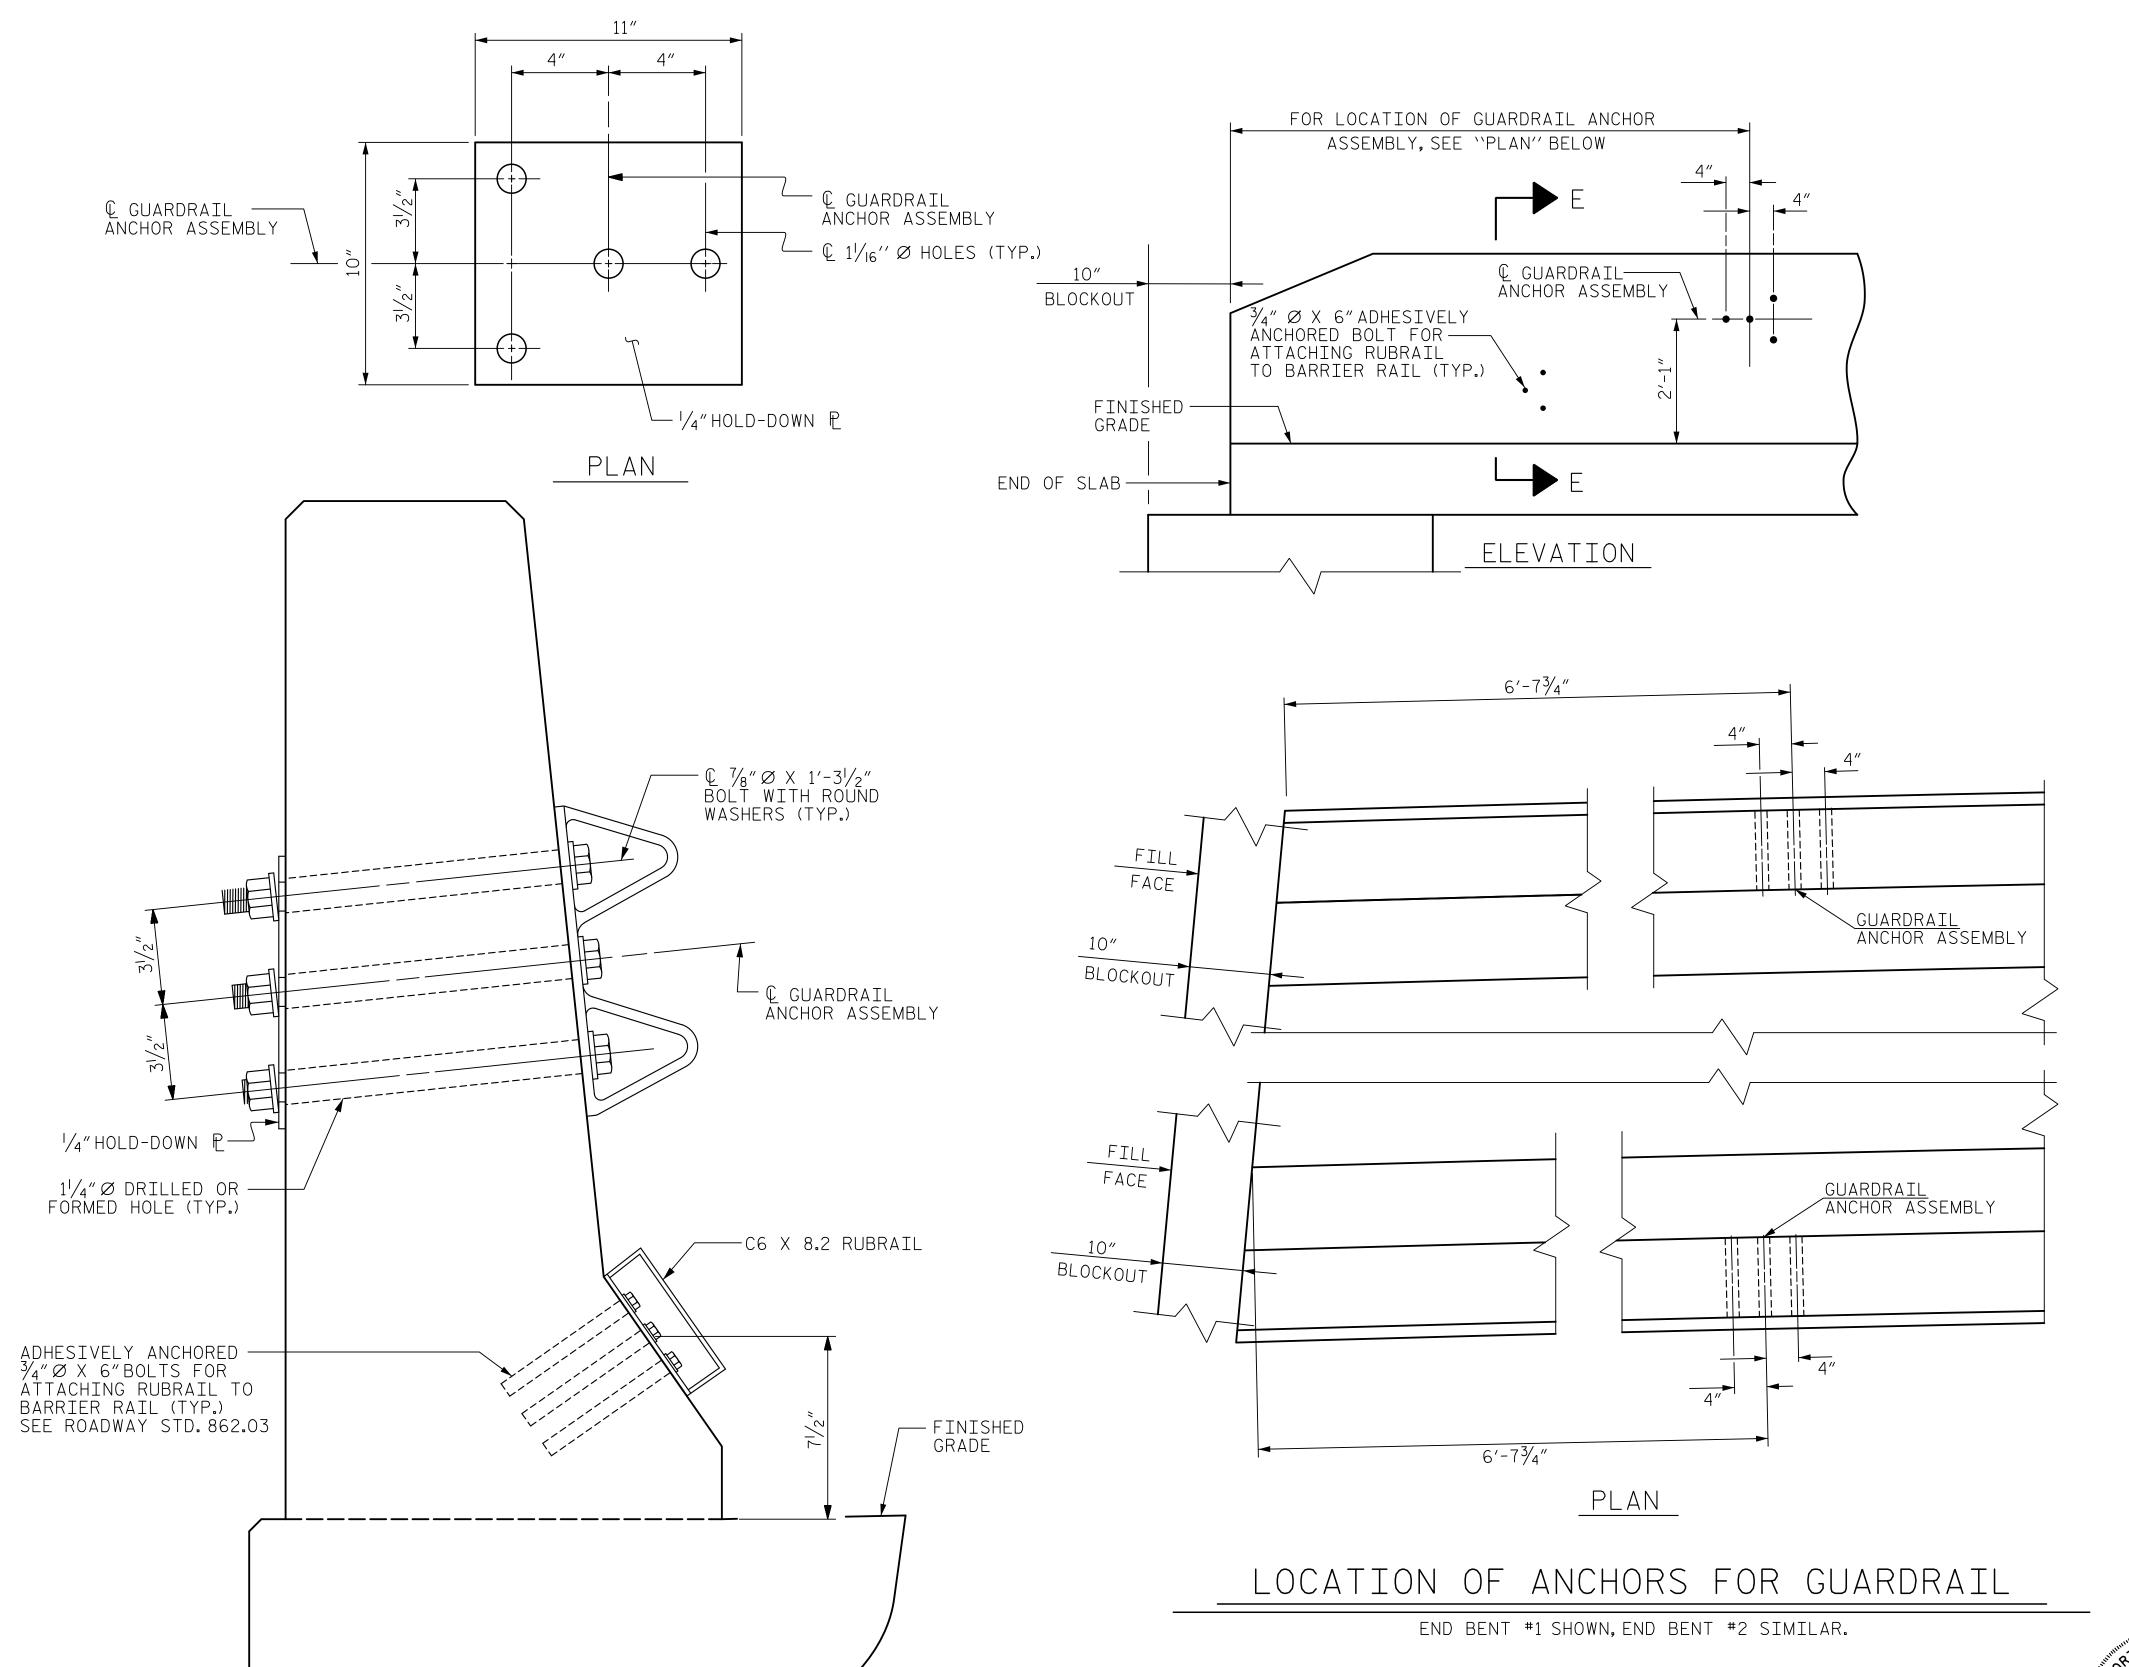

SECTION E-E

DATE : 12/17

DATE : 12/17

MAA/GM MAA/GM MAA/GM

ASSEMBLED BY : LLW

DRAWN BY: TLA 5/06

CHECKED BY: GM 5/06

CHECKED BY : JVE

GUARDRAIL ANCHOR ASSEMBLY DETAILS

12/7/2018

12/7/2018 The Attaches MINEE

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609 DATE 6/18
DATE 6/18
DATE 12/18 DWG. NO. 16 CHECKED BY ___ DESIGN ENGINEER OF RECORD B. BOSLEY

NOTES

THE GUARDRAIL ANCHOR ASSEMBLY SHALL CONSIST OF A $\frac{1}{4}$ " HOLD-DOWN PLATE AND 4 - $\frac{7}{8}$ " \alpha Bolts with nuts and washers, rubrail, and adhesively anchored bolts.

THE HOLD-DOWN PLATE SHALL CONFORM TO AASHTO M270 GRADE 36. AFTER FABRICATION, THE HOLD-DOWN PLATE SHALL BE HOT-DIP GALVANIZED IN ACCORDANCE WITH AASHTO M111.

BOLTS SHALL CONFORM TO THE REQUIREMENTS OF ASTM A307 AND NUTS SHALL CONFORM TO THE REQUIREMENTS OF AASHTO M291. BOLTS, NUTS AND WASHERS SHALL BE GALVANIZED. (AT THE CONTRACTOR'S OPTION, STAINLESS STEEL BOLTS, NUTS AND WASHERS MAY BE USED AS AN ALTERNATE FOR THE \(\frac{7}{8}'' \) GALVANIZED BOLTS, NUTS AND WASHERS. THEY SHALL CONFORM TO OR EXCEED THE MECHANICAL REQUIREMENTS OF ASTM A307. THE USE OF THIS ALTERNATE SHALL BE APPROVED BY THE ENGINEER.)


THE GUARDRAIL ANCHOR ASSEMBLY IS REQUIRED AT ALL POINTS WHERE APPROACH GUARDRAIL IS TO BE ATTACHED TO THE END OF BARRIER RAIL. FOR POINTS OF ATTACHMENT, SEE SKETCH.

AFTER INSTALLATION, THE EXPOSED THREAD OF THE BOLT SHALL BE BURRED WITH A SHARP POINTED TOOL.

THE COST OF THE GUARDRAIL ANCHOR ASSEMBLY SHALL BE INCLUDED IN THE UNIT CONTRACT PRICE BID FOR CONCRETE BARRIER RAIL.

THE 1 $\frac{1}{4}$ " Ø HOLES SHALL BE FORMED OR DRILLED WITH A CORE BIT. IMPACT TOOLS WILL NOT BE PERMITTED. ANY CONCRETE DAMAGED BY THIS WORK SHALL BE REPAIRED TO THE SATISFACTION OF THE ENGINEER.

THE C6 X 8.2 RUBRAIL IS TO BE ADHESIVELY ANCHORED TO THE RAIL USING THREE 3/4" Ø X 6"BOLTS WITH WASHERS. LEVEL ONE FIELD TESTING IS REQUIRED, AND THE YIELD LOAD OF THE 3/4" Ø BOLT IS 12 KIPS. FOR ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS, SEE STANDARD SPECIFICATIONS. SEE ROADWAY STANDARD 862.03 FOR DETAILS AND LOCATION OF THE RUBRAIL.

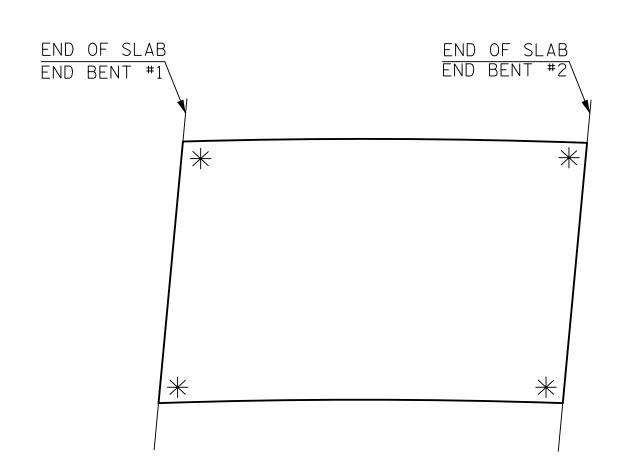

SKETCH SHOWING POINTS OF ATTACHMENTS

* DENOTES GUARDRAIL ANCHOR ASSEMBLY

R-5021 PROJECT NO. __ BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

STANDARD

GUARDRAIL ANCHORAGE FOR BARRIER RAIL

SHEET NO. **REVISIONS** S3-16 NO. BY DATE BY DATE NO.

STD. NO. GRA2

ASSEMBLED BY: LLW CHECKED BY: RBB

DRAWN BY: JMB 5/87

CHECKED BY: SJD 9/87

DATE : 12/17

DATE : 12/17


RWW/LES

TLA/GM MAA/GM

REV. 8/I6/99 REV. 5/I/06 REV. IO/I/II

	BILL	_ OF N	MATER	RIAL			BILI	_ OF I	MATER	RIAL	
		EPOXY	COATED					EPOXY	COATED		
BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT	BAR	NO.	SIZE	TYPE	LENGTH	WEIGHT
A1	430	5	STR.	43′-6″	19,509	B1	290	4	STR.	29'-6"	5,715
Α2	2	5	STR.	38′-7″	80	B2	114	6	STR.	28′-6″	4,880
А3	2	5	STR.	31′-10″	66	В3	114	6	STR.	28′-6″	4,880
Α4	2	5	STR.	25′-3″	53	В4	55	4	STR.	29'-9"	1,093
A5	2	5	STR.	18'-7"	39						
А6	2	5	STR.	11'-11"	25	S1	104	4	3	11'-11"	828
Α7	2	5	STR.	46′-1″	96	S2	104	4	3	12'-3"	851
Α8	2	5	STR.	39′-5″	82						
Α9	2	5	STR.	32′-9″	68	U1	145	5	5	14'-0"	2,117
A10	2	5	STR.	26′-1″	54	U2	8	5	5	17′-6″	146
A11	2	5	STR.	19′-5″	41						
A12	2	5	STR.	12'-8"	26	K1	42	5	STR.	31′-6″	1,380
A13	2	5	STR.	6′-0″	13	K2	80	5	STR.	8'-8"	723
A14	94	4	STR.	14'-10"	931	К3	16	5	STR.	6′-8″	111
						K4	16	5	STR.	7′-1″	118
						K5	4	5	STR.	4'-6"	19
						K6	20	5	STR.	5′-3″	110
						K7	8	5	STR.	2'-1"	17
										<u> </u>	

BILL OF MATERIAL UNCOATED												
	L		1	LENGTH	WETCHT							
BAR	NO.	SIZE	TYPE	LENGTH								
A101	430	5	STR.	43′-4″	19,435							
A102	2	5	STR.	38′-5″	80							
A103	2	5	STR.	31′-8″	66							
A104	2	5	STR.	25′-1″	52							
A105	2	5	STR.	18′-5″	38							
A106	2	5	STR.	11'-9"	25							
A107	2	5	STR.	46′-1″	96							
A108	2	5	STR.	39′-5″	82							
A109	2	5	STR.	32′-9″	68							
A110	2	5	STR.	26′-1″	54							
A111	2	5	STR.	19′-5″	41							
A112	2	5	STR.	12'-8"	26							
A113	2	5	STR.	6′-0″	13							
B101	216	5	STR.	48'-3"	10,870							
				TOTAL	30,946							

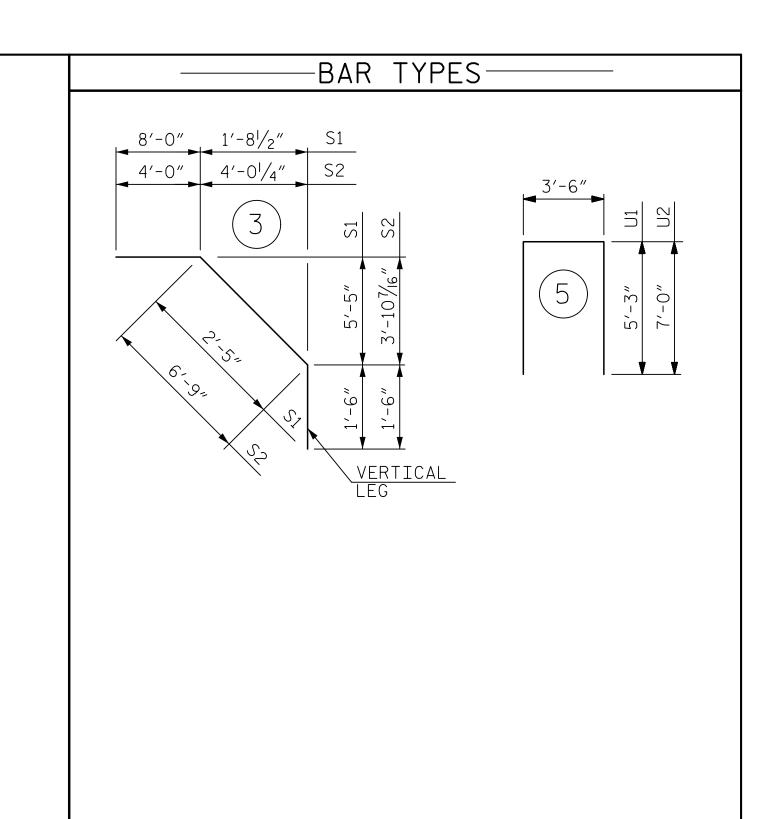


ALL BAR DIMENSIONS ARE OUT TO OUT

—SUPERS	tructure e	BILL OF MA	ATERIAL——
	CLASS AA CONCRETE	REINFORCING STEEL	EPOXY COATED REINFORCING STEEL
	(CU.YDS.)	(LBS.)	(LBS.)
POUR 1	326.1		
POUR 2	233.4		
MEDIAN	33.4		
TOTALS**	592.9	30,946	42,047

**QUANTITIES FOR BARRIER RAIL ARE NOT INCLUDED

NOTE: QUANTITIES INCLUDE THE CONCRETE AND REINFORCING STEEL FOR THE UPPER PORTION OF THE INTEGRAL END BENTS.

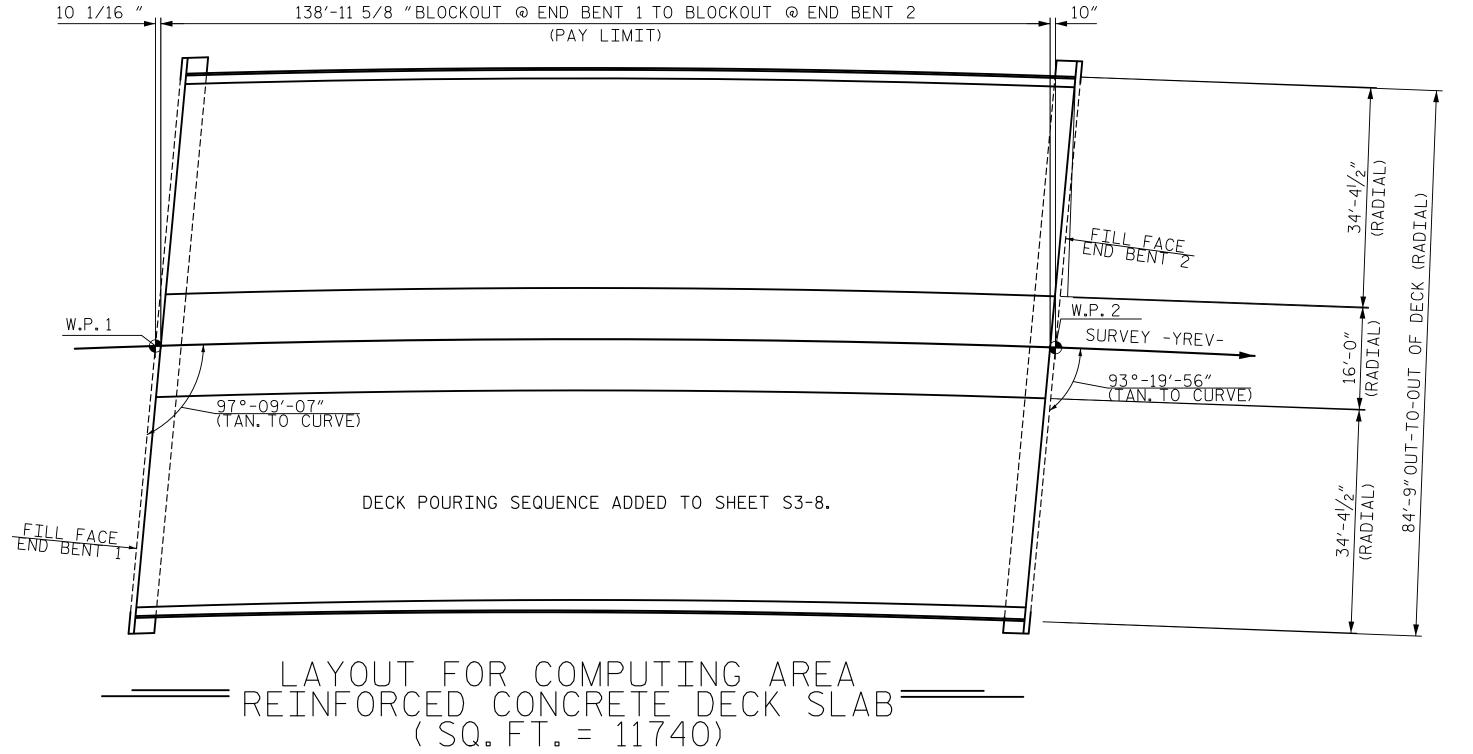

11236 SQ.FT.

TOTAL 42,047

SUPERSTRUCTURE REINFORCING STEEL
LENGTHS ARE BASED ON THE
FOLLOWING MINIMUM SPLICE LENGTHS

BAR SIZE SUPERSTRUCTURE EXCEPT APPROACH SLABS, PARAPET, AND BARRIER RAIL

EPOXY COATED UNCOATED EPOXY UNCOATED

#4 2'-0" 1'-9" 2'-0" 1'-9" 2'-9"

#5 2'-6" 2'-2" 2'-6" 2'-2" 3'-5"

#6 3'-0" 2'-7" 3'-10" 2'-7" 4'-4"

#7 5'-3" 3'-6"

#8 6'-10" 4'-7"

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

DocuSigned by:

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

STANDARD

SUPERSTRUCTURE BILL OF MATERIAL

GROOVING BRIDGE FLOORS

APPROACH SLABS 2916 SQ.FT.
BRIDGE DECK 8320 SQ.FT.

TOTAL

DOCUMENT NOT CONSIDERED
FINAL UNLESS ALL
SIGNATURES COMPLETED


HNTB NORTH CAROLINA, P.C.


NC License No. C-1554
343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609


DRAWN BY


L. WATERS
CHECKED BY
R. BOSLEY
DATE 6/18
DWG. NO. 17
DESIGN ENGINEER OF RECORD B. BOSLEY
DATE 12/18


		REVISI	ONS			SHEET NO.
NO.	BY	DATE	NO.	BY	DATE	S3-17
1			3			TOTAL SHEETS
2			4			25

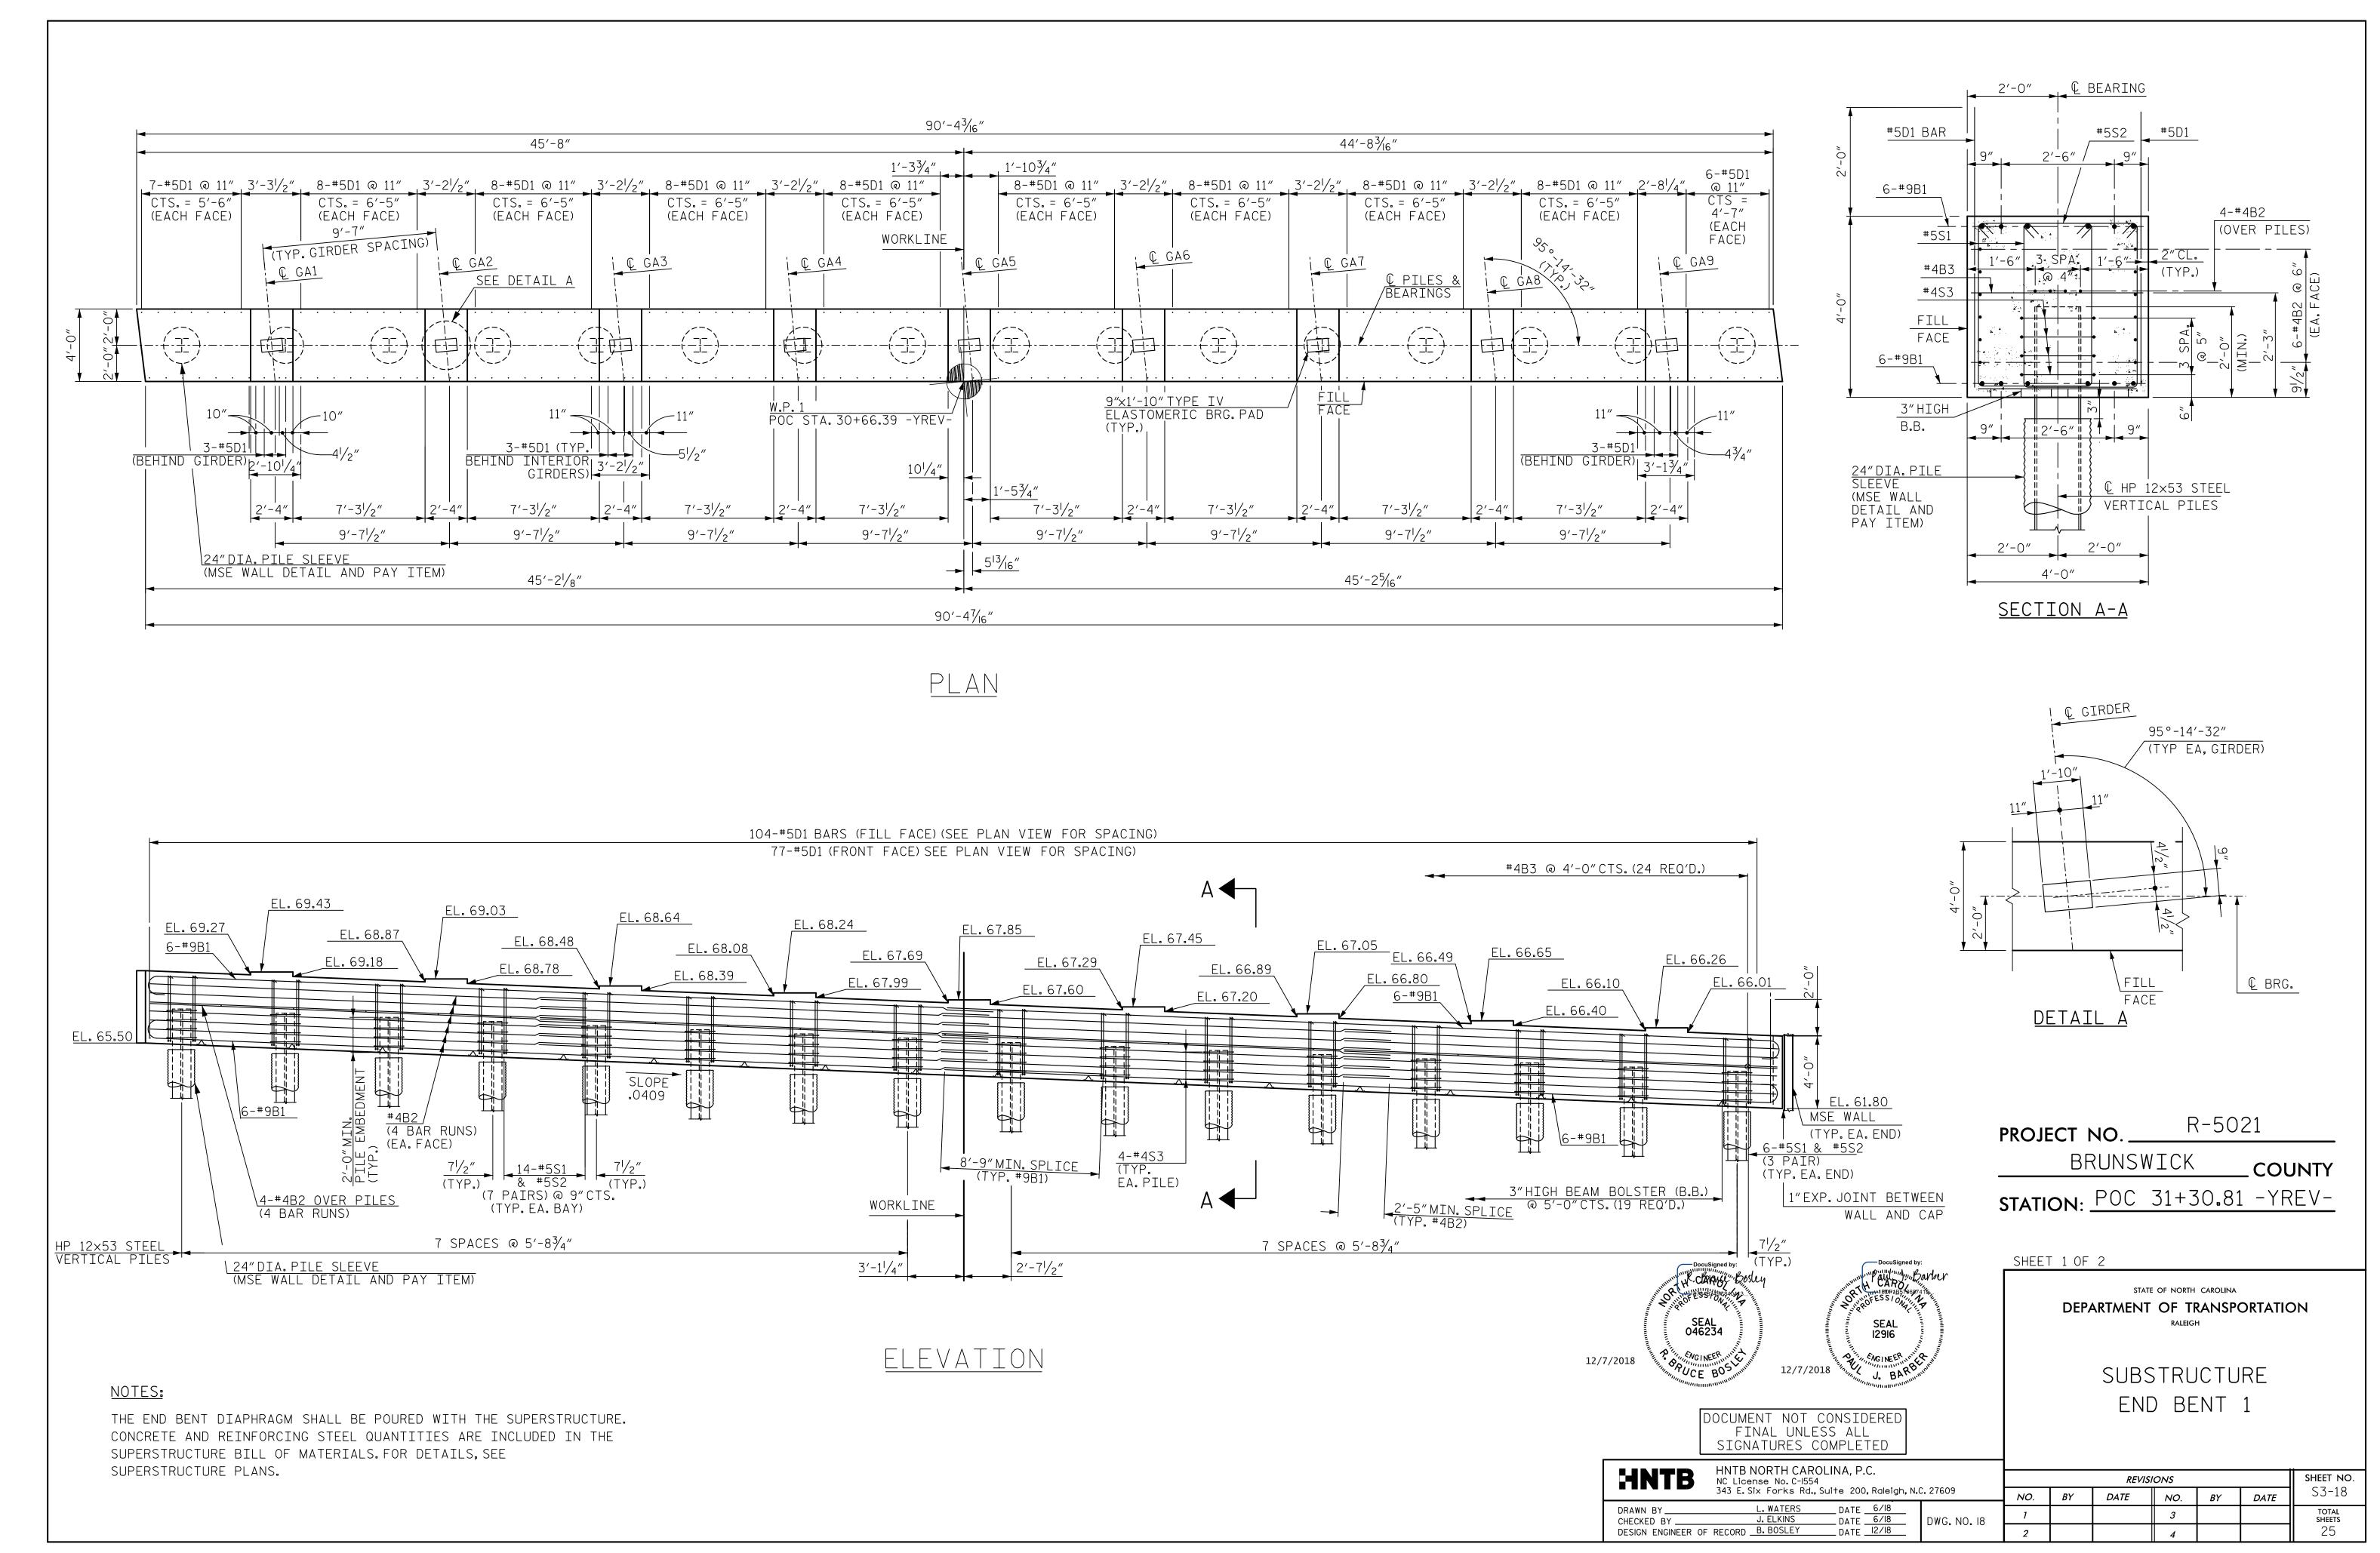

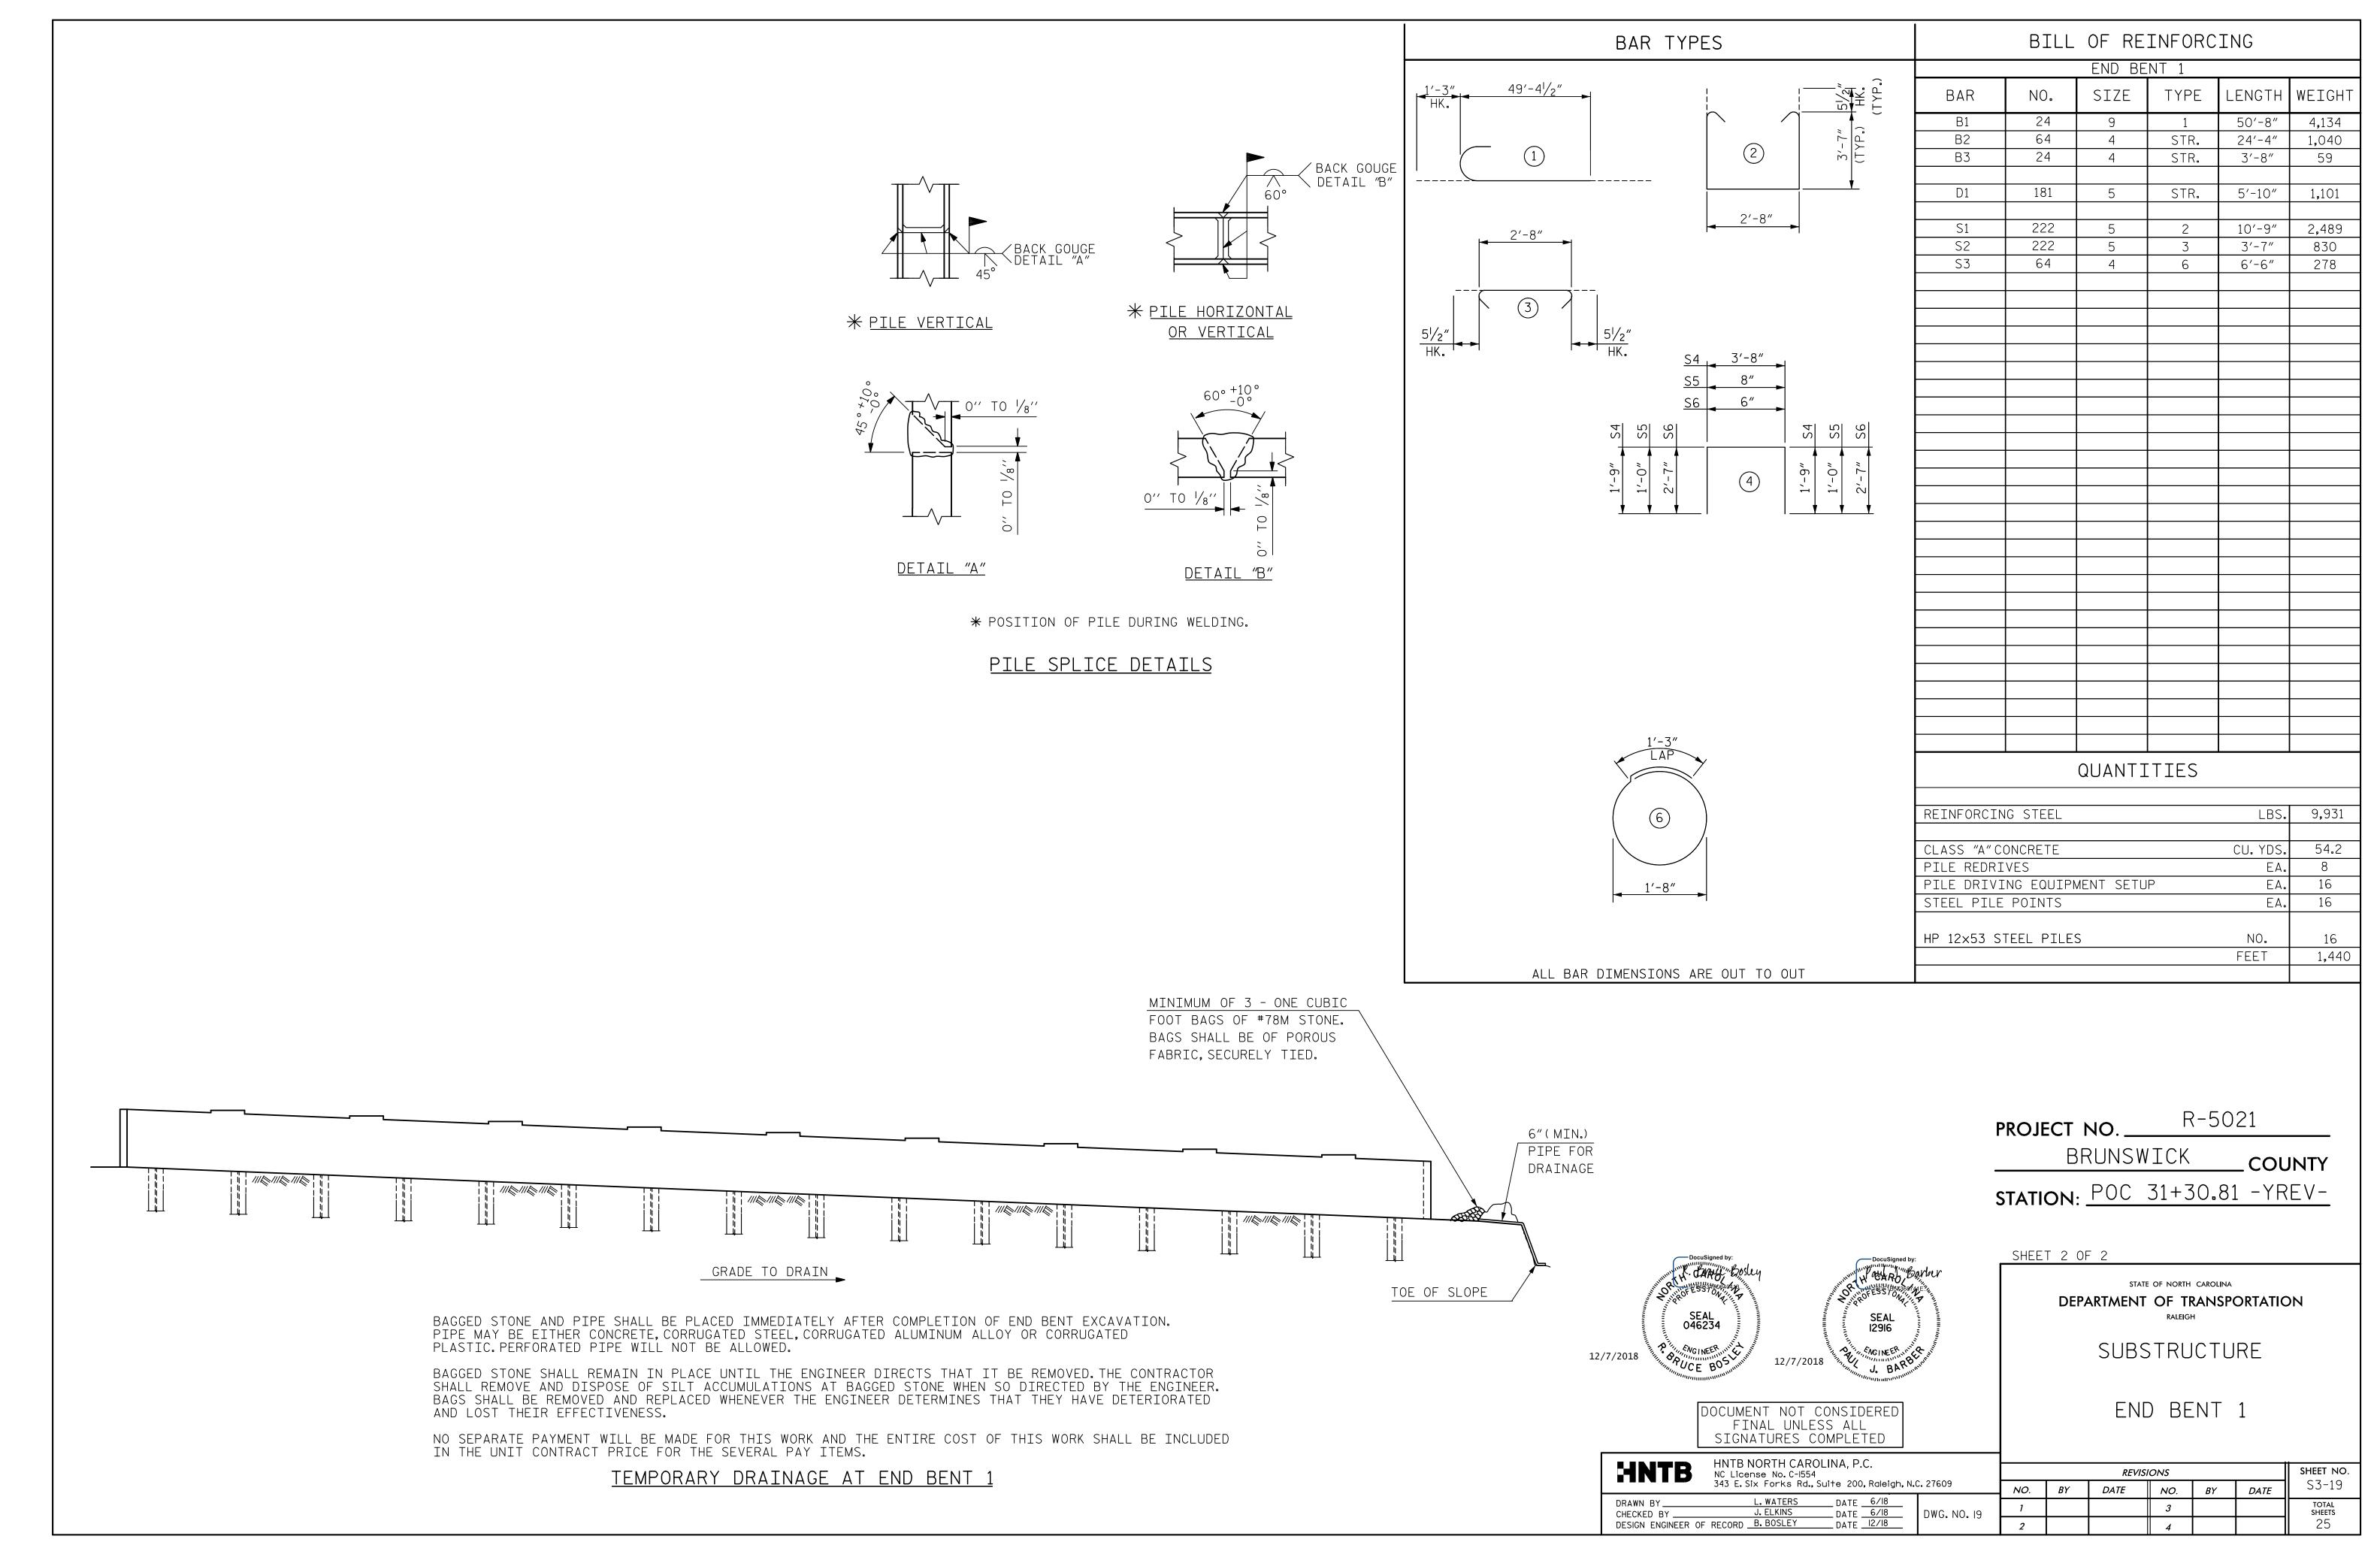

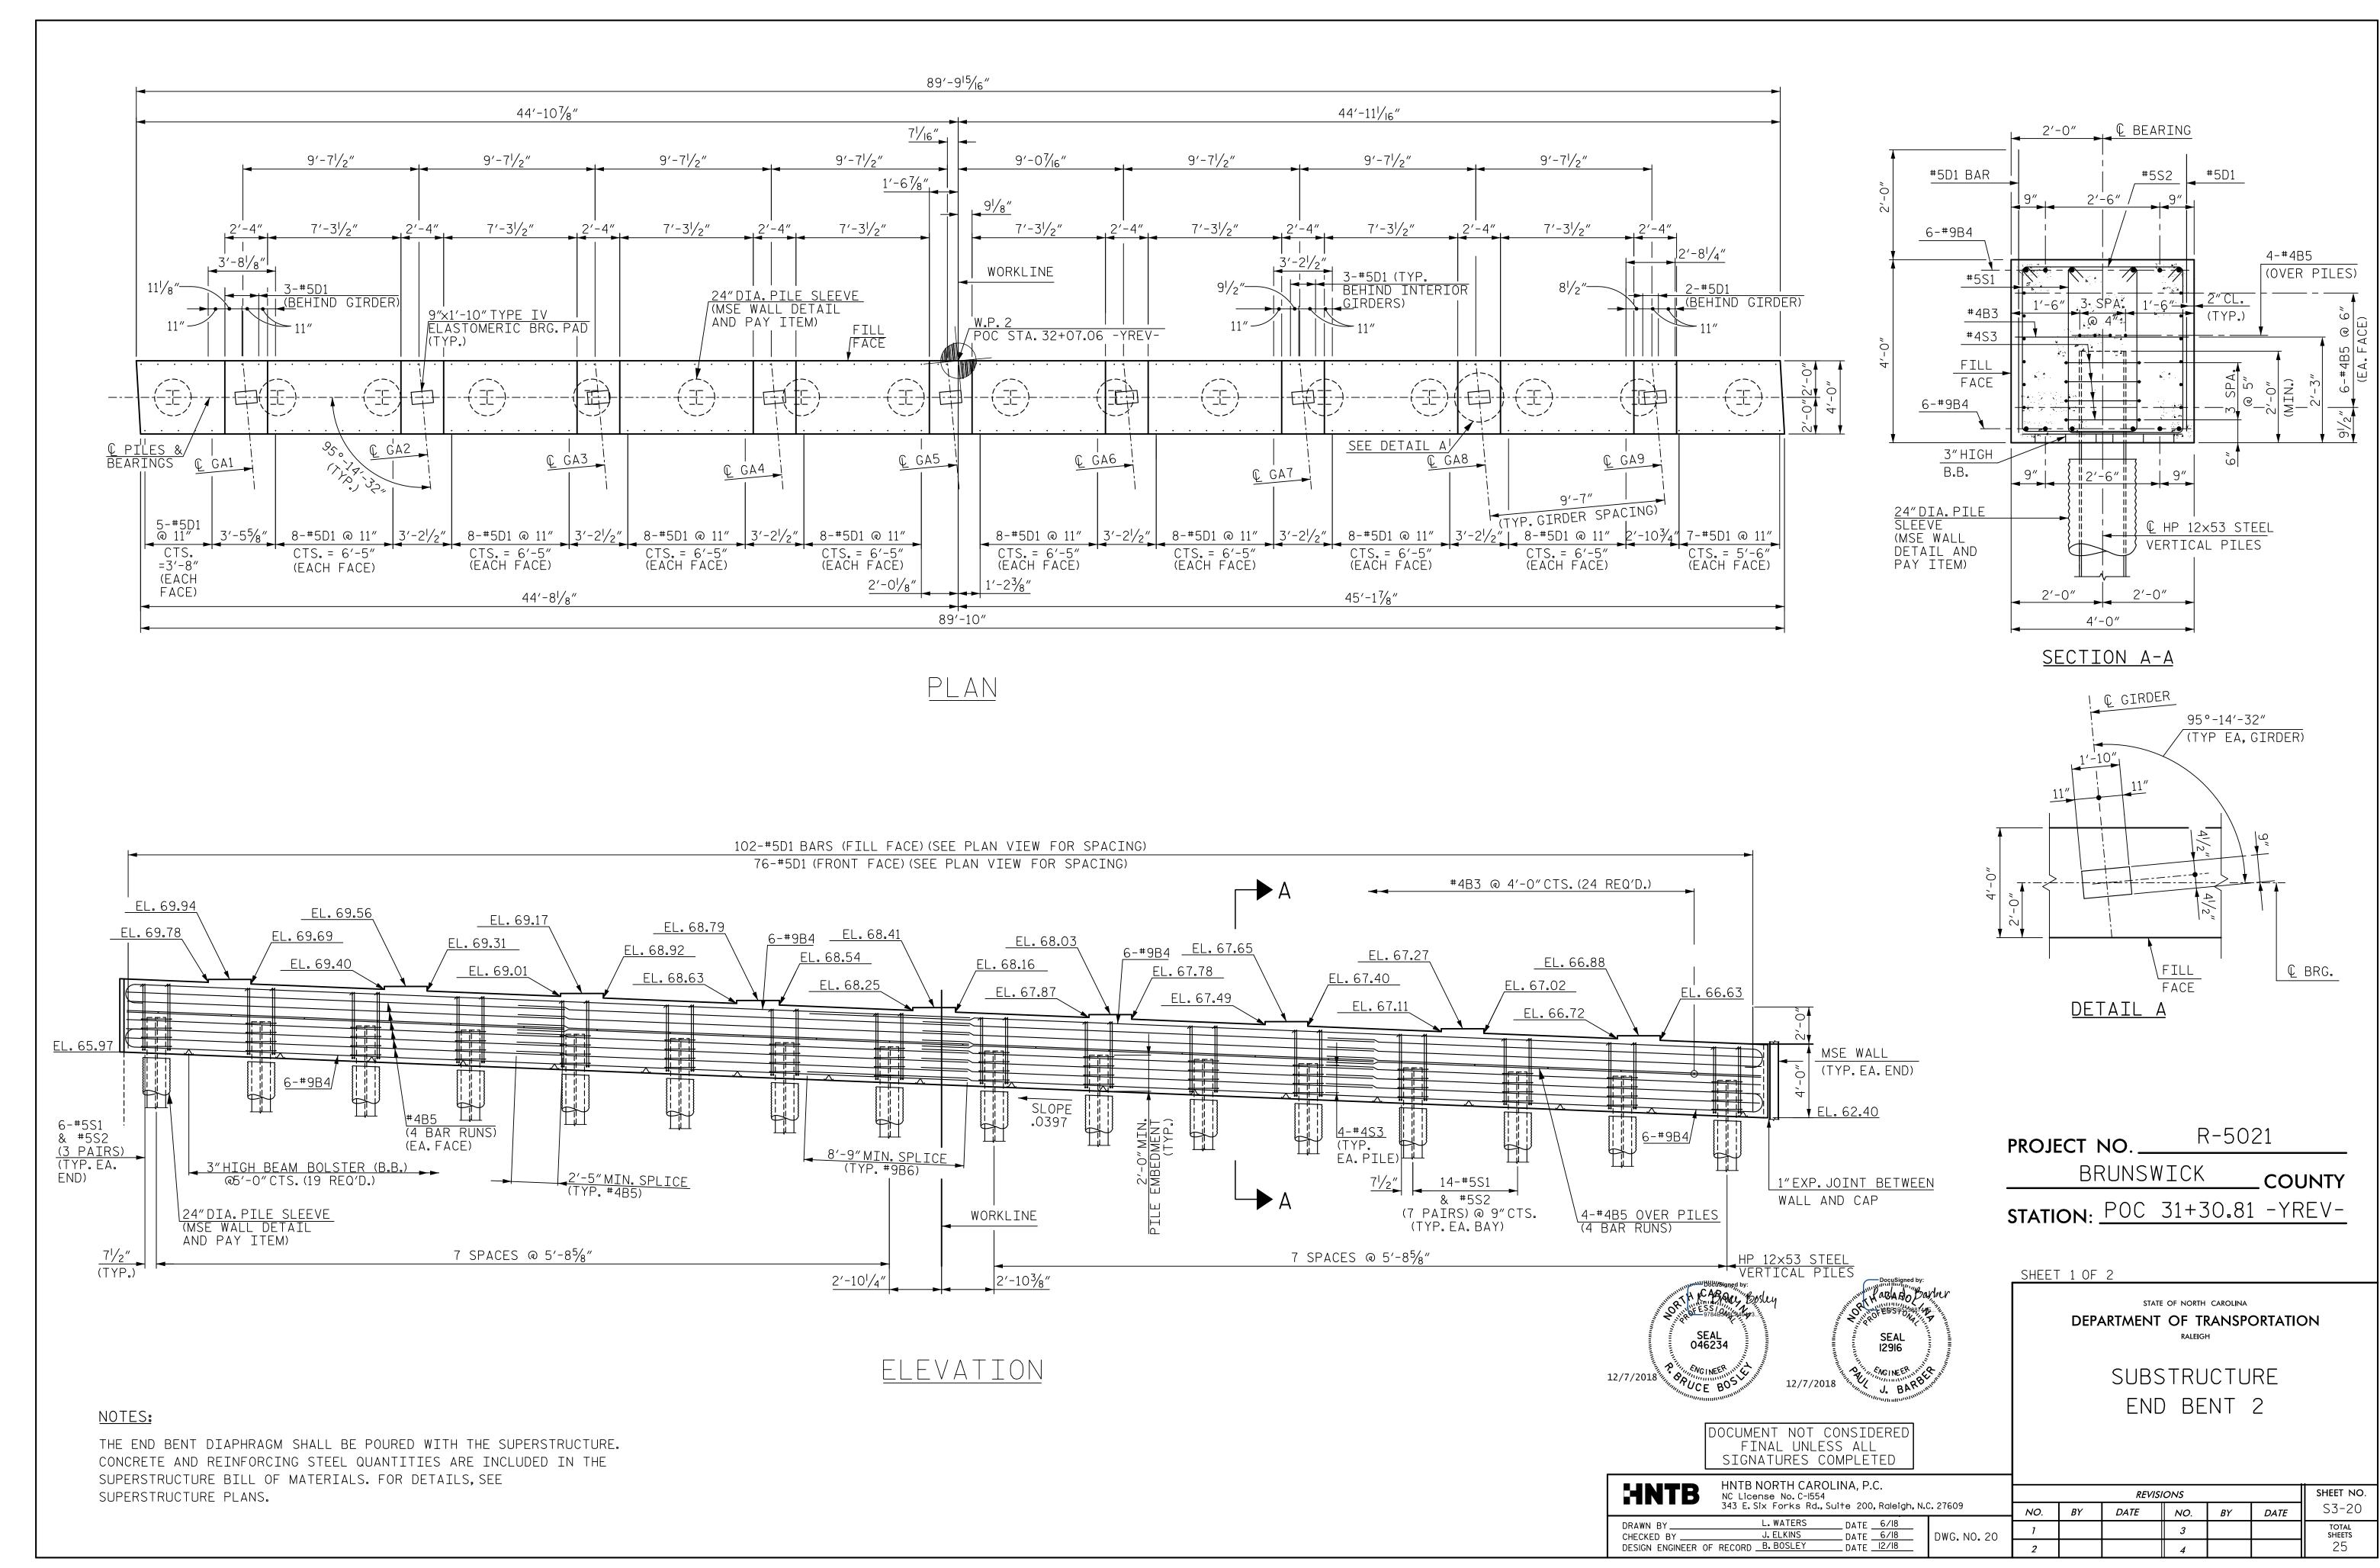

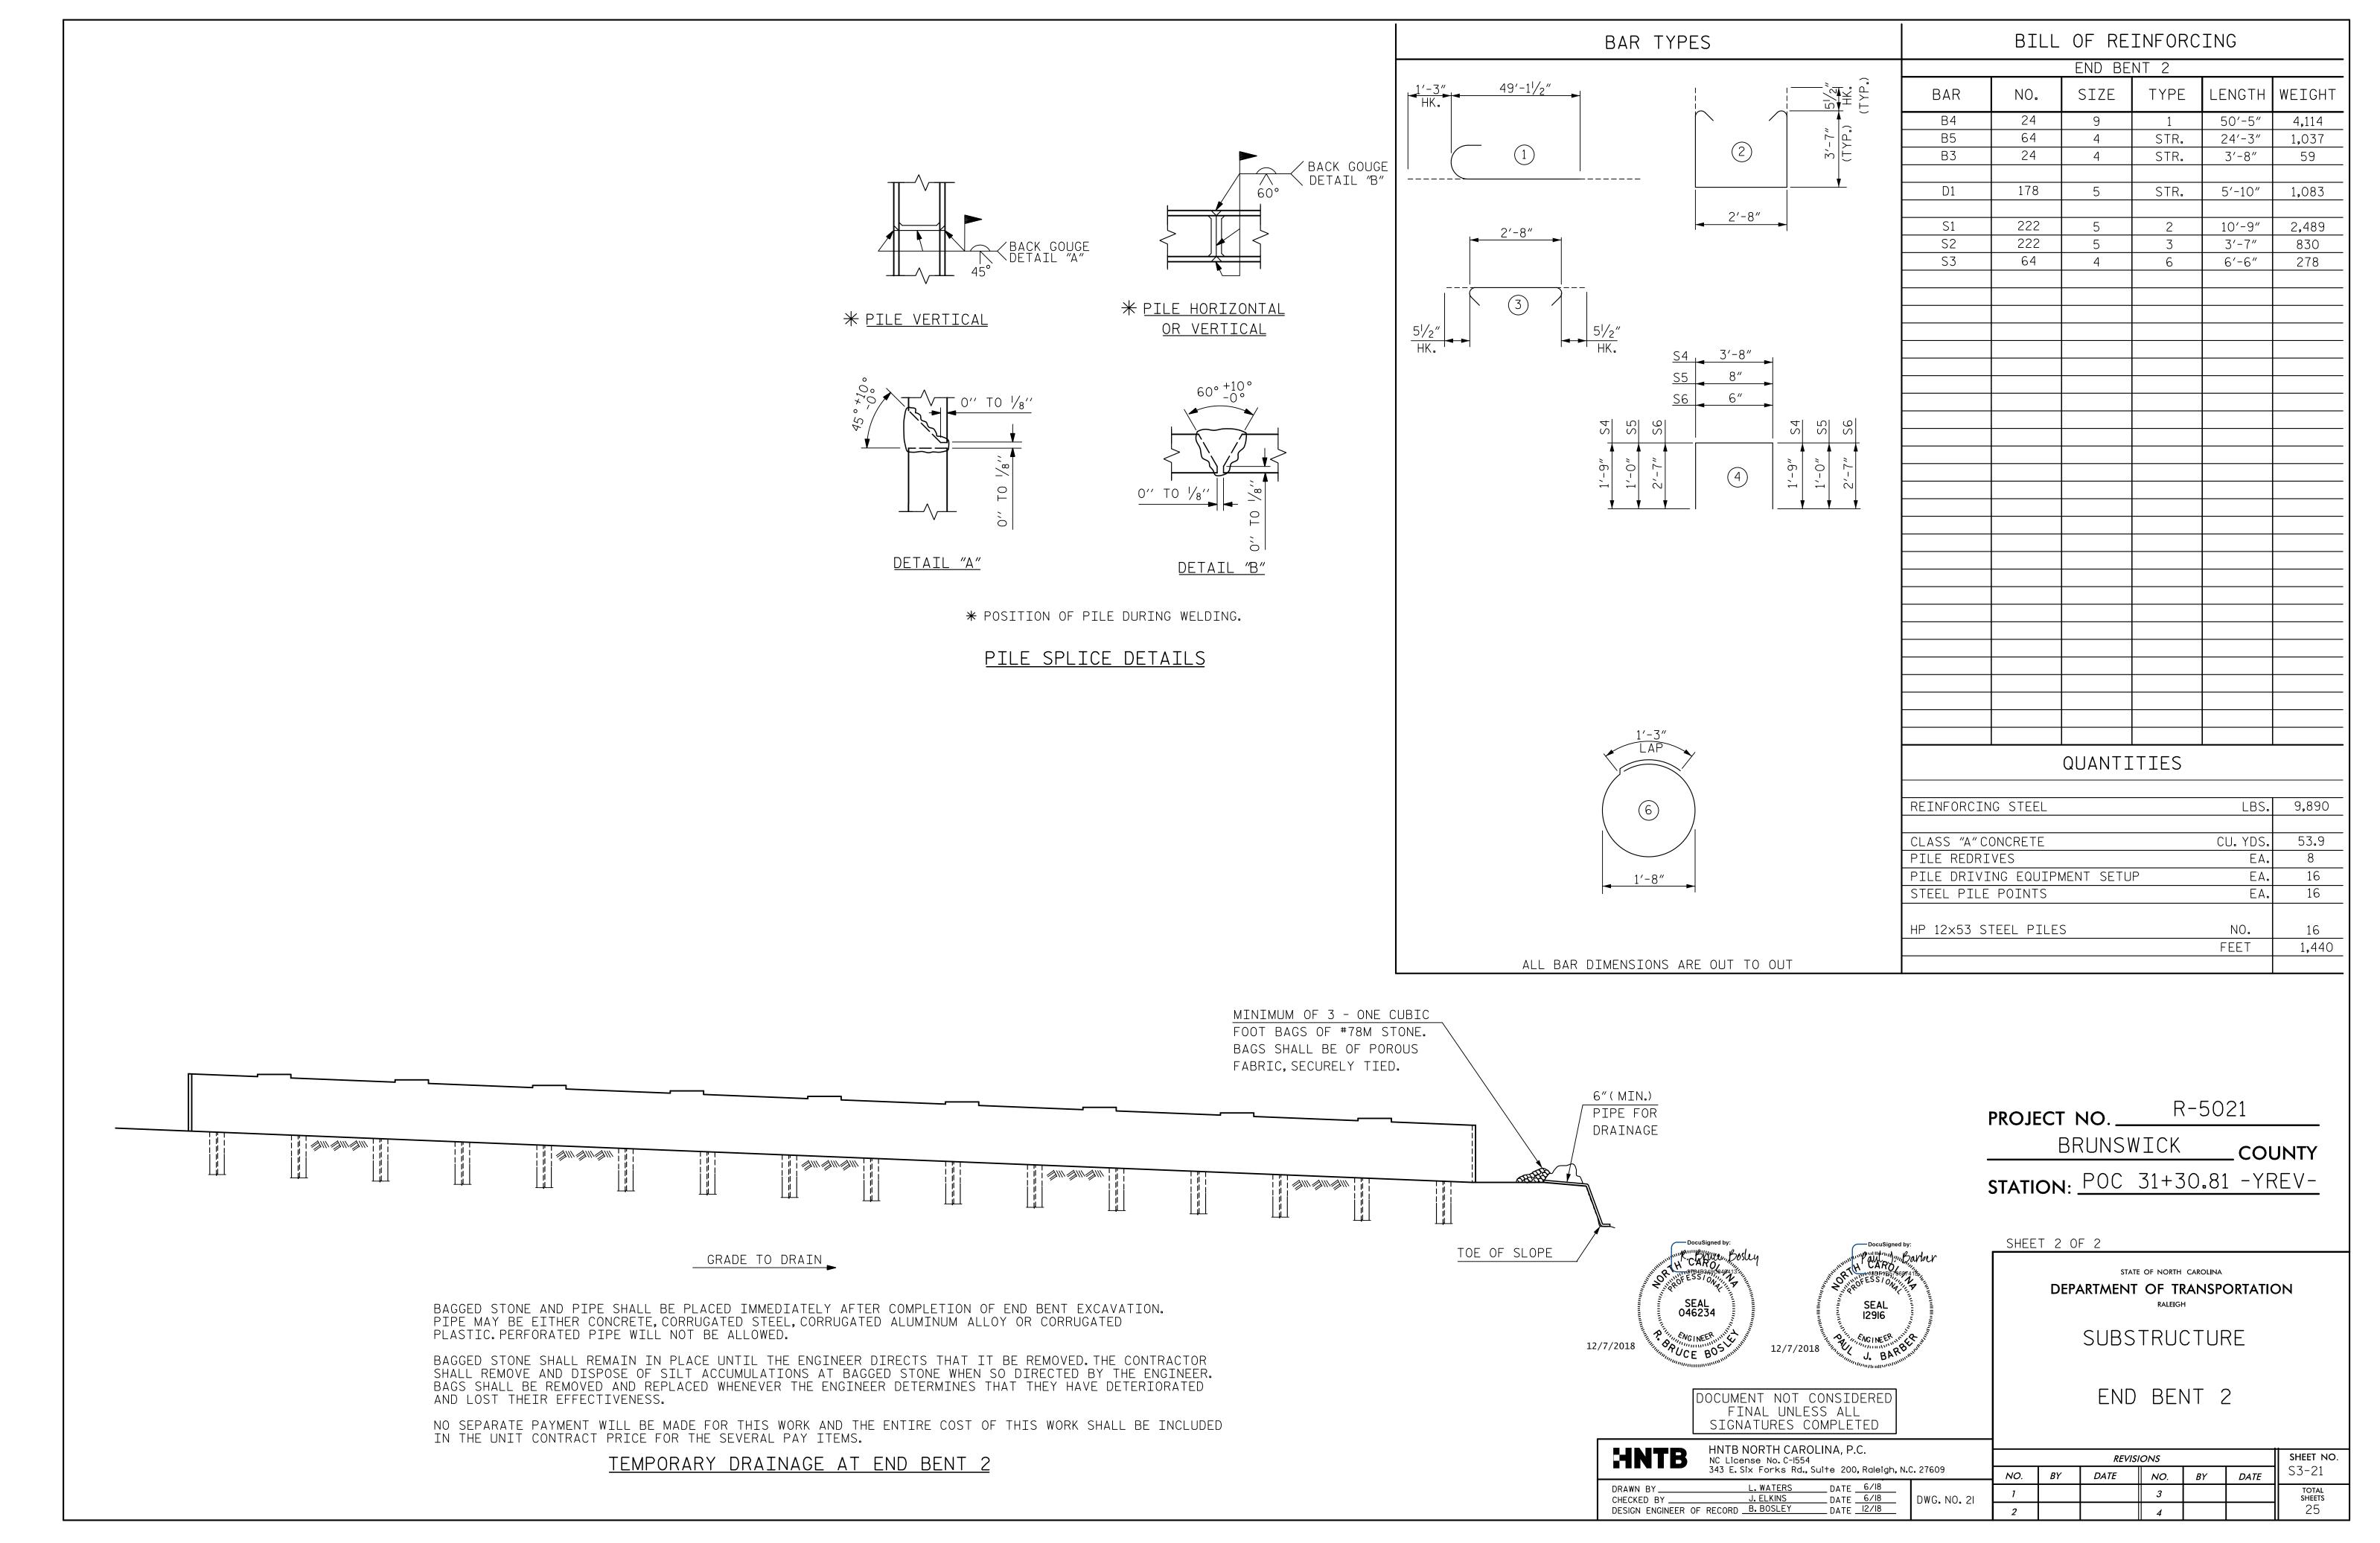

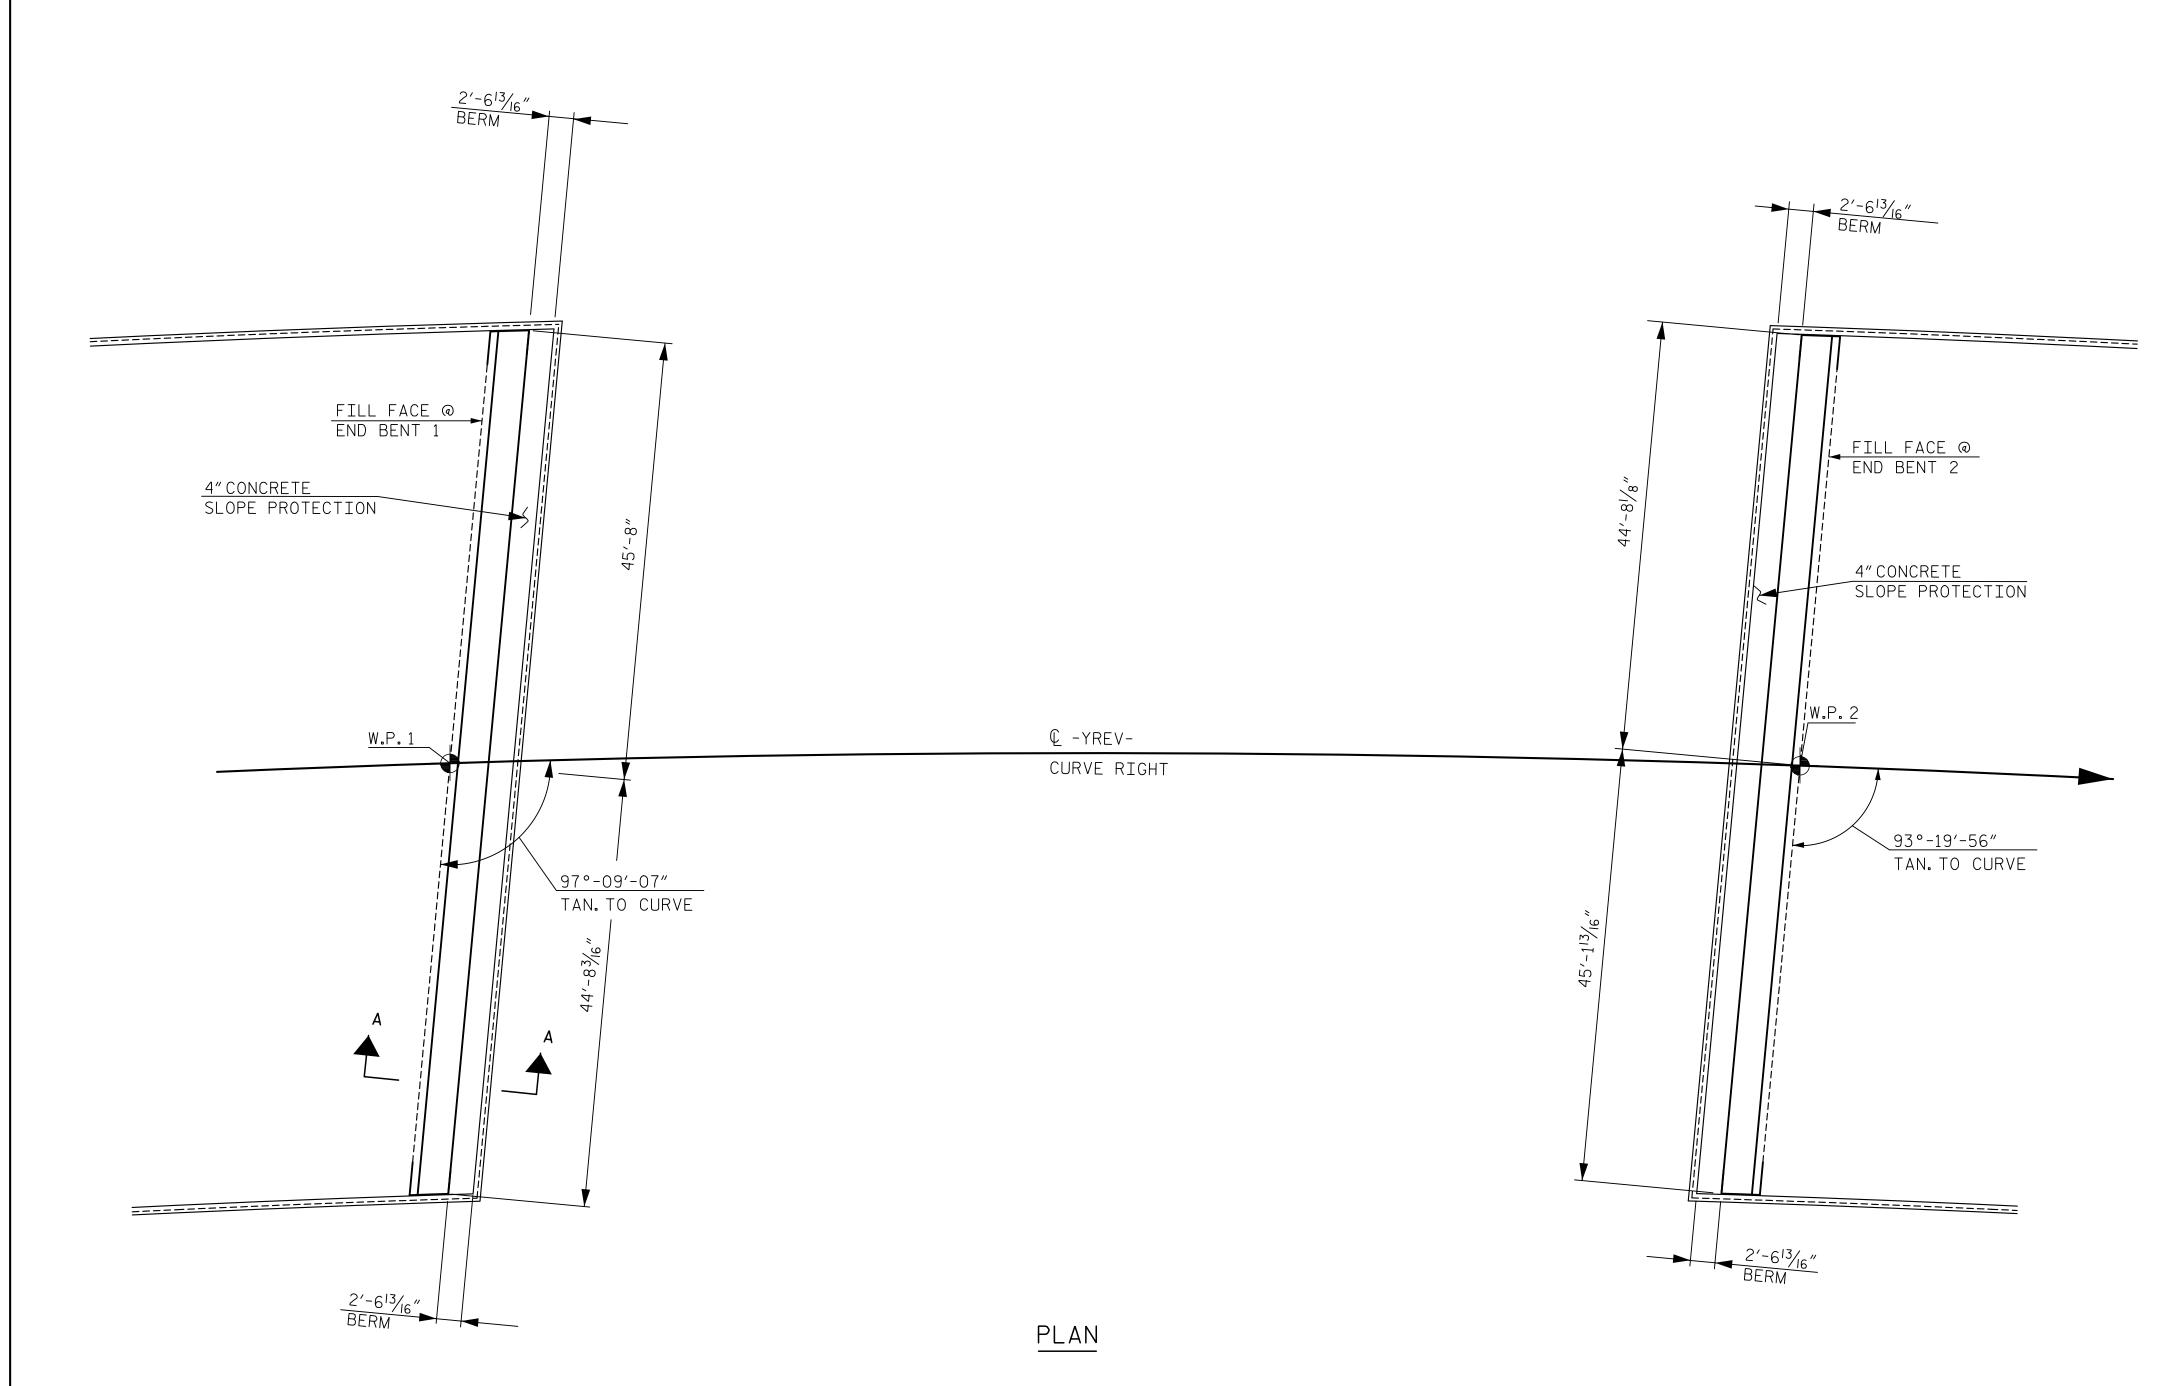

SILICONE SEALANT

GRADE ELEVATION

SECTION A-A

1/4 IN/FT` (MIN.)

END BENT

WALL Workline

MSE WALL

TOP OF COPING


NOTES:

FOR BERM WIDTHS AND ELEVATIONS, SEE GENERAL DRAWING.

SLOPE PROTECTION SHALL CONSIST OF 4" POURED-IN-PLACE CONCRETE PAVING AS SHOWN IN THE DETAILS ON THIS SHEET. CONCRETE SHALL BE CLASS "B". THE CONCRETE SURFACE SHALL BE FLOATED WITH A WOODEN FLOAT AND FINISHED. WELDED WIRE FABRIC REINFORCING SHALL BE 6 X 6 - W1.4 X W1.4, 60" WIDE. SLOPE PROTECTION SHALL BE POURED IN 5' STRIPS AS SHOWN IN THE "POURING DETAIL" WITH 2'-O"LONG #4 BARS PLACED ALONG THE SLOPE BETWEEN STRIPS AT 1'-6" MAXIMUM SPACING. SLOPE PROTECTION MAY BE POURED IN ALTERNATE 4' AND 5' STRIPS AS SHOWN IN THE "OPTIONAL POURING DETAIL" WITH ADJACENT RUNS OF WELDED WIRE FABRIC LAPPING AT LEAST 6". THE COST OF THE WELDED WIRE FABRIC AND #4 BARS, IF USED, SHALL BE INCLUDED IN THE CONTRACT UNIT PRICE BID PER SQUARE YARD FOR SLOPE PROTECTION.


BRIDGE @ STA. POC 31+30.81 -YREV-	4"INCH SLOPE PROTECTION	* WELDED WIRE FABRIC 60 INCHES WIDE
	SQUARE YARDS	APPROX. L.F.
END BENT 1	34	60
END BENT 2	33	60

*QUANTITY SHOWN IS BASED ON 5'POURS.

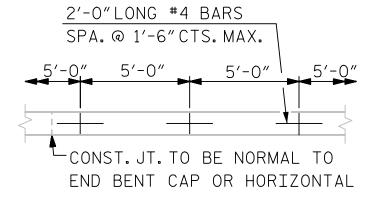

STRIP WIDTHS MAY VARY IN CURVED PORTION.

POURING DETAIL

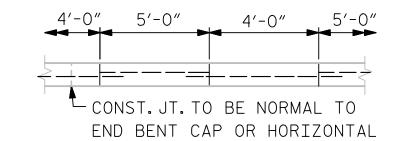


POUR A 4'-O" STRIP FIRST. STRIP WIDTHS MAY VARY IN CURVED PORTION.

OPTIONAL POURING DETAIL

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

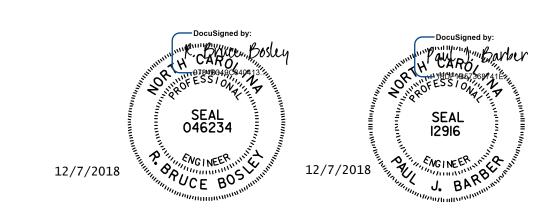

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION


RALEIGH

SLOPE PROTECTION
DETAILS

DOCUMENT NOT CONSIDERED
FINAL UNLESS ALL
SIGNATURES COMPLETED

HNTB NORTH CAROLINA, P.C.
NC License No. C-1554
343 E. Six Forks Rd., Suite 200, Raleigh, 1

	HNTB NORTH CAROLINA, P.C.		1						
HNTB				REVISI	ONS			SHEET NO.	
	343 E. Six Forks Rd., Suite 200, Raleigh, N	.C. 27609	NO.	BY	DATE	NO.	BY	DATE	S3-22
DRAWN BY CHECKED BY	A. GOFF DATE 6/18 B. BOSLEY DATE 6/18	DWG. NO. 22	1			3			TOTAL SHEETS
DESIGN ENGINEER O		2			4			25	

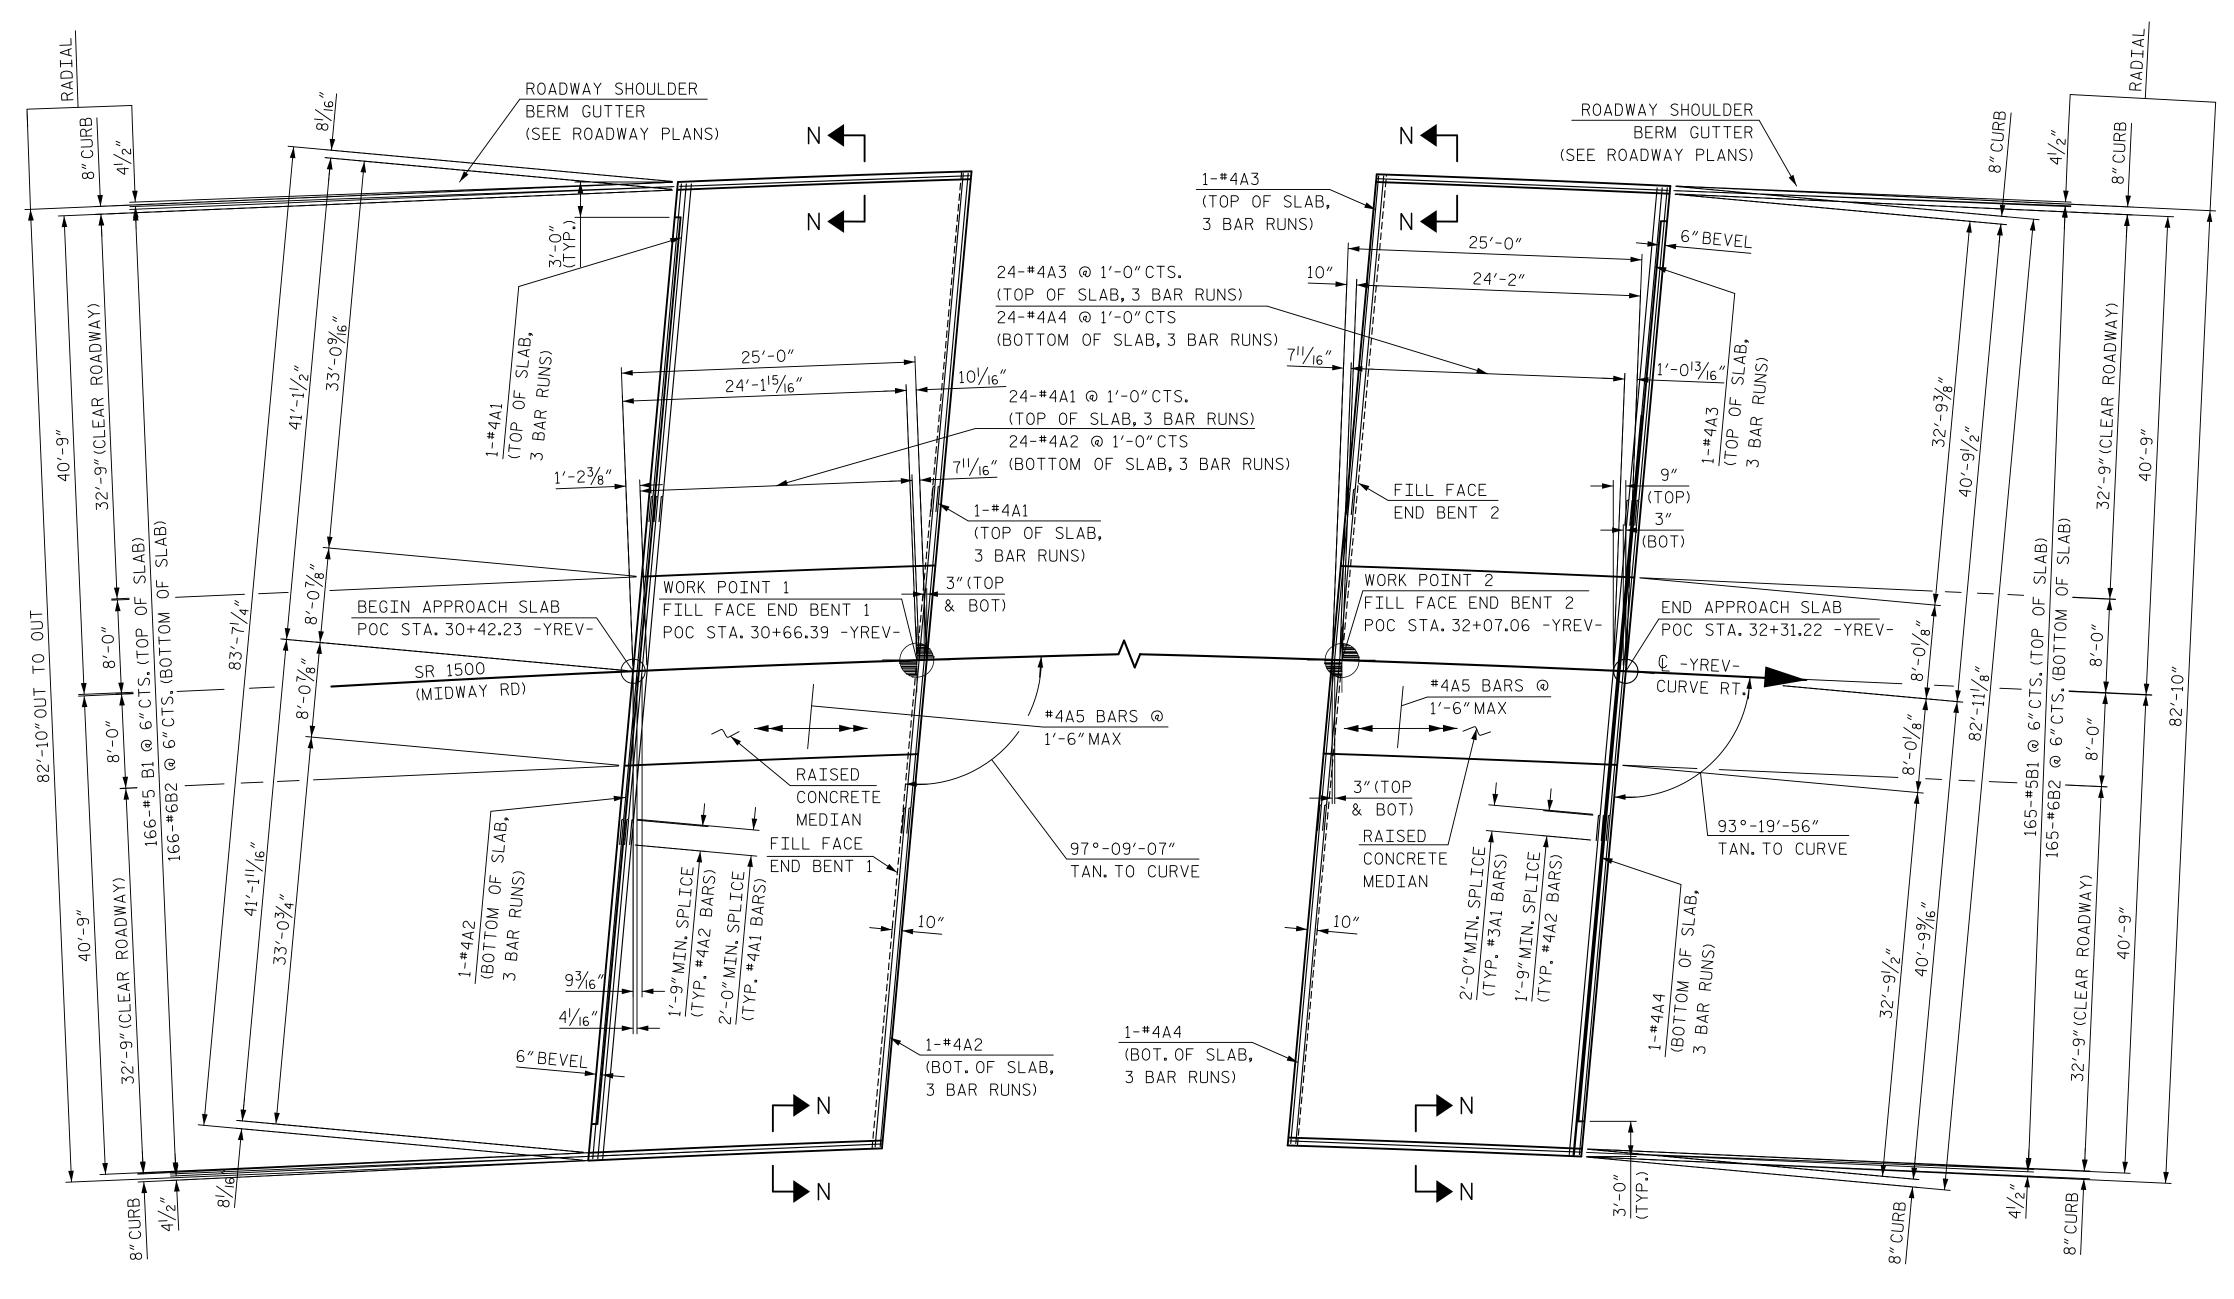


PLAN @ END BENT 1

PLAN @ END BENT 2

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

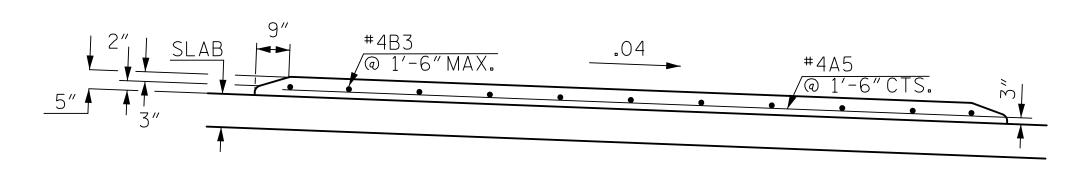



PERMANENT CONCRETE MEDIAN STRIP ON BRIDGE

NOTES:

FOR SECTION N-N, SEE "BRIDGE APPROACH SLAB FOR INTEGRAL ABUTMENT" SHEET 2 OF 3.

FOR APPROACH SLAB BILL OF MATERIAL, SEE "BRIDGE APPROACH SLAB FOR INTEGRAL ABUTMENT" SHEET 2 OF 3





SHEET 1 OF 3

STATE OF NORTH CAROLINA


DEPARTMENT OF TRANSPORTATION


RALEIGH

BRIDGE APPROACH SLAB PLAN

SIGNATURES COMPLETED

		I INIA D.C								
HNTB	HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609					REVISI	IONS			SHEET NO.
	545 E. SIX FORKS Rd., Suite 200, Rdieign, N.C. 21609					DATE	NO.	BY	DATE	S3-23
DRAWN BY CHECKED BY	L. WATERS J. ELKINS	DATE <u>6/18</u> DATE <u>6/18</u>	DWG. NO. 23	7			3			TOTAL SHEETS
DESIGN ENGINEER OF RECORD B. BOSLEY DATE 12/18			D 110. 110. 23	2			4			25

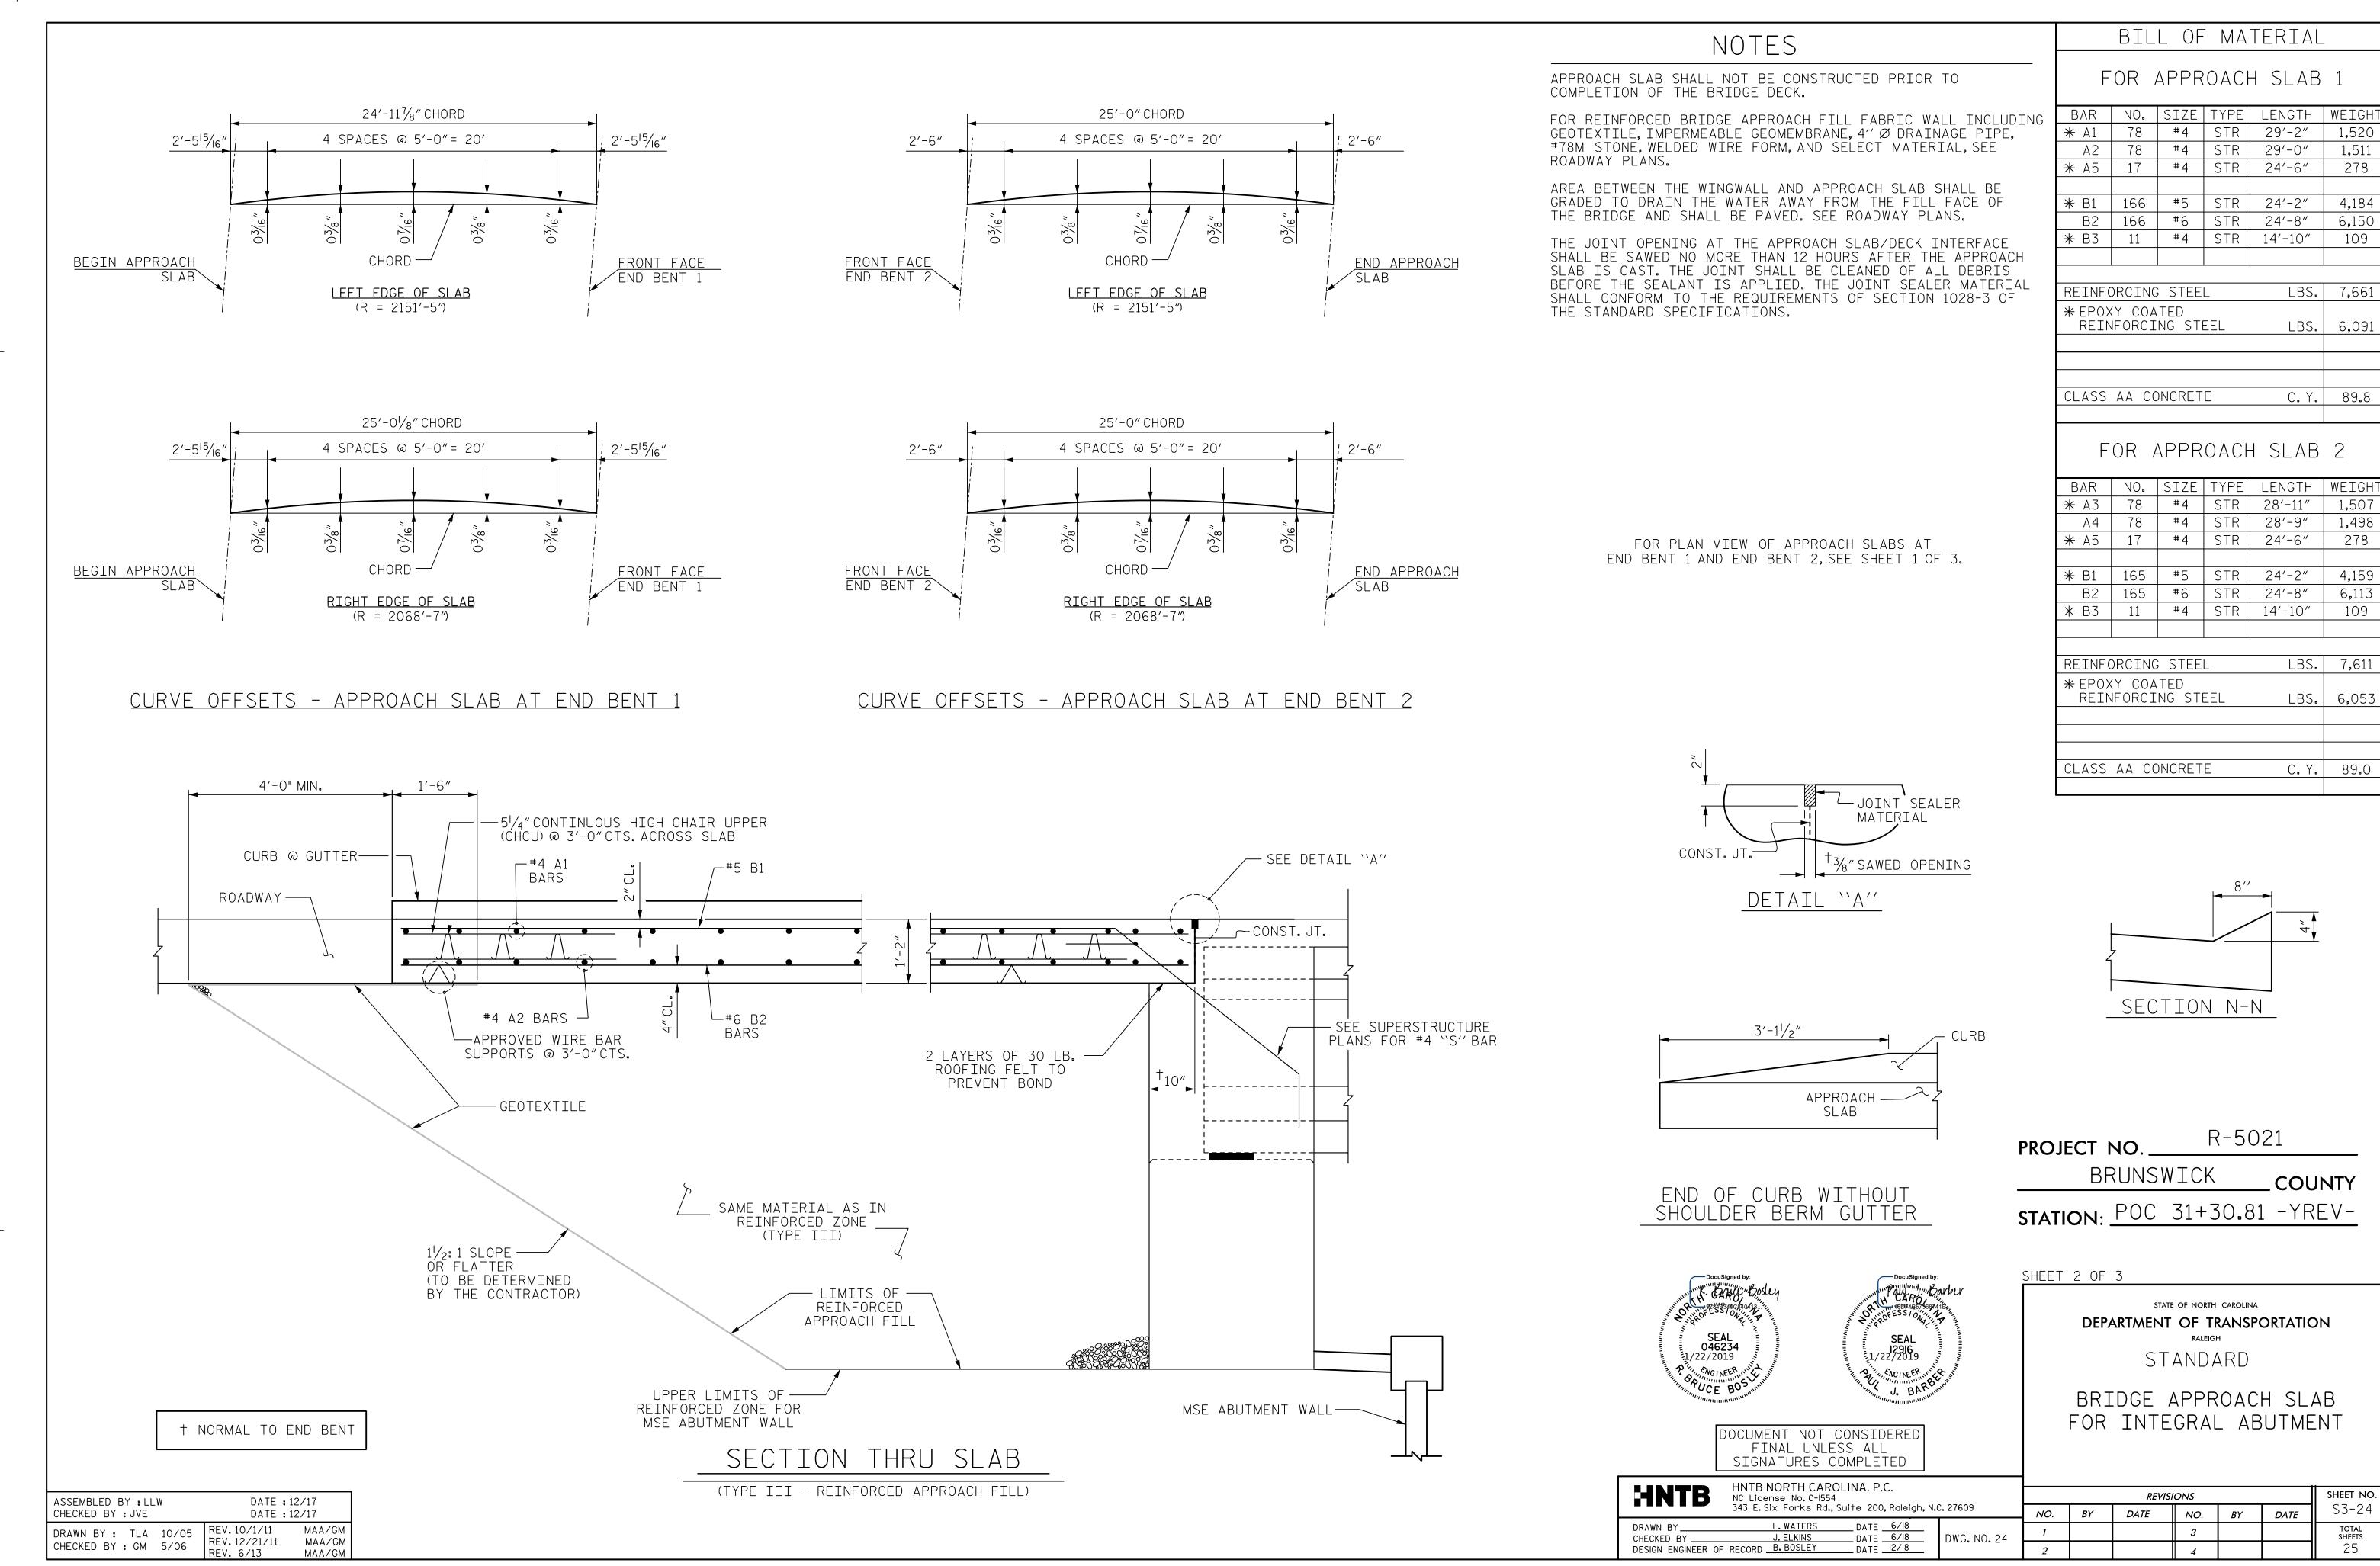

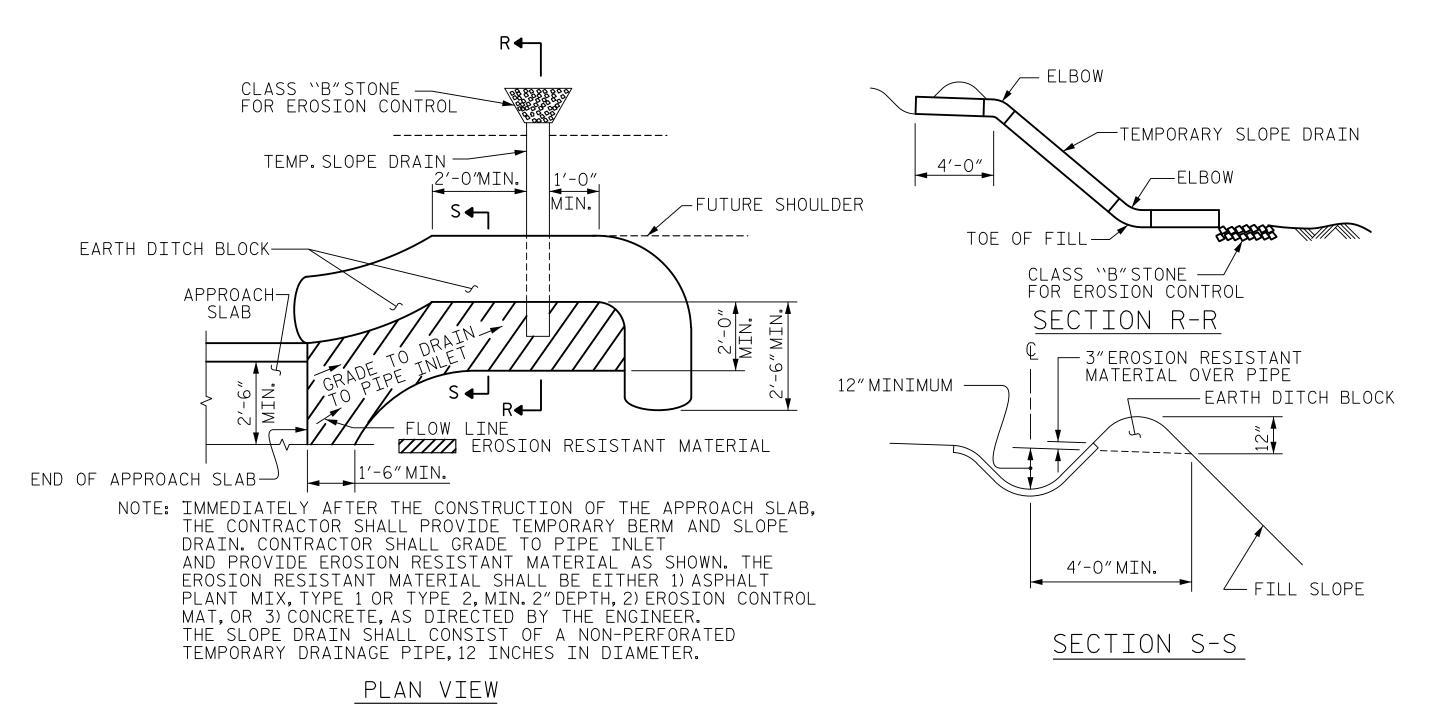

BRIDGE DECK

CRADETON

CRADETON

CRADETON

CAP FLOW LINE ONLY WITH

EROSION RESISTANT MATERIAL

BACKFILL EXCAVATION HOLE

AND GRADE TO DRAIN

NOTE: IF THE APPROACH SLAB IS NOT CONSTRUCTED IMMEDIATELY AFTER THE BACKFILLING OF THE END BENT EXCAVATION, GRADE TO DRAIN TO THE BOTTOM OF THE SLOPE AND PROVIDE EROSION RESISTANT MATERIAL, SUCH AS FIBERGLASS ROVING OR AS DIRECTED BY THE ENGINEER TO PREVENT SOIL EROSION AND TO PROTECT THE AREA ADJACENT TO THE STRUCTURE. THE CONTRACTOR WILL BE REQUIRED TO REMOVE THESE MATERIALS PRIOR TO CONSTRUCTION OF THE APPROACH SLAB.

TEMPORARY DRAINAGE DETAIL


TEMPORARY BERM AND SLOPE DRAIN DETAILS

(TO BE USED WHEN SHOULDER BERM GUTTER IS REQUIRED)

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: POC 31+30.81 -YREV-

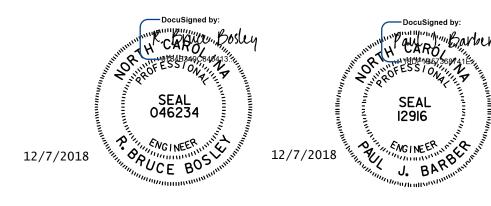

SHEET 3 OF 3

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

RALEIGH

STANDARD

BRIDGE APPROACH SLAB DETAILS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB	HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609				
DRAWN BY	L. WATERS	DATE 6/18			
CHECKED BY	J. ELKINS	DATE 6/18	DWG. NO. 25		
DESIGN ENGINEER O	F RECORD B.BOSLEY	DATE 12/18			

 REVISIONS
 SHEET NO.

 NO.
 BY
 DATE
 S 3 - 25

 1
 3
 TOTAL SHEETS SHEETS

 2
 4
 25

CHECKED BY: JVE


DATE: 12/17


DRAWN BY: FCJ II/88 REV. 10/1/II MAA/GM REV. 7/12 MAA/GM REV. 6/13 MAA/GM MAA/GM

DATE : 12/17

ASSEMBLED BY : LLW

STD. NO. BAS4

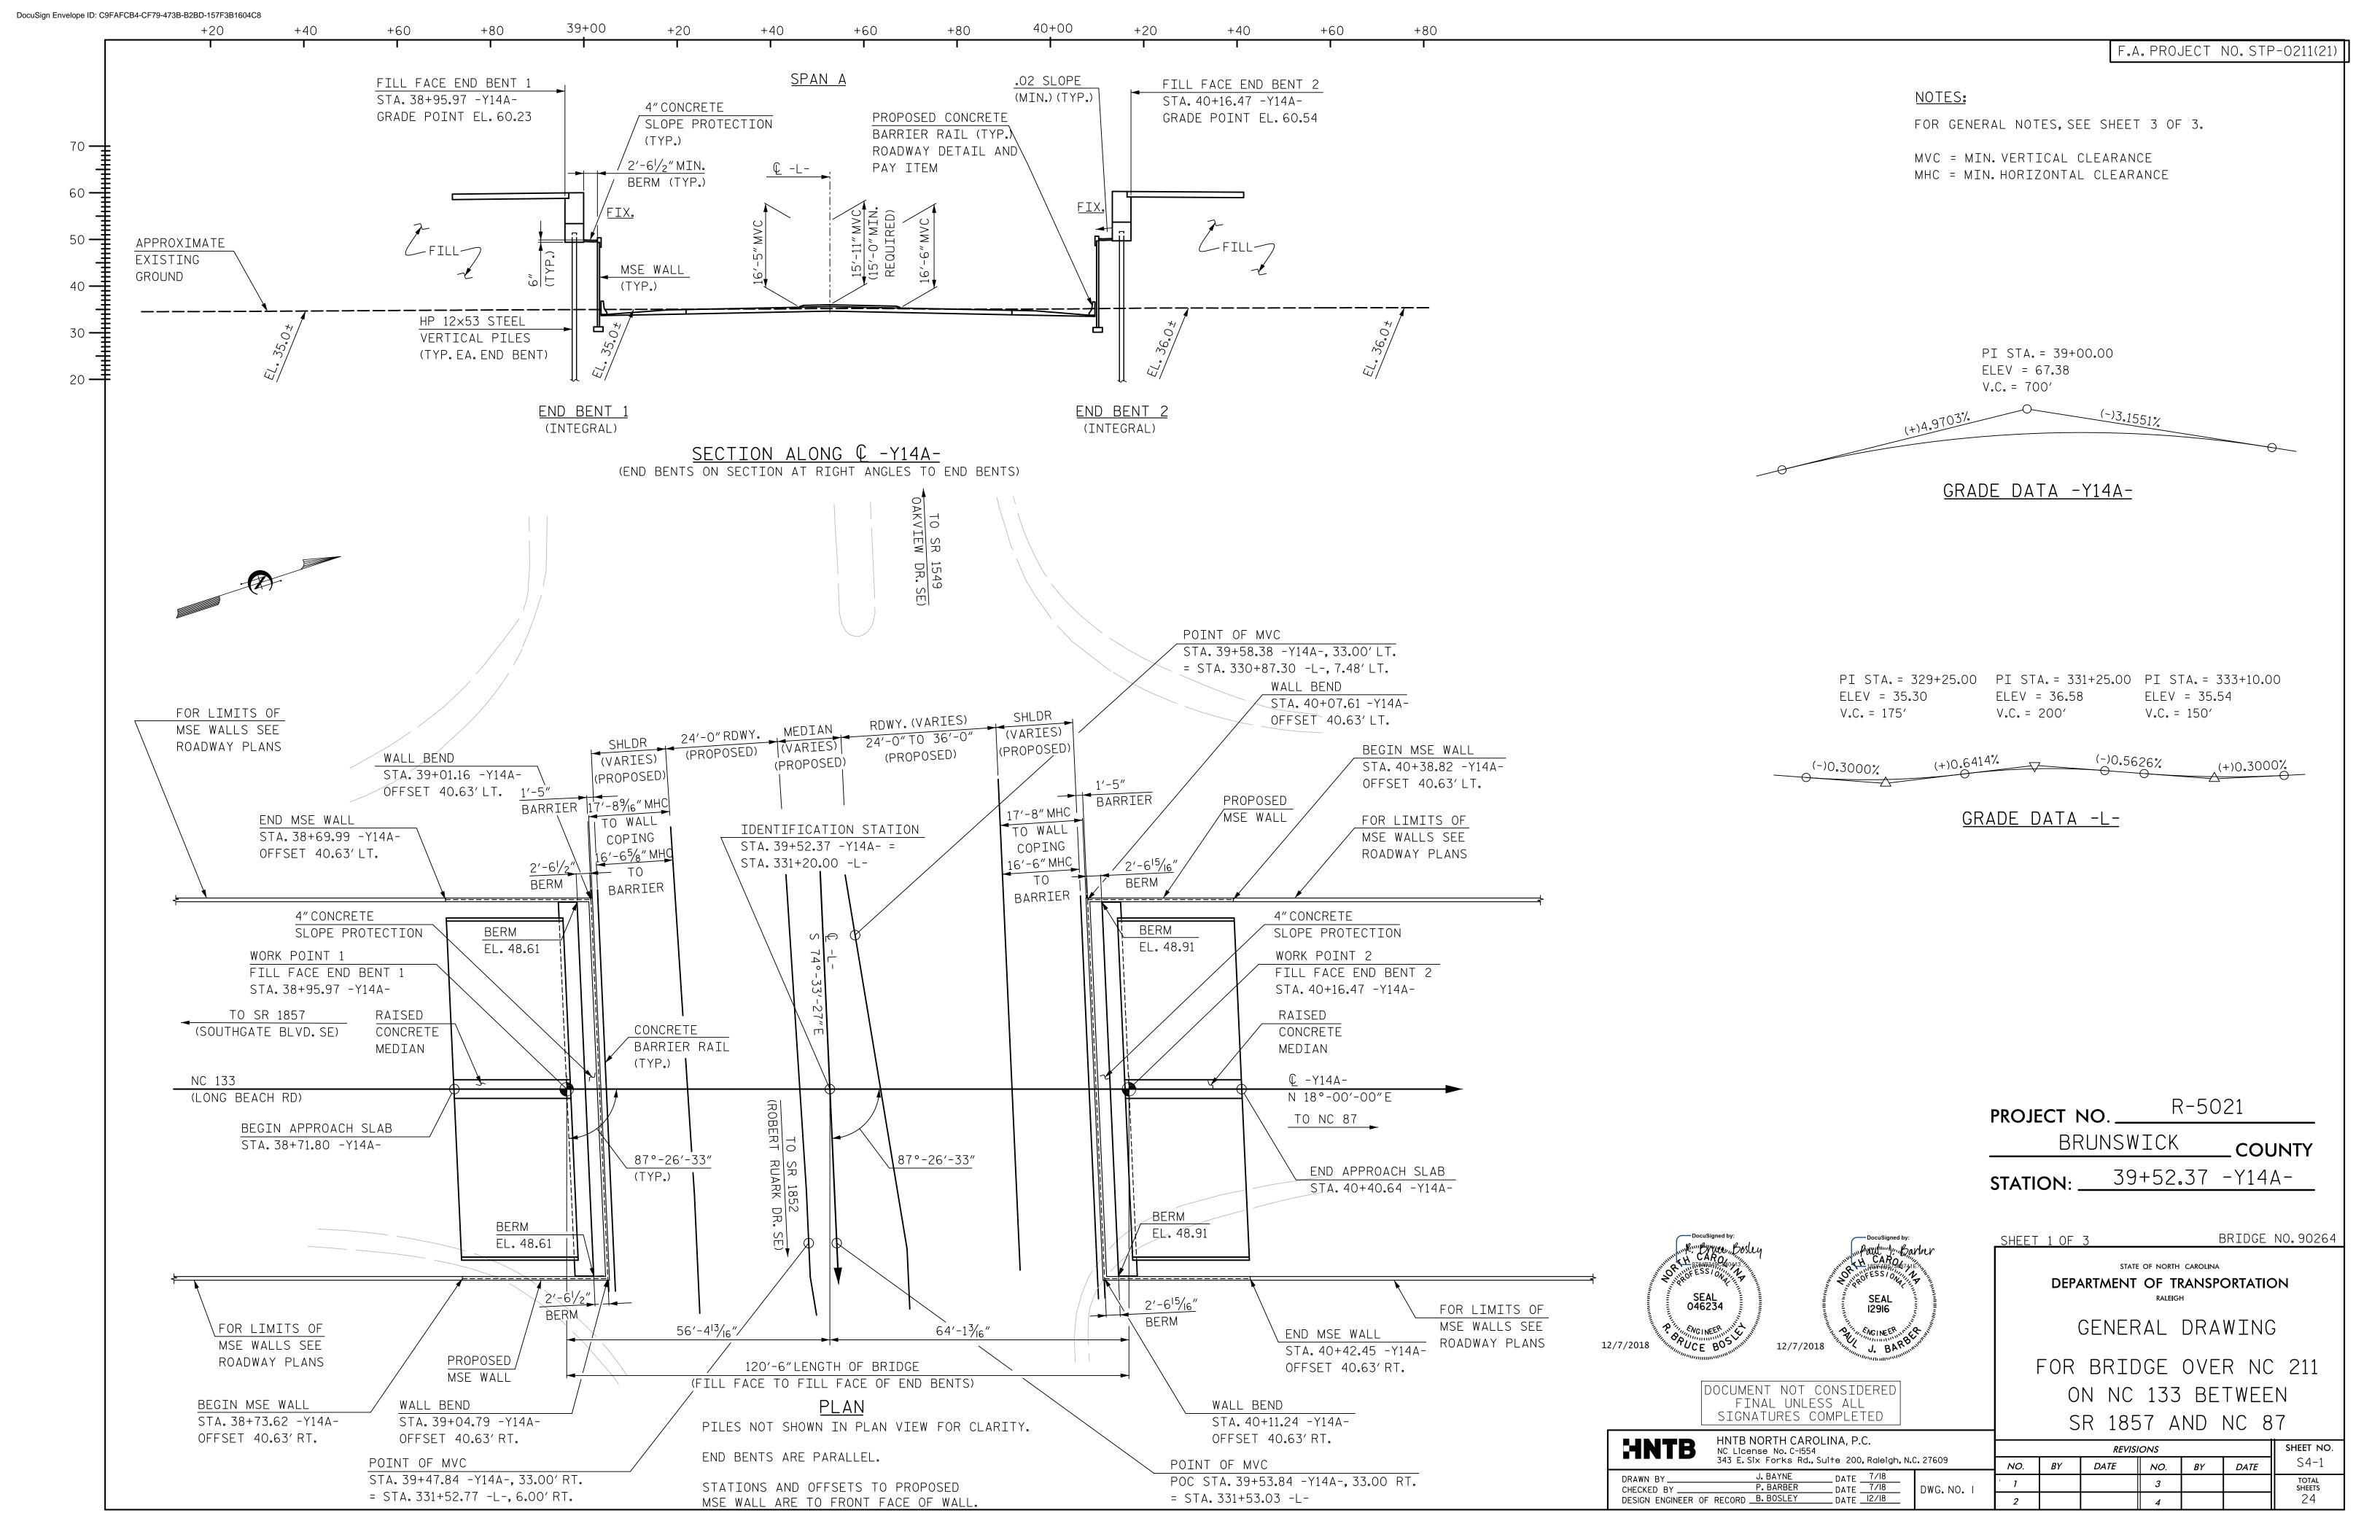

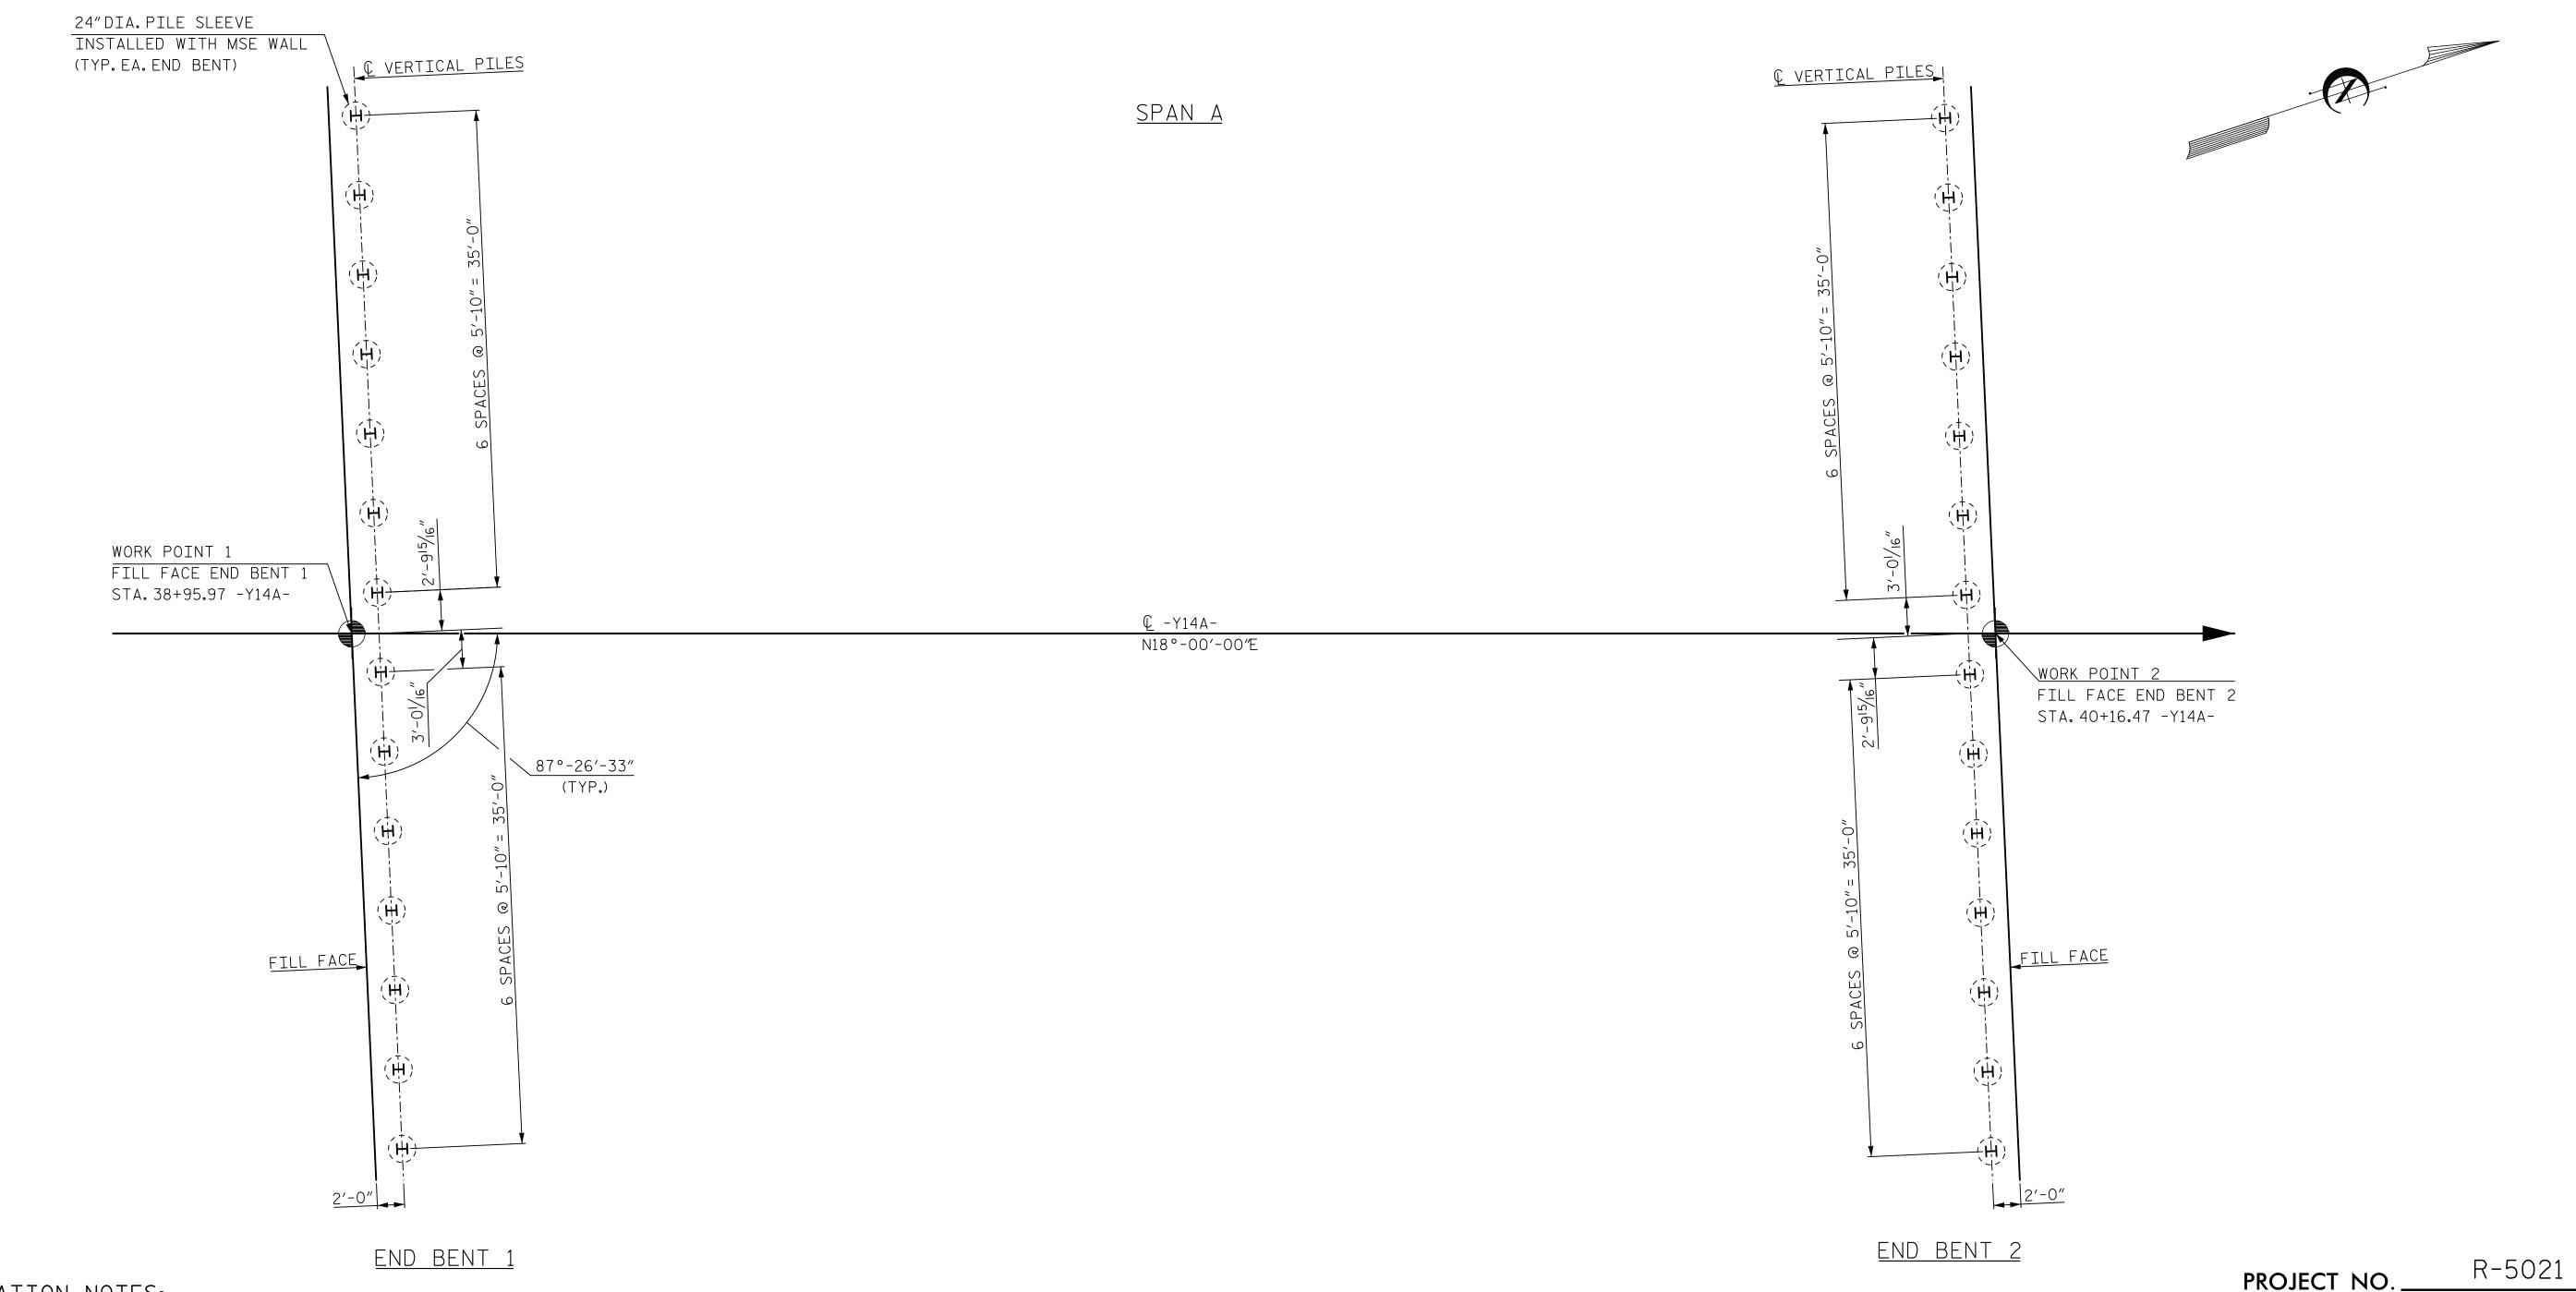

FOUNDATION NOTES:

FOR PILES, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

PILES AT END BENT NO.1 AND END BENT NO.2 ARE DESIGNED FOR A FACTORED RESISTANCE OF 120 TONS PER PILE.

DRIVE PILES AT END BENT NO.1 AND END BENT NO.2 TO A REQUIRED DRIVING RESISTANCE OF 200 TONS PER PILE.


STEEL H-PILE POINTS ARE REQUIRED FOR STEEL H-PILES AT END BENT NO.1 AND END BENT NO. 2. FOR STEEL PILE POINTS, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

TESTING PILES WITH THE PDA DURING DRIVING, RESTRIKING OR REDRIVING MAY BE REQUIRED. THE ENGINEER WILL DETERMINE THE NEED FOR PDA TESTING. FOR PDA TESTING, SEE SECTION 450 OF THE STANDARD SPECIFICATIONS.

OBSERVE A 1 MONTH WAITING PERIOD AFTER CONSTRUCTING THE MECHANICALLY STABILIZED EARTH (MSE) ABUTMENT WALL TO WITHIN 1 FT OF THE BOTTOM OF CAP ELEVATIONS BEFORE BEGINNING END BENT CONSTRUCTION AT END BENT NO.1 AND END BENT NO.2. FOR BRIDGE WAITING PERIODS, SEE ROADWAY PLANS AND SECTION 235 OF THE STANDARD SPECIFICATIONS.


FOUNDATION LAYOUT PLAN

ALL DIMENSIONS ARE PARALLEL OR NORMAL TO FILL FACES AT END BENTS. ALL PILE DIMENSIONS ARE TO CENTERS OF PILES. PILES AT END BENT 1 AND END BENT 2 ARE HP 12x53 STEEL PILES. FOR FOUNDATION ELEVATIONS AND DETAILS, SEE END BENT SHEETS.



CHECKED BY ____

DESIGN ENGINEER OF RECORD B. BOSLEY



SHEET 2 OF 3

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

_ COUNTY

BRUNSWICK


STATION: 39+52.37 -Y14A-

GENERAL DRAWING FOUNDATION LAYOUT

FINAL UNLESS ALL SIGNATURES COMPLETED HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609 DATE 7/18
DATE 7/18
DATE 12/18

|DOCUMENT NOT CONSIDERED|

				REVISI	IONS			SHEET NO.
(C. 27609	NO.	BY	DATE	NO.	BY	DATE	S4-2
	DWG. NO. 2	1			3			TOTAL SHEETS
	D 11 01 11 01 2	2			4			24

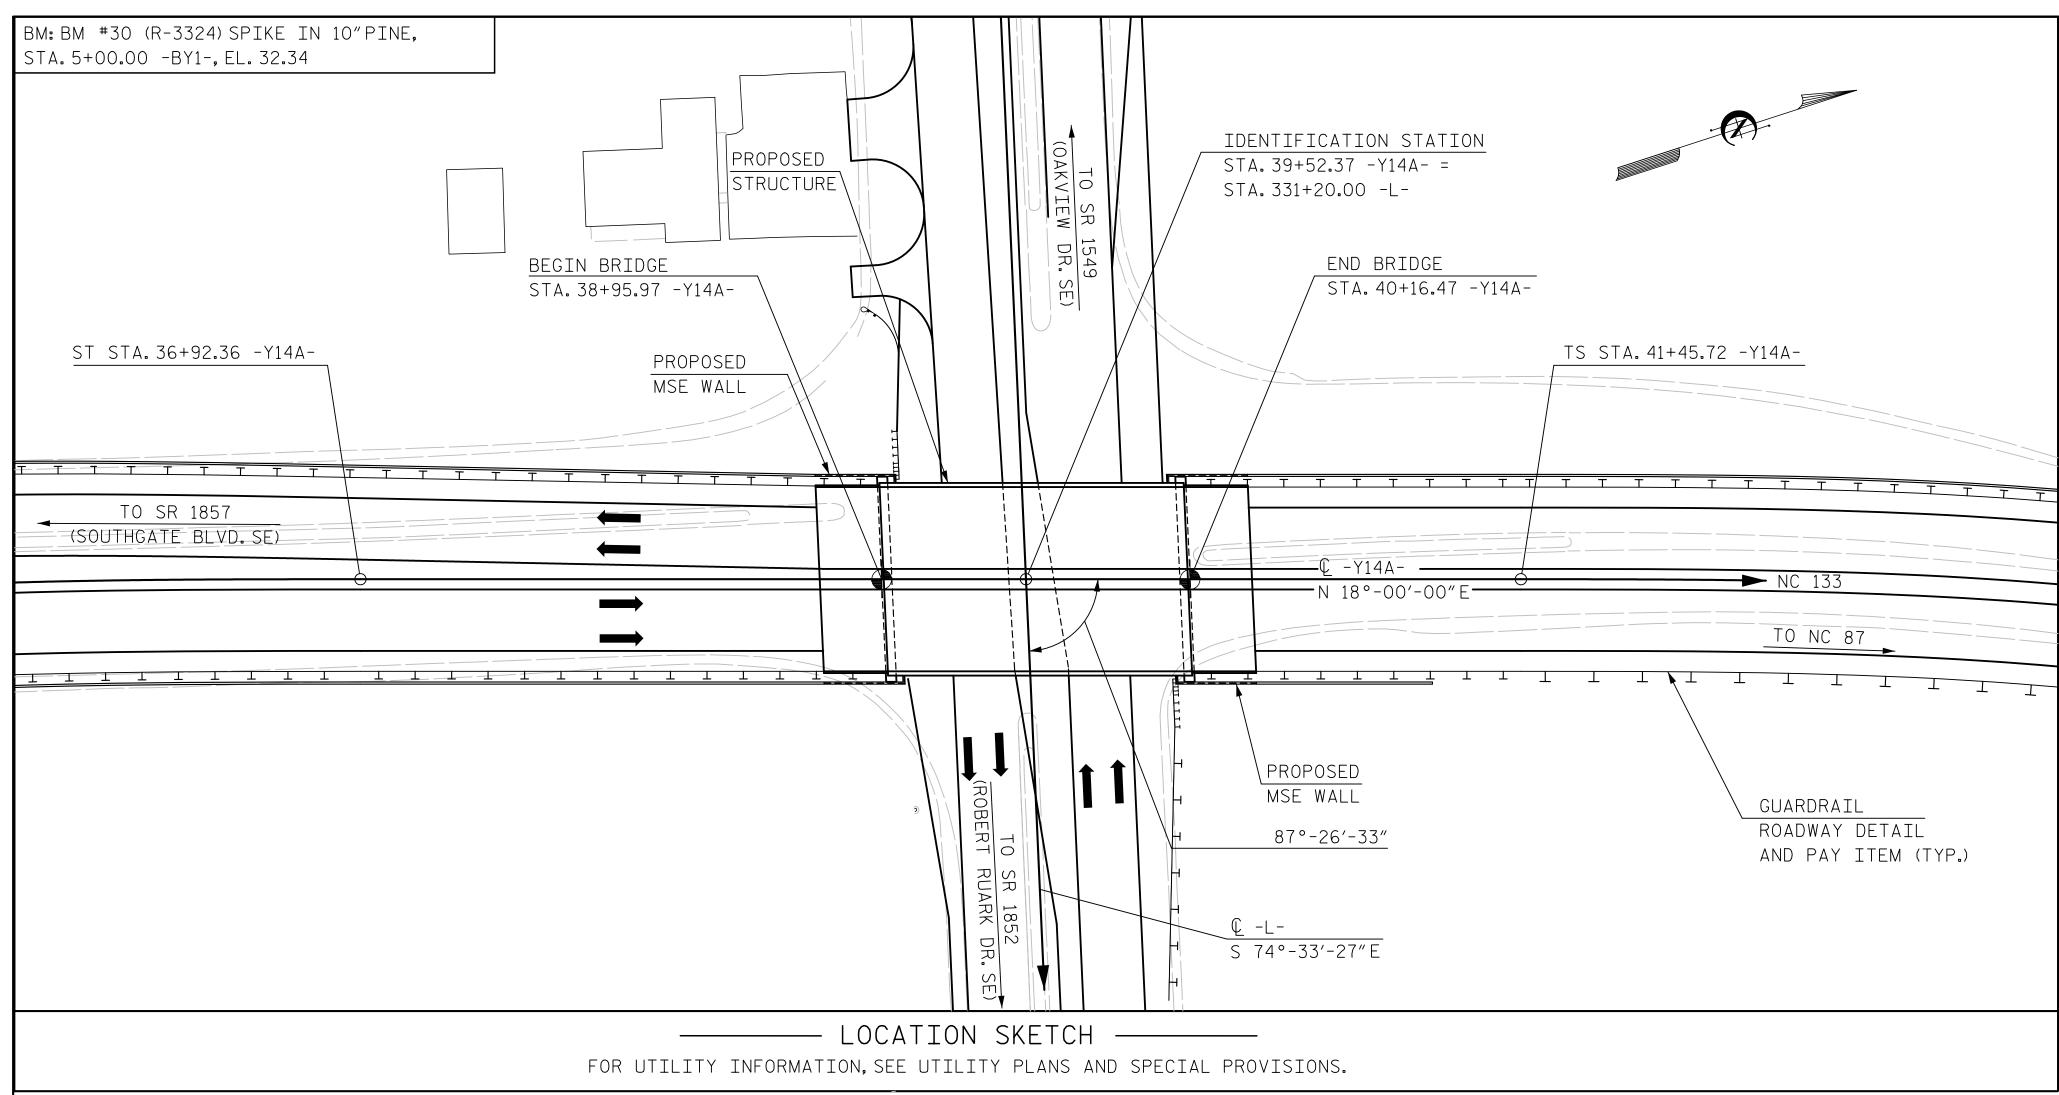

BRIDGE

APPROACH

SLABS,

STATION

39+52.37 -Y14A-

LUMP SUM

LUMP SUM

LUMP SUM

REINFORCED

CONCRETE

DECK SLAB

SQ.FT.

8,942

8,942

PDA

TESTING

EA.

SUPERSTRUCTURE

END BENT :

END BENT 2

TOTAL

GROOVING

BRIDGE

FLOORS

SQ.FT.

10,405.6

10,405.6

CLASS A

CONCRETE

CU. YDS.

50.6

50.6

101.2

TOTAL BILL OF MATERIAL

REINFORCING

STEEL

LBS.

9,041

9,041

MODIFIED

PRESTRESSED

CONCRETE

GIRDERS

825.4

NO. L.F.

PILE DRIVING

HP 12X53

STEEL

NO.

14

14

PILES

L.F.

1,078

1,078

2,156

STEEL PILE

POINTS

EA.

14

14

28

PILE

REDRIVES

EA.

EQUIPMENT

SETUP FOR

HP 12X53

STEEL PILES

EA.

14

14

<u>GENERAL NOTES</u>

ASSUMED LIVE LOAD = HL-93 OR ALTERNATE LOADING.

- FOR OTHER DESIGN DATA AND GENERAL NOTES, SEE SHEET SN.
- FOR EROSION CONTROL MEASURES SEE EROSION CONTROL PLANS.
- THIS BRIDGE HAS BEEN DESIGNED IN ACCORDANCE WITH THE AASHTO LRFD BRIDGE DESIGN SPECIFICATIONS.
- REMOVABLE FORMS MAY BE USED IN LIEU OF METAL STAY-IN-PLACE FORMS IN ACCORDANCE WITH ARTICLE 420-3 OF THE STANDARD SPECIFICATIONS.
- FOR MAINTENANCE AND PROTECTION OF TRAFFIC BENEATH PROPOSED STRUCTURE, SEE SPECIAL PROVISIONS.
- THE CONTRACTOR SHALL PROVIDE INDEPENDENT ASSURANCE SAMPLES OF REINFORCING STEEL AS FOLLOWS: FOR PROJECTS REQUIRING UP TO 400 TONS OF REINFORCING STEEL, ONE 30 INCH SAMPLE OF EACH SIZE BAR USED, AND FOR PROJECTS REQUIRING OVER 400 TONS OF REINFORCING STEEL, TWO 30 INCH SAMPLES OF EACH SIZE BAR USED. THE SAMPLE BARS SHOULD COME FROM STEEL ACTUALLY USED IN THE PROJECT AND THE SAMPLE BARS SHOULD BE REPLACED BY SPLICED BARS AS SPECIFIED IN THE SAMPLE BAR REPLACEMENT CHART. PAYMENT FOR THE SAMPLE BARS AND REPLACEMENT REINFORCING STEEL SHALL BE CONSIDERED INCIDENTAL TO VARIOUS PAY ITEMS.
- NEEDLE BEAMS WILL NOT BE ALLOWED UNLESS OTHERWISE CALLED FOR ON THE PLANS OR APPROVED BY THE ENGINEER.
- FOR SUBMITTAL OF WORKING DRAWINGS, SEE SPECIAL PROVISIONS.
- FOR FALSEWORK AND FORMWORK, SEE SPECIAL PROVISIONS.
- FOR CRANE SAFETY, SEE SPECIAL PROVISIONS.
- THE ELEVATION(S) AND CLEARANCE(S) SHOWN ON THE PLANS AT THE POINT(S) OF MINIMUM VERTICAL CLEARANCE ARE FROM THE BEST INFORMATION AVAILABLE.PRIOR TO BEGINNING BRIDGE CONSTRUCTION, VERIFY THE ELEVATION(S) ON THE EXISTING PAVEMENT AND CHECK THE CLEARANCE.REPORT ANY VARIATIONS TO THE ENGINEER.ANY PLAN REVISIONS NECESSARY TO ACHIEVE THE REQUIRED MINIMUM
- VERTICAL CLEARANCE WILL BE PROVIDED BY THE DEPARTMENT.
- FOR GROUT FOR STRUCTURES, SEE SPECIAL PROVISIONS.
- THIS BRIDGE IS LOCATED IN SEISMIC ZONE 1.

	E BAR CEMENT
SIZE	LENGTH
#3	6′-2″
#4	7′-4″
#5	8′-6″
#6	9′-8″
#7	10'-10"
#8	12'-0"
#9	13′-2″
#10	14'-6"
#11	15′-10″

NOTE:

SAMPLE BAR REPLACEMENT LENGTHS BASED ON 30" (SAMPLE LENGTH) PLUS TWO SPLICE LENGTHS AND fy = 60ksi.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 39+52.37 -Y14A-

SHEET 3 OF 3



4"

SLOPE

PROTECTION

SQ. YD.

26

26

CONCRETE

BARRIER

RAIL

L.F.

237.7

237.7

SEAL 1/22/2019

1/2/2019

1/2/2019

1/2/2019

1/2/2019

SIGNATURES COMPLETED

ELASTOMERIC

BEARINGS

LUMP SUM

LUMP SUM

LUMP SUM

DOCUMENT NOT CONSIDERED GENE FINAL UNLESS ALL

LOCATION SKETCH, GENERAL NOTES, AND TOTAL BILL OF MATERIALS

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

GENERAL DRAWING

HNTB NORTH CAROLINA, P.C. NC License No. C-1554 AC I Selve Port Coults 200 Parists No. 27600					REVISI	IONS			SHEET NO.	
343 E. SIX FORKS Rd., SUITE 200, Rdieign, N.C. 21		C. 27609	NO.	BY	DATE	NO.	BY	DATE	S4-3	
DRAWN BY CHECKED BY	L. WATERS B. BOSLEY	DATE <u>7/18</u> DATE <u>7/18</u>	DWG. NO. 3	1			3			TOTAL SHEETS
DESIGN ENGINEER O	F RECORD B. BOSLEY	DATE 12/18		2			4			24

LOAD AND RESISTANCE FACTOR RATING (LRFR) SUMMARY FOR PRESTRESSED CONCRETE GIRDERS SERVICE III LIMIT STATE STRENGTH I LIMIT STATE SHEAR MOMENT MOMENT DIST/ LEFT SPAN DISTI FACT DISTE FACT DISTI FACT DIST, LEFT SPAN IVE A C MII | | AR 1.040 1.10 1.07 1.75 0.982 1.23 58.2 0.80 0.982 1.07 58.2 HL-93 (INVENTORY) N/A 1.35 0.982 1.59 58.2 1.46 DESIGN HL-93 (OPERATING) 1.040 N/A 1.46 11.1 N/A ___ LOAD 58.2 55.8 1.56 1.55 58.2 36.000 1.55 1.75 0.982 1.040 0.80 0.982 RATING HS-20 (INVENTORY HS-20 (OPERATING) 2.06 74.2 1.35 0.982 2.31 58.2 1.040 2.06 36.000 11.1 N/A SNSH 13.500 3.75 50.6 1.40 0.982 5.38 58.2 1.040 5.10 0.80 0.982 3.75 58.2 53.6 0.982 58.2 1.040 3.52 0.982 58.2 SNGARBS2 2.68 1.40 3.85 2.68 20.000 0.80 0.982 58.2 58.2 2.50 55.0 3.59 3.23 0.80 0.982 2.50 SNAGRIS2 22.000 1.40 1.040 58.2 1.040 58.2 1.86 50.9 0.982 2.67 0.982 SNCOTTS3 27.250 1.40 2.48 11.1 0.80 1.86 SNAGGRS4 52.7 1.40 0.982 2.17 58.2 1.99 0.982 1.51 58.2 34.925 1.51 1.040 0.80 0.982 2.13 58.2 1.98 0.982 1.40 1.040 1.48 58.2 SNS5A 35.550 1.48 52.6 0.80 58.2 58.2 53.5 0.982 1.93 1.78 0.80 0.982 SNS6A 39.950 1.34 1.40 1.040 1.34 58.2 53.8 58.2 LEGAL LOAD 1.28 0.982 1.84 1.040 1.72 0.982 SNS7B 42.000 1.40 1.28 11.1 0.80 58.2 58.2 1.040 TNAGRIT3 33.000 1.63 53.8 1.40 0.982 2.35 2.16 0.80 0.982 1.63 1.64 1.40 0.982 58.2 1.040 2.12 58.2 TNT4A 33.075 54.2 2.35 11.1 0.80 0.982 1.64 58.2 1.040 1.80 58.2 41.600 1.32 54.9 1.40 0.982 1.90 0.80 0.982 1.32 TNT6A 58.2 55.4 58.2 1.32 0.982 0.80 0.982 TNT7A 42.000 1.40 1.90 1.77 1.32 1.040 11.1 58.2 58.2 TNT7B 42.000 1.35 56.7 1.40 0.982 1.93 1.69 0.80 0.982 1.35 --А 1.040 11.1 0.982 58.2 TNAGRIT4 43.000 1.29 55.5 1.40 1.86 1.040 1.65 0.80 0.982 1.29 58.2 58.2 TNAGRT5A 45.000 55.3 1.40 0.982 58.2 1.040 1.61 0.80 0.982 1.23 1.23 1.76

58.2

1.040

1.57

0.80

0.982

1.22

LOAD FACTORS:

DESIGN	LIMIT STATE	$\gamma_{ extsf{DC}}$	$\gamma_{\sf DW}$
LOAD RATING	STRENGTH I	1.25	1.5
FACTORS	SERVICE III	1.00	1.0

NOTES:

MINIMUM RATING FACTORS ARE BASED ON THE STRENGTH I AND SERVICE III LIMIT STATES.

ALLOWABLE STRESSES FOR SERVICE III LIMIT STATE ARE AS REQUIRED FOR DESIGN.

COMMENTS:

(#) CONTROLLING LOAD RATING

1 DESIGN LOAD RATING (HL-93)

2 DESIGN LOAD RATING (HS-20)

 $\langle 3 \rangle$ LEGAL LOAD RATING **


GIRDER LOCATION

** SEE CHART FOR VEHICLE TYPE

I - INTERIOR GIRDER

E - EXTERIOR GIRDER

R-5021 PROJECT NO. BRUNSWICK COUNTY **STATION**: 39+52.37 -Y14A-



58.2

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL

_		SIGNATURES COM	IPLETED	
	HNTB	HNTB NORTH CAROLIN NC License No. C-1554 343 E. Six Forks Rd., Suit	,	C. 27609
	DRAWN BY CHECKED BY DESIGN ENGINEER OF	A. GOFF	DATE 7/18 DATE 7/18 DATE 12/18	DWG. NO.4

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

STANDARD

		REVISI	ONS			SHEET NO.
NO.	BY	DATE	NO.	BY	DATE	S4-4
1			3			TOTAL SHEETS
2			4			24

STD. NO. LRFR1

-	116'-6"	→
	$\langle 2 \rangle \langle 3 \rangle$	
BENT 1		END BE

LRFR SUMMARY

45.000

54.9

1.40

0.982


1.75

ASSEMBLED BY : LLW DATE:3/18 CHECKED BY : ADG DATE : 4/18 DRAWN BY: MAA 1/08 REV. 11/12/08RR MAA/GM

CHECKED BY : GM/DI 2/08

MAA/GM

TNAGRT5B

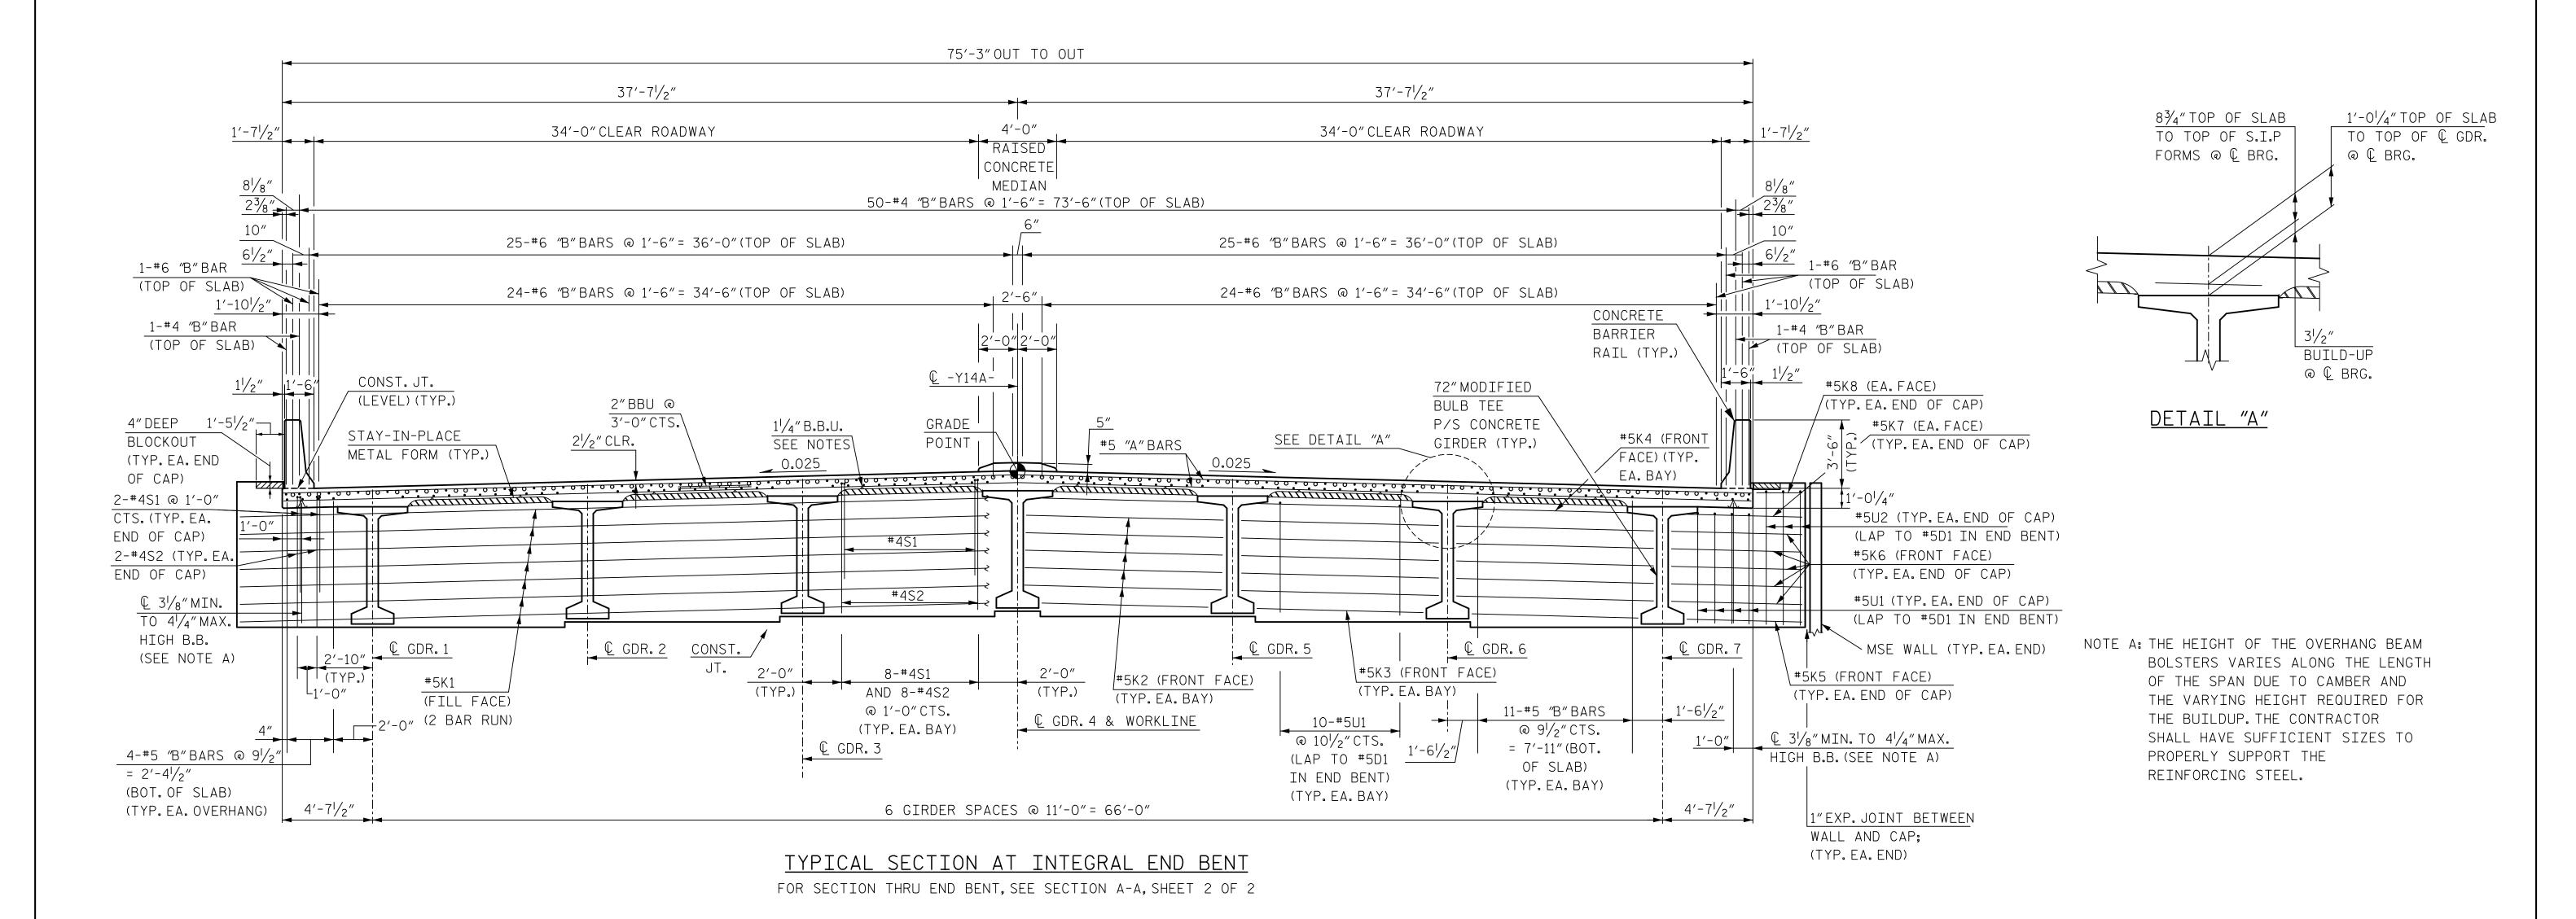

<u>NOTES</u>

PROVIDE $1^{1}/_{4}$ " HIGH BEAM BOLSTERS UPPER AT 4'-0"CTS. ATOP THE METAL STAY-IN-PLACE FORMS TO SUPPORT THE BOTTOM MAT OF 'A' BARS. WHEN USING REMOVABLE FORMS, PROVIDE CONTINUOUS HIGH CHAIRS FOR METAL DECK (CHCM) AT 4'-0"CTS. WITH A HEIGHT TO SUPPORT THE BOTTOM MAT OF 'A' BARS A CLEAR DISTANCE OF $2^{1}/_{2}$ " ABOVE THE TOP OF THE REMOVABLE FORM


LONGITUDINAL STEEL MAY BE SHIFTED SLIGHTLY, AS NECESSARY, TO AVOID INTERFERENCE WITH STIRRUPS IN PRESTRESSED CONCRETE GIRDERS.

PREVIOUSLY CAST CONCRETE IN EACH SPAN SHALL HAVE ATTAINED A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI BEFORE ADDITIONAL CONCRETE IS CAST IN THE SPAN.

BARRIER RAIL IN EACH SPAN SHALL NOT BE CAST UNTIL ALL SLAB CONCRETE IN THAT SPAN HAS BEEN CAST AND HAS REACHED A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI.

TO MAINTAIN PROPER LOCATION OF "A" BARS IN THE TOP OF SLAB, BBU DEPTH MUST VARY IN UNIT AS THE MAXIMUM SIZE OF THE "B" BARS IN THE TOP OF THE SLAB VARIES. A 21/4" BBU SHALL BE USED WHERE ONLY #4 "B" BARS ARE PRESENT. WHERE #6 "B" BARS ARE PRESENT, A 2" BBU SHALL BE USED.

NO CHAMFER IS REQUIRED ON CORNERS OF GIRDER BUILD-UPS.

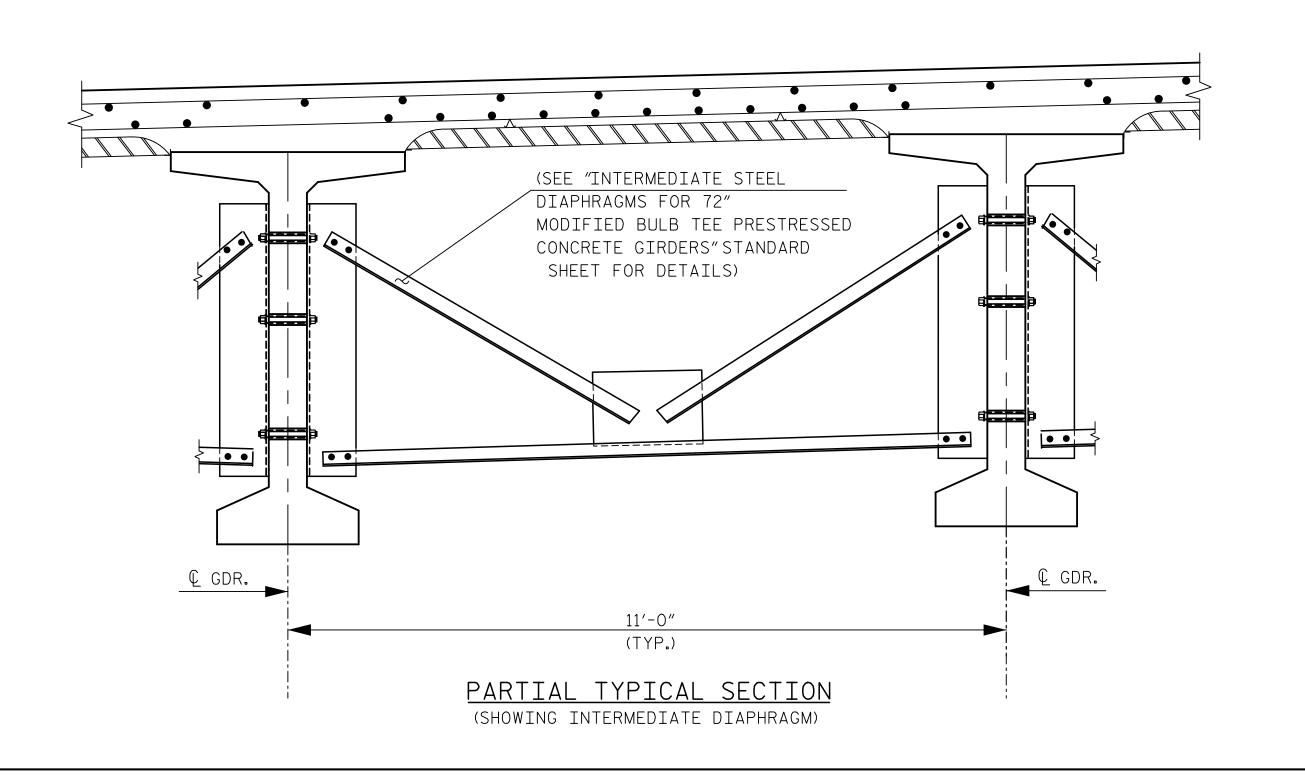


"B" BAR KEY

- = CONTINUOUS BAR RUN, SEE PLAN OF SPAN SHEETS.
- •= NON-CONTINUOUS BAR RUN FOR NEGATIVE MOMENT REGIONS, SEE PLAN OF SPAN SHEETS.

PROJECT NO. R-5021

BRUNSWICK COUNTY

STATION: 39+52.37 -Y14A-

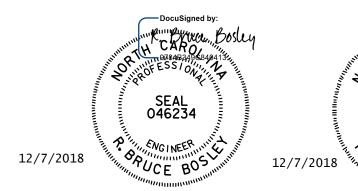

DESIGN ENGINEER OF RECORD B. BOSLEY

SHEET 1 OF 2

Thur

DEPAR

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

SUPERSTRUCTURE

TYPICAL SECTION

HNTB NORTH CAROLINA, P.C.

NC License No. C-1554
343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609

DRAWN BY

CHECKED BY

A. GOFF
DATE 7/18
CHECKED BY

DEPOSITE T/18
DWG. NO. 5

__ DATE 12/18

DOCUMENT NOT CONSIDERED


FINAL UNLESS ALL

SIGNATURES COMPLETED

 REVISIONS
 SHEET NO.


 NO.
 BY
 DATE
 NO.
 BY
 DATE
 TOTAL SHEETS


 2
 4
 24
 24

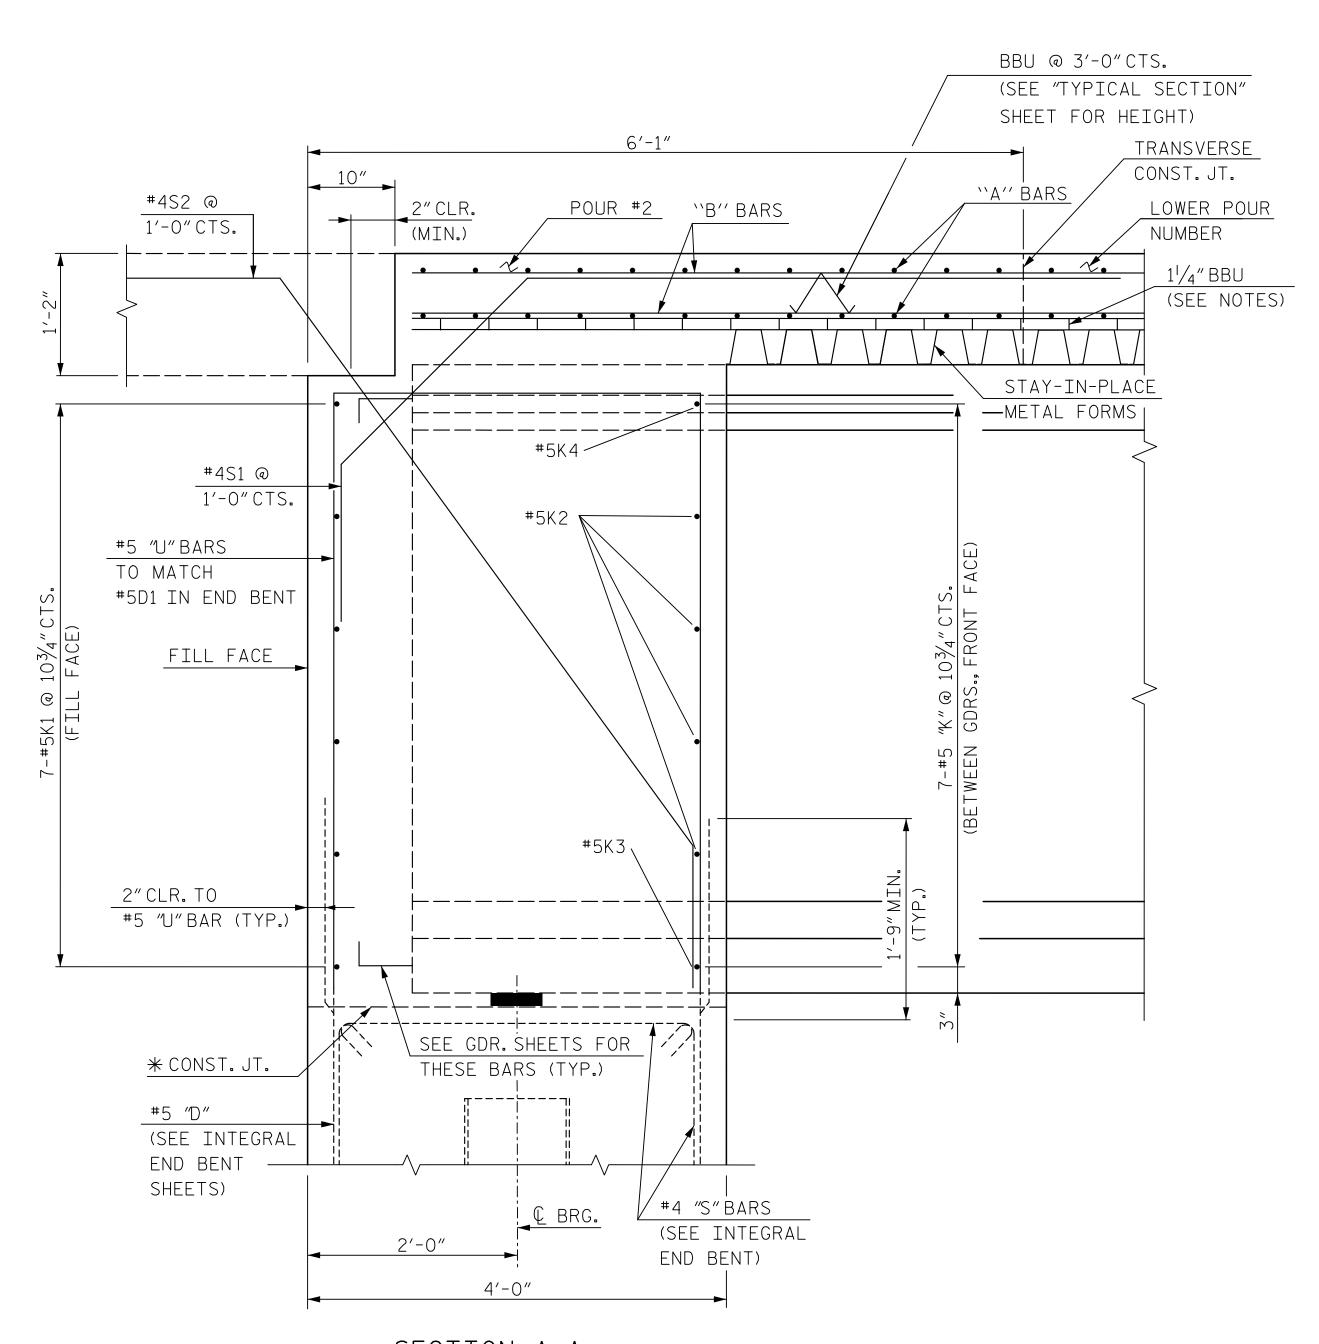

SECTION A-A
(END BENT 1 SHOWN, END BENT 2 SIMILAR)

* THE TOP SURFACE OF THE END BENT CAP EXCLUDING THE BEARING AREA SHALL BE RAKED TO A DEPTH OF 1/4".

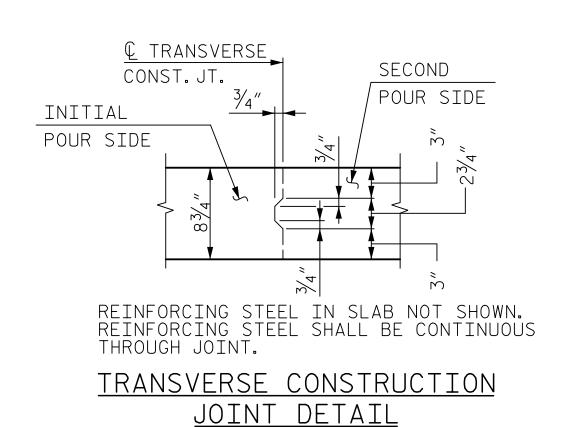

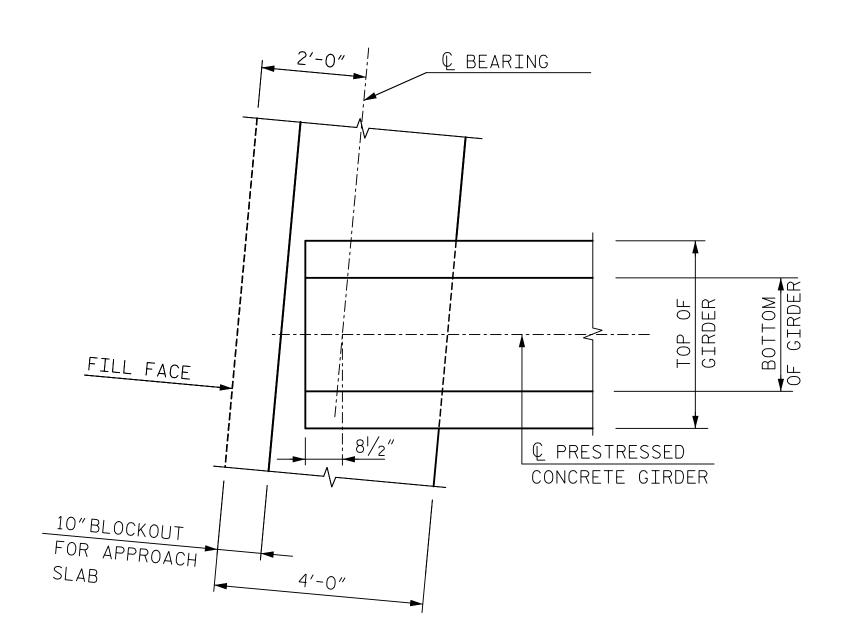

PLAN OF GIRDER AT INTEGRAL END BENT 1
(END BENT 2 SIMILAR)

SHEET 2 OF 2

Docusigned by:

SUPERSTRUCTURE

SUFERSTRUCTURE

TYPICAL SECTION
DETAILS

STATE OF NORTH CAROLINA

DEPARTMENT OF TRANSPORTATION

HNTB NORTH CAROLINA, P.C.

NC License No. C-1554
343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609

DRAWN BY

CHECKED BY

DESIGN ENGINEER OF RECORD

HNTB NORTH CAROLINA, P.C.

NC License No. C-1554
343 E. Six Forks Rd., Suite 200, Raleigh, N.C. 27609

DATE 7/18


7/18


DWG. NO. 6


|DOCUMENT NOT CONSIDERED|


FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO.
NO.	BY	DATE	NO.	BY	DATE	S4-6
1			3			TOTAL SHEETS
2			4			24

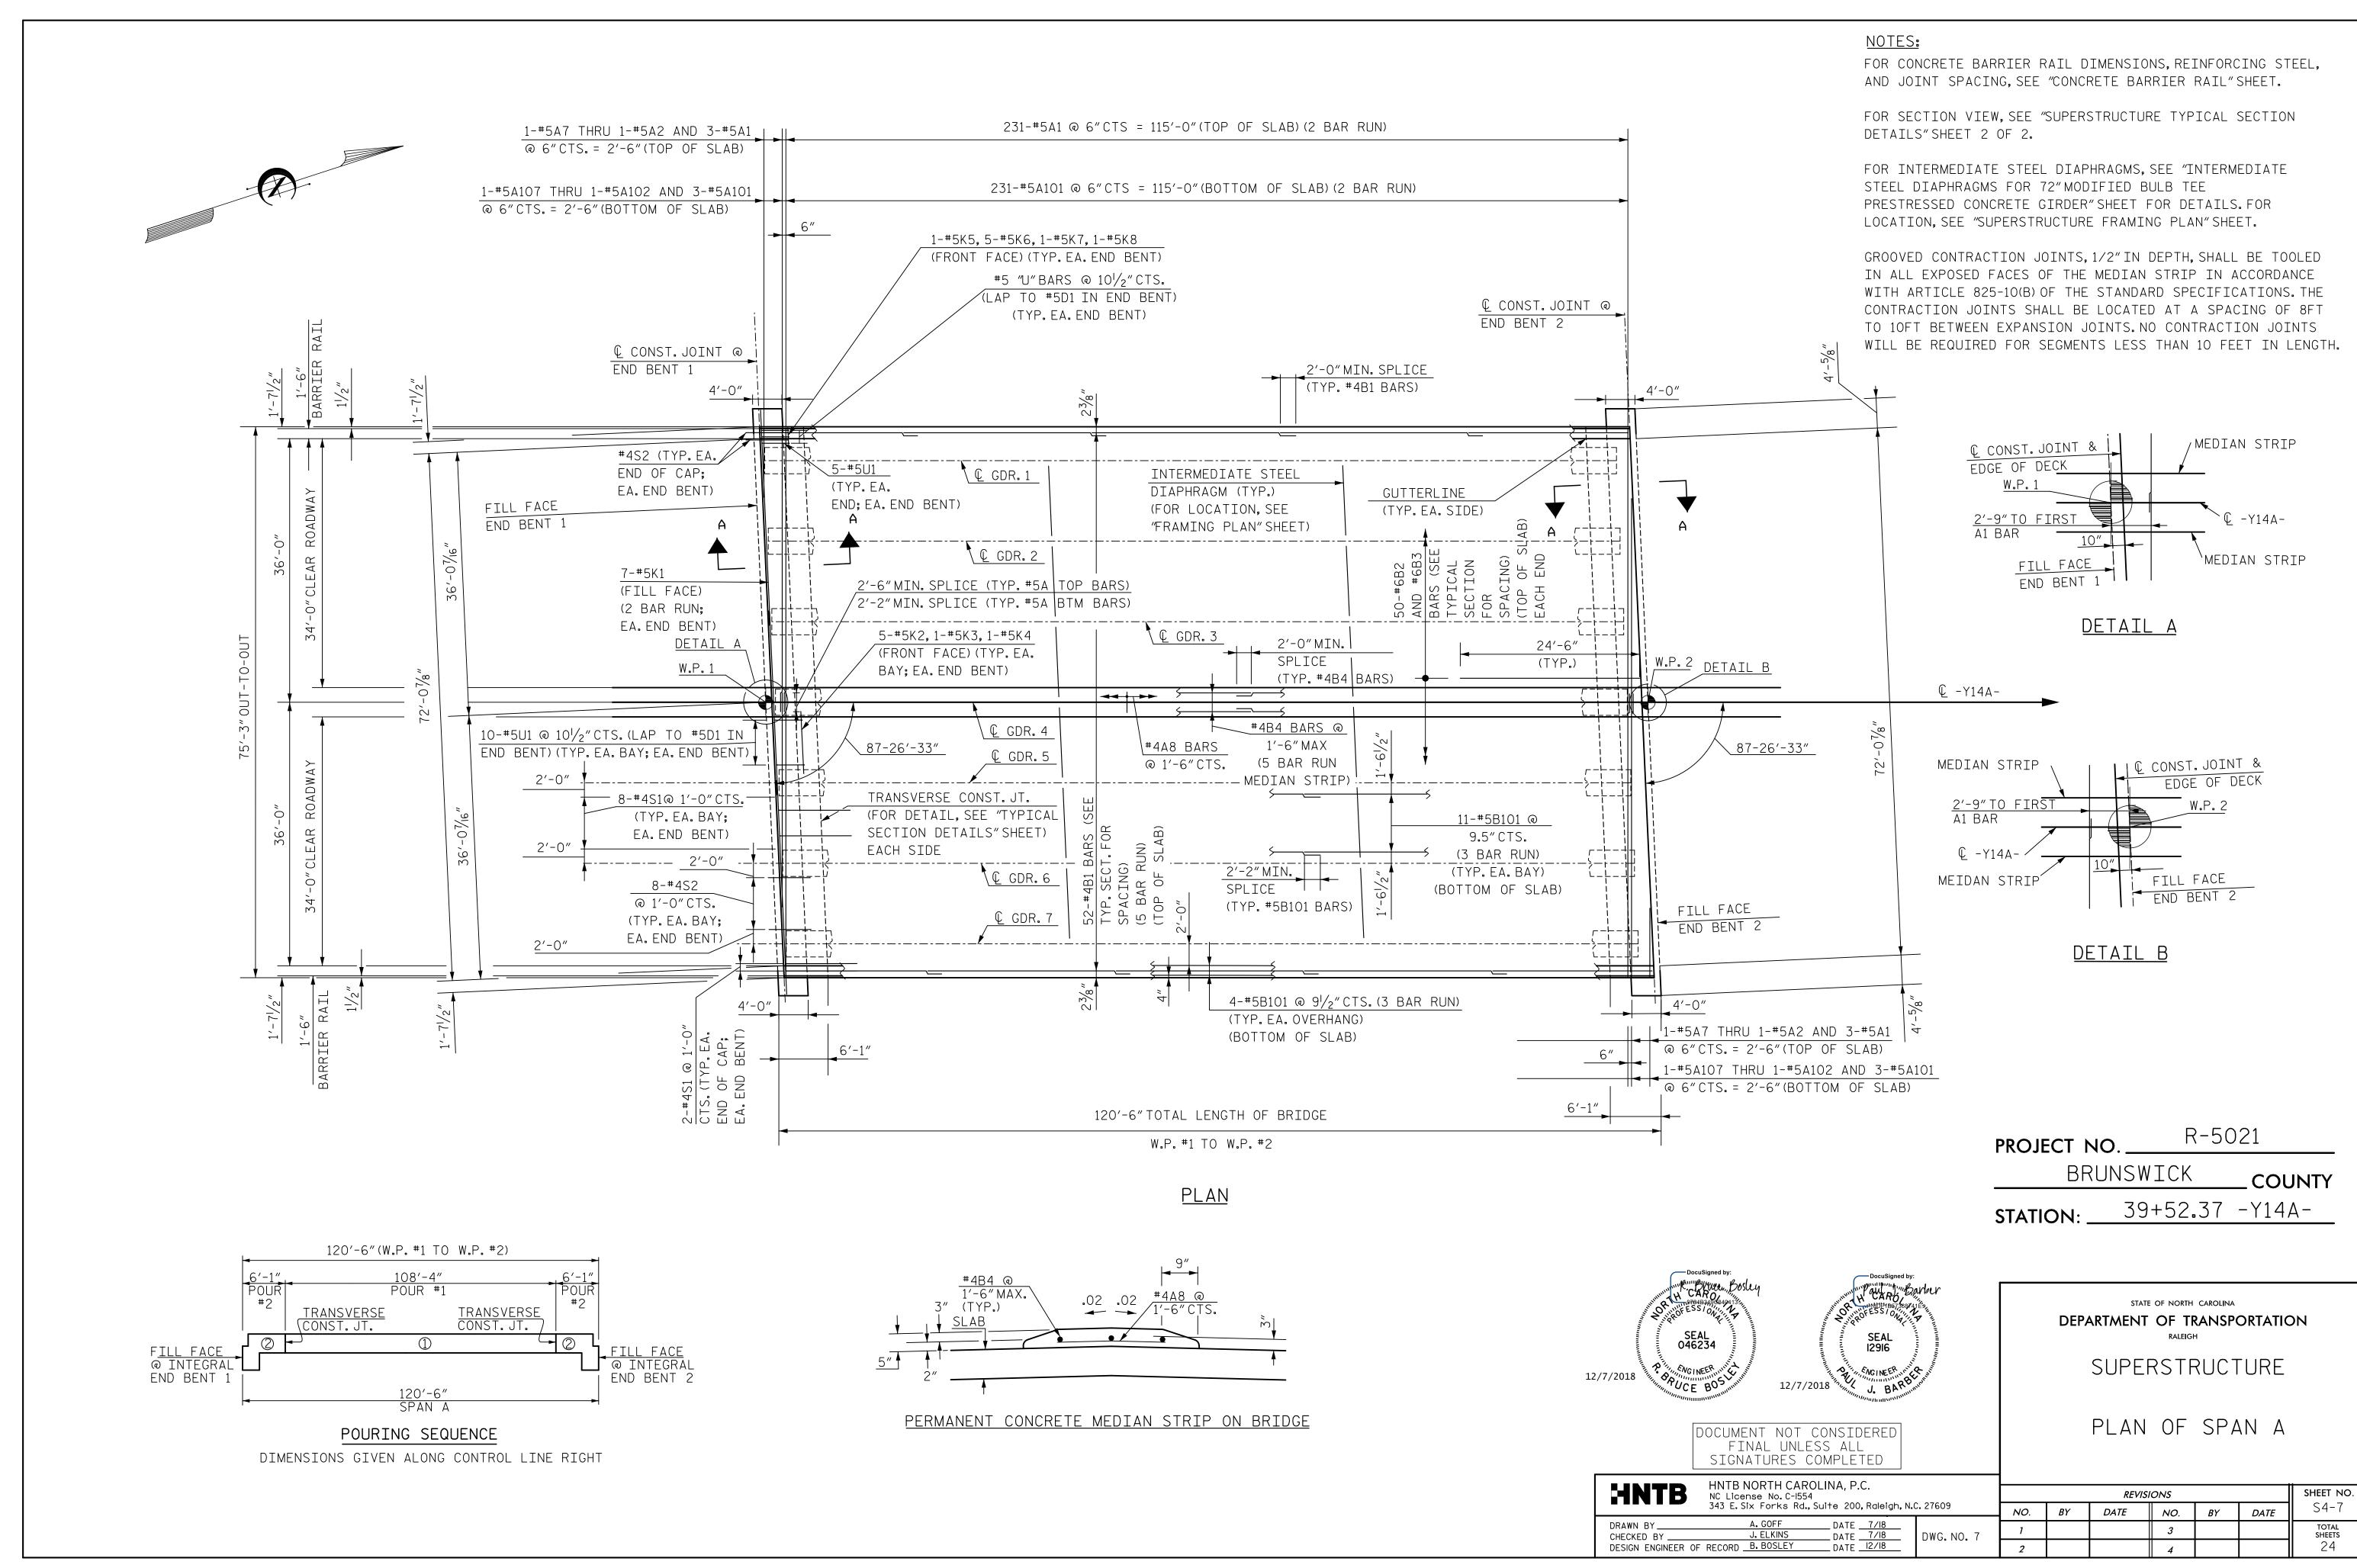

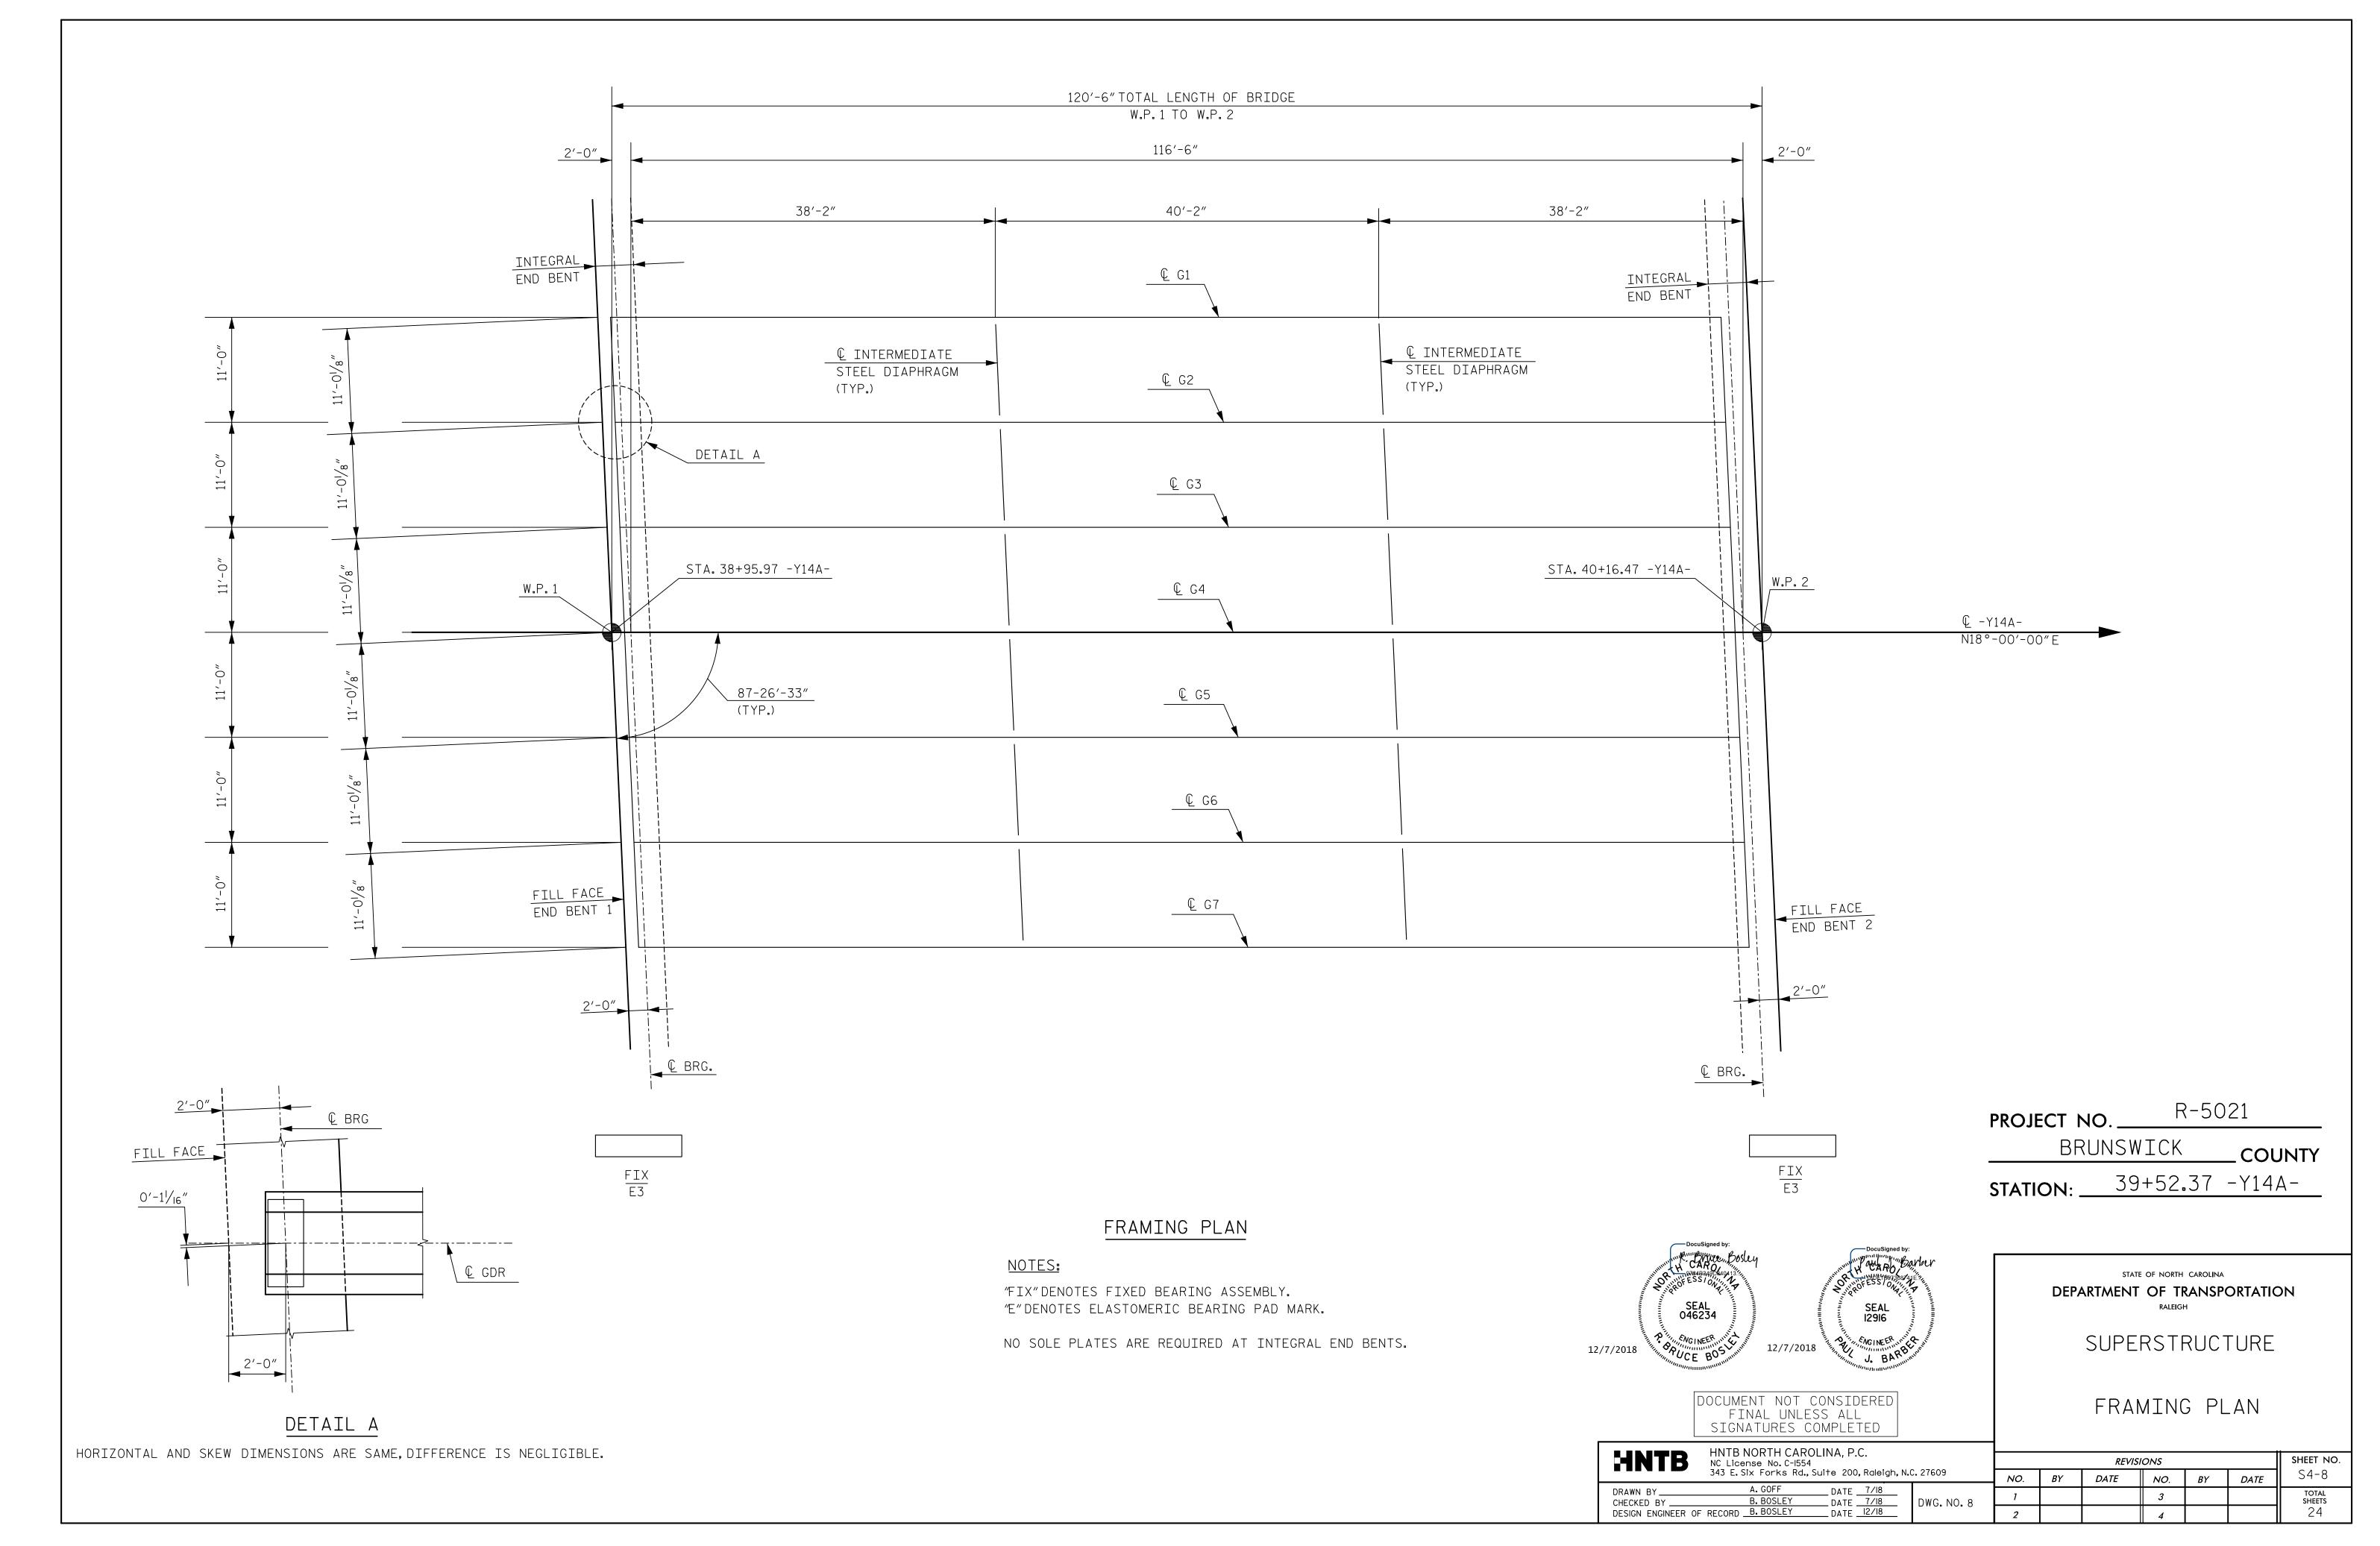

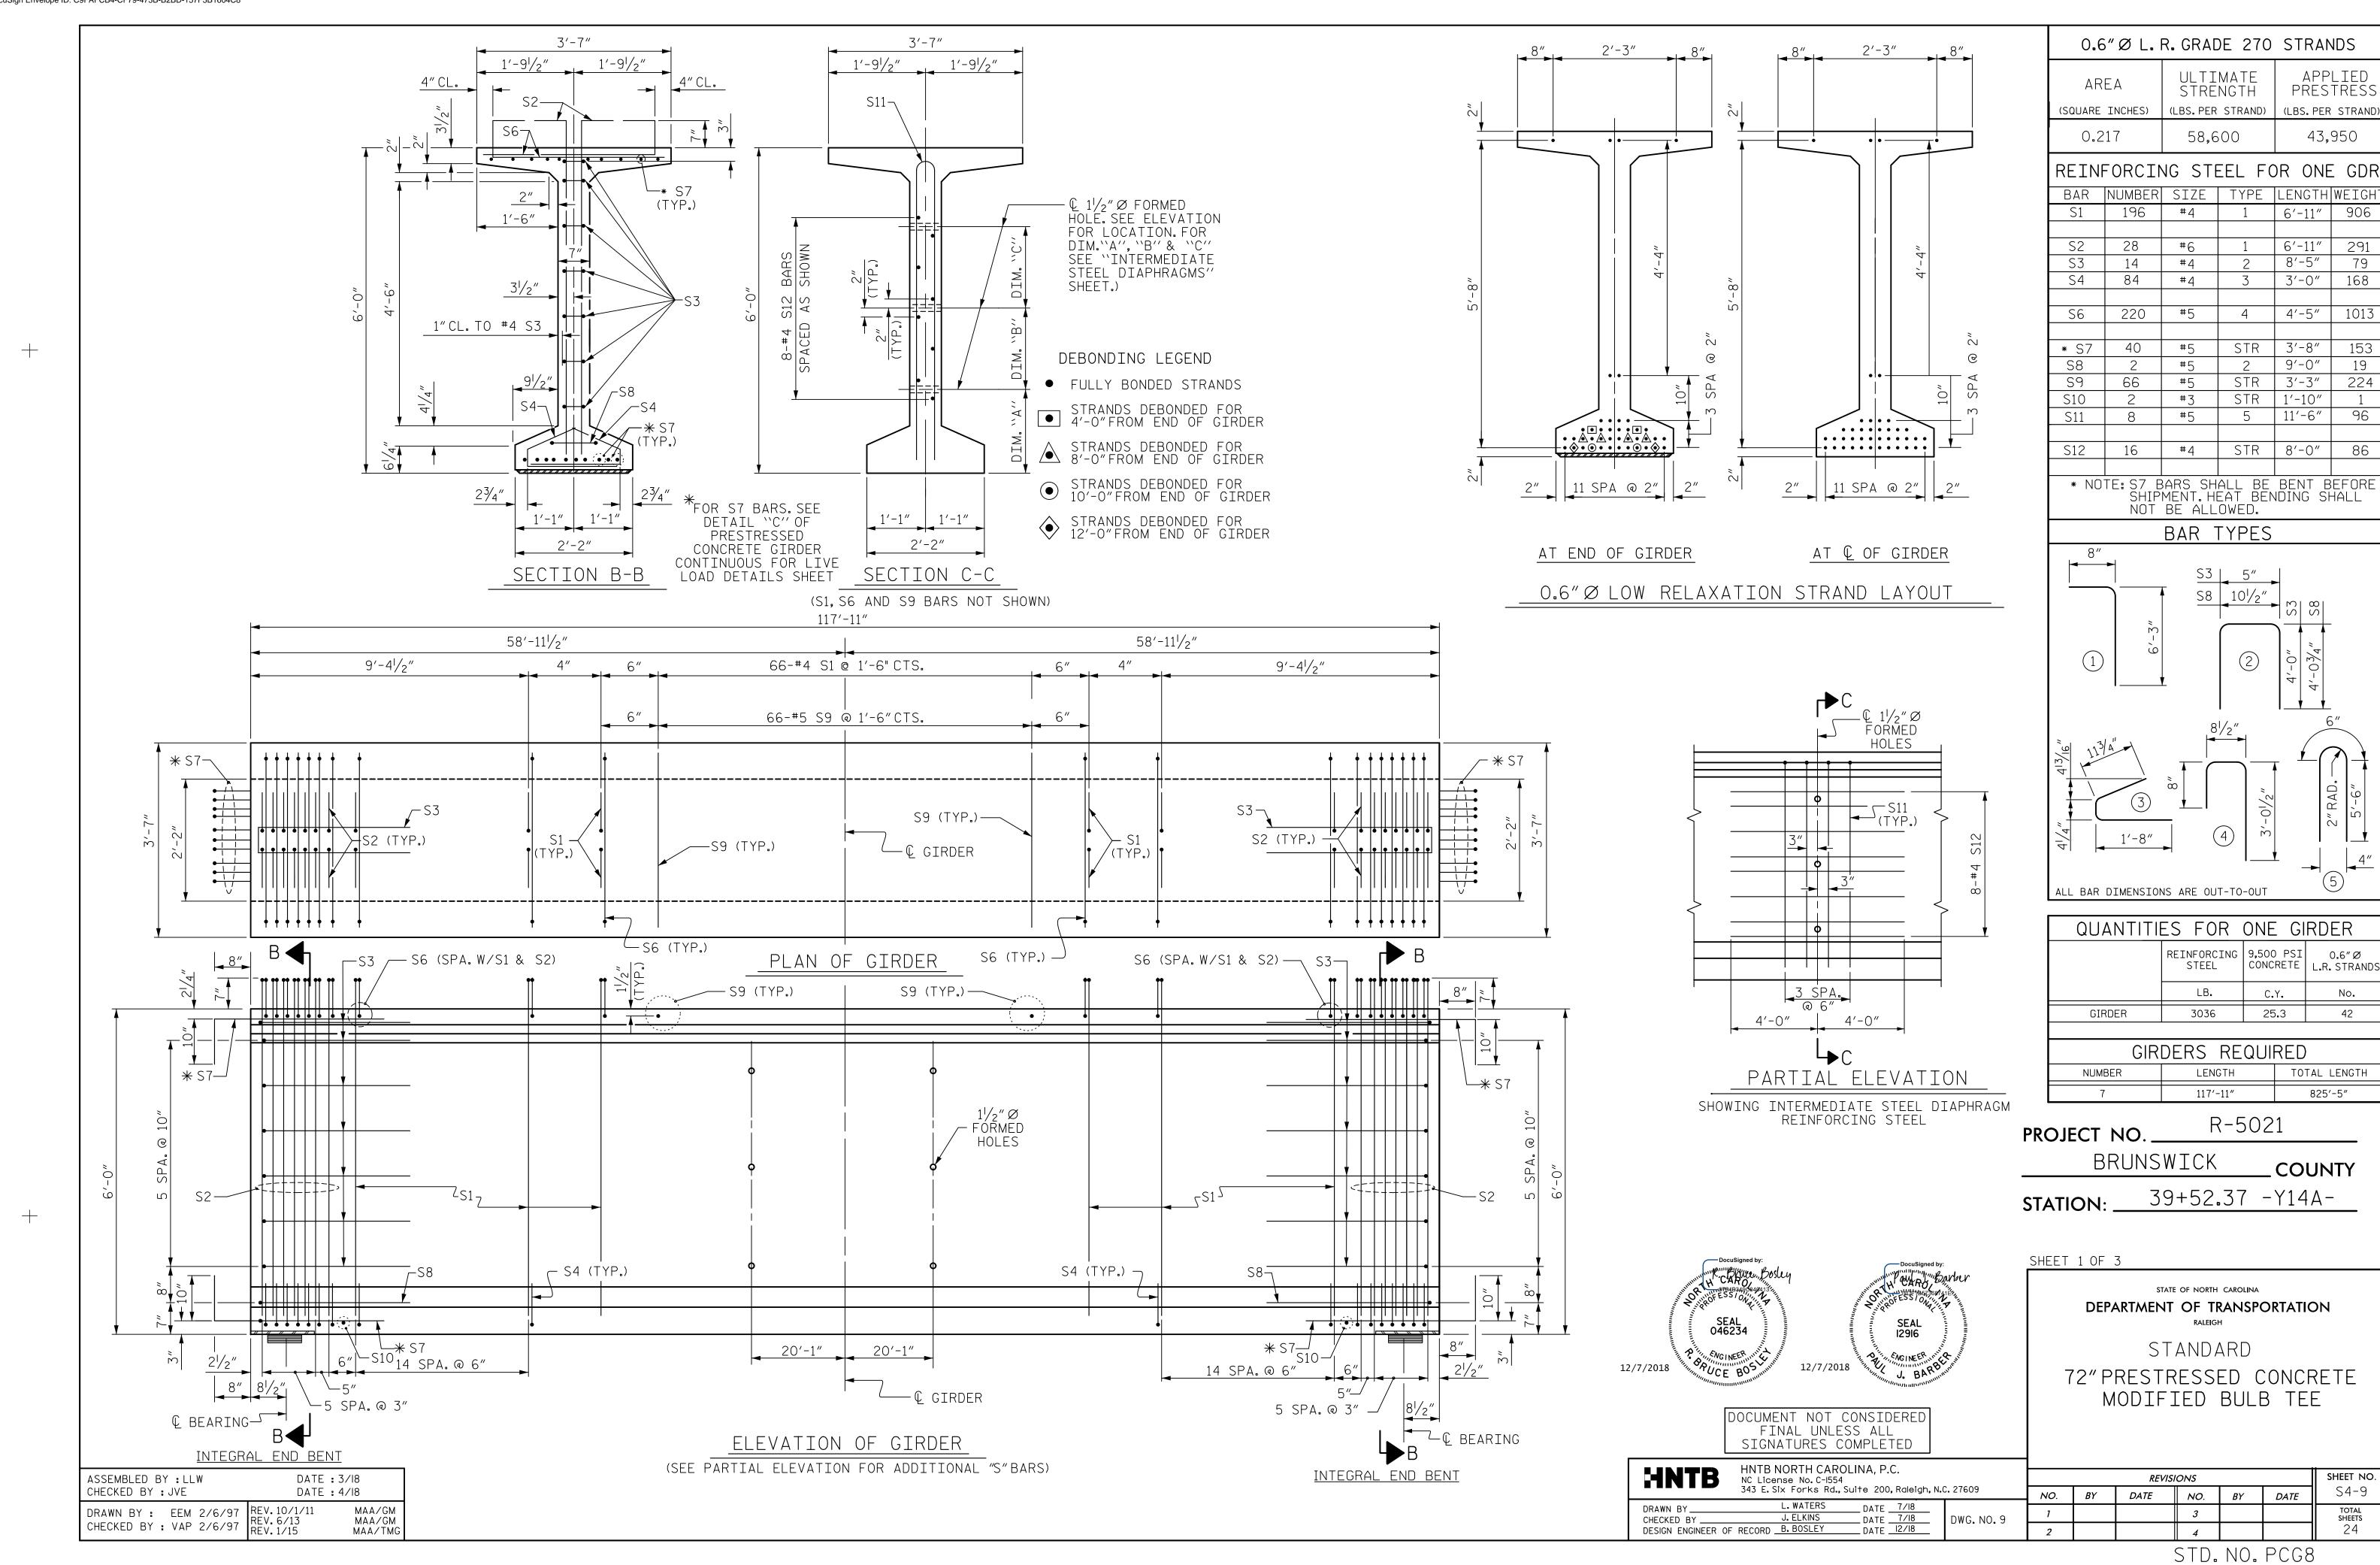

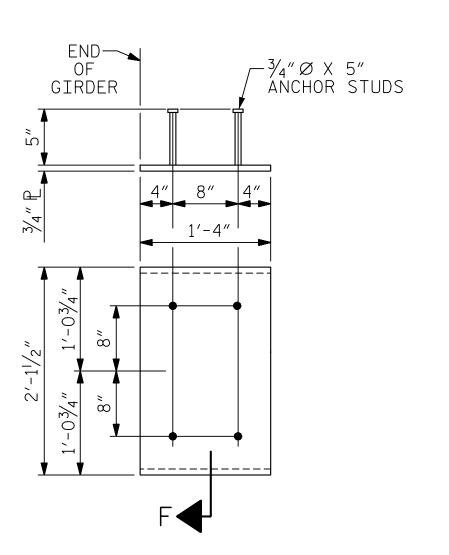

EMBEDDED PLATE "B-1" DETAILS 72" MODIFIED BULB TEES

(2 REQ'D PER GIRDER)

3 SPA. (TYP.) — © GDR.

→ ¾"BEVEL EDGE SECTION "F"

(SEE NOTES)

(FOR 72" MODIFIED BULB TEES)

└ C GIRDER — S7 (TYP.) 2¹/₈"

12/7/2018 12/7/2018

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

HNTB	HNTB NORTH CAROLINA, P.C. NC License No. C-1554 343 E. Six Forks Rd., Suite 200, Raleigh, N.C.	27609
DRAWN BY	L. WATERS DATE 7/18	
DRAWN BY	L. WAIERS DATE //18	

PRESTRESSED CONCRETE GIRDER DETAILS

REVISIONS

BY DATE

NO.

STANDARD

STATE OF NORTH CAROLINA DEPARTMENT OF TRANSPORTATION

DATE : 4/18 DATE : 4/18 ASSEMBLED BY : LLW CHECKED BY : JVE MAA/GM MAA/TMG MAA/TMG DRAWN BY: ELR 11/91 CHECKED BY: GRP 11/91

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW-RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE

IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS. ALL REINFORCING STEEL SHALL BE GRADE 60.

EMBEDDED PLATE "B-1" SHALL BE GALVANIZED IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ANCHOR STUDS SHALL CONFORM TO AASHTO M169 GRADES 1010 THROUGH 1020 OR APPROVED EQUAL, AND SHALL MEET THE TYPE "B" REQUIREMENTS OF SUBSECTION 7.3 OF THE ANSI/AASHTO/AWS D1.5 BRIDGE WELDING CODE.

NOTES

AT ENDS OF GIRDERS TO BE EMBEDDED IN CONCRETE DIAPHRAGMS OR END WALLS, PRESTRESSING STRANDS MAY EXTEND A MAXIMUM OF 2"BEYOND THE GIRDER ENDS. OTHERWISE, PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE GIRDER ENDS.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE GIRDER SHALL BE DONE WHEN CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 7,100 PSI.

DEPENDING ON THE TYPE OF SYSTEM USED TO SUPPORT THE DECK SLAB FORMS, PRESET ANCHORS MAY BE NECESSARY IN THE PRESTRESSED CONCRETE GIRDER.

THE TOP SURFACE OF THE GIRDER, EXCLUDING THE OUTSIDE 4", SHALL BE RAKED TO A DEPTH OF 1/4".

A 2"imes 2"CHAMFER IS ALLOWED AT THE INTERSECTION OF THE WEB AND THE BOTTOM FLANGE OF THE 72" MODIFIED BULB TEES ONLY.

DETAIL "C" (FOR 72"MODIFIED BULB TEES)

CHECKED BY J. ELKINS DATE 7/18
DESIGN ENGINEER OF RECORD B. BOSLEY DATE 12/18

STD. NO. PCG9

NO. BY DATE

R-5021

COUNTY

SHEET NO.

S4-10

PROJECT NO. _

SHEET 2 OF 3

BRUNSWICK

STATION: 39+52.37 -Y14A-