


SEE R.S.D. 840.02
FOR DIMENSIONS
FOR THIS PORTION
OF CATCH BASIN

NOTES:
 MORTAR JOINTS 1/2" TO 1/4" THICK.
 USE CLASS "B" CONCRETE THROUGHOUT.
 USE TYPE "E", "F" AND "G" GRATES UNLESS OTHERWISE INDICATED.
 USE BRICK OR CONCRETE BLOCK WHICH COMPLIES WITH THE REQUIREMENTS OF SECTION 840 OF THE STANDARD SPECIFICATIONS.
 CHAMFER ALL EXPOSED CORNERS 1".
 DRAWING NOT TO SCALE.
 PROVIDE ALL CATCH BASINS OVER 3'-6" IN DEPTH WITH STEPS 12" ON CENTER. USE STEPS WHICH COMPLY WITH STD. DRAWING 840.66

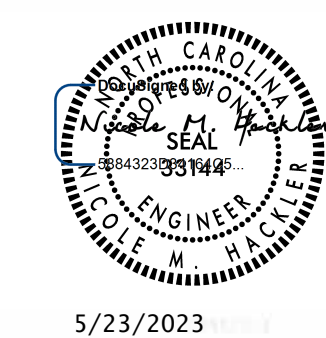

**DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED**

**CONTRACT STANDARDS
AND DEVELOPMENT UNIT**
Office 919-707-6950 FAX 919-250-4119

**PROPOSED
OFFSET CATCH BASIN**

ORIGINAL BY:	DATE:
MODIFIED BY: K. KEMPF	DATE: 11/13/15
CHECKED BY:	DATE:
FILE SPEC.: nbritt/english/hydro/840d06 offset_boxes.dgn	

I:\JUN-2019\3442
 S:\Contracts\Contractors\Special Details\nbritt\english\hydro\840d06_offset_boxes.dgn
 J:\power\ton AT CSU-212595