DocuSign Envelope ID: 9E77D082-1CEB-4431-A3F5-8FE5E0642C54

5/14/99

PROJECT REFERENCE NO.	SHEET NO.
U-5824	2C-7

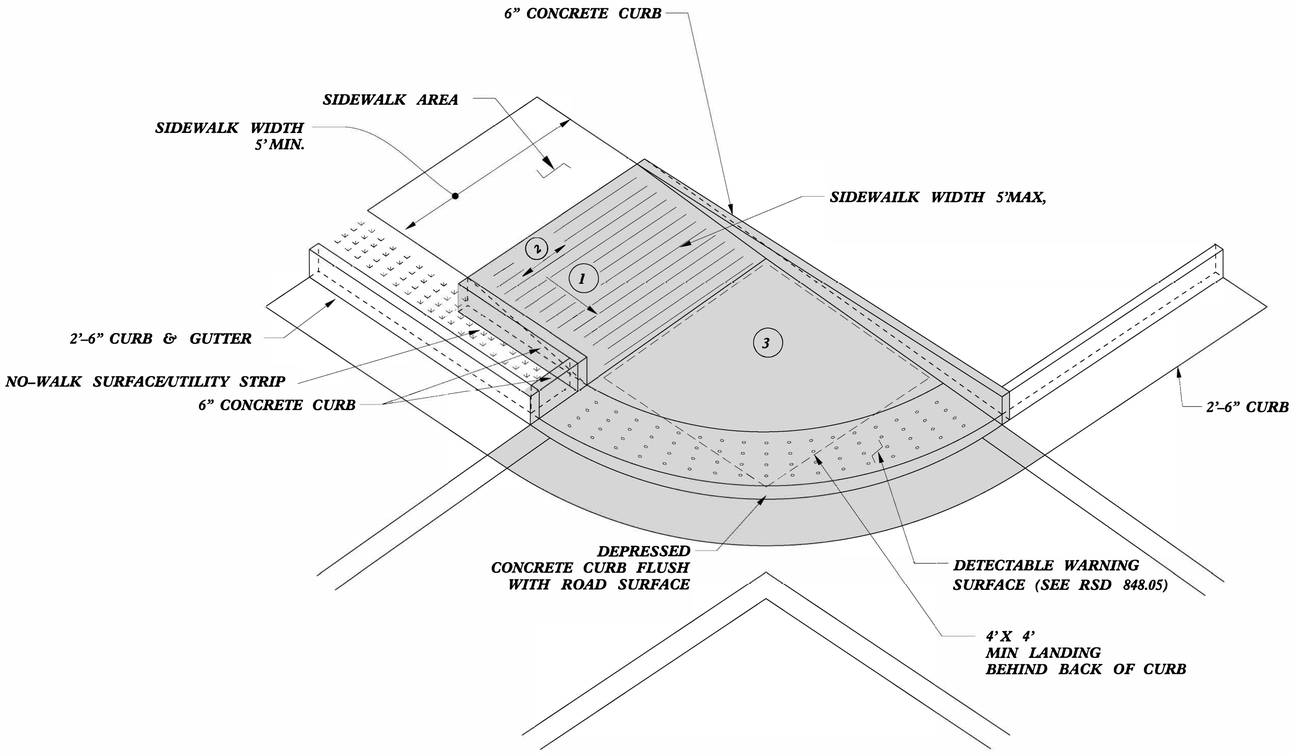

TYPE 2A MOD

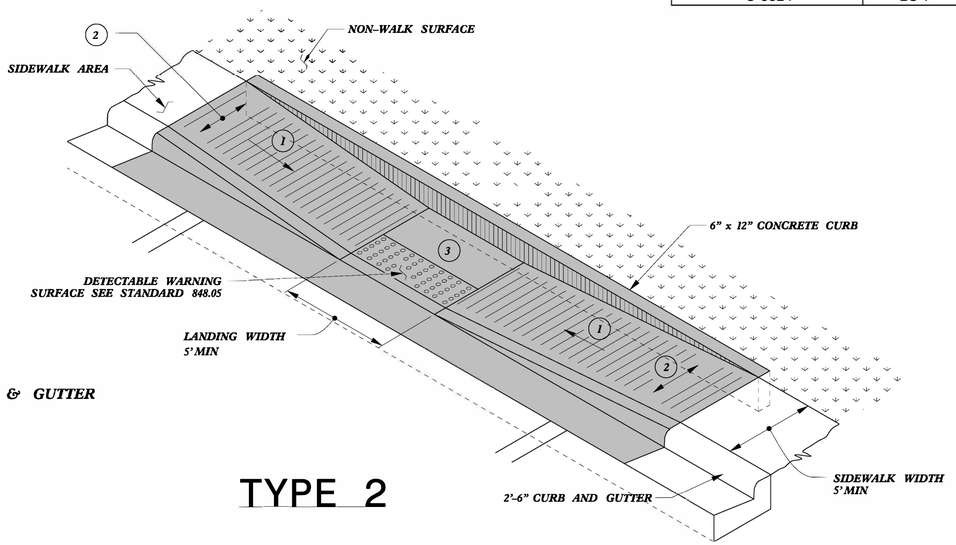

TYPE 2

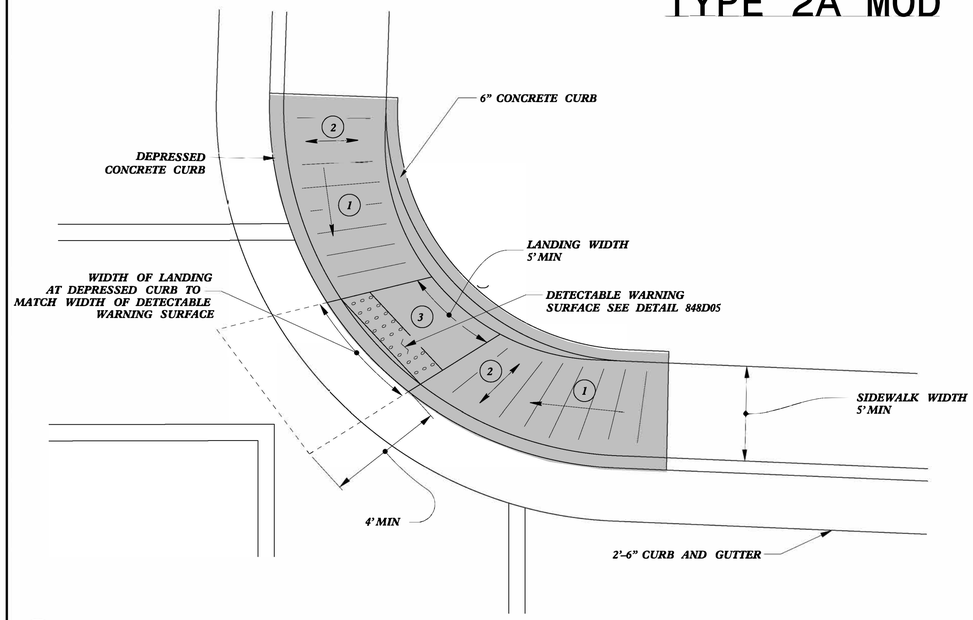

TYPE 2B

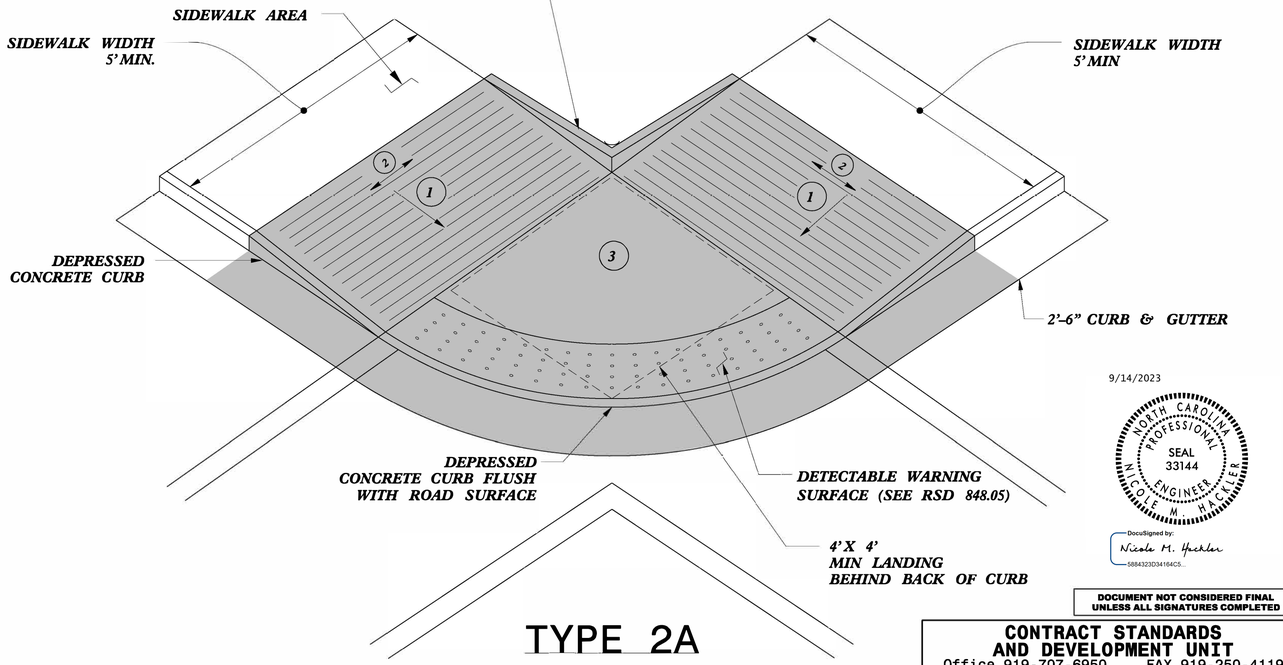

TYPE 2A

1. 8.33% (12:1) MAX RAMP SLOPE
2. CROSS SLOPE: 2.00%
3. CURB RAMPS REQUIRE A (4'-0") MINIMUM LANDING WITH A MAXIMUM CROSS SLOPE AND LONGITUDINAL SLOPE OF 2.00% WHERE PEDESTRIANS PERFORM TURNING MANEUVERS. SLOPE TO DRAIN TO CURB.

PAY LIMITS FOR 1 CURB RAMP

9/14/2023

NORTH CAROLINA PROFESSIONAL SEAL 33144 ENGINEER NICOLE M HACKLER

DocuSigned by: Nicole M. Hackler 5884323D34164C5...

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

CONTRACT STANDARDS AND DEVELOPMENT UNIT
Office 919-707-6950 FAX 919-250-4119

CURB RAMPS

ORIGINAL BY: J.S. HOWERTON DATE: 7/7/11
MODIFIED BY: _____ DATE: _____
CHECKED BY: _____ DATE: _____
FILE SPEC. stds/2012CurbRamp/CurbRampDetails.dgn

USTIMES
USSONNEMES
USERNAMES