DocuSign Envelope ID: FC8E86D7-D86A-4F53-BAFD-EC04BB140CC0

Prepared in the Office of:

AECOM

AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
1600 Perimeter Park Drive, Morrisville, NC 27560
919-461-1100 919-461-1415 (fax)
F - 0342

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

PROJECT REFERENCE NO.	SHEET NO.
U-5824	UC-10

DESIGNED BY: FR
DRAWN BY: FR/RR
CHECKED BY: SS
APPROVED BY: JT
REVISED:

NORTH CAROLINA DEPARTMENT OF TRANSPORTATION
UTILITIES ENGINEERING SEC.
PHONE:(919)707-6690
FAX:(919)250-4151

NORTH CAROLINA PROFESSIONAL SEAL 036963 ENGINEER JOSEPH C. TUCKER
DocuSigned by: Joseph Tucker
10/4/2023 | 12:06 PM EDT
UTILITY CONSTRUCTION PLANS ONLY

UTILITY CONSTRUCTION

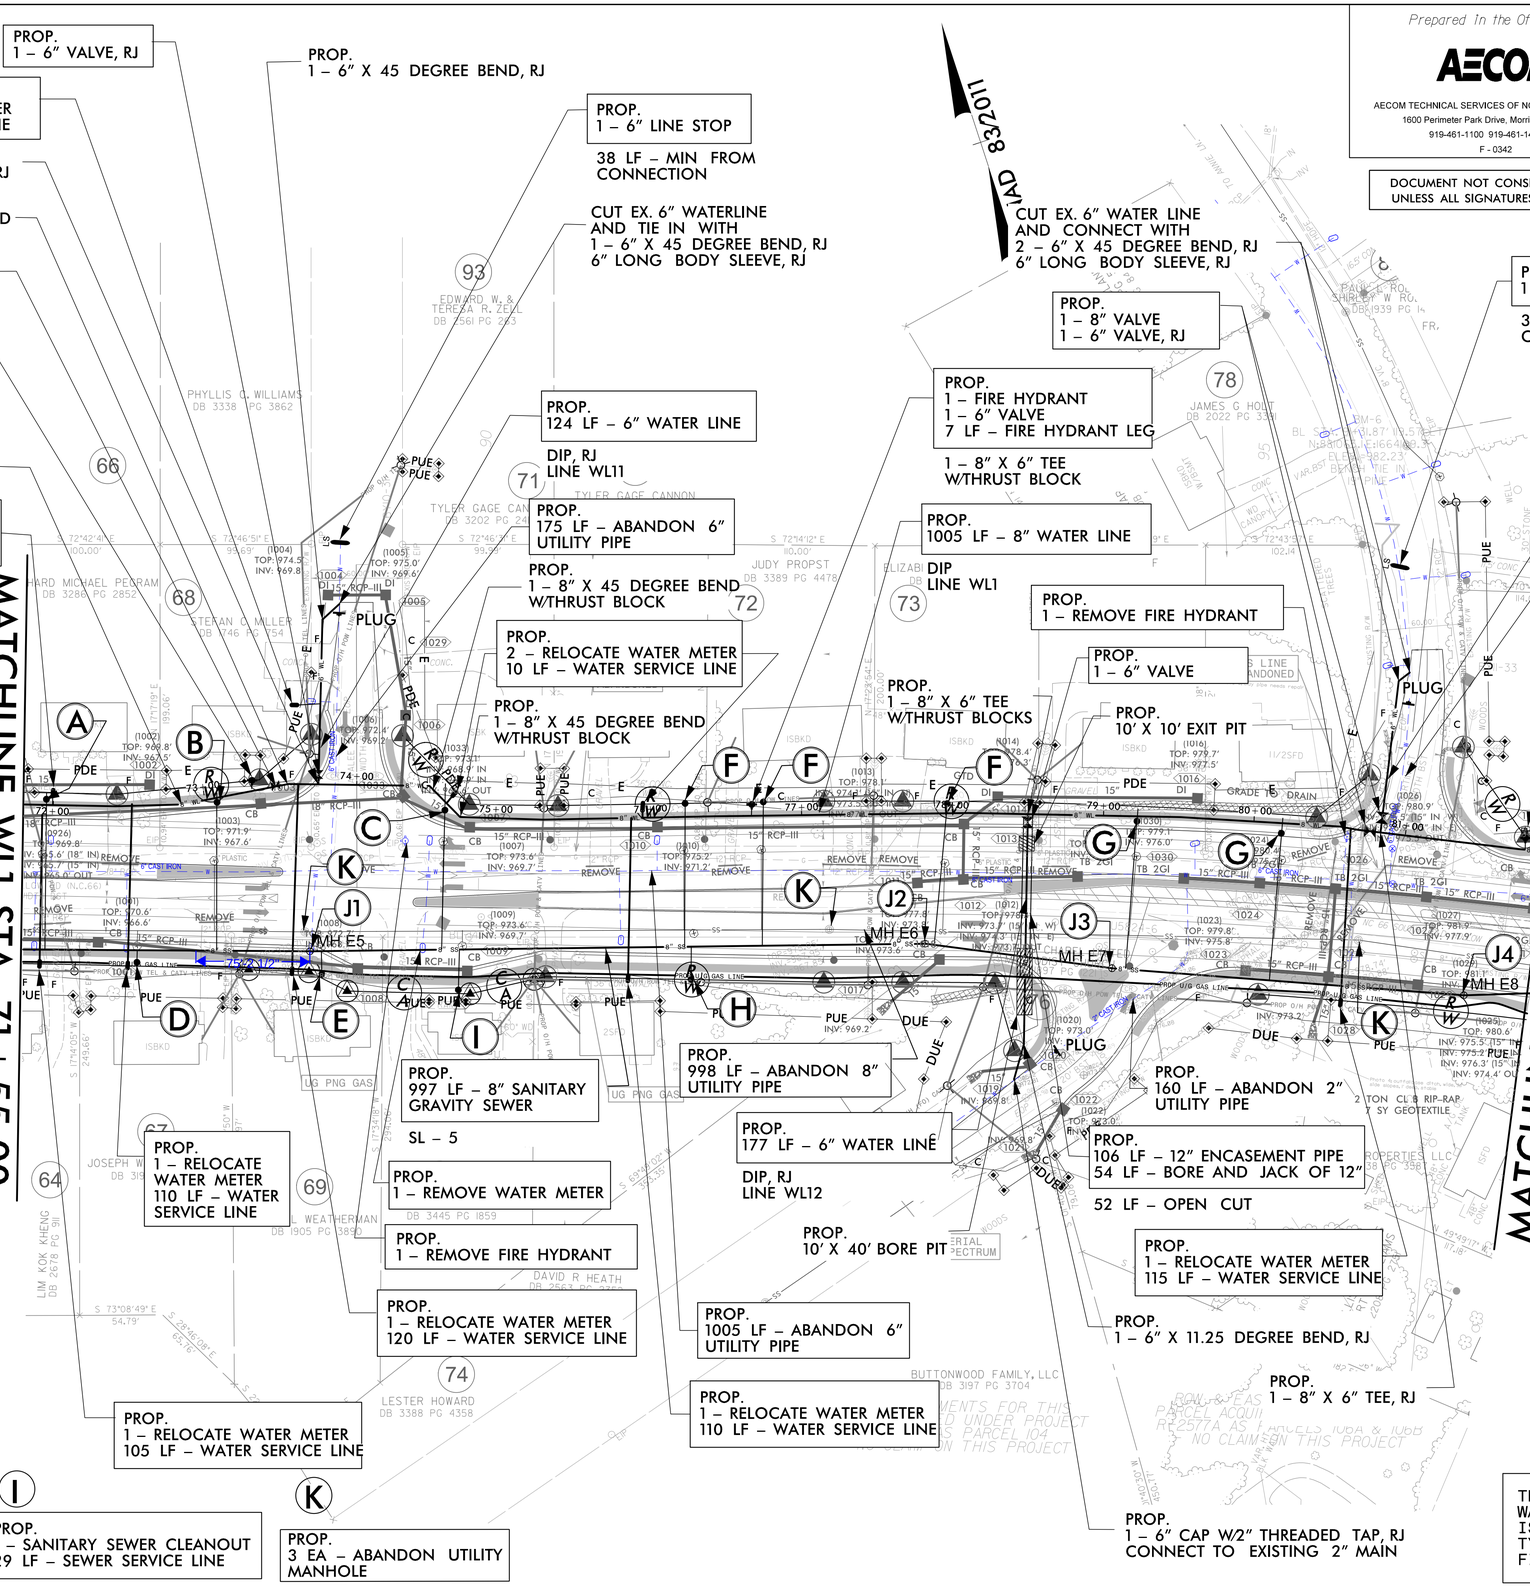

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 2241 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

DGN: L:\Secure_DCS\Proj\etr\60580105_NCDOTWSUTL\900_CAD_GIS\90_CAD\70_NCDOT_T1\Utilities\Engineering\UC\Proj\U5824_uc_ash_10_AGREEMENT_new.dgn