

DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED

Prepared in the Office of:







AECOM TECHNICAL SERVICES OF NORTH CAROLINA, INC.
701 CORPORATE CENTER DRIVE, SUITE 475, RALEIGH, NC 27607
919-854-6200 919-854-6259 (fax)
F - 0342

PROJECT REFERENCE NO. U-5824	SHEET NO. UC-17
DESIGNED BY: FR	
DRAWN BY: FR/RR	
CHECKED BY: SS	
APPROVED BY: JT	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION	
UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
10/4/2023 12:06 PM EDT	

UTILITY CONSTRUCTION

THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 300 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

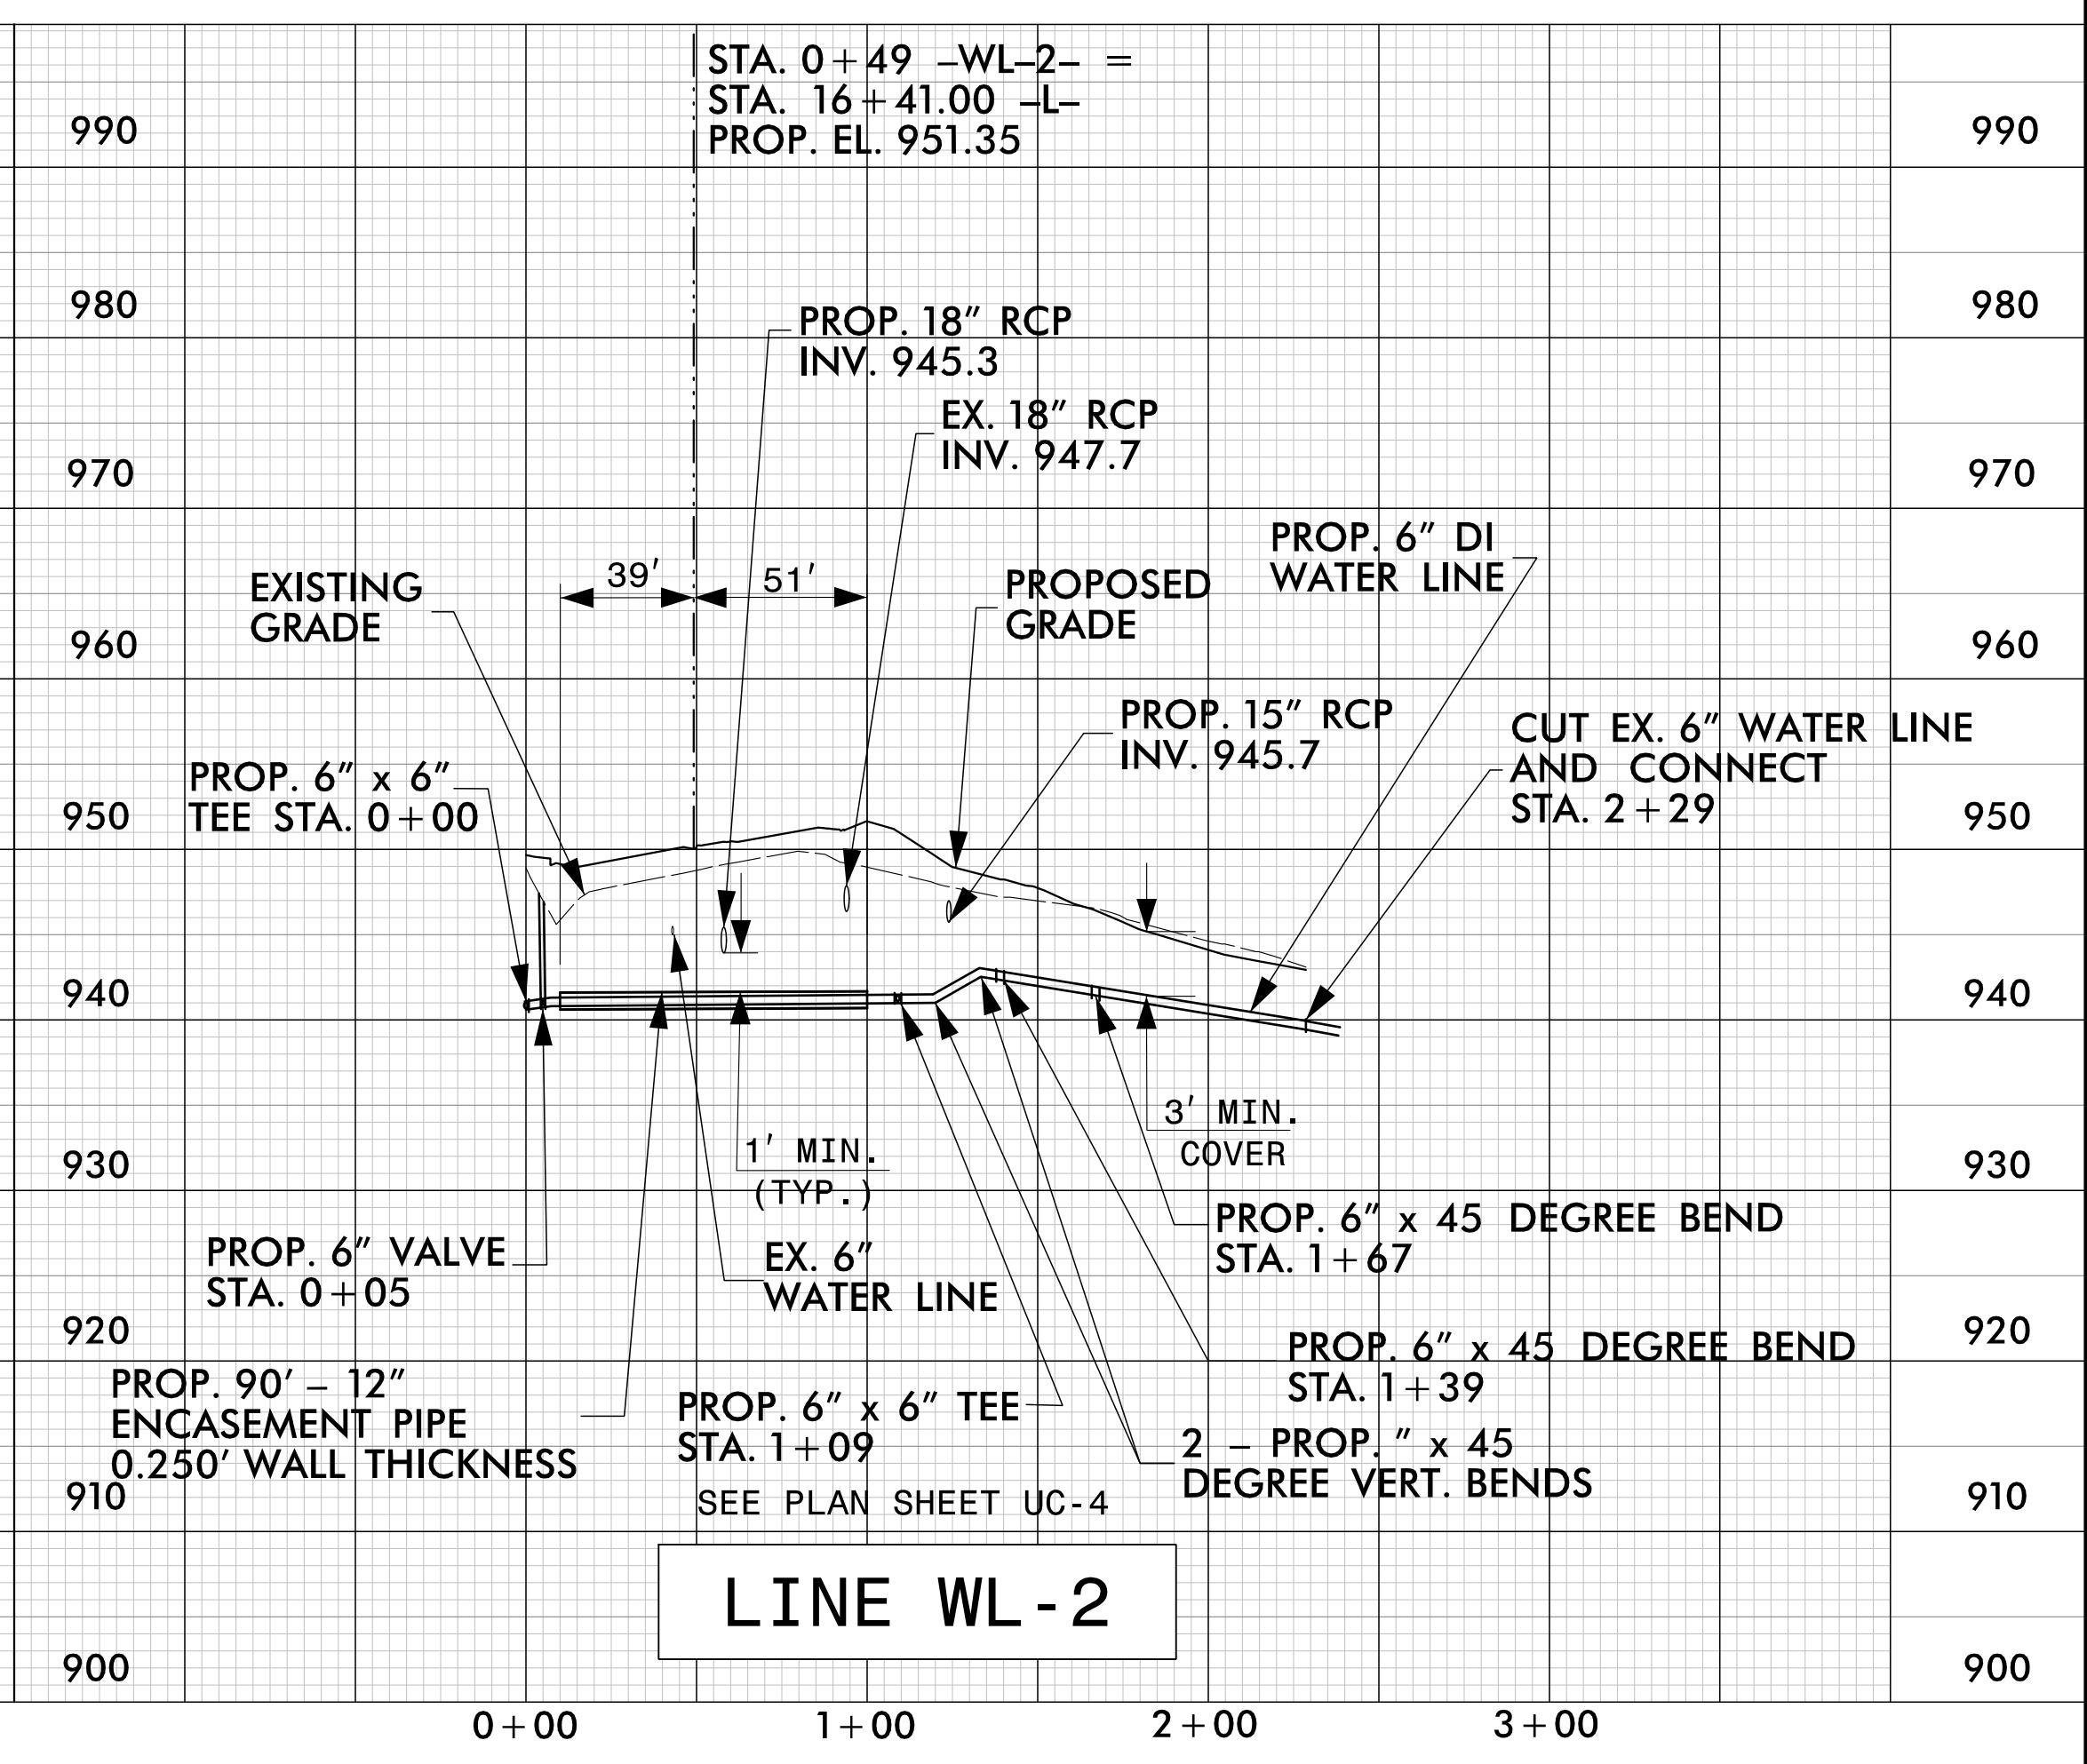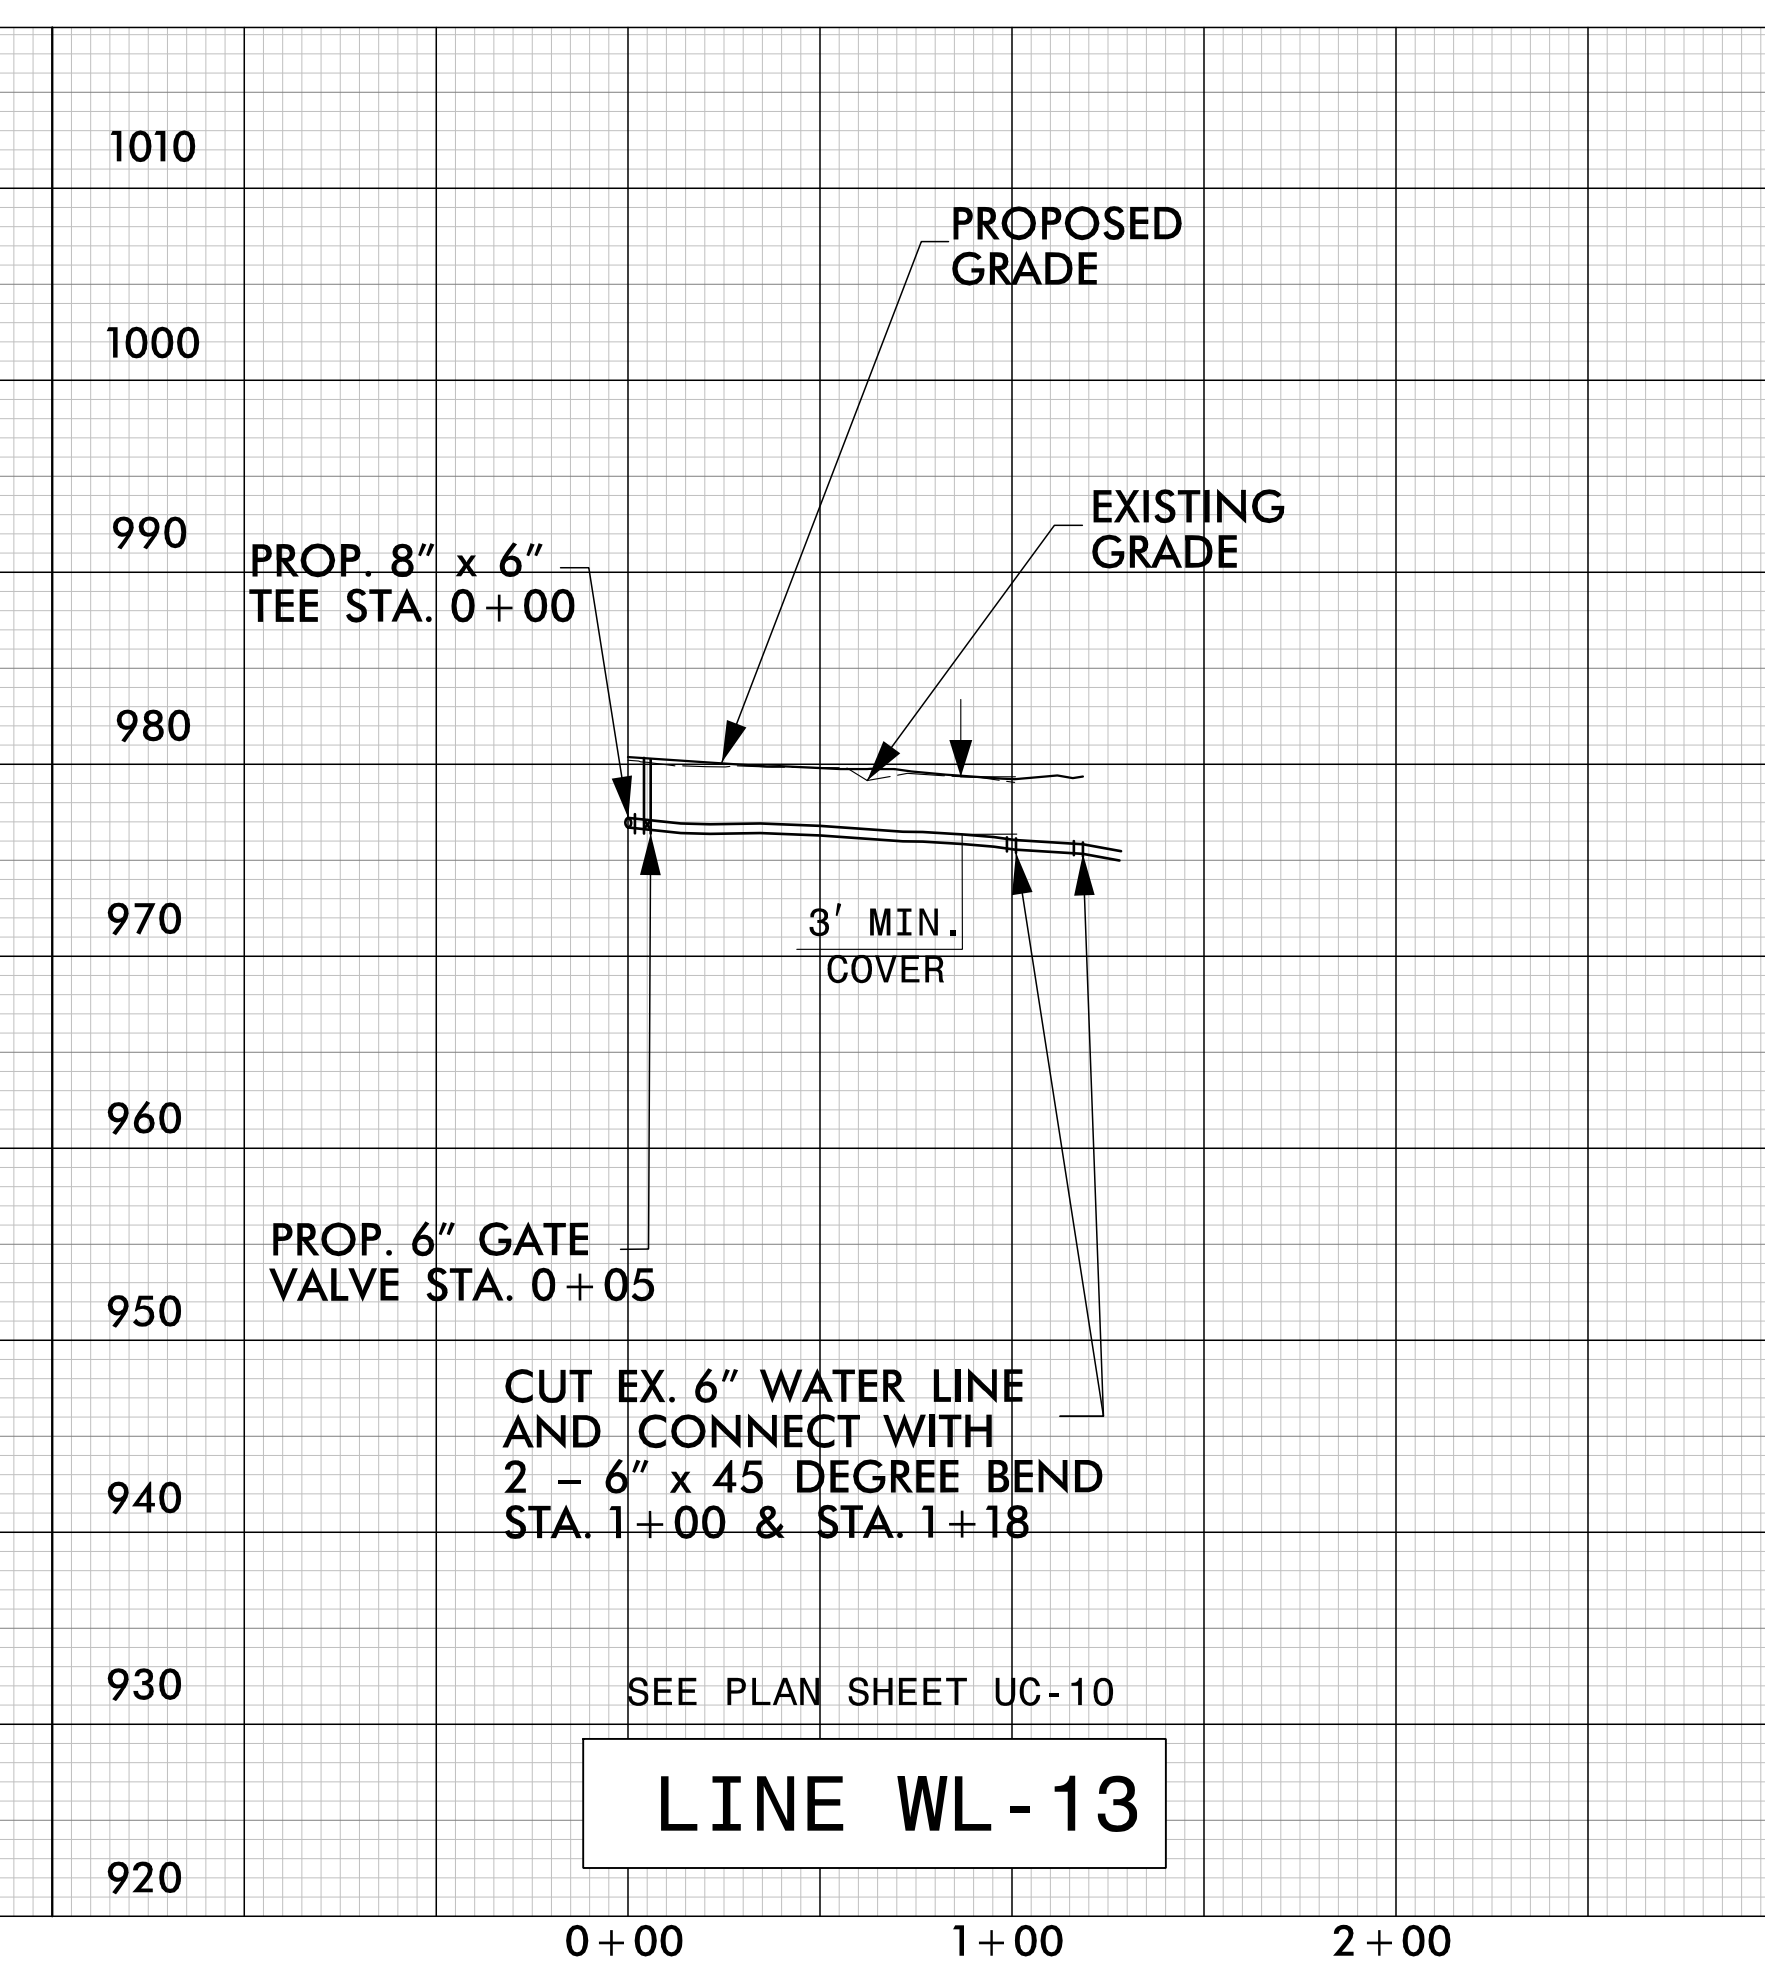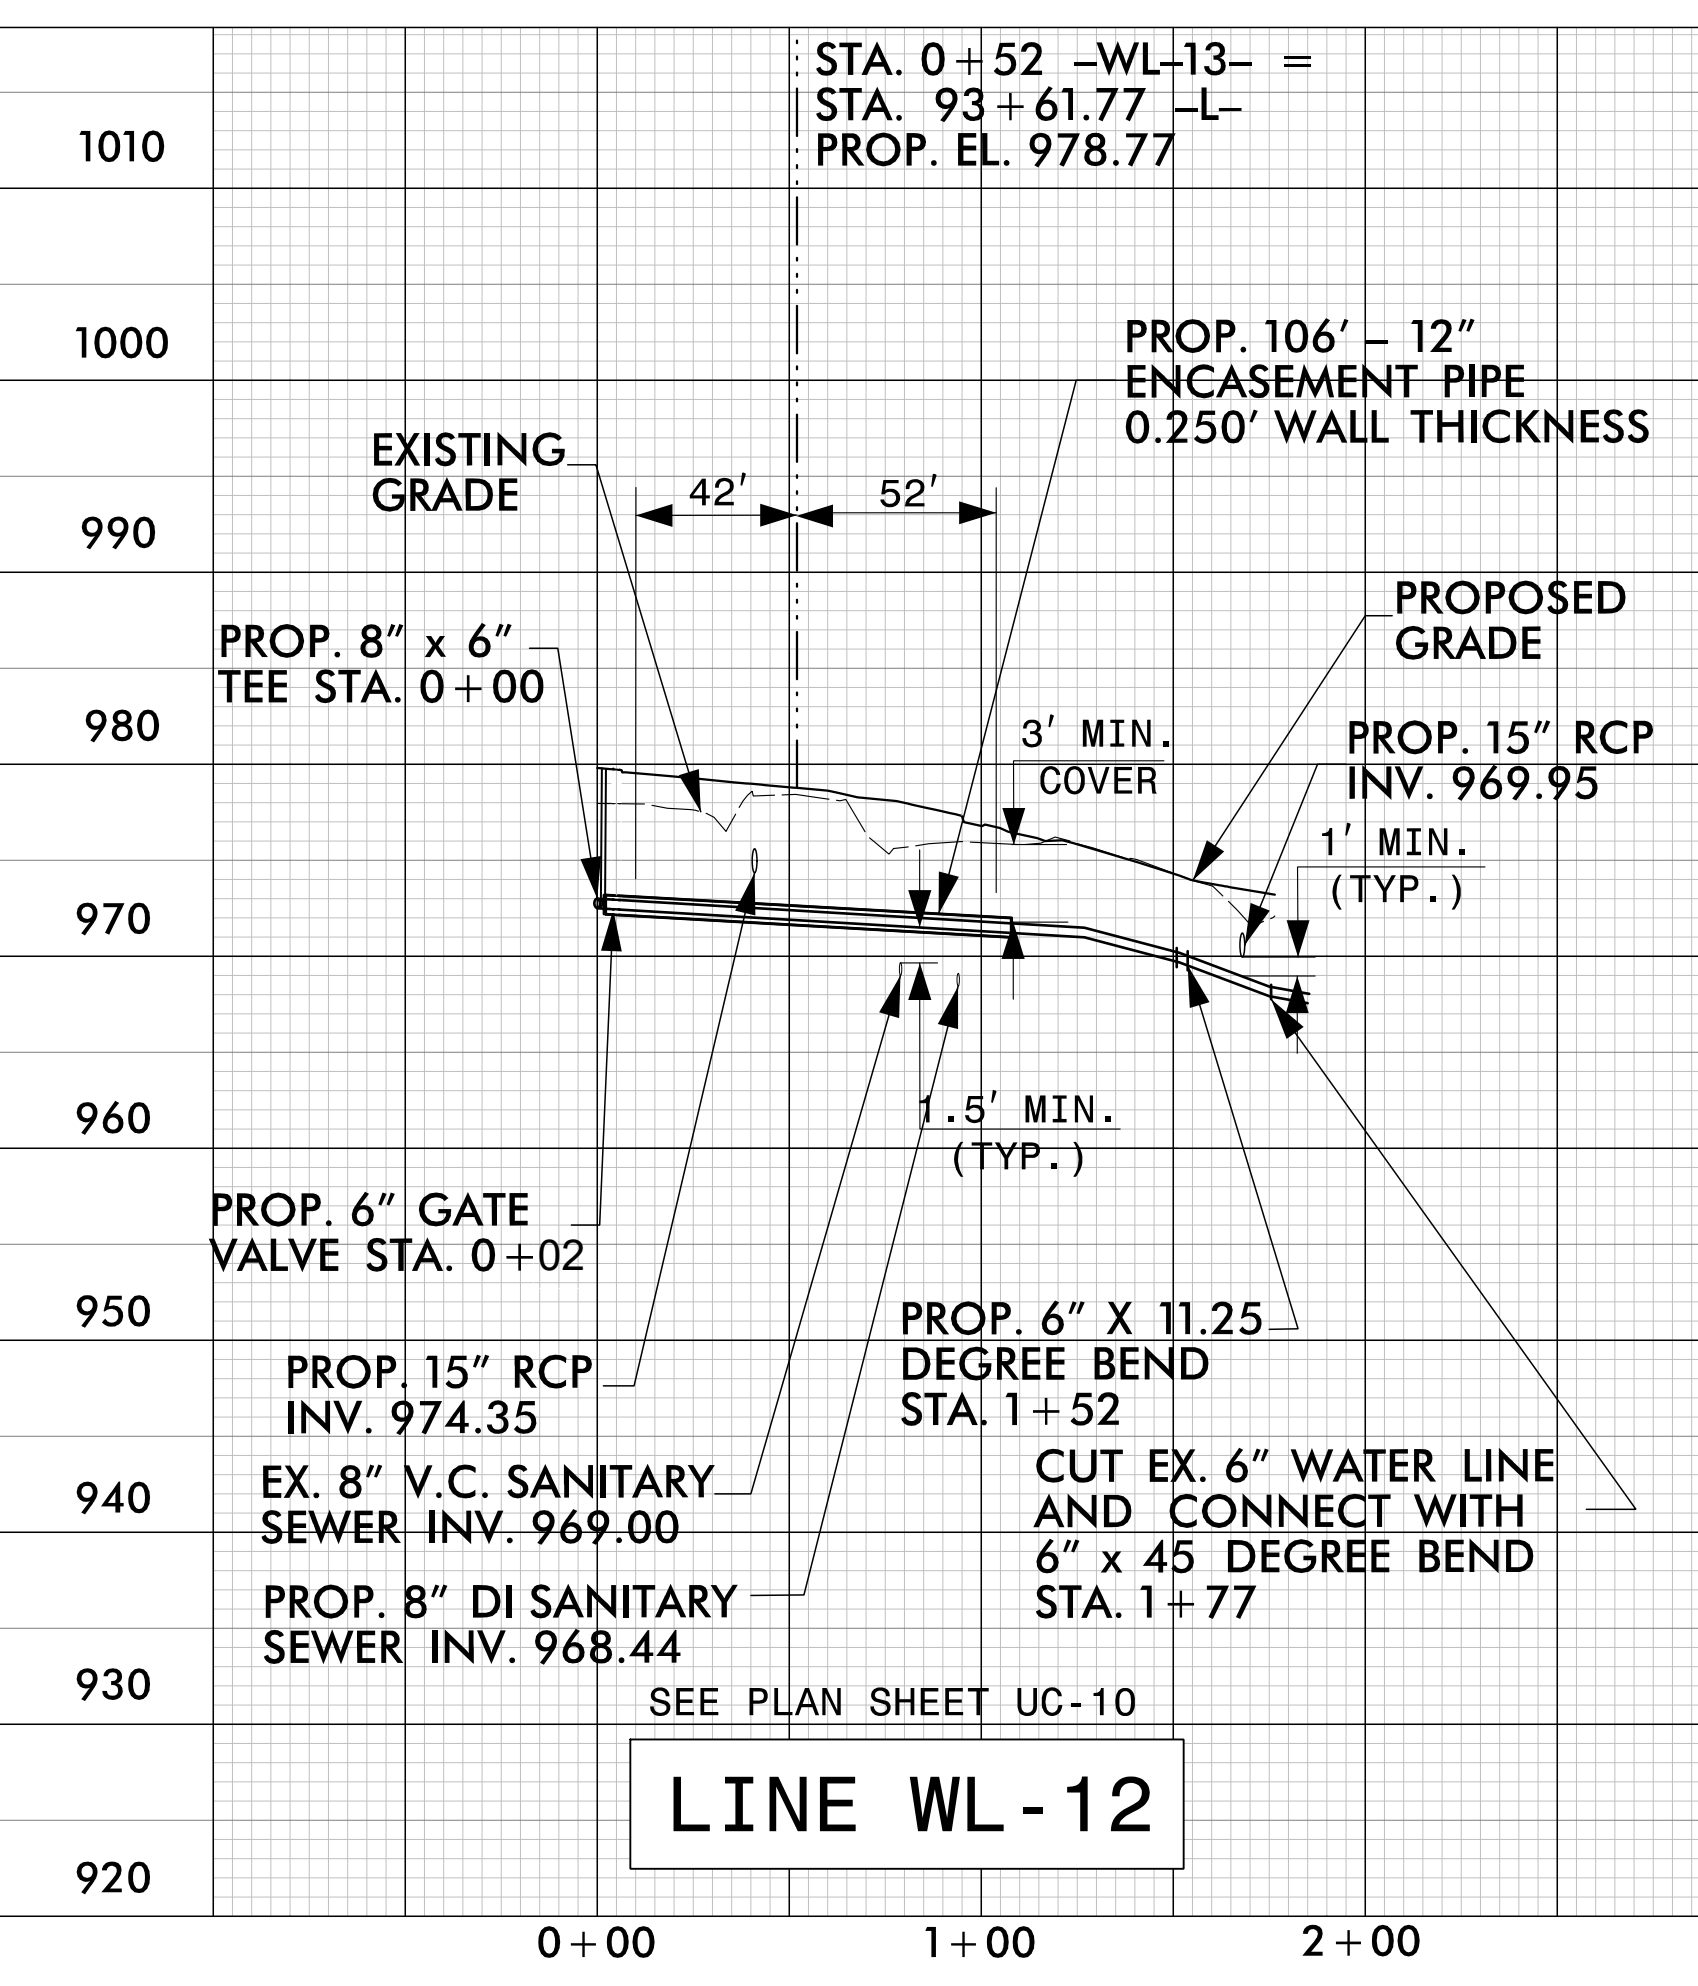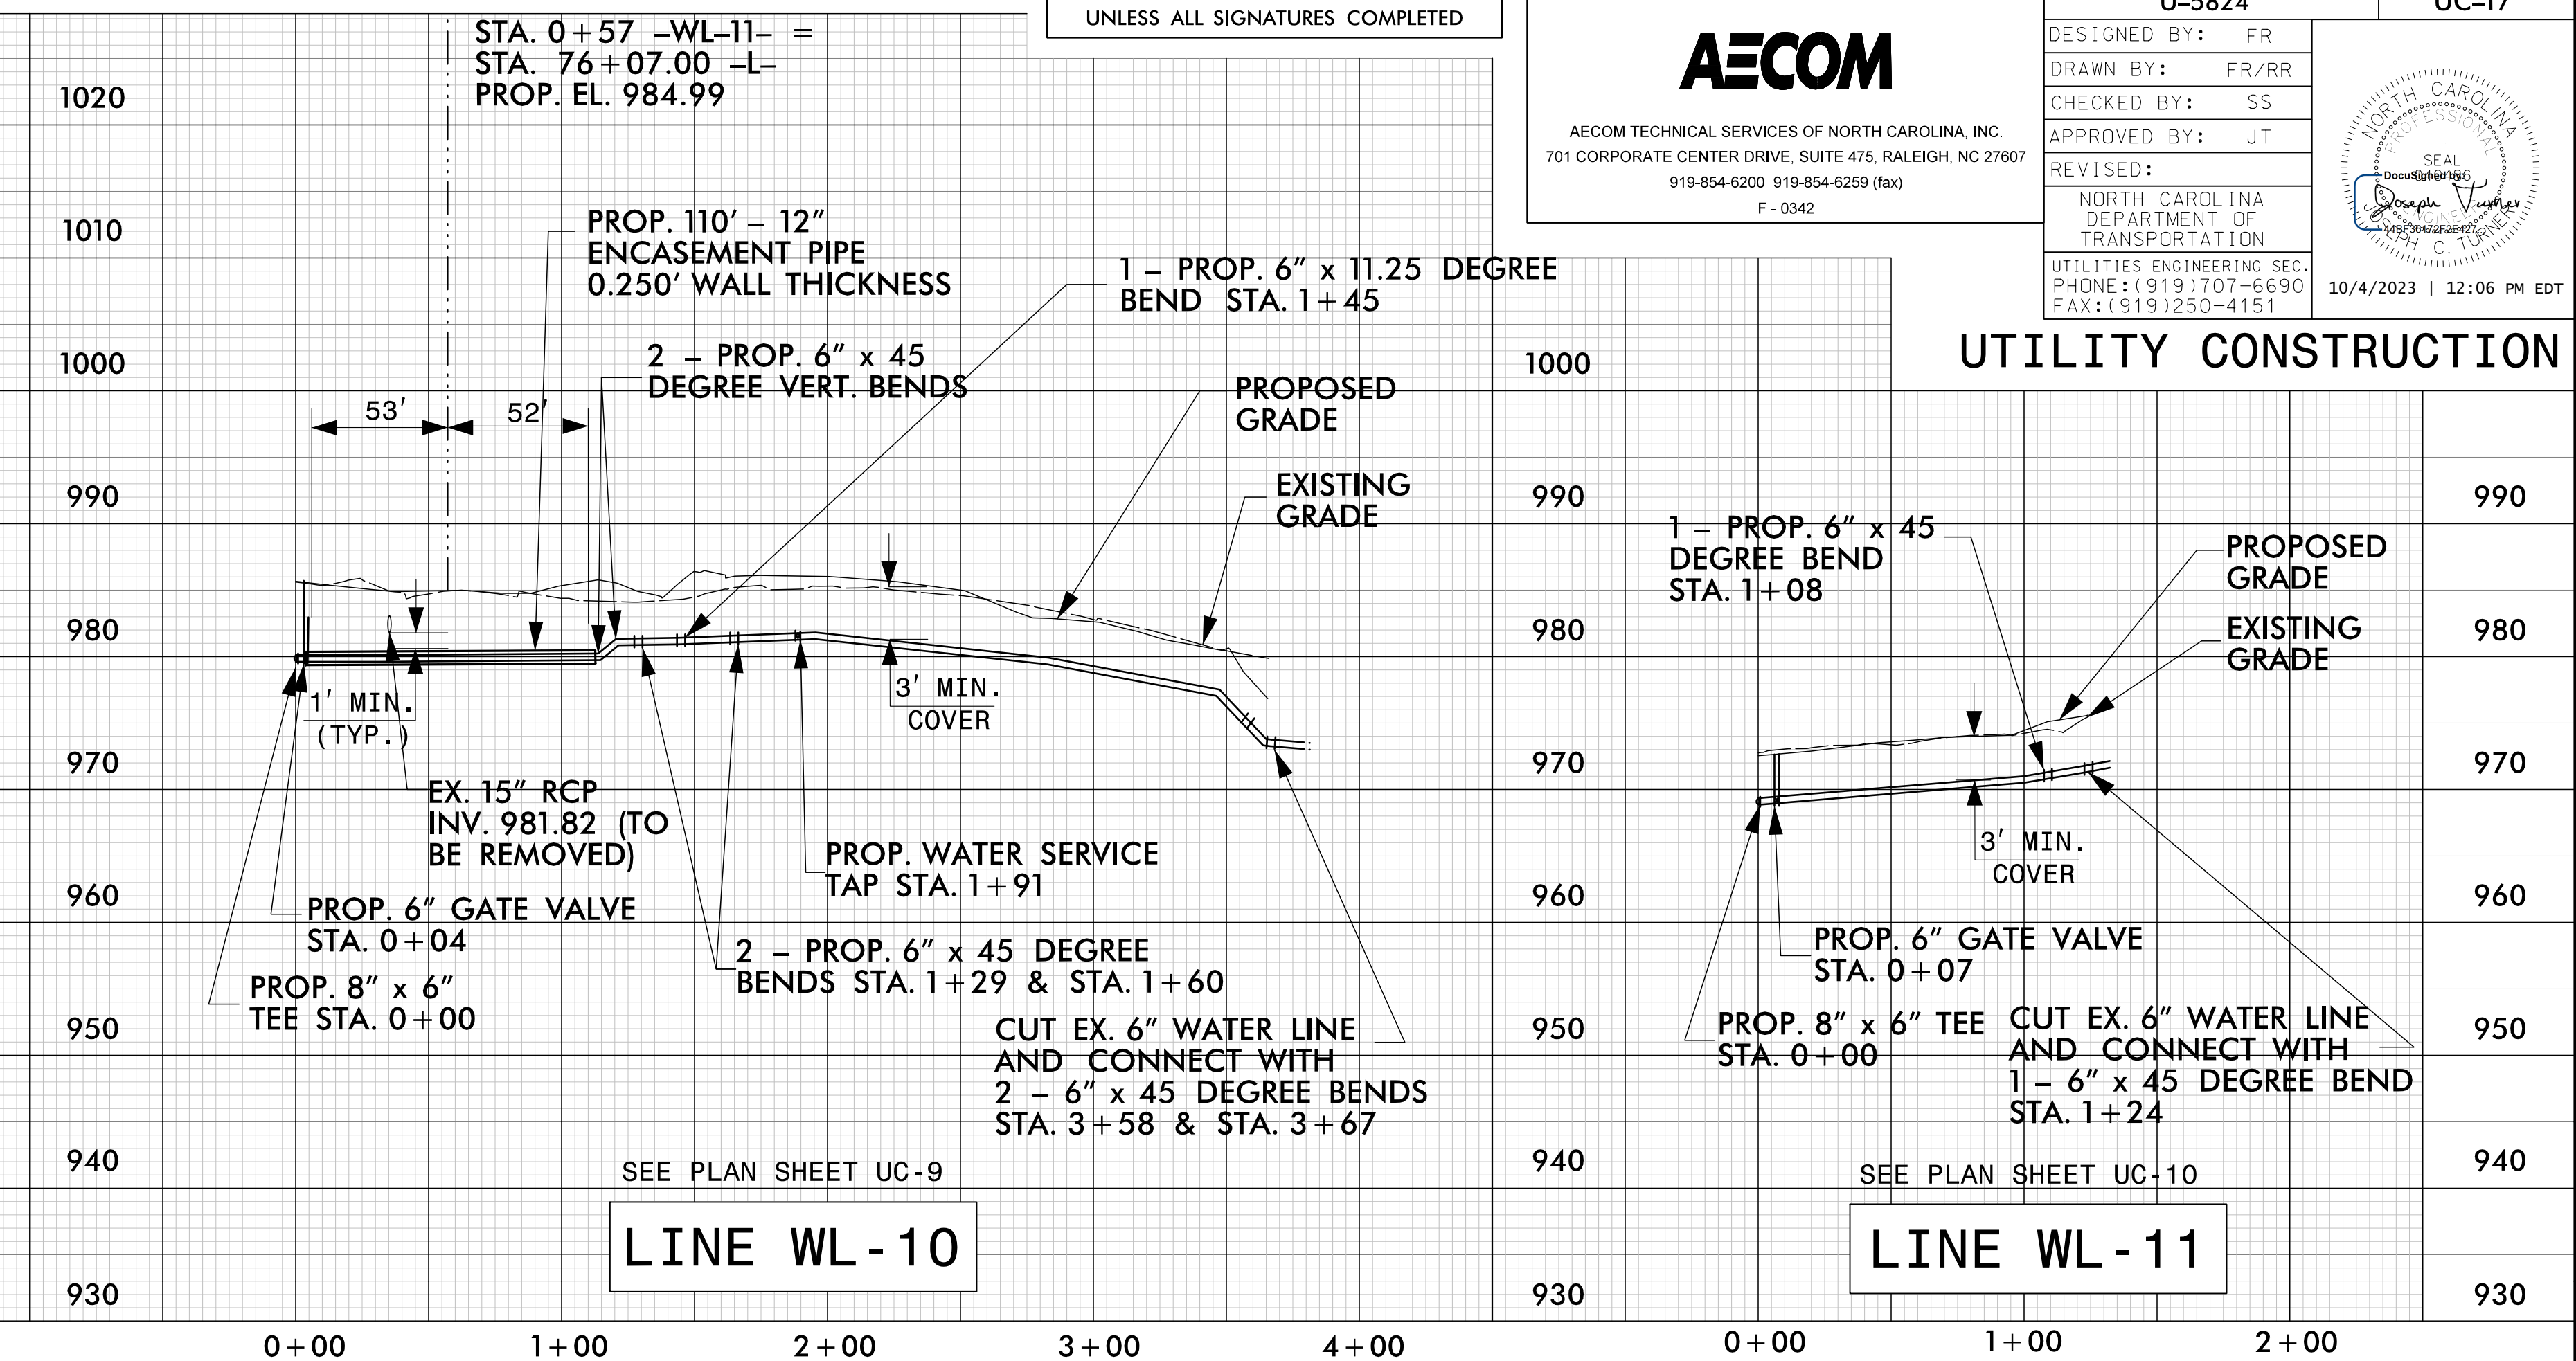

DATE: 9/21/2023
TIME: 5:02:20 PM
DWG: U5824-UC17-Utilities-Engineering\UC17\U5824.uc.plt - AGREEMENT.dgn