


 <p>Stantec Consulting Services Inc. 801 Jones Franklin Road Suite 300 Raleigh, NC 27606 Tel. (919) 851-6866 Fax. (919) 851-7024 www.stantec.com License No. F-0672</p>	PROJECT REFERENCE NO. R-3833C	SHEET NO. UC-11
	DESIGNED BY: LLP DRAWN BY: RGR CHECKED BY: LLP APPROVED BY: REVISED: NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	

UTILITY CONSTRUCTION

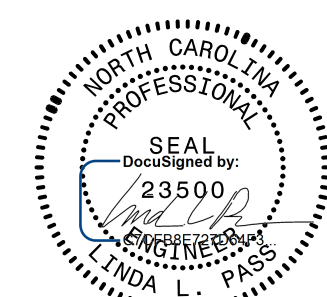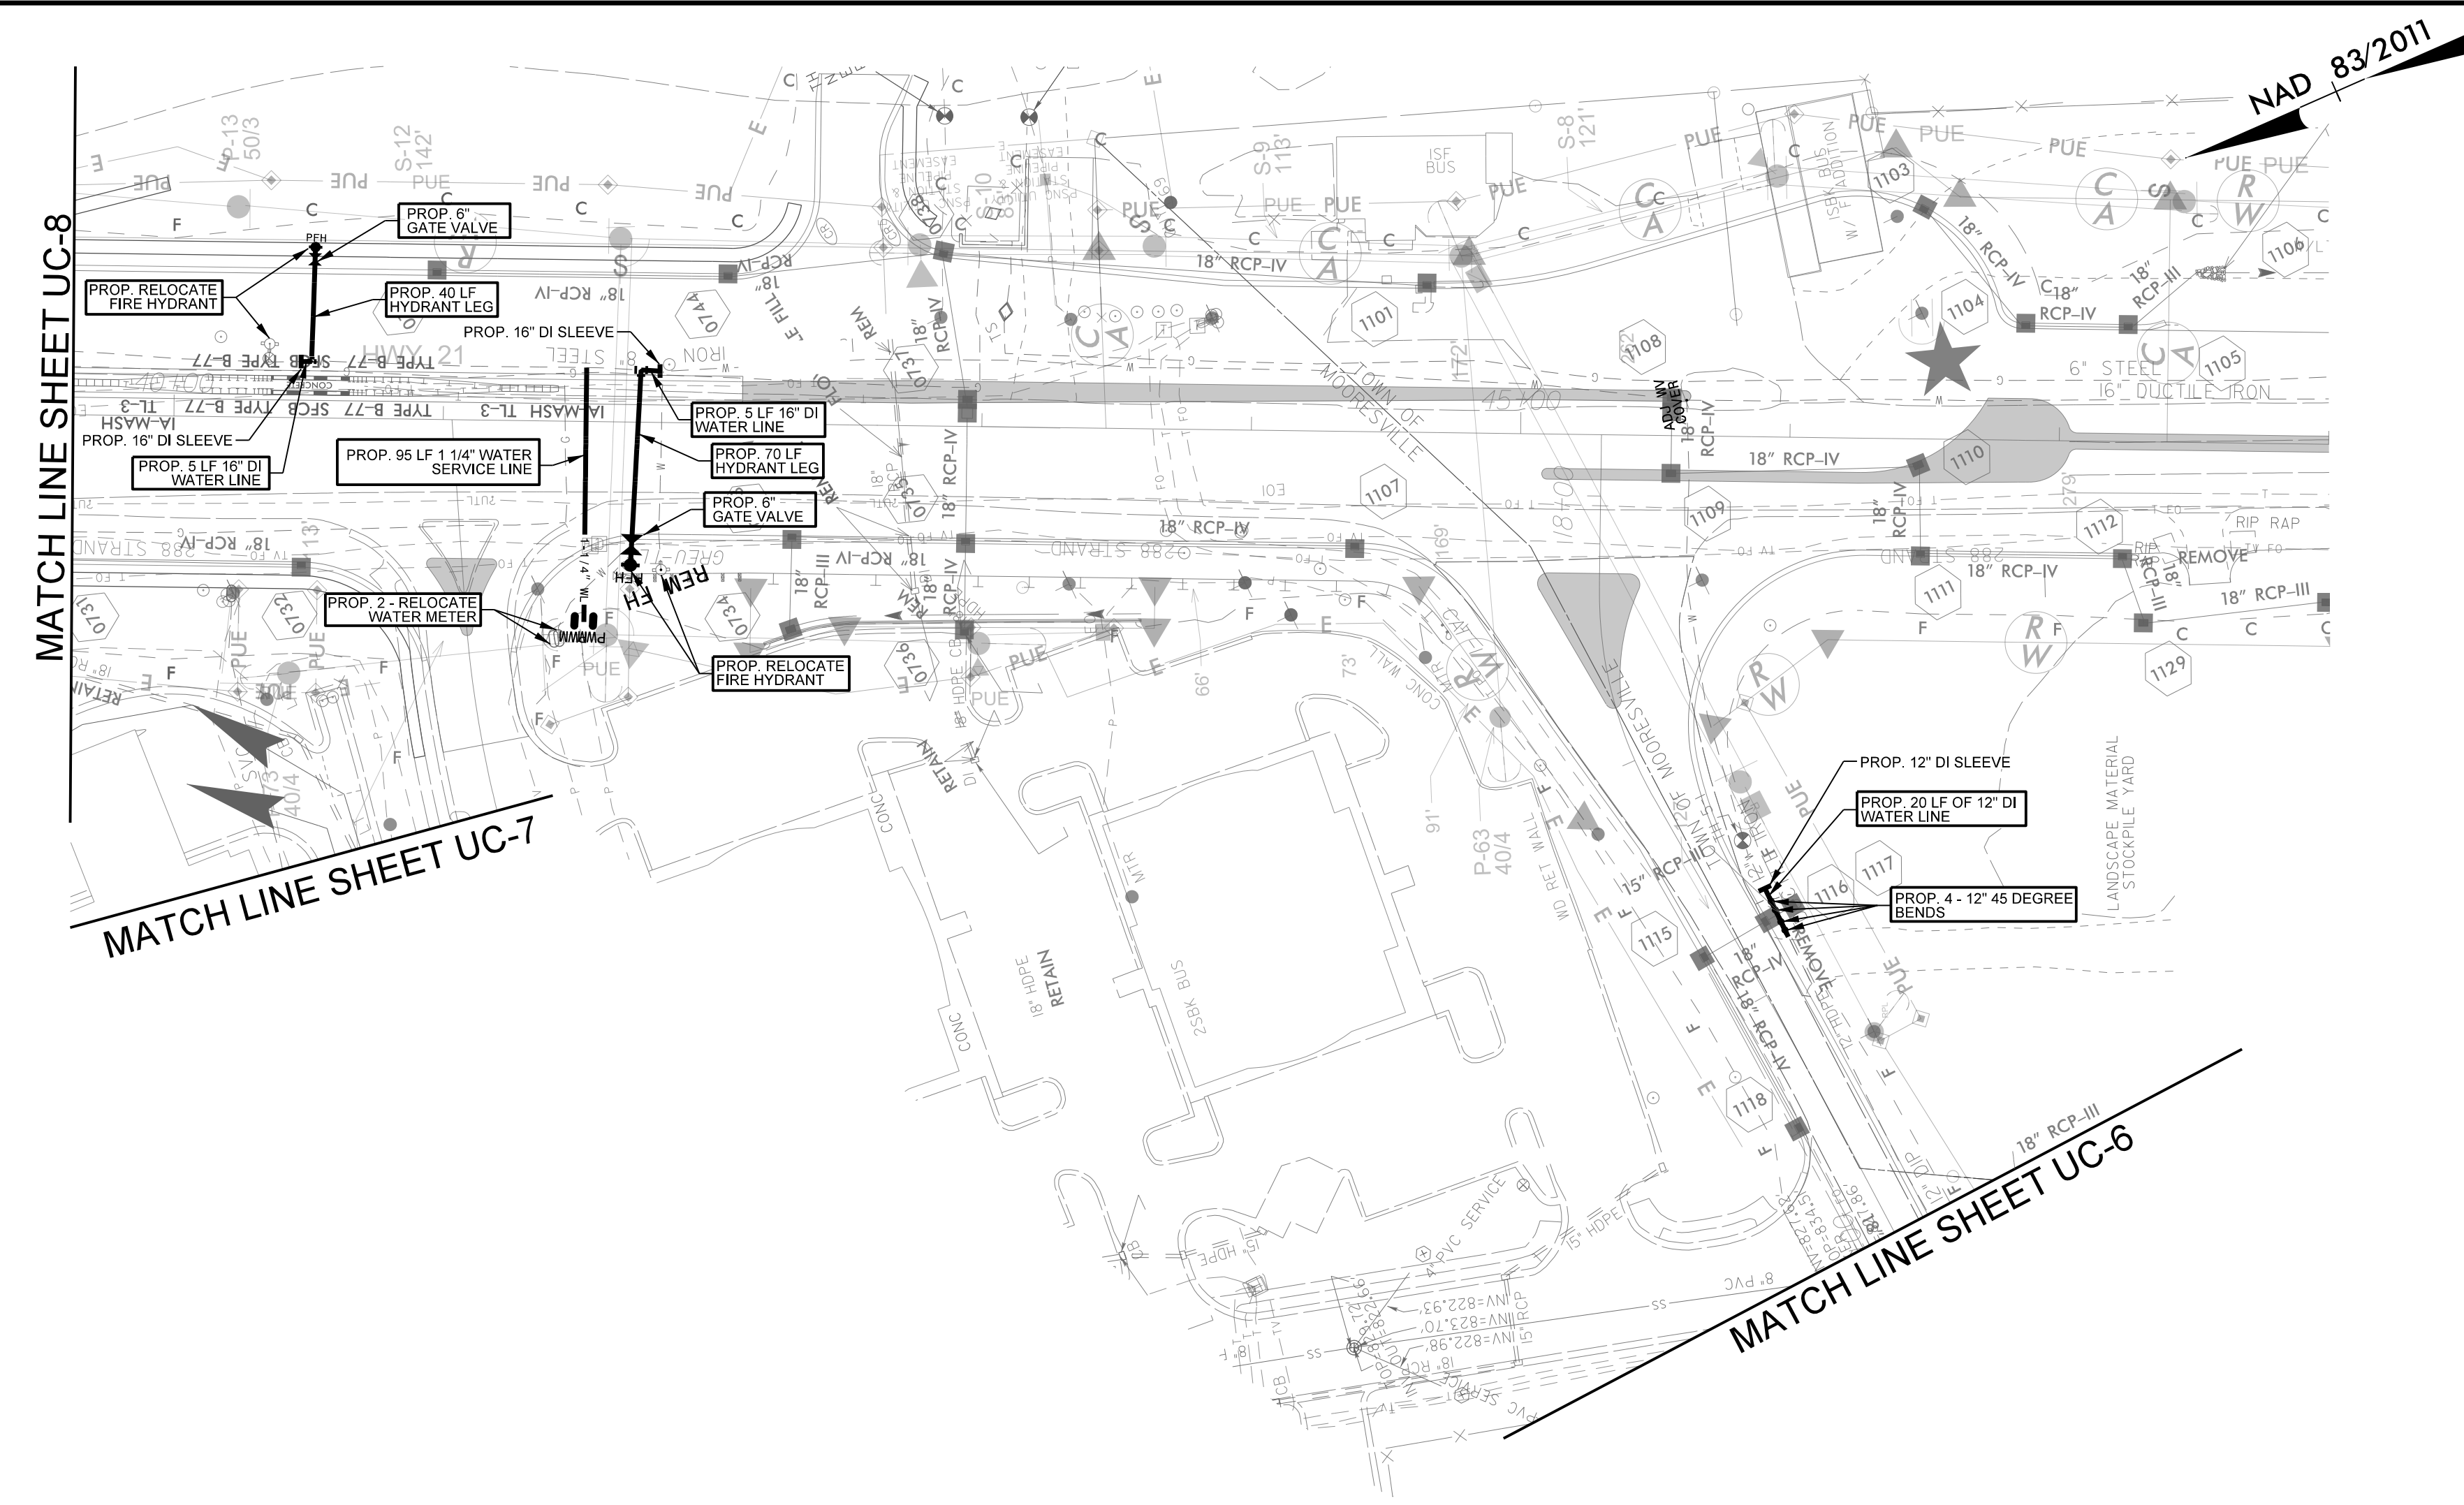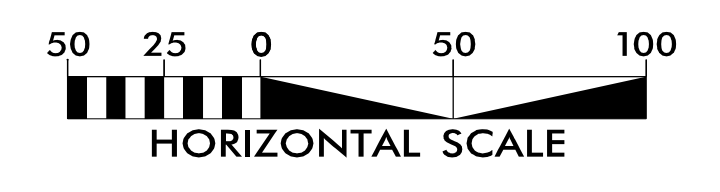

NOTES:
REFER TO MINIMUM RESTRAINED JOINT LENGTH TABLE ON SHEET UC-03E FOR LENGTH REQUIRED ON EACH SIDE OF FITTINGS.

NOTES:
THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 2635 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.