. INVERTS TO BE CONSTRUCTED OF BRICK WITH A CONCRETE BENCH (DETAIL# 07.xx).

THE MAXIMUM SEPARATION OR INVERT IN TO INVERT OUT WITHIN A MANHOLE IS 0.50 FEET.

. MANHOLES GREATER THAN 18 FEET IN DEPTH SHALL HAVE AN INSIDE DIAMETER OF 5'-0". FOR SANITARY SEWER MAINS GREATER THAN EIGHTEEN INCHES (18") IN DIAMETER, MANHOLES SHALL BE A MINIMUM OF 5'-0" IN DIAMETER.

STANDARD SANITARY

SEWER MANHOLE


SMITHFIELD, NORTH CAROLINA


PUBLIC UTILITIES


SCALE: NTS

DETAIL NO. 07.03

DATE: 04/03/2018

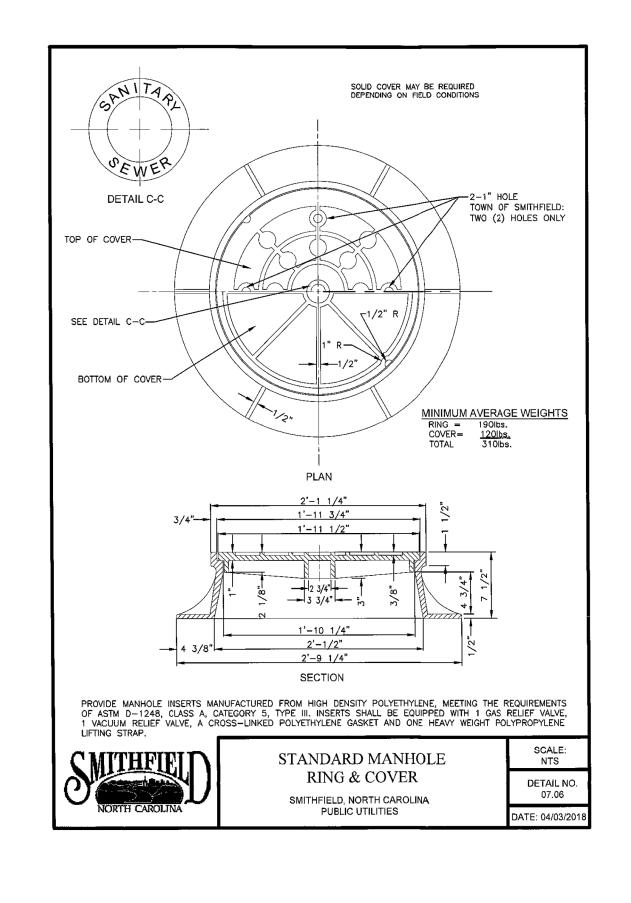

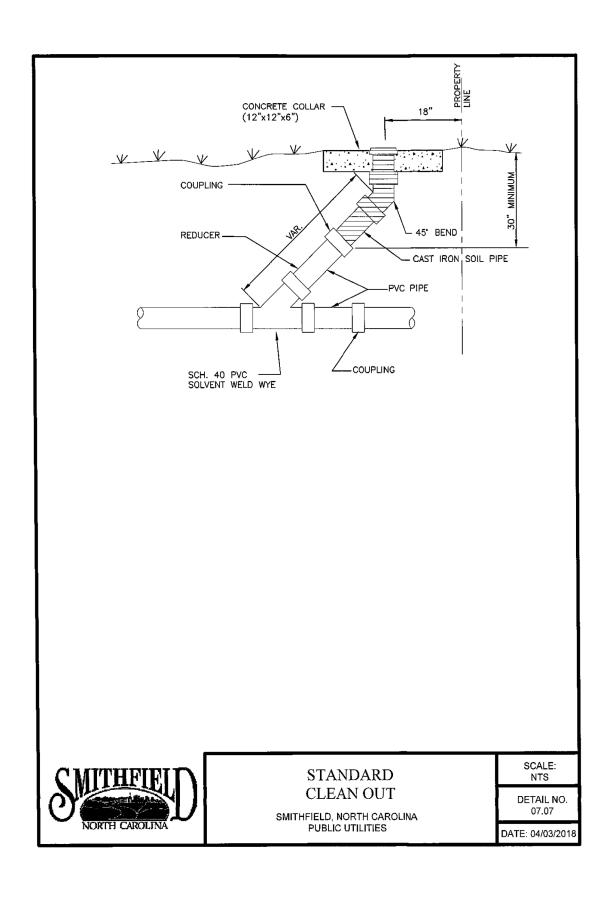

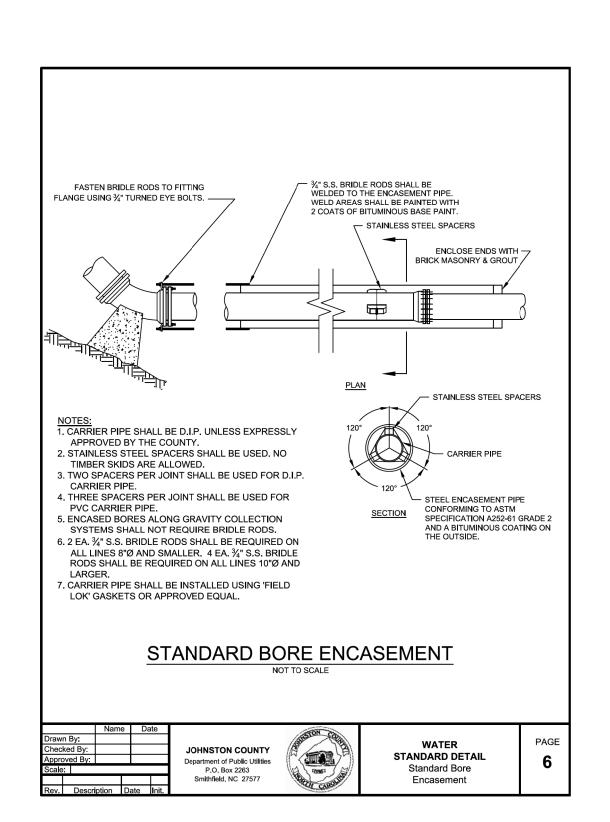





PROJECT REFERENCE NO.

1-5972

Bryan Badey

UTILITY CONSTRUCTION PLANS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

UC-3B

8/11/2023

Engineers | Construction Managers | Planners | Scientists www.rkk.com

Responsive People | Creative Solutions

ılītıes\Engıneerıng\UC\Proj\I5972_ut_dtl_UC3b_psh.dgn tu

023 ||ties/Fngineering\UC\Proj\