

PCCS POST-TENSIONING SEQUENCE

PERFORM P/T IN STAGES AFTER DECK SURFACE PREPARATION IS COMPLETE.

REMOVE EXISTING P/T, INSTALL NEW P/T STRANDS, AND TENSION AND MAINTAIN AN INITIAL LOAD OF 10,000 LBS.

THE CONTRACTOR SHALL MAINTAIN A SYMMETRIC TENSION FORCE BETWEEN EACH PAIR OF TRANSVERSE POST-TENSIONING STRANDS IN THE SPAN.

APPLY THE FINAL P/T LOAD OF 43,950 LBS.

NOTES:

FOR POST-TENSIONING STRAND REPLACEMENT, SEE PCCS POST-TENSIONING STRAND REPLACEMENT SPECIAL PROVISION.

ALL POST-TENSIONING STRANDS SHALL BE 7-WIRE LOW RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO ASSHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

RECESSES FOR TRANSVERSE STRANDS SHALL BE GROUTED AFTER THE FINAL TENSIONING OF THE STRANDS.


FOR "GROUT FOR STRUCTURES," SEE SPECIAL PROVISIONS.

FLAME CUTTING OF TRANSVERSE POST-TENSIONING STRANDS IS NOT ALLOWED.

SUMMARY OF QUANTITIES

	ESTIMATE	ACTUAL
POST-TENSIONING STRAND REPLACEMENT	6 EA.	

PROJECT NO. **HI-0017**
ROBESON COUNTY
 BRIDGE NO. **770454**

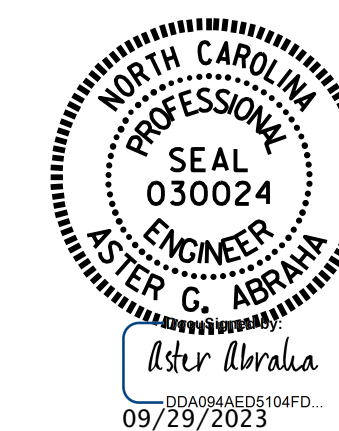

STATE OF NORTH CAROLINA
DEPARTMENT OF TRANSPORTATION
RALEIGH

POST-TENSIONING STRAND REPAIR DETAILS

DRAWN BY : J. BALDWIN DATE : 11/2022
 CHECKED BY : S. WANCE DATE : 11/2022

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

REVISIONS						SHEET NO.
NO.	BY:	DATE:	NO.	BY:	DATE:	
1			3			S4-4
2			4			TOTAL SHEETS 7