


PROJECT REFERENCE NO. B-5898B-3186	SHEET NO. W-24
---------------------------------------	-------------------

GEOTECHNICAL ENGINEER
 RYAN PATRICK DOYLE
 SEAL 045161
 PROFESSIONAL ENGINEER
 STATE OF NORTH CAROLINA

DocuSigned by:
 Ryan Patrick Doyle
 11/9/2023

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED
AECOM

ESTIMATED SOIL NAIL WALL QUANTITIES			
RETAINING WALL NO.	SOIL NAIL RETAINING WALLS (SQUARE FEET)	SOIL NAIL VERIFICATION TESTS	SOIL NAIL PROOF TESTS
2	5,155	2	18

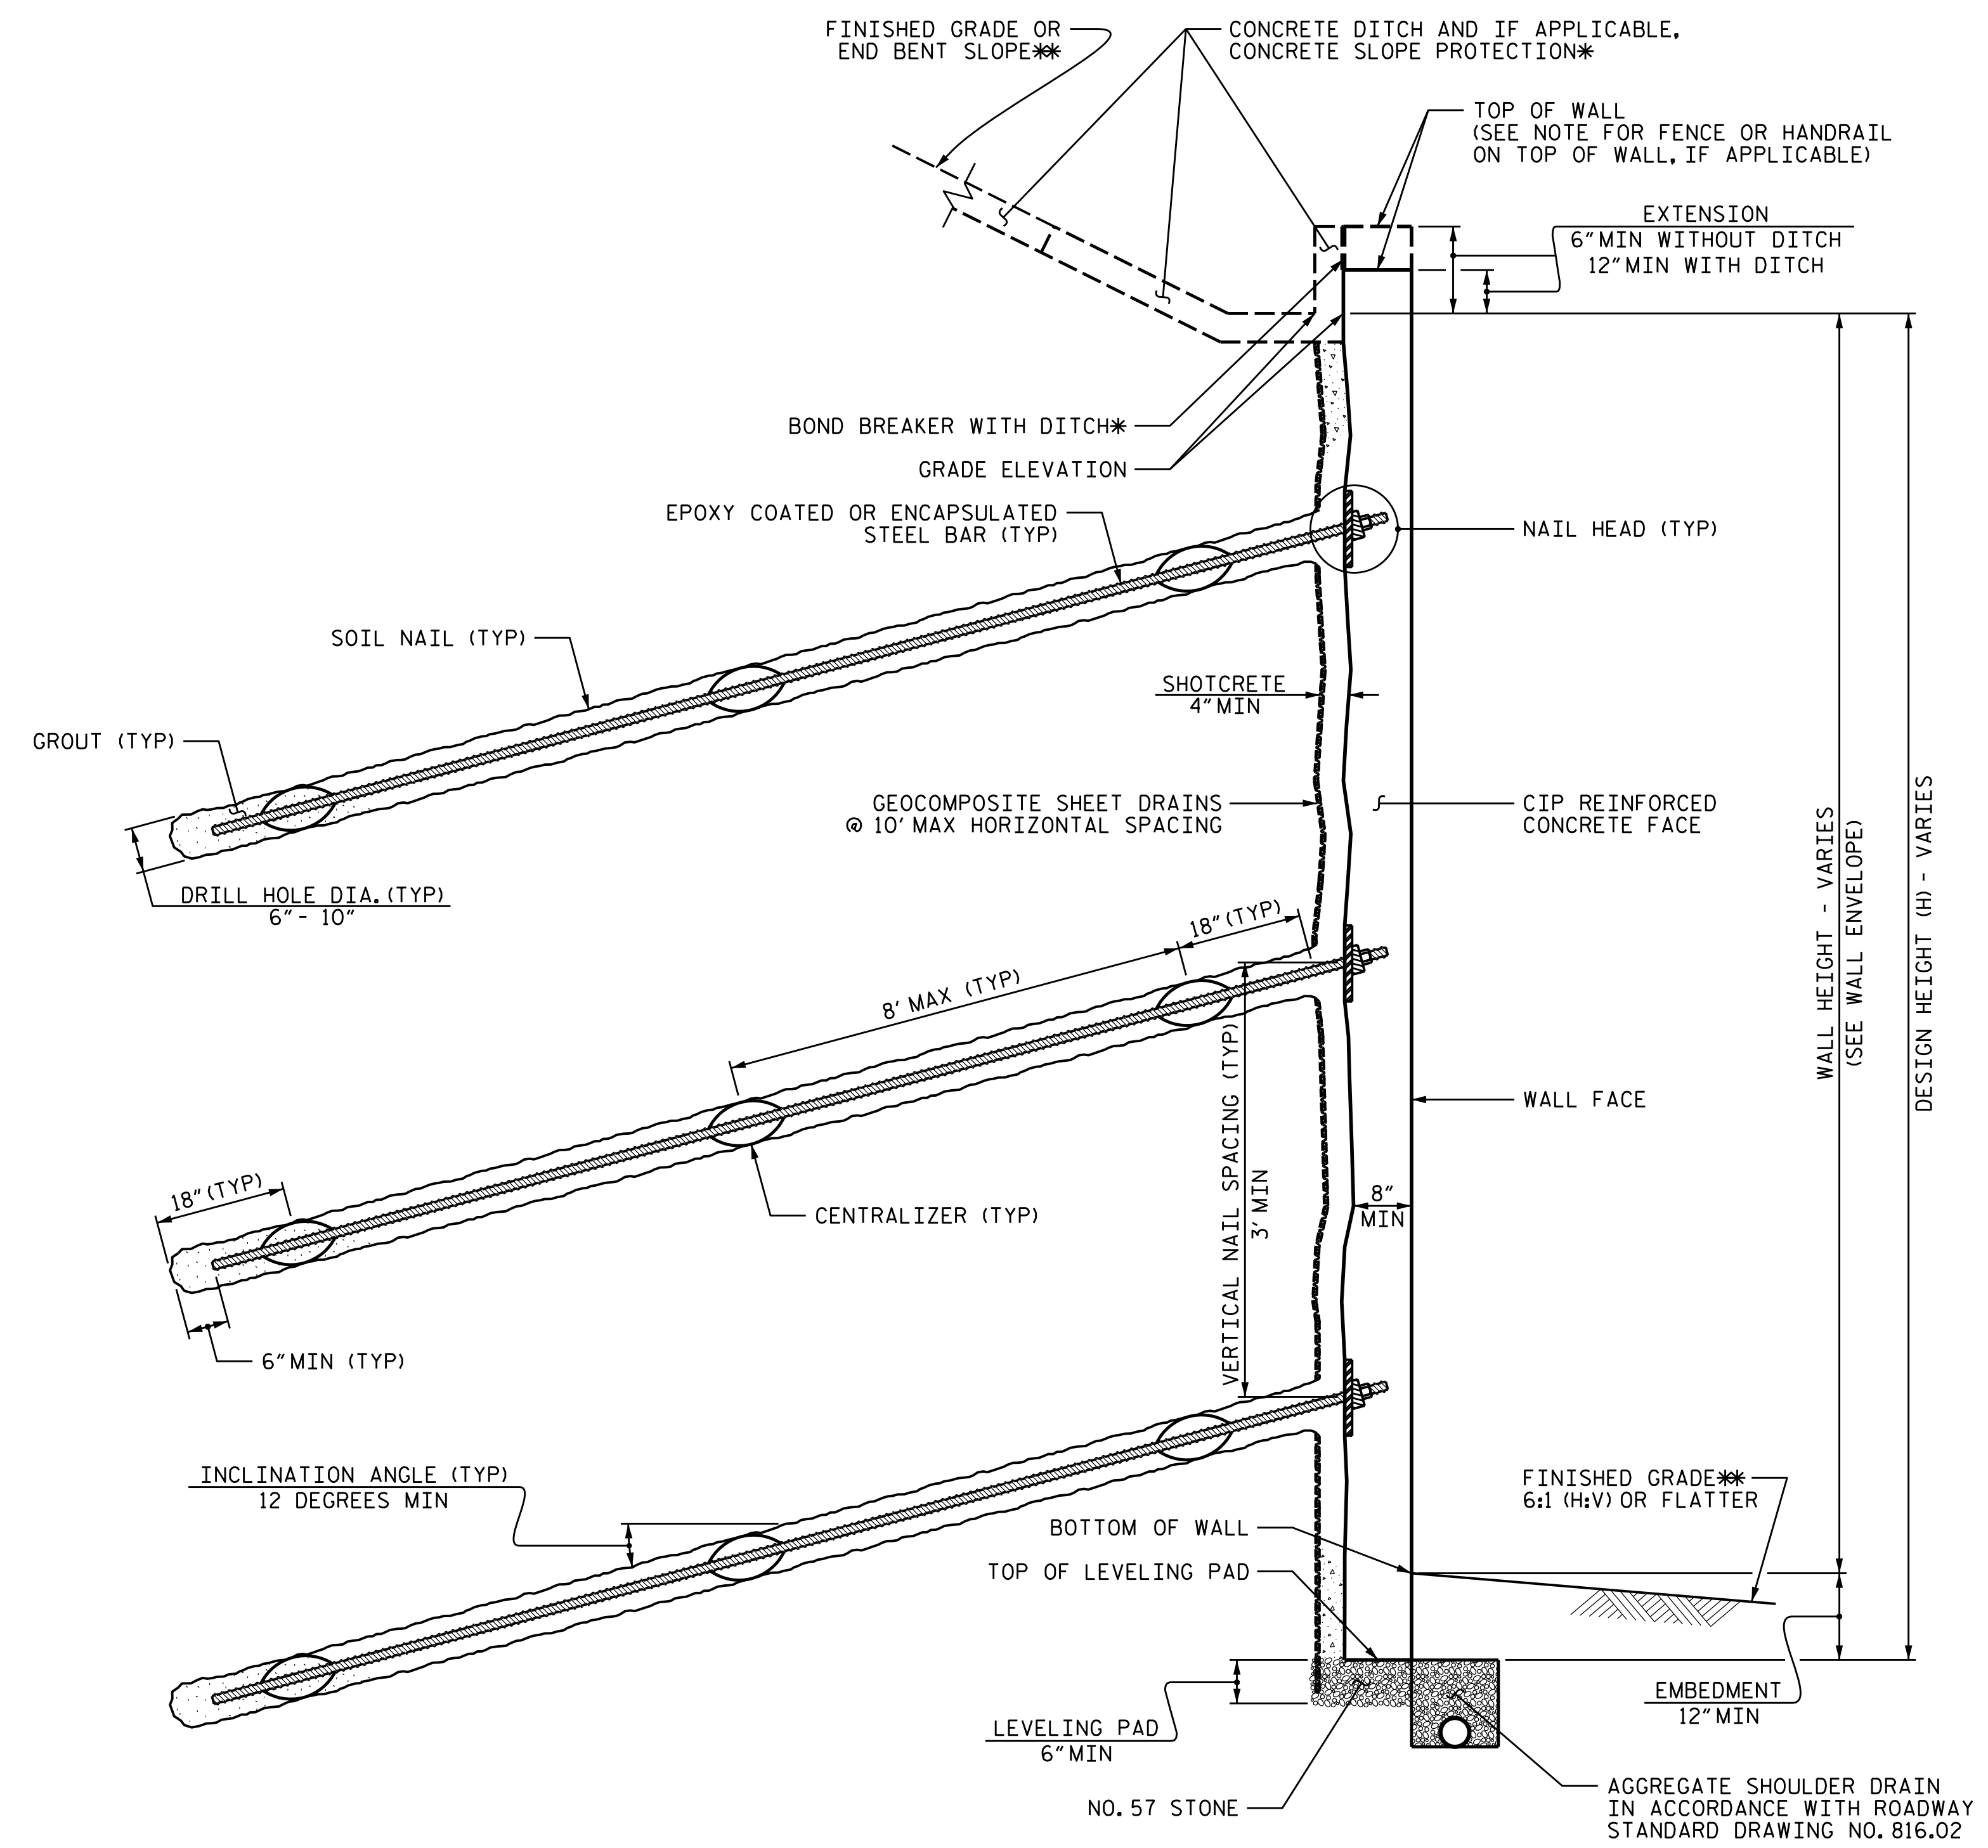

NOTES:

FOR SOIL NAIL RETAINING WALLS, SEE SOIL NAIL RETAINING WALLS PROVISION.

BEFORE BEGINNING SOIL NAIL WALL DESIGN FOR RETAINING WALL NO. 2, SURVEY WALL LOCATION AND SUBMIT A REVISED WALL PROFILE VIEW (WALL ENVELOPE) FOR REVIEW. DO NOT START WALL DESIGN OR CONSTRUCTION UNTIL THE REVISED WALL ENVELOPE IS ACCEPTED.

DESIGN RETAINING WALL NO. 2 FOR THE FOLLOWING:

- 1) H = WALL HEIGHT + WALL EMBEDMENT
- 2) DESIGN LIFE = 100 YEARS
- 3) IN-SITU ASSUMED MATERIAL PARAMETERS, ELEVATION ABOVE 2638 FT:
 UNIT WEIGHT, $\gamma = 110$ PCF
 FRICTION ANGLE, $\phi = 25$ DEGREES
 COHESION, $c = 0$ PSF
- 4) IN-SITU ASSUMED MATERIAL PARAMETERS, ELEVATION FROM 2623 FT TO 2638 FT:
 UNIT WEIGHT, $\gamma = 115$ PCF
 FRICTION ANGLE, $\phi = 30$ DEGREES
 COHESION, $c = 0$ PSF
- 5) IN-SITU ASSUMED MATERIAL PARAMETERS BELOW ELEVATION 2623 FT:
 UNIT WEIGHT, $\gamma = 115$ PCF
 FRICTION ANGLE, $\phi = 30$ DEGREES
 COHESION, $c = 0$ PSF

EXISTING OR FUTURE OBSTRUCTIONS SUCH AS FOUNDATIONS, GUARDRAIL, FENCE OR HANDRAIL POSTS, PAVEMENTS, PIPES, INLETS OR UTILITIES MAY INTERFERE WITH SOIL NAILS FOR RETAINING WALL NO. 2.

SOIL NAIL WALL (RETAINING WALL NO. 2) - TYPICAL SECTION

*SEE CONCRETE DITCH BEHIND WALL DETAILS.
 **SEE PLANS FOR FINISHED GRADE OR END BENT SLOPE DETAILS.