


IN-LINE SPLICE




NOT TO SCALE

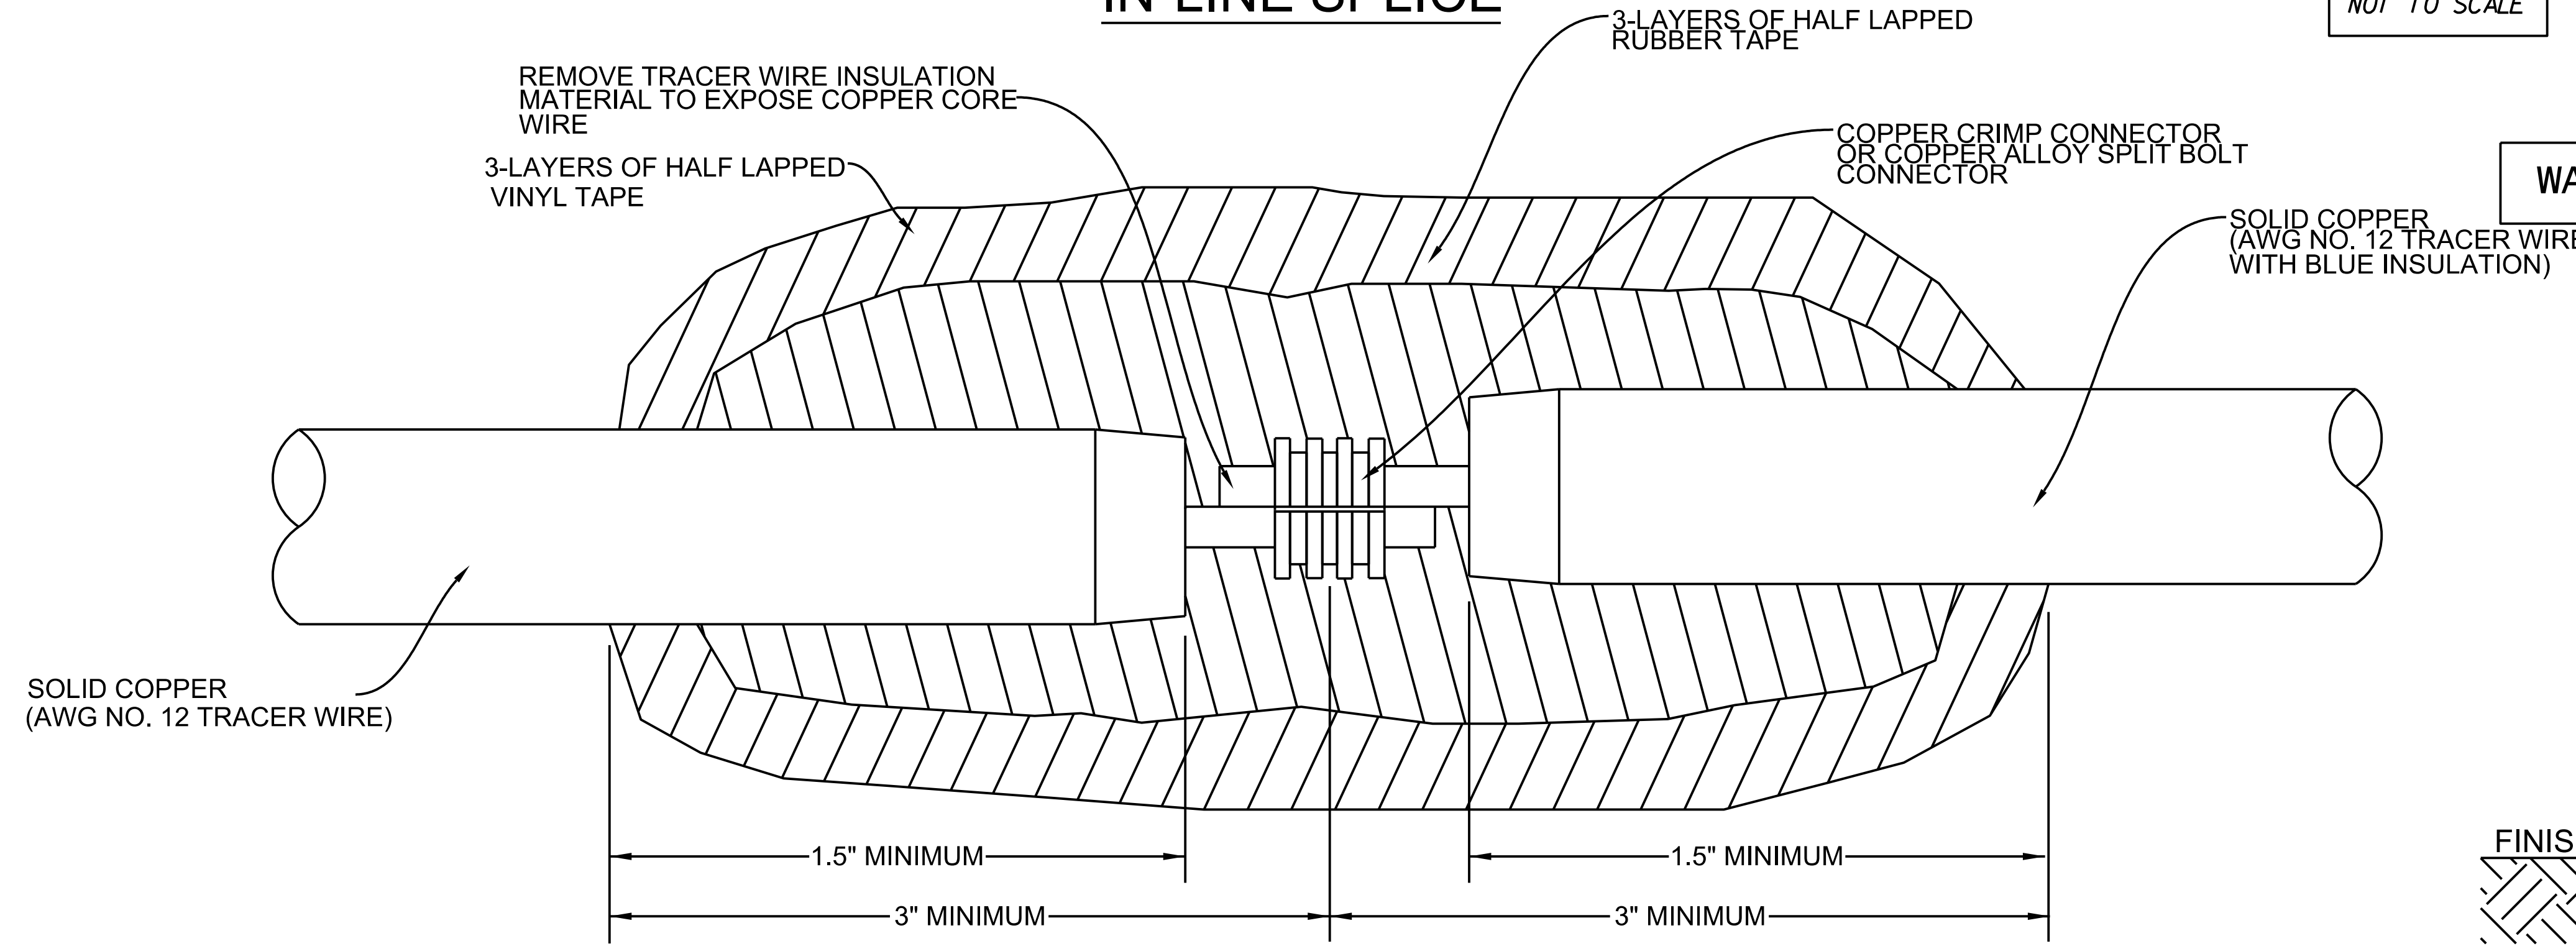

HINDE ENGINEERING
License No. C-2639
401 Harrison Oaks Blvd., Suite 220 Cary, NC 27513

**DOCUMENT NOT CONSIDERED FINAL
UNLESS ALL SIGNATURES COMPLETED**

WATER AND SEWER PLANS

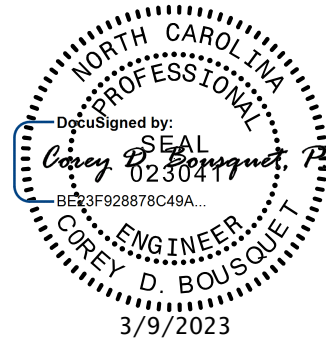PROJECT REFERENCE NO. U-5839	SHEET NO. UC-3B
DESIGNED BY: JKC	
DRAWN BY: ASW	
CHECKED BY: CLS	
APPROVED BY: CDB	
REVISED:	
NORTH CAROLINA DEPARTMENT OF TRANSPORTATION UTILITIES ENGINEERING SEC. PHONE: (919) 707-6690 FAX: (919) 250-4151	
UTILITY CONSTRUCTION PLANS ONLY	


BORE DETAIL



NOTES:


1. IN LINE SPLICES SHALL BE LIMITED TO THE GREATEST EXTENT POSSIBLE. TRACER WIRE SHALL BE AS CONTINUOUS AS POSSIBLE WITHOUT SPLICES.
2. INLINE SPLICES SHALL INCLUDE 3 FEET OF SLACK WIRE ON EACH SIDE OF EACH SPLICE.

10" HDPE WATER LINE

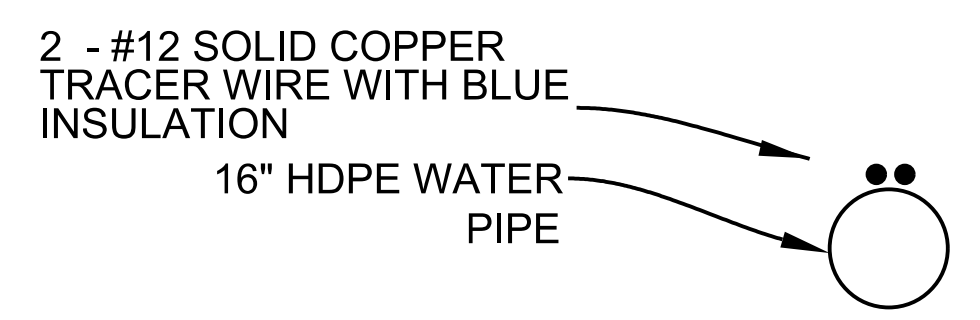


TRACER WIRE FOR WATER MAIN

SECTION VIEW

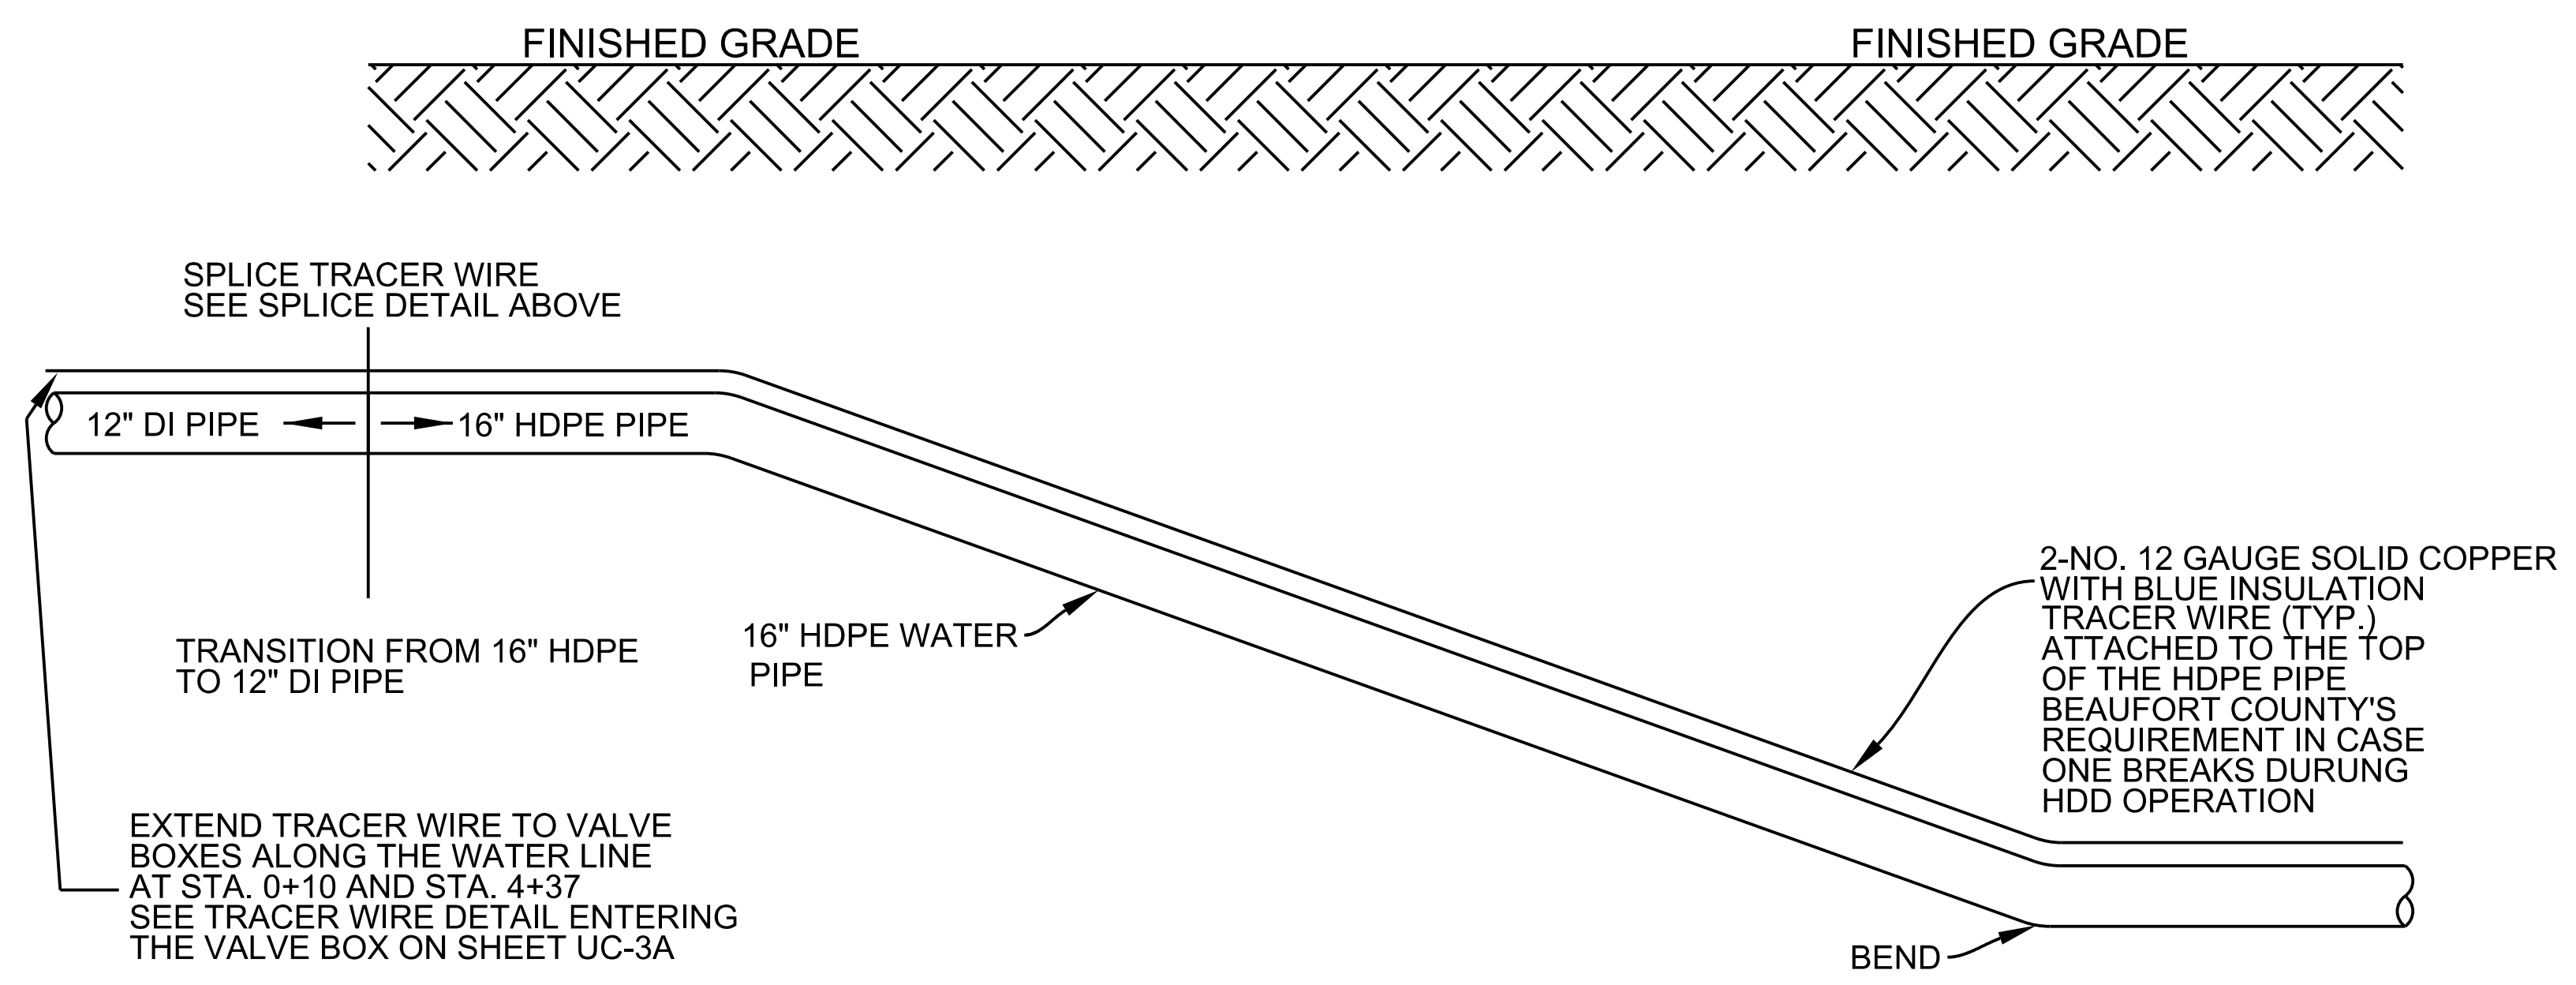

TRENCH DETAIL

PROFILE VIEW

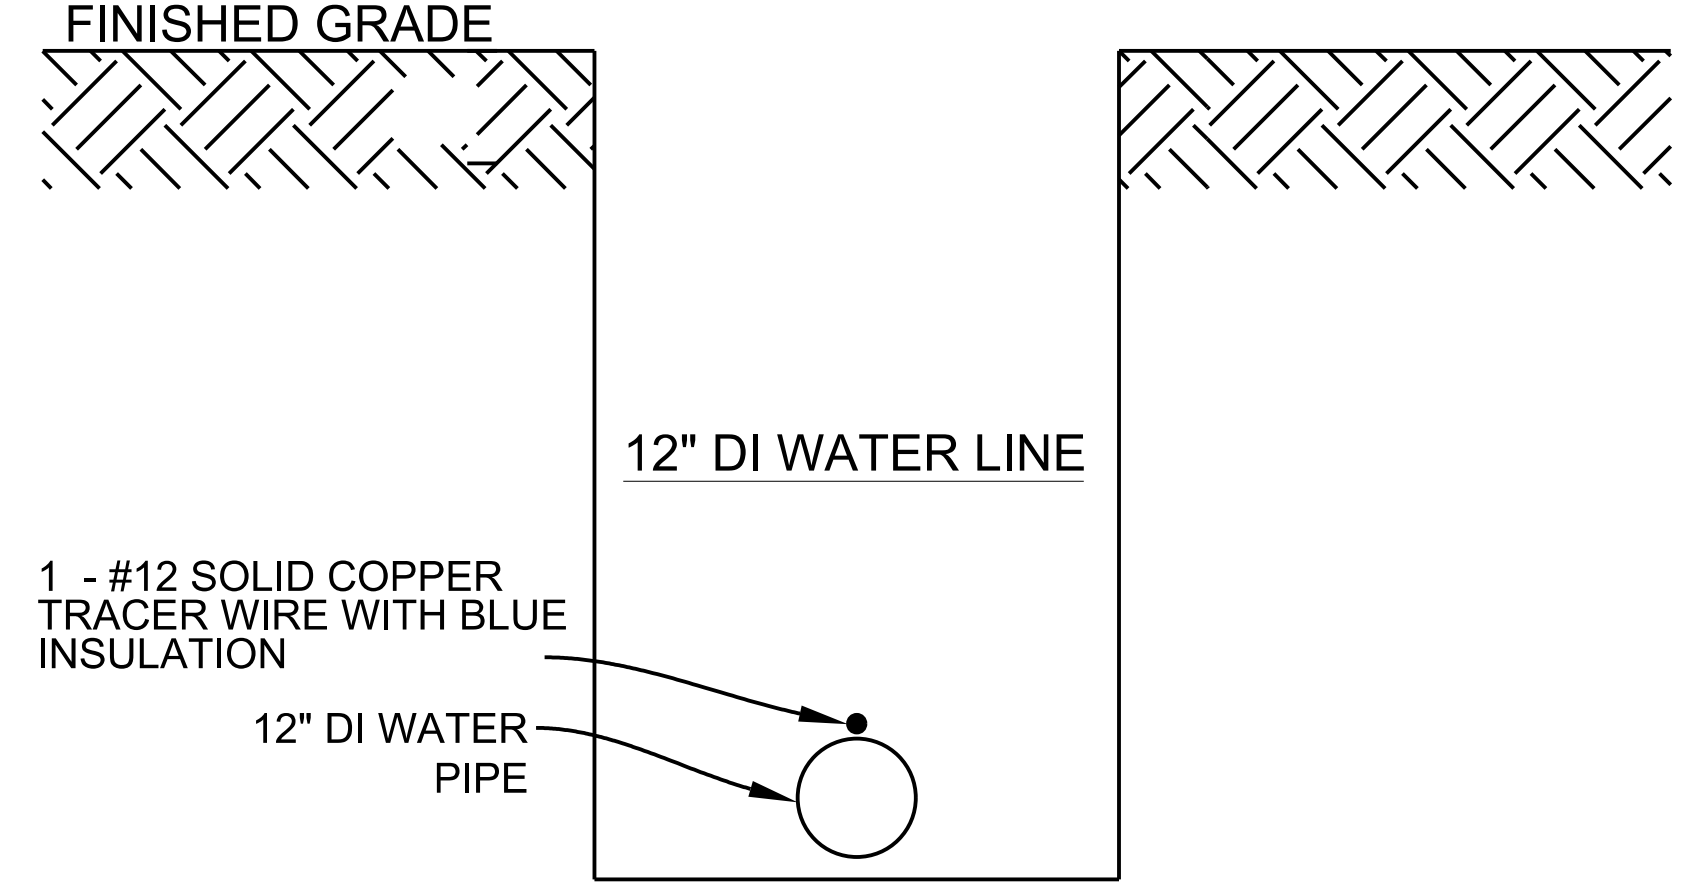

20-MAR-2023 15:20 PROJECTS\2015\A2015803.00 Mulkey - U-5839\Design\Utilities\Engineering\UC\Proj\U5839_ut_dtl_UC3B_psh.dgn
 3386111111