


UTILITIES BY OTHERS

NOTE:
ALL UTILITY WORK SHOWN ON THIS SHEET WILL BE DONE BY OTHERS. NO PAYMENT WILL BE MADE TO THE CONTRACTOR FOR UTILITY WORK SHOWN ON THIS SHEET.

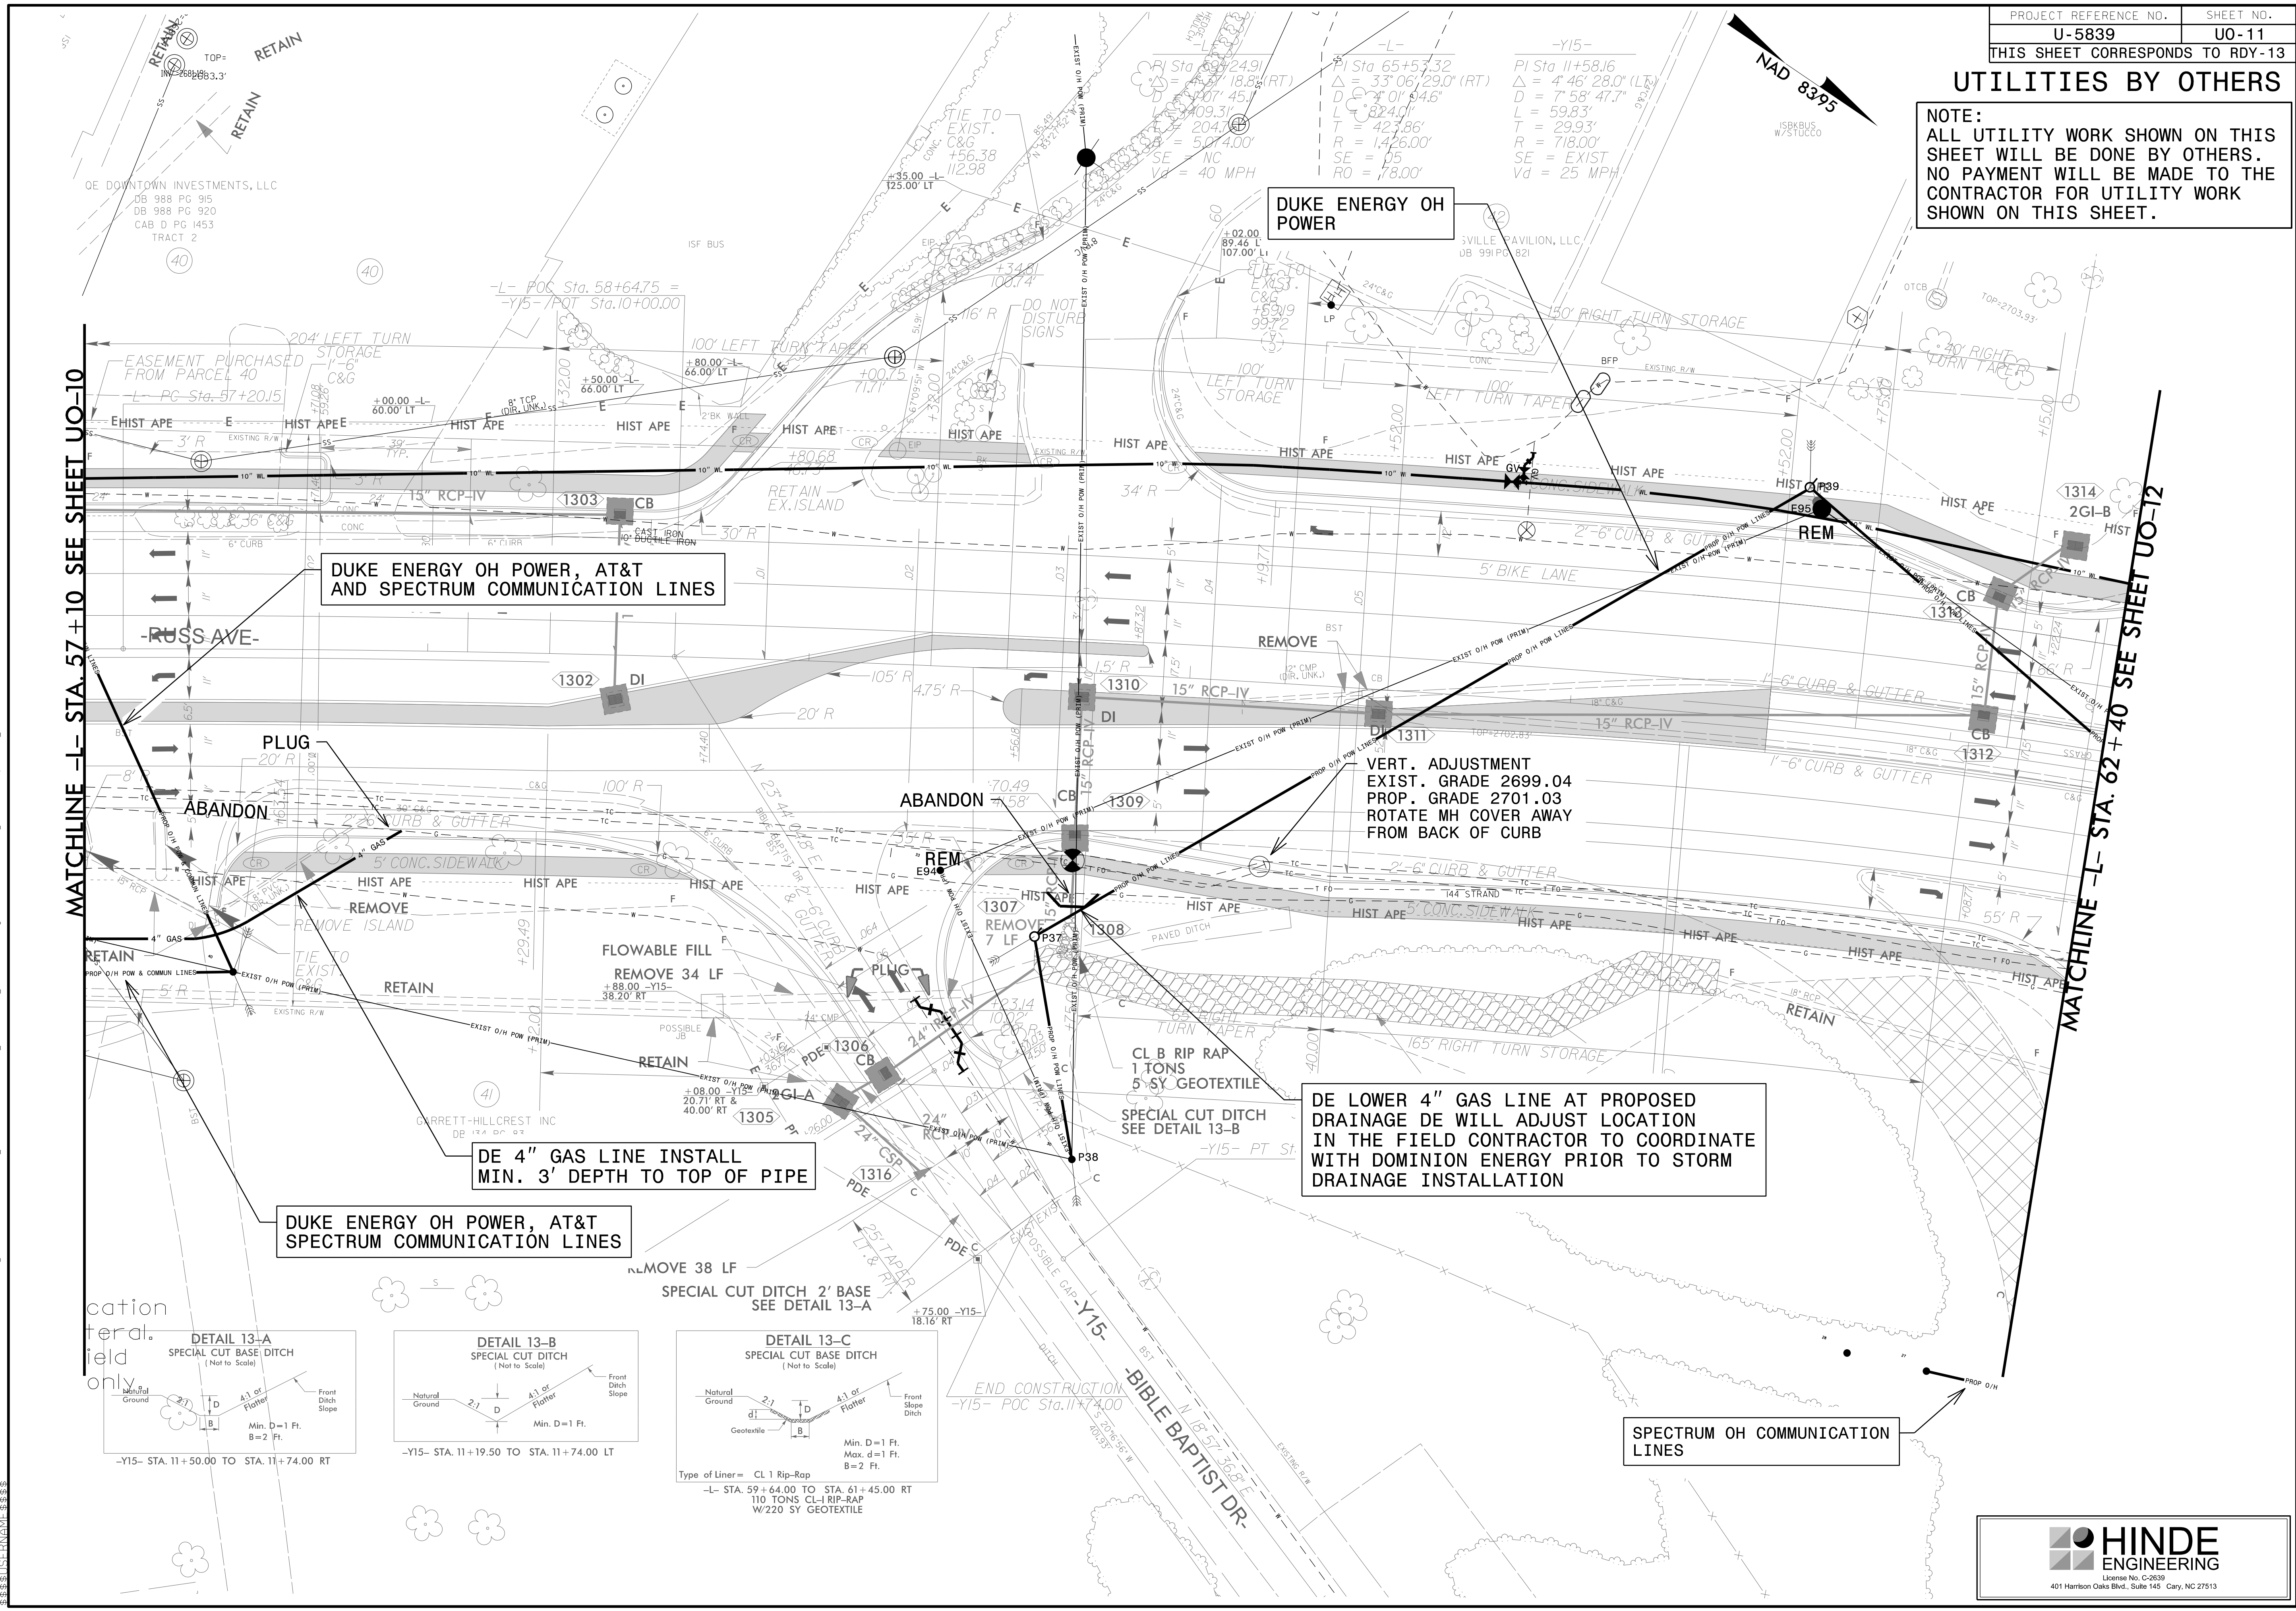

MATCHLINE -L- STA. 57+10 SEE SHEET UO-10

MATCHLINE -L- STA. 62+40 SEE SHEET UO-12




DUKE ENERGY OH POWER, AT&T AND SPECTRUM COMMUNICATION LINES

DUKE ENERGY OH POWER, AT&T SPECTRUM COMMUNICATION LINES

VERT. ADJUSTMENT
EXIST. GRADE 2699.04
PROP. GRADE 2701.03
ROTATE MH COVER AWAY FROM BACK OF CURB

DE LOWER 4" GAS LINE AT PROPOSED DRAINAGE DE WILL ADJUST LOCATION IN THE FIELD CONTRACTOR TO COORDINATE WITH DOMINION ENERGY PRIOR TO STORM DRAINAGE INSTALLATION

DE 4" GAS LINE INSTALL
MIN. 3' DEPTH TO TOP OF PIPE

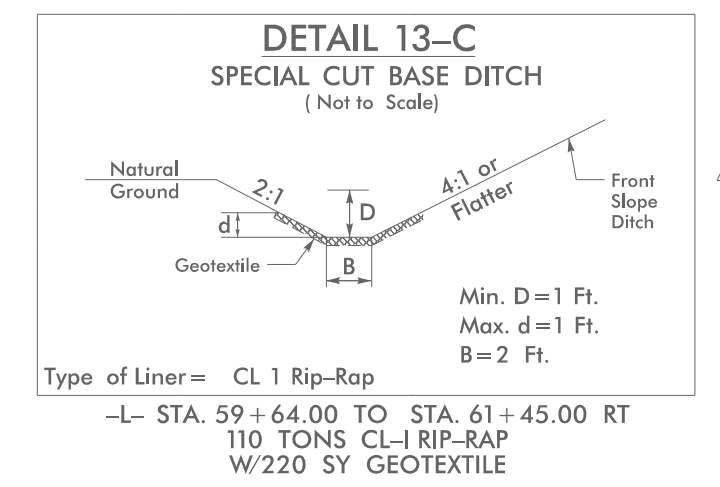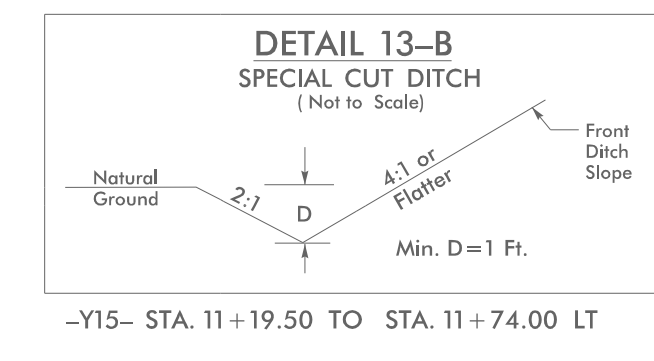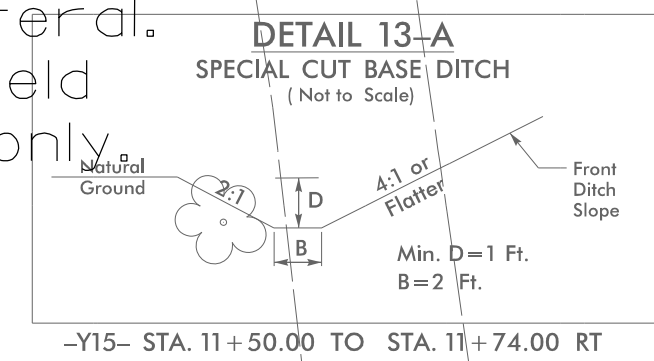

C:\MAR-2013\180\PROJECTS\2015\A2015803\00_Mulkey - U-5839\Design\Utilities\Engineering\UBD01\U-5839_Ut_rdy13_U011_psh.dgn