

PROJECT TYPICAL DETAILS

PROJECT REFERENCE NO. SHEET NO. R-2577A UC-3B

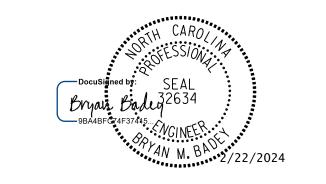



UTILITY CONSTRUCTION


DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

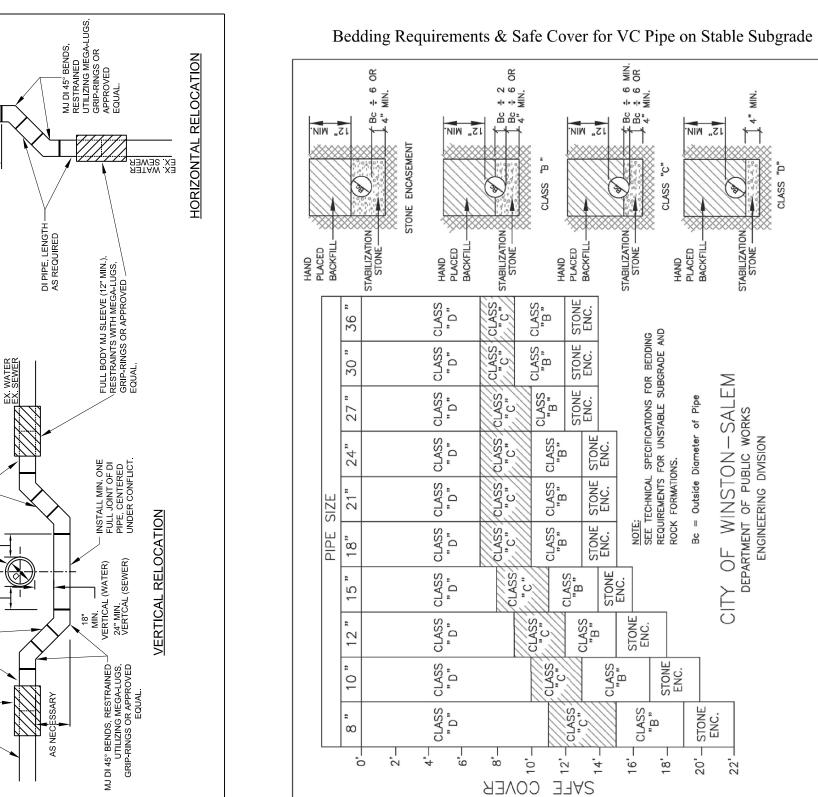


R:\Data\Utility\Utility Spec Drawings\bedding requirements.dwg

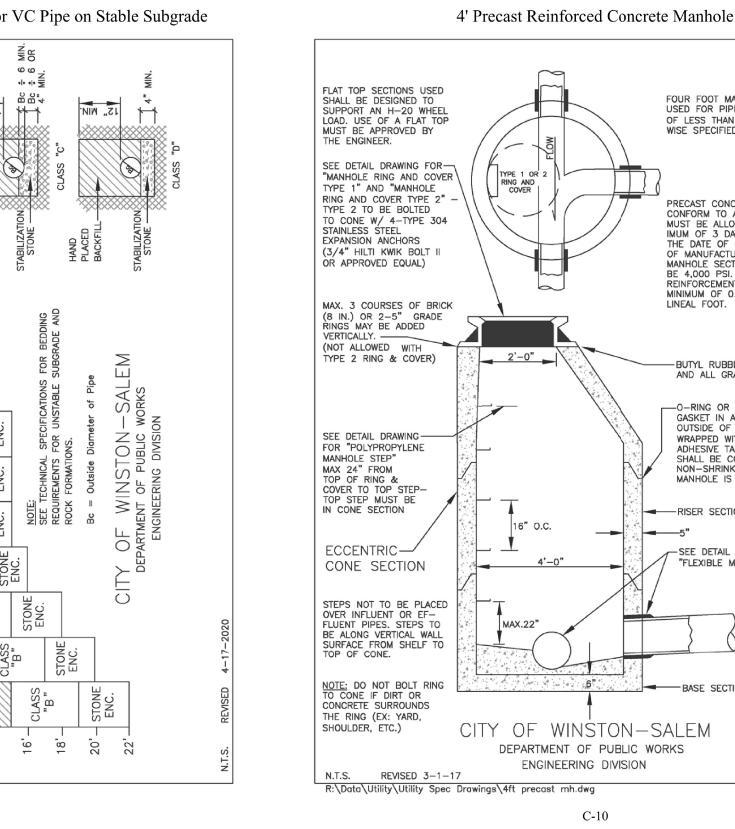


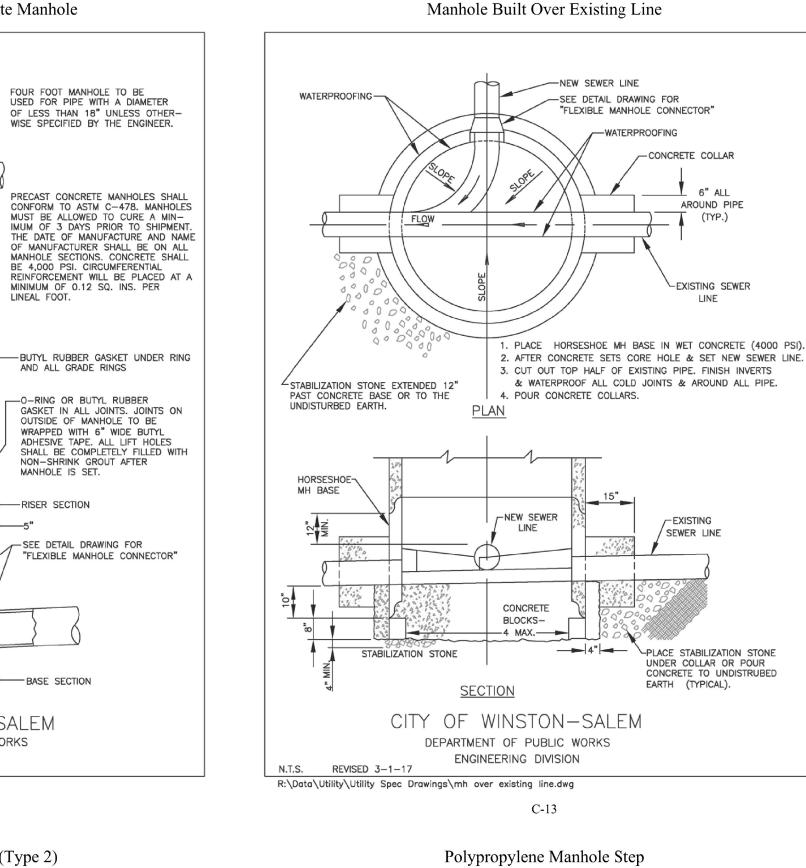

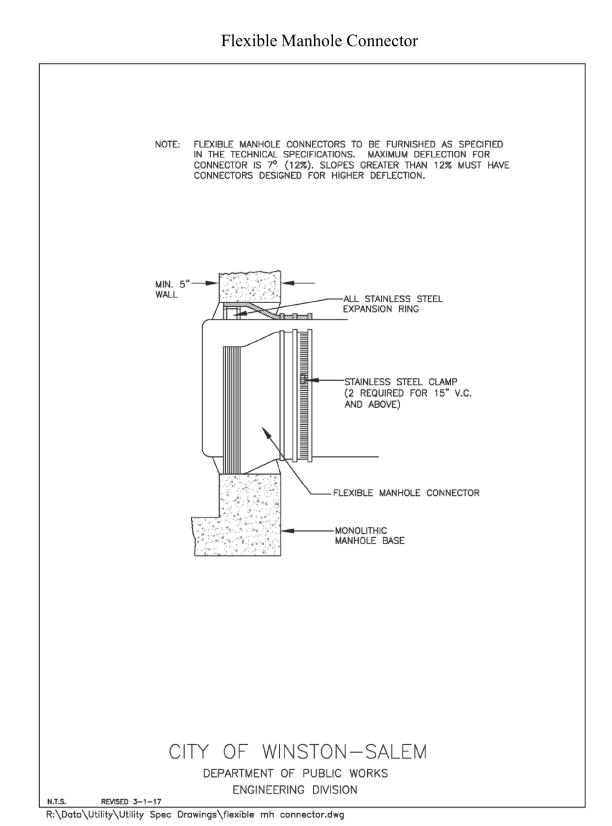

PIPE RELOCATION FOR VERT. & HORIZ. ADJUSTMENTS DETAIL D-1

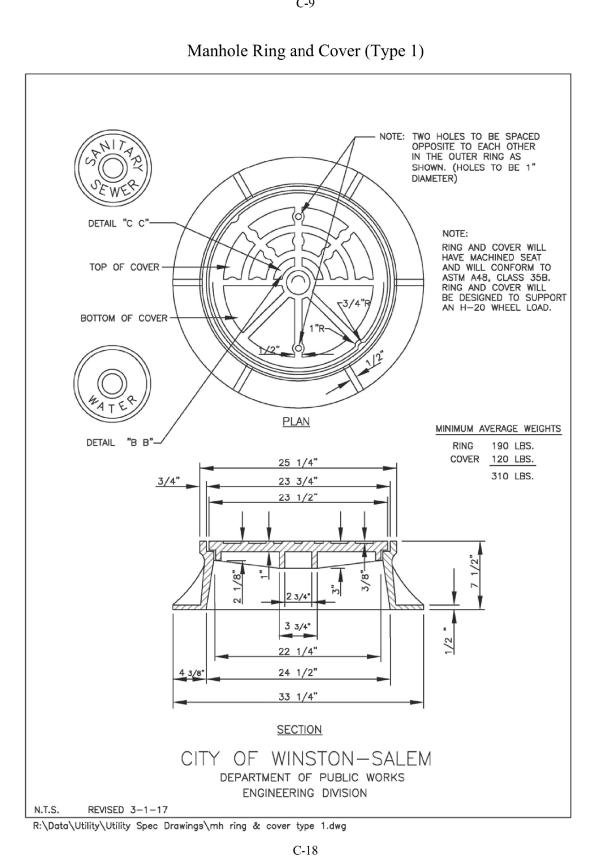

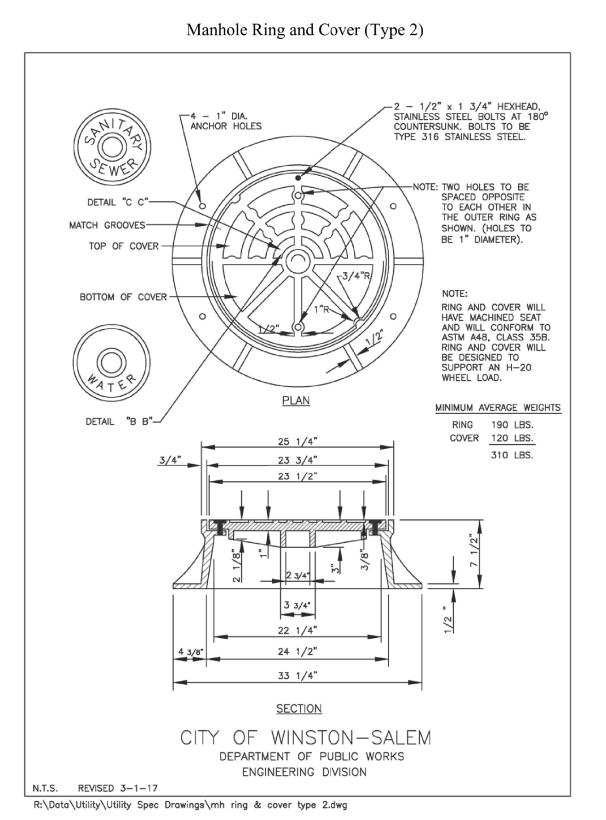

DEPARTMENT OF PUBLIC WORKS

ENGINEERING DIVISION


FOUR FOOT MANHOLE TO BE USED FOR PIPE WITH A DIAMETER

OF LESS THAN 18" UNLESS OTHER-WISE SPECIFIED BY THE ENGINEER.

RISER SECTION

SEE DETAIL DRAWING FOR "FLEXIBLE MANHOLE CONNECTOR"

16" O.C.

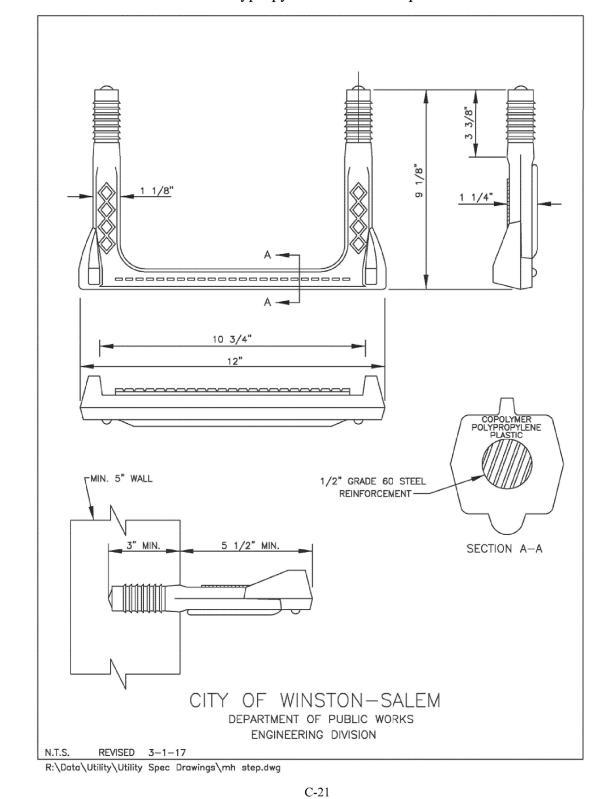



C-17

C-19