PROJECT REFERENCE NO.	SHEET NO.
R-2577A	UC-15
R/W SHEET NO.	

NORTH CAROLINA PROFESSIONAL SEAL 032634 ENGINEER BRYAN M. BADEY
DocuSigned by: Bryan Badey 2/22/2024

UTILITY CONSTRUCTION PLANS

DOCUMENT NOT CONSIDERED FINAL UNLESS ALL SIGNATURES COMPLETED

NOTE:
THE ESTIMATED QUANTITY OF DUCTILE IRON WATER PIPE FITTINGS ON THIS PLAN SHEET IS 950 POUNDS. THE ACTUAL QUANTITY AND TYPE OF FITTINGS WILL VARY BASED ON FIELD CONDITIONS.

NOTE:
1. INSERTION VALVE LOCATED 91 LF AWAY FROM PROPOSED TIE-IN.

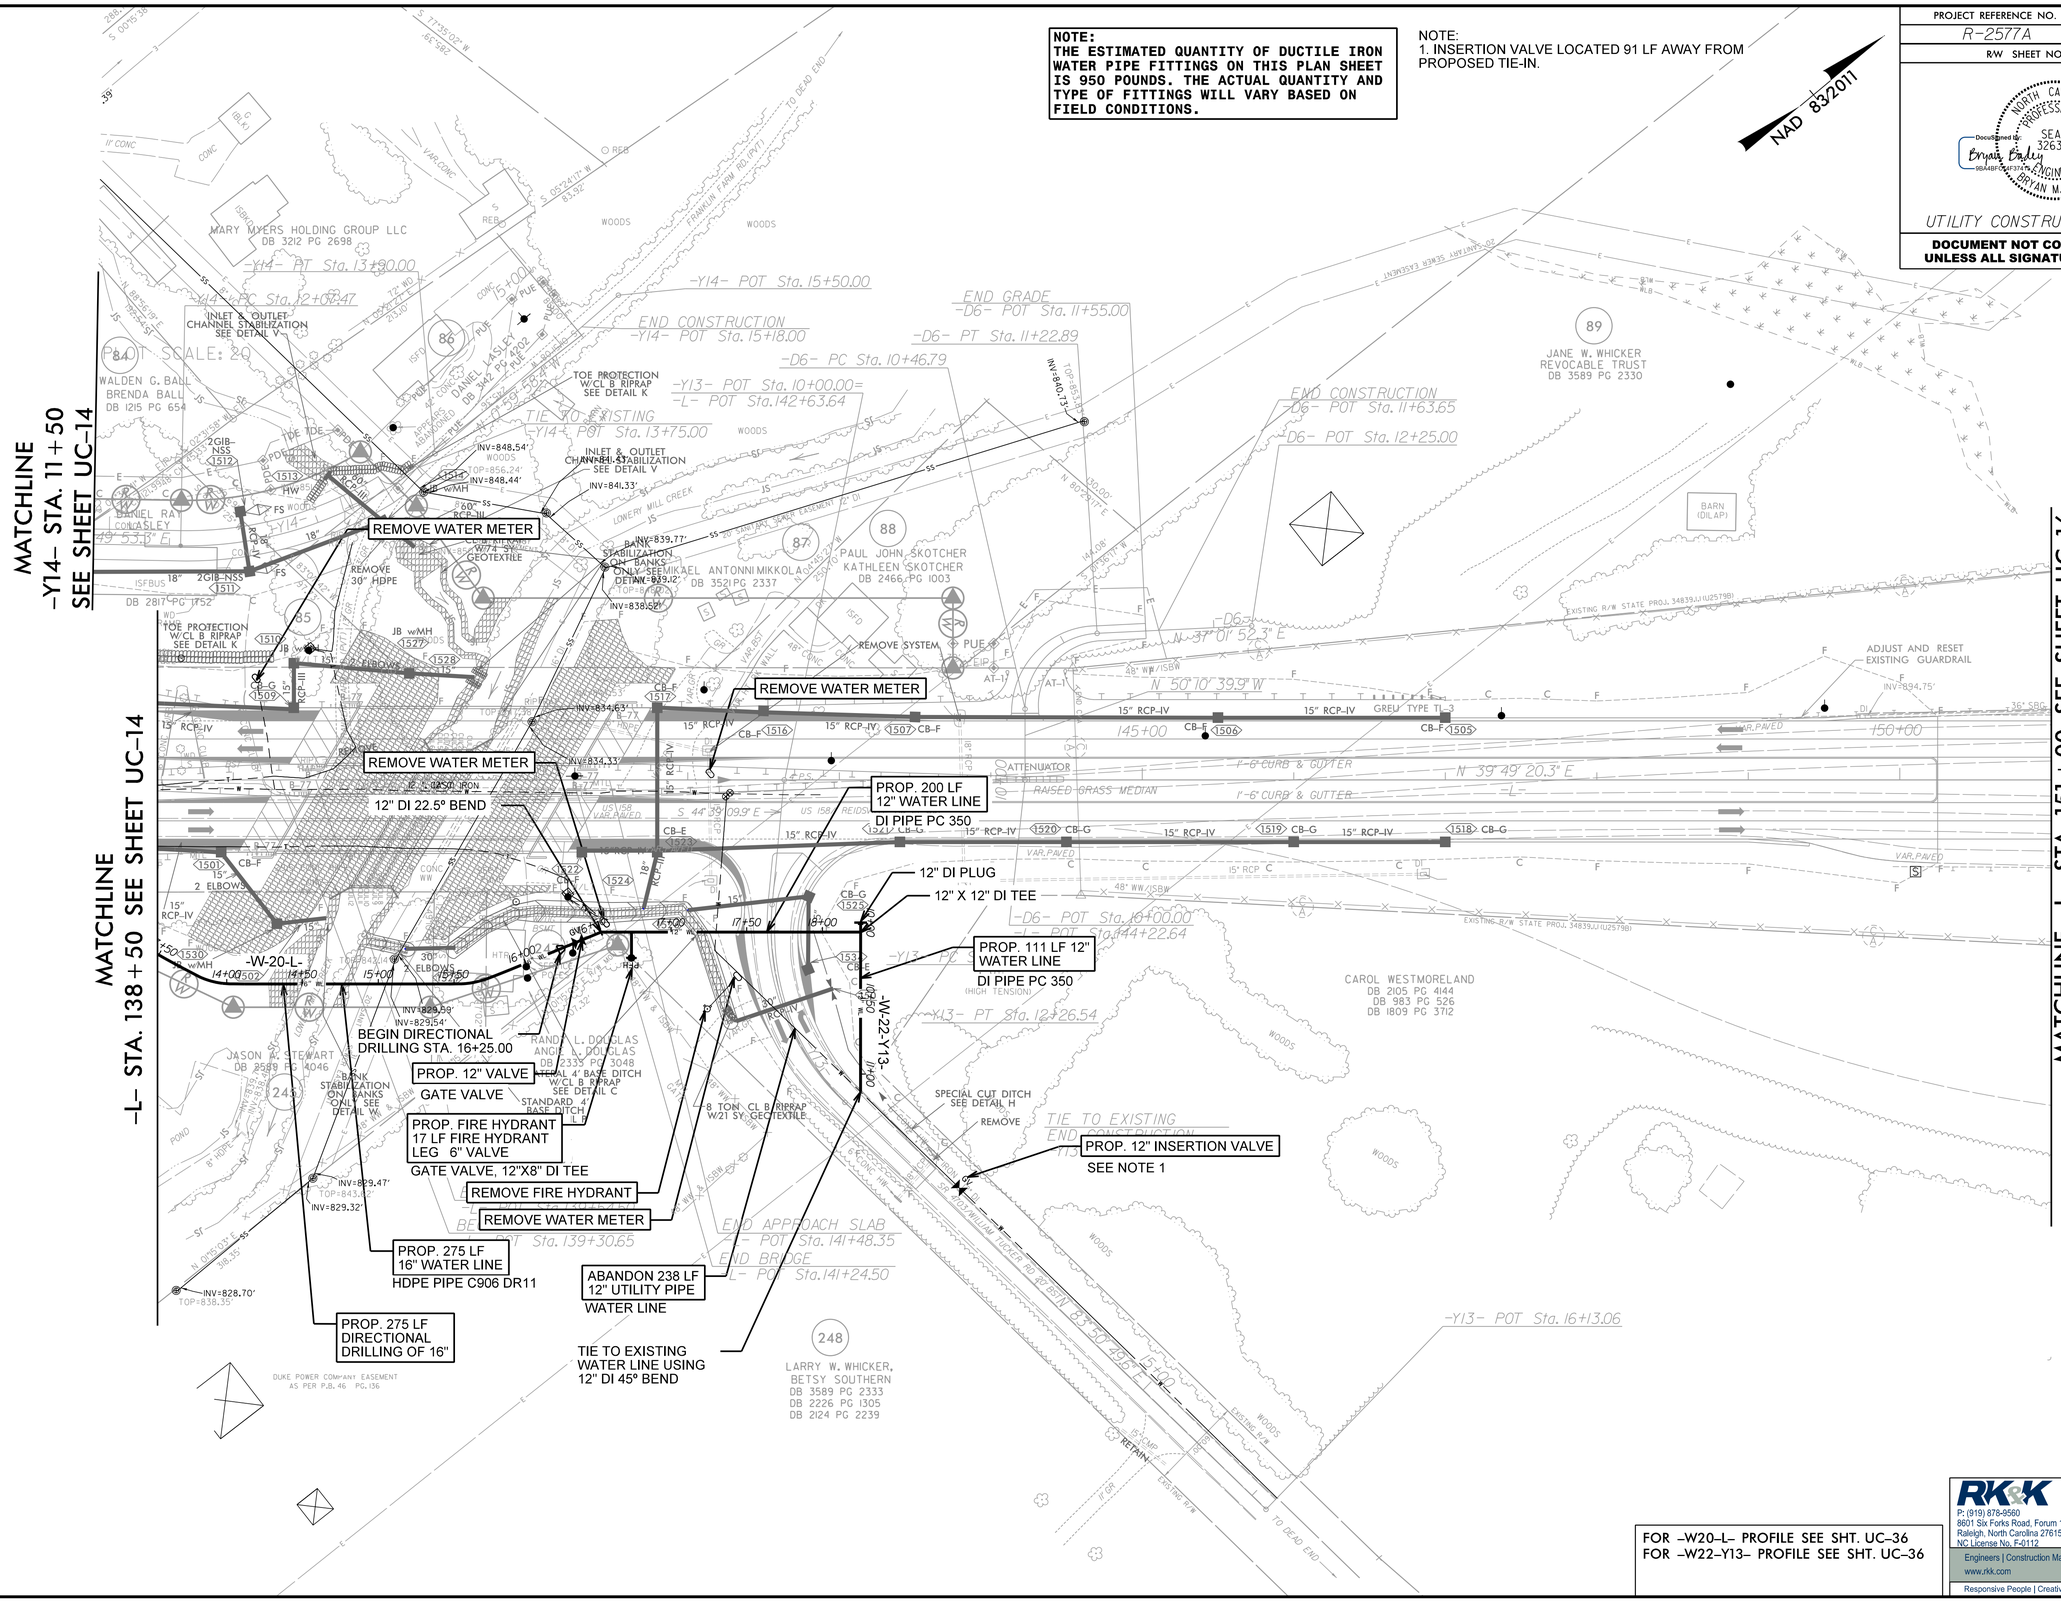

FOR -W20-L- PROFILE SEE SHT. UC-36
FOR -W22-Y13- PROFILE SEE SHT. UC-36

RK&K
P: (919) 878-9560
8601 Six Forks Road, Forum 1,Suite 700
Raleigh, North Carolina 27615-3960
NC License No. F-0112
Engineers | Construction Managers | Planners | Scientists
www.rkk.com
Responsive People | Creative Solutions

8/17/99
2/22/2024
R:\Utilities\Engineering\UC\Proj\R-2577A_rdy15_UC15_psh.dgn
mpowell