
## SEWER TYPICAL DETAILS

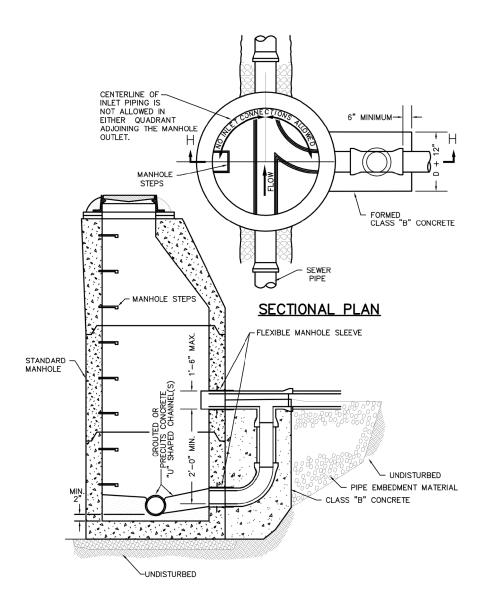


## SECTION H-H


NOTE:


1. DROP CONNECTION IS NOT PERMITTED FOR HIGH VELOCITY SEWER MAINS MAINTAIN MINIMUM OF 8" OF CLEARANCE BETWEEN DROP CONNECTION AND MANHOLE STEPS.


2. BASE FOUNDATION TO CONSTRUCTED LEVEL WITH EXISTING MATERIAL OR CONDITIONED WITH STONE AS REQUIRED BY SPECIFICATIONS

DROP MANHOLE DETAIL

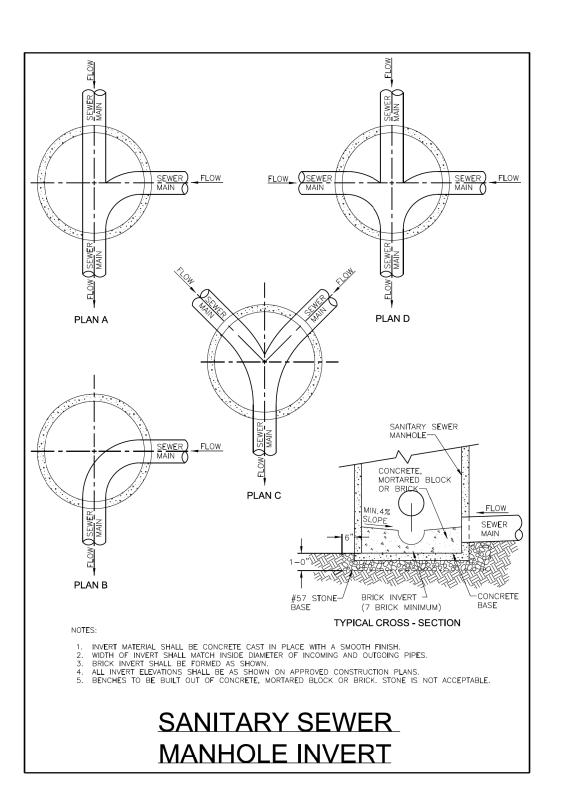

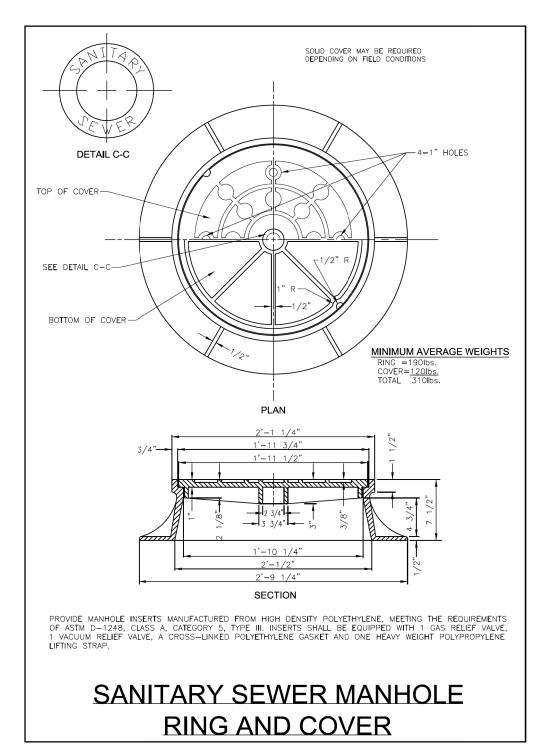

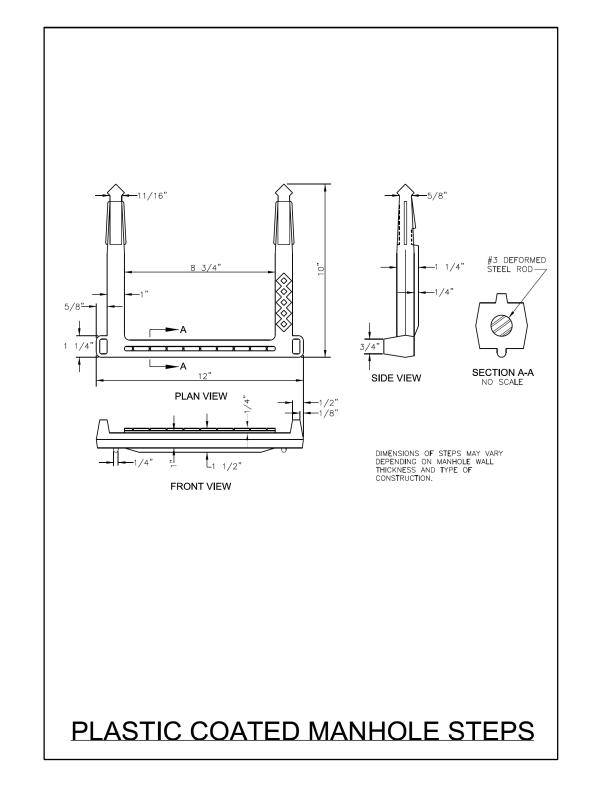

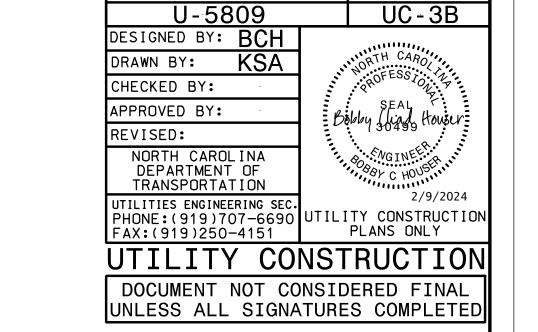

PROJECT REFERENCE NO. SHEET NO.

