


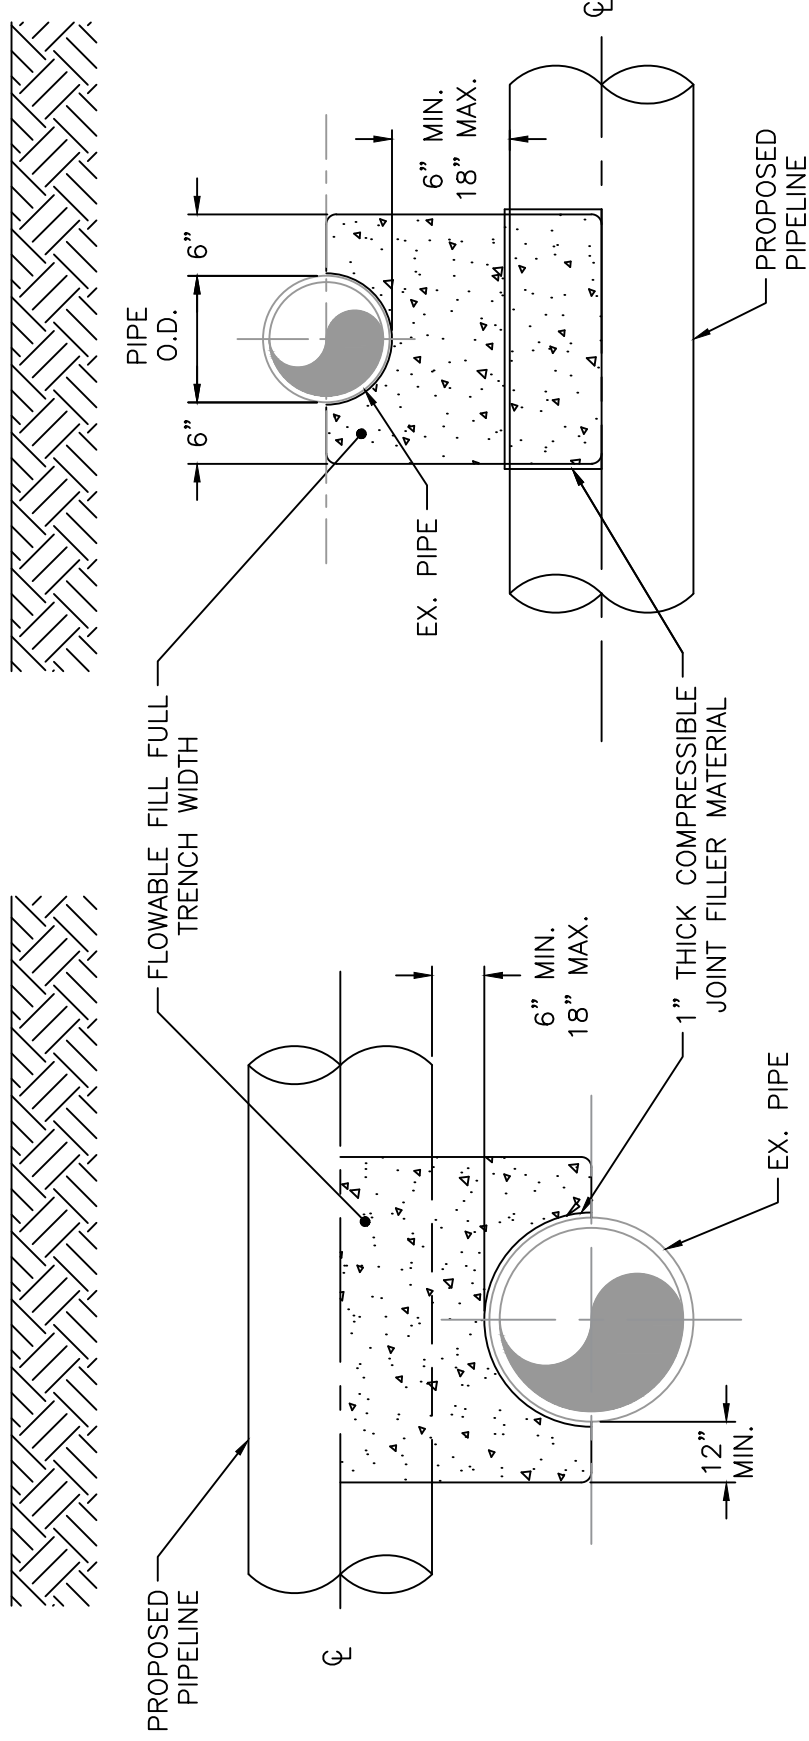

PROPOSED PIPELINE OVER EXISTING PIPE

PROPOSED PIPELINE UNDER EXISTING PIPE

NOTE:
NO ENCASEMENT REQUIRED FOR SPACE
GREATER THAN 18" FOR WATER LINES.