


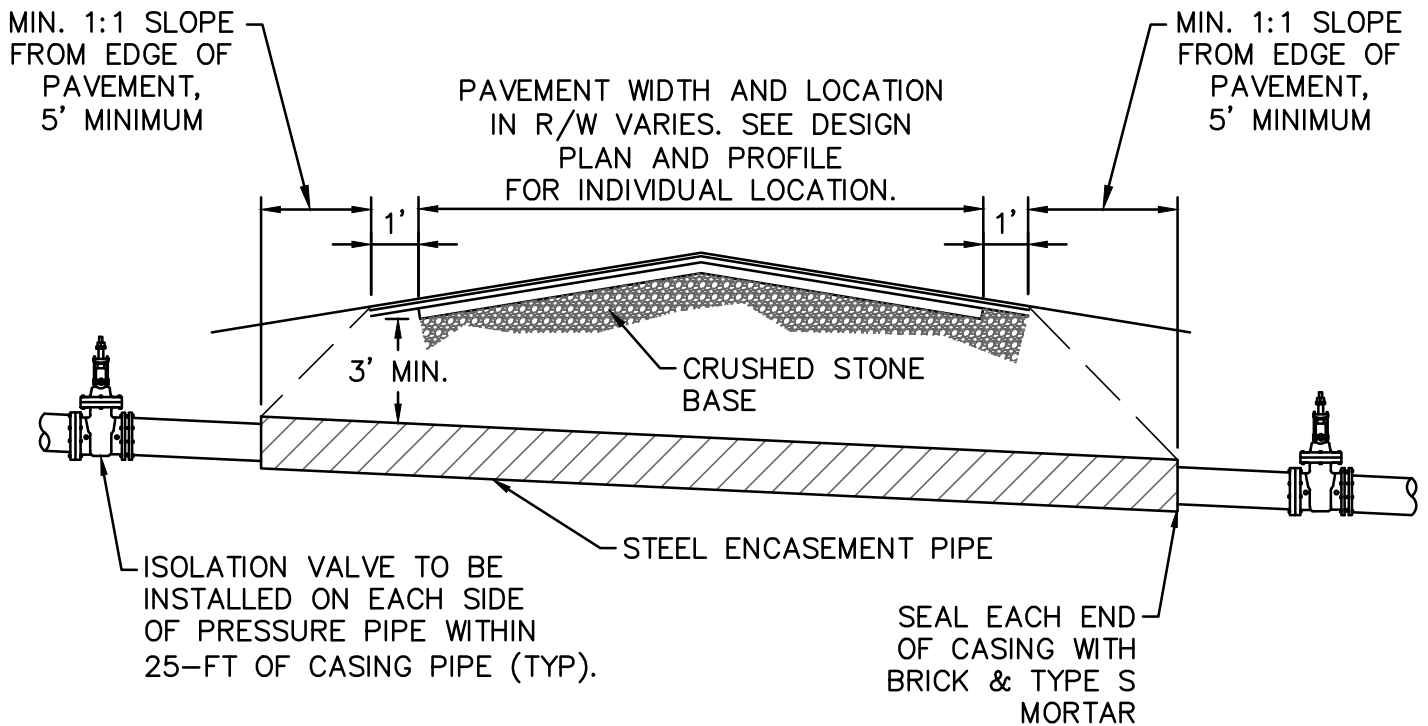

NOTES:

1. CASING WILL BE INSTALLED AT LINE AND GRADE SHOWN ON INDIVIDUAL PROFILE FOR EACH CROSSING. BORING/JACKING TO LINE AND GRADE IS REQUIRED.
2. TRACER WIRE SHALL BE TAPED AT 12' INTERVALS THROUGHOUT THE CASING.
3. PRESSURE AND NON-PRESSURE PIPING THROUGH CASING SHALL BE RESTRAINED JOINT.
4. SEE DETAIL WS-8 FOR PIPE CASING SUPPORT DETAILS.

DETAIL:

TYPICAL BORING & JACKING DETAIL

SCALE: NOT TO SCALE

CFPUA DETAIL DATE:

01/01/2021



CAPE FEAR PUBLIC UTILITY AUTHORITY
235 GOVERNMENT CENTER DRIVE
WILMINGTON, NC 28403
OFFICE: (910)332-6560

Stewardship. Sustainability. Service.

DETAIL NO:

WS-7

SHEET NO:

-