


INCOMPLETE PLANS
 DO NOT USE FOR R/W ACQUISITION
 PRELIMINARY PLANS
 DO NOT USE FOR CONSTRUCTION

CONST. REV. _____
 R/W REV. _____


RAMP 'A'

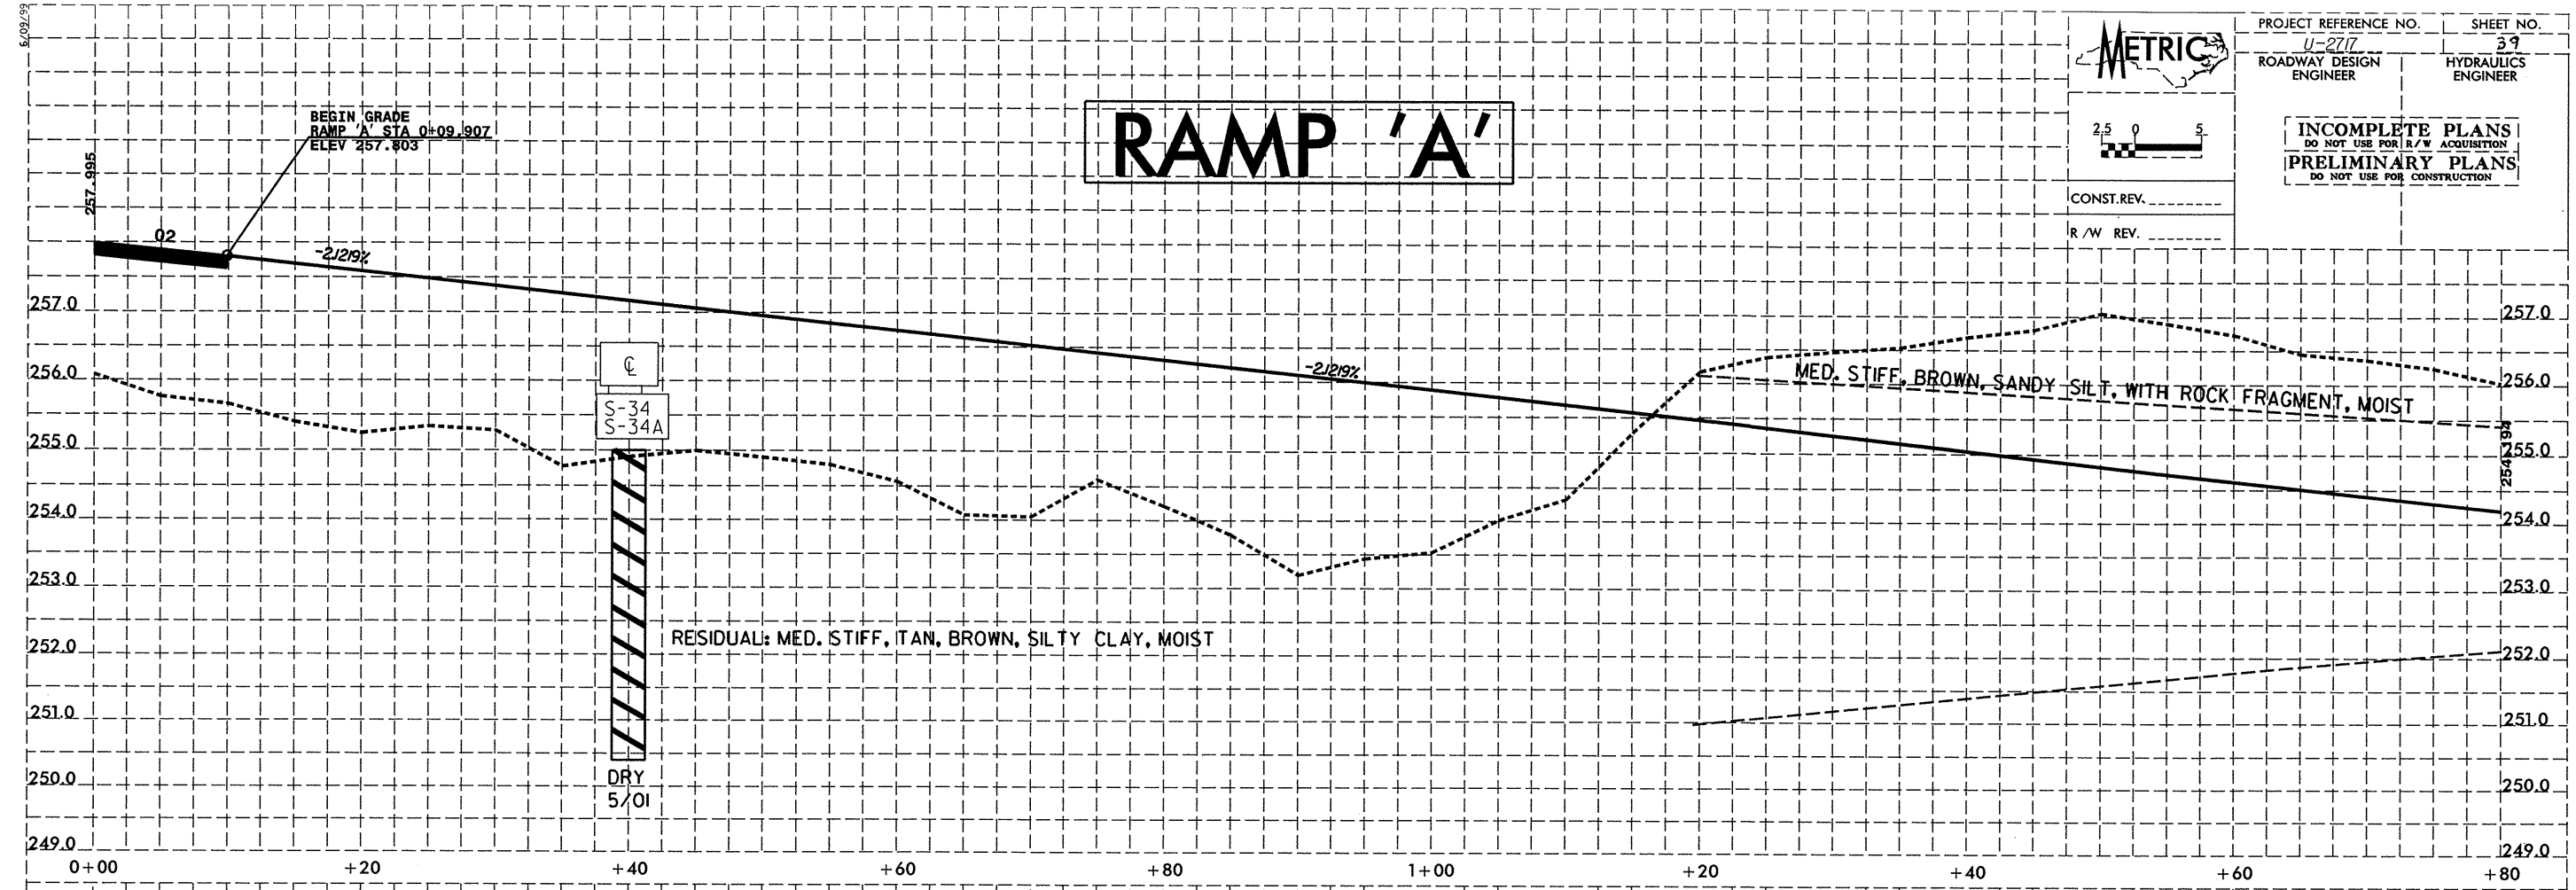

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							G.SAND	F.SAND	SILT	CLAY	10	40	200		
S-34	CL	0+40	0.30-0.50	A-7-61(74)	93	65	0.6	3.9	31.5	63.9	100	100	97		
S-34A	CL	0+40	1.50-1.70	A-7-61(81)	50	25	16.3	19.8	35.1	28.9	100	92	72		
S-35	2M RT	2+20	0.80-1.00	A-7-61(28)	58	36	8.5	20.0	30.3	41.2	100	95	76	31	
S-35A	2M RT	2+20	1.40-1.70	A-7-61(51)	41	12	14.6	38.4	34.6	12.4	100	94	54		
S-35B	2M RT	2+20	2.20-2.40	A-2-41(0)	32	7	42.1	29.1	16.5	12.4	89	63	30		

RAMP 'A'

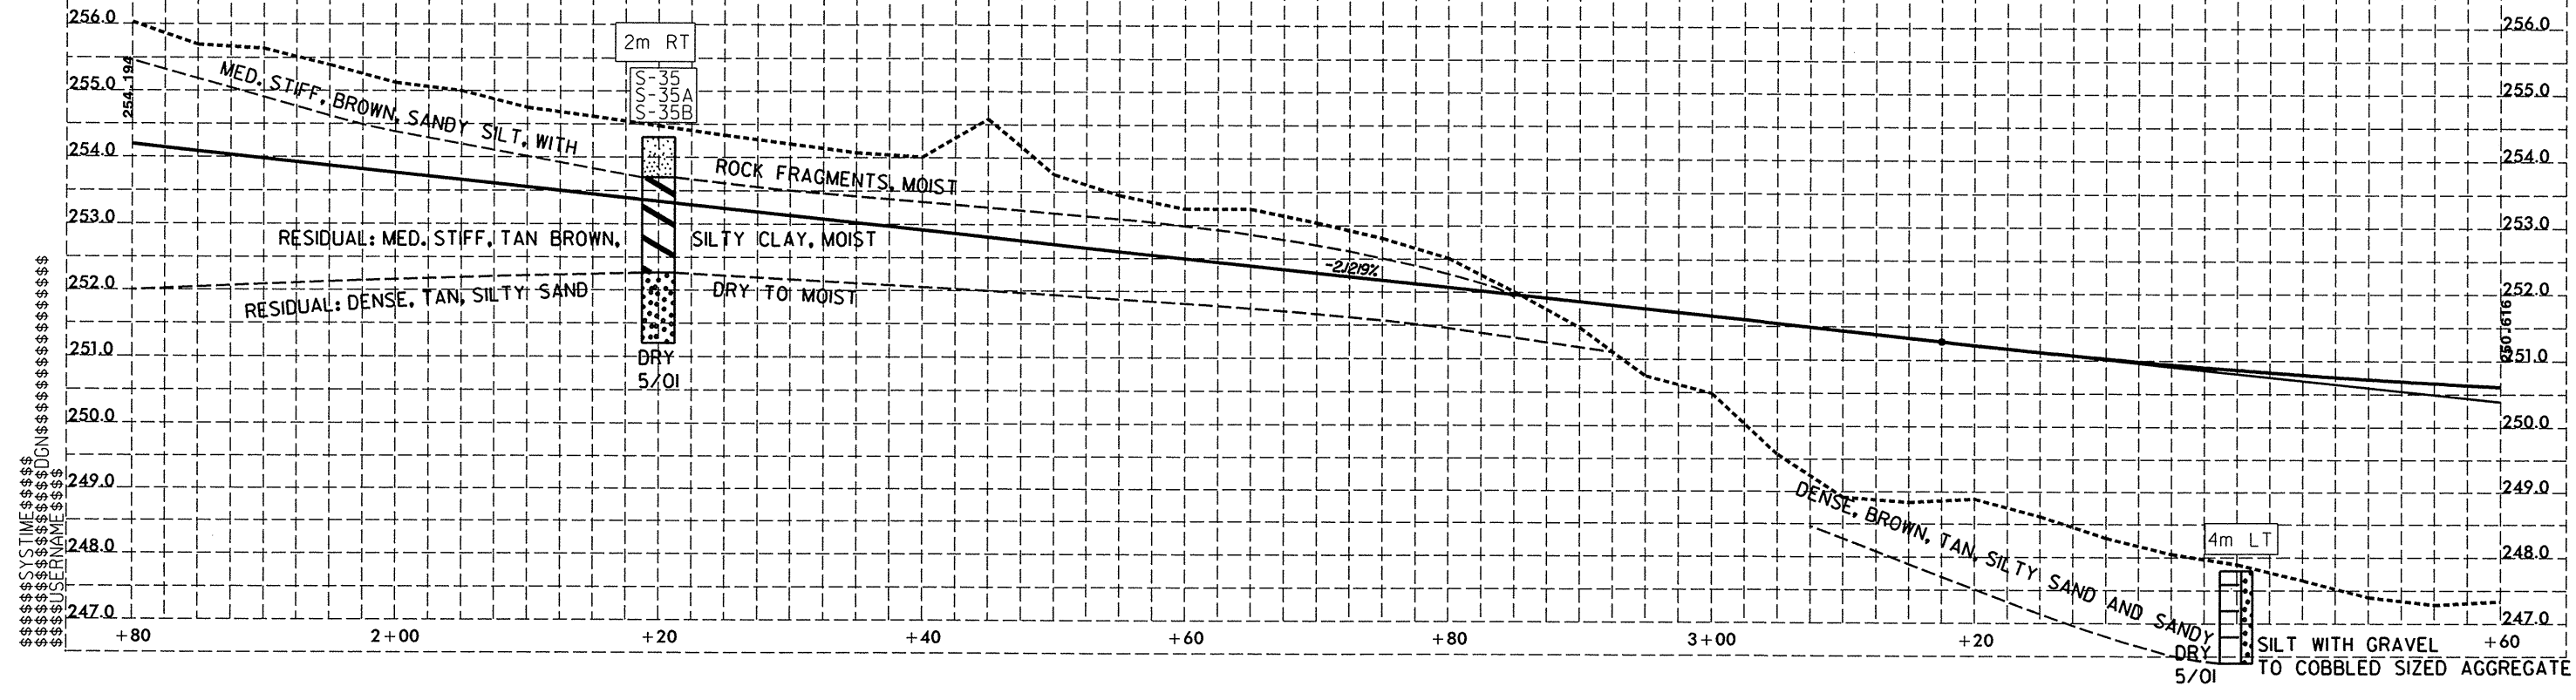

\$\$\$SYSTIME\$\$\$
 \$\$\$DGN\$\$\$
 \$\$\$USE\$\$\$
 \$\$\$NAME\$\$\$