
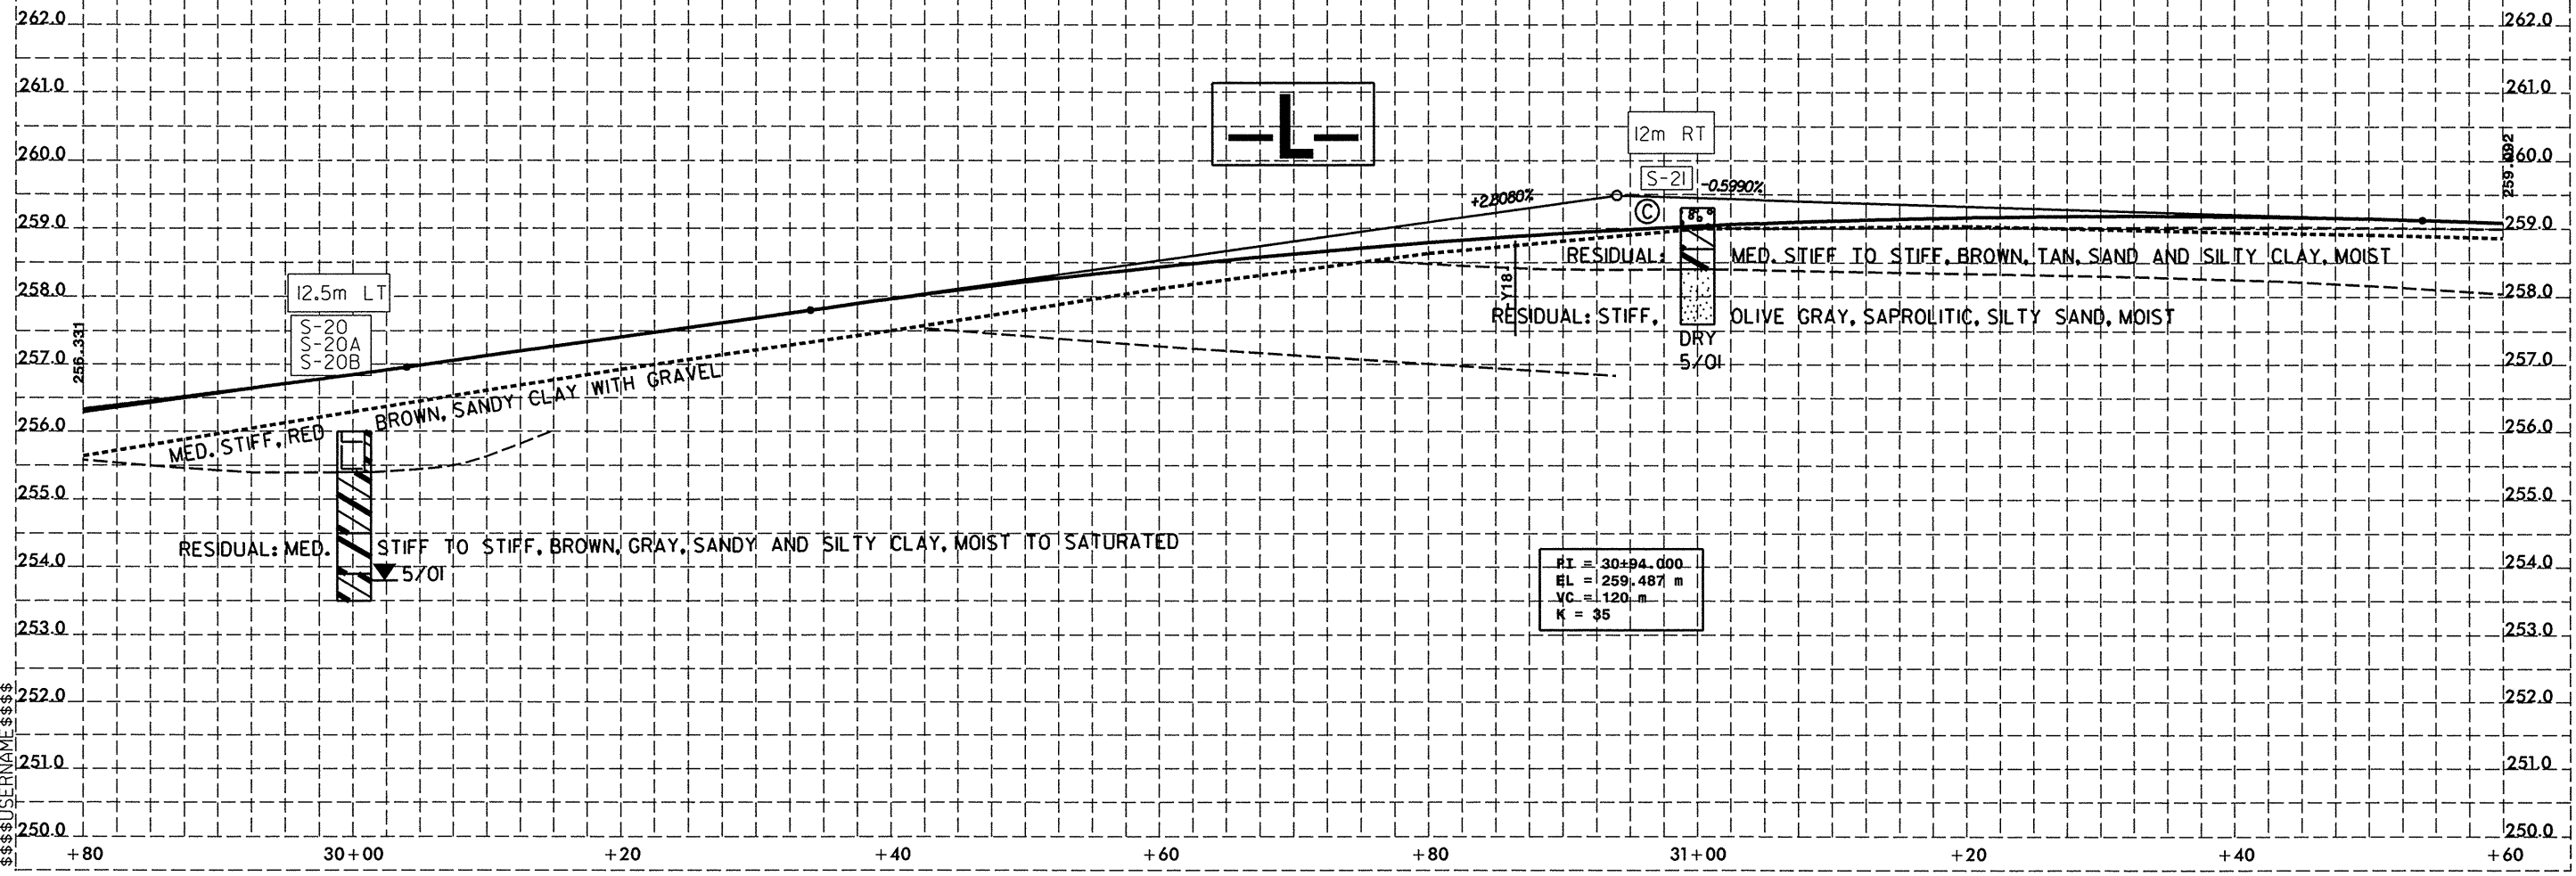


PI = 28+44.000  
 EL = 252.467 m  
 VC = 320 m  
 K = 63

© MED. DENSE. TAN, BROWN, SILTY SAND, MOIST

SOIL TEST RESULTS															
SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			MOISTURE	ORGANIC
							C.SAND	F.SAND	SILT	CLAY	10	40	200		
S-18	4.5M LT	28+00	0.15-0.30	A-7-6(34)	67	42	13.7	11.4	24.7	50.2	99	89	77		
S-18A	4.5M LT	28+00	0.30-0.40	A-7-6(11)	48	27	26.7	19.1	22.1	32.1	91	73	53		
S-18B	4.5M LT	28+00	1.70-1.80	A-7-5(15)	48	16	7.0	17.3	41.6	34.1	100	96	81		
S-19	2.5M LT	29+00	0.20-0.30	A-7-6(55)	85	56	4.2	11.2	24.3	60.2	100	98	87		
S-20	12.5M LT	30+00	1.70-1.20	A-6(1)	27	11	30.3	30.3	17.3	22.1	97	81	42		
S-20A	12.5M LT	30+00	1.70-1.80	A-7-6(11)	45	29	23.1	23.9	16.9	36.1	92	79	52		
S-20B	12.5M LT	30+00	2.10-2.20	A-6(5)	38	18	19.3	34.9	23.7	22.1	94	84	49		
S-21	12M RT	31+00	0.60-0.90	A-7-6(53)	83	58	6.4	13.9	21.5	58.2	100	97	83		

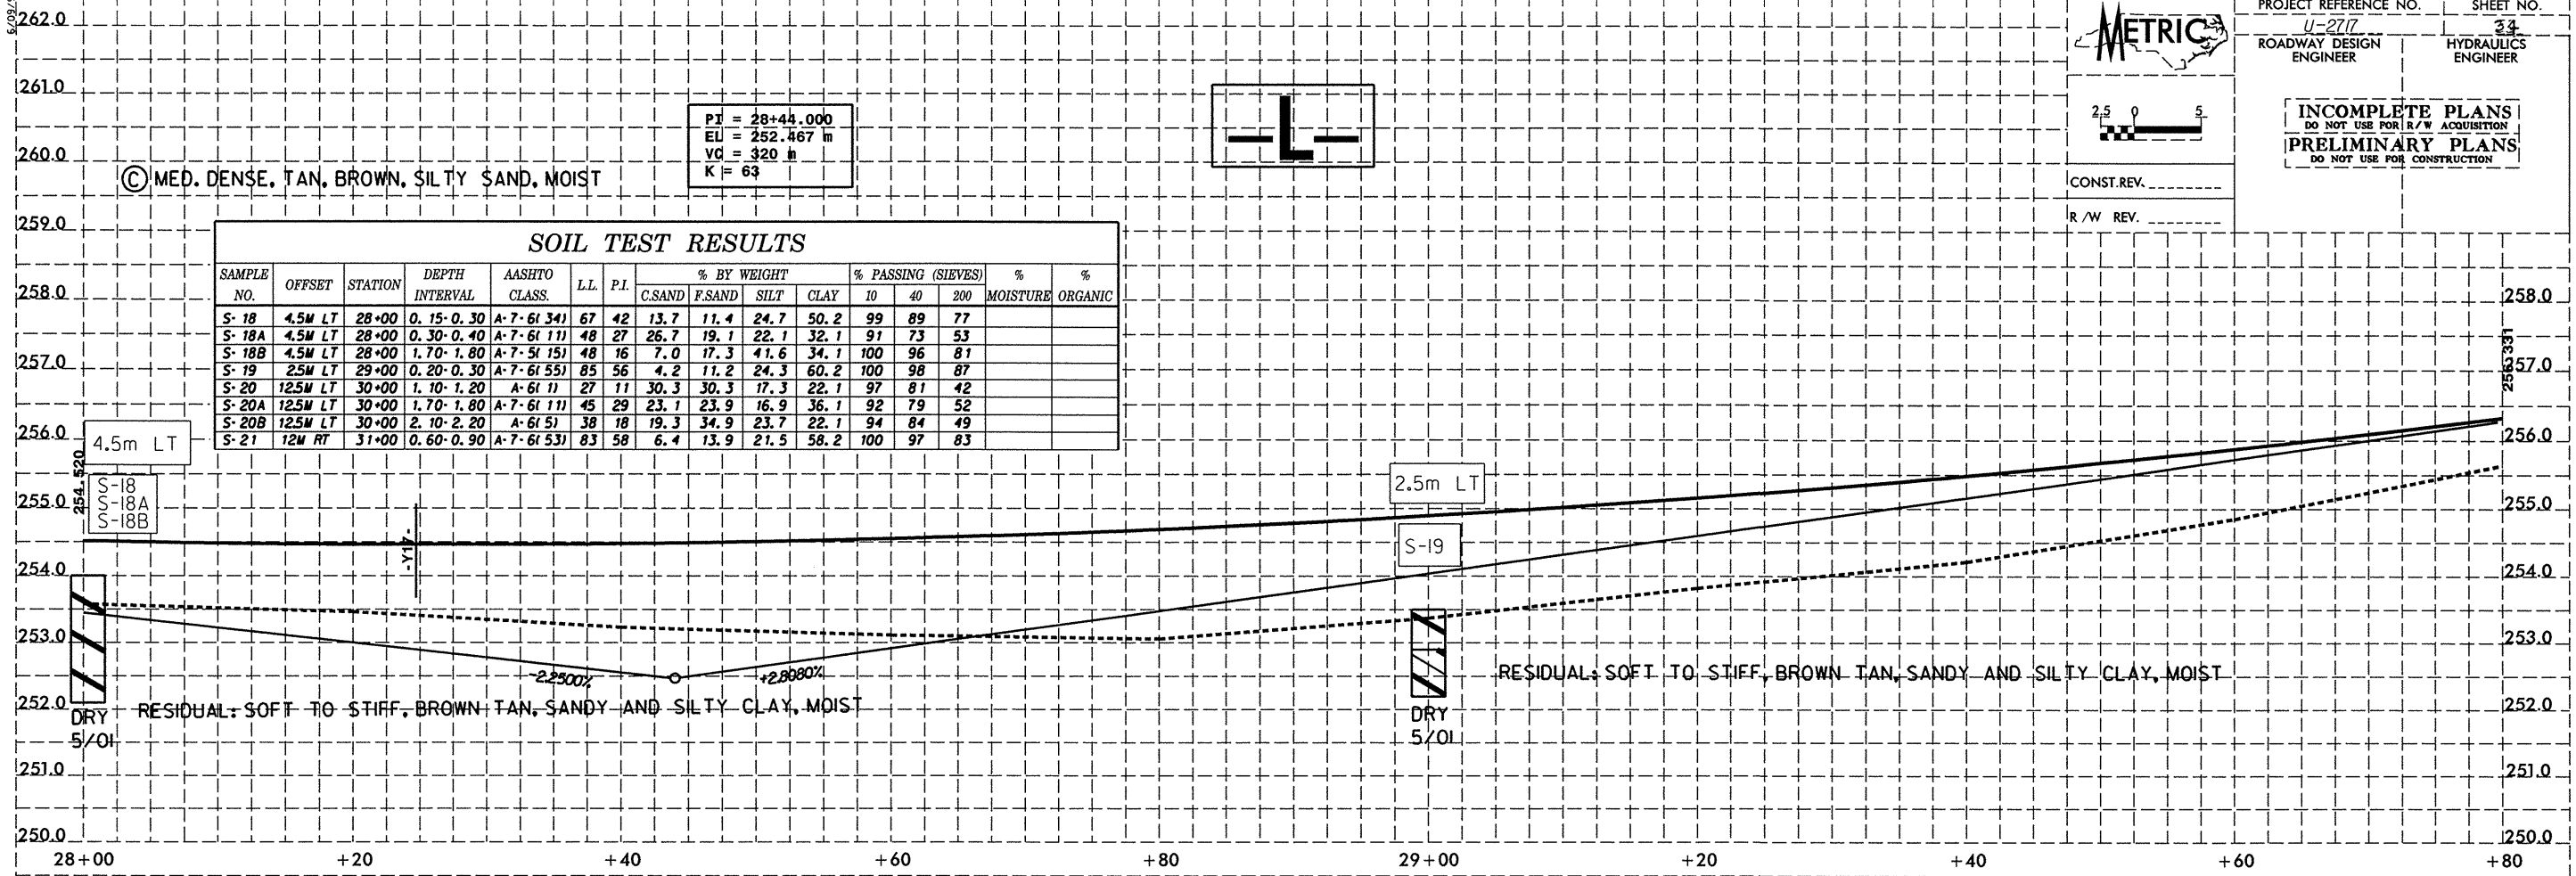

\$\$\$\$SYTIME\$\$\$\$  
 \$\$\$DCN\$\$\$\$  
 \$\$\$NAME\$\$\$\$  
 \$\$\$\$\$\$\$