

### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS 39	7.0 Rt	23+46.2	1.50-1.95	A-7-6(13)	54	33	2.3	48.8	10.5	38.4	100.0	99.5	52.0	23	NS
SS 40	7.0 Rt	23+46.2	5.60-6.05	A-3(0)	23	NP	26.9	65.1	0.0	8.0	99.9	88.2	9.3	23	NS
SS 41	7.0 Rt	23+46.2	13.20-13.65	A-2-6(0)	33	14	70.5	15.1	0.4	14.0	91.0	37.4	17.3	13	NS
SS 42	7.0 Rt	23+46.2	16.20-16.65	A-2-6(1)	31	13	53.9	15.1	10.4	20.6	99.6	82.2	32.3	17	NS
SS 43	7.0 Rt	23+46.2	19.30-19.75	A-7-6(20)	51	22	5.5	15.8	30.8	47.9	99.2	96.4	82.0	17	NS

DESCRIPTION:  
US 74 FROM SR1003  
TO I-95



PROJECT NO.: 6.469002T  
SHEET NO. 112

TIP NO.: R-0513C


COUNTY: ROBESON

PREPARED BY:

**CAELIN**

ENGINEERS and SCIENTISTS  
WILMINGTON, NORTH CAROLINA

DATE: 06/00




CONST. REV. \_\_\_\_\_  
RW REV. \_\_\_\_\_

ROADWAY DESIGN ENGINEER  
HYDRAULICS ENGINEER

**PRELIMINARY PLANS**  
DO NOT USE FOR CONSTRUCTION

**INCOMPLETE PLANS**  
DO NOT USE FOR R/W ACQUISITION

TGS  
ADAPTED FROM:  
TGS ENGINEERS  
975 WALNUT STREET  
CARY, NC 27511  
PH (919) 319-8850

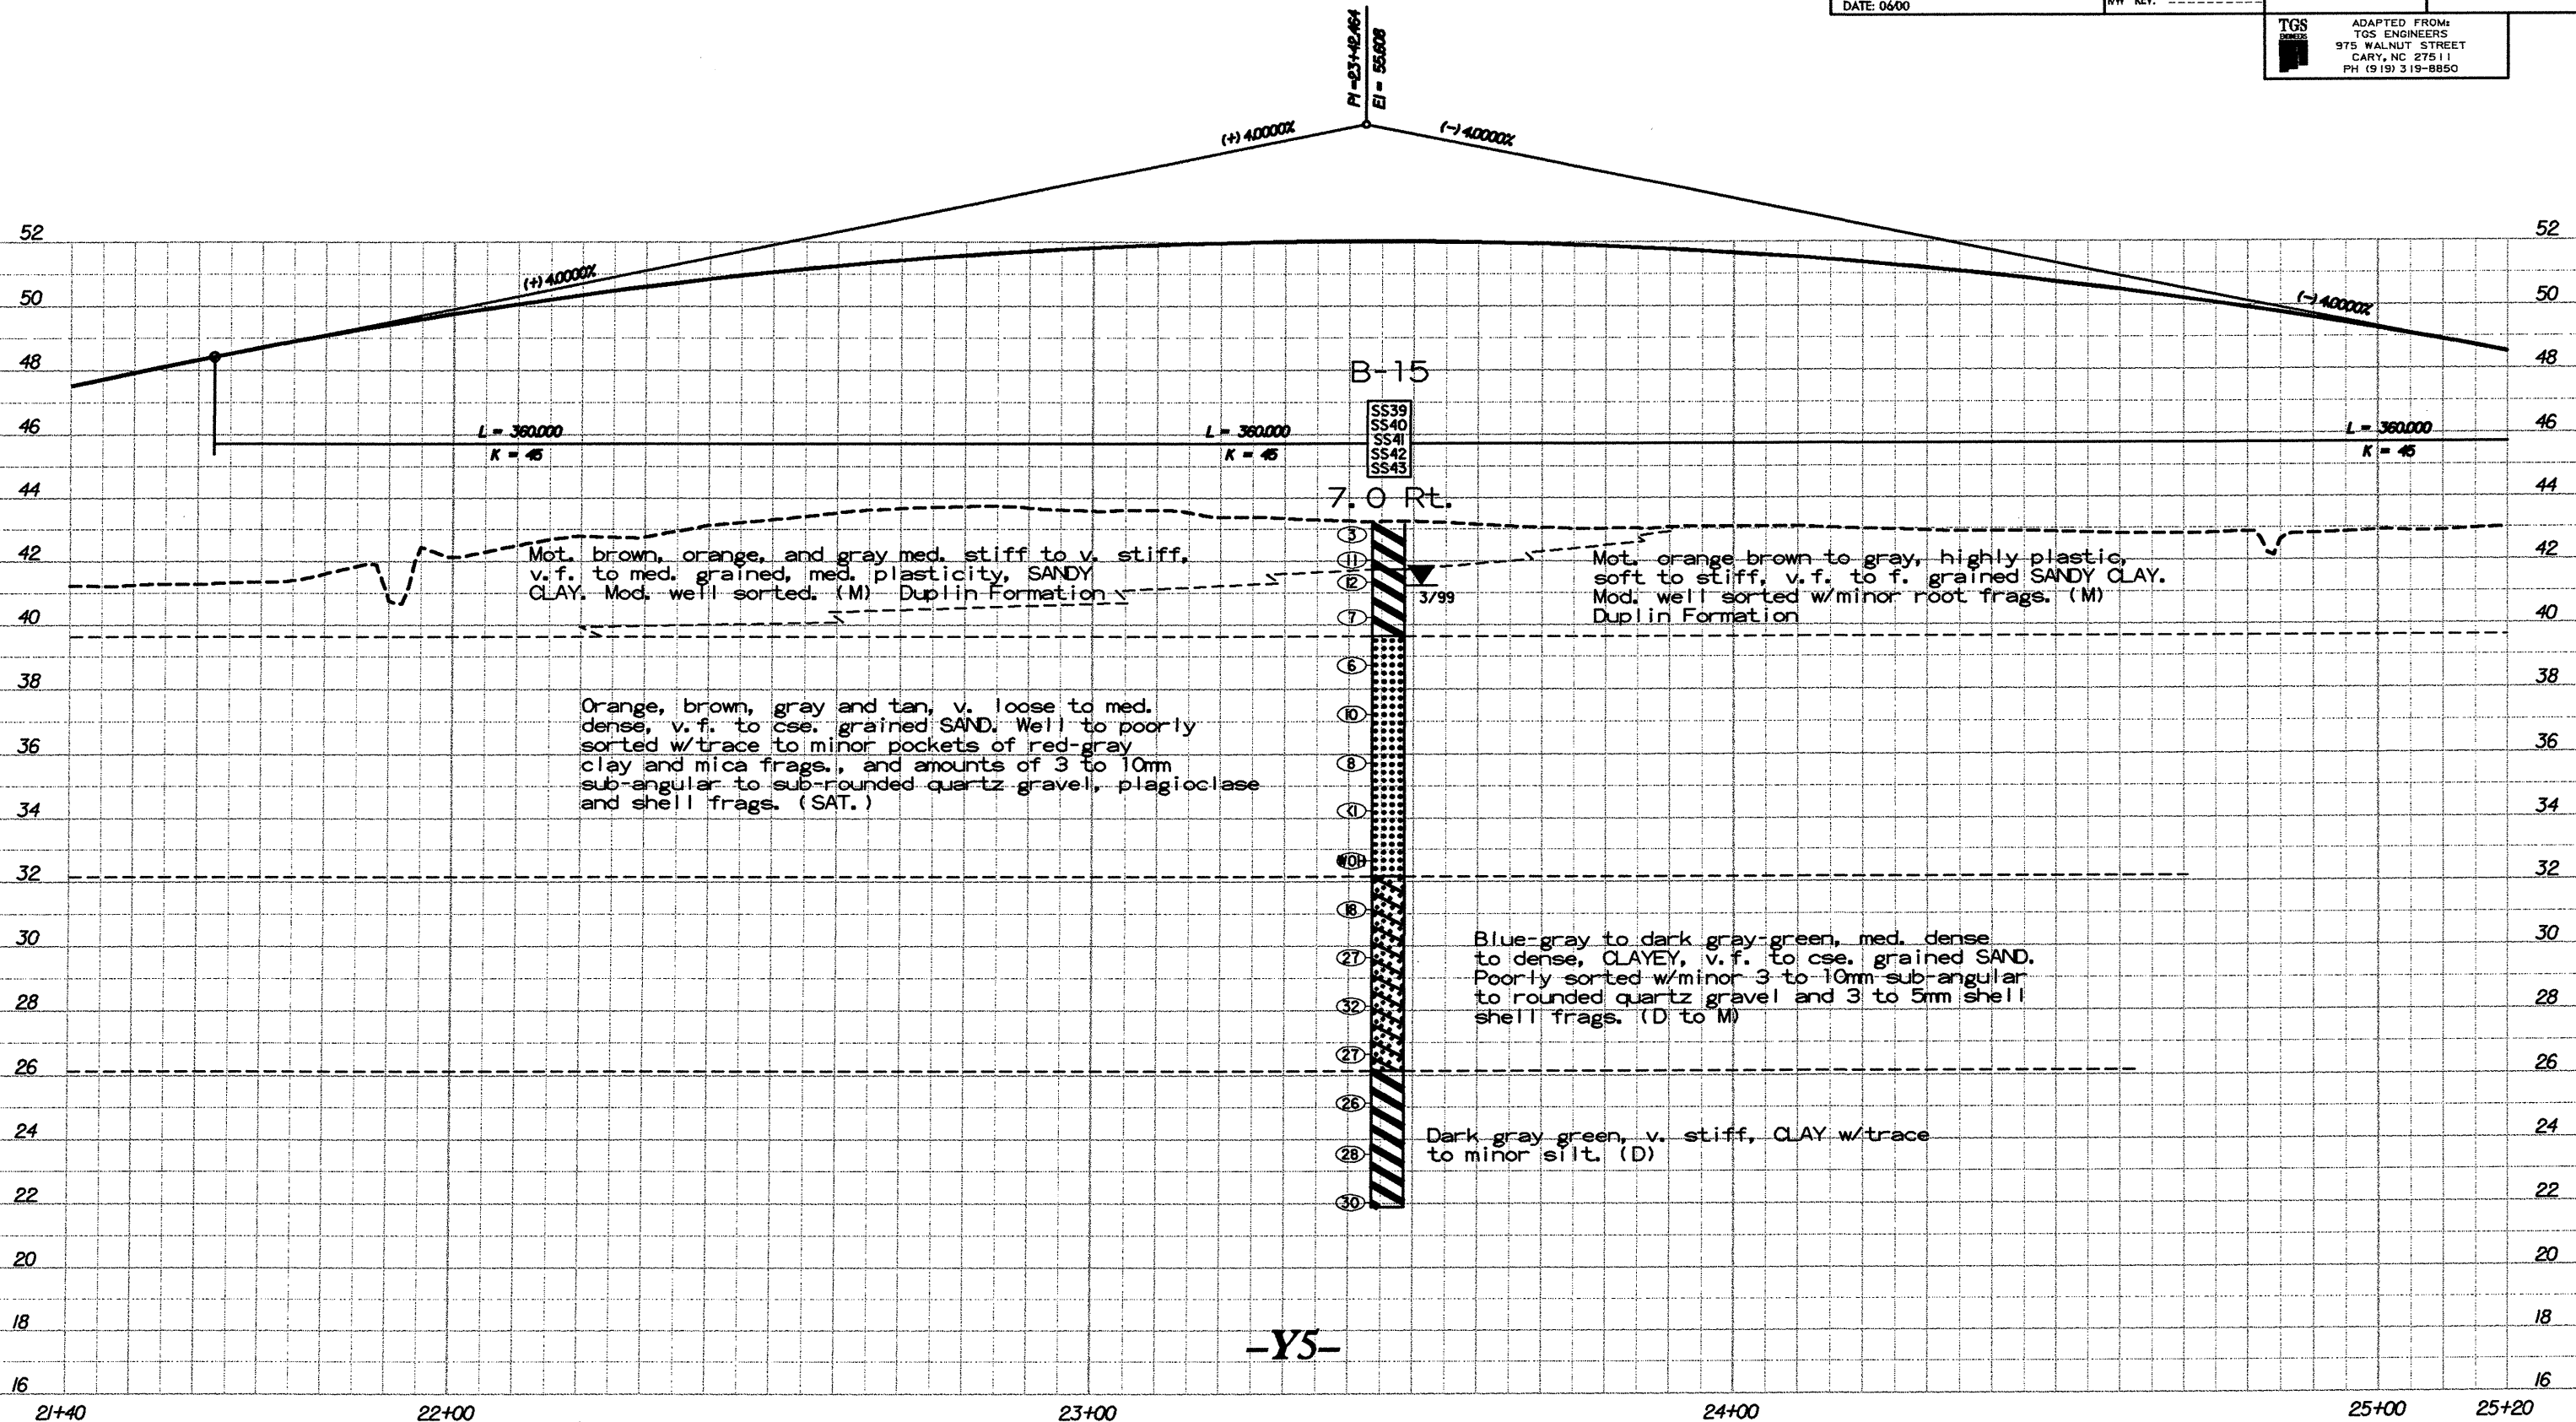

P1012.DGN