



10/22/99



SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-9	CL	28+60	0.00-2.00	A-6(3)	26	11	22.1	25.1	22.6	30.2	99	86	57	-	-
SS-8	20M RT	28+80	2.84-2.96	A-2-4(0)	22	NP	50.1	29.7	14.2	6.0	95	62	25	-	-

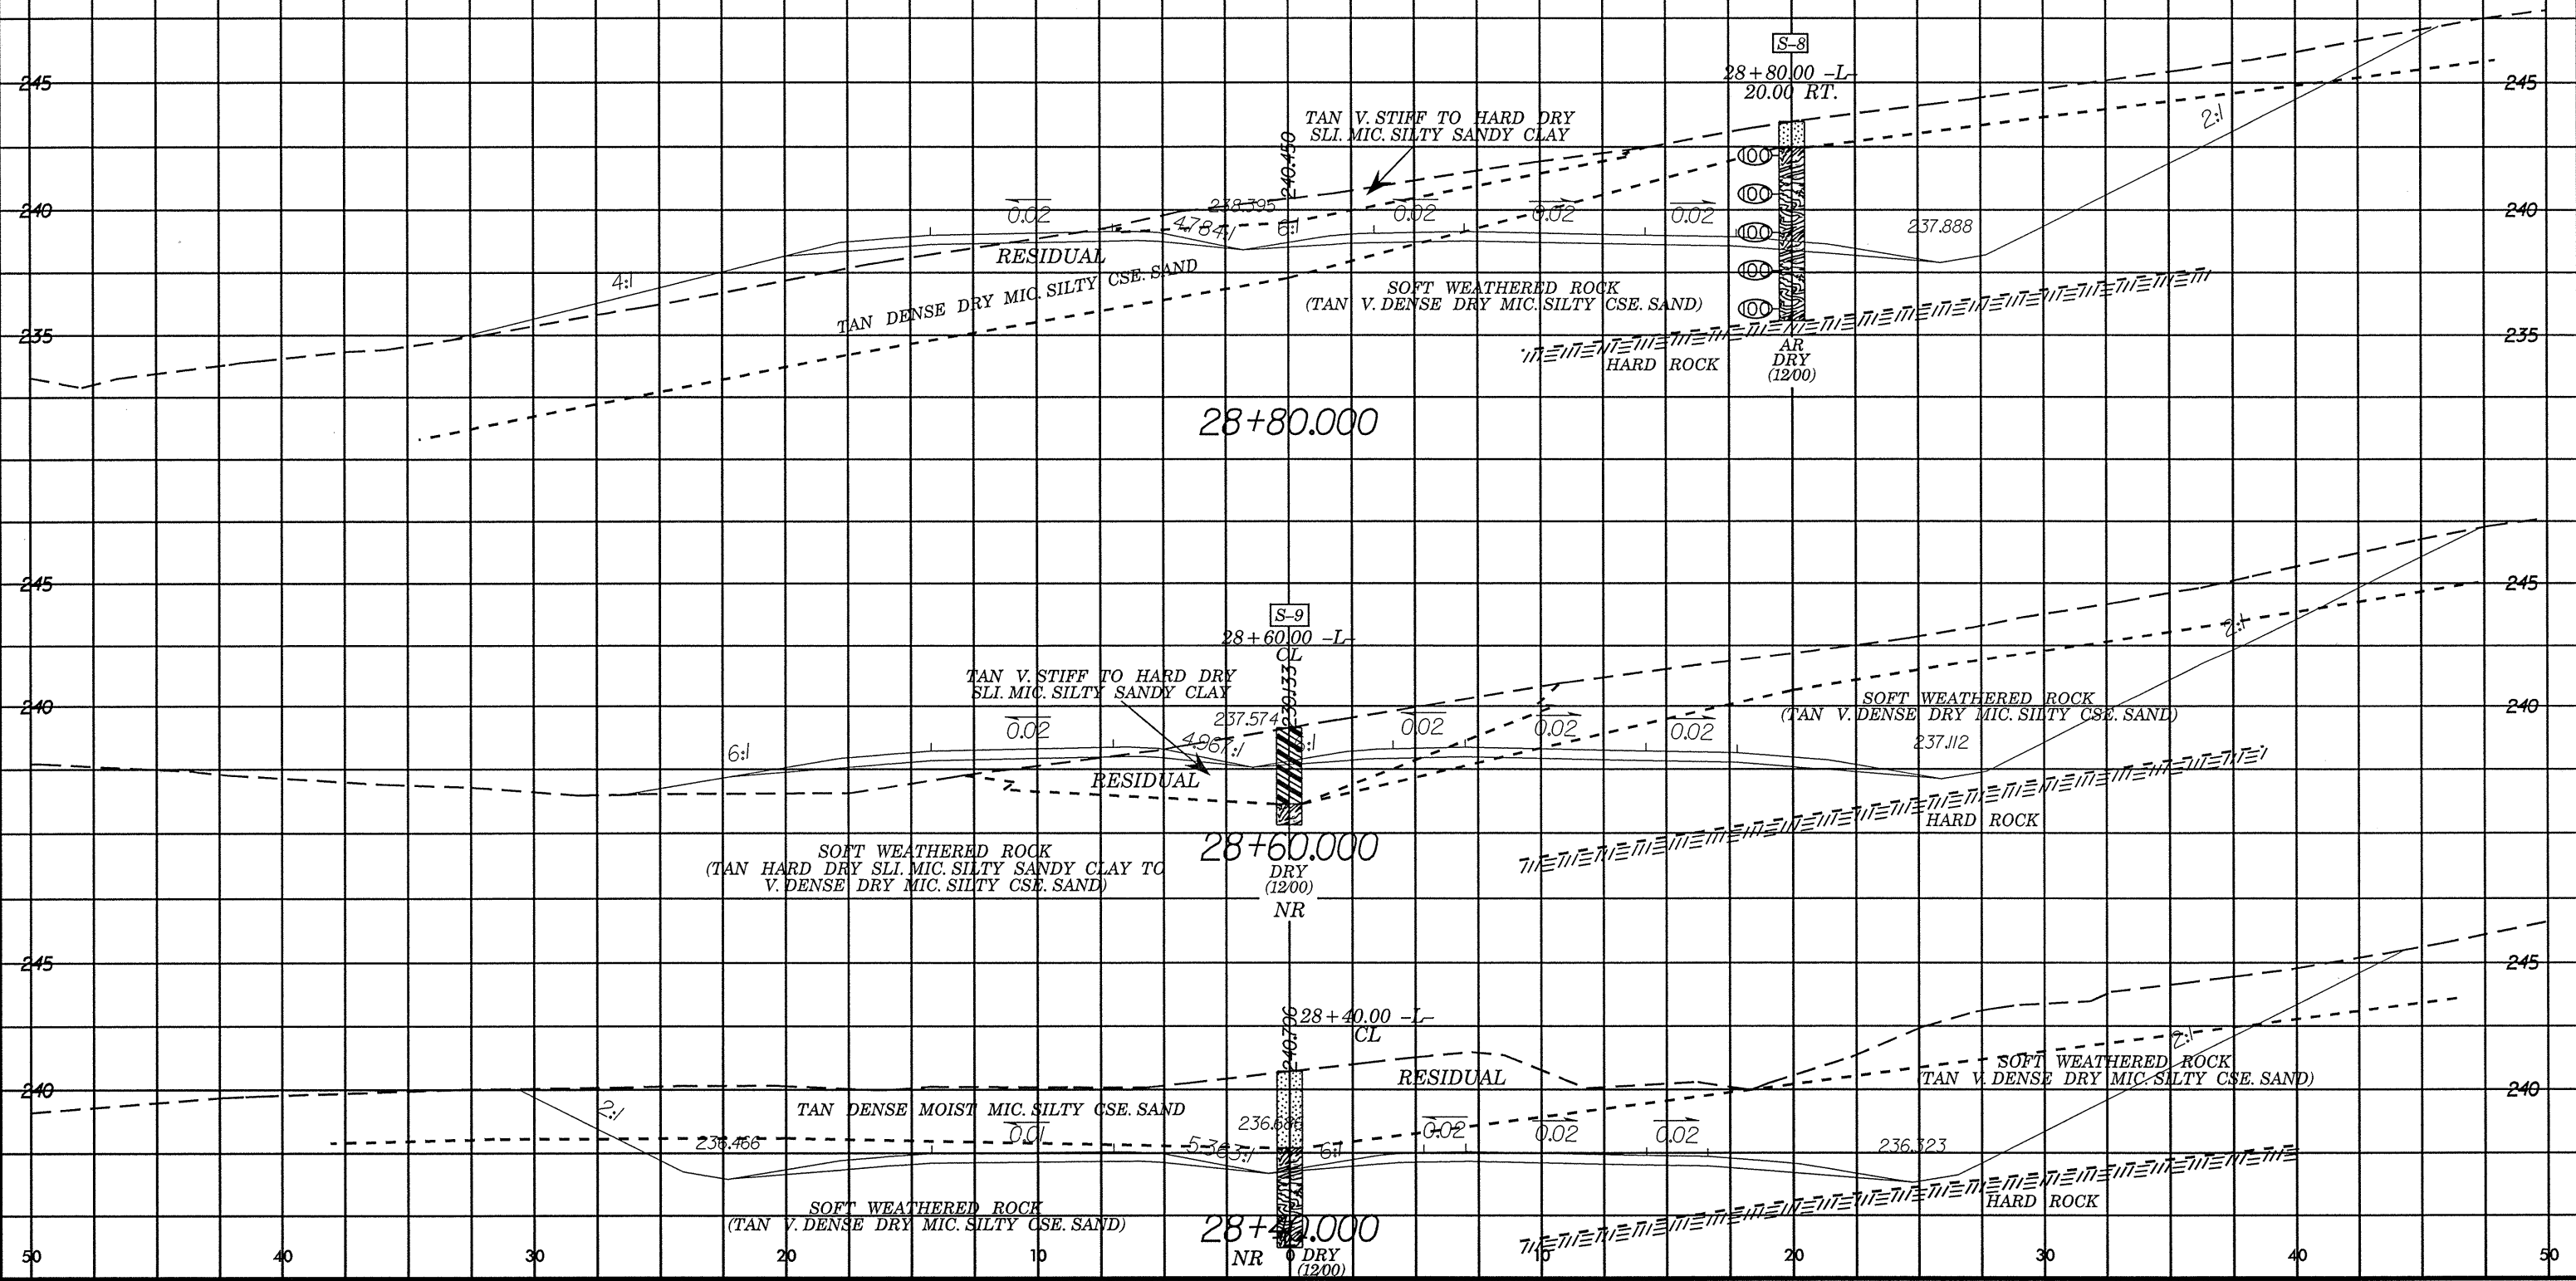

SYSTEM TIME *****

USER NUMBER *****