

ALL WATER LINES OWNED BY DAVIDSON WATER INC.

PROP. 1 - REMOVE EXISTING WATER METER

PROP. 340M OF 200MM DI WATER PIPE, PC 2.41 MPA WP
 3 - 200MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 CONNECT USING NECESSARY FITTINGS


PROP. 63M OF 200MM DI WATER PIPE, PC 2.41 MPA WP
 1 - 200MM X 200MM DI TEE
 1 - 200MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 1 - 200MM 11 1/4° DI BEND
 CONNECT USING NECESSARY FITTINGS

PROP. 78M OF 150MM PVC WATER PIPE, SDR 21, 1.38 MPA WP
 1 - 200MM X 150MM DI TEE
 1 - 150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 CONNECT USING NECESSARY FITTINGS

PROP. 142M OF 150MM PVC WATER PIPE, SDR 21, 1.38 MPA WP
 1 - 200MM X 150MM DI TEE
 1 - 150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 2 - 150MM 45° DI BENDS
 CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING 50MM WATER METER & METER VAULT
 1 - 200MM X 50MM TAPPING SADDLE
 1 - 50MM GATE VALVE & VALVE BOX, 1.38 MPA WP
 66M OF 50MM PVC WATER PIPE, SDR 17, 1.72 MPA WP
 CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING WATER METER
 1 - 20MM X 20MM TAPPING SADDLE
 1 - 20MM CORPORATION STOP
 1.5M OF 20MM COPPER WATER PIPE, TYPE K
 CONNECT USING NECESSARY FITTINGS

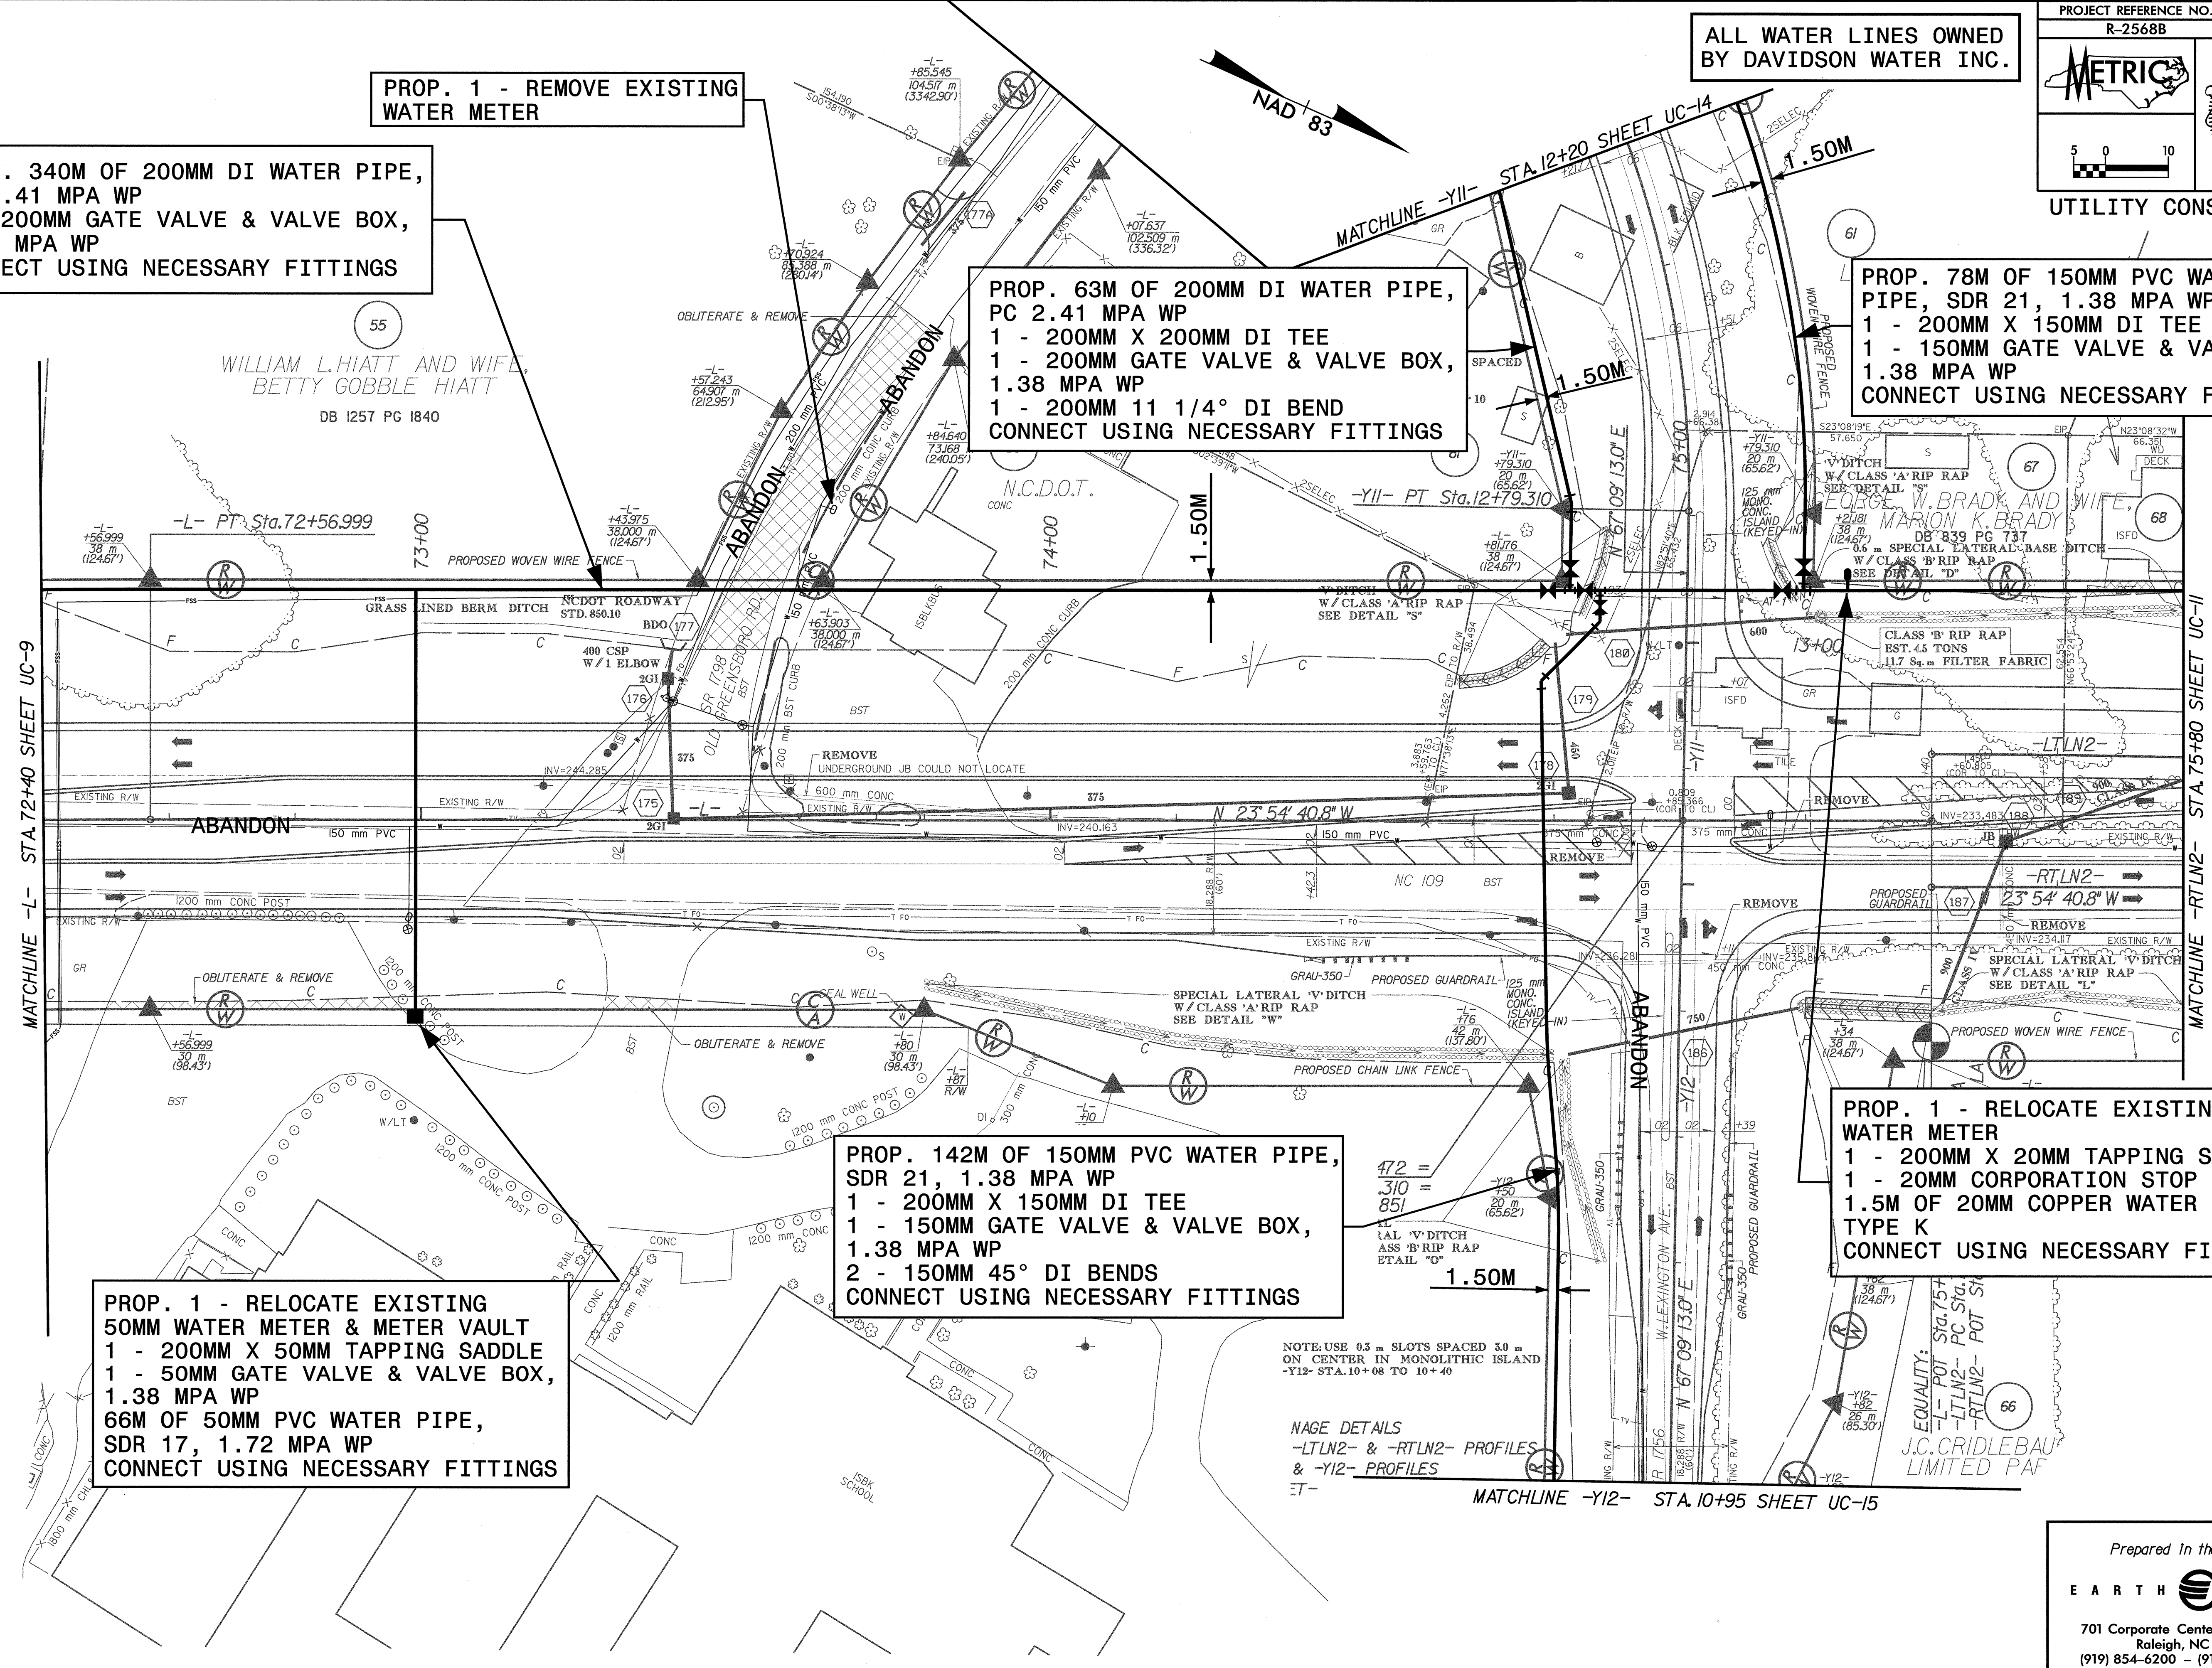

NOTE: USE 0.3 m SLOTS SPACED 3.0 m ON CENTER IN MONOLITHIC ISLAND
 -Y12- STA. 10+08 TO 10+40

NAME DETAILS
 -LTLN2- & -RTLN2- PROFILES
 & -Y12- PROFILES

16/08/2004 10:25:00 2568buc10.dwg 10/25/2004 10:25:00