
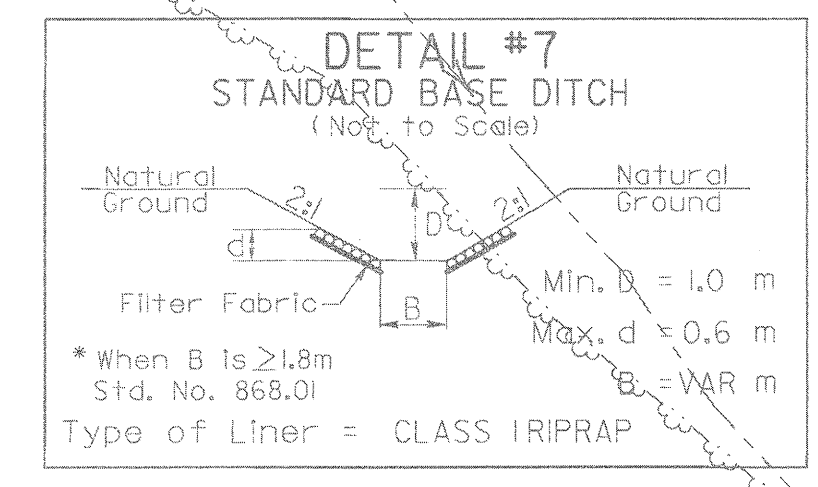


ALL WATER LINES AND SANITARY SEWER LINES OWNED BY THE CITY OF GASTONIA

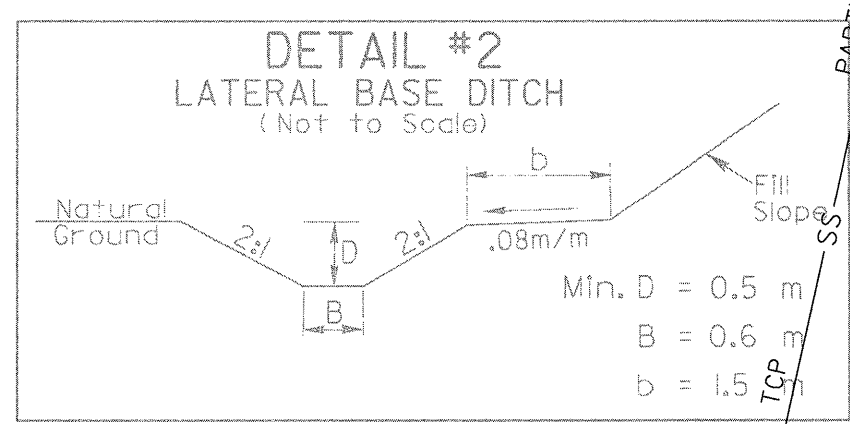

PROP. 1 - RELOCATE EXISTING WATER METER
5M OF 20MM COPPER WATER PIPE, TYPE K
1 - 200MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 37M OF 150MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
1 - 150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
1 - 200MM X 150MM DI TEE
3 - 150MM 22 1/2° DI BENDS
1 - 150MM 45° DI BEND
CONNECT USING NECESSARY FITTINGS

PROP. 1 - CUT-IN SANITARY SEWER CLEAN-OUT CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT
150MM X 150MM DI TEE
150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
4M OF 150MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 17M OF 200MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
4 - 200MM 22 1/2° DI BENDS
CONNECT USING NECESSARY FITTINGS

PROP. 16.0M - FILL OR REMOVE ABANDONED 200MM PIPE, CI WATER

PROP. 3 - RELOCATE EXISTING WATER METERS
59M OF 20MM COPPER WATER PIPE, TYPE K
3 - 200MM X 20MM TAPPING SADDLES
3 - 20MM CORPORATION STOPS
CONNECT USING NECESSARY FITTINGS

PROP. 40.6M - FILL OR REMOVE ABANDONED 200MM PIPE, CI WATER

PROP. 42M OF 200MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
4 - 200MM 22 1/2° DI BENDS
1 - 200MM GATE VALVE & VALVE BOX, 1.38 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE SANITARY SEWER CLEAN-OUT
2M OF 100MM PVC SEWER PIPE, SDR 21, 1.03 MPA
CONNECT USING NECESSARY FITTINGS

