

PROP. 27.8M - FILL OR REMOVE
ABANDONED 200MM PIPE, TCP SEWER

EXIST. 1200MM MANHOLE E1,
STA. 0+00.00, LINE E

20.13 M LT. OF -Y26-
STA. 10+51.59

PROP. 2 - RELOCATE EXISTING
WATER METERS
15M OF 20MM COPPER WATER PIPE,
TYPE K
2 - 150MM X 20MM TAPPING SADDLES
2 - 20MM CORPORATION STOPS
CONNECT USING NECESSARY FITTINGS

ALL WATER LINES AND SANITARY
SEWER LINES OWNED BY THE
CITY OF GASTONIA

D.B. 1464 PG. 123

PROP. 1200MM MANHOLE E2,
1 - SEWER MANHOLE OUTSIDE
DROP ASSEMBLY
STA. 0+09.77, LINE E

11.44 M LT. OF -Y26-
STA. 10+54.54

PROP. 9.77M OF 200MM DI SEWER PIPE, CLASS 51
SEE PROFILE FOR LINE E ON SHEET UC-30

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT
200MM X 150MM DI TEE
150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
7M OF 150MM DI WATER PIPE,
CLASS 51, 2.41 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 6.0M OF 200MM DI SEWER PIPE,
CLASS 51. MATCH EXISTING SLOPE
CENTER ON PROP. DITCH
2 - 200MM TRANSITION COUPLINGS
(DI TO TC)
CONNECT USING NECESSARY FITTINGS

PROP. 89M OF 200MM DI WATER PIPE,
CLASS 51, 2.41 MPA WP
4 - 200MM 22 1/2° DI BENDS
1 - 200MM X 200MM DI TEE
2 - 200MM GATE VALVE & VALVE BOX,
1.38 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 82.5M - FILL OR REMOVE
ABANDONED 200MM PIPE, CI WATER

PROP. 1500MM MANHOLE D2,
STA. 0+53.02, LINE D

5.10 M RT. OF -L-
STA. 51+39.85

PROP. 1 - CUT-IN SANITARY
SEWER CLEAN-OUT
CONNECT USING NECESSARY FITTINGS


PROP. 1 - RELOCATE EXISTING
WATER METER
29M OF 20MM COPPER WATER PIPE,
TYPE K
1 - 200MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 35.54M OF 500MM DI
SEWER PIPE, CLASS 51
SEE PROFILE FOR LINE D
ON SHEET UC-30

PROP. 32.2M - FILL OR REMOVE
ABANDONED 200MM PIPE, TCP SEWER

EXIST. 1200MM MANHOLE D3,
STA. 0+88.57, LINE D

26.23 M RT. OF -L-
STA. 51+69.10

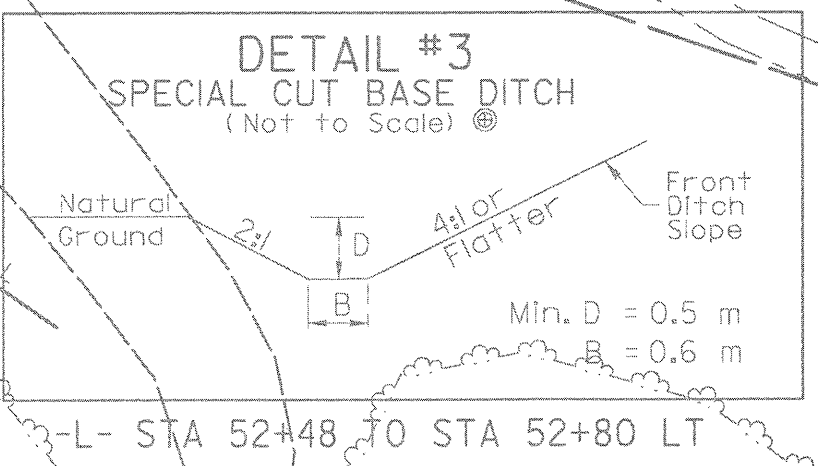

G:\16845\Fedway\proj\2408\2408uc23.dwg 14:48:53 AM 10/07/2004