


**SOIL TEST RESULTS**


SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-127	0.0	3+04.8-LPB-	13.5-15.0	A-1-B(0)	NP	NP	90	5	0	5	74	20	5	9	
S-69	0.0	5+00-LPB-	10.0-15.0	A-6(5)	40	20	7	47	11	35	100	98	49	33	

PROJECT REFERENCE NO. <b>R-2417BB</b>	SHEET NO. <b>18</b>
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER
<b>PRELIMINARY PLANS</b> DO NOT USE FOR CONSTRUCTION	

BM #24  
RR-SPIKE IN BASE OF POWER POLE  
EL. = 436.300  
-Y3- STA. 37+41.99 OFF. 55.04 RT.

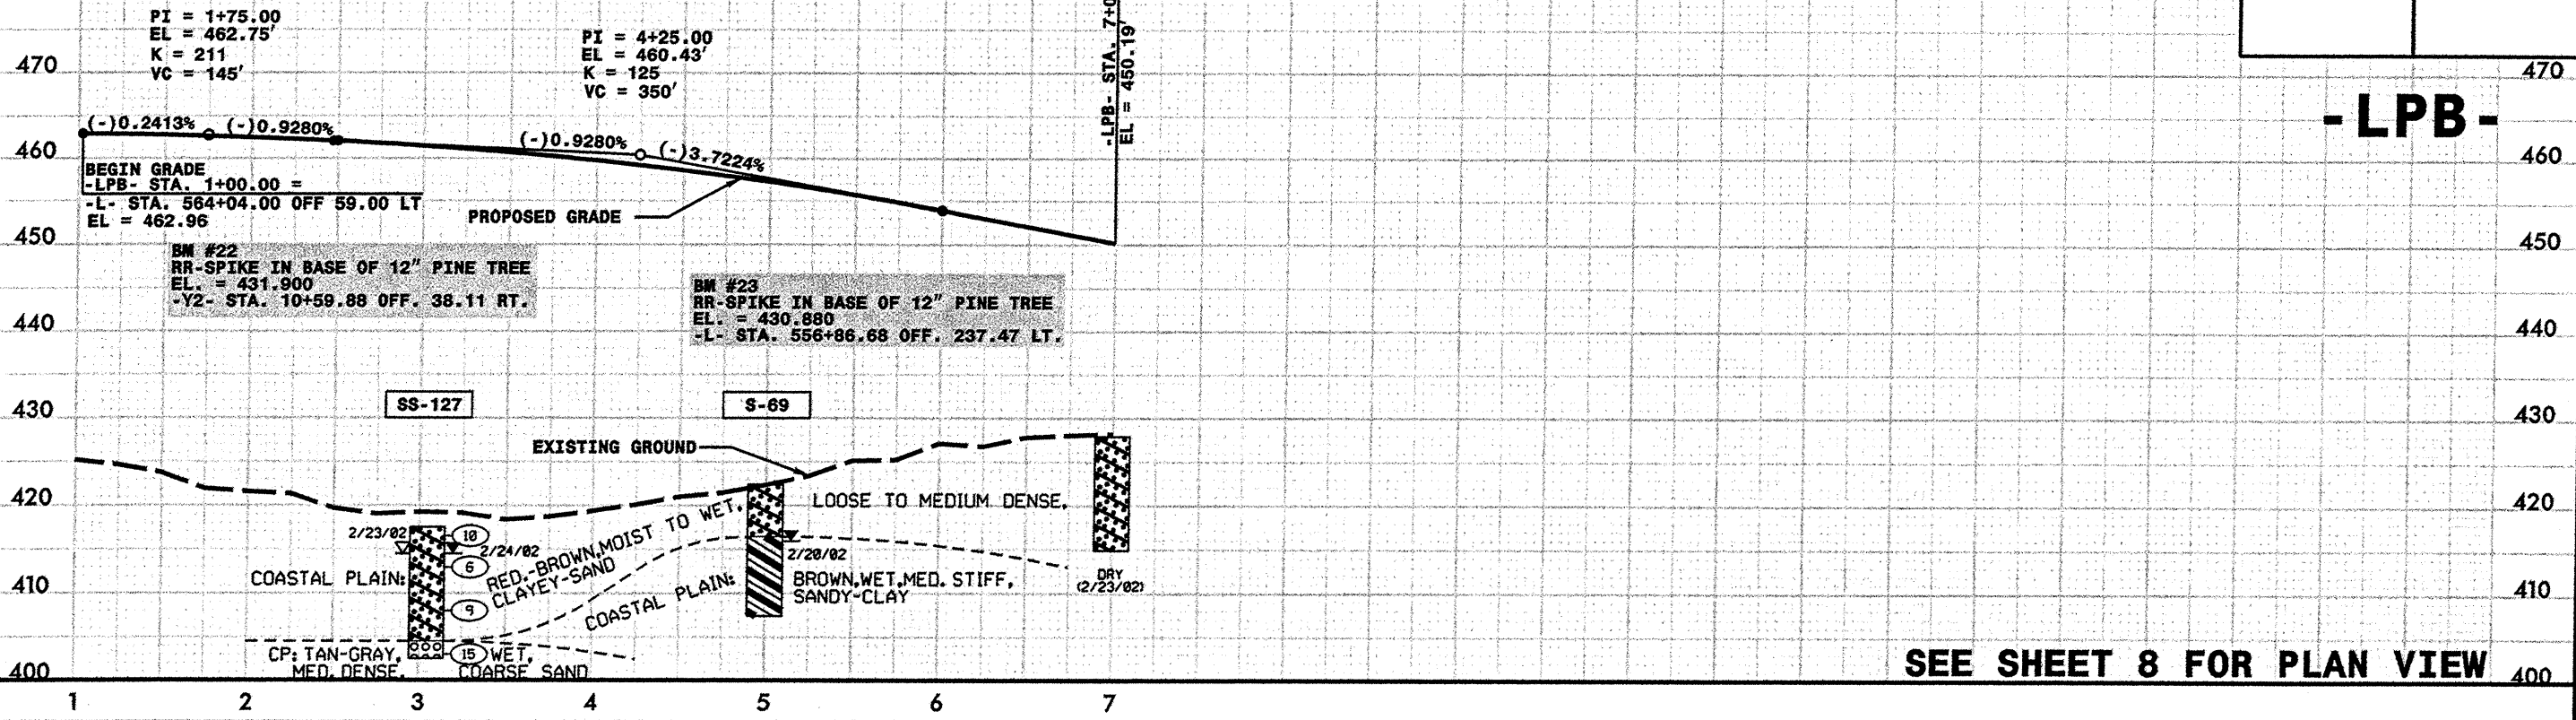

SEE SHEET 8 FOR PLAN VIEW

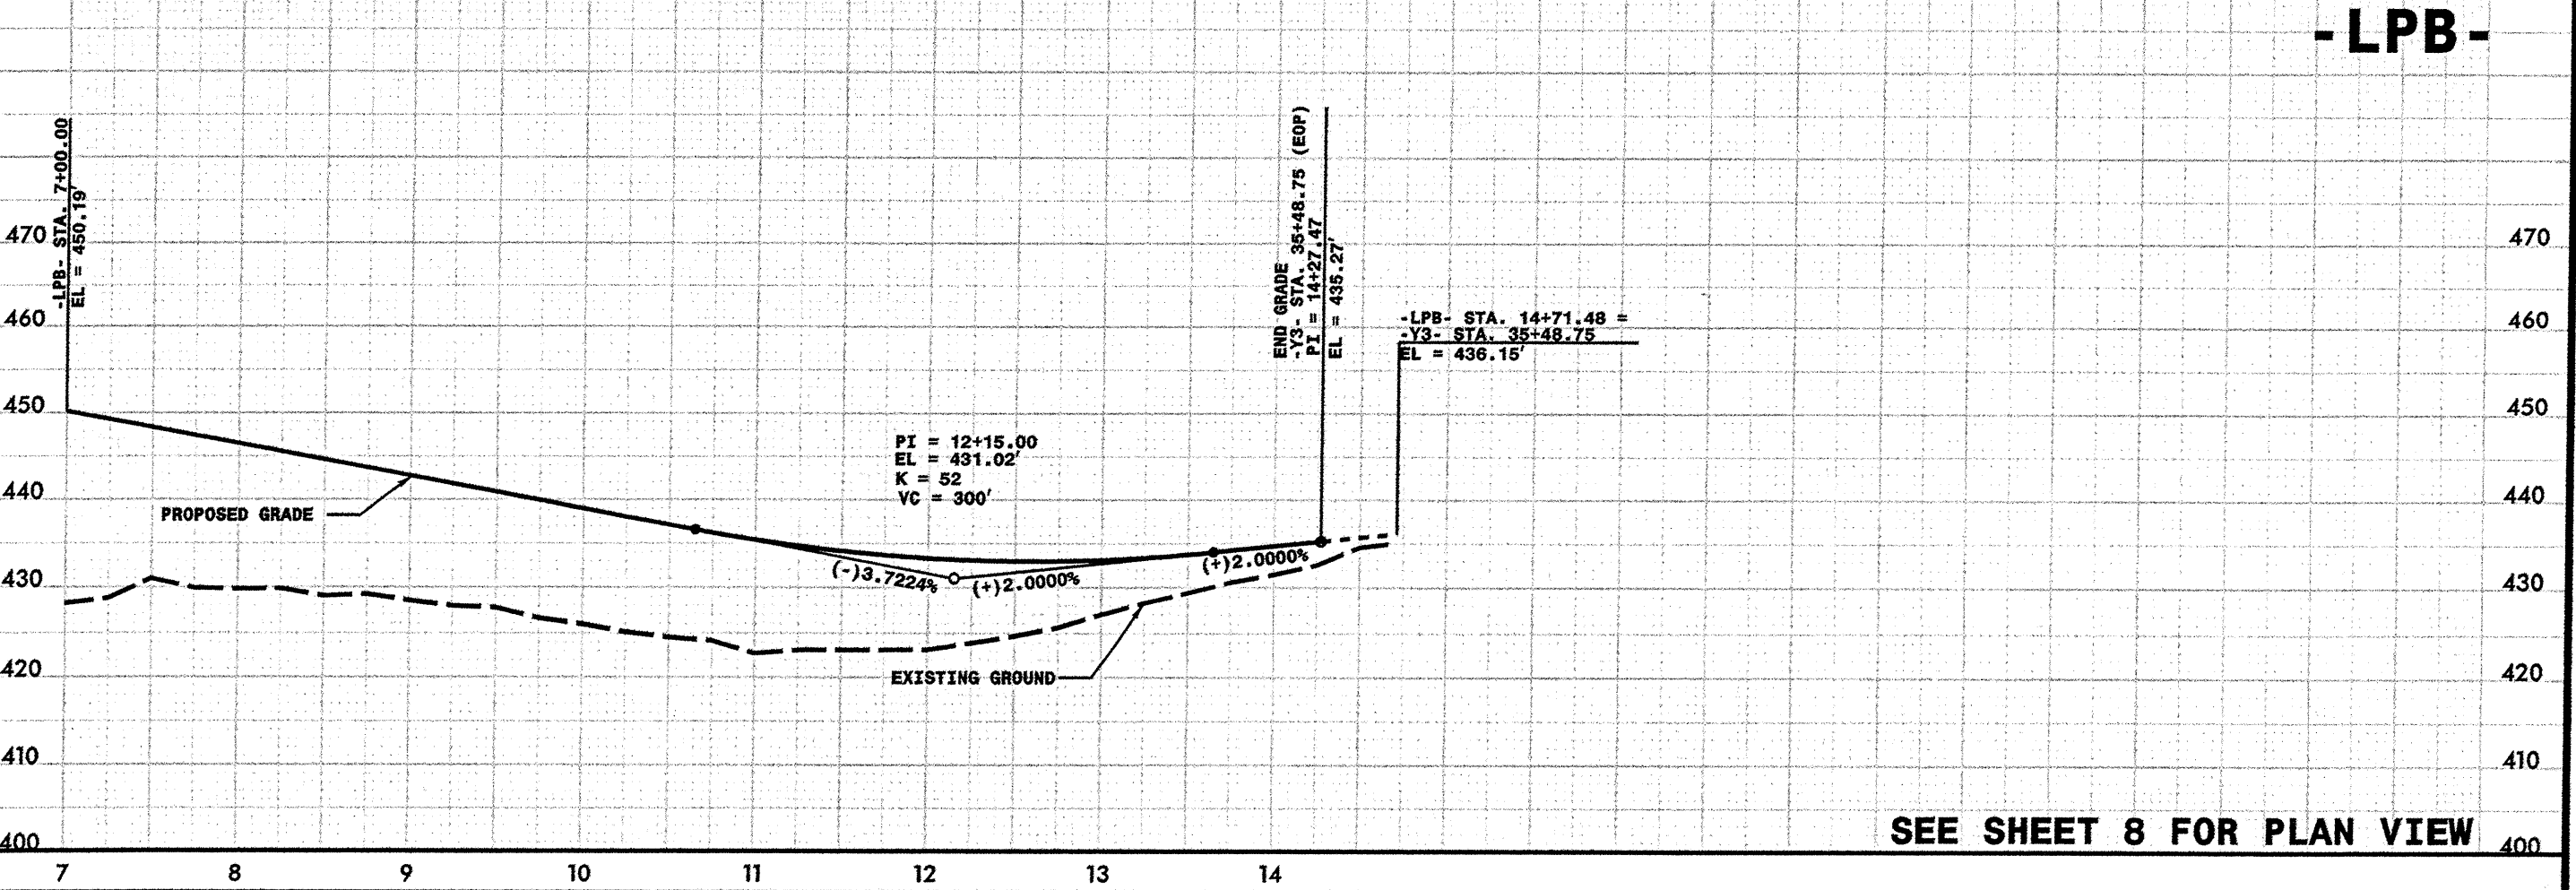

SEE SHEET 8 FOR PLAN VIEW