

ALL WATER LINES OWNED
BY ROBESON COUNTY

PROP. 58M OF 150MM PVC WATER
PIPE, SDR 21, 1.38MPA WP
1 - 150MM GATE VALVE & VALVE BOX,
1.38MPA WP
1 - 50MM BLOW OFF ASSEMBLY
CONNECT USING NECESSARY FITTINGS


(47)
ROY CHAVIS, JR.
DB 705 PG 887

NOTE: ALL WATER METERS AND VALVES WERE FIELD LOCATED.
WATER LINE LOCATIONS ARE FROM AS-BUILT PLANS AND WERE NOT MARKED IN THE FIELD.

PROP. 236M - FILL OR REMOVE
ABANDONED 200MM PIPE, PVC WATER

PROP. 246M OF 200MM PVC WATER
PIPE, SDR 21, 1.38MPA WP
1 - 200MM X 150MM DI TEE
1 - 200MM GATE VALVE & VALVE BOX,
1.38MPA WP
2 - 200MM 45° DI BENDS
CONNECT USING NECESSARY FITTINGS

(45)
BERNELL LOCKLEAR ESTATE
DB 932 PG 859

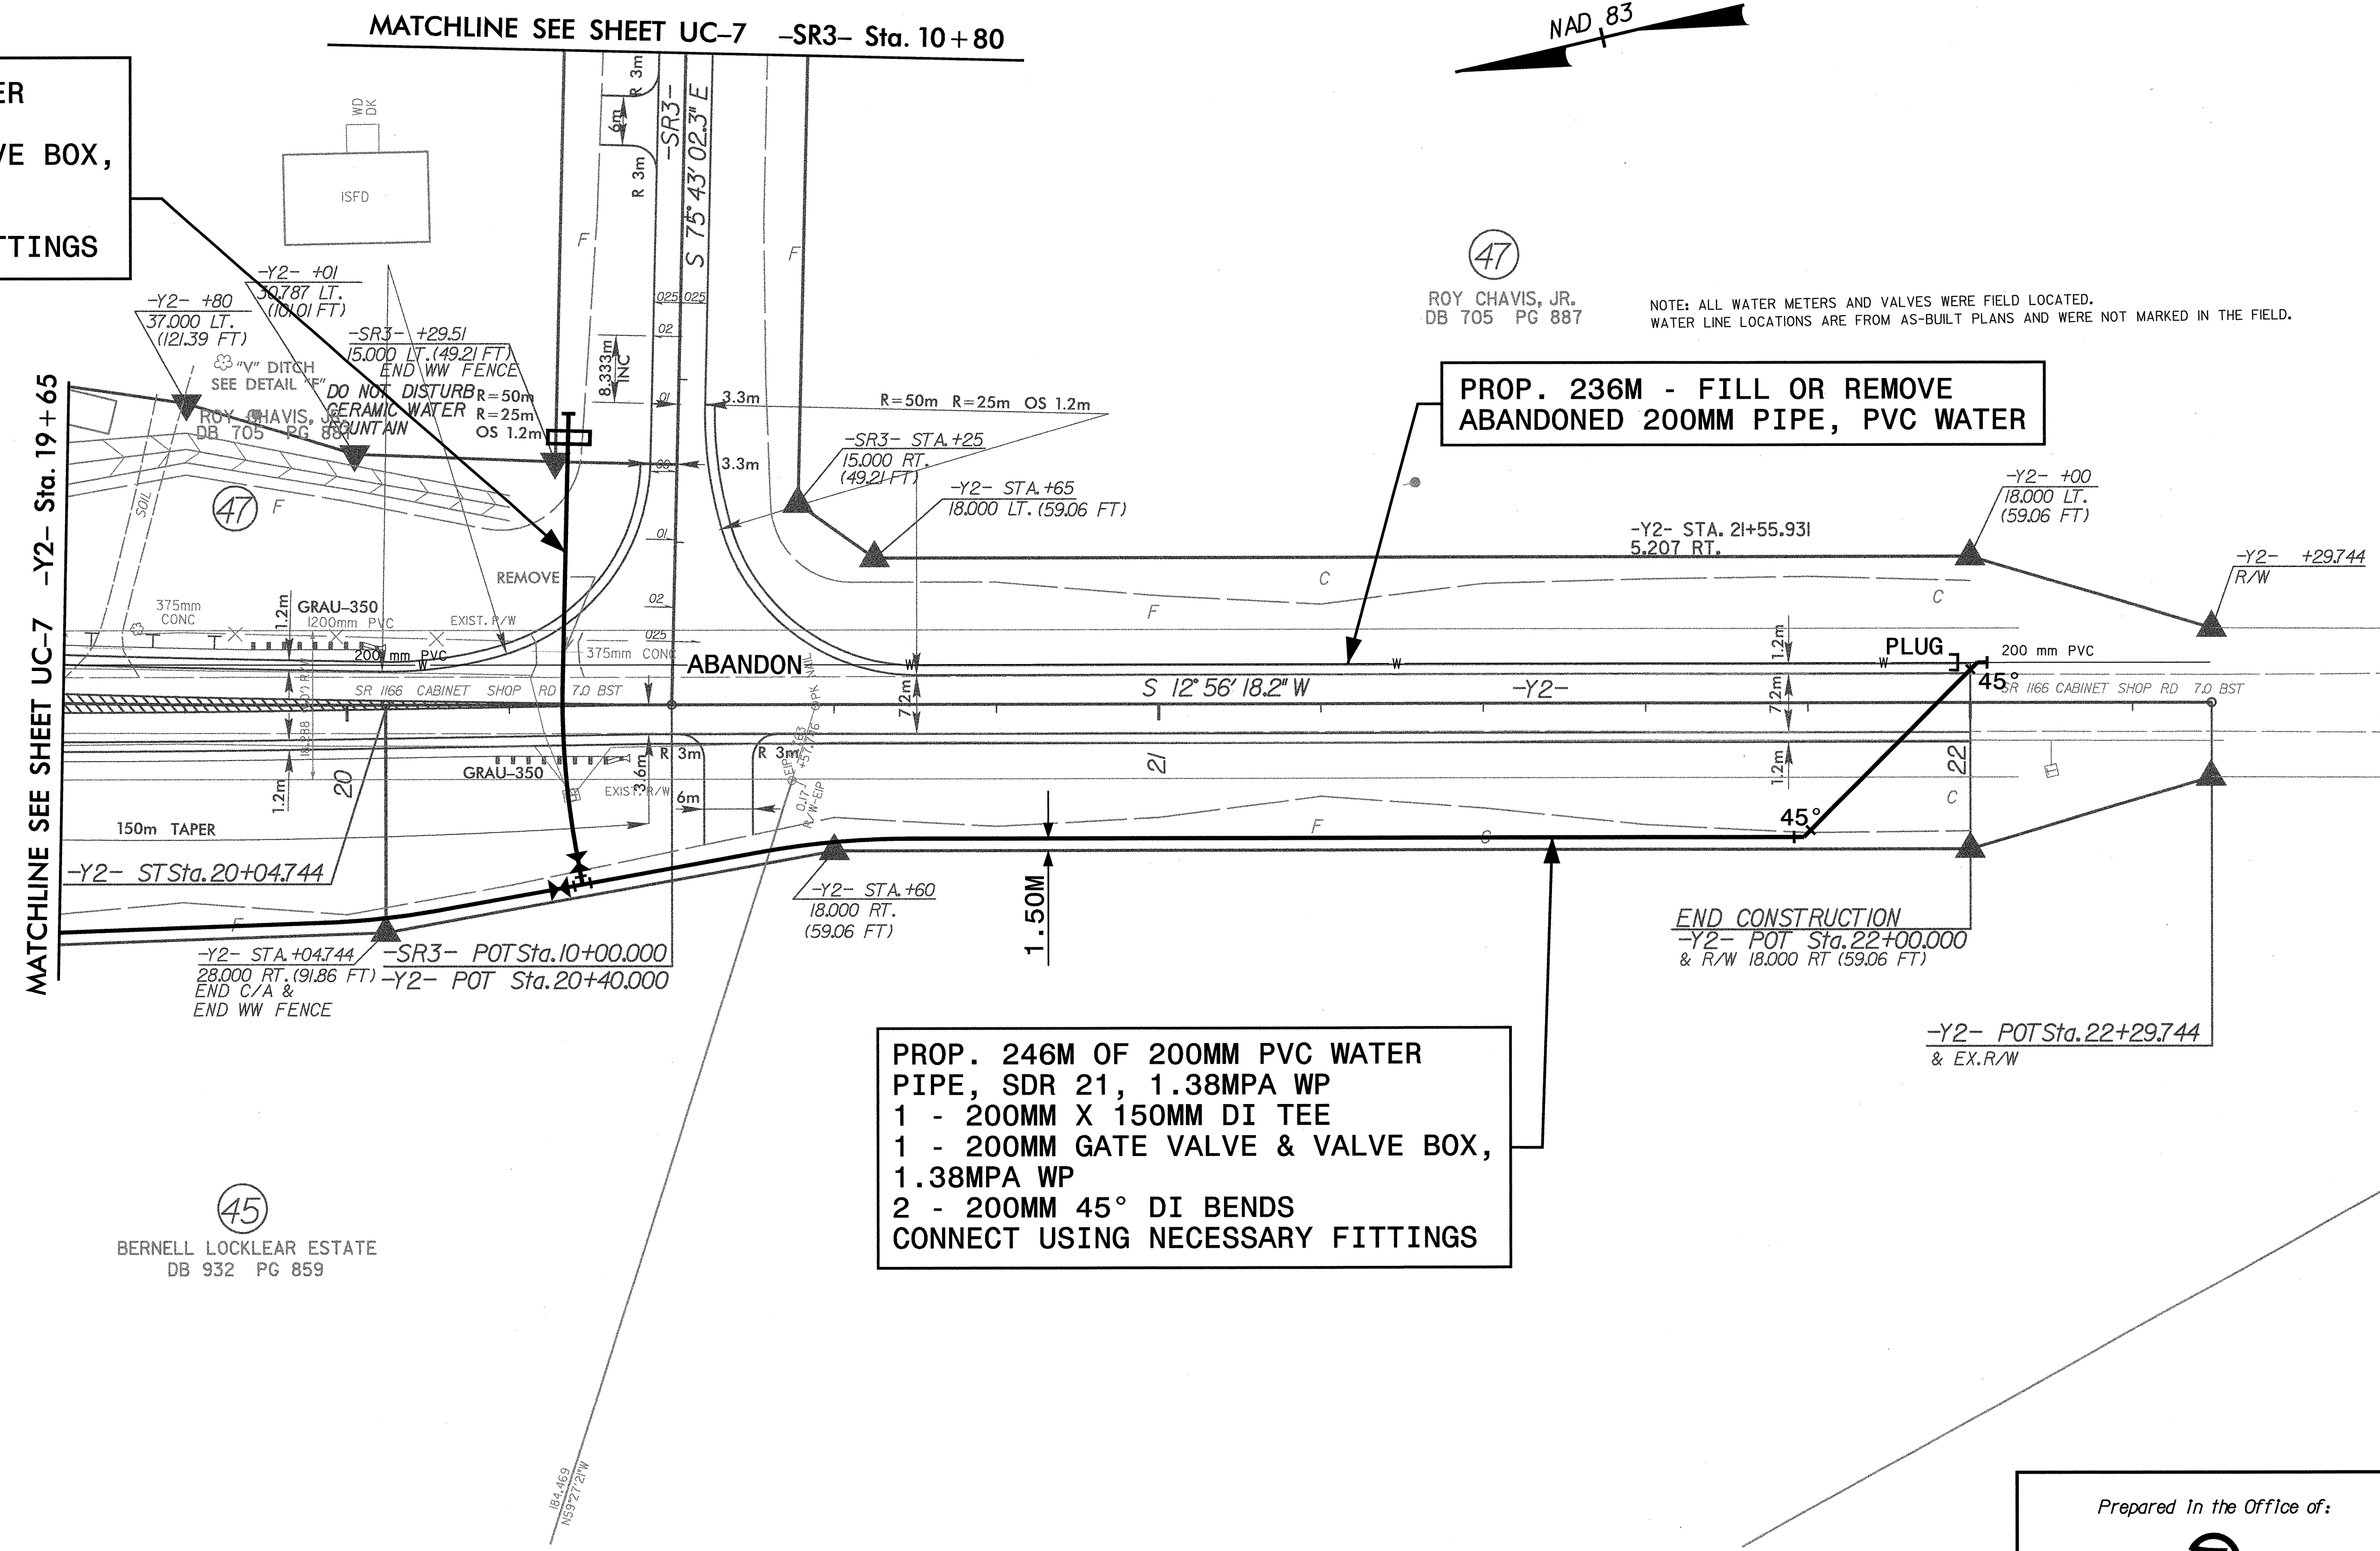

9:17:50:41 CADD \Y-05 13:05:05 13AUC11.psh
 08/03/2004 02:13:01 PM

Prepared In the Office of:
EARTH TECH
701 Corporate Center Drive, Suite 475
Raleigh, NC 27607
(919) 854-6200 - (919) 854-6259(FAX)