


ALL WATER LINES OWNED BY ROBESON COUNTY

-Y2-			-DW1-	
PIs Sta. 13+03.675	PI Sta. 14+17.781	PIs Sta. 15+30.537	PI Sta. 10+23.763	PI Sta. 10+54.403
$\Delta s = 3' 20' 32.1''$	$\Delta = 17' 12' 26.8''$ (LT)	$\Delta s = 3' 20' 32.1''$	$\Delta = 39' 22' 56.7''$ (RT)	$\Delta = 19' 03' 41.4''$ (LT)
Ls = 70.000	L = 180.196	Ls = 70.000	L = 13.747	L = 4.990
LT = 46.675	T = 90.781	LT = 46.675	T = 7.158	T = 2.518
ST = 23.341	R = 600.000	ST = 23.341	R = 20.000	R = 15.000
	SE = 0.07			

-DW2-		-DW3-		-DW4-		-SR4-	
PI Sta. 10+17.931	PI Sta. 10+21.902	PI Sta. 10+55.949	PI Sta. 10+35.026	PI Sta. 10+17.931	PI Sta. 10+21.902	PI Sta. 10+55.949	PI Sta. 10+35.026
$\Delta = 26' 10' 09.5''$ (RT)	$\Delta = 20' 50' 56.7''$ (RT)	$\Delta = 21' 02' 28.5''$ (RT)	$\Delta = 73' 13' 13.0''$ (LT)				
L = 9.135	L = 7.278	L = 7.345	L = 38.338				
T = 4.649	T = 3.680	T = 3.714	T = 22.288				
R = 20.000	R = 20.000	R = 20.000	R = 30.000				

-DW6-	
PI Sta. 10+11.581	PI Sta. 10+41.327
$\Delta = 26' 55' 57.3''$ (RT)	$\Delta = 10' 41' 50.9''$ (LT)
L = 7.049	L = 2.801
T = 3.591	T = 1.404
R = 15.000	R = 15.000

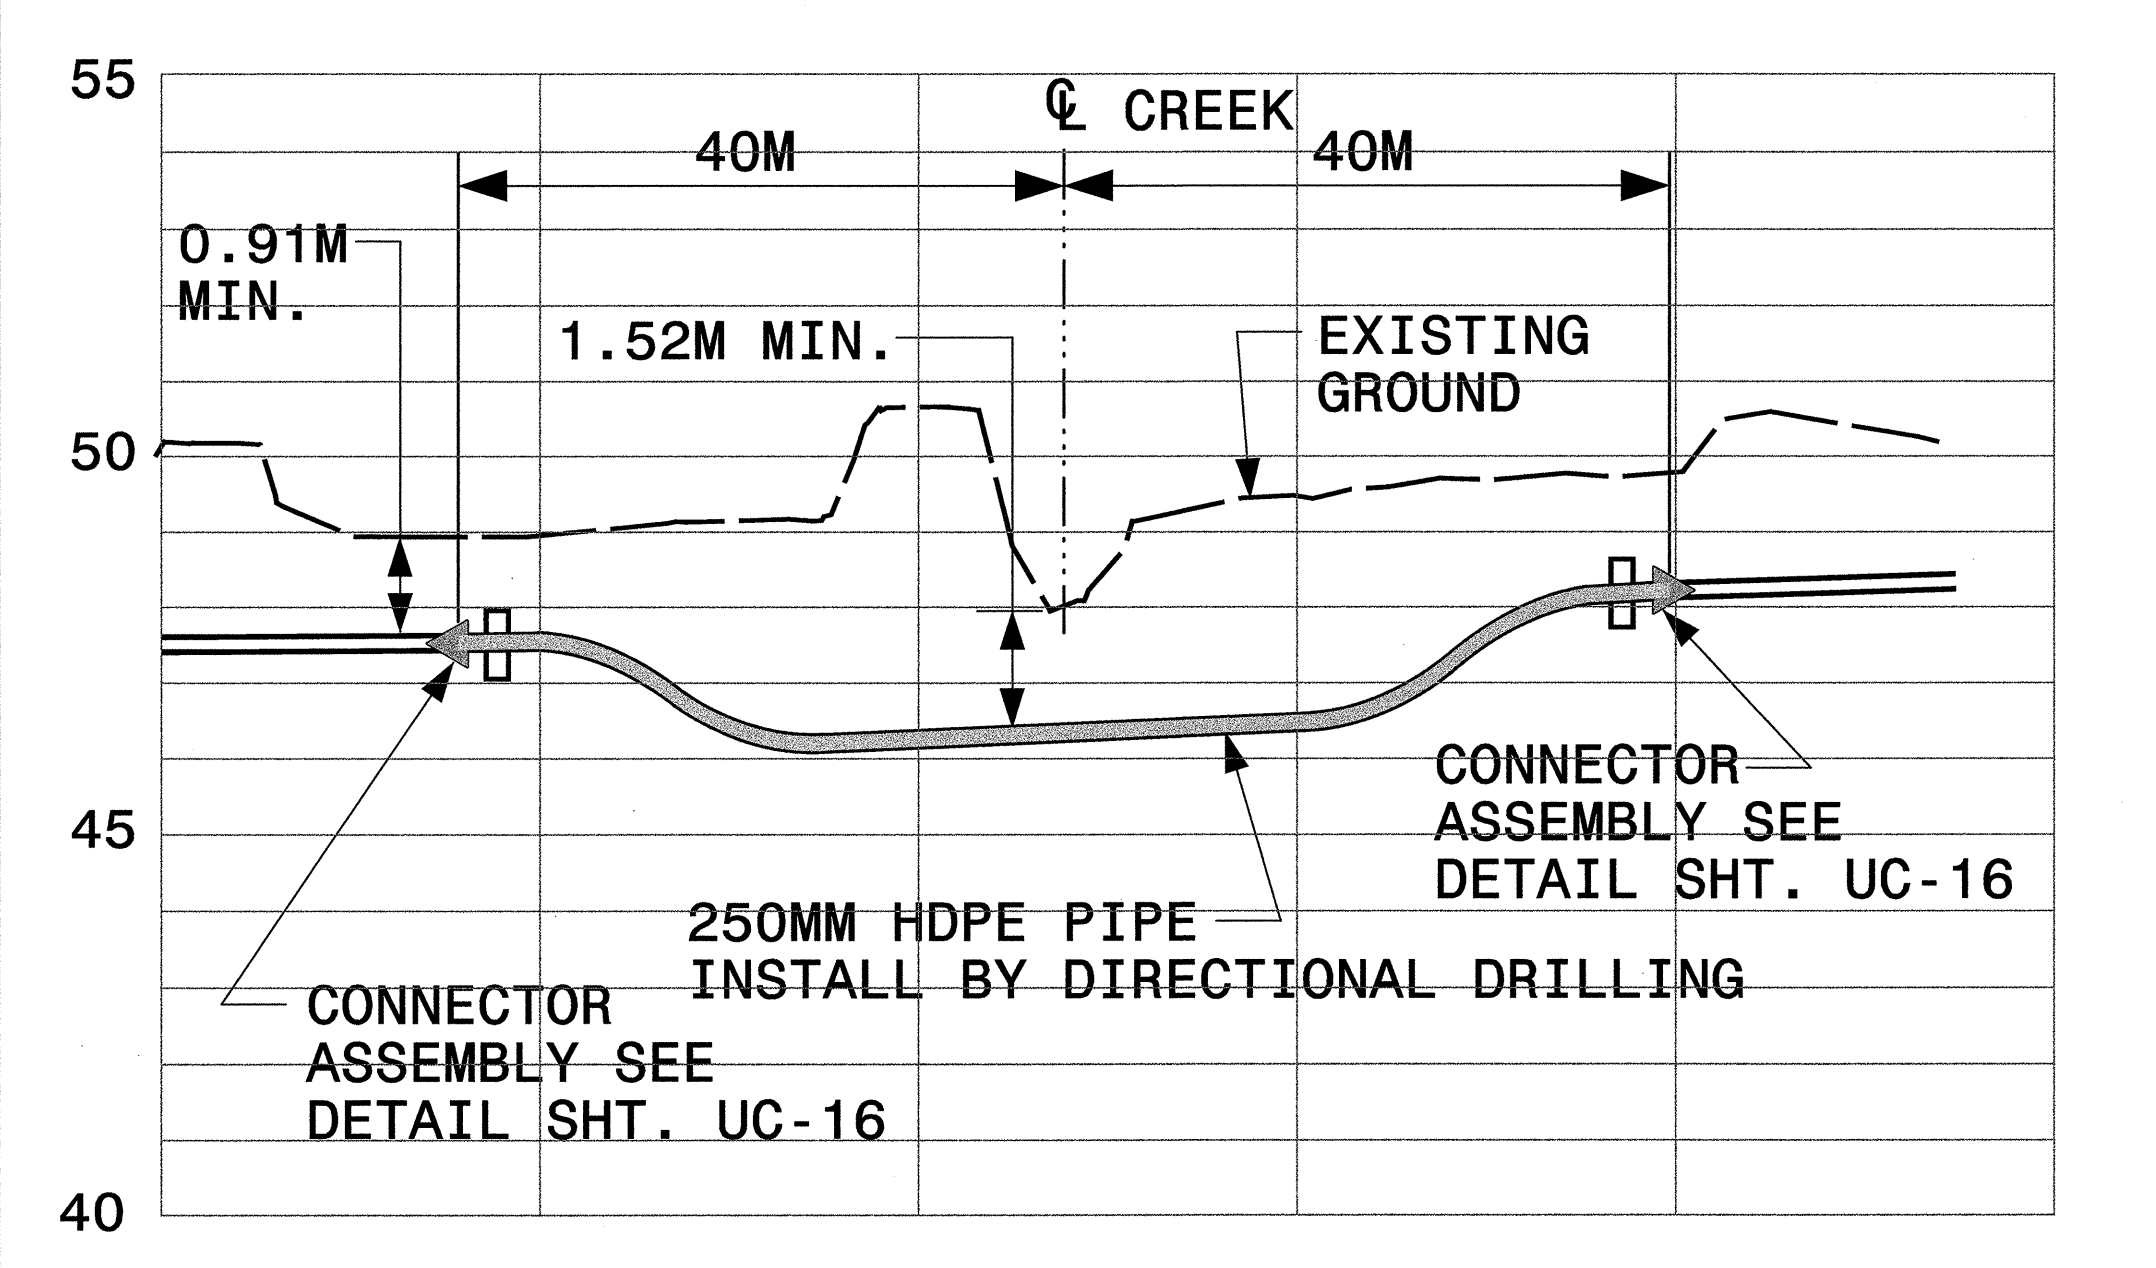

REMOVAL

LIAM HUNT
25 PG 267

PROP. 1 - RELOCATE EXISTING WATER METER 7M OF 20MM PE WATER TUBING, SDR 7, 1.38MPA WP CONNECT USING NECESSARY FITTINGS

PROP. 186M - FILL OR REMOVE ABANDONED 200MM PIPE, PVC WATER

PROP. 1 - REMOVE EXISTING WATER METER

PROP. 113M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP 4 - 200MM 45° DI BENDS CONNECT USING NECESSARY FITTINGS

PROP. 8M OF 20MM PE WATER TUBING, SDR 7, 1.38MPA WP 3 - 200MM X 20MM TAPPING SADDLES 3 - 20MM CORPORATION STOPS CONNECT USING NECESSARY FITTINGS

PROP. 80M OF 250MM HDPE WATER PIPE, DR 9, 1.38MPA WP 2 - 250MM X 200MM HDPE CONNECTOR ASSEMBLIES CONNECT USING NECESSARY FITTINGS

g:\76054\CADD\1-05_130_105_15Auc 10.psh 02/23/2004 12:02:16 PM