
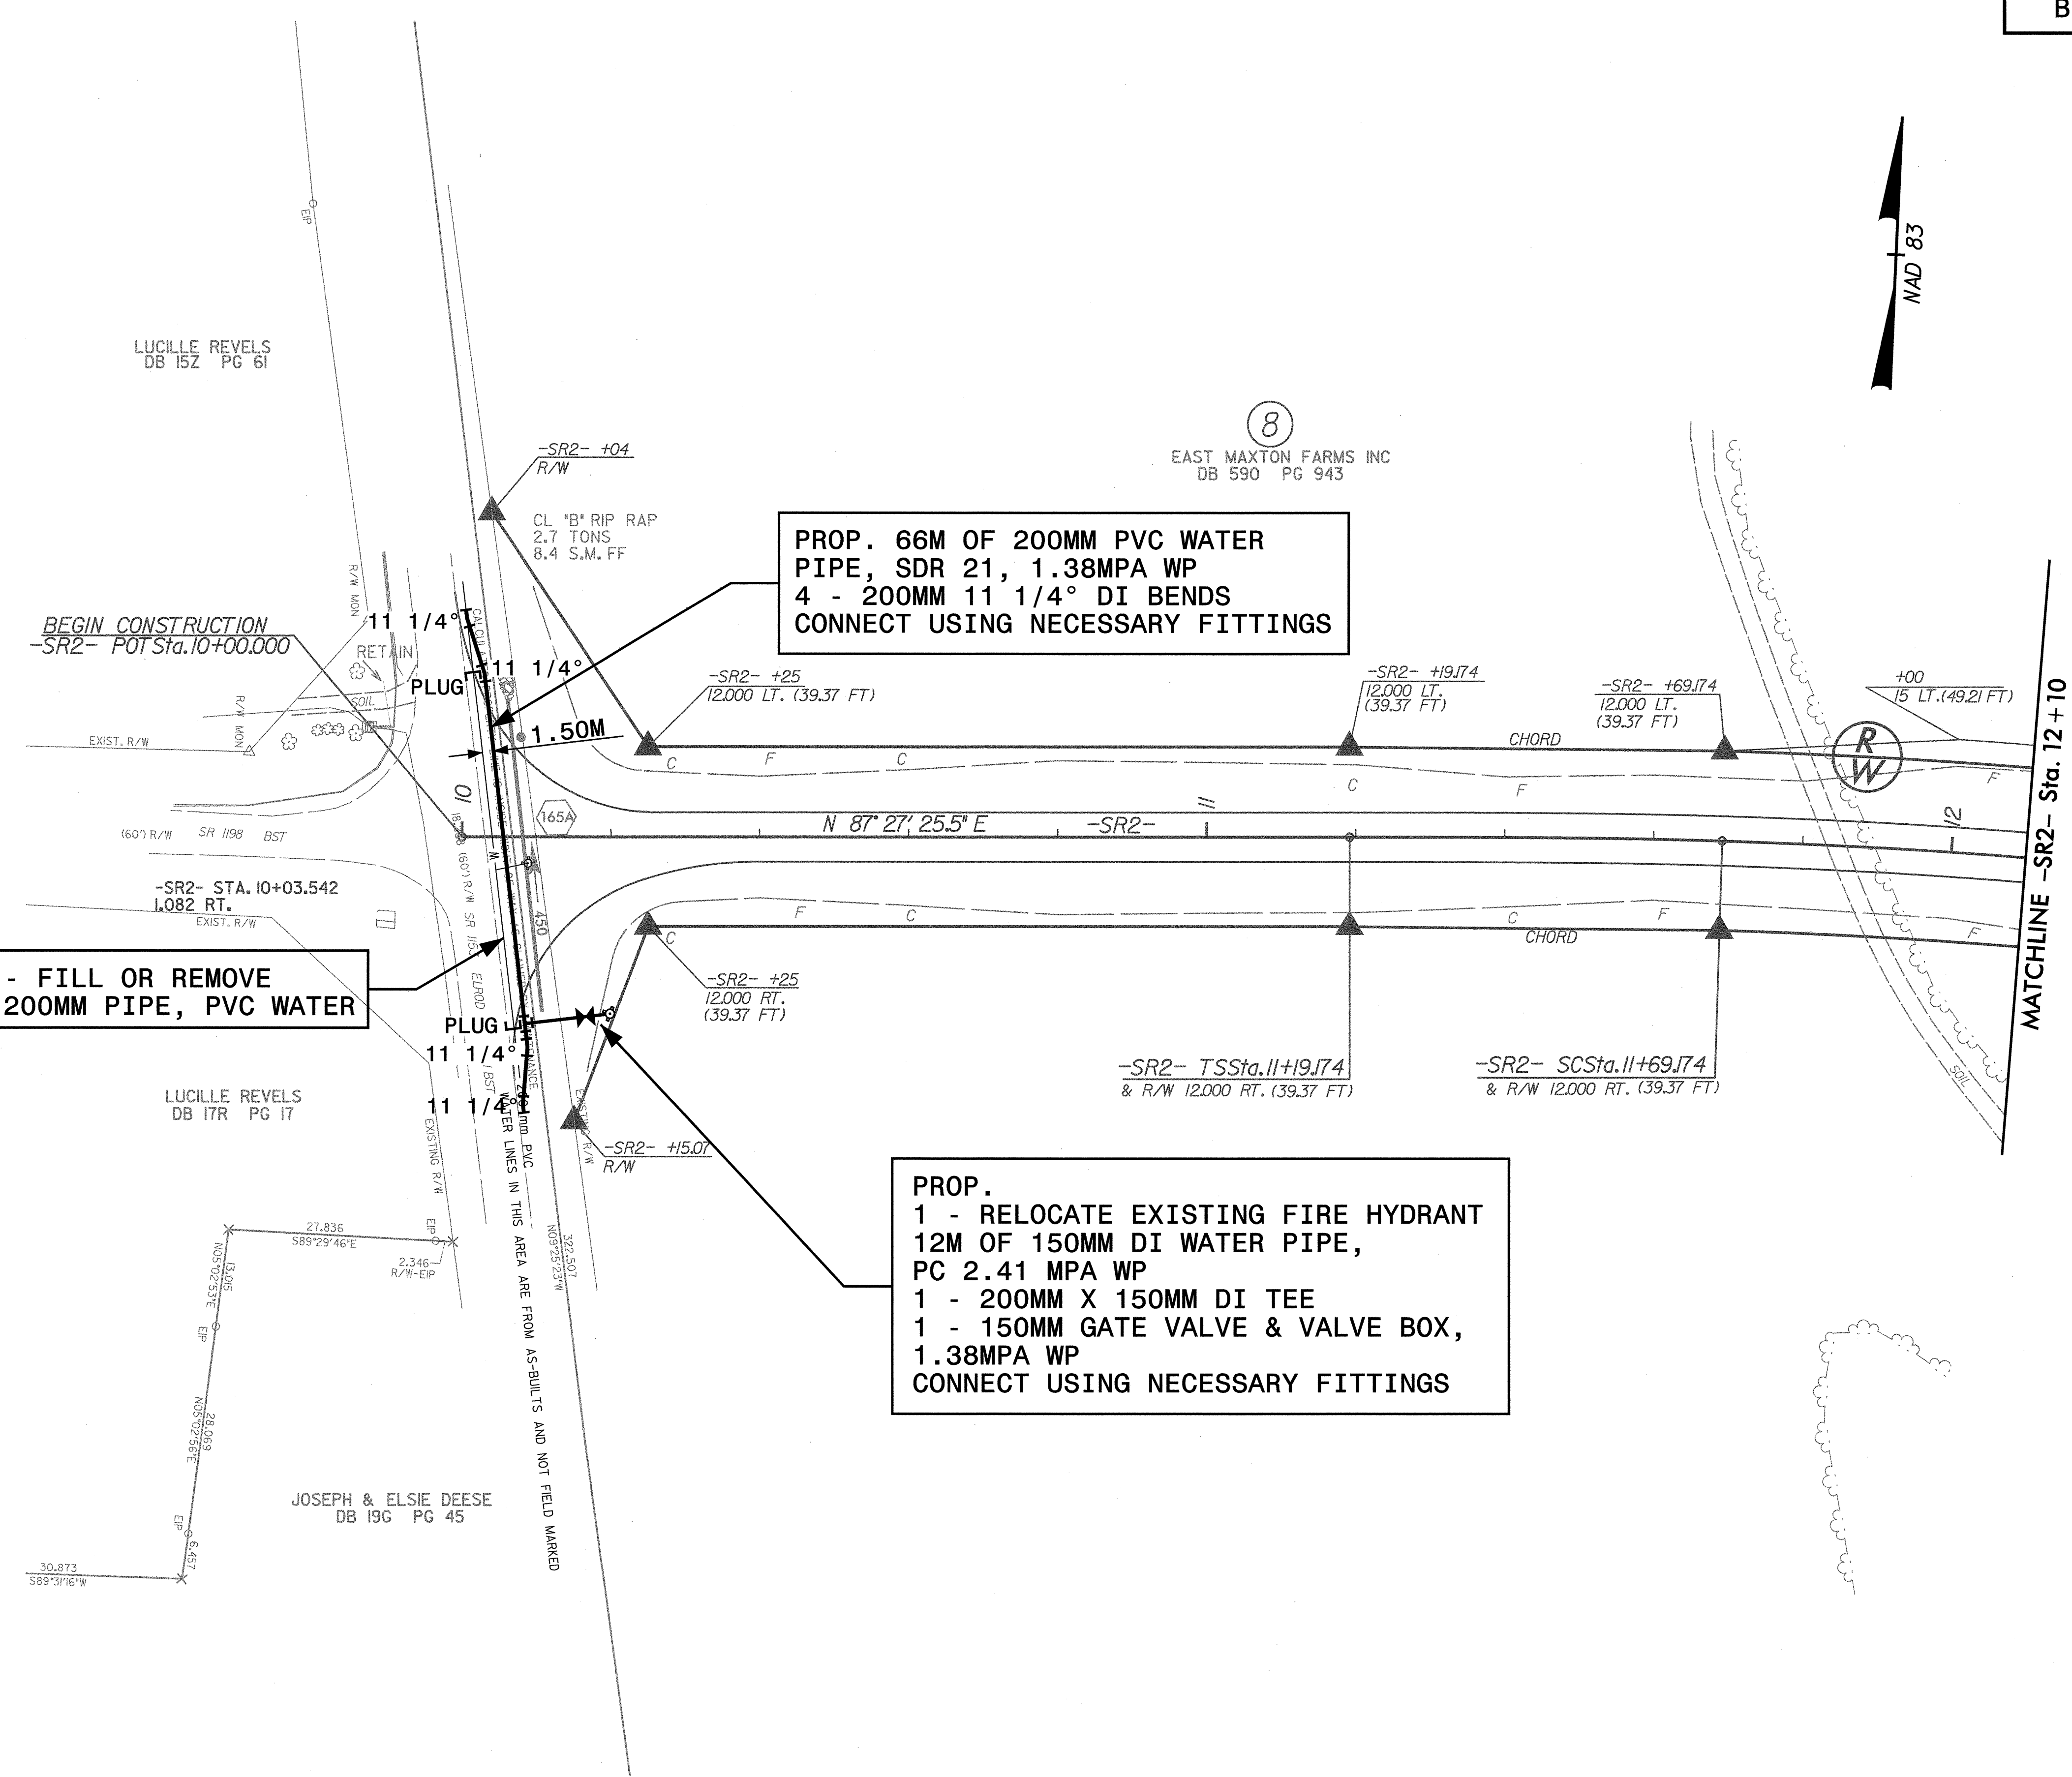


ALL WATER LINES OWNED
BY ROBESON COUNTY

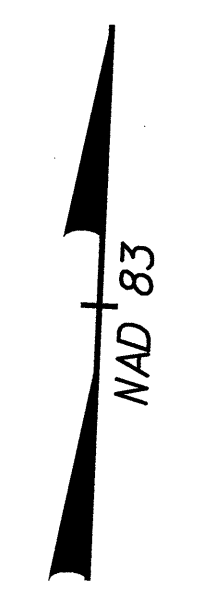

PROP. 66M OF 200MM PVC WATER PIPE, SDR 21, 1.38MPA WP
4 - 200MM 11 1/4° DI BENDS
CONNECT USING NECESSARY FITTINGS

PROP. 66M - FILL OR REMOVE ABANDONED 200MM PIPE, PVC WATER

PROP.
1 - RELOCATE EXISTING FIRE HYDRANT
12M OF 150MM DI WATER PIPE,
PC 2.41 MPA WP
1 - 200MM X 150MM DI TEE
1 - 150MM GATE VALVE & VALVE BOX,
1.38MPA WP
CONNECT USING NECESSARY FITTINGS

6175954.CADD\105130\005 28Aug09.psh
28/07/2004 02:10:52 PM