


ALL WATER LINES OWNED
BY ROBESON COUNTY

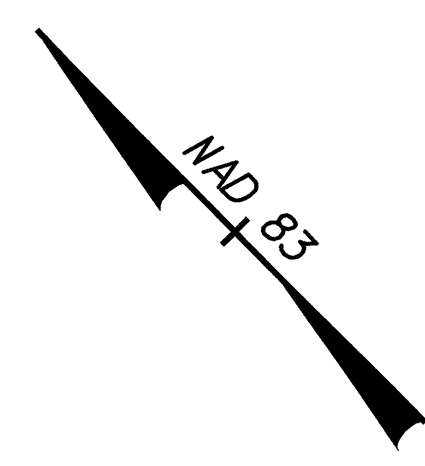


PROP. 1 - RELOCATE EXISTING WATER METER
 22M OF 20MM PE WATER TUBING, SDR 7,
 1.38MPA WP
 1 - 150MM X 20MM TAPPING SADDLE
 1 - 20MM CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP. 1 - REMOVE EXIST. WATER METER

**PROP. 110M - FILL OR REMOVE
ABANDONED 150MM PIPE, PVC WATER**

PROP.
 13M OF 20MM PE WATER TUBING, SDR 7,
 1.38MPA WP
 1 - 150MM X 20MM TAPPING SADDLE
 1 - 20MM CORPORATION STOP
 CONNECT USING NECESSARY FITTINGS

PROP.
 107M OF 150MM PVC WATER
 PIPE, SDR 21, 1.38MPA WP
 1 - 150MM 11 1/4° DI BEND
 2 - 150MM 45° DI BENDS
 3M OF 150MM DI WATER PIPE,
 PC 2.41 MPA WP
 1 - FIRE HYDRANT, 1.38MPA WP
 1 - 150MM GATE VALVE & VALVE BOX,
 1.38MPA WP
 CONNECT USING NECESSARY FITTINGS

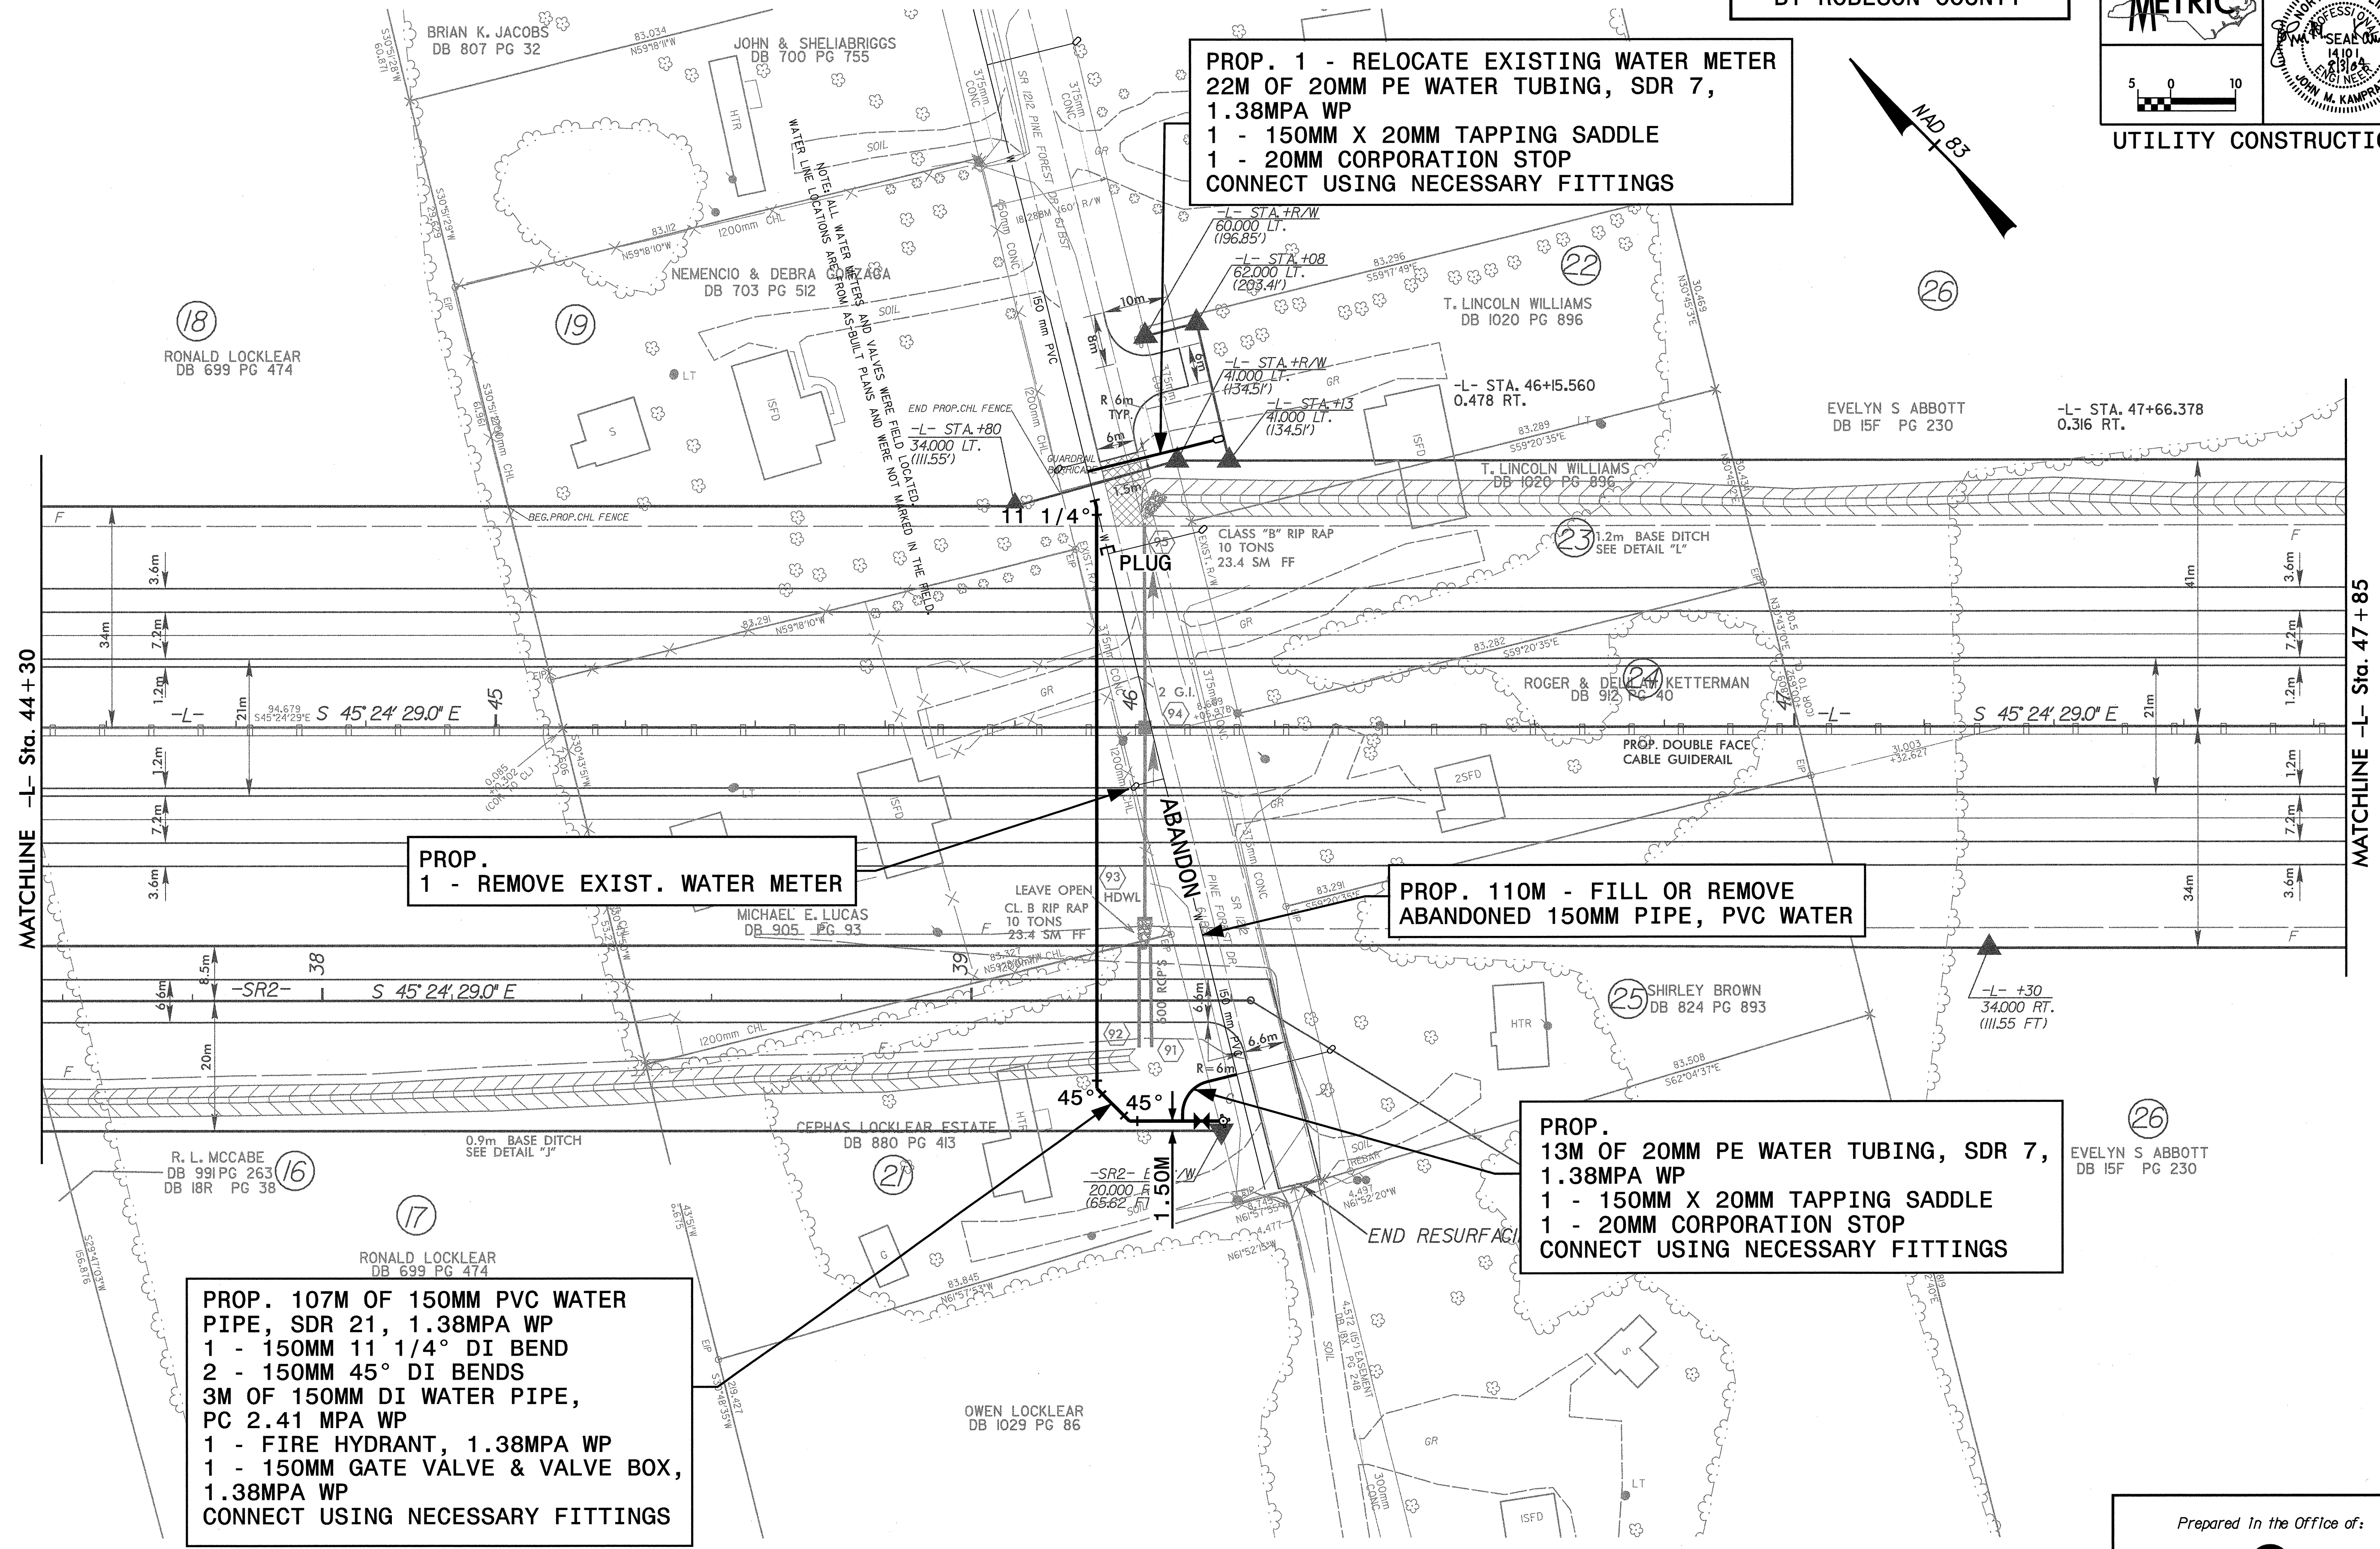

S:\7505A\CADD\1-05_130\105_130\105_130.dwg
 02/03/2004 10:06:06 AM