

ALL WATER LINES OWNED  
BY ROBESON COUNTY

PROP. 20M OF 300MM PVC WATER  
PIPE, SDR 21, 1.38MPA WP  
1 - 300MM 11 1/4° DI BEND  
CONNECT USING NECESSARY FITTINGS

②  
MARY H. HORNE  
DB 79E PG 5I

②  
MARY H. HORNE  
DB 79E PG 5I


PROP. 20M - FILL OR REMOVE  
ABANDONED 300MM PIPE, PVC WATER

PROP. 170M OF 300MM PVC WATER  
PIPE, SDR 21, 1.38MPA WP  
1 - 300MM 11 1/4° DI BEND  
CONNECT USING NECESSARY FITTINGS

UTILITY CONSTRUCTION

MATCHLINE SEE SHEET UC-2 -L- Sta. 12+40

MATCHLINE SEE SHEET UC-4 -L- Sta. 15+10

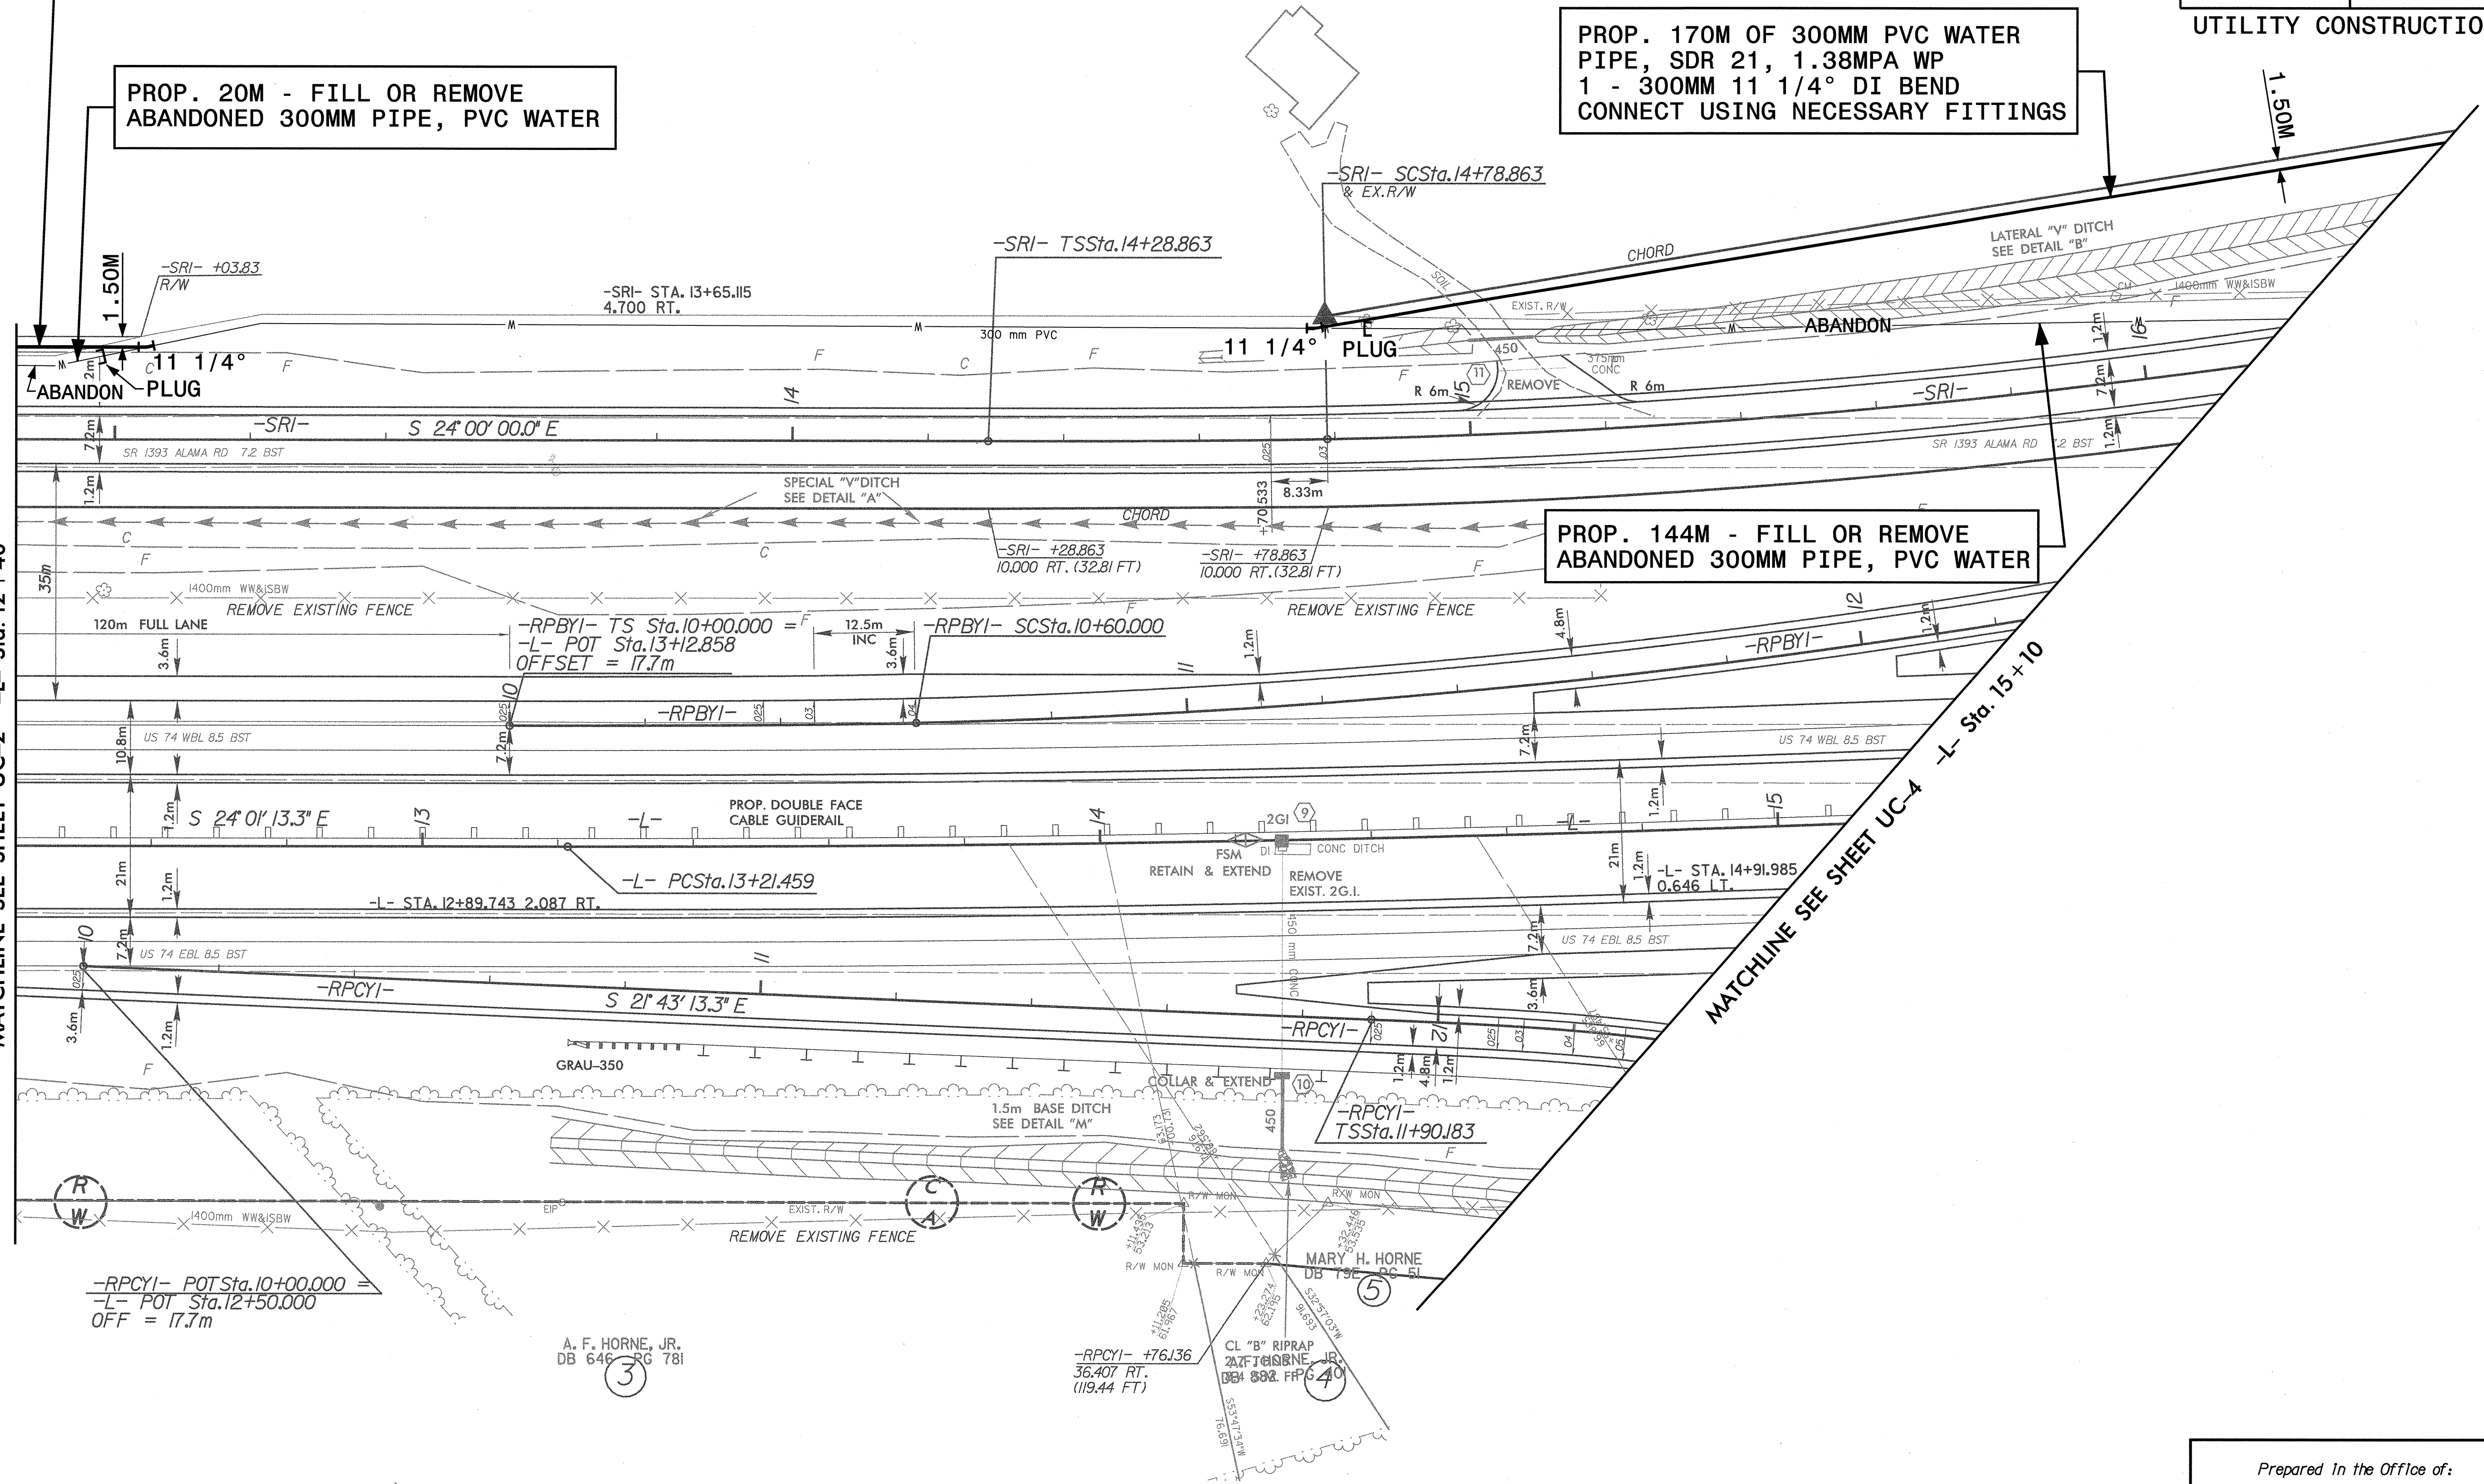

-RPCYI- POT Sta. 10+00.000 =  
-L- POT Sta. 12+50.000  
OFF = 17.7m

A. F. HORNE, JR.  
DB 64E PG 78I  
③

-RPCYI- +76.136  
36.407 RT.  
(119.44 FT)  
④

MARY H. HORNE  
DB 79E PG 5I  
⑤

06/25/2004 15:54:05 15:54:03.psh  
 06/25/2004 0:13:54:14