


5.09/20

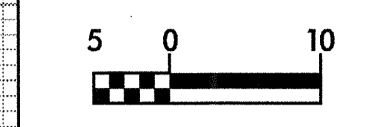


CONST. REV.
R/W REV.

PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION
INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION

SOIL SAMPLE TEST RESULTS															
SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)			MOISTURE %	ORGANIC %
							C. SAND	F. SAND	SILT	CLAY	2.0 mm	#25 um	75 um		
S-42	11+20	CL	0.30-0.91	A-2(4)	18	3	51.4	24.6	12.0	12.1	97	87	25		
S-43	11+20	CL	3.05-3.97	A-6(11)	35	18	11.3	24.0	22.5	42.3	98	91	71	28.8	
SS-34	13+00	GL	0.30-0.45	A-6(8)	27	13	32.6	19.9	23.3	24.1	99	78	51	16.4	
SS-35	13+00	CL	1.52-1.97	A-1(6)	15	NP	71.4	18.4	5.1	7.0	97	49	13		
SS-36	13+00	CL	3.56-4.01	A-2(0)	19	NP	61.1	37.6	0.3	1	100	76	2		
SS-37	13+00	CL	9.66-10.11	A-2(6)	29	15	64	17.1	2.8	16.1	97	59	19		
S-44	14+80	CL	0.30-0.61	A-2(4)	14	NP	20.4	50.3	17.2	12.1	100	89	35		
S-45	14+80	CL	0.61-1.37	A-7(6)	44	25	30.7	20.6	12.1	36.4	100	77	52	18	
SS-60	16+54	CL	0.76-1.21	A-1(6)	17	NP	83	11.8	3.1	2	99	46	6		
SS-61	16+54	CL	3.05-3.50	A-1(6)	21	NP	92.6	5.8	0.6	1	99	21	2		


PI = 12+50.000
EL = 56.370 m
VC = 330 m
K = 42

-SR2-

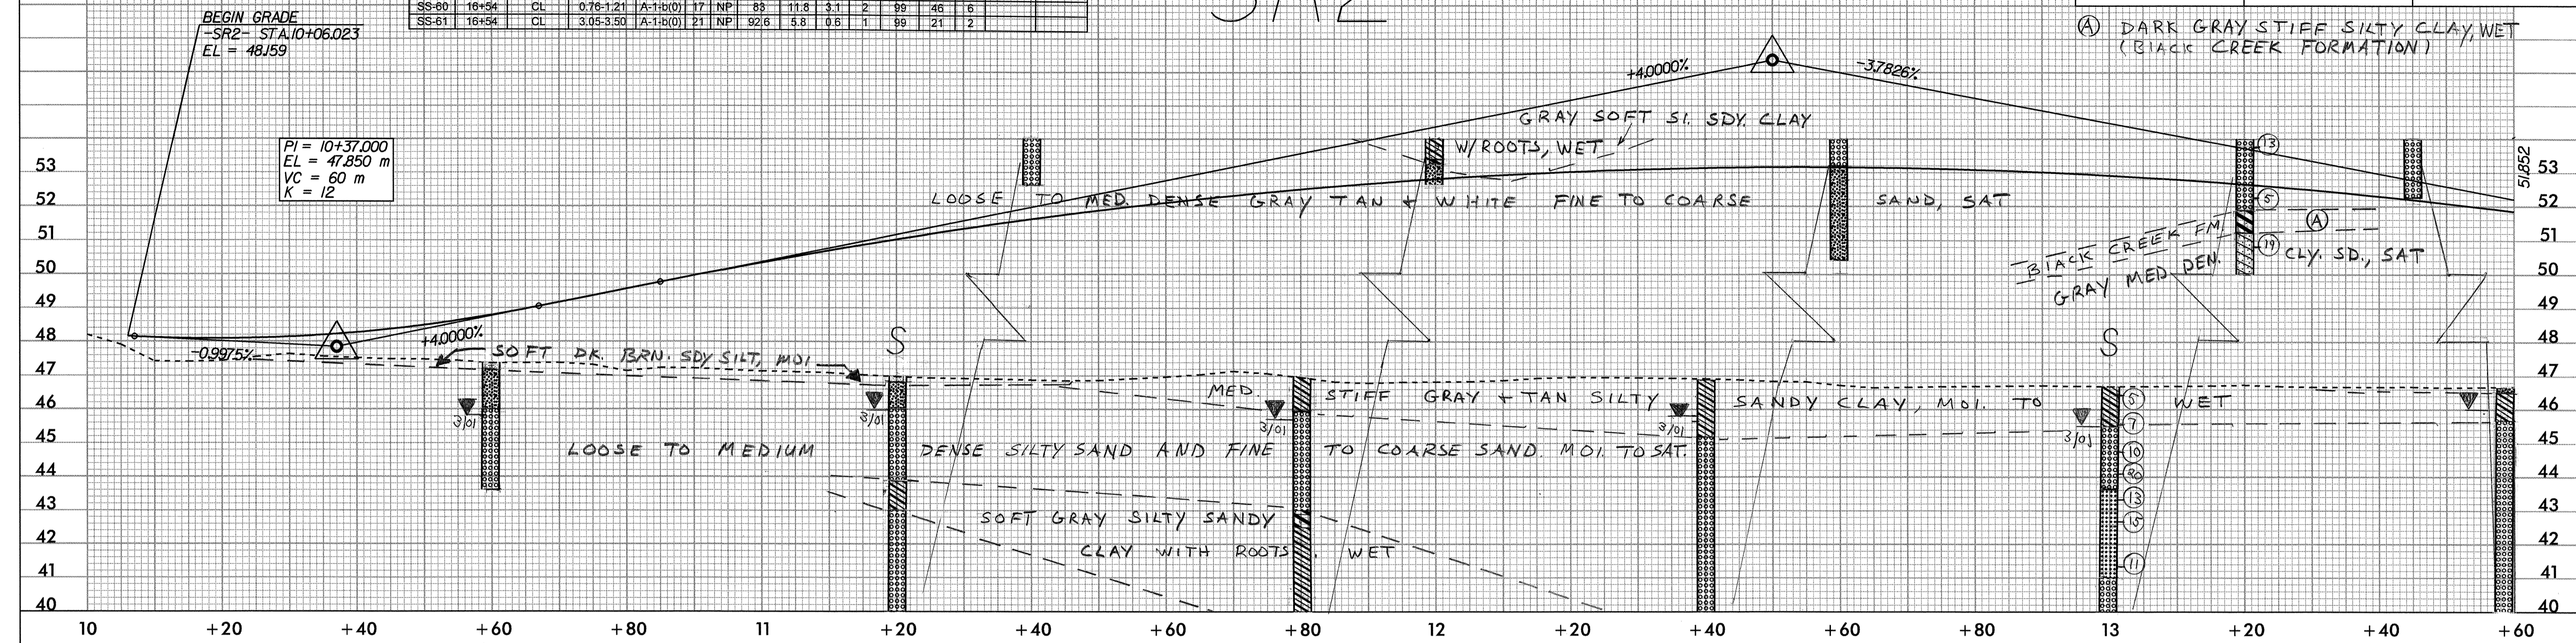

(A) DARK GRAY STIFF SILTY CLAY, WET
(BLACK CREEK FORMATION)

-SR2-

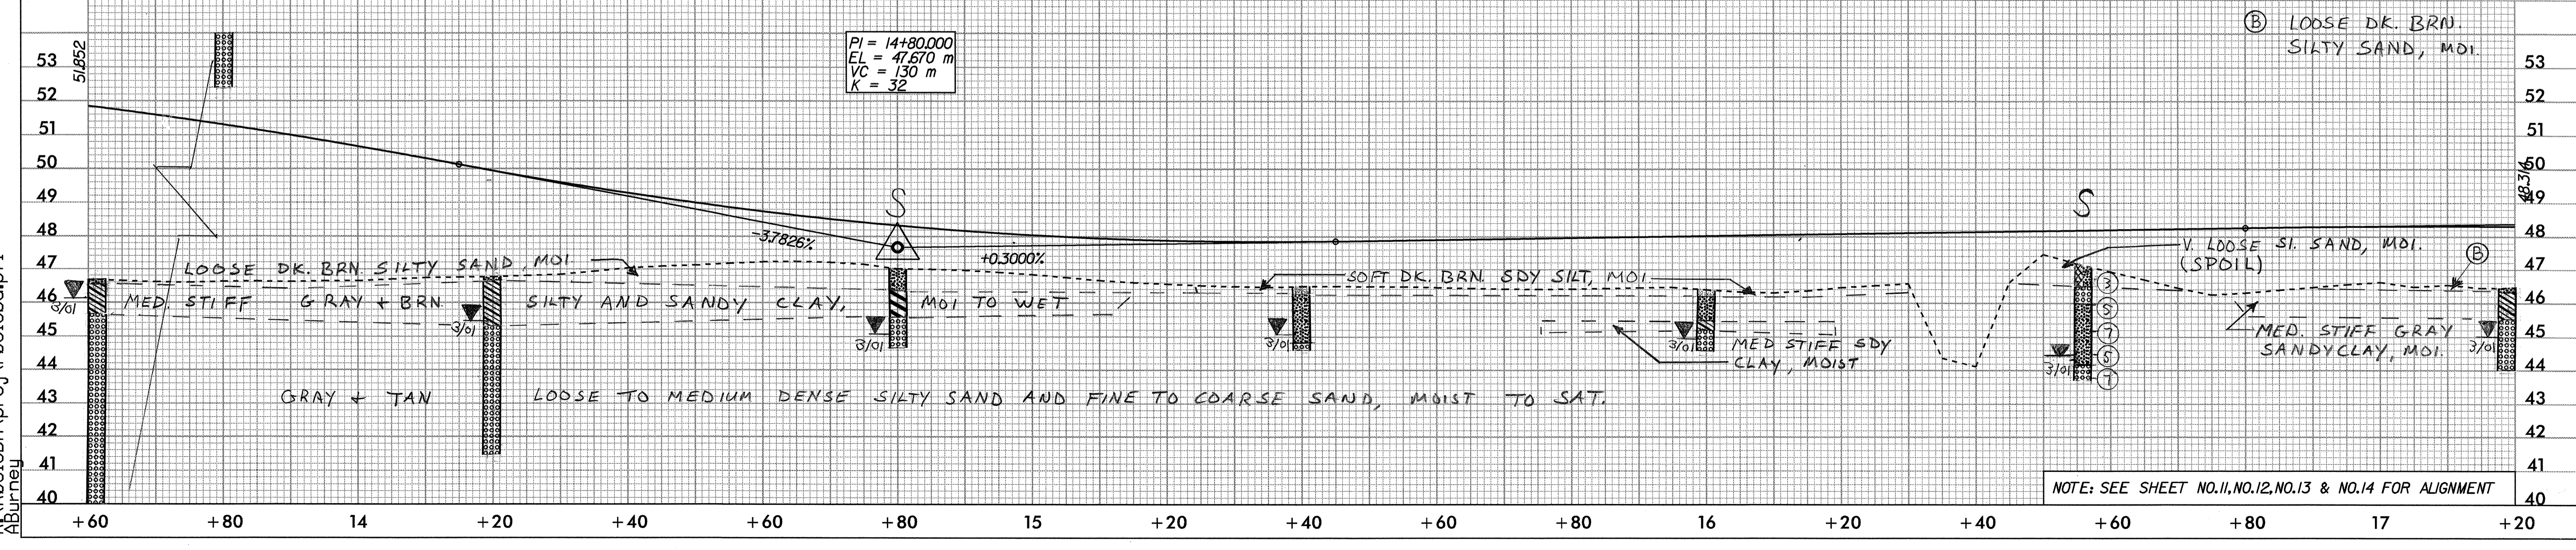

(B) LOOSE DK. BRN. SILTY SAND, MOI.

NOTE: SEE SHEET NO. 11, NO. 12, NO. 13 & NO. 14 FOR ALIGNMENT

28-DEC-2000 14:55
R:\R0513BA\proj\A-0513ba.pfl
ABurney