


INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION
PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

CONST. REV.
R/W REV.


-RPDYI-

SOIL SAMPLE TEST RESULTS															
SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			MOISTURE	ORGANIC
							C-SAND	F-SAND	SILT	CLAY	2.0 mm	425 um	75 um		
SS-178	18+80	CL	0.30-0.45	A-2-4(0)	17	NP	45.5	32.0	14.4	8.1	99	73	27		
SS-179	18+80	CL	0.76-1.21	A-2-6(0)	25	11	46.2	23.8	7.9	22.2	99	71	33		
SS-180	18+80	CL	1.52-1.97	A-1-8(0)	19	NP	76.7	13.2	2	8.1	100	49	11		
SS-181	18+80	CL	4.15-4.60	A-2-4(0)	17	NP	66.6	22.6	2.8	8.1	95	51	11		
SS-182	18+80	CL	7.16-7.64	A-8(0)	38	21	19.9	24.8	19	36.3	100	92	59	23.0	
SS-183	18+80	CL	6.72-9.17	A-3(0)	20	NP	69.8	32.4	1.7	6	98	59	8		
SS-184	18+80	CL	11.77-12.22	A-1-8(0)	16	NP	69.8	22.2	2	6	94	46	9		

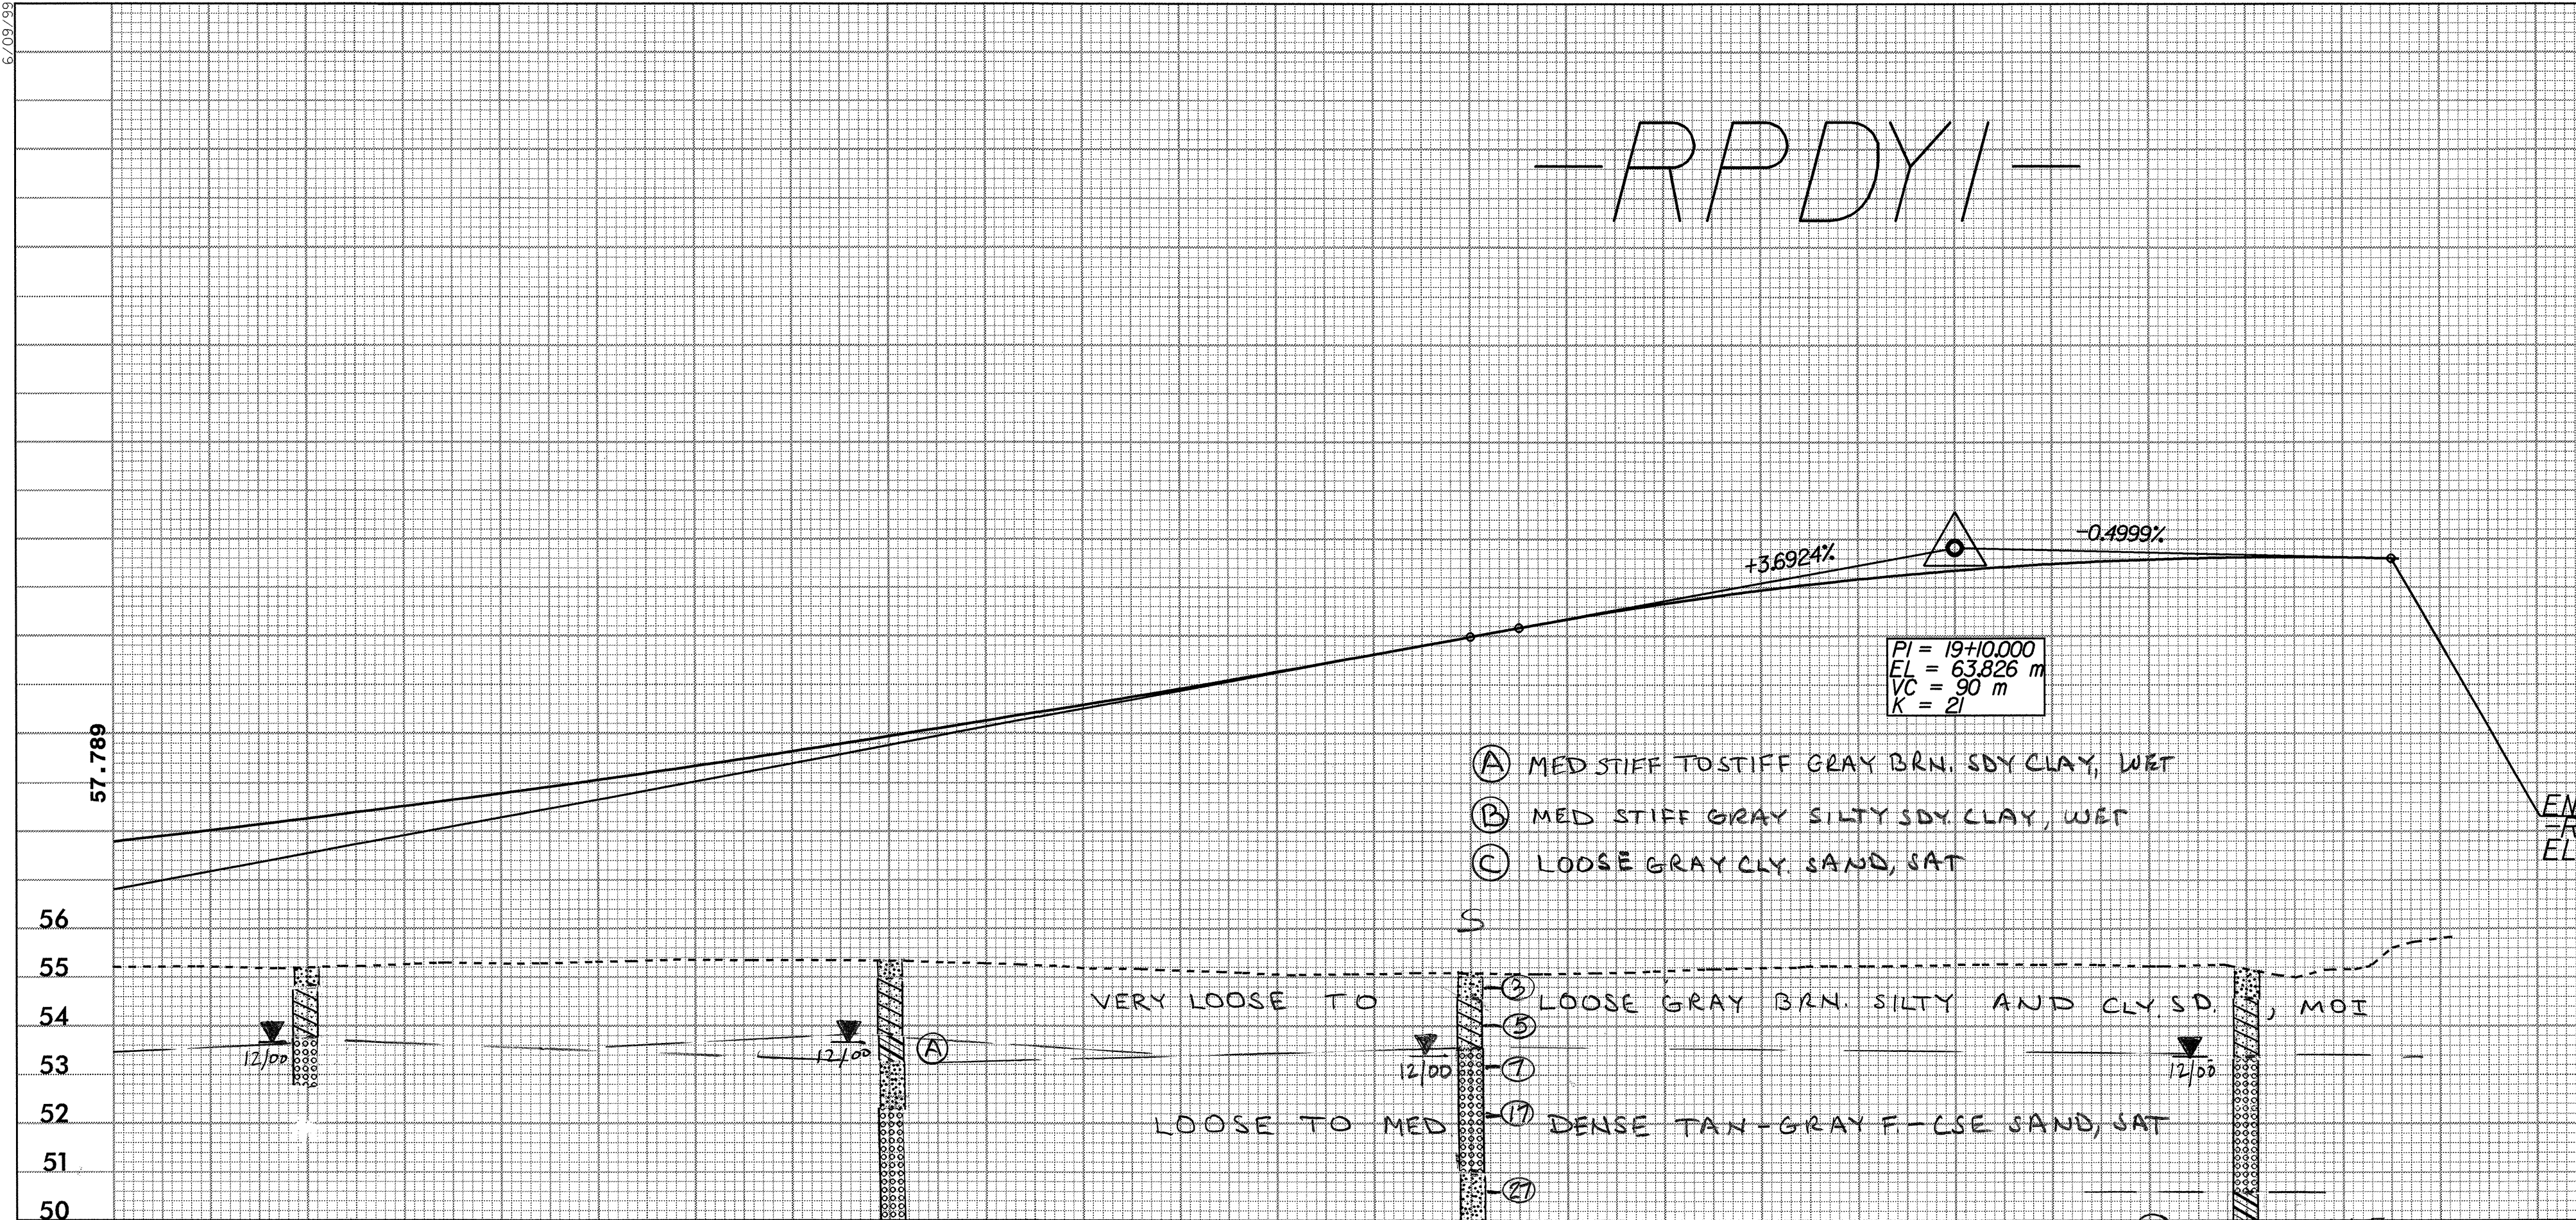

NOTE: SEE SHEET NO. 6 FOR ALIGNMENT

SOIL SAMPLE TEST RESULTS															
SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			MOISTURE	ORGANIC
							C-SAND	F-SAND	SILT	CLAY	2.0 mm	425 um	75 um		
S-173	11+00	CL	0.30-0.91	A-7-6(11)	41	20	22.0	17.1	22.7	38.3	98	85	63		
SS-191	12+20	CL	0.30-0.45	A-2-4(0)	22	8	41.5	29.4	6.9	22.2	100	85	31		
SS-192	12+20	CL	0.76-1.21	A-2-4(0)	18	NP	63.1	26.5	3.3	7	100	73	11		
SS-193	12+20	CL	1.52-1.97	A-1-8(0)	11	NP	87.7	10.9	0.4	1	97	37	2		

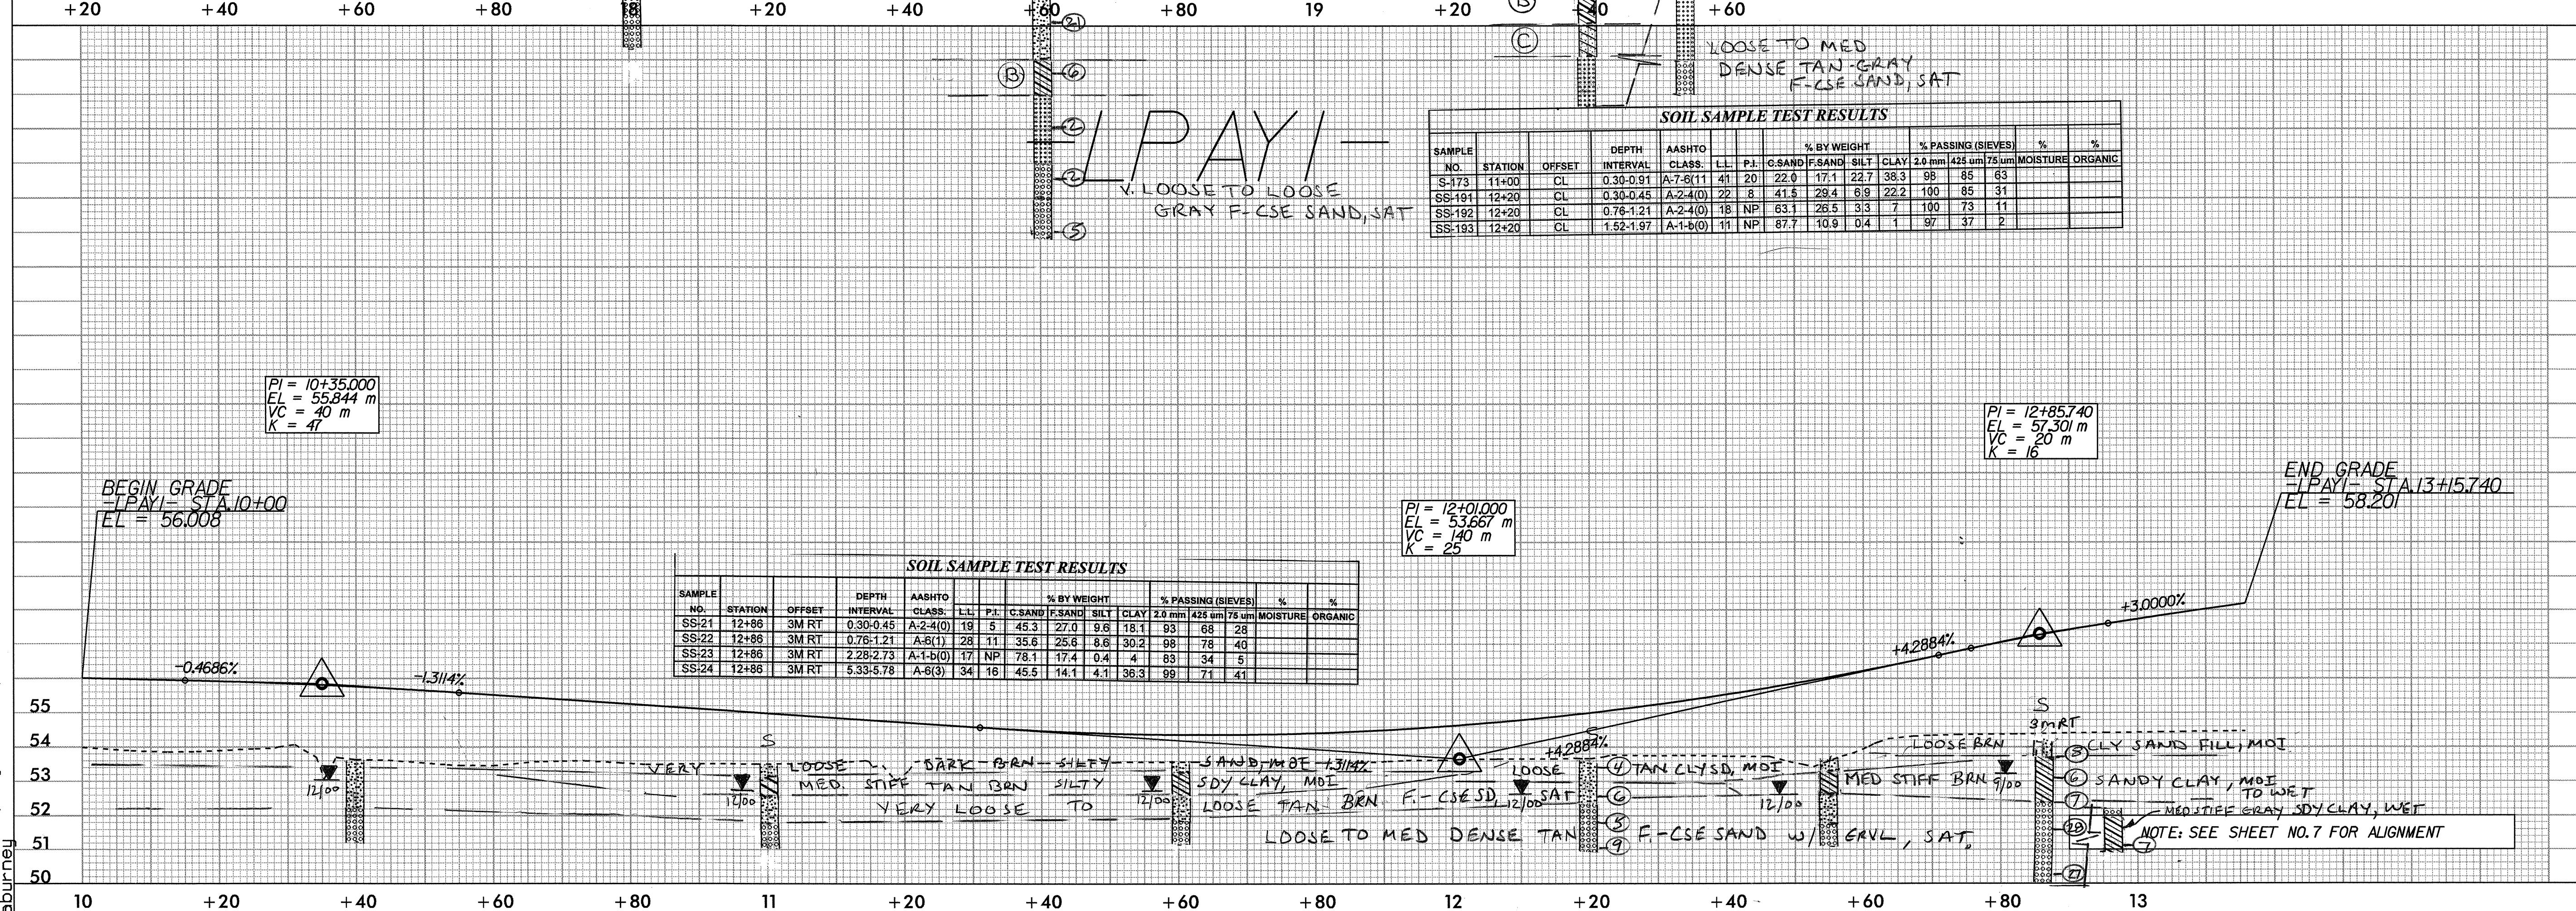

SOIL SAMPLE TEST RESULTS															
SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			MOISTURE	ORGANIC
							C-SAND	F-SAND	SILT	CLAY	2.0 mm	425 um	75 um		
SS-21	12+86	3M RT	0.30-0.45	A-2-4(0)	19	5	45.3	27.0	9.8	18.1	93	68	28		
SS-22	12+86	3M RT	0.76-1.21	A-6(1)	28	11	35.6	25.6	8.8	30.2	99	76	40		
SS-23	12+86	3M RT	2.28-2.73	A-1-8(0)	17	NP	78.1	17.4	0.4	4	83	34	5		
SS-24	12+86	3M RT	5.33-5.78	A-6(3)	34	16	45.5	14.1	4.1	36.3	99	71	41		

NOTE: SEE SHEET NO. 7 FOR ALIGNMENT

09-NOV-2000 09:36
r:\r0513a\proj\0513a.p1
aburney