



**INCOMPLETE PLANS**  
 DO NOT USE FOR R/W ACQUISITION  
**PRELIMINARY PLANS**  
 DO NOT USE FOR CONSTRUCTION

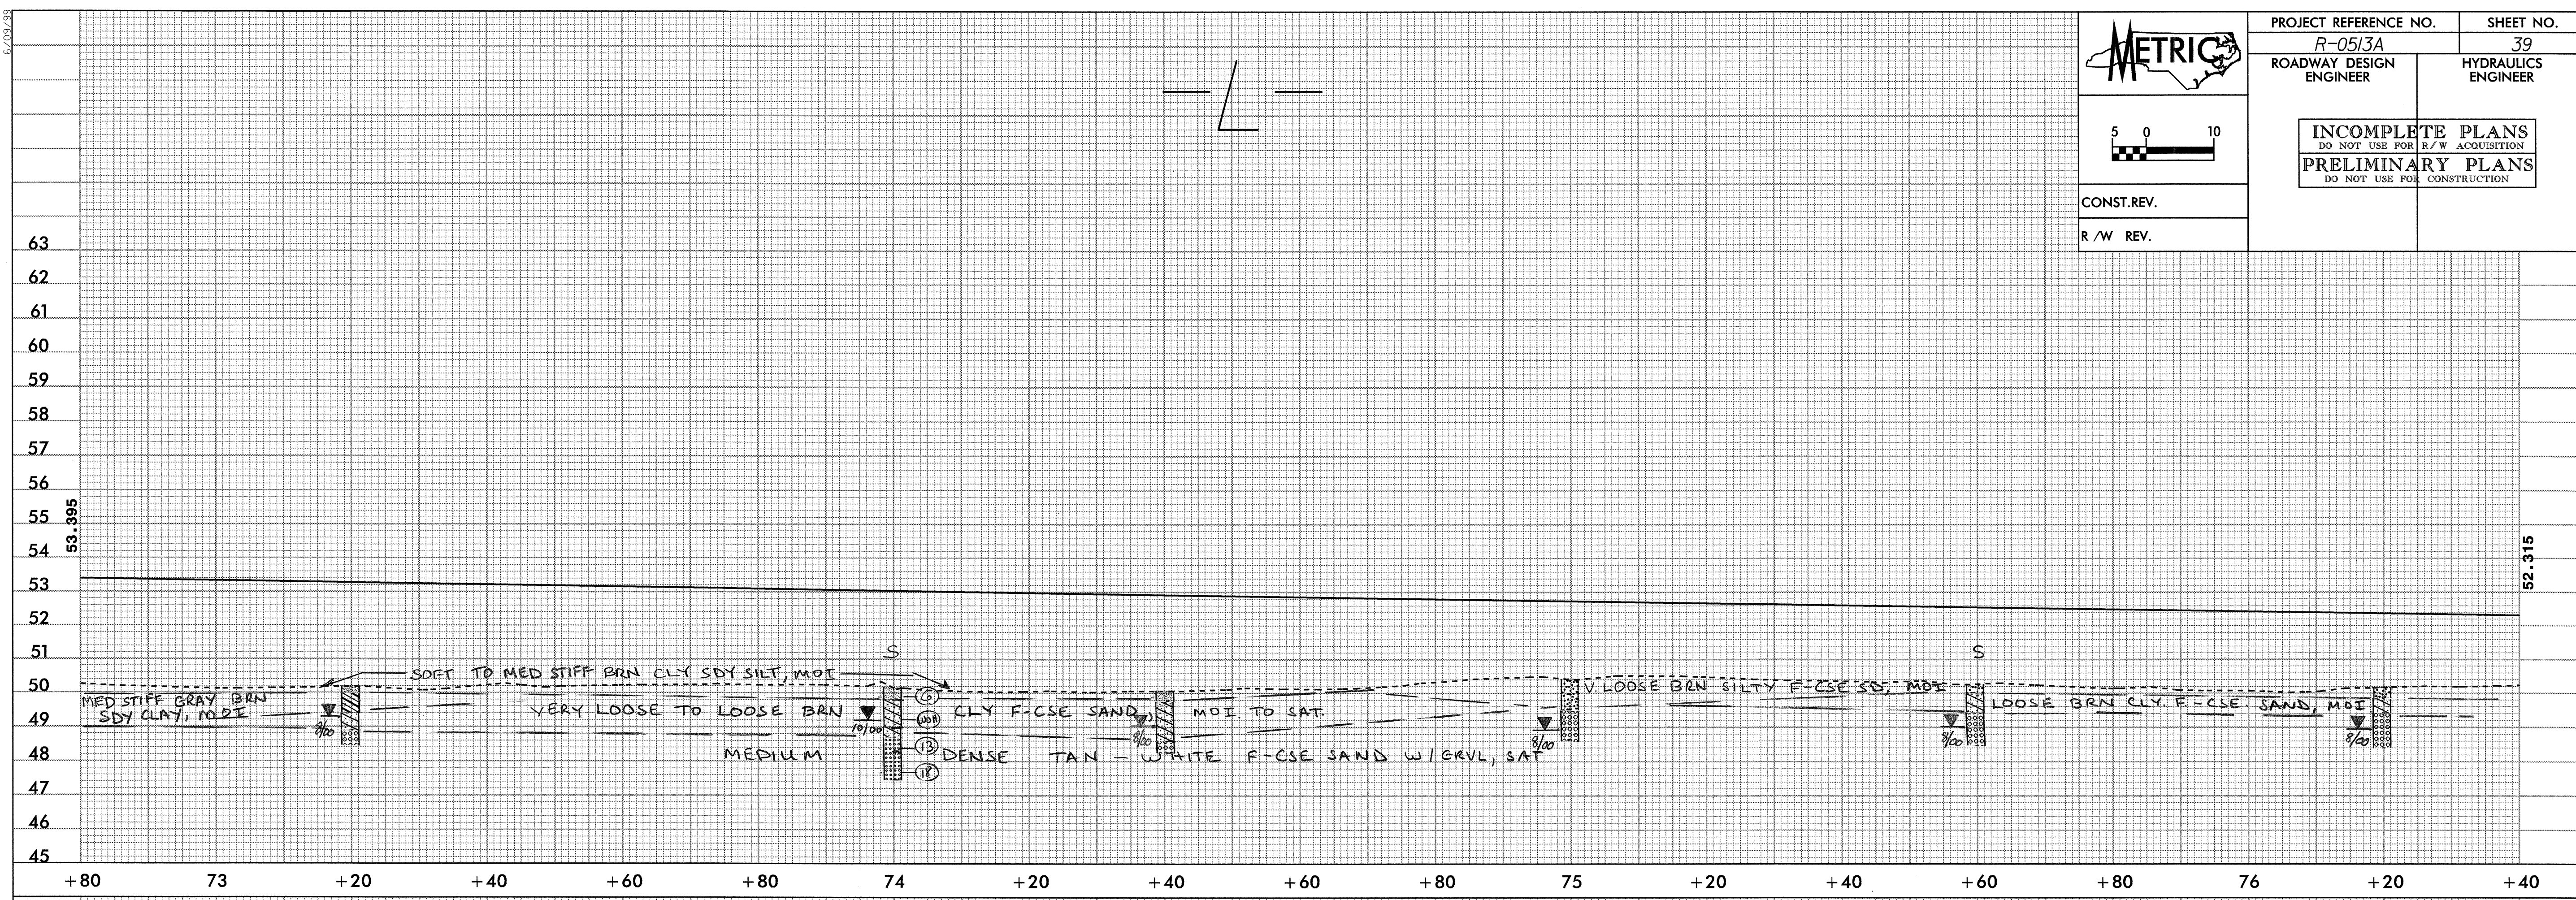

**SOIL SAMPLE TEST RESULTS**

SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							SAND	F SAND	SILT	CLAY	2.0mm	425um	75um		
SS-98	74+00	CL	0.30-0.45	A-4(0)	22	7	43.1	22.6	15.3	19.1	99	26	26		
SS-99	74+00	CL	0.76-1.21	A-2.8(0)	25	11	49.0	18.7	13.3	19.1	99	68	33		
SS-100	74+00	CL	1.52-1.97	A-3(0)	20	NP	67.9	30.1	0.0	2.0	99	98	3		
S-85	75+60	CL	0.30-0.76	A-2.8(0)	27	12	57.8	13.0	10.0	19.2	99	63	31		
S-86	75+60	CL	0.76-1.37	A-1-b(0)	18	NP	88.0	9.3	0.7	2.0	98	41	3		
S-87	75+60	CL	1.37-1.83	A-1-b(0)	20	NP	88.3	11.4	0.3	0.0	97	38	0		
SS-92	78+33	CL	0.30-0.46	A-2.4(0)	27	NP	66.0	19.4	7.6	13.1	100	66	22		
SS-93	78+33	CL	0.76-1.21	A-3(0)	19	NP	62.1	29.0	2.8	6.0	99	65	10		
SS-94	78+33	CL	1.52-1.97	A-1-b(0)	15	NP	80.4	17.5	0.1	2.0	95	42	2		

BM#11 - RR SPIKE IN BASE OF 400mm OAK  
 81.300m RT. - BL - STA. 84+60.500 EL= 50.582

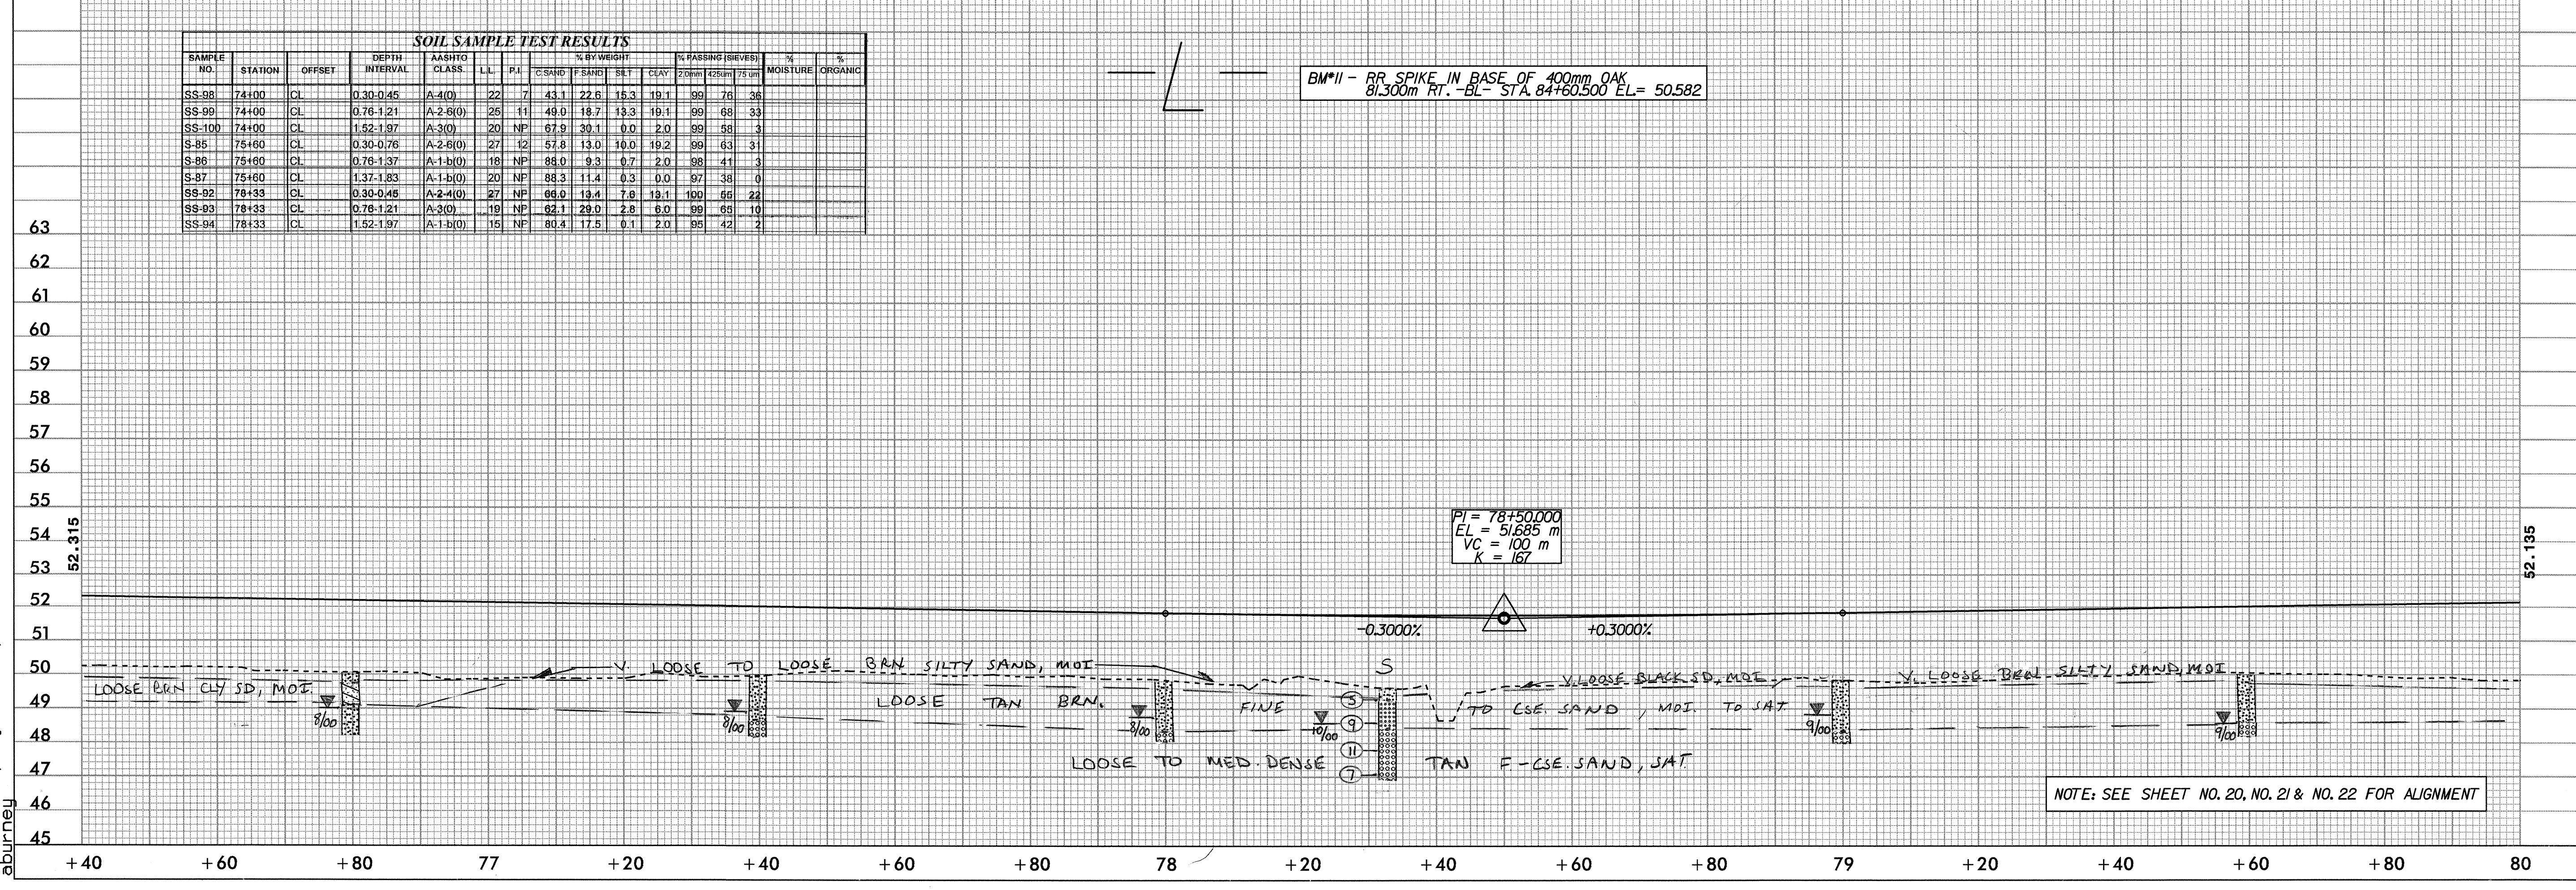

NOTE: SEE SHEET NO. 20, NO. 21 & NO. 22 FOR ALIGNMENT

09-NOV-2000 09:37  
 r:\r0513a\proj\r0513a.pfl  
 aburney