


CONST. REV.
R / W REV.

INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION
PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

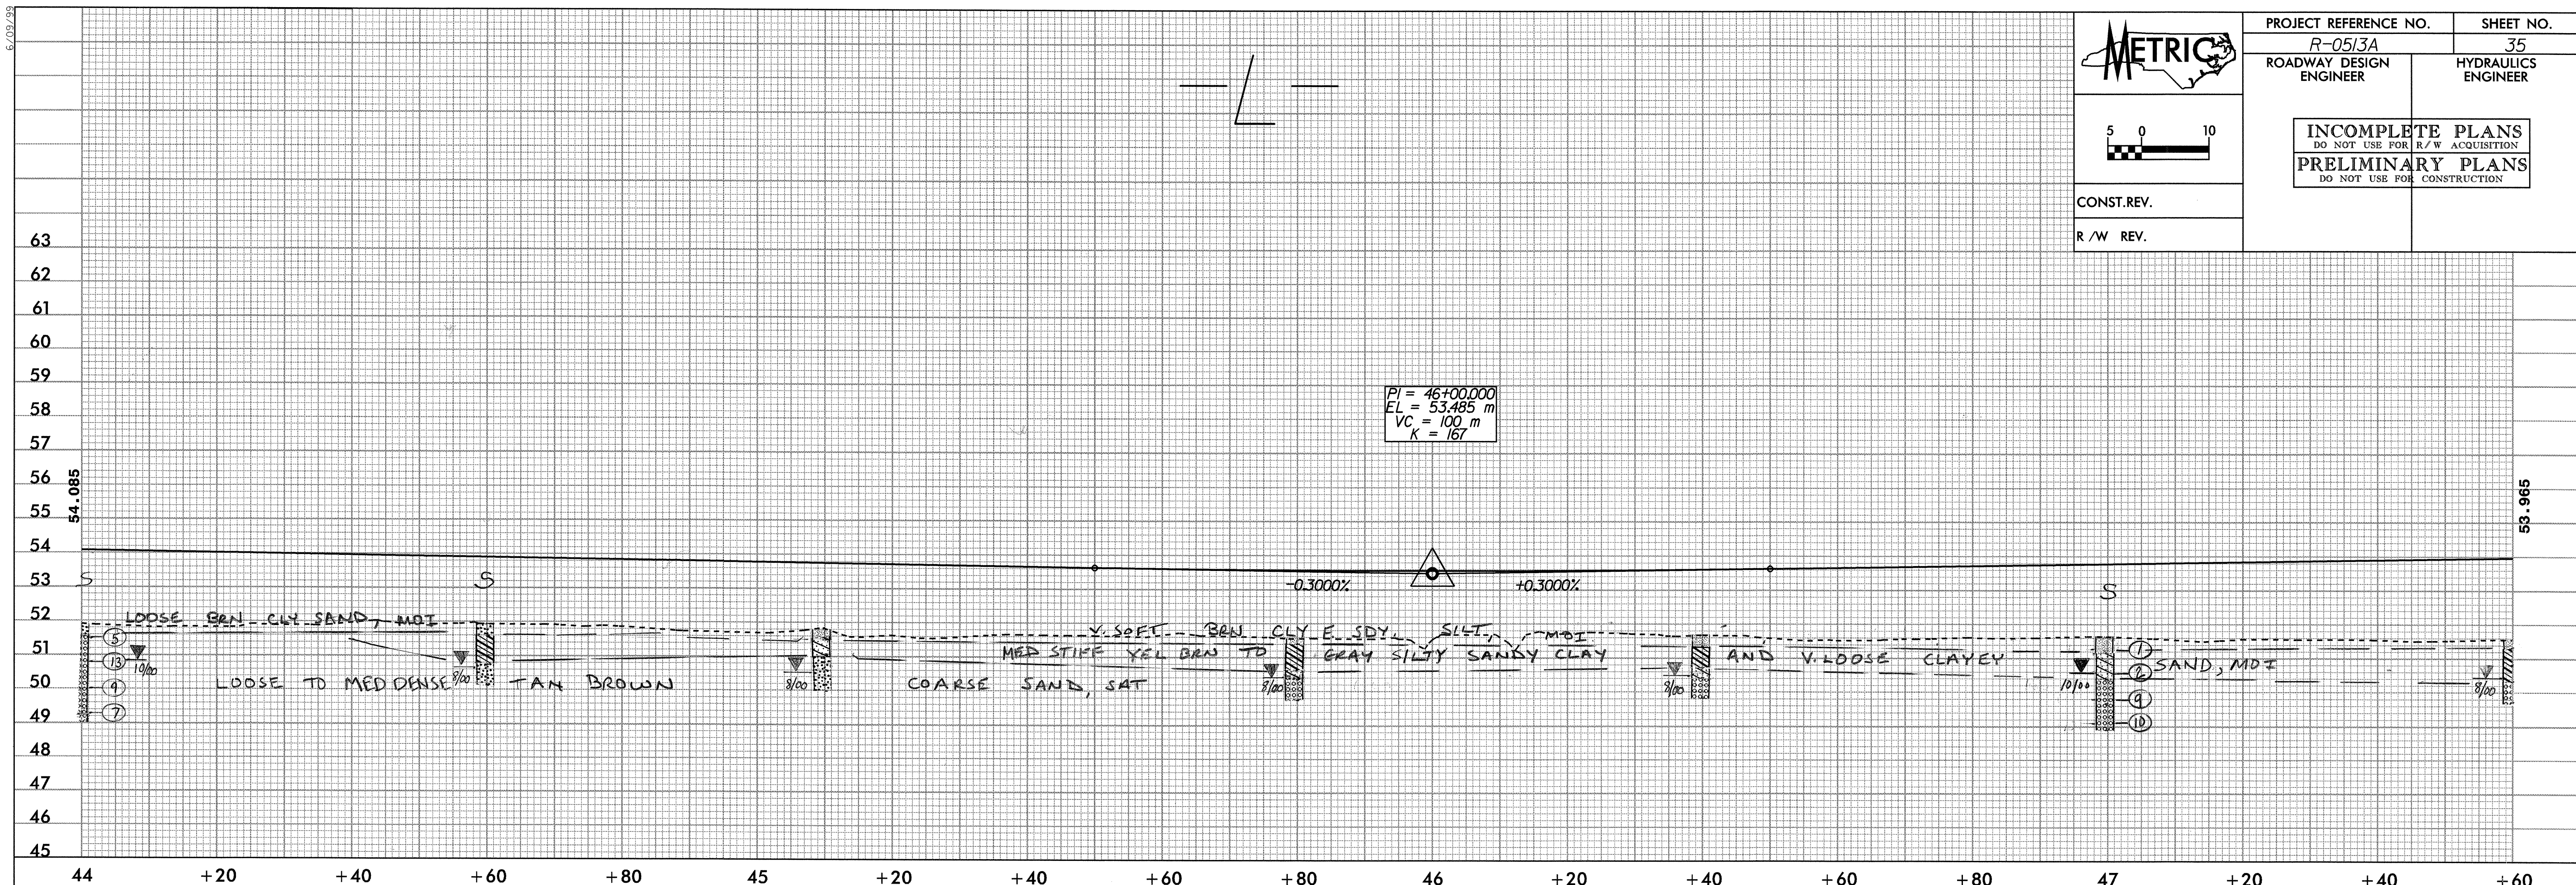


PI = 46+00.000
EL = 53.485 m
VC = 100 m
K = 167

BM#6 - RR SPIKE IN BASE OF 300mm WHITE OAK
95.400m LT. - BL - STA. 45+48.800 EL = 52.205

SOIL SAMPLE TEST RESULTS

SAMPLE NO.	STATION	OFFSET	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	2.0mm	425um	75 um		
SS-72	44+00	CL	0.30-0.45	A-2-4(0)	26	9	59.3	15.9	5.7	19.1	100	62	26		
SS-73	44+00	CL	0.76-1.21	A-1-4(0)	22	NP	80.0	16.1	0.9	3.0	98	45	4		
SS-74	44+00	CL	2.28-2.73	A-1-4(0)	20	NP	70.6	24.7	1.7	3.0	96	47	5		
S-56	44+60	CL	0.30-0.91	A-6(3)	27	12	39.6	20.1	22.1	24.2	99	76	50	14.3	
S-57	44+60	CL	0.91-1.22	A-6(9)	39	22	32.4	14.3	15.0	38.3	99	77	55		
SS-75	47+00	CL	0.76-1.21	A-2-6(1)	31	15	51.1	15.4	7.4	26.1	99	67	34		
SS-76	47+00	CL	1.52-1.97	A-1-4(0)	21	NP	85.6	10.9	0.4	2.0	98	39	3		
S-58	48+80	CL	0.30-0.76	A-6(4)	28	12	20.9	25.8	24.1	28.2	100	86	58	16.5	
S-59	48+80	CL	0.76-1.22	A-6(7)	33	19	17.9	25.2	24.7	32.2	100	89	62	17.1	
S-60	48+80	CL	1.22-1.83	A-1-4(0)	21	6	78.9	9.5	2.6	9.1	95	37	12		

PI = 48+70.000
EL = 54.295 m
VC = 100 m
K = 164

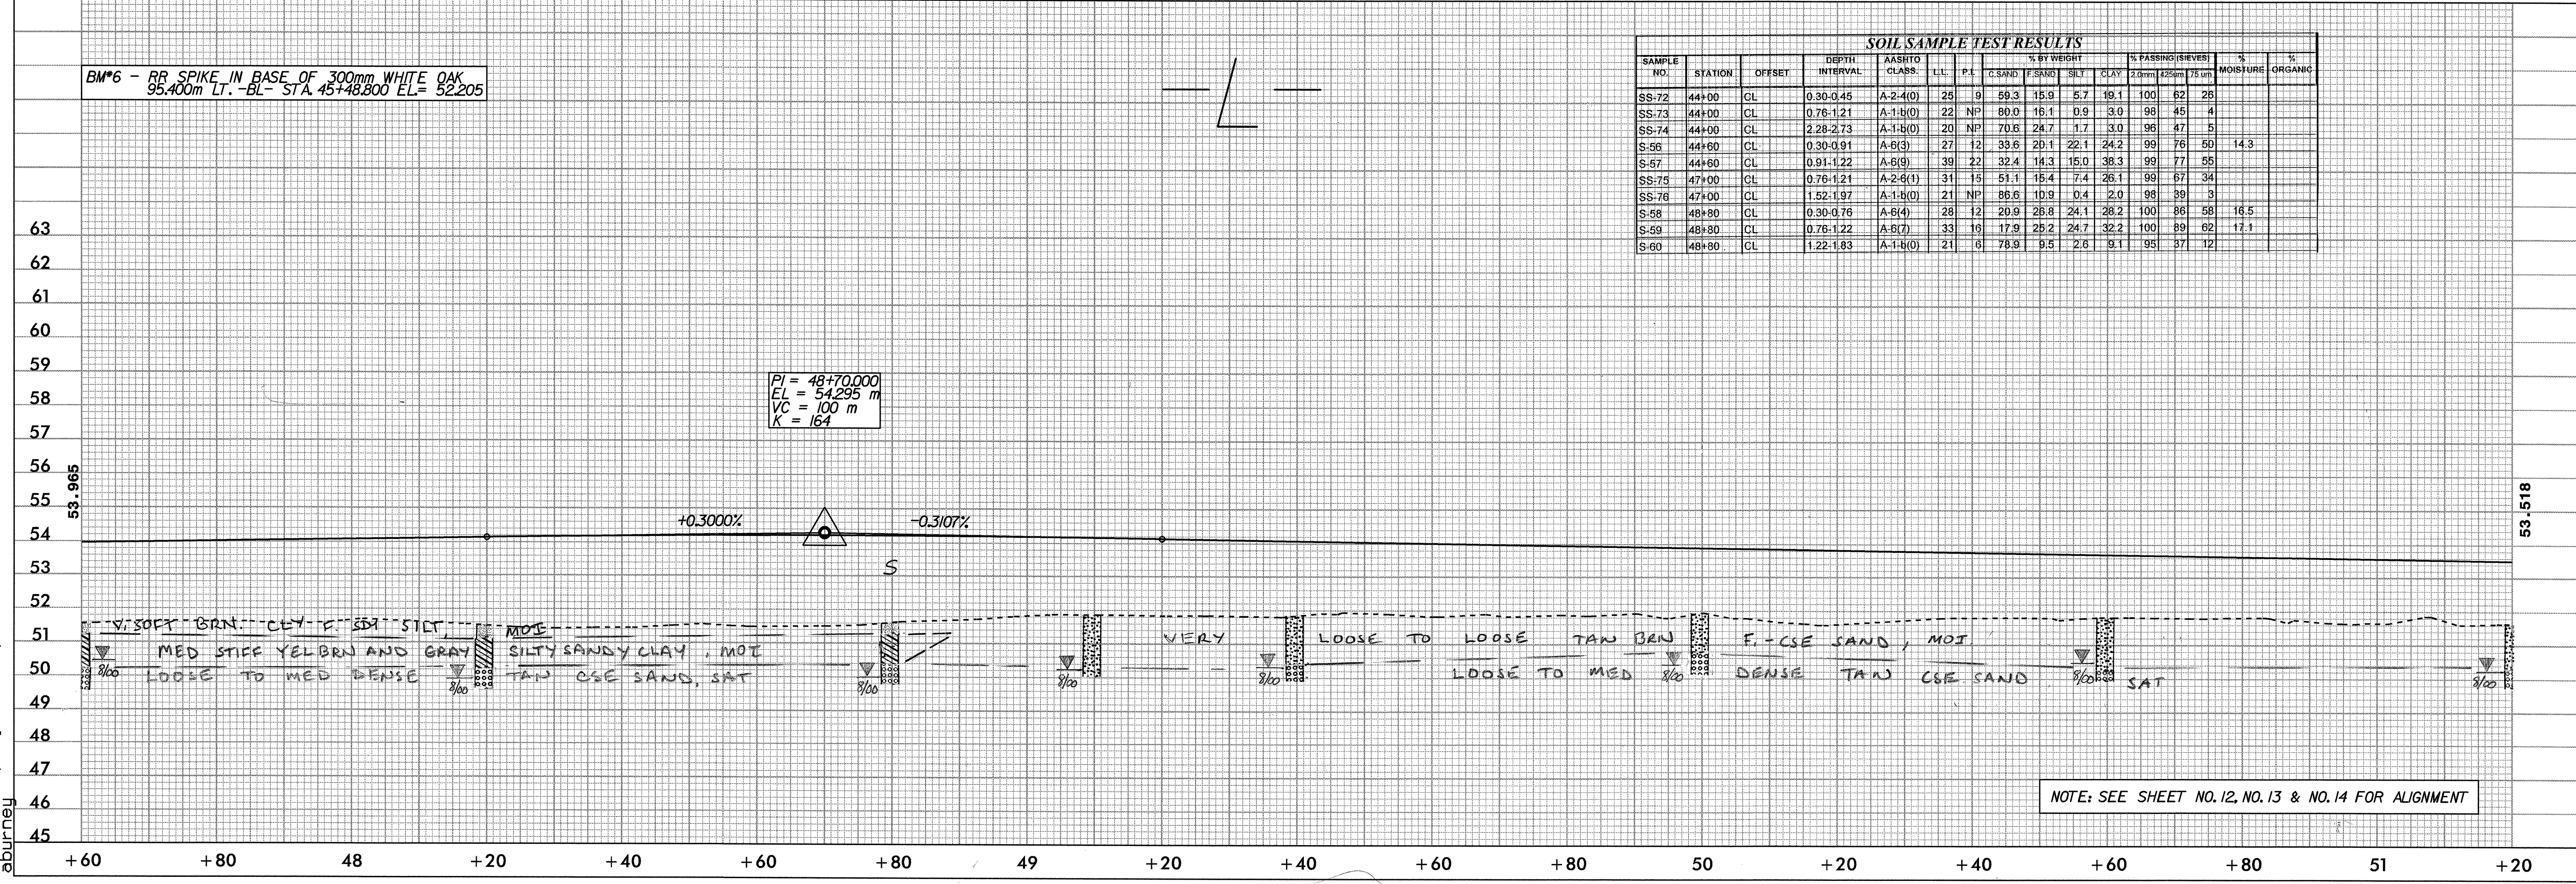

NOTE: SEE SHEET NO. 12, NO. 13 & NO. 14 FOR ALIGNMENT

09-NOV-2000 09:37
r:\0513a\proj\0513a.pfl
aburney