


**Project Special Provisions  
Structures & Culverts**

**Table of Contents**

	<b>Page #</b>
Maintenance & Protection of Traffic Beneath Proposed Structure at Station 113+73.429 -L- Left Ln & Right Ln (8-13-04)	1
Falsework and Forms Over or Adjacent to Traffic (10-12-01)	1
Pot Bearings (8-13-04)	2
Thermal Sprayed Coatings (Metallization) (2-14-04)	6
Minimizing Railroad Flagging Service (10-12-01)	10
Adhesively Anchored Anchor Bolts or Dowels (10-12-01)	11
Evazote Joint Seals (8-13-04)	14
Epoxy Protective Coating (10-12-01)	18
Optional Precast Reinforced Concrete Box Culvert at Station 14+19.671 -RP B-, 14+40.000 -Y1-, 120+86.500 -L-, & 12+42.500 -Y2- (2-14-04)	20
Elastomeric Concrete (10-12-01)	26
Falsework and Formwork (10-12-01)	27
Submittal of Working Drawings (8-13-04)	33
Metric Structural Steel (10-12-01)	39
Optional Disc Bearings (10-03-02)	40
Elastomeric Bearings (10-03-02)	44
Charpy V-Notch Tests (SPECIAL)	45
2080 mm Chain Link Fence (SPECIAL)	45
High Performance Steel (SPECIAL)	46
Bearing Piles (SPECIAL)	50
Railroad Provisions (SPECIAL)	

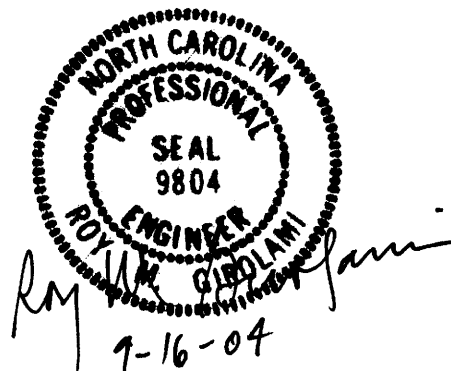

**PROJECT SPECIAL PROVISIONS**  
**STRUCTURES AND CULVERTS**

PROJECT R-513A&amp;BA

ROBESON COUNTY

**MAINTENANCE AND PROTECTION OF TRAFFIC**  
**BENEATH PROPOSED STRUCTURE AT STATION**  
**113+73.429 -L- LEFT LN & RIGHT LN**

(8-13-04)

Maintain traffic on NC 710 as shown in Traffic Control Plans and as directed by the Engineer.

Provide a minimum temporary vertical clearance of 4.6 m at all times during construction.

Submit plans and calculations for review and approval for protecting traffic and bracing girders, as described herein, at the above station before beginning work at this location. Have the drawings and design calculations prepared, signed, and sealed by a North Carolina Registered Professional Engineer. The approval of the Engineer will not relieve the Contractor of the responsibility for the safety of the method or equipment.

Protect traffic from any operation that affords the opportunity for construction materials, equipment, tools, etc. to be dropped into the path of traffic beneath the structure. Based on Contractor means and methods determine and clearly define all dead and live loads for this system, which, at a minimum, shall be installed between beams or girders over any travelway or shoulder area where traffic is maintained. Install the protective system before beginning any construction operations over traffic. In addition, for these same areas, keep the overhang falsework in place until after the rails have been poured.

Brace girders to resist wind forces, weight of forms and other temporary loads, especially those eccentric to the vertical axis of the member during all stages of erection and construction. Before casting of intermediate diaphragms, decks, or connecting steel diaphragms do not allow the horizontal movement of girders to exceed ½ inch (13mm).

Payment at the contract unit prices for the various pay items will be full compensation for the above work.

**FALSEWORK AND FORMS OVER OR ADJACENT TO TRAFFIC**

(10-12-01)

This Special Provision applies in addition to Article 420-3 of the Standard Specifications.

This Special Provision covers falsework or forms including metal stay-in-place forms and precast concrete deck panels erected over vehicular, pedestrian or railroad traffic, or vessel traffic on navigable waterways. It also covers falsework and forms for those parts of a substructure unit constructed within 20 ft. (6 m) of the edge of a travelway or railroad track and more than 25 ft. (7.6 m) above the ground line at the time of substructure construction.

**1.0 SUBMITTALS**

Submit detailed drawings as required by the Standard Specifications or other Special Provisions and one set of design calculations for falsework and forms for review and acceptance before beginning construction of the falsework or forms. Have the drawings and design calculations prepared, signed and sealed by a North Carolina Registered Professional Engineer. These submittal requirements apply to all falsework and form systems covered by this Special Provision.

**2.0 DESIGN**

Design falsework and forms for the combined effects of dead load and live load and with appropriate safety factors in accordance with these Special Provisions and the respective design codes of the materials used. Include the weight of concrete, reinforcing steel, forms and falsework in the dead load. Live load includes the actual weight of any equipment the falsework supports, applied as concentrated loads at the points of contact, and a uniform load of not less than 20 lbs/ft<sup>2</sup> (1.0 kPa) applied over the supported area. In addition, apply a line load of 75 lbs/ft (1.1 kN/m) along the outside edge of deck overhangs.

**3.0 INSPECTION**

Before the form or falsework system is loaded, inspect the erected falsework and forms and submit a written statement certifying that the erected falsework system complies with the accepted detailed drawings prepared by the Registered Professional Engineer. Submit a separate certification for each span, unit, or bridge component. Any condition that does not comply with the accepted drawings, or any other condition deemed unsatisfactory by the Engineer, is cause for rejection until corrections are made.

**4.0 BASIS OF PAYMENT**

Payment at the contract unit prices for the various pay items will be full compensation for the above work required for falsework or forms.

**POT BEARINGS****(8-13-04)****1.0 GENERAL**

This item consists of furnishing, fabrication and installation of pot bearings in accordance with AASHTO Standard Specifications, the Standard Specifications, the recommendations of the manufacturer and the details shown on the plans and as specified herein.

Fixed pot bearings consist of a sole plate, a disc of elastomer in a steel cylinder with a snug fitting steel piston, masonry plate, anchor bolts, nuts and washers. Expansion pot bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed pot bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe

sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans.

## 2.0 MATERIALS

Use pot bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the pot bearings. Clean, coat, and seal the plates in the pot bearing assemblies except for the areas with special facings and the internal surfaces of pot, in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)". Metallization of the internal surfaces of the pot is permitted provided these surfaces are then polished to a surface smoother than 63 micro inches (0.0016 mm) root mean square. Coat surfaces to a thickness of 6 mils (0.150 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)".

Galvanize all fill plates specified on the plans. Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion pot bearings that is at least 16 gage or 1/16" (1.6 mm). When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A240/A167 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the piston, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195°C to 260°C).

Provide a neoprene or natural rubber elastomer with a durometer hardness of 50 that allows for a minimum rotation of 0.02 radians. Place a 1/64" (0.4 mm) thick unfilled PTFE disc on either side of the elastomer inside the bearing. Use a brass sealing ring with the neoprene or natural rubber elastomer.

### 3.0 DESIGN

Have the manufacturer design the pot bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine, cast as a single piece, or weld together the sole plate and top plate/piston and the cylinder with the masonry plate.

When designing the bearings, use the following allowable bearing stresses:

- On confined elastomer: 3500 psi (24.1 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

### 4.0 SAMPLING AND TESTING

#### A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. Have the manufacturer furnish the results of the tests to the Materials and Tests Engineer.

#### B. Testing

##### 1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep the steel bearing plate and steel piston in continuous and uniform contact for the duration of the test. Any observed lift-off is cause for rejection.

## 2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing's design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing's vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficients of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

## 3. Test Method

For the test method and equipment, meet the following requirements:

- a. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- b. Clean the bearing surface prior to testing.
- c. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.
- d. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:

0.04	unfilled PTFE
0.08	filled PTFE

- e. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

**5.0 INSTALLATION**

Prior to shipment, seal the joint between the steel piston and the steel cylinder with a bead of caulk. Store pot bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer's direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

**6.0 BASIS OF PAYMENT**

Payment will be at the lump sum contract price bid for "Pot Bearings" which price will be full compensation for furnishing all labor, materials, tools, equipment and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer's requirements and as directed by the Engineer.

**THERMAL SPRAYED COATINGS (METALLIZATION)****(2-14-04)****1.0 DESCRIPTION**

Apply a thermal sprayed coating (TSC) and sealer to metal surfaces as specified herein when called for on the plans or by other Special Provisions, or when otherwise approved by the Engineer in accordance with the SSPC-CS 23.00/AWS C2.23/NACE No. 12 Specification. Only Arc Sprayed application methods are used to apply TSC coatings, the Engineer must approve other methods of application.

**2.0 QUALIFICATIONS**

Only use NCDOT approved TSC Contractors meeting the following requirements:

1. Who have the capability of blast cleaning steel surfaces to SSPC SP-5 and SP-10 Finishes.
2. Who employ a Spray Operator(s) qualified in accordance with AWS C.16/C2.16M2002 and a Quality Control Inspector(s) who have documented training in the applicable test procedures of ASTM D-3276 and SSPC-CS 23.00.

A summary of the contractor's related work experience and the documents verifying each Spray Operator's and Quality Control Inspector's qualifications are submitted to the Engineer before any work is performed.

### 3.0 MATERIALS

Provide wire in accordance with the metallizing equipment manufacturer's recommendations. Use the wire alloy specified on the plans which meets the requirements in Annex C of the SSPC-CS 23.00 Specification. Have the contractor provide a certified analysis (NCDOT Type 2 Certification) for each lot of wire material.

Apply an approved sealer to all metallized surfaces in accordance with Section 9 of SSPC-CS 23. The sealer must either meet SSPC Paint 27 or is an alternate approved by the Engineer.

### 4.0 SURFACE PREPARATION AND TSC APPLICATION

Grind flame cut edges to remove the carbonized surface prior to blasting. Bevel all flame cut edges in accordance with Article 442-10(D) regardless of included angle. Blast clean surfaces to be metallized with grit or mineral abrasive in accordance with Steel Structures Painting Council SSPC SP-5/10(as specified) to impart an angular surface profile of 2.5 - 4.0 mils (0.063 – 0.100 mm). Surface preparation hold times are in accordance with Section 7.32 of SSPC-CS 23. If flash rusting occurs prior to metallizing, blast clean the metal surface again. Apply the thermal sprayed coating only when the surface temperature of the steel is at least 5°F (3°C) above the dew point.

At the beginning of each work period or shift, conduct bend tests in accordance with Section 6.5 of SSPC-CS 23.00. Any disbonding or delamination of the coating that exposes the substrate requires corrective action, additional testing, and the Engineer's approval before resuming the metallizing process.

Apply TSCs to thickness specified on the plans. All spot results (the average of 3 to 5 readings) must meet the minimum requirement. No additional tolerance (as allowed by SSPC PA-2) is permitted. The specified thickness requirement has been adjusted for surface roughness so that no correction for base metal is needed. (For Steel Beams: For pieces with less than 200 ft<sup>2</sup> (18.6m<sup>2</sup>) measure 2 spots/surface per piece and for pieces greater than 200 ft<sup>2</sup> (18.6m<sup>2</sup>) add 1 additional spots/surface for each 500 ft<sup>2</sup> (46.5m<sup>2</sup>))

When noted on the plans, apply the sealer to all metallized surfaces in accordance with the manufacturer's recommendations. Only apply the seal coat when the air temperature is above 40°F (4°C) and the surface temperature of the steel is at least 5°F (3°C) above the dew point. If the sealer is not applied within eight hours after the final application of TSC, the applicator verifies acceptable TSC surfaces and obtains approval from the Engineer before applying the sealer.



## 5.0 INSPECTION FREQUENCY

The TSC Contractor must conduct the following tests at the specified frequency and the results documented in a format approved by the Engineer.

TEST/STANDARD	LOCATION	FREQUENCY	SPECIFICATION
Ambient Conditions	Site	Each Process	5°F (3°C) above the dew point
Abrasive Properties	Site	Each Day	Size, angularity, cleanliness
Surface Cleanliness SSPC Vis 1	All Surfaces	Visual All Surfaces	SSPC-SP-10 Atmospheric Service SSPC-SP - 5 Immersion Service
Surface Profile ASTM D-4417 Method C	Random Surfaces	3 per 500 ft <sup>2</sup>	2.5 - 4.0 mils
Bend Test SSPC-CS 23.00	Site	5 per shift	Pass Visual
Thickness SSPC PA-2R SSPC-CS 23.00	Each Surface	Use the method in PA-2 Appendix 3 for Girders and Appendix 4 for frames and miscellaneous steel. See Note 1.	Zn - 8.0 mils minimum Al - 12 mils minimum Areas with more than twice the minimum thickness are inspected for compliance to the adhesion and cut testing requirements of this specification.
Adhesion ASTM 4541	Random Surfaces Splice Areas	1 set of 3 per 500 ft <sup>2</sup>	ZN > 500 psi Al > 1000 psi
Cut Test - SSPC-CS 23.00	Random Surfaces	3 sets of 3 per 500 ft <sup>2</sup>	No peeling or delamination
Job Reference Std. SSPC-CS 23.00	Site	1 per job	Meets all the above requirements

## 6.0 REPAIRS

All Repairs are to be performed in accordance with the procedures below, depending on whether the repair surface is hidden or exposed. As an exception to the following, field welded splices on joint angles may be repaired in accordance with the procedures for hidden surfaces.

**For hidden surfaces (including but not limited to interior girders, interior faces of exterior girders, and below-grade sections of piles):**

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallizing at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. Minor areas less than or equal to  $0.1 \text{ ft}^2$  ( $9300\text{mm}^2$ ) exposing the substrate are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
3. Large areas greater than  $0.1 \text{ ft}^2$  ( $9300\text{mm}^2$ ) exposing the substrate are metallized in accordance with SSPC CS 23.00.
4. Damaged (burnished) areas not exposing the substrate with less than the specified coating thickness are metallized in accordance with SSPC CS 23.00 or painted in accordance with ASTM A780, "Repair of Damaged and Uncoated Areas of Hot Dip Galvanized Coatings."
5. Damaged (burnished) areas not exposing the substrate with more than the specified coating thickness are not repaired.
6. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

**For Exposed Surfaces (including but not limited to exterior faces of exterior girders and above-grade sections of piles):**

1. Welding of metallized surfaces may be performed only if specifically permitted by the Engineer. Remove metallization at the location of field welds by blast cleaning (SSPC SP-6 finish), or hand (SSPC SP-2 finish) or power tool cleaning (SSPC SP-3 finish) just prior to welding. Clean sufficiently to prevent contamination of the weld. All repairs to welded connections are metallized in accordance with SSPC CS 23.00.
2. All areas exposing the substrate are metallized in accordance with SSPC CS 23.00
3. Defective coating is repaired by either method 2 or 3 depending on the area of the defect.

## 7.0 TWELVE MONTH OBSERVATION PERIOD

The contractor maintains responsibility for the coating system for a twelve (12) month observation period beginning upon the satisfactory completion of all the work required in the plans or as directed by the engineer. The contractor must guarantee the coating system under the payment and performance bond (refer to article 109-10). To successfully complete the observation period, the coating system must meet the following requirements after twelve(12) months service:

- No visible rust, contamination or application defect is observed in any coated area.
- Painted surfaces have a uniform color and gloss.
- Surfaces have an adhesion of no less than 500 psi (3.45 MPa) when tested in accordance with ASTM D-4541.

## 8.0 BASIS OF PAYMENT

The contract price bid for the bridge component to which the coating is applied will be full compensation for the thermal sprayed coating.

## **MINIMIZING RAILROAD FLAGGING SERVICE**

**(10-12-01)**

Notify the Engineer whenever construction activity on, or immediately adjacent to, the railroad right-of-way is expected to be delayed for more than 2 weeks due to:

- Construction activity being confined to an area where the activity, including the possible falling or overturning of proposed construction equipment and/or material, is not reasonably expected to interfere with Railroad operations or cause damage to facilities of the Railroad or its tenants, and where Railroad operations would not affect personnel and/or equipment.
- The Contractor removing his work force from the site to pursue his work at other locations.
- Scheduling of needed construction equipment and/or material
- Coordination with other required construction activity
- Seasonal considerations

In the notification, describe the reason for the delay and provide a schedule of when the delay in the area is expected to begin and when work in the area is expected to resume.

Contact the Railroad's authorized representative to determine if the flagman can be released and reassigned to accommodate the proposed work delay schedule. If the Railroad agrees, the Engineer follows the advance notification procedures for releasing and rescheduling a flagman as stated elsewhere in this Special Provision or as provided by the Railroad.

**R-513A&BA**

Prior to the release of the flagman, ensure that drainage facilities and erosion control measures adjacent to the tracks are properly maintained and that the site is left in a condition satisfactory to the Railroad. In addition, remove any material or equipment stored on the Railway right of way that is needed during the absence of the flagman.

If failing to notify the Engineer of a construction activity delay as stated above and a flagman remains assigned to the site for more than 2 weeks after the delay begins, the flagman time exceeding the 2 weeks, until work resumes on a routine schedule, is considered the Contractor's responsibility.

For that portion of the flagman time considered as the Contractor's responsibility, the Department will continue to pay the flagging charges but an amount of \$250 per day will be withheld from partial or final payment due the Contractor.

**ADHESIVELY ANCHORED ANCHOR BOLTS OR DOWELS****(10-12-01)****1.0 DESCRIPTION**

The work covered by this Special Provision consists of furnishing all necessary labor, equipment, and materials and performing all operations necessary for installing anchor bolts/dowels in concrete using an adhesive bonding system in accordance with the details shown on the plans and with the requirements of this specification unless otherwise directed.

Submit a description of the proposed adhesive bonding system to the Engineer for review, comments and acceptance. Include in the description the bolt type and its deformations, equipment, manufacturer's recommended hole diameter, embedment depth, material specifications, and any other material, equipment or procedure not covered by the plans or these specifications. List the properties of the adhesive, including density, minimum and maximum temperature application, setting time, shelf life, pot life, shear strength and compressive strength. If bars/dowels containing a corrosion protective coating are required, provide an adhesive that does not contain any chemical elements that are detrimental to the coating and include a statement to this effect in the submittal.

**2.0 MATERIALS**

Use an adhesive bonding system that has been tested for a tensile strength of 125% of the specified anchor bolt/dowel yield load. Provide certification that, for the particular bolt grade, diameter and embedment depth required, the anchor system will not fail by adhesive failure and that the anchor bolt/dowel will not move. The minimum concrete compressive strength is 3000 psi (20.7 MPa) for certification and anchorage selection.

Package components of the adhesive so that one whole container of each component mixes to form one batch of adhesive. Use containers designed so that all of the contents may be removed easily and sealed tightly to prevent leakage. Furnish adhesive material requiring hand mixing in two separate containers designated as Component A and Component B.

Provide a self contained cartridge or capsule consisting of two components which are automatically mixed as they are dispensed, as in the case of a cartridge, or drilled into, as in the case of a capsule.

Clearly label each container with the manufacturer's name, date of manufacture, batch number, batch expiration date, direction for use, and warnings and precautions concerning the contents as required by State or Federal Laws and Regulations.

### 3.0 PROCEDURE

#### A. Drilling of Holes into Concrete

When directed, use a jig or fixture to ensure the holes are positioned and aligned correctly during the drilling process. Upon approval, adjusting hole locations to avoid reinforcing steel is permitted.

Drill the holes with a pneumatic drill unless another drilling method is approved. Follow the manufacturer's recommendations regarding the diameter of the drilled hole.

Immediately after completion of drilling, blow all dust and debris out of the holes with oil-free compressed air using a wand extending to the bottom of the hole. Remove all dust from the sides of the holes by brushing the holes with a stiff-bristled brush of a sufficient size and then blow the hole free of dust. Repeat this procedure until the hole is completely clean. Check each hole with a depth gauge to ensure proper embedment depth.

Repair spalled or otherwise damaged concrete using approved methods.

#### B. Inspection of Holes

Inspect each hole immediately prior to placing the adhesive and the anchor bolts/dowels. Ensure all holes are dry and free of dust, dirt, oil, and grease. Rework any hole that does not meet the requirements of this Special Provision.

#### C. Mixing of Adhesive

Mix the adhesive in strict conformance with the manufacturer's instructions.

#### D. Embedment of Anchor Bolt/Dowel

Clean each anchor bolt/dowel so that it is free of all rust, grease, oil, and other contaminants.

Unless otherwise shown on the plans, the minimum anchor bolt/dowel embedment depth is such that the adhesive develops at least 125% of the anchor bolt/dowel yield load as determined by the manufacturer.

Insert the anchor bolt/dowel the specified depth into the hole and slightly agitate it to ensure wetting and complete encapsulation. After insertion of the anchor bolt/dowel, strike off any excessive adhesive flush with the concrete face. Should the adhesive fail to fill the hole, add additional adhesive to the hole to allow a flush strike-off.

Do not disturb the anchor bolts/dowels while adhesive is hardening.

#### **4.0 FIELD TESTING**

When specified on the plans, test the installed anchor bolts/dowels for adequate adhesive as specified below. Inform the Engineer when the tests will be performed at least 2 days prior to testing. Conduct the tests in the presence of the Engineer.

Use a calibrated hydraulic centerhole jack system for testing. Place the jack on a plate washer that has a hole at least 1/8 inch (3 mm) larger than the hole drilled into the concrete. Position the plate washer on center to allow an unobstructed pull. Position the anchor bolts/dowels and the jack on the same axis. Have an approved testing agency calibrate the jack within 6 months prior to testing. Supply the Engineer with a certificate of calibration.

In the presence of the Engineer, field test 10% of the first 50 anchor bolts/dowels prior to installing any additional anchors. For testing, apply and hold briefly 90% of the anchor bolt/dowel yield load shown on the plans. No visible signs of movement of the anchor bolts/dowels is permitted under this load. Upon receiving satisfactory results from these tests, install the remaining anchors. Test a minimum of 2% of the remaining anchors as previously described.

Record data for each anchor bolt/dowel tested on the report form entitled "Installation Test Report of Adhesively Anchored Anchor Bolts or Dowels". Obtain this form from the North Carolina Department of Transportation Materials and Tests Engineer. Submit a copy of the completed report forms to the Engineer.

Final acceptance of the adhesively anchored system is based on the conformance of the pull test to the requirements of this specification. Failure to meet the criteria of this specification is grounds for rejection.

#### **5.0 BASIS OF PAYMENT**

No separate measurement or payment will be made for furnishing, installing, and testing anchor bolts/dowels.

Payment at the contract unit prices for the various pay items will be full compensation for all materials, equipment, tools, labor, and incidentals necessary to complete the above work.

**EVAZOTE JOINT SEALS**

(8-13-04)

**1.0 SEALS**

Use preformed seals compatible with concrete and resistant to abrasion, oxidation, oils, gasoline, salt and other materials that are spilled on or applied to the surface. Use a low-density closed cell, cross-linked ethylene vinyl acetate polyethylene copolymer nitrogen blown material for the seal.

Use seals manufactured with grooves 1/8" (3 mm) ± wide by 1/8" (3 mm) ± deep and spaced between 1/4 (6 mm) and 1/2 inch (13 mm) apart along the bond surface running the length of the joint. Use seals sized so that the depth of the seal meets the manufacturer's recommendation, but is not less than 70% of the uncompressed width. Provide a seal designed so that, when compressed, the center portion of the top does not extend upward above the original height of the seal by more than 1/4 inch (6 mm). Splice the seal using the heat welding method by placing the joint material ends against a teflon heating iron of 350°F (177°C) for 7 - 10 seconds, then pressing the ends together tightly. Do not test the welding until the material has completely cooled. Use material that resists weathering and ultraviolet rays. Provide a seal that has a working range of 30% tension and 60% compression and is watertight along its entire length including the ends.

Provide seals that meet the requirements given below.

TEST	TEST METHOD	REQUIREMENT
Elongation at break	ASTM D3575	210 ± 15%
Tensile strength, psi (kPa)	ASTM D3575	110 ± 15 (755 ± 100)
Compression Recovery (% of original width)	AASHTO T42 50% compr. for 22 hr. @ 73°F (23°C) 1/2 hr. recovery	87 ± 3
Weather/Deterioration	AASHTO T42 Accelerated Weathering	No deterioration for 10 years min.
Compression/Deflection	@ 50% deflection of original width  @ 50% deflection of original width	10 psi (69 kPa) min.  60 psi (414 kPa) max.
Tear Strength, psi (kPa)	ASTM D624	16 ± 3 (110 ± 20)
Density	ASTM D545	2.8 to 3.4
Water Absorption (% vol/vol)	ASTM D3575 Total immersion for 3 months	3

Have the top of the evazote seal clearly shop marked. Inspect the evazote seals upon receipt to ensure that the marks are clearly visible upon installation.

## 2.0 ADHESIVES

Use a two component, 100% solid, modified epoxy adhesive with the seal that meets the requirements of ASTM C881, Type 1, Grade 3, Class B & C and has the following physical properties:

Tensile strength .....	3500 psi (24.1 MPa) min.
Compressive strength .....	7000 psi (48.3 MPa) min.
Shore D Hardness.....	75 psi (0.5 MPa) min.
Water Absorption .....	0.25% by weight

Use an adhesive that is workable to 40°F (4°C). When installing in temperatures below 40°F (4°C) or for application on moist, difficult to dry concrete surfaces, use an adhesive specified by the manufacturer of the joint material.

## 3.0 SAWING THE JOINTS

When the plans call for sawing the joints, the joints shall be initially formed to a width as shown on the plans including the blockout for the elastomeric concrete. Complete placement of the elastomeric concrete after the reinforced concrete deck slab has cured for seven full days and reached a minimum strength of 3000 psi (20.7 Mpa).

Cure the elastomeric concrete for a minimum of 2 days prior to sawing the elastomeric concrete to the final width and depth as specified in the plans.

When sawing the joint to receive the evazote seal, always use a rigid guide to control the saw in the desired direction. To control the saw and to produce a straight line as indicated on the plans, anchor and positively connect a template or a track to the bridge deck. Do not saw the joint by visual means such as a chalk line. Fill the holes used for holding the template or track to the deck with an approved, flowable non-shrink, non-metallic grout.

Saw cut to the desired width and depth in one or two passes of the saw by placing and spacing two metal blades on the saw shaft to the desired width for compression seals.

The desired depth is the depth of the seal plus 1/4 inch (6 mm) above the top of the seal plus approximately 1 inch (25 mm) below the bottom of the seal. An irregular bottom of sawed joint is permitted as indicated on the plans. Grind exposed corners on saw cut edges to a 1/4" (6 mm) chamfer.

Remove any staining or deposited material resulting from sawing with a wet blade to the satisfaction of the Engineer.

Use extreme care to saw the joint straight to the desired width and to prevent any chipping or damage to sawed edges of the joint.



#### 4.0 PREPARATIONS FOR SAWED JOINTS

When the plans call for sawing the joint, the Engineer thoroughly inspects the sawed joint opening for spalls, popouts, cracks, etc. Make all necessary repairs prior to blast cleaning and installing the seal.

Immediately before sealing, clean the joints by sandblasting with clean dry sand. Sandblast to provide a firm, clean joint surface free of curing compound, loose material and any foreign matter. Sandblast without causing pitting or uneven surfaces. The aggregate in the elastomeric concrete may be exposed after sandblasting.

After blasting, either brush the surface with clean brushes made of hair, bristle or fiber, blow the surface with compressed air, or vacuum the surface until all traces of blast products and abrasives are removed from the surface, pockets, and corners.

If nozzle blasting, use compressed air that does not contain detrimental amounts of water or oil.

Examine the blast cleaned surface and remove any traces of oil, grease or smudge deposited in the cleaning operations.

Bond the seal to the blast cleaned surface on the same day the surface is blast cleaned.

#### 5.0 PREPARATIONS FOR ARMORED JOINTS

When the plans call for armored joints, form the joint and blockout openings in accordance with the plans. If preferred, wrap the temporary form with polyethylene sheets to allow for easier removal. Do not use form release agents.

##### A. Submittals

Submitting detailed working drawings is not required; however, submitting catalog cuts of the proposed material is required. In addition, direct the joint supplier to provide an angle segment placing plan.

##### B. Surface Preparation

Prepare the surface within the 48 hours prior to placing the elastomeric concrete. Do not place the elastomeric concrete until the surface preparation is completed and approved.

##### 1. Angle Assembly

Clean and free metallized steel of all foreign contaminants and blast the non-metallized steel surfaces to SSPC SP-10. Blast-cleaning anchor studs is not required.

## 2. Concrete

Prior to placing the elastomeric concrete, thoroughly clean and dry all concrete surfaces. Sandblast the concrete surface in the blockout and clear the surface of all loose debris.

### C. Elastomeric Concrete Placement

Make sure that a manufacturer's representative is present when placing elastomeric concrete. Do not place elastomeric concrete if the ambient air temperature is below 45°F (7°C).

Prepare and apply a primer, as per manufacturer's recommendations, to all vertical concrete faces, all steel components to be in contact with elastomeric concrete, and to areas specified by the manufacturer. Align the angles with the joint opening.

Prepare, batch, and place the elastomeric concrete in accordance with the manufacturer's instructions. Place the elastomeric concrete in the areas specified on the plans while the primer is still tacky and within 2 hours after applying the primer. Pay careful attention to properly consolidate the concrete around the steel and anchors. Trowel the elastomeric concrete to a smooth finish.

### D. Joint Preparation

Prior to installing the seal, the Engineer thoroughly inspects the armored joint opening for proper alignment and full consolidation of elastomeric concrete under the angle assemblies. Make all necessary repairs prior to cleaning the joint opening and installing the seal.

Clean the armored joint opening with a pressure washer rated at 3000 psi (20.7 MPa) minimum at least 24 hours after placing the elastomeric concrete. Dry the cleaned surface prior to installing the seal.

Examine the cleaned surface and remove traces of oil, grease or smudge deposited during the cleaning operations.

Bond the seal to the cleaned surface on the same day the surface is cleaned.

## 6.0 SEAL INSTALLATION

Install the joint seal according to the manufacturer's procedures and recommendations and as recommended below. Do not install the joint seal if the ambient air temperature is below 45°F (7°C). Have a manufacturer's representative present during the installation of the first seal of the project.

Begin installation at the low end of the joint after applying the mixed epoxy to the sides of both the joint material and both sides of the joint, making certain to completely fill the grooves with epoxy. With gloved hands, compress the material and with the help of a blunt

probe, push it down into the joint until it is recessed approximately 1/4 inch (6 mm) below the surface. Do not push the seal at an angle that would stretch the material. Once work on a joint begins, do not stop until it is completed. Clean the excess epoxy off the surface of the joint material *quickly* and *thoroughly*. Do not use solvents to remove excess epoxy. Remove excess epoxy in accordance with the joint manufacturer's recommendations.

Install the seal so that it is watertight. Testing of the joint seal is not required, but it is observed until final inspection.

## 7.0 BASIS OF PAYMENT

Payment for all evazote joint seals will be at the lump sum contract price bid for "Evazote Joint Seals" which prices and payment will be full compensation for furnishing all material, including elastomeric concrete when required, labor, tools and equipment necessary for installing these units in place and accepted.

## EPOXY PROTECTIVE COATING

(10-12-01)

### 1.0 DESCRIPTION

This work consists of preparing the concrete surface and furnishing and applying an epoxy protective coating to the surfaces described in this Special Provision. When epoxy protective coating is required, cure the top surfaces of the bent or end bent caps in accordance with the Standard Specifications, but do not use the Membrane Curing Compound method.

### 2.0 MATERIALS

Use an epoxy coating that meets the most recently published NCDOT Specification on the date of advertisement. Use the epoxy coating that meets NCDOT-Type 4A Flexible, epoxy coating, moisture insensitive.

Provide a certification for the proposed epoxy showing that it meets NCDOT-Type 4A.

The following companies have epoxies that meet Type 4A Specifications:

- E-Bond Epoxy, Inc.  
Fort Lauderdale, Florida 33307
- Permagile Industries  
Plainview, NY 11803
- Poly-Carb  
Cleveland, OH 44139

- Tamms, Inc.  
Mentor, OH 44060
- Adhesive Engineering  
Cleveland, OH 44122-5554
- Kaufman Products  
Baltimore, MD 21226-1131
- Prime Resins  
Lithonia, GA 30058
- Sika Corporation  
Lyndhurst, N. J. 07071

A copy of the specifications for Epoxy Resin Systems is available from the Materials and Tests Unit.

### 3.0 SURFACES

With the exception of cored slab bridges, apply the epoxy protective coating to the top surface area, including chamfer area, of bent caps under expansion joints and of end bent caps, excluding areas under elastomeric bearings. For cored slab bridges, do not apply the epoxy protective coating to the bent or end bent caps. Also, apply epoxy protective coating to the ends of prestressed concrete members as noted on the plans.

Use extreme care to keep the area under the elastomeric bearings free of the epoxy protective coating. Do not apply the epoxy protective coating in the notch at the ends of the prestressed concrete girders.

Thoroughly clean all dust, dirt, grease, oil, laitance, and other objectionable material from the concrete surfaces to be coated. Air-blast all surfaces immediately prior to applying the protective coating.

Only use cleaning agents pre-approved by the Engineer.

### 4.0 APPLICATION

Apply epoxy protective coating only when the air temperature is at least 40°F (4°C) and rising, but less than 95°F (35°C) and the surface temperature of the area to be coated is at least 40°F (4°C). Remove any excess or free standing water from the surfaces before applying the coating. Apply one coat of epoxy protective coating at a rate such that it covers between 100 and 200 ft<sup>2</sup>/gal (2.5 and 5 m<sup>2</sup>/liter).

Note: Under certain combinations of circumstances, the cured epoxy protective coating may develop “oily” condition on the surface due to amine blush. This condition is not detrimental to the applied system.

Apply the coating so that the entire designated surface of the concrete is covered and all pores filled. To provide a uniform appearance, use the exact same material on all visible surfaces.

## 5.0 BASIS OF PAYMENT

No separate measurement or payment will be made for preparing, furnishing and applying the epoxy protective coating to the concrete surfaces.

Payment at the contract unit prices for the various pay items will be full compensation for the above work including all materials, equipment, tools, labor, and incidentals necessary to complete the work.

### **OPTIONAL PRECAST REINFORCED CONCRETE BOX CULVERT AT STATIONS 14+19.671 -RPB-, 14+40.000 -Y1-, 120+86.500 -L-, 12+42.500 -Y2-**

(2-14-04)

## 1.0 GENERAL

This Special Provision covers precast reinforced concrete box culverts intended for the construction of culverts and for the conveyance of storm water.

If the option is indicated on the plans, the submittal of a design for a precast reinforced box culvert in lieu of a cast-in-place culvert is permitted. Provide the size and number of barrels as indicated on the plans. Precast wing walls will not be allowed. For culverts with less than 2 feet (0.6 m) of cover, design the precast culvert sections in accordance with AASHTO M273. Detail the culvert with cast in place wings. Provide a precast box culvert that meets the requirements of Section 1077 and any other applicable parts of the Standard Specifications.

The design of the precast members is the responsibility of the Contractor and is subject to review, comments and approval. Submit two sets of detailed plans for review. Include all details in the plans, including the size and spacing of the required reinforcement necessary to build the precast box culvert. Include checked design calculations for the precast members complying with the latest AASHTO Standard Specifications and requirements detailed herein. Have a North Carolina Registered Professional Engineer check and seal the plans and design calculations. After the plans are reviewed and, if necessary, the corrections made, submit one set of reproducible tracings on 22" x 34" sheets to become the revised contract plans.

A pre-installation meeting is required prior to installation. Representatives from the Contractor, the precast box manufacturer, and the Department should attend this meeting. The precast box manufacturer representative shall be on site during installation.

## 2.0 PRECAST REINFORCED CONCRETE BOX SECTIONS

### A. Types

Precast reinforced concrete box sections manufactured in accordance with this Special Provision are designated by span, rise, and design earth cover.

### B. Design

1. Design – The box section dimensions and reinforcement details are subject to the provisions of Section F.
2. Placement of Reinforcement – Provide a 1 inch (25 mm) concrete cover over the circumferential reinforcement subject to the provisions of Section F. Extend the inside circumferential reinforcement into the male portion of the joint and the outside circumferential reinforcement into the female portion of the joint. Detail the clear distance of the end circumferential wires so it is not less than 1/2 inch (13 mm) nor more than 2 inches (51 mm) from the ends of the box section. Assemble reinforcement per the requirements of AASHTO M259, Section 7.3. The exposure of the ends of the wires used to position the reinforcement is not a cause for rejection.
3. Laps and Spacing – Use lap splices for the circumferential reinforcement. Detail the circumferential wires so that the center to center spacing is not less than 2 inches (50 mm) nor more than 4 inches (100 mm). Do not detail the longitudinal wires with a center to center spacing of more than 8 inches (200 mm).
4. The design earth cover is reported on the plans as the elevation difference between the point of maximum fill and the top of the top slab.

## C. Joints

1. Produce the precast reinforced concrete box section with male and female ends. Design and form these ends of the box section so, when the sections are laid together, they make a continuous line of box sections with a smooth interior free of appreciable irregularities in the flowline, all compatible with the permissible variations given in Section F. The internal joint formed at the male and female ends of the precast units shall be sealed with either bitumen/butyl sealant or closed-cell neoprene material. The internal joint material shall be installed in accordance with the manufacturer's recommendations. The material shall be shown on the shop drawings when they are submitted for review.
2. Seal the external joint with an outside sealer wrap that is at least 12 inches (300 mm) wide and covers the joint on both the sides and the top of the box section. Use ConWrap CS-212 from Concrete Sealants, Inc., EZ-Wrap from Press-Seal Gasket Corporation, Seal Wrap from Mar-Mac Manufacturing Co., Inc., Cadilloc External Pipe Joint from Cadilloc, or an approved equal for the outside sealer wrap. If the outside sealer wrap is not applied in a continuous strip along the entire joint, a 12 inch (300 mm) minimum lap of the outside sealer wrap is permitted. Before placing the outside sealer wrap, clean and prime the area receiving the outside sealer wrap in accordance with the sealer wrap manufacturer recommendations. The joint wrap manufacturer installation recommendations shall be included with shop drawings submitted for review. The external joint wrap shall be installed in three pieces, as indicated on Figure 1 below:

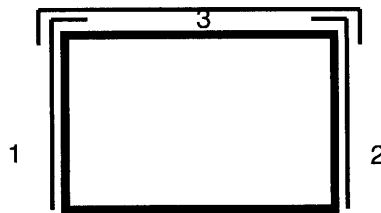


Figure 1

Cover the external joint sealer with a 3 foot (900 mm) strip of filter fabric conforming to Type 4 requirements in Section 1056 of the Standard Specifications.

Place multiple lines of a precast reinforced concrete box culvert such that the longitudinal joint between the sections has a minimum width of 3 inches (75 mm). Fill the joint between multiple lines of precast box sections with Class A concrete. Use Class A concrete that meets the requirements listed in the Standard Specifications except that Field Compressive Strength Specimens are not required.

#### D. Manufacture

Precast box culverts may be manufactured by either the wet cast method or dry cast method.

1. Mixture – In addition to the requirements of Section 1077 of the Standard Specifications, do not proportion the mix with less than 564 lb/yd<sup>3</sup> (335 kg/m<sup>3</sup>) of portland cement.
2. Strength – Make sure that all concrete develops a minimum 28-day compressive strength of 5000 psi (34.5 MPa). Movement of the precast sections should be minimized during the initial curing period. Any damage caused by moving or handling during the initial curing phase will be grounds for rejection of that precast section.
3. Air Entrainment – Air entrain the concrete in accordance with Section 1077 - 5(A) of the Standard Specifications. For dry cast manufacturing, air entrainment is not required.
4. Testing – Test the concrete in accordance with the requirements of Section 1077 - 5(B).
5. Handling – Handling devices or holes are permitted in each box section for the purpose of handling and laying. Submit details of handling devices or holes for approval and do not cast any concrete until approval is granted. Remove all handling devices flush with concrete surfaces as directed. Fill holes in a neat and workmanlike manner with an approved non-metallic non-shrink grout, concrete, or hole plug.

#### E. Physical Requirements

Acceptability of precast culvert sections is based on concrete cylinders made and tested in accordance with AASHTO T22 and AASHTO T23.



## F. Permissible Variations

1. Flatness – All external surfaces shall be flat, true, and plumb. Irregularities, depressions, or high spots on all external surfaces shall not exceed 1/2 inch (12 mm) in 8 feet (2.5 meters).
2. Internal Dimensions – Produce sections so that the internal and haunch dimensions do not vary by more than 1/4 inch (6 mm) from the plan dimensions.
3. Adjacent Sections - Internal, external, and haunch dimensions for connecting sections shall not vary by more than 1/2 inch (12 mm).
4. Length of Tongue and Groove – The minimum length of the tongue shall be 4 inches (100 mm). The minimum length of the groove shall be 4 inches (100 mm). The dimensions of the tongue and groove shall not vary by more than 1/4 inch (6 mm) from the plan dimensions.
5. Slab and Wall Thickness – Produce sections so that the slab and wall thickness are not less than that shown on the plans by more than 5% or 3/16 inch (5 mm), whichever is greater. A thickness more than that required on the plans is not a cause for rejection.
6. Length of Opposite Surfaces – Produce sections so that variations in laying lengths of two opposite surfaces of the box section meet the requirements of AASHTO M259, Section 11.3.
7. Length of Section – Produce sections so that the underrun in length of a section is not more than 1/2 inch (13 mm) in any box section.
8. Position of Reinforcement – Produce sections so that the maximum variation in the position of the reinforcement is  $\pm 3/8$ " ( $\pm 10$  mm) for slab and wall thicknesses of 5 inches (125 mm) or less and  $\pm 1/2$ " ( $\pm 13$  mm) for slab and wall thicknesses greater than 5 inches (125 mm). Produce sections so that the concrete cover is never less than 5/8 inch (16 mm) as measured to the internal surface or the external surface. The preceding minimum cover limitations do not apply at the mating surfaces of the joint.
9. Area of Reinforcement – Use the design steel shown on the plans for the steel reinforcement. Steel areas greater than those required are not cause for rejection. The permissible variation in diameter of any wire in finished fabric is prescribed for the wire before fabrication by either AASHTO M32 or M225.

### G. Marking

1. Each section shall be match-marked in order of intended installation as indicated on the approved shop drawings. Ensure that pieces fit together neatly and in a workmanlike manner. In order to ensure a good, neat field fit, assemble adjacent sections at the producer's facility and match-mark the pieces. This will require that a minimum of three adjacent sections of the culvert be fitted at the production yard at a time and then match-marked. Once three sections have been match-marked, the first section may be removed for shipment and a fourth section set for marking. Continue in a progressive manner until all sections have been properly match-marked.
2. Clearly mark each section of the box culvert in accordance with AASHTO M259, Section 15.

### H. Construction

1. Foundation – Foundation for precast box culvert shall meet the requirements of Section 414 of the Standard Specifications. In addition, Type VI foundation material shall be encapsulated in filter fabric conforming to Type 4 requirements in Section 1056 of the Standard Specifications. The filter fabric shall be placed perpendicular to the culvert barrel. Provide sufficient overhang beyond the excavation to allow a minimum lap of 3 feet (900 mm) when the foundation material is placed and fabric wrapped on top. Perpendicular sections of fabric shall be continuous. A minimum lap of 2 feet (600 mm) shall be provided between sections of fabric.
2. Installation – Sections shall be placed at the beginning of the outlet end of the culvert with the groove end being laid up grade. Tongue sections shall be laid into the groove sections. Positive means shall be provided to pull each section firmly into the previously placed section so that the joints are tightly homed. Use a "come-along", box pullers or other approved methods to create a positive means of joining box sections. Construction equipment shall not have direct contact with the box section. The load of the box shall be suspended by lifting device during joining procedure.
3. Backfill – Complete backfill in accordance with Section 414 of the Standard Specifications.

**3.0 BASIS OF PAYMENT**

Any additional cost of redesigning will be paid for by the Contractor if Precast Reinforced Concrete Culvert is used in lieu of the cast-in-place culvert shown on the plans. Except for Foundation Conditioning Material and Culvert Excavation, payment for the Precast Box Culvert will be a lump sum amount equal to the payment that would be allowed for construction of a Cast-in-Place Box Culvert. Plan quantities and unit bid prices will be used to compute the lump sum amount. Such price and payment will be full compensation for all work covered by this Special Provision, the plans and applicable parts of the Standard Specifications and will include, but not be limited to, furnishing all labor, materials (including all filter fabric), equipment and other incidentals necessary to complete this work. Such price and payment will also be full compensation for concrete, reinforcing steel, labor, equipment and all other related materials necessary for the completion of the barrel section, and the construction of the headwalls, leveling pad, end curtain walls, wings and wing footings.

**ELASTOMERIC CONCRETE****(10-12-01)****1.0 DESCRIPTION**

Elastomeric concrete is a mixture of a two-part polymer consisting of polyurethane and/or epoxy, and kiln-dried aggregate. Have the manufacturer supply it as a unit. Use the concrete in the blocked out areas on both sides of the bridge deck joints as indicated on the plans.

**2.0 MATERIALS**

Provide materials that comply with the following minimum requirements at 14 days.

CONCRETE PROPERTIES	TEST METHOD	MINIMUM REQUIREMENT
Bond Strength to Concrete, psi (MPa)	ASTM D638 (D638M)	450 (3.1)
Brittleness by Impact, ft-lb (kg-m)	Ball Drop	7 (0.97)
Compressive Strength, psi (MPa)	ASTM D695 (D695M)	2800 (19.3)

BINDER PROPERTIES (without aggregate)	TEST METHOD	MINIMUM REQUIREMENT
Tensile Strength, psi (MPa)	ASTM D638 (D638M)	800 (5.5)
Ultimate Elongation	ASTM D638 (D638M)	150%
Tear Resistance, lb/in (kN/m)	ASTM D624	90 (15.7)

In addition to the requirements above, use elastomeric concrete that also resists water, chemical, UV, and ozone exposure and withstands extreme temperature (freeze-thaw) changes.

Furnish a manufacturer's certification verifying that the materials satisfy the above requirements. Provide samples of elastomeric concrete to the Engineer, if requested, to independently verify conformance with the above requirements.

Require a manufacturer's representative to be present on site during the installation of the elastomeric concrete.

### **3.0 BASIS OF PAYMENT**

No separate payment will be made for elastomeric concrete. The lump sum contract price bid for "Evazote Joint Seals" will be full compensation for furnishing and placing the Elastomeric Concrete.

## **FALSEWORK AND FORMWORK**

**(10-12-01)**

### **1.0 DESCRIPTION**

Use this Special Provision as a guide to develop temporary works submittals required by the Standard Specifications or other provisions; no additional submittals are required herein. Such temporary works include, but are not limited to, falsework and formwork.

Falsework is any temporary construction used to support the permanent structure until it becomes self-supporting. Formwork is the temporary structure or mold used to retain plastic or fluid concrete in its designated shape until it hardens. Access scaffolding is a temporary structure that functions as a work platform that supports construction personnel, materials, and tools, but is not intended to support the structure. Scaffolding systems that are used to temporarily support permanent structures (as opposed to functioning as work platforms) are considered to be falsework under the definitions given. Shoring is a component of falsework such as horizontal, vertical, or inclined support members. Where the term "temporary works" is used, it includes all of the temporary facilities used in bridge construction that do not become part of the permanent structure.

Design and construct safe and adequate temporary works that will support all loads imposed and provide the necessary rigidity to achieve the lines and grades shown on the plans in the final structure.

## 2.0 MATERIALS

Select materials suitable for temporary works; however, select materials that also ensure the safety and quality required by the design assumptions. The Engineer has authority to reject material on the basis of its condition, inappropriate use, safety, or nonconformance with the plans. Clearly identify allowable loads or stresses for all materials or manufactured devices on the plans. Revise the plan and notify the Engineer if any change to materials or material strengths is required.

## 3.0 DESIGN REQUIREMENTS

### A. Working Drawings

Provide working drawings for items as specified in the contract, or as required by the Engineer, with design calculations and supporting data in sufficient detail to permit a structural and safety review of the proposed design of the temporary work.

When concrete placement is involved, include data such as the drawings of proposed sequence, rate of placement, direction of placement, and location of all construction joints. Submit the number of copies as called for by the contract.

When required, have the drawings and calculations prepared under the guidance of, and sealed by, a North Carolina Registered Professional Engineer who is knowledgeable in temporary works design.

Design falsework and formwork requiring submittals in accordance with the 1995 AASHTO *Guide Design Specifications for Bridge Temporary Works* except as noted herein.

### 1. Wind Loads

Table 2.2 of Article 2.2.5.1 is modified to include wind velocities up to 110 mph (177 km/hr). In addition, Table 2.2A is included to provide the maximum wind speeds by county in North Carolina.

**Table 2.2 - Wind Pressure Values**

Height Zone feet (m) above ground	Pressure, lb/ft <sup>2</sup> (kPa) for Indicated Wind Velocity, mph (km/hr)				
	70 (112.7)	80 (128.7)	90 (144.8)	100 (160.9)	110 (177.0)
0 to 30 (0 to 9.1)	15 (0.72)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)
30 to 50 (9.1 to 15.2)	20 (0.96)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)
50 to 100 (15.2 to 30.5)	25 (1.20)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)
over 100 (30.5)	30 (1.44)	35 (1.68)	40 (1.92)	45 (2.15)	50 (2.39)

### 2. Time of Removal

The following requirements replace those of Article 3.4.8.2.

Do not remove forms until the concrete has attained strengths required in Article 420-17 of the Standard Specifications and these Special Provisions.

Do not remove forms until the concrete has sufficient strength to prevent damage to the surface.

**Table 2.2A - Steady State Maximum Wind Speeds by Counties in North Carolina**

COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)	COUNTY	25 YR (mph) (km/hr)
Alamance	70 (112.7)	Franklin	70 (112.7)	Pamlico	100 (160.9)
Alexander	70 (112.7)	Gaston	70 (112.7)	Pasquotank	100 (160.9)
Alleghany	70 (112.7)	Gates	90 (144.8)	Pender	100 (160.9)
Anson	70 (112.7)	Graham	80 (128.7)	Perquimans	100 (160.9)
Ashe	70 (112.7)	Granville	70 (112.7)	Person	70 (112.7)
Avery	70 (112.7)	Greene	80 (128.7)	Pitt	90 (144.8)
Beaufort	100 (160.9)	Guilford	70 (112.7)	Polk	80 (128.7)
Bertie	90 (144.8)	Halifax	80 (128.7)	Randolph	70 (112.7)
Bladen	90 (144.8)	Harnett	70 (112.7)	Richmond	70 (112.7)
Brunswick	100 (160.9)	Haywood	80 (128.7)	Robeson	80 (128.7)
Buncombe	80 (128.7)	Henderson	80 (128.7)	Rockingham	70 (112.7)
Burke	70 (112.7)	Hertford	90 (144.8)	Rowan	70 (112.7)
Cabarrus	70 (112.7)	Hoke	70 (112.7)	Rutherford	70 (112.7)
Caldwell	70 (112.7)	Hyde	110 (177.0)	Sampson	90 (144.8)
Camden	100 (160.9)	Iredell	70 (112.7)	Scotland	70 (112.7)
Carteret	110 (177.0)	Jackson	80 (128.7)	Stanley	70 (112.7)
Caswell	70 (112.7)	Johnston	80 (128.7)	Stokes	70 (112.7)
Catawba	70 (112.7)	Jones	100 (160.9)	Surry	70 (112.7)
Cherokee	80 (128.7)	Lee	70 (112.7)	Swain	80 (128.7)
Chatham	70 (112.7)	Lenoir	90 (144.8)	Transylvania	80 (128.7)
Chowan	90 (144.8)	Lincoln	70 (112.7)	Tyrell	100 (160.9)
Clay	80 (128.7)	Macon	80 (128.7)	Union	70 (112.7)
Cleveland	70 (112.7)	Madison	80 (128.7)	Vance	70 (112.7)
Columbus	90 (144.8)	Martin	90 (144.8)	Wake	70 (112.7)
Craven	100 (160.9)	McDowell	70 (112.7)	Warren	70 (112.7)
Cumberland	80 (128.7)	Mecklenburg	70 (112.7)	Washington	100 (160.9)
Currituck	100 (160.9)	Mitchell	70 (112.7)	Watauga	70 (112.7)
Dare	110 (177.0)	Montgomery	70(112.7)	Wayne	80 (128.7)
Davidson	70 (112.7)	Moore	70 (112.7)	Wilkes	70 (112.7)
Davie	70 (112.7)	Nash	80 (128.7)	Wilson	80 (128.7)
Duplin	90 (144.8)	New Hanover	100 (160.9)	Yadkin	70 (112.7)
Durham	70 (112.7)	Northampton	80 (128.7)	Yancey	70 (112.7)
Edgecombe	80 (128.7)	Onslow	100 (160.9)		
Forsyth	70 (112.7)	Orange	70 (112.7)		

Note on the working drawings any anchorages, connectors, inserts, steel sleeves or other such devices used as part of the falsework or formwork that remains in the permanent structure. If the plan notes indicate that the structure contains the necessary corrosion protection required for a Corrosive Site, epoxy coat, galvanize, metallize or otherwise protect these devices as directed by the Engineer. Any coating required by the Engineer will be considered incidental to the various pay items requiring temporary works.

#### B. Review and Approval

The Engineer is responsible for the review and approval of temporary works' drawings.

Submit the working drawings sufficiently in advance of proposed use to allow for their review, revision (if needed), and approval without delay to the work.

Do not start construction of any temporary work for which working drawings are required until the drawings have been approved. Such approval does not relieve the Contractor of the responsibility for the accuracy and adequacy of the working drawings.

The time period for review of the working drawings does not begin until complete drawings and design calculations, when required, are received by the Engineer.

On the drawings, show all information necessary to allow the design of any component to be checked independently as determined by the Engineer.

If requested by the Engineer, submit with the working drawings manufacturer's catalog data listing the weight of all construction equipment that will be supported on the temporary work. Show anticipated total settlements and/or deflections of falsework and forms on the working drawings. Include falsework footing settlements, joint take-up, and deflection of beams or girders. Design the falsework and forms supporting deck slabs and overhangs on girder bridges so that there will be no differential settlement between the girders and the deck forms during placement of deck concrete.

#### 4.0 CONSTRUCTION REQUIREMENTS

All requirements of Section 420 of the Standard Specifications apply.

Construct temporary works in conformance with the approved working drawings. Ensure that the quality of materials and workmanship employed is consistent with that assumed in the design of the temporary works. Do not weld falsework members to any portion of the permanent structure unless approved. Show any welding to the permanent structure on the approved construction drawings.



Provide tell-tales attached to the forms and extending to the ground, or other means, for accurate measurement of falsework settlement. Make sure that the anticipated compressive settlement and/or deflection of falsework does not exceed 1 inch (25 mm). For cast-in-place concrete structures, make sure that the calculated deflection of falsework flexural members does not exceed 1/240 of their span regardless of whether or not the deflection is compensated by camber strips.

#### A. Maintenance and Inspection

Inspect and maintain the temporary work in an acceptable condition throughout the period of its use. Certify that the manufactured devices have been maintained in a condition to allow them to safely carry their rated loads. Clearly mark each piece so that its capacity can be readily determined at the job site.

Perform an in-depth inspection of an applicable portion(s) of the temporary works, in the presence of the Engineer, not more than 24 hours prior to the beginning of each concrete placement. Inspect other temporary works at least once a month to ensure that they are functioning properly. Have a North Carolina Registered Professional Engineer inspect the cofferdams, shoring, sheathing, support of excavation structures, and support systems for load tests prior to loading.

#### B. Foundations

Determine the safe bearing capacity of the foundation material on which the supports for temporary works rest. If required by the Engineer, conduct load tests to verify proposed bearing capacity values that are marginal or in other high-risk situations.

The use of the foundation support values shown on the contract plans of the permanent structure is permitted if the foundations are on the same level and on the same soil as those of the permanent structure.

Allow for adequate site drainage or soil protection to prevent soil saturation and washout of the soil supporting the temporary works supports.

If piles are used, the estimation of capacities and later confirmation during construction using standard procedures based on the driving characteristics of the pile is permitted. If preferred, use load tests to confirm the estimated capacities; or, if required by the Engineer conduct load tests to verify bearing capacity values that are marginal or in other high risk situations.

The Engineer reviews and approves the proposed pile and soil bearing capacities.

**5.0 REMOVAL**

Unless otherwise permitted, remove and keep all temporary works upon completion of the work. Do not disturb or otherwise damage the finished work.

Remove temporary works in conformance with the contract documents. Remove them in such a manner as to permit the structure to uniformly and gradually take the stresses due to its own weight.

**6.0 METHOD OF MEASUREMENT**

Unless otherwise specified, temporary works will not be directly measured.

**7.0 BASIS OF PAYMENT**

Payment at the contract unit prices for the various pay items requiring temporary works will be full compensation for the above falsework and formwork.

**SUBMITTAL OF WORKING DRAWINGS****8-13-04****1.0 GENERAL**

Submit working drawings in accordance with Article 105-2 of the Standard Specifications and the requirements of this Special Provision. The list of submittals contained herein does not represent a list of required submittals for this project. Submittals are only necessary for those items as required by the Standard Specifications, other Special Provisions, or contract plans. Make submittals that are not specifically noted in this Special Provision directly to the Resident Engineer.

If submittals contain variations from plan details or specifications, significantly affect project cost, or significantly affect field construction or operations, discuss them with, and submit them through, the Resident Engineer. State the reason for the proposed variation in the submittals. To minimize overall review time, make sure all working drawing submittals are complete when first submitted. Provide a contact name and phone number with each submittal. Direct any questions regarding working drawing submittal requirements to the Resident Engineer, Structure Design Unit contacts or the Geotechnical Engineering Unit contacts noted below.

## 2.0 WORKING DRAWINGS SUBMITTAL CONTACTS

All submittals noted herein are reviewed by the Structure Design Unit and/or the Geotechnical Engineering Unit.

For submittals to the Structure Design Unit, use the following addresses:

Via US mail:

Mr. G. R. Perfetti, P. E.  
State Bridge Design Engineer  
North Carolina Department  
of Transportation  
Structure Design Unit  
1581 Mail Service Center  
Raleigh, NC 27699-1581

Attention: Mr. P. D. Lambert, P. E.

Via other delivery service:

Mr. G. R. Perfetti, P. E.  
State Bridge Design Engineer  
North Carolina Department  
of Transportation  
Structure Design Unit  
1000 Birch Ridge Drive  
Raleigh, NC 27610

Attention: Mr. P. D. Lambert, P. E.

For submittals to the Geotechnical Engineering Unit, use the following addresses:

For projects in Divisions 1-7, use the following Eastern Regional Office address:

Via US mail:

Mr. K. J. Kim, Ph. D., P. E.  
Eastern Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Eastern Regional Office  
1570 Mail Service Center  
Raleigh, NC 27699-1570

Via other delivery service:

Mr. K. J. Kim, Ph. D., P. E.  
Eastern Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Eastern Regional Office  
3301 Jones Sausage Road, Suite 100  
Garner, NC 27529

For projects in Divisions 8-14, use the following Western Regional Office address:

Via US mail:

Mr. John Pilipchuk, L. G., P. E.  
Western Regional Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Western Regional Office  
5253 Z Max Boulevard  
Harrisburg, NC 28075

Via other delivery service:

Mr. John Pilipchuk, L. G., P. E.  
Western Region Geotechnical  
Manager  
North Carolina Department  
of Transportation  
Geotechnical Engineering Unit  
Western Regional Office  
5253 Z Max Boulevard  
Harrisburg, NC 28075

Direct any questions concerning submittal review status, review comments, or drawing markups to the following contacts:

Primary Structures Contact:	Paul Lambert (919) 250 – 4041 (919) 250 – 4082 facsimile <a href="mailto:plambert@dot.state.nc.us">plambert@dot.state.nc.us</a>
Secondary Structures Contacts:	James Gaither (919) 250 – 4042 Man-Pan Hui (919) 250 – 4044
Eastern Regional Geotechnical Contact (Divisions 1-7):	K. J. Kim (919) 662 – 4710 (919) 662 – 3095 facsimile <a href="mailto:kkim@dot.state.nc.us">kkim@dot.state.nc.us</a>
Western Regional Geotechnical Contact (Divisions 8-14):	John Pilipchuk (704) 455 – 8902 (704) 455 – 8912 facsimile <a href="mailto:jpilipchuk@dot.state.nc.us">jpilipchuk@dot.state.nc.us</a>

### 3.0 SUBMITTAL COPIES

The quantities provided in this Special Provision act as a guide in the submittal process.

Unless otherwise required by the contract, submit two sets of supporting calculations to the Structure Design Unit.

Furnish one complete copy of the submittal, including all attachments, to the Resident Engineer. If requested, provide additional copies of any submittal. At the same time, submit the following number of copies directly to the Structure Design Unit and/or the Geotechnical Engineering Unit:

<b>Working Drawing Submittal</b>	<b>Copies Required by Structure Design Unit</b>	<b>Copies Required by Geotechnical Engineering Unit</b>	<b>Contract Reference Requiring Submittal <sup>1</sup></b>
Arch Culvert Falsework	5	0	Plan Note & SN Sheet
Box Culvert Falsework <sup>2</sup>	5	0	Plan Note & SN Sheet
Cofferdams <sup>4</sup>	6	1	Articles 410-5 and 420-8
Expansion Joint Seals (hold down plate type with base angle)	9	0	“Expansion Joint Seals”
Expansion Joint Seals (modular)	2, then 9	0	“Modular Expansion Joint Seals”
Expansion Joint Seals (strip seals)	9	0	“Strip Seals”
Falsework & Forms (superstructure)	8	0	Article 420-3
Falsework & Forms <sup>2</sup> (substructure)	8	0	Article 420-3
Mechanically Stabilized Earth Retaining Walls <sup>4</sup>	7	1	“MSE Retaining Walls”
Metal Bridge Railing	8	0	Plan Note
Metal Stay-in-Place Forms	8	0	Article 420-3
Metalwork for Elastomeric Bearings <sup>5,6</sup>	7	0	Article 1072-10
Miscellaneous Metalwork <sup>5,6</sup>	7	0	Article 1072-10
Overhead Sign Assemblies	13	0	Article 903-3(C)
Pile Points	7	1	Article 450-8(D) & “Steel Pile Points”
Placement of Equipment on Structures (cranes, etc.)	7	0	Article 420-20

Precast Concrete Box Culverts	2, then 1 reproducible	0	“(Optional) Precast Reinforced Concrete Box Culvert at Station ____”
Precast Retaining Wall Panels	10	0	Article 1077-2
Pot bearings <sup>5</sup>	8	0	“Pot Bearings”
Prestressed Concrete Deck Panels	6 and 1 reproducible	0	Article 420-3
Proprietary retaining walls <sup>4</sup>	9	1	Applicable Project Special Provision
Prestressed Concrete Girder (strand elongation and detensioning sequences)	6	0	Articles 1078-8 and 1078-11
Prestressed Concrete Cored Slab (detensioning sequences) <sup>3</sup>	6	0	Article 1078-11
Revised Bridge Deck Plans (adaptation to metal stay-in-place forms)	2, then 1 reproducible	0	Article 420-3
Revised Bridge Deck Plans (adaptation to modular expansion joint seals)	2, then 1 reproducible	0	“Modular Expansion Joint Seals”
Soil Nail Retaining Walls <sup>4</sup>	4	1	Applicable Project Special Provision
Sound Barrier Wall Steel Fabrication Plans <sup>6</sup>	7	0	Article 1072-10 & “Sound Barrier Wall”
Sound Barrier Wall Casting Plans	10	0	Article 1077-2 & “Sound Barrier Wall”
Structural Steel <sup>5</sup>	2, then 7	0	Article 1072-10
TFE Expansion Bearings <sup>5</sup>	8	0	Article 1072-10
Temporary Detour Structures <sup>4</sup>	10	1	Article 400-3 & “Construction, Maintenance and Removal of Temporary Structure at Station ____”
Temporary Shoring <sup>4</sup>	6	1	Article 410-4 & “Temporary Shoring for Maintenance of Traffic”

Temporary Fabric or Wire Walls <sup>8</sup>	0	2	Applicable Project Special Provision
Permanent Anchored Tieback Retaining Walls <sup>4</sup>	4	1	Applicable Project Special Provision
Evazote Joint Seals <sup>7</sup>	9	0	Applicable Project Special Provision
Optional Disc Bearings <sup>5</sup>	8	0	“Optional Disc Bearings”
Removal of Existing Structure over Railroad	5	0	Railroad Special Provisions
Drilled Pier Construction Sequence Plans <sup>8</sup>	0	2	“Drilled Piers”
Pile Hammers <sup>8</sup>	0	2	Article 450-6

**FOOTNOTES**

1. References are provided to help locate the part of the contract where the working drawing submittals are required. References in quotes refer to the Project Special Provision by that name. Articles refer to the Standard Specifications.
2. Submittals for these items are necessary only when plan notes require them.
3. Submittals for these items may not be required. A list of pre-approved sequences is available from the producer or the Materials and Tests Unit.
4. These submittals are reviewed by the Structure Design Unit and the Geotechnical Engineering Unit. If NCDOT Shoring Standards are used, working drawings need not be submitted, but the Shoring Selection Form should be forwarded to the Geotechnical Engineering Unit.
5. The fabricator may submit these items directly to the Structure Design Unit.
6. The two sets of preliminary submittals required by Article 1072-10 of the Standard Specifications are not required for these items.
7. Submittals for Fabrication Drawings are not required. Submission of Catalogue Cuts of Proposed Material is required. See Section 5.A of the Project Special Provision.
8. Submittals for these items are reviewed by the Geotechnical Engineering Unit only and correspondence regarding these items should be directed to and will come from the Geotechnical Engineering Unit.

**METRIC STRUCTURAL STEEL**

(10-12-01)

The structural steel for this project is specified in SI (Metric) units with plate thickness designated in millimeters in accordance with AASHTO M160M.

The substitution of structural steel in US Customary nominal thickness is permitted for primary and secondary members defined as follows:

- Primary members - members such as webs and flanges of plate girders, transverse and bearing stiffeners, girder field splice plates, and connector plates for curved girders.
- Secondary members - members such as connector plates for straight girders, bearing plates and miscellaneous hardware.

Such substitution is limited to the values shown in the following table.

Material Specified Metric (mm)	Primary Members US Customary (in)	Secondary Members US Customary (in)
8	3/8	*
9	3/8	*
10	7/16	3/8
11	7/16	*
12	1/2	*
14	9/16	*
16	11/16	5/8
18	3/4	11/16
20	13/16	3/4
22	7/8	*
25	1	*
28	1-1/8	*
30	1-3/16	*
32	1-5/16	1-1/4
35	1-7/16	1-3/8
38	1-1/2	*
40	1-5/8	*
45	1-13/16	*
50	2	*
55	2-1/4	*
60	2-3/8	*
70	2-13/16	2-3/4
* These values are the same as those for Primary members.		

There will be no additional payment for any extra weight incurred as a result of any substitution.



**OPTIONAL DISC BEARINGS**

(10-03-02)

**1.0 GENERAL**

This item consists of furnishing, fabrication and installation of disc bearings in accordance with AASHTO Standard Specifications, the Standard Specifications, the recommendations of the manufacturer and as specified herein. In addition, all plan notes pertaining to furnishing and installing pot bearing assemblies shall also apply to disc bearing assemblies, except as noted herein.

Disc Bearings consist of a polyether urethane structural element (disc) confined by upper and lower steel bearing plates. Equip disc bearings with a shear restriction mechanism to prevent movement of the disc. Supply disc bearings as fixed bearings and guided expansion bearings as designated by the Contract Documents.

Fixed disc bearings allow rotation but no longitudinal or transverse movement in the bearing plane. Fixed bearings consist of a sole plate, an elastomer disc, upper bearing plate, lower bearing plate, masonry plate, anchor bolts, nuts and washers.

Guided expansion disc bearings allow rotation and only longitudinal movement in the bearing plane. Guided expansion disc bearings consist of a sole plate, a top steel plate with a polished stainless steel sheet facing bearing on a fixed disc bearing with a layer of virgin polytetrafluoroethylene (PTFE) material on its top, masonry plate, anchor bolt assembly which includes anchor bolts, nuts, washers, pipe sleeves, a closure plate, grout and various sizes of standard pipe and any other necessary material as detailed on the plans. To allow longitudinal movement, bond a polytetrafluoroethylene (PTFE) sheet to the upper steel bearing plate. Support a sliding steel top bearing plate with the upper steel bearing plate. Face the mating surface of the sliding steel top bearing plate with polished stainless steel. Use either a guide bar or keyway system to restrict transverse movement. Face the sliding surfaces of the guide bar or keyway systems with either PTFE sheets or stainless steel.

**2.0 MATERIALS**

Use disc bearings produced by the same manufacturer.

Use AASHTO M270 Grade 50W (345W) for all steel in the disc bearings. Clean, coat, and seal the plates in the disc bearing assemblies except for the areas with special facings and the areas that come in contact with the elastomer disc, in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)". Coat surfaces to a thickness of 6 mils (0.150 mm) minimum on all external parts. Repair surfaces that are abraded or damaged after the application of metallizing in accordance with the Special Provision for "Thermal Sprayed Coatings (Metallization)".

Provide anchor bolts and nuts in accordance with the Standard Specifications.

When the maximum plan dimension of the sheet is 12" (300 mm) or less, provide a stainless steel sheet in expansion disc bearings that is at least 16 gage or 1/16" (1.6 mm).

When the maximum plan dimension is greater than 12" (300 mm), provide a stainless steel sheet that is at least 11 gage or 1/8" (3 mm). Ensure that all stainless steel sheets are in conformance with ASTM A167/A240 Type 304 and polished to a minimum #8 mirror surface finish.

Blast clean the surface of the plate that will be attached to the stainless sheet to a near white condition in accordance with the Standard Specifications. Position and clamp the back of the stainless sheet that is to be in contact with the steel plate on the steel plate. Apply the stainless steel to the blast cleaned surface of the steel plate as soon as possible after blasting and before any visible oxidation of the blast cleaned surface occurs. Weld the stainless sheet continuously around its perimeter using a tungsten inert gas, wire-fed welder.

For the PTFE sheet, used as a mating surface for the stainless sheet, provide an unfilled virgin PTFE Sheet (Recessed) or a glass-fiber filled PTFE sheet, resulting from skiving billets formed under hydraulic pressure and heat. Provide resin that conforms to the requirements of ASTM D4894 or D4895.

To bond the PTFE and the bearing plate, use heat cured high temperature epoxy capable of withstanding temperature of -320°F to 500°F (-195 °C to 260 °C).

Mold the polyether urethane structural element from a polyether urethane compound. Conform the physical properties of the polyether urethane to the following requirements:

Physical Property	ASTM Test Method	Requirements	
		Min.	Max.
Hardness, Type D Durometer	D2240	60	64
Tensile Stress psi (Mpa) At 100% elongation At 200% elongation	D412	2000 (13.8) 3700 (25.5)	----
Tensile Strength psi (Mpa)	D412	5000 (34.5)	----
Ultimate Elongation %	D412	220	----
Compression Set % 22 hrs. at 158°F (70°C)	D395	----	40

### 3.0 DESIGN

Design the disc bearings for the loads and movements shown on the contract plans. However, use the anchor bolt size, length, spacing and masonry plate thickness as shown on the contract plans and provide an overall height of the bearing assembly that is at least the height shown on the contract plans, but no more than 1/2 inch (13 mm) greater than this height. Either combine and cast the sole plate and top plate/upper bearing plate and the lower bearing plate and masonry plate as a single unit or weld together prior to the installation of the disc.

When designing the bearings, use the following allowable bearing stresses:

- On polyether urethane structural element: 5000 psi (34.5 MPa)
- On PTFE Sliding Surface, filled or unfilled PTFE (recessed): 3500 psi (24.1 MPa)

Submit eight sets of shop drawings and one set of design calculations for review, comments and acceptance. Have a North Carolina Registered Professional Engineer check and seal the shop drawings and design calculations.

After the Engineer reviews the drawings and, if necessary, corrections are made, submit one 22" x 34" reproducible set of the working drawings.

### 4.0 SAMPLING AND TESTING

#### A. Sampling

The manufacturer is responsible for randomly selecting and testing sample bearings from completed lots of bearings. The manufacturer is also responsible for certifying that the completed bearings and their components have been tested and are in compliance with the requirements of this Special Provision. Have the manufacturer furnish the results of the tests to the Materials and Tests Engineer.

#### B. Testing

##### 1. Proof Load Test

Load a test bearing to 150% of the bearing's rated design capacity and simultaneously subject it to a rotational range of 0.02 radians (1.146°) for a period of 1 hour.

Have the bearing visually examined both during the test and upon disassembly after the test. Any resultant visual defects, such as extruded or deformed elastomer or PTFE, damaged seals or rings, or cracked steel is cause for rejection.

Keep continuous and uniform contact between the polyether urethane element and the bearing plates and between the sliding steel top plate and the upper bearing plate for the duration of the test. Any observed lift-off is cause for rejection.

## 2. Sliding Coefficient of Friction

For all guided and non-guided expansion type bearings, measure the sliding coefficient of friction at the bearing's design capacity in accordance with the test method described below, and on the fifth and fiftieth cycles, at a sliding speed of 1 in/min (25 mm/min).

Calculate the sliding coefficient of friction as the horizontal load required to maintain continuous sliding of one bearing, divided by the bearing's vertical design capacity.

The test results are evaluated as follows:

- A maximum measured sliding coefficient of friction of 3%.
- A visual examination both during and after the test. Any resultant visual defects, such as bond failure, physical destruction, cold flow of PTFE to the point of debonding, or damaged components is cause for rejection of the lot.

Using undamaged test bearings in the work is permitted.

## 3. Test Method

The test method and equipment shall meet the following requirements:

- f. Arrange the test to determine the coefficient of friction on the first movement of the manufactured bearing.
- g. Clean the bearing surface prior to testing.
- h. Conduct the test at maximum working stress for the PTFE surface with the test load applied continuously for 12 hours prior to measuring friction.
- i. Determine the first movement static and dynamic coefficient of friction of the test bearing at a sliding speed of less than 1 in/min (25 mm/min), not to exceed:
 

0.04	unfilled PTFE
0.08	filled PTFE
- j. Subject the bearing specimen to 100 movements of at least 1 inch (25 mm) of relative movement and, if the test facility permits, the full design movement at a speed of less than 1 ft/min (300 mm/min). Following this test determine the static and kinetic coefficient of friction again. The specimen is considered a failure if it exceeds the values measured in (d) above or if it shows any signs of bond failure or other defects.

Bearings represented by test specimens passing the above requirements are approved for use in the structure subject to on-site inspection for visible defects.

**5.0 INSTALLATION**

Store disc bearings delivered to the bridge site under cover on a platform above the ground surface. Protect the bearings from injury at all times and, before placing the bearings, dry and clean all dirt, oil, grease or other foreign substances from the bearing. Do not disassemble the bearings during installation, except at the manufacturer’s direction. Place the bearings in accordance with the recommendations of the manufacturer, Contract Drawings, and as directed by the Engineer. If there is any discrepancy between the recommendations of the manufacturer, Special Provisions, and Contract Drawings, the Engineer is the sole judge in reconciling any such discrepancy.

Provide preformed bearing pads under the masonry plates in accordance with Article 1079-1 of the Standard Specifications.

Do not install any bearing before the Engineer approves it.

**6.0 BASIS OF PAYMENT**

Payment for all optional disc bearings will be at the lump sum contract price bid for “Pot Bearings” which includes full compensation for furnishing all disc bearings, labor, materials, tools, equipment, testing and incidentals required to complete the work in accordance with the Standard Specifications, this Special Provision, the manufacturer’s requirements and as directed by the Engineer.

**ELASTOMERIC BEARINGS**

**(10-03-02)**

Use elastomeric bearings in accordance with Article 1079-2 of the Standard Specifications except as follows:

**TABLE 1079-2  
NATURAL RUBBER ELASTOMER REQUIREMENTS**

Grade (durometer)	50	60
<b>PHYSICAL PROPERTIES</b>		
Hardness ASTM D2240	50 +5 -5	60 +5 -5

**CHARPY V-NOTCH TESTS****(SPECIAL)**

All structural steel furnished for main beam and girder members (for girder members see plans) shall meet the longitudinal Charpy V-Notch Tests specified in the supplementary requirements in ASTM A709-03a for zone 1. Unless otherwise noted on the plans, the material shall be marked and tested as non-fracture critical. Sampling and testing procedures shall be in accordance with AASHTO T243M (ASTM A673M). The (P) frequency of heat testing shall be used. For grade or grades of structural steel required, see Structure plans.

Obtain and submit certified mill test reports to the Materials and Tests Unit to show the results of each test required by this specification.

Material failing to meet the qualification requirements outlined above is unacceptable for use on this project.

**2080 MM CHAIN LINK FENCE****(SPECIAL)**

The 2080 mm Chain Link Fence will be constructed according to methods described in the Standard Specifications. The materials making up the 2080 mm Chain Link Fence will be as specified in the Standard Specifications.

The quantity of 2080 mm Chain Link Fence will be the actual number of meters of fence, measured in place from end post to end post, which has been completed and accepted. All posts used for the chain link fence are included in the price of the fence and will not be paid for separately. There will be no measurement made for installing adhesive anchors in concrete barrier rail as such work is considered incidental.

The quantity of fence, measured as described above, will be paid for at the contract unit price per meter for "2080 mm Chain Link Fence."

Payment will be made under:

2080 mm Chain Link Fence \_\_\_\_\_ Meter

**HIGH PERFORMANCE STEEL****(SPECIAL)****1.0 GENERAL**

High performance steel shall be produced and fabricated in accordance with ANSI/AASHTO/AWS Bridge Welding Code D1.5-96, applicable portions of the Standard Specifications, and these Special Provisions.

**2.0 MATERIAL PROPERTIES**

Structural steel designated on the plans as Grade HPS 485W shall conform to the requirements of ASTM A709-03a.

**3.0 WELDING****A. General**

All welding procedures for HPS 485W Steel shall be qualified in accordance with AWS D1.5 unless otherwise modified within this Special Provision.

Butt welds of flanges and webs and fillet welds of web to flanges of plate girders shall be made using the Submerged Arc Welding process. Only Submerged Arc Welding (SAW) or Shielded Metal Arc Welding (SMAW) may be used for all other connections involving HPS 485W steel.

The maximum level of diffusible hydrogen in deposited weld metal shall be 4 mL/100g. The level of diffusible hydrogen may be raised to 8mL/100g for SMAW only, provided that the higher preheat temperatures of Table 1 are attained.

**B. Filler Metal Requirements**

1. Filler metals for use in connecting Grade HPS 485W plates using the SAW process shall be as follows:
  - a. LA85 electrode with Mil800HPNi flux, by Lincoln Electric Company, 22801 St. Clair Avenue, Cleveland, Ohio 44117-1199; (216) 481-8100
  - b. ENi4 electrode, by ESAB, 801 Wilson Avenue, Hanover, PA 17331-1058; (800) 933-7070, combined with Mil800H flux by Lincoln Electric Company
  - c. In lieu of the above consumable combinations, the contractor may request approval of alternate consumables from the Engineer. Alternate manufacturer specific filler metals, both electrode and flux, shall meet the AWS Electrode/Flux Classification F9A4 EXXX-X, with supplementary moisture resistance designators H4 or H2, as per AWS A5.23, with 1% Nickel minimum in the weld deposit.

When using alternate consumables, the fabricator is required to perform the full range of weld tests as required by AWS D1.5 Section 12.6.

When using alternate consumables, diffusible hydrogen ( $H_d$ ) tests shall be performed on the weld metal. Minimum preheat and interpass temperatures to be used with alternate consumables shall be in accordance with AWS D1.5, Table 4.4. The deposited weld metal shall have a diffusible hydrogen level equivalent to 4 mL/100g or less.  $H_d$  test specimens are to be prepared at the fabrication plant. Specimens are to be tested in accordance with AWS A4.3. Test results in excess of 4 mL/100g are unacceptable, and a retest is required, with or without revised welding procedures. AWS D1.5 Section 5.7.6 is applicable, but WPS or  $H_d$  results are not transferable from fabricator to fabricator. Fabricators with multiple plants under a common umbrella of welding equipment, welding training, and supervision are required to perform the  $H_d$  testing only once per combination of consumables for each location. Plants audited as a single facility by the American Institute of Steel Construction (AISC) as a part of their Quality Certification Program, or other owner approved equal Quality Assurance Program, are considered one location. Multiple plants not falling under the AISC, or other 'single facility' audit definition, are considered separate facilities and additional WPS and  $H_d$  tests are required.

SAW consumables shall meet the hydrogen control level of H4 as per AWS D1.5, Section VIII6.2.2.1(1).

2. Filler metals for all welds connecting a Grade HPS 485W plate to a Grade 345W plate shall conform to the requirements for Grade 345W base metal as listed in AWS D1.5, Table 4.1 (H8 maximum). At the fabricator's option, the consumable combinations of Section 3.0(B)(1)(a) or 3.0(B)(1)(b) may be used provided the hydrogen control level of H4 is met as per AWS D1.5, Section VIII6.2.2.1(1). Electrodes for use in connecting Grade HPS 485W plates to Grade 345W plates using the SMAW process shall have the designator 'R' for moisture resistant coating. The designator 'HZ' shall be either H4 or H8, depending upon the level of preheat used.
3. SAW consumables and SMAW electrodes shall produce weld deposits that meet the requirements of AWS D1.5 Table 4.3.
4. Filler Metal Qualification Test Requirements for welding of HPS 485W plates together are as listed in AWS D1.5, Table 4.1, for Grade 485W base metal. Qualification, Pretest and Verification Test Requirements for welding HPS 485W plates as determined using WPS Test Plates shall provide properties equal to or greater than the base metal requirements as specified in ASTM A709-03a.



C. Preheat and Interpass Temperature

The maximum interpass temperature for welding HPS 485W steel is 232°C.

The minimum preheat and interpass temperatures for welding of HPS 485W steel plates using the electrodes of Section 3.0(B)(1)(a) or 3.0(B)(1)(b) shall be in accordance with Table 1.

**Table 1**

**Minimum Preheat and Interpass Temperature, °C, for HPS 485W**

Welding Process	H <sub>d</sub> maximum	Thickness, t, (mm) of Thickest Part at Point of Welding			
		t ≤ 19	19 < t ≤ 38	38 < t ≤ 64	t > 64
SAW/SMAW*	4 mL/100g	10	22	22	52
SMAW	8 mL/100g	10	52	80	108

If satisfactory results are not achieved with the above minimum preheat and interpass temperatures during development of the Welding Procedure Specifications (WPS), and an increased preheat temperature is used to provide a satisfactory Procedure Qualification Record (PQR), the higher preheat temperature shall be used during bridge fabrication as the required minimum.

The minimum preheat or interpass temperature required for a joint composed of different base metals and/or thicknesses, shall be based on the highest of the minimum preheat from AWS D1.5, Table 4.4 or the table above.

\* Diffusible hydrogen or filler metal tested by manufacturer shall not exceed a H4 classification. Heat input shall be limited as indicated below.

For all other consumable combinations:

The preheat and interpass temperature requirements shall be in accordance with AWS D1.5, Table 4.4. When welding two pieces of Grade HPS 485W steel, the temperature requirements of Table 4.4, Group IV shall be used. When welding Grade HPS 485W steel to Grade 345W steel, the temperature requirements of Table 4.4, Group I/II shall be used.

D. Heat Input

The minimum amount of heat input shall be 1.57 kilojoules per millimeter (kJ/mm) and the maximum shall be 3.54 kJ/mm determined using AWS D1.5, Section 5.12.

E. Backing

Steel backing material for Welding Procedure Specification test plates may be composed of Grade 345W (Sulfur = 0.025 maximum) or HPS 485W material.

4.0 AISC CERTIFICATION

Only fabricators meeting the requirements of the AISC Quality Certification Program for "Major Steel Bridges " may be used to fabricate HPS 485W steel.

5.0 BASIS OF PAYMENT

Structural steel will be paid for at the contract lump sum price for "Approximately \_\_\_\_\_ Kilograms Structural Steel". No separate payment will be made for HPS 485W Steel. The approximate quantity shown in the contract pay item is an estimate based on the computed weight of the structural steel necessary to complete the work. No measurement for payment will be made for this pay item, and no adjustment in the contract lump sum price will be made for any variation from the approximate quantity shown except for revisions in the plans which affect the quantity of structural steel necessary to complete the work.

When revisions in the plans have been made which affect the quantities of structural steel, adjustments in compensation will be made by supplemental agreement.

Payment at the contract lump sum price for "Approximately \_\_\_\_\_ Kilograms Structural Steel" will be full compensation for shop painting.

The above prices and payments will be full compensation for all work covered by this section including but not limited to furnishing, fabricating, delivering, placing, erecting, cleaning, and shop painting; furnishing, erecting, and removing falsework; setting bearings and anchorages; welding; and assembling all structural joints.

Payment will be made under:

Approximately \_\_\_\_\_ Kilograms Structural Steel.....Lump Sum

## **BEARING PILES**

### A. GENERAL

During pile driving operations, the Contractor shall use an approved system. No variations in the driving system will be permitted without the Engineer's written approval. Any change in the driving system will only be considered after the Contractor has submitted the necessary information for a revised wave equation analysis. The Contractor will be notified of the acceptance or rejection of the driving system changes within five (5) calendar days of the Engineer's receipt of the requested change.

A detailed and accurate record shall be kept by the Engineer during the driving of piles. Pile logs shall be forwarded to the Eastern Regional Design Group, Geotechnical Engineering Unit.

### B. PILE DRIVING ANALYZER (PDA)

#### 1.0 General:

This work shall consist of driving steel pipe pile(s) and steel H pile(s) with the Pile Driving Analyzer (PDA) (ASTM D 4945-89) attached. The PDA shall be used on the first production pile installed as directed by the Engineer. This pipe pile or H pile shall be a vertical pile. The Contractor shall be responsible for notifying the Engineer of their pile driving schedule not less than fourteen (14) working days prior to the beginning of pile driving.

The Engineer will take dynamic measurements during pile driving. Measurements taken during driving will include, but not be limited to: hammer performance, skin friction, bearing capacity, and driving stresses.

Pile driving criteria for the production piles will be furnished to the Contractor two (2) weeks after the dynamic testing is completed. Deeper driving or less driving may be required in order to allow for variations in the location and/or strength of the stratum from which the pile obtains its primary capacity.

The acceptability of production piles will be determined by the Engineer if absolute refusal above the specified plan elevation or the order length can not be driven to the plan elevation.

Piles not achieving the specified resistance within these limits shall be driven to penetrations established by the Engineer.

#### 2.0 Equipment:

The Engineer will furnish the dynamic measuring instruments. Transducers will be attached at an approximate distance equal to  $1.00 \pm$  m below the head of the pile. The transducers will be attached with bolts placed in holes that the Contractor has pre-drilled as directed by the Engineer. The Engineer will furnish materials and directions for installation of the transducers. The Contractor shall install the transducers as directed by the Engineer.

The Contractor is responsible in terms of both actual expense and time delays for transducers that are either damaged during installation or are installed incorrectly. The Engineer may require the Contractor to readjust the transducers during driving if the dynamic records are inconclusive. The transducers will be attached near the head of the pile after the hammer and leads have been placed on the pile.

It shall be the Contractor's responsibility to supply a suitable enclosure (shelter) to protect the computer and the test equipment operator from conditions of sun, wet, wind, and cold. The shelter shall have a minimum floor size of 2 m x 2 m and minimum roof height of 2.2 m. The inside temperature of the shelter shall be maintained between 10 to 30 degrees C. A heating or cooling system shall be provided, if required, to maintain the above-mentioned temperature. The enclosure shall be sufficiently near the pile location (within 23 m of the pile being tested) to be reached by the PDA cable(s).

Any damage to the Pile Driving Analyzer and supporting equipment due to the fault or negligence of the Contractor shall be replaced by the Contractor at no additional cost to the department.

### 3.0 Construction

The Contractor shall drill the holes necessary for the attachment of the transducers. The Contractor shall then lift, align and rotate the pile(s) to be tested in the driving leads. The Contractor shall install the instrumentation after the hammer and leads have been placed on the pile as directed by the Engineer. The Engineer will measure the wavespeed of the pile(s) as the Contractor drives the pile for approximately ten (10) blows with the proposed hammer or as directed by the Engineer. It is estimated that it will take approximately one (1) hour per pile to attach the transducers and measure the wavespeed after the hammer has been placed on the pile.

It is the Contractor's responsibility to supply pile(s) with extra length, if needed, or to situate the pile(s) in the leads and template such that the dynamic instruments and their accompanying wires will not be damaged by the template during driving.

The pile(s) shall be driven to the depth at which the Pile Driving Analyzer indicates that the capacity as shown in the plans has been achieved or as directed by the Engineer.

The Engineer may require that the Contractor reduce the energy transmitted to the pile(s) by reducing the energy of the hammer during driving. The pile installation procedure shall be subject to modification if dynamic testing indicates it to be necessary.

When directed by the Engineer, the Contractor shall wait a minimum 24 hours and then redrive the pile. After the Engineer reattaches the instruments, the contractor shall restrike the pile with the approved hammer. The hammer shall obtain the required stroke and then the minimum amount of penetration as directed by the Engineer. The minimum amount of penetration required during restrike will be 15 cm or as directed by the Engineer.

**R-513A&BA**

The Contractor shall notify the Engineer of his redriving schedule not less than one (1) working day prior to beginning redrive.

The Engineer shall determine when the dynamic testing has been satisfactorily completed.

**C. DYNAMIC TESTING OF PRODUCTION PILES**

The work shall consist of driving steel pipe pile(s) and steel H pile(s) with the Pile Driving Analyzer (PDA) (ASTM D 4945-89) attached. The PDA shall be used on the first production pile installed as directed by the Engineer.

The piles shall be tested vertically in accordance with Section B., "Pile Driving Analyzer" of this Special Provision.

Evaluation of the results of the dynamic testing may require that additional dynamic testing be performed at other locations as required by the Engineer.

The Engineer will determine when the dynamic testing has been satisfactorily completed.

Procedures for installing piles shall be subject to modification if subsequent dynamic testing indicates it to be necessary.

The number of production piles to be dynamically tested on this project will be as directed by the Engineer. It is anticipated that the number of monitor piles(s) will be two (2).

**D. METHOD OF MEASUREMENT AND BASIS OF PAYMENT**

**The number of production steel pipe piles and steel H piles to be dynamically tested on this project will be as directed by the Engineer. The number of piles to be tested is anticipated to be two (2). However, evaluation of the PDA results may require that additional dynamic testing be performed on other production piles as required by the Engineer.**

**All costs involved with dynamic load testing the steel pipe pile(s) and steel H pile(s) using the PDA shall be included in the unit price bid for the "Dynamic Load Test", each per pile. The unit price bids shall be full compensation for all materials, labor, tools, equipment, mobilization, and incidentals necessary to complete the work for each dynamic test, including redriving but excluding the production pile(s).**