


Rev. 3/16/01

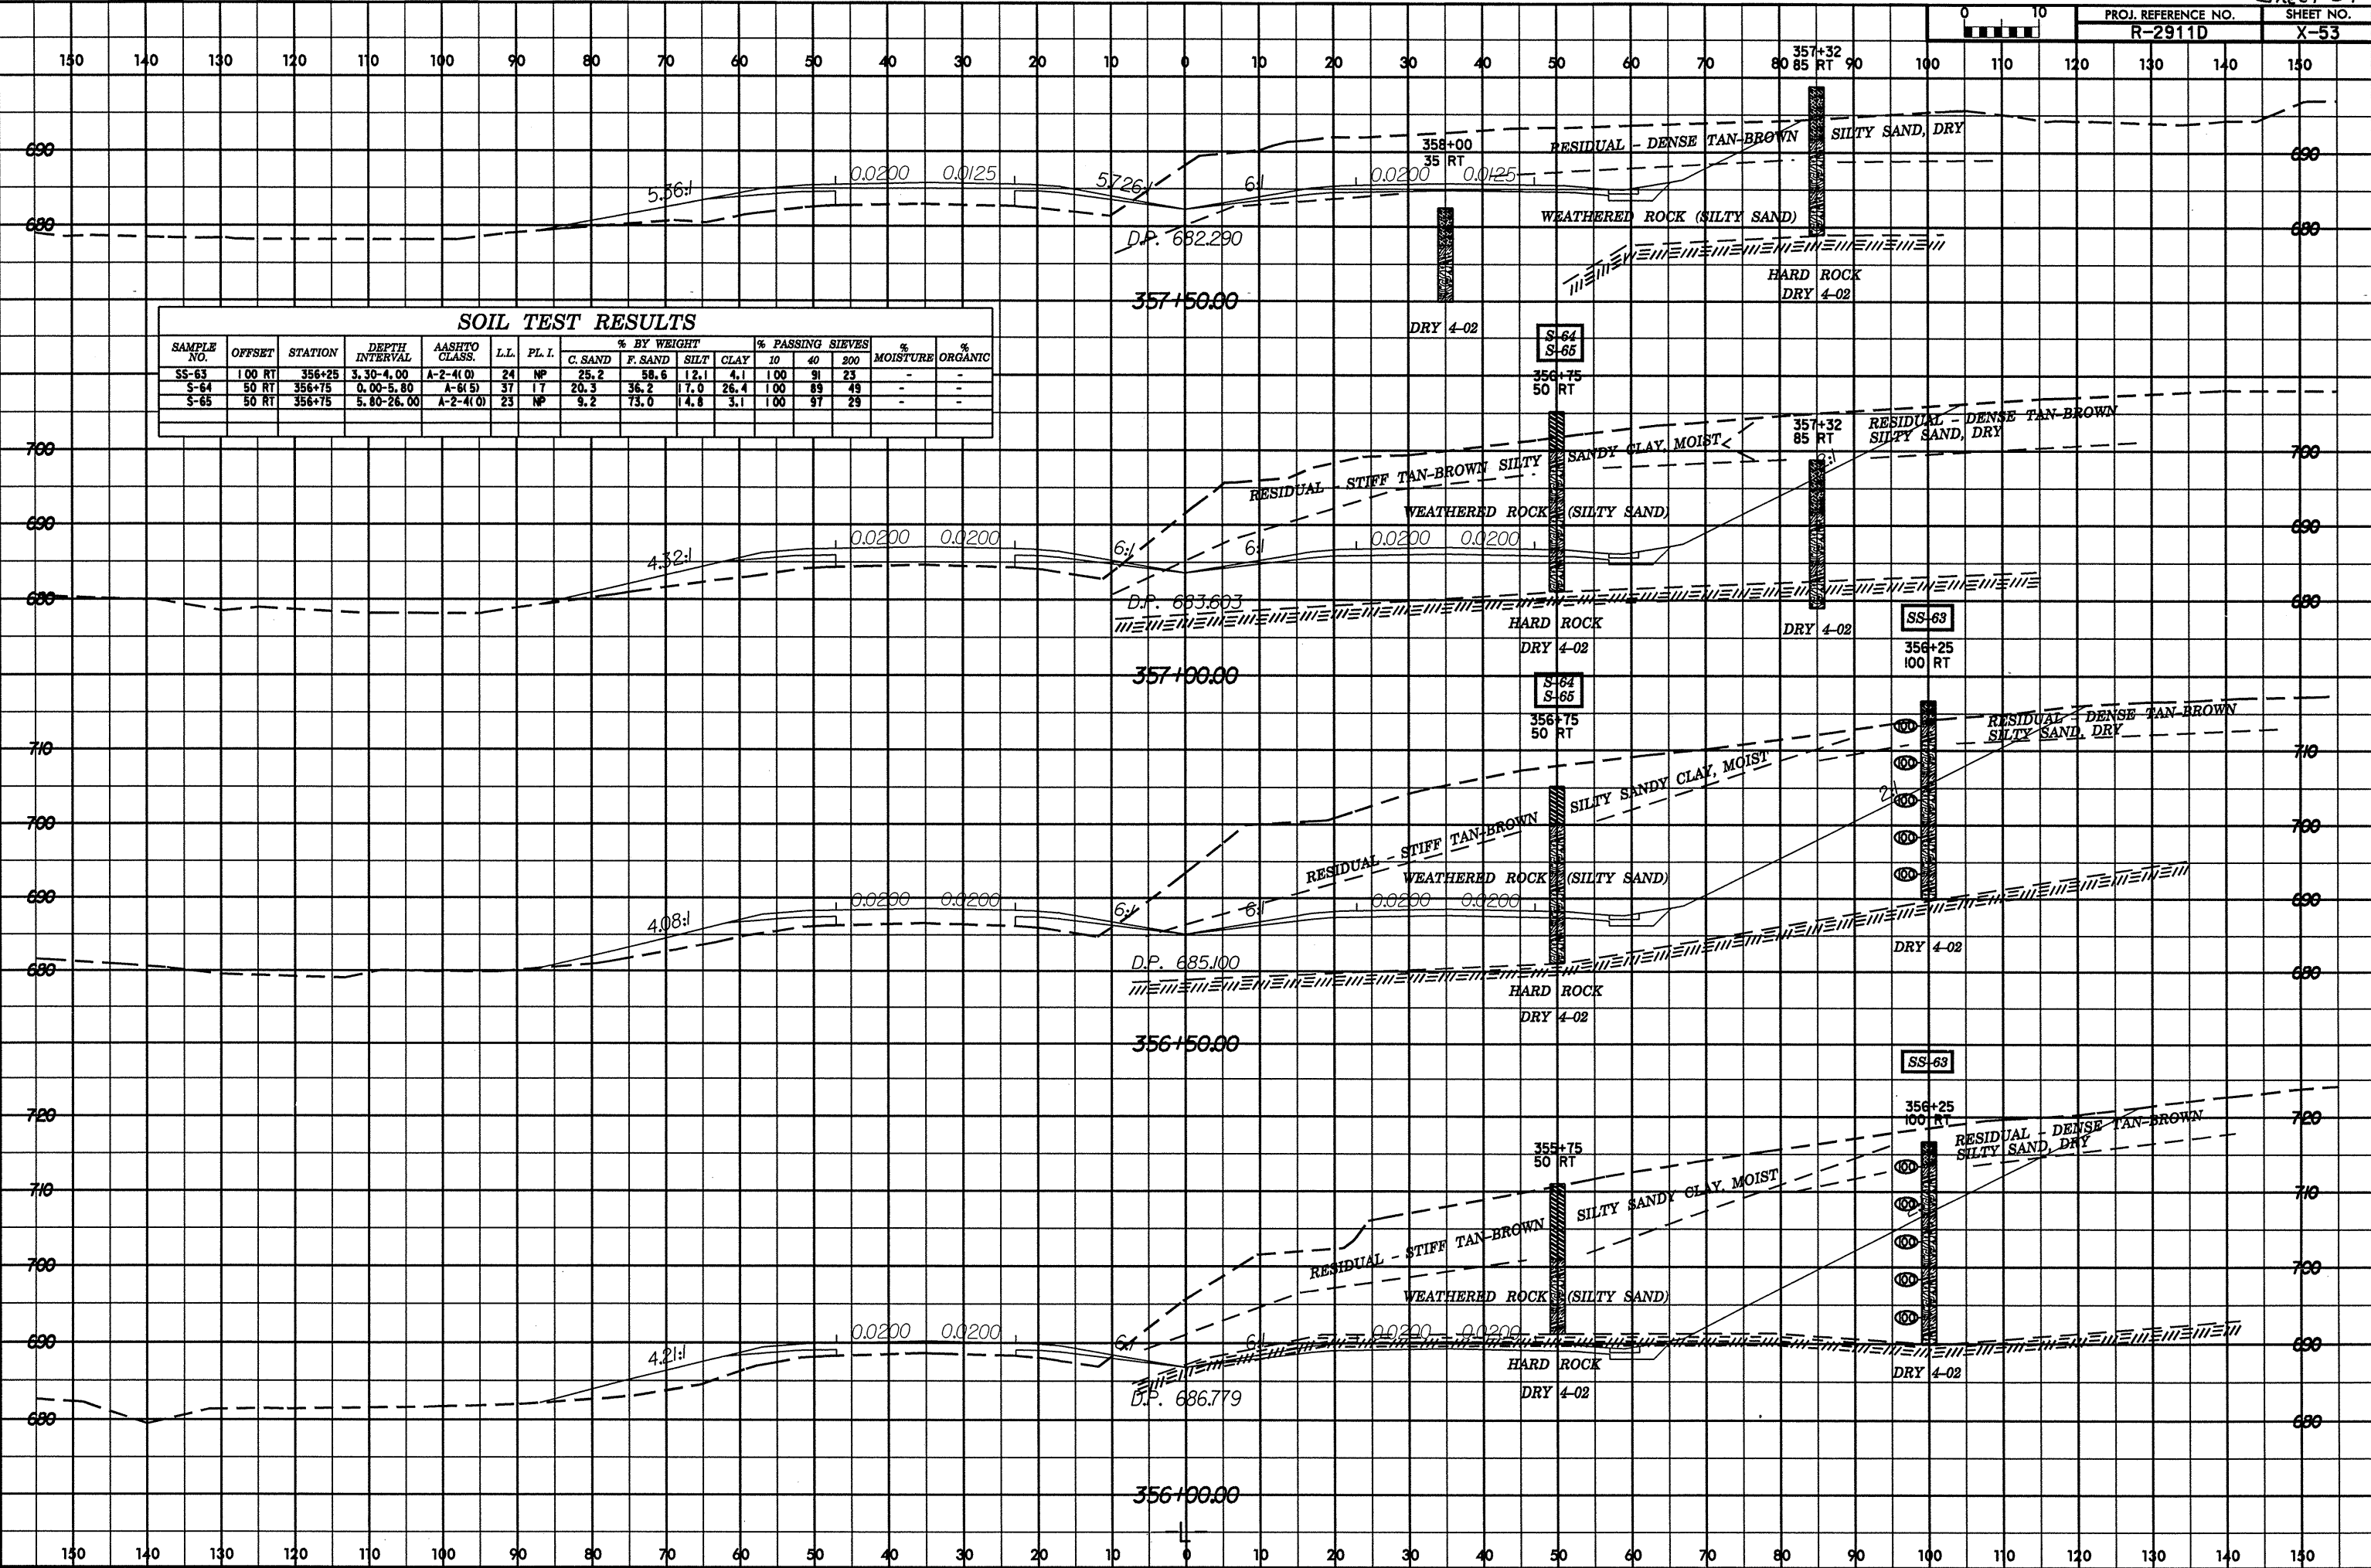

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L.I.	% BY WEIGHT				% PASSING SIEVES			% MOISTURE	% ORGANIC
							C. SAND	F. SAND	SILT	CLAY	10	40	200		
SS-63	100 RT	356+25	3.30-4.00	A-2-4(0)	24	NP	25.2	58.6	12.1	4.1	100	91	23	-	-
S-64	50 RT	356+75	0.00-5.80	A-6(5)	37	17	20.3	36.2	17.0	26.4	100	89	49	-	-
S-65	50 RT	356+75	5.80-26.00	A-2-4(0)	23	NP	9.2	73.0	14.8	3.1	100	97	29	-	-

SYSTEM TIME