





UTILITY CONSTRUCTION

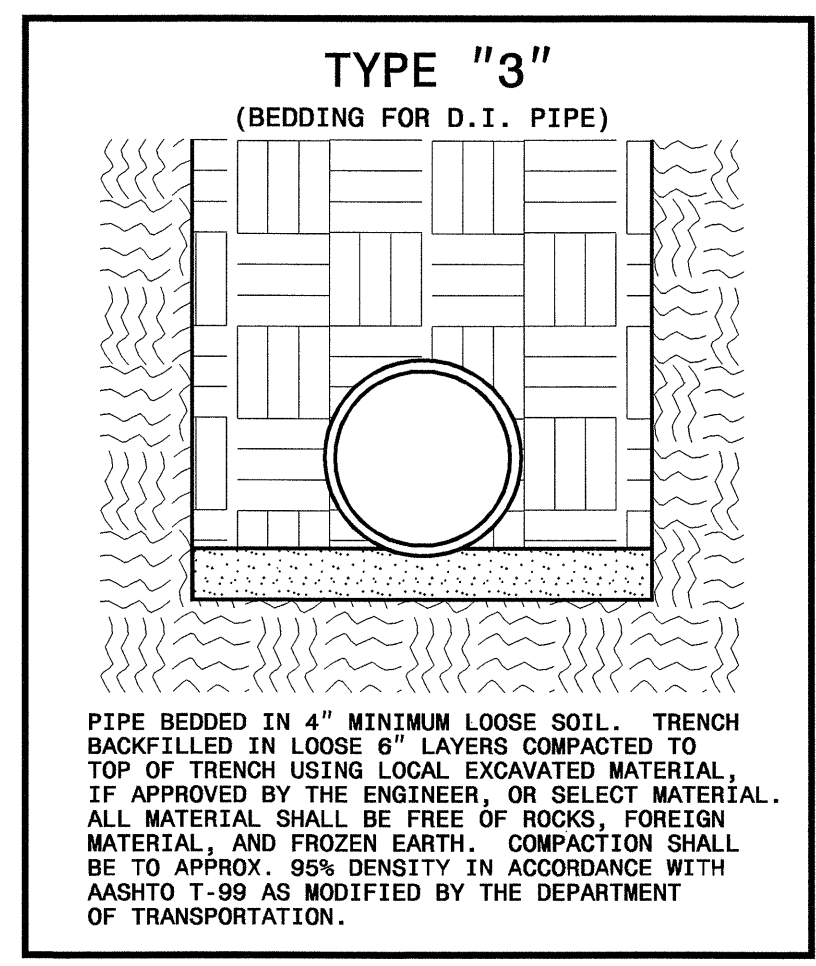

MAXIMUM TRENCH WIDTH AT TOP OF PIPE

NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)	NOMINAL PIPE SIZE (INCHES)	TRENCH WIDTH (INCHES)
4	28	20	44
6	30	24	48
8	32	30	54
10	34	36	60
12	36	42	66
14	38	48	72
16	40	54	78
18	42		

-L- STA. 11+50.00 BEGIN STATE TIP NO. B-3711

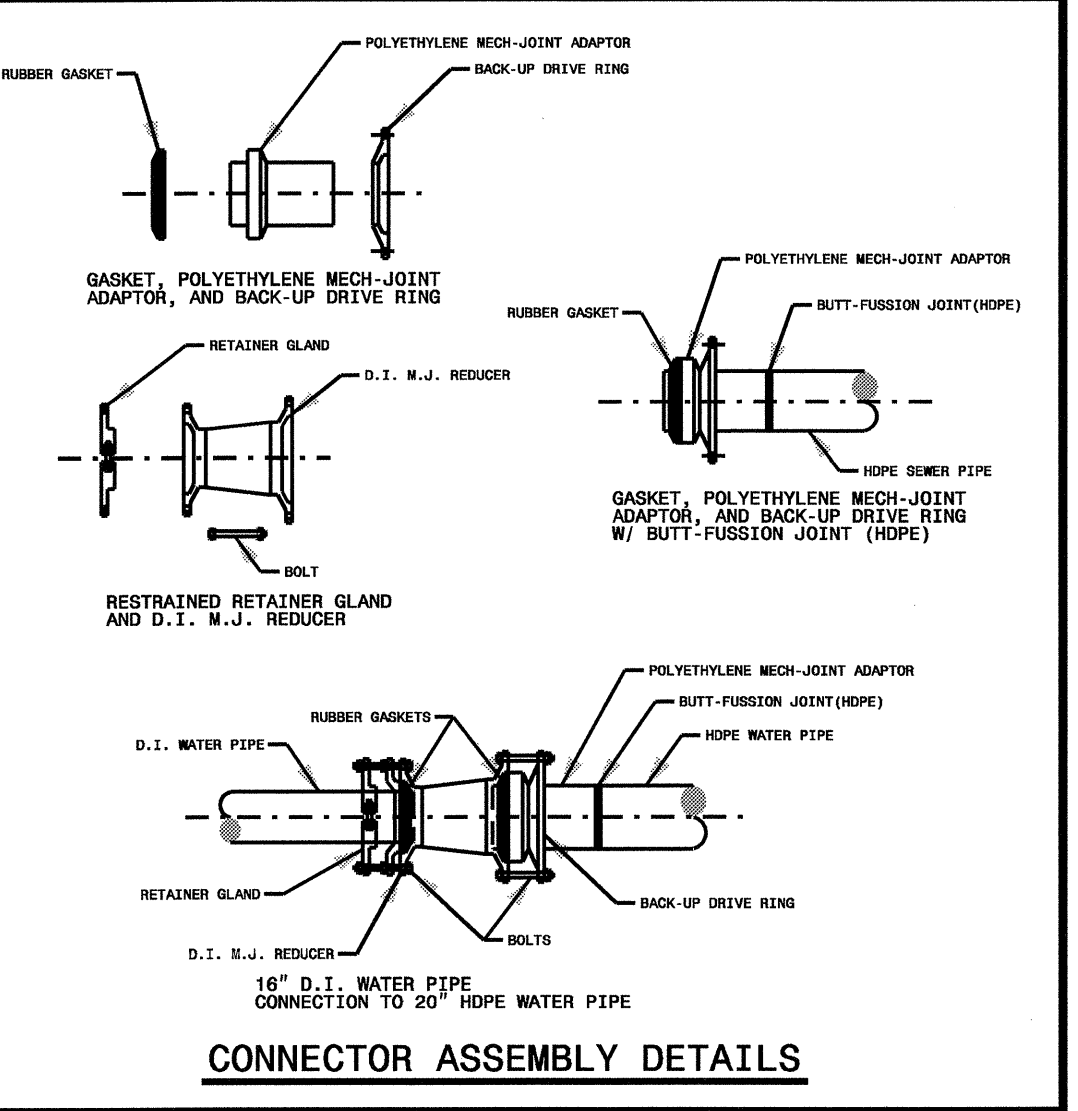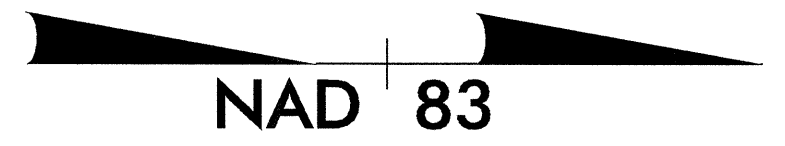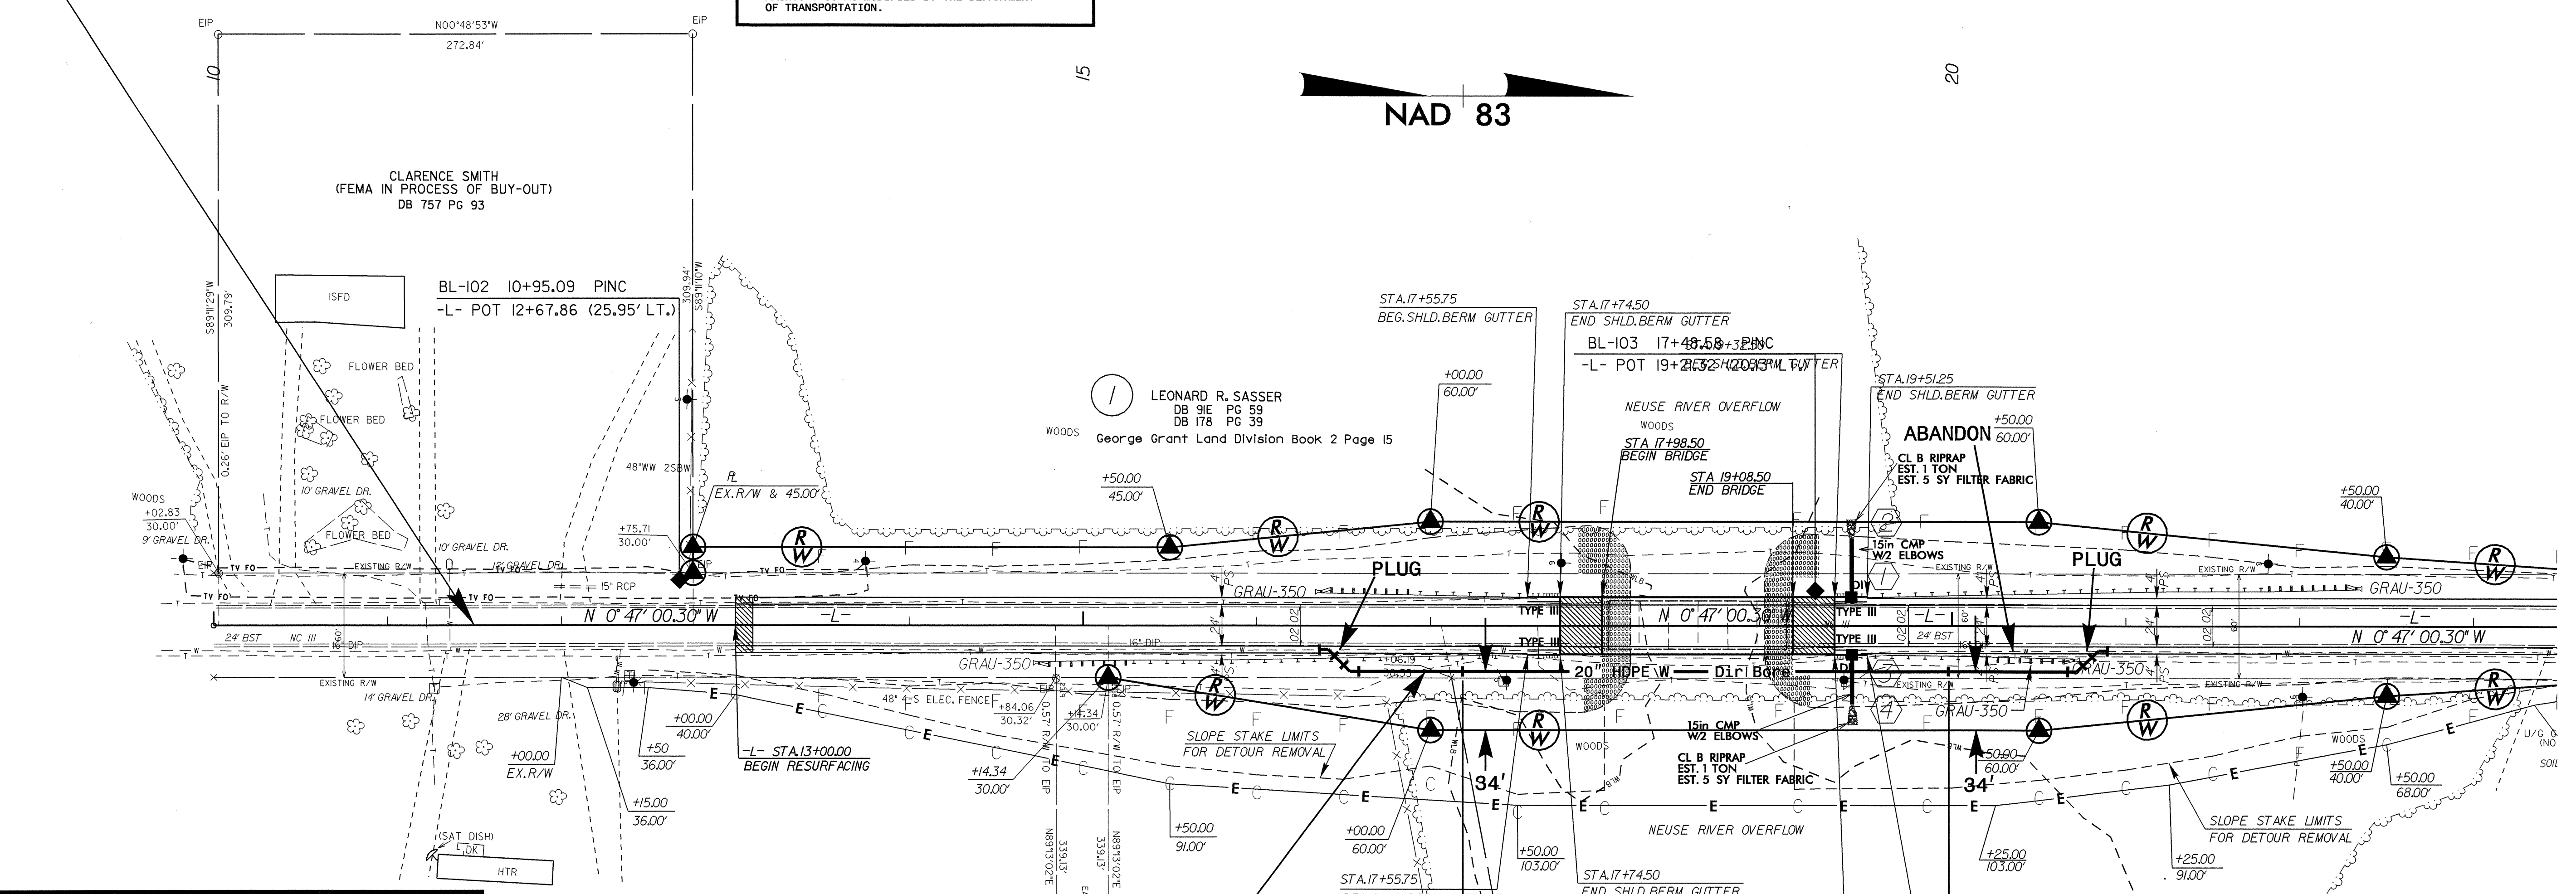

LEAH H. BEST  
DB 82E PG 153  
George Grant Land Division Book 2 Page 15

**PROP. - 280' OF 20" HDPE WATER PIPE BY DIRECTIONAL BORE  
 184' OF 16" DI WATER PIPE, PC 250  
 16 - 16" RESTRAINED RETAINER GLANDS  
 4 - 16" - 45° DI BENDS  
 CONNECT USING NECESSARY FITTINGS**

LEAH H. BEST  
DB 82E PG 153  
George Grant Land Division Book 2 Page 15

M. BRYANT PRICE  
DB 40PG 121  
George Grant Land Division Book 2 Page 15

8/17/99  
06-AUG-2004 14:03  
R:\Utilities\Utility\Projects\B3711-ut-UC-2\_psh.dgn  
shd at 10:21:24