PROJECT REFERENCE NO.	SHEET NO.
U-0620	31
ROADWAY DESIGN ENGINEER	HYDRAULICS ENGINEER

LEGEND

[X] N60 EQUIVALENT

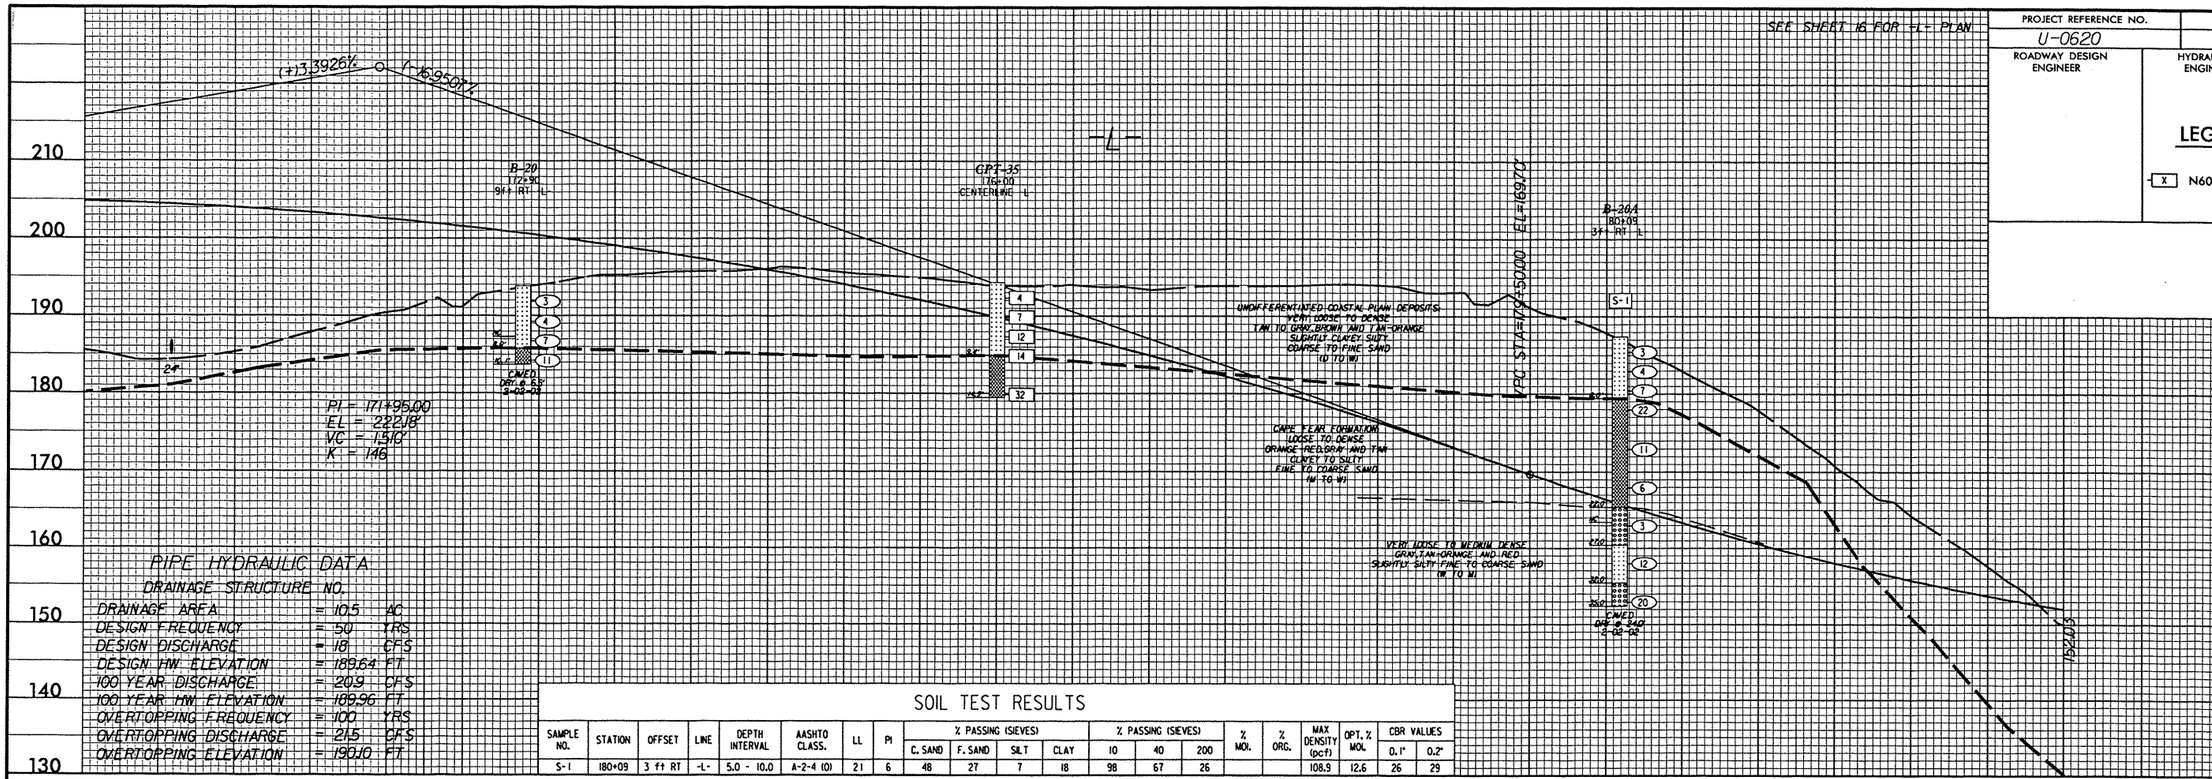

SOIL TEST RESULTS

SAMPLE NO.	STATION	OFFSET	LINE	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% PASSING (SIEVES) C. SAND	F. SAND	SILT	CLAY	% PASSING (SIEVES) 10	40	200	% MOI.	% ORG.	MAX DENSITY (pcf)	OPT. % MOI.	CBR VALUES 0.1"	0.2"
S-1	180+09	3 ft RT	-L-	5.0 - 10.0	A-2-4 (0)	21	6	48	27	7	18	98	67	26			108.9	12.6	26	29

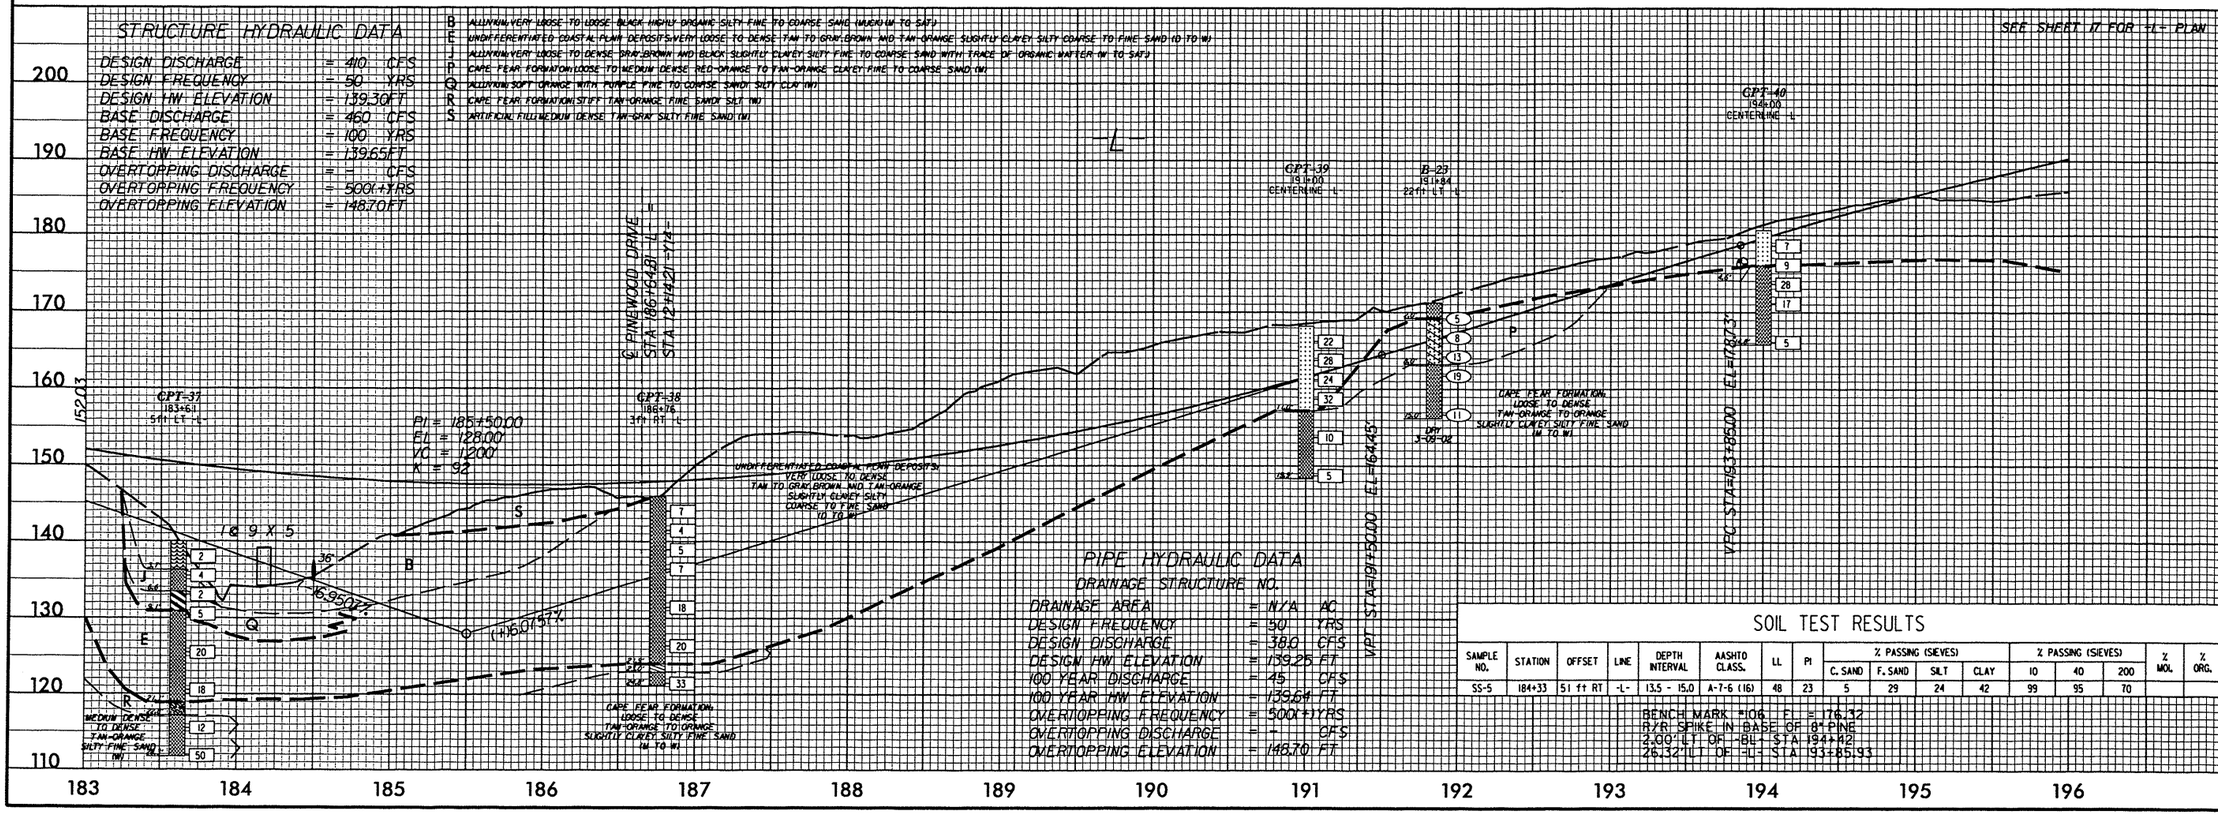

SOIL TEST RESULTS

SAMPLE NO.	STATION	OFFSET	LINE	DEPTH INTERVAL	AASHTO CLASS.	LL	PI	% PASSING (SIEVES) C. SAND	F. SAND	SILT	CLAY	% PASSING (SIEVES) 10	40	200	% MOI.	% ORG.
SS-5	184+33	51 ft RT	-L-	13.5 - 15.0	A-7-6 (16)	48	23	5	29	24	42	99	95	70		