
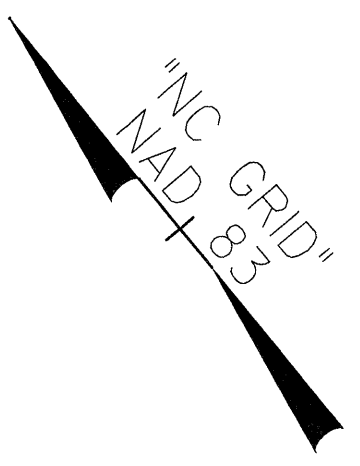


ALL WATER LINES AND SANITARY SEWER LINES OWNED BY THE CITY OF GASTONIA

PROP. 1 - RELOCATE EXISTING WATER METER
10M OF 20MM COPPER WATER PIPE, TYPE K
1 - 400MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 18M OF 400MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
4 - 400MM 22 1/2° DI BENDS
CONNECT USING NECESSARY FITTINGS
SEE PROFILE LINE W1 UC-31

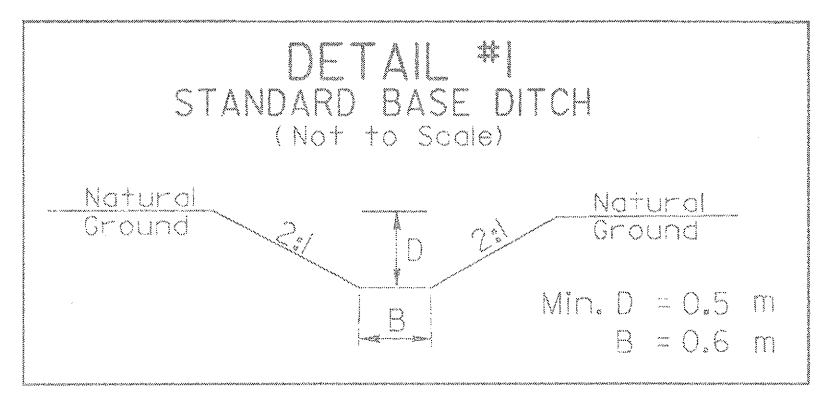

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT
8M OF 150MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING WATER METER
10M OF 20MM COPPER WATER PIPE, TYPE K
1 - 300MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 18M - FILL OR REMOVE ABANDONED 400MM PIPE, CI WATER

MATCHLINE -L- STA 36+40 SHEET UC-13

MATCHLINE -L- STA 38+20 SHEET UC-15

PROP. 1 - RELOCATE EXISTING WATER METER
2M OF 50MM PVC WATER PIPE, SDR 21, 1.38 MPA WP
1 - 150MM X 50MM TAPPING SADDLE
1 - 50MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING WATER METER
20M OF 20MM COPPER WATER PIPE, TYPE K
1 - 400MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

PROP. 21M - FILL OR REMOVE ABANDONED 300MM PIPE, CI WATER

PROP. 22M OF 300MM DI WATER PIPE, CLASS 51, 2.41 MPA WP
4 - 300MM 22 1/2° DI BENDS
CONNECT USING NECESSARY FITTINGS

QA: T56845\Recovery\Frc\U2408\U2408UC 14.dgn 10/07/2004 02:28:10 PM