

ALL WATER LINES AND SANITARY SEWER LINES OWNED BY THE CITY OF GASTONIA

"NC GRID"
NAD 83

STANDARD BUSINESS FORMS, INC.
D.B. 798 PG. 449

13

PROP. 1 - BREAK DOWN & REBUILD EXISTING MANHOLE G3
STA. 0+42.54, LINE G

0.40 M RT. OF -Y3-
STA. 10+87.91
EX. TOP EL. 259.683
NEW TOP EL. 260.551

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT
10M OF 150MM DI WATER PIPE,
CLASS 51, 2.41 MPA WP
1 - 150MM GATE VALVE & VALVE BOX,
1.38 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - 1200MM DIA PRECAST CONC SEWER MANHOLE G2
STA. 0+15.96, LINE G

19.47 M LT. OF -L-
STA. 18+45.28


PROP. 42.54M OF 200MM DI SEWER PIPE, CLASS 51. SEE PROFILE FOR LINE G ON SHEET UC-29

PROP. 42M - FILL OR REMOVE ABANDONED 200MM PIPE, TCP SEWER

PROP. 1 - BREAK DOWN & REBUILD EXISTING MANHOLE G1
STA. 0+00.00, LINE G

5.19 M LT. OF -L-
STA. 18+38.46
EX. TOP EL. 260.498
NEW TOP EL. 261.121

PROP. 1 - RELOCATE EXISTING WATER METER
22M OF 20MM COPPER WATER PIPE, TYPE K
1 - 300MM X 20MM TAPPING SADDLE
1 - 20MM CORPORATION STOP
CONNECT USING NECESSARY FITTINGS

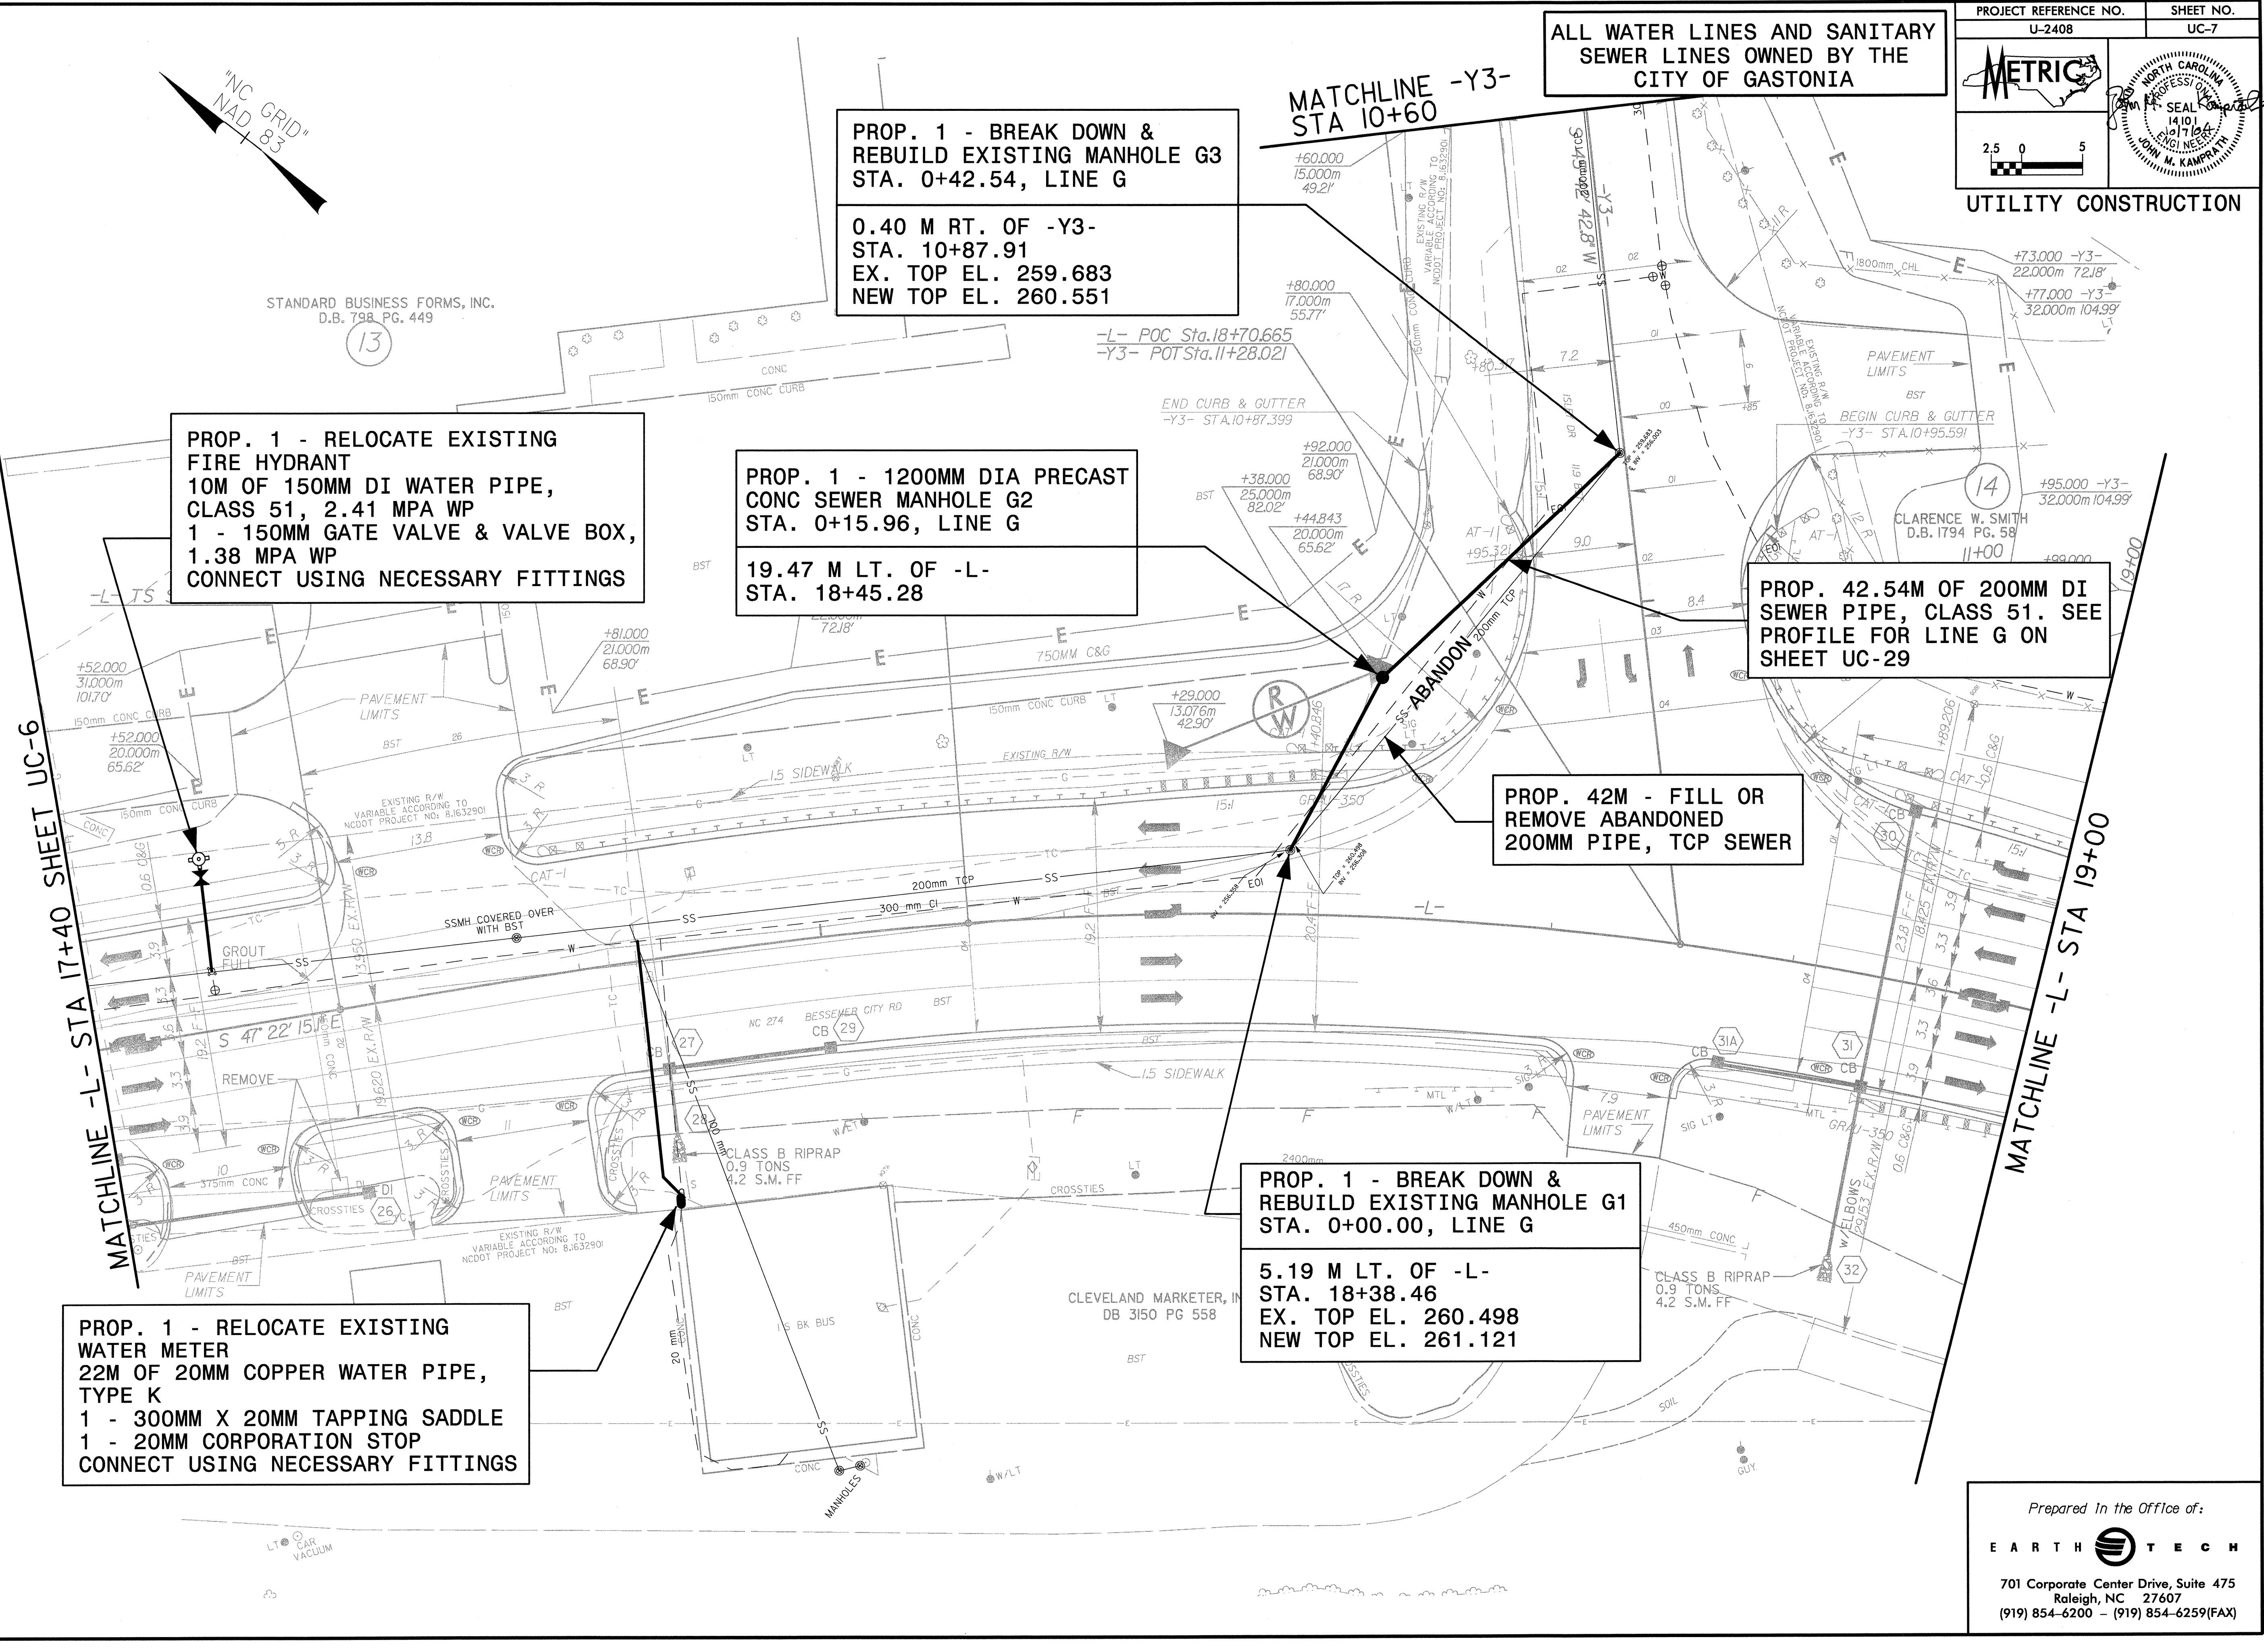

S:\7684EV\codway\BTS\1\2408\UC-7.dwg UC-7.rvt 11/23/2004 11:26:26 AM