



## ELEVATION AT EXPANSION JOINTS BARRIER RAIL DETAILS

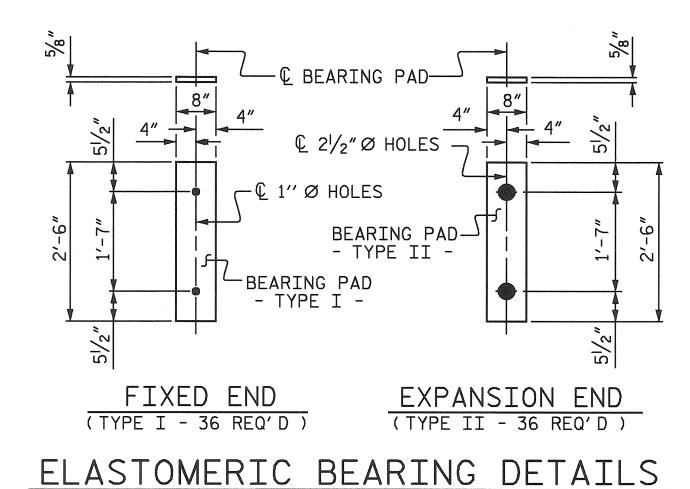

1	ASSEMBLED BY : J.L. WALTON CHECKED BY : B.N. BARODAWALA	 9/2/03 2/19/04
ut ton	DRAWN BY: WJH 4/89 REV. 10/1 CHECKED BY: FCJ 5/89 REV. 5/7	 RWW/LES RWW/LES

GRADE 270 S	TRANDS
	½″Ø L.R.
AREA (SQUARE INCHES)	0.153
ULTIMATE STRENGTH (LBS.PER STRAND)	41,300
APPLIED PRESTRESS (LBS.PER STRAND)	30,980

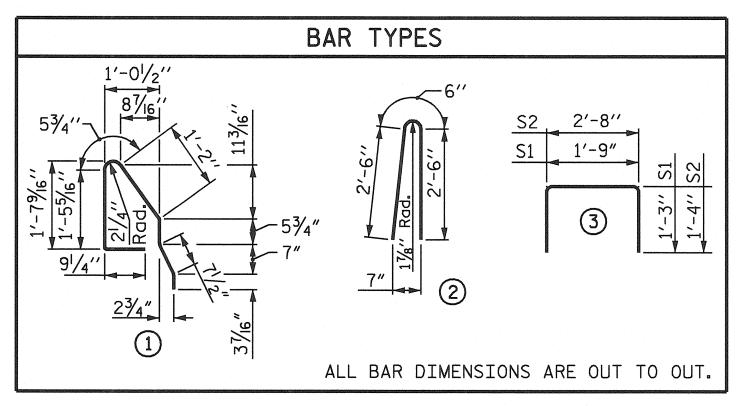

BILI	LOF	MATER	IAL F	OR ONE	CORED	SLAB SE	CTION		
SPANS A AND C									
	EXTERIOR UNIT   INTERIOR UNIT								
BAR	NUMBER	SIZE	TYPE	LENGTH	WEIGHT	LENGTH	WEIGHT		
B1	2	# 4	STR	24'-8"	33	24'-8"	33		
		-							
S1	8	# 5	3	4′-3″	35	4′-3″	35		
S2	48	# 4	3	5′-4″	171	5′-4″	171		
* S3	26	# 5	1	5′-3″	142				
REINFO	ORCING	STEEL	÷		239 LBS.		239 LBS.		
₩ EPOX	Y COATE	ED REIN	FORCING	STEEL	142 LBS.				
5,000	P.S.I.CO	NCRETE		3.0	6 CU. YDS.	3.	6 CU. YDS.		
					:				
1/2"Ø L	.R. STRA	NDS			No. 12	No. 12			

BIL	L OF N	MATER	IAL F	OR ONE	CORED	SLAB SE	CTION			
SPAN B										
EXTERIOR UNIT   INTERIOR UNIT										
BAR	NUMBER	SIZE	TYPE	LENGTH	WEIGHT	LENGTH	WEIGHT			
B2	4	# 4	STR	25'-9"	69	25′-9″	69			
S1	8	# 5	3	4'-3"	35	4'-3"	35			
S2	98	# 4	3	5′-4″	349	5′-4″	349			
* S3	51	# 5	1	5′-3″	279					
			-							
REINF(	ORCING S	STEEL			453 LBS.		453 LBS.			
₩ EPOX	Y COATE	ED REIN	FORCING	STEEL	279 LBS.		·			
5,000	P.S.I. CC	7.	O CU. YDS.							
1/2"ØL	R. STRA	NDS			No. 20		No. 20			

DEAD LOAD DEFI	ECTION AND C	AMBER
	SPANS A & C 3'-0"× 1'-9"	SPAN B 3'-0"× 1'-9"
	1/2"Ø L.R. STRAND	½″Ø L.R. STRAND
CAMBER (SLAB ALONE IN PLACE)	Å 3/8"	1 <sup>5</sup> / <sub>8</sub> "
DEFLECTION DUE TO *** SUPERIMPOSED DEAD LOAD	√ ½16″	√ 5/ <sub>16</sub> ″
FINAL CAMBER	<u></u> 5/16″	15/16"
** INCLUDES FUTURE WEARING SUR	FACE	

	BII	LL OF N	MATERIA	AL FOR	CONCRE	TE BA	RRIE	R RAIL	
BAR	BARS PER SPAN				TOTAL NO.	SIZE	TYPE	LENGTH	WEIGHT
	SPAN A	SPAN B	SPAN C		:				
* B3	14	28	14		56	#5	STR	24'-7"	1436
							·		
					·		`	·	
* S4	52	102	52		206	#5	2	5′-6″	1182
* E	<u>POXY COA</u>	TED REIN	<u> </u>	STEEL	LBS.				2618
CLA	SS AA CO	DNCRETE			CU.YDS.	·			21.9
TOT	AL LIN. F	T. OF CON	NCRETE BA	RRIER R	AIL				200.75

## NOTES

ALL PRESTRESSING STRANDS SHALL BE 7-WIRE LOW RELAXATION GRADE 270 STRANDS AND SHALL CONFORM TO AASHTO M203 EXCEPT FOR SAMPLING REQUIREMENTS WHICH SHALL BE IN ACCORDANCE WITH THE STANDARD SPECIFICATIONS.

ALL REINFORCING STEEL CAST WITH THE CORED SLAB SECTIONS SHALL BE GRADE 60 AND SHALL BE INCLUDED IN THE LUMP SUM PRICE BID FOR CONSTRUCTION OF SUPERSTRUCTURE.

RECESSES FOR TRANSVERSE STRANDS SHALL BE GROUTED AFTER THE TENSIONING OF THE STRANDS.

THE  $2\frac{1}{2}$ " Ø DOWEL HOLES AT FIXED ENDS OF SLAB SECTIONS SHALL BE FILLED WITH GROUT. THE  $2\frac{1}{2}$ " Ø DOWEL HOLES AT EXPANSION ENDS OF SLAB SECTIONS SHALL BE FILLED WITH JOINT SEALER MATERIAL TO  $1\frac{1}{2}$ " ABOVE THE TOP OF DOWELS AND THEN FILLED WITH GROUT.

THE JOINT SEALER MATERIAL SHALL CONFORM TO THE REQUIREMENTS OF TYPE SL LOW MODULUS SILICONE SEALANT. THE 2"Ø BACKER ROD SHALL CONFORM TO THE REQUIREMENTS OF TYPE M BOND BREAKER. SEE SECTION 1028 OF THE STANDARD SPECIFICATIONS.

WHEN CORED SLABS ARE CAST, A POSITIVE HOLD-DOWN SYSTEM SHALL BE EMPLOYED TO PREVENT VOIDS FROM RISING OR MOVING SIDEWAYS. THIS SYSTEM SHALL BE DESIGNED TO BE LEFT IN PLACE UNTIL THE CONCRETE HAS REACHED RELEASE STRENGTH. AT LEAST THREE WEEKS PRIOR TO CASTING CORED SLABS, THE CONTRACTOR SHALL SUBMIT TO THE ENGINEER FOR REVIEW AND COMMENT, DETAILED DRAWINGS OF THE PROPOSED HOLD-DOWN SYSTEM. IN ADDITION TO STRUCTURAL DETAILS, LOCATION AND SPACING OF THE HOLD-DOWNS SHALL BE INDICATED.

THE TRANSFER OF LOAD FROM THE ANCHORAGES TO THE CORED SLAB UNIT SHALL BE DONE WHEN THE CONCRETE HAS REACHED A COMPRESSIVE STRENGTH OF NOT LESS THAN 4000 PSI.

ALL REINFORCING STEEL IN BARRIER RAILS SHALL BE EPOXY COATED.

PRESTRESSING STRANDS SHALL BE CUT FLUSH WITH THE CORED SLAB UNIT ENDS.

APPLY EPOXY PROTECTIVE COATING TO CORED SLAB UNIT ENDS. FOR EPOXY PROTECTIVE COATING, SEE SPECIAL PROVISIONS.

VERTICAL GROOVED CONTRACTION JOINTS, ½" IN DEPTH, SHALL BE TOOLED IN ALL EXPOSED FACES OF THE BARRIER RAIL AND IN ACCORDANCE WITH ARTICLE 825-10(B) OF THE STANDARD SPECIFICATIONS. A VERTICAL CONTRACTION JOINT SHALL BE LOCATED AT EACH THIRD POINT BETWEEN BARRIER RAIL EXPANSION JOINTS. ONLY ONE CONTRACTION JOINT IS REQUIRED AT MIDPOINT OF BARRIER RAIL SEGMENTS LESS THAN 20 FEET IN LENGTH AND NO CONTRACTION JOINTS ARE REQUIRED FOR THOSE SEGMENTS LESS THAN 10 FEET IN LENGTH.

FOR ELASTOMERIC BEARINGS, SEE SPECIAL PROVISIONS.


CORED SLABS REQUIRED						
	NO.	LENGTH	TOTAL			
SPANS A & C EXTERIOR C.S.	4	25′-0″	100′-0″			
SPANS A & C INTERIOR C.S.	20	25′-0″	500′-0″			
SPAN B EXTERIOR C.S.	2	50′-0″	100′-0″			
SPAN B INTERIOR C.S.	10	50′-0″	500′-0″			
TOTAL	36		1200′-0″			

PROJECT NO. B-3530

WAKE COUNTY

STATION: 15+83.00 -L-



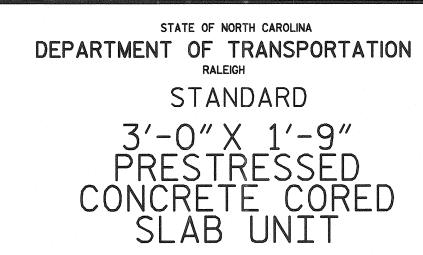

		SHEET NO.				
).	BYs	DATE:	NO.	BYs	DATE:	S-9
	-		3			TOTAL SHEETS
			4			21