


-L-

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.I.	% BY WEIGHT				% PASSING (SIEVES)		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
SS-1	20	22+00	1.5-3.0	A-7-6(10)	41	23	20.8	21.0	28.0	30.3	87	75	56
SS-2	20	22+00	6.5-8.0	A-4(0)	18	NP	8.7	39.8	35.4	16.1	100	95	62
SS-3	20	22+00	11.5-13.0	A-4(2)	26	6	6.1	34.7	41.1	18.2	100	97	70
SS-4	20	22+00	16.5-18.0	A-4(0)	33	NP	36.5	21.6	35.8	6.1	100	72	48
SS-5	-20	27+00	6.0-7.5	A-7-6(7)	50	31	34.1	18.4	21.3	26.2	82	60	42
SS-6	-20	27+00	11.0-12.5	A-4(4)	35	10	2.0	46.0	27.7	24.2	100	100	59
SS-7	25	28+50	1.5-3.0	A-7-6(10)	59	26	29.5	13.1	19.1	38.3	84	64	51
SS-8	25	28+50	1.0-1.5	A-2-4(0)	18	NP	40.0	30.7	21.3	8.1	86	60	31
SS-9	25	28+50	11.5-13.0	A-1-5(0)	31	NP	56.1	16.5	19.3	8.1	64	33	21

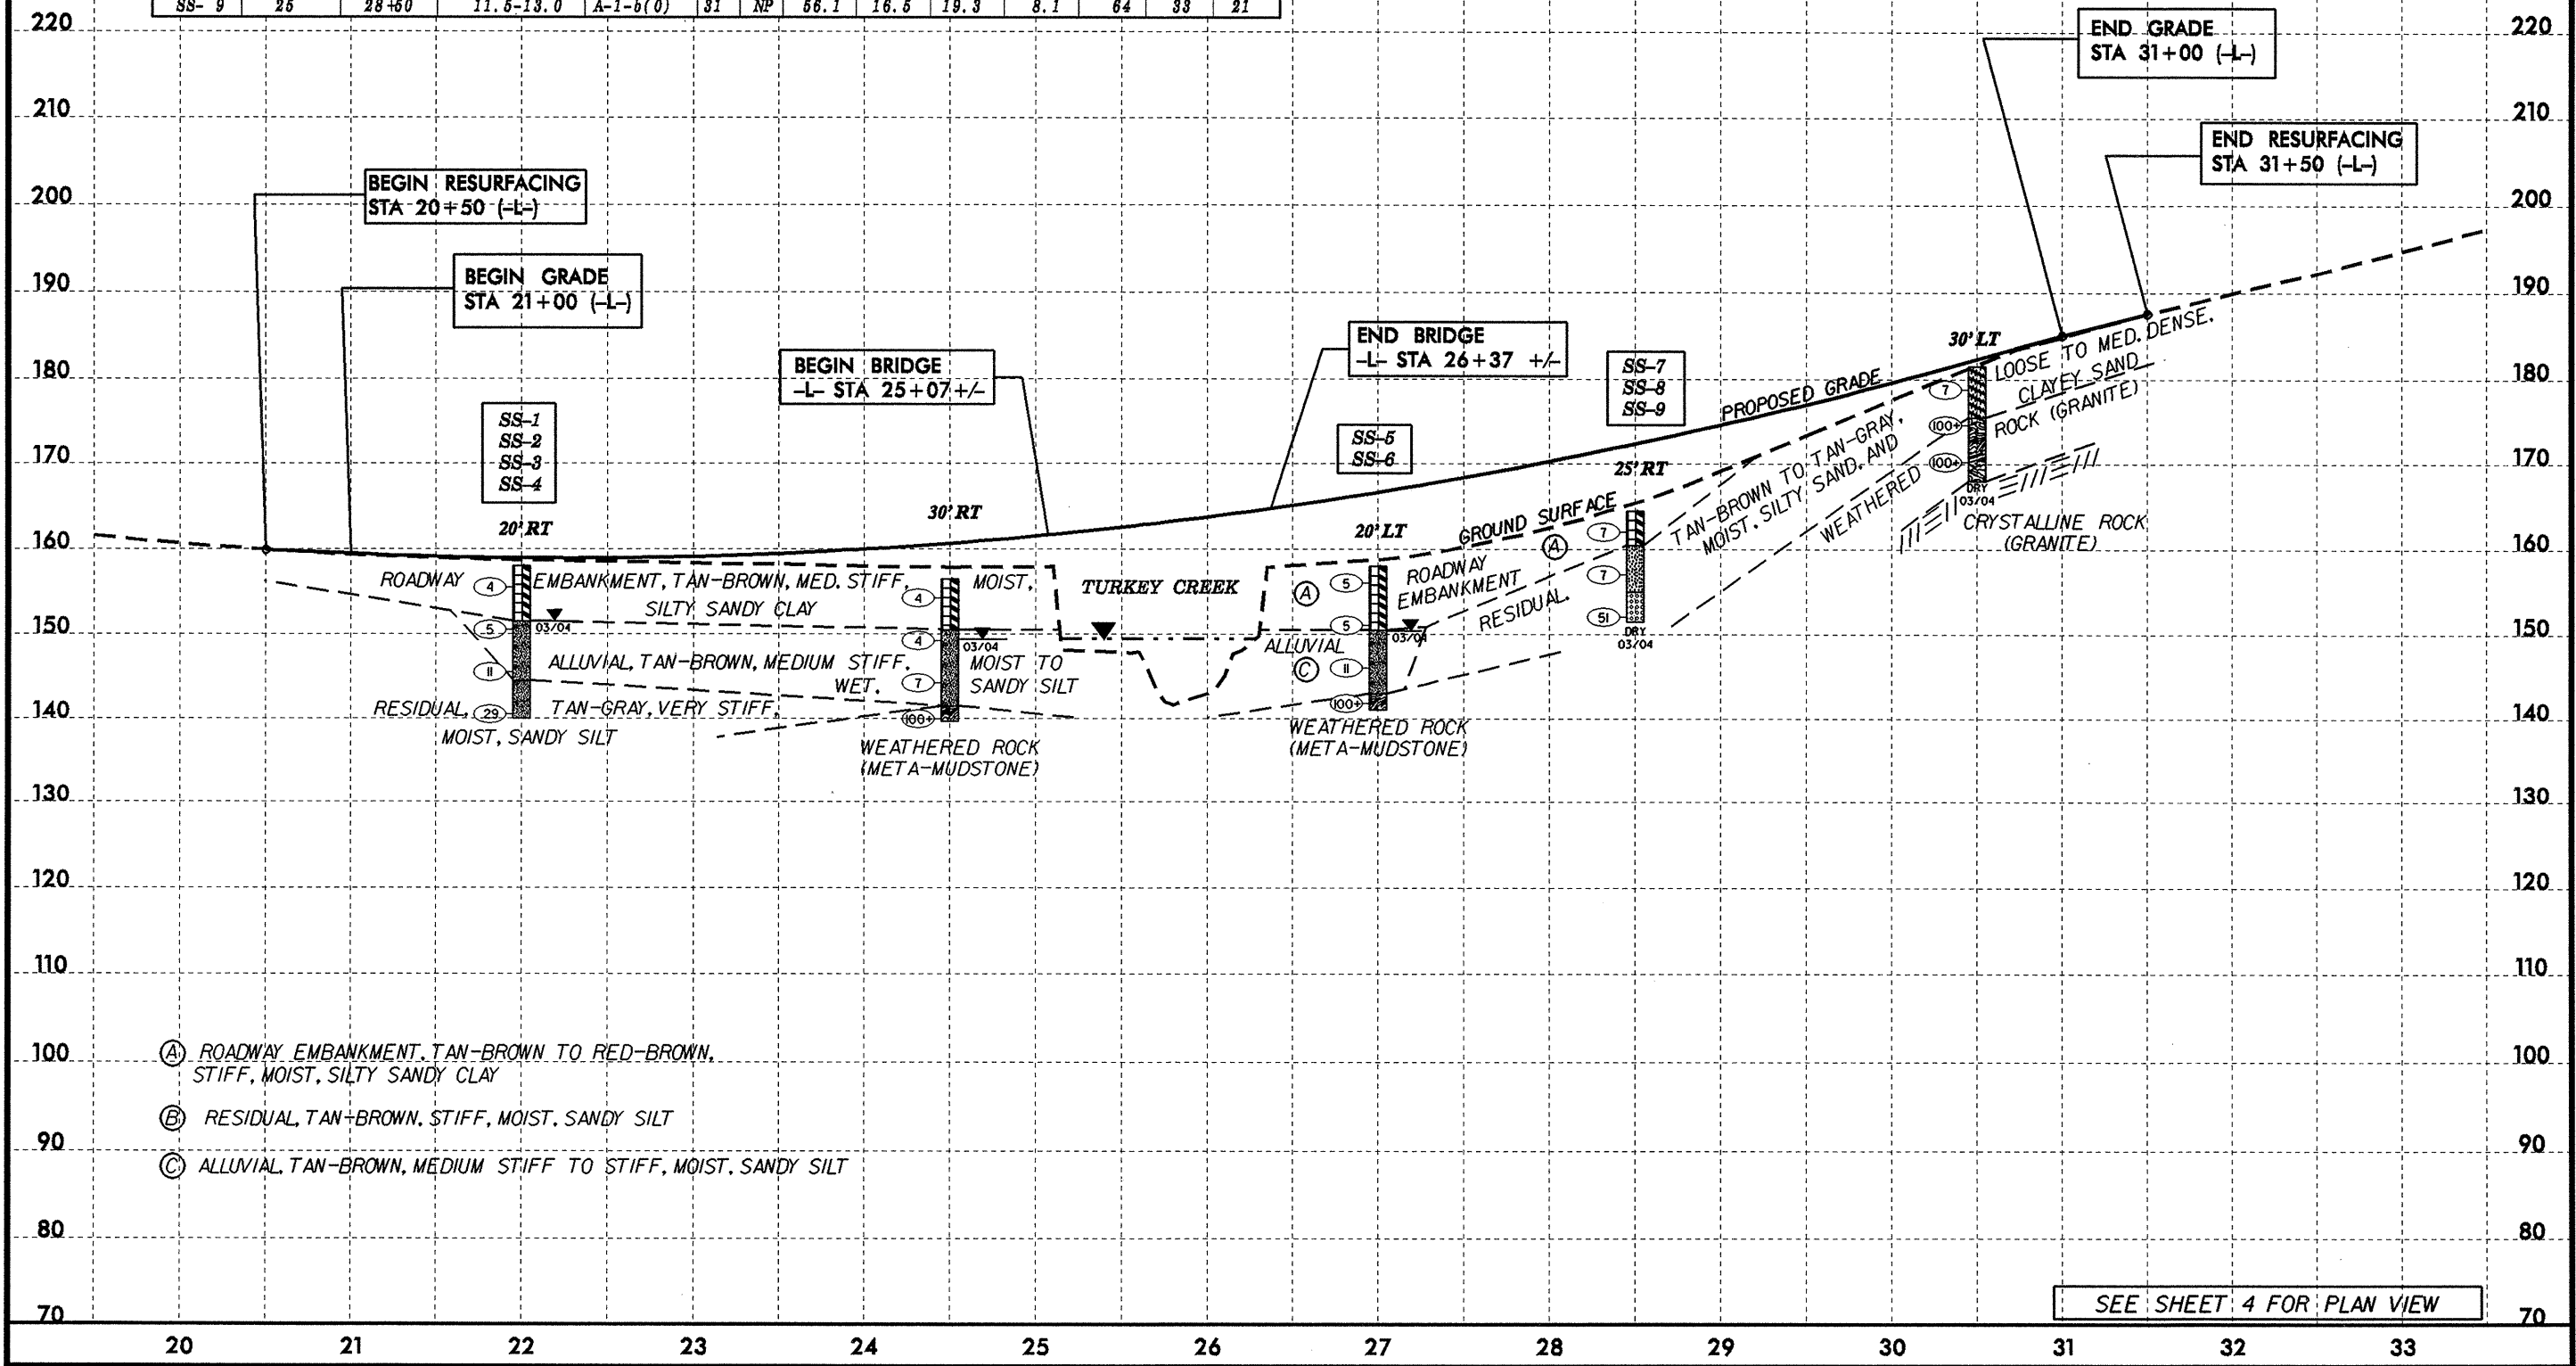

- (A) ROADWAY EMBANKMENT, TAN-BROWN TO RED-BROWN, STIFF, MOIST, SILTY SANDY CLAY
- (B) RESIDUAL, TAN-BROWN, STIFF, MOIST, SANDY SILT
- (C) ALLUVIAL, TAN-BROWN, MEDIUM STIFF TO STIFF, MOIST, SANDY SILT

SEE SHEET 4 FOR PLAN VIEW