


150 140 130 120 110 100 90 80 70 60 50 40 30 20 10 0 10 20 30 40 50 60 70 80 90 100 110 120 130 140 150

### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	LL	P.I.	% BY WEIGHT				% PASSING (SIEVES)			% MOISTURE	% ORGANIC
							C.SAND	F.SAND	SILT	CLAY	10	40	200		
S-1	45' RT	20+00	0.30-3.50	A-7-5(26)	62	28	6.3	18.3	32.8	42.6	100	98	80	-	-
S-2	45' RT	20+00	3.50-6.00	A-7-5(10)	47	15	16.0	21.1	34.4	28.4	96	84	66	-	-
S-3	45' RT	20+00	6.00-18.00	A-4(3)	29	10	7.3	44.9	25.5	22.3	98	94	57	-	-
S-4	65' RI	22+00	3.00-8.00	A-7-6(20)	42	20	1.0	5.7	44.6	48.7	98	98	93	-	-

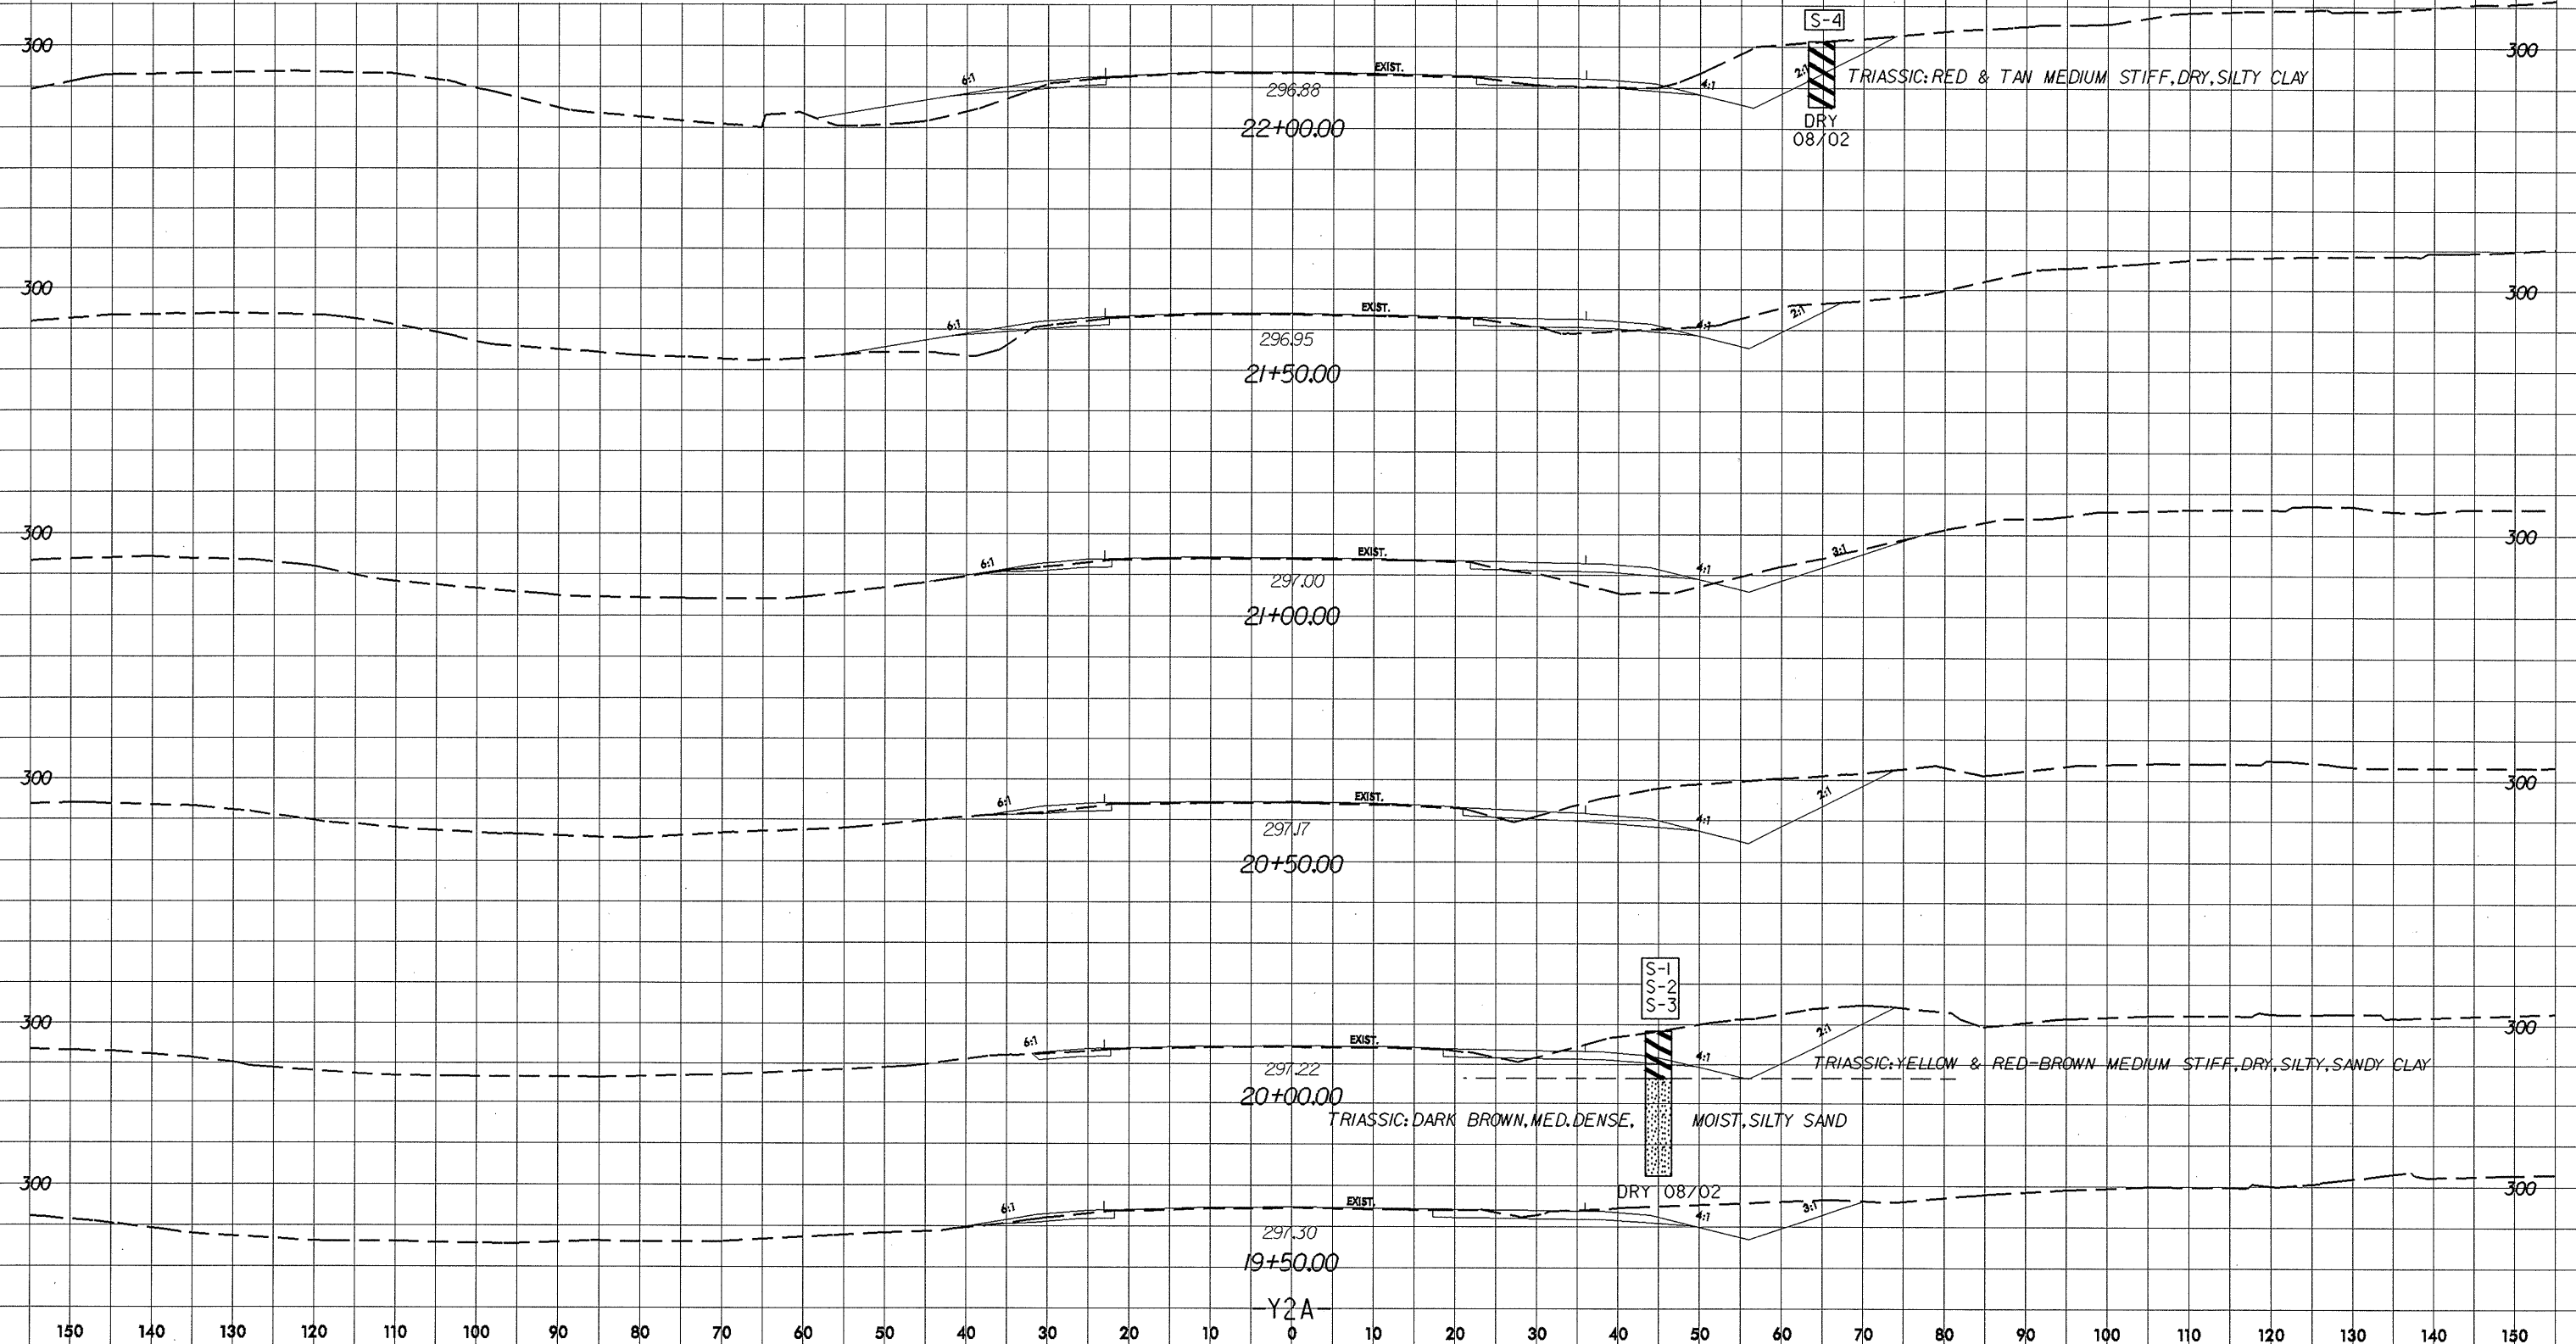

SYSTEMS TIME 08/02/02 USER NAME

Y2A