


SOIL TEST RESULTS													
SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL (FEET)	DEPTH (FEET)	L.	P.	1.	2. BY WEIGHT			3. PASSING (PERCENT)	4. ORGANIC	
								SAND	SILT	CLAY			
55-77	0	64+32	1.00-1.49	A-7-5(10)	46	13	2.0	12.9	40.5	44.5	100	99	90
51-78	0	64+32	1.23-1.93	A-7-5(10)	43	11	4.3	14.4	55.1	26.3	99	97	80
55-83	0	65+12	2.29-2.61	A-7-5(10)	41	7	10.2	29.7	37.5	22.2	100	94	70
55-84	0	65+12	3.99-10.29	A-4(4)	35	6	15.8	22.0	46.0	18.2	100	90	70

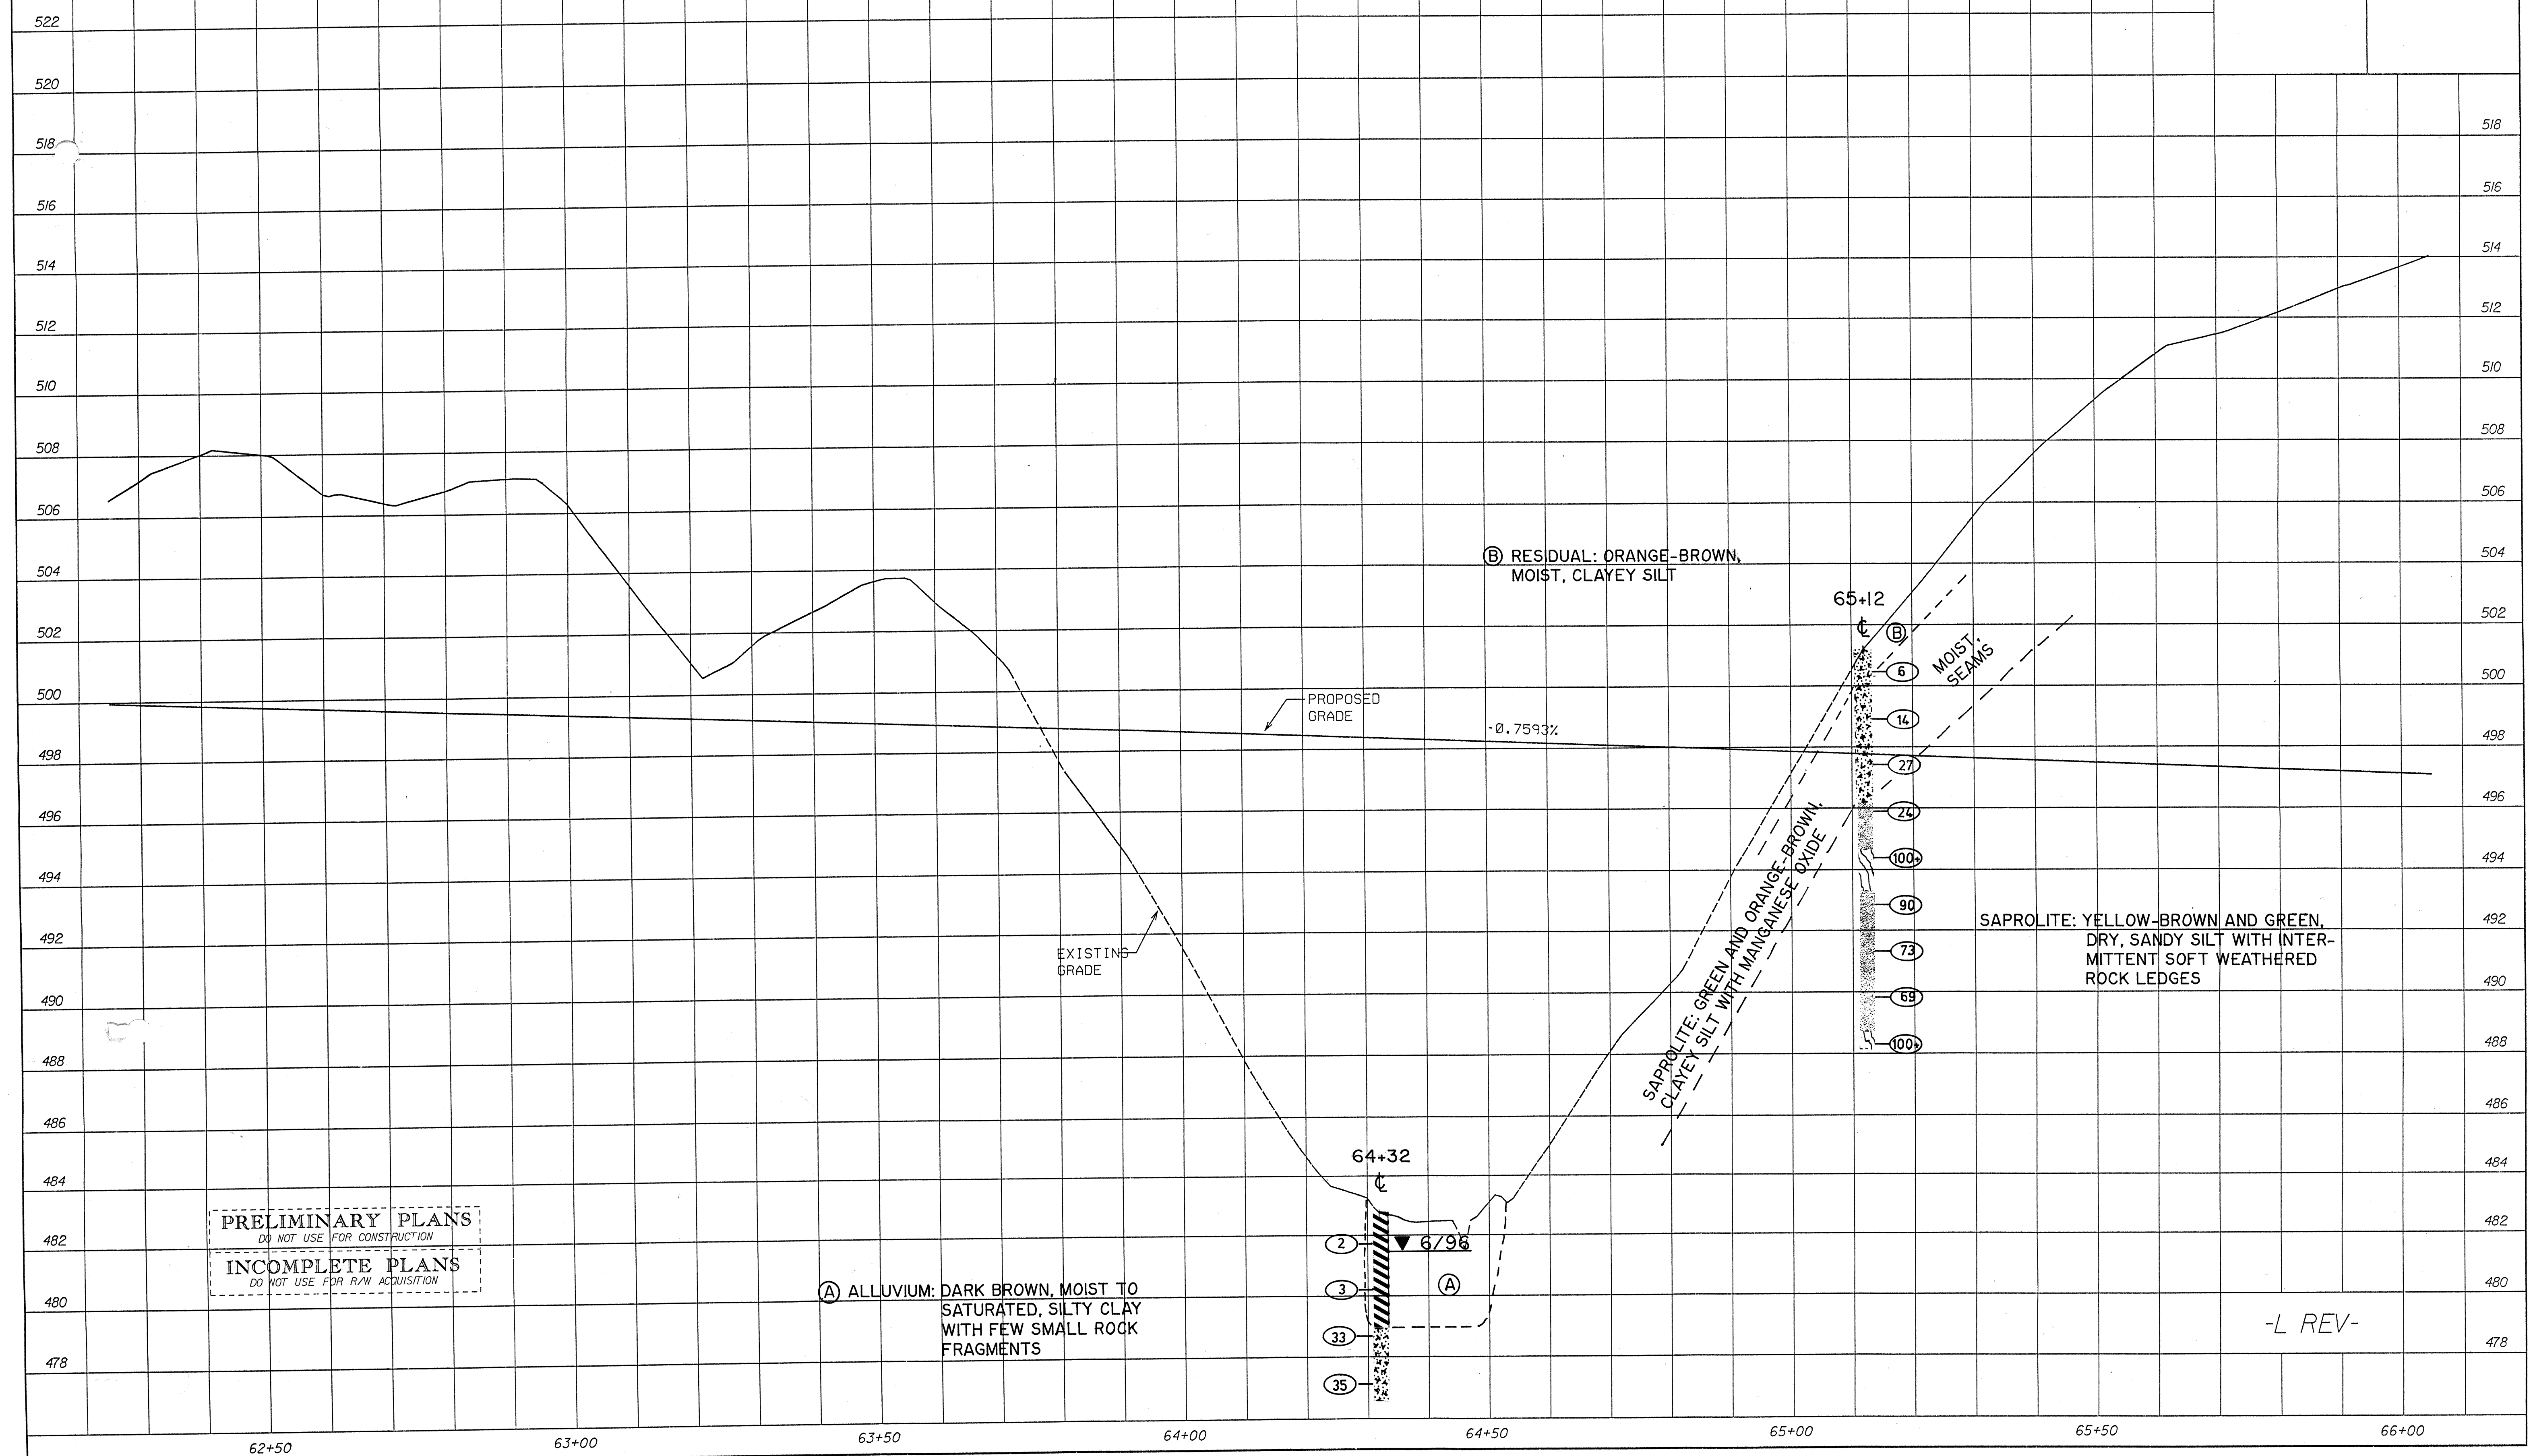

PRELIMINARY PLANS
DO NOT USE FOR CONSTRUCTION

INCOMPLETE PLANS
DO NOT USE FOR R/W ACQUISITION

(A) ALLUVIUM: DARK BROWN, MOIST TO SATURATED, SILTY CLAY WITH FEW SMALL ROCK FRAGMENTS

(B) RESIDUAL: ORANGE-BROWN, MOIST, CLAYEY SILT

SAPROLITE: YELLOW-BROWN AND GREEN, DRY, SANDY SILT WITH INTERMITTENT SOFT WEATHERED ROCK LEDGES

SAPROLITE: GREEN AND ORANGE-BROWN, CLAYEY SILT WITH MANGANESE OXIDE

MOIST SEAMS

-L REV-