


150 140 130 120 110 100 90 80 70 60 50 40 30 20 10 0 10 20 30 40 50 60 70 80 90 100 110 120 130 140 150

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S-11	30	23+50	1.00-2.00	A-7-6(24)	68	40	8.5	31.7	17.4	42.4	100	97	66
S-12	30	23+50	3.00-4.00	A-4(2)	35	8	15.8	45.9	18.8	20.2	100	94	48
S-13	30	25+50	2.50-3.00	A-2-4(0)	28	NP	34.8	48.6	15.4	6.1	96	77	26

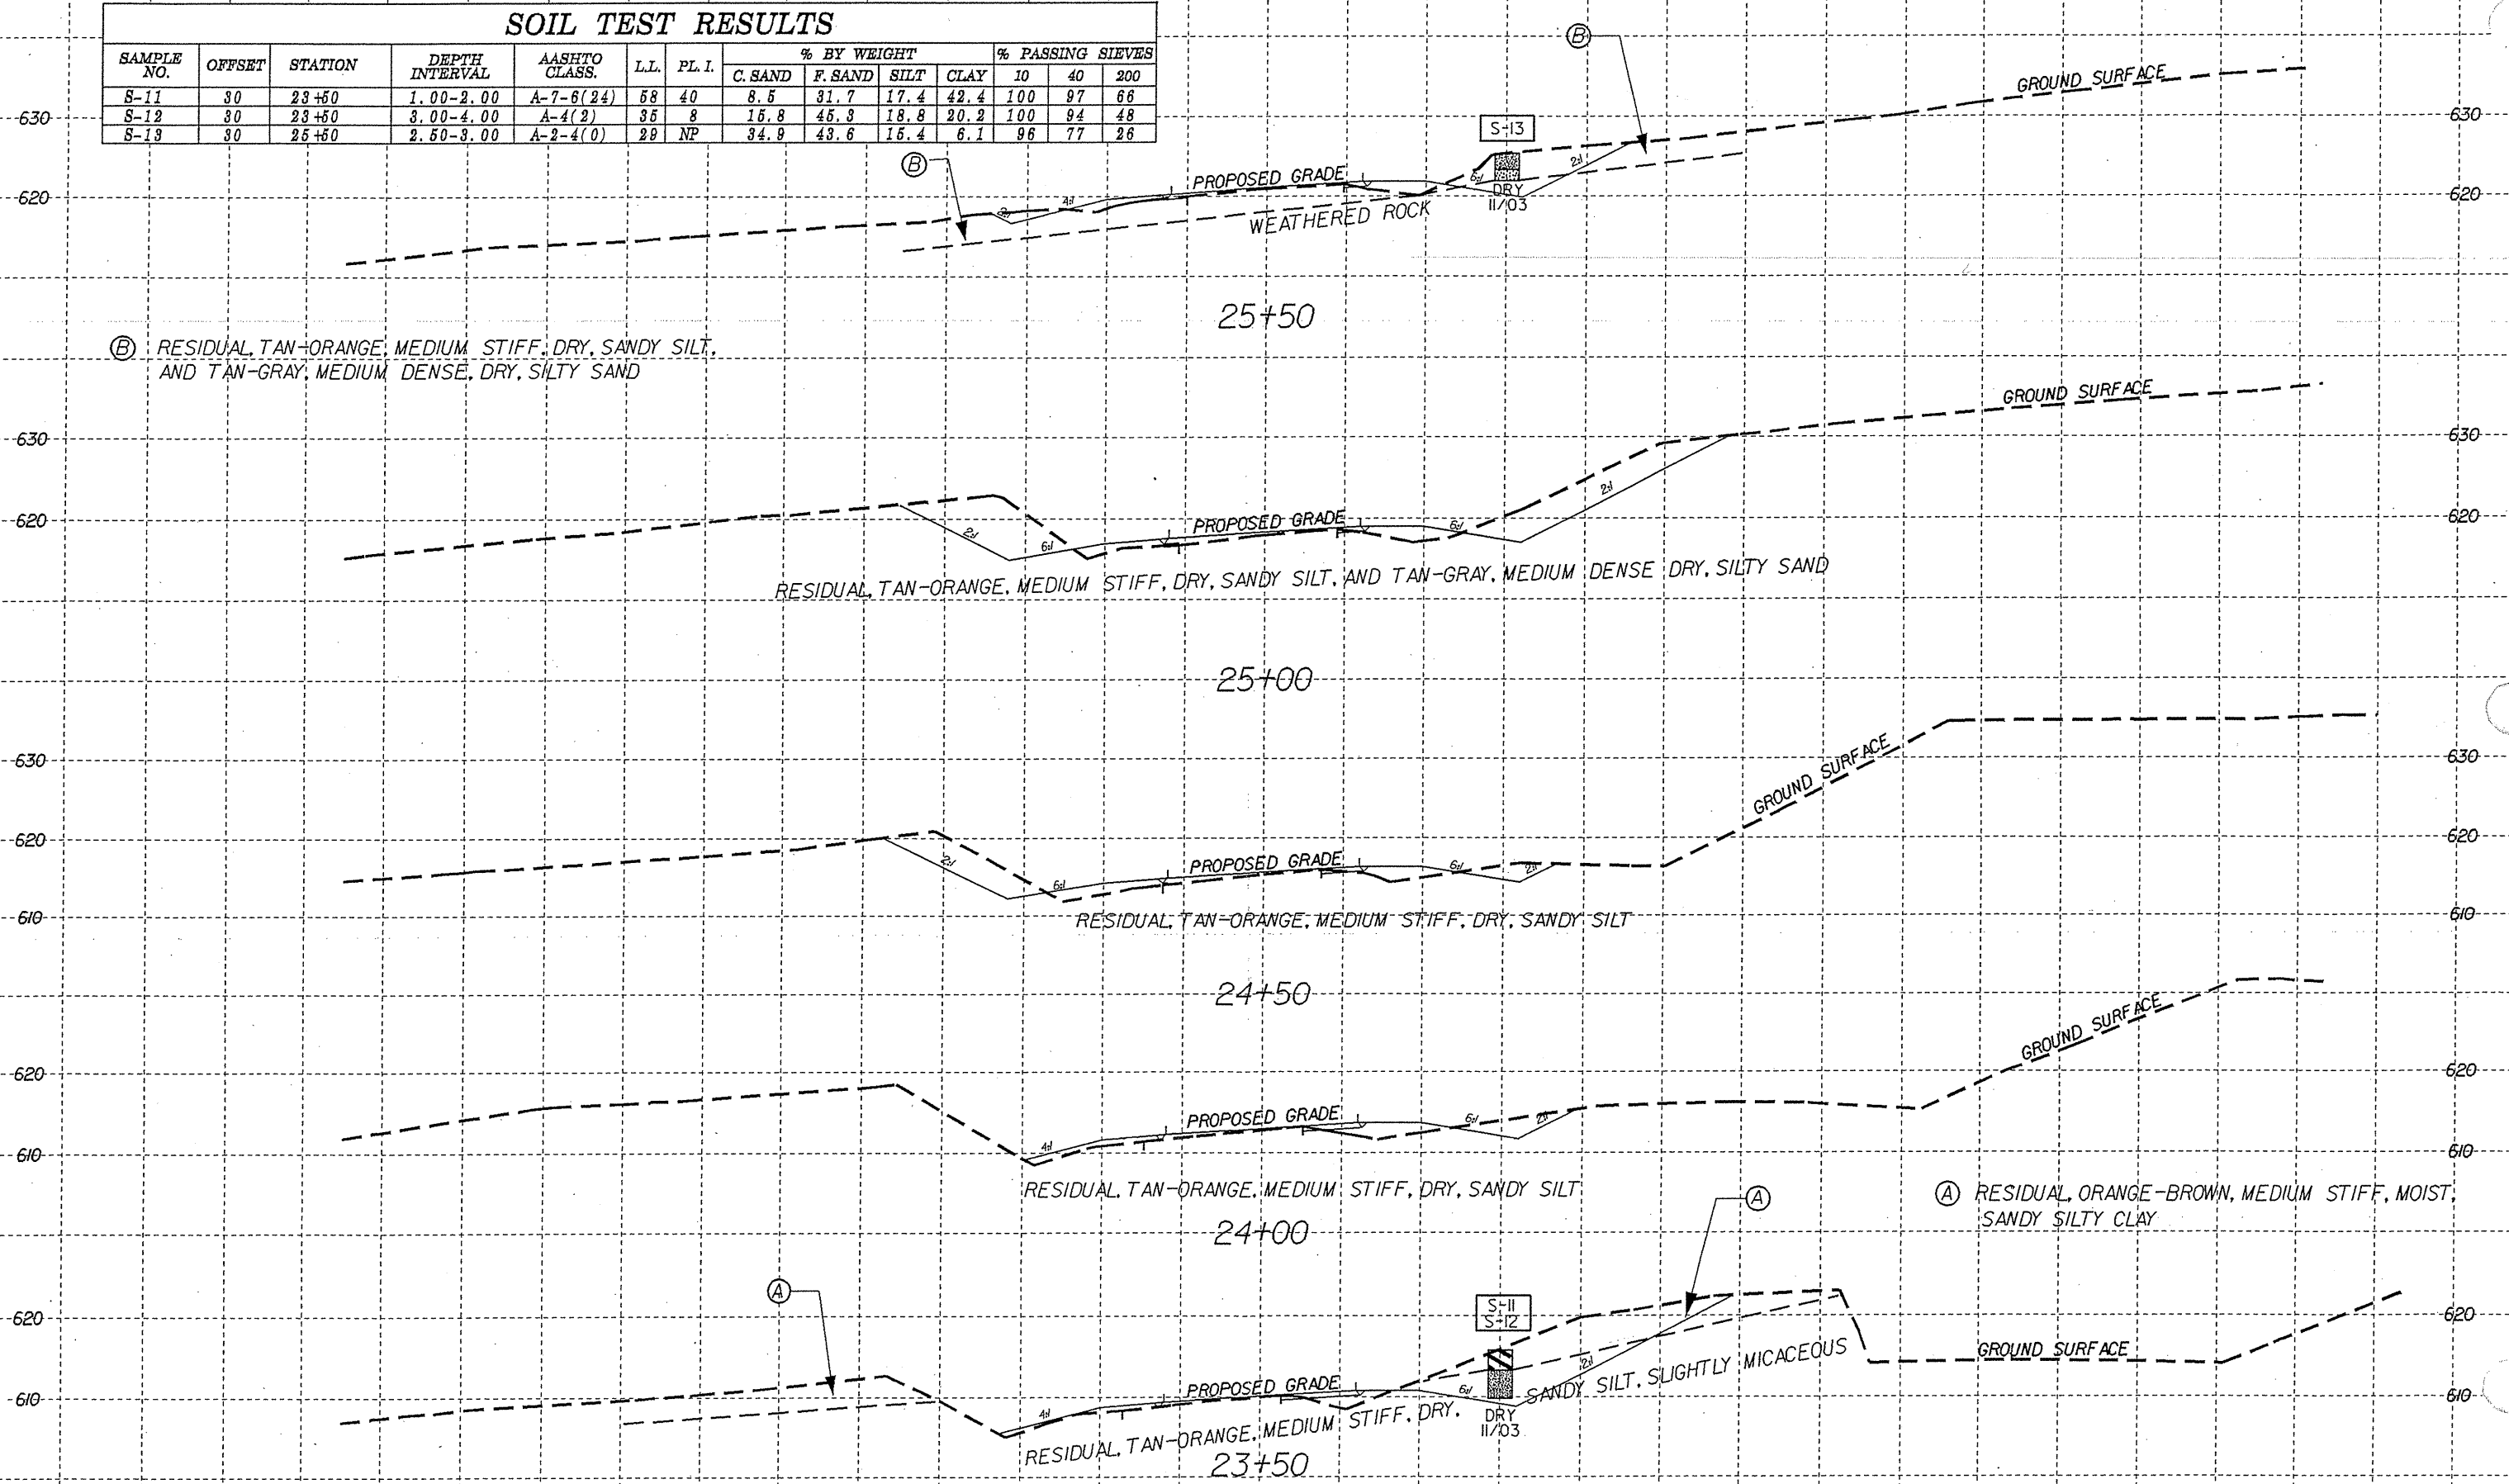

(B) RESIDUAL, TAN-ORANGE, MEDIUM STIFF, DRY, SANDY SILT, AND TAN-GRAY, MEDIUM DENSE, DRY, SILTY SAND

RESIDUAL TAN-ORANGE, MEDIUM STIFF, DRY, SANDY SILT, AND TAN-GRAY, MEDIUM DENSE DRY, SILTY SAND

RESIDUAL TAN-ORANGE, MEDIUM STIFF, DRY, SANDY SILT

RESIDUAL TAN-ORANGE, MEDIUM STIFF, DRY, SANDY SILT

RESIDUAL TAN-ORANGE, MEDIUM STIFF, DRY, SANDY SILT, SLIGHTLY MICACEOUS

(A) RESIDUAL, ORANGE-BROWN, MEDIUM STIFF, MOIST, SANDY SILTY CLAY