


ALL WATER AND SEWER LINES OWNED BY JOHNSTON COUNTY

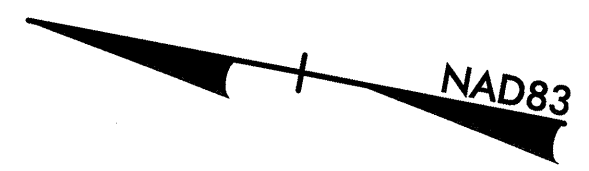

UTILITY CONSTRUCTION

PROP. 3M OF 300MM DI WATER PIPE, PC 2.41 MPA
1 - 400MM X 300MM DI TEE
1 - 300MM GATE VALVE & VALVE BOX, 1.38 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING FIRE HYDRANT
2M OF 150MM DI WATER PIPE, PC 2.41 MPA
1 - 400MM X 150MM DI TEE
1 - 150MM GATE VALVE & VALVE BOX, 1.38 MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 1 - RELOCATE EXISTING WATER METER
1 - 400MM X 20MM TAPPING SADDLE
1 - 20M CORPORATION STOP
2M OF 20MM PE WATER TUBING, SDR 9, 1.38MPA WP
CONNECT USING NECESSARY FITTINGS

PROP. 368M OF 400MM DI WATER PIPE, PC 1.72 MPA
1 - 400MM BUTTERFLY VALVE & VALVE BOX
2 - 400MM 22 1/2° DI BENDS
1 - 400MM 11 1/4° DI BEND
CONNECT USING NECESSARY FITTINGS
SEE PROFILE WL1 SHEET UC-17

PROP. 10M - FILL OR REMOVE ABANDONED 300MM PIPE, DI WATER

PROP. 365M - FILL OR REMOVE ABANDONED 400MM PIPE, DI WATER

PROP. 41M - FILL OR REMOVE ABANDONED 300MM PIPE, PVC FORCE MAIN

PROP. 46M OF 300MM PVC FORCE MAIN SEWER PIPE, SDR 21, 1.38 MPA WP
4 - 300MM 11 1/4° DI BENDS
CONNECT USING NECESSARY FITTINGS
SEE PROFILE FM2 SHEET UC-22

PROP. 45M - FILL OR REMOVE ABANDONED 300MM PIPE, PVC FORCE MAIN

PROP. 42M OF 300MM PVC FORCE MAIN SEWER PIPE, SDR 21, 1.38 MPA WP
4 - 300MM 22 1/2° DI BENDS
CONNECT USING NECESSARY FITTINGS
SEE PROFILE FM1 SHEET UC-22

MATCHLINE -Y4- 6 +60 SEE SHEET UC-5

MATCHLINE -Y4- 10 +25 SEE SHEET UC-7

G:\17887\17887-2552c\17887-2552c\17887-2552c.dwg

DORIS M MATTHEWS
DB 894 PG 455