

20

10


0

10

20

30

40





PROJECT REFERENCE NO.
R-2552C

SHEET NO.
120 OF 126

SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	PL. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
SS-167	0	11+20	1.12-1.57	A-7-6(12)	65	39	41.2	14.7	9.9	34.2	95	65	45
SS-168	0	11+20	4.16-4.61	A-2-7(4)	67	37	53.3	12.3	4.2	30.2	76	44	28
SS-169	0	11+20	7.20-7.65	A-6(3)	38	15	0.6	60.4	12.9	26.2	100	100	44

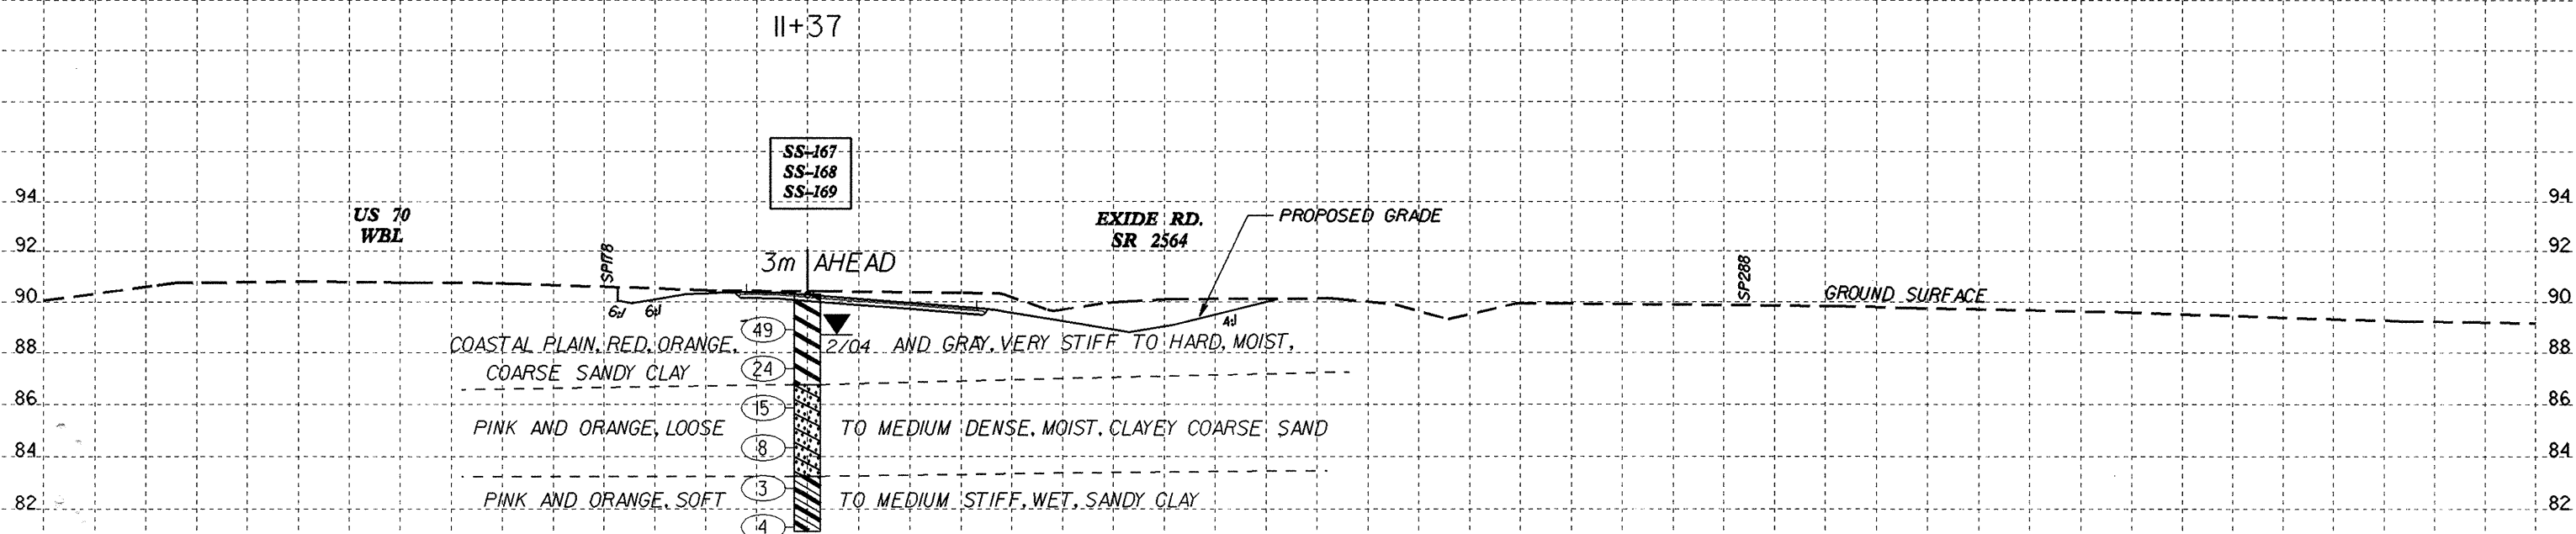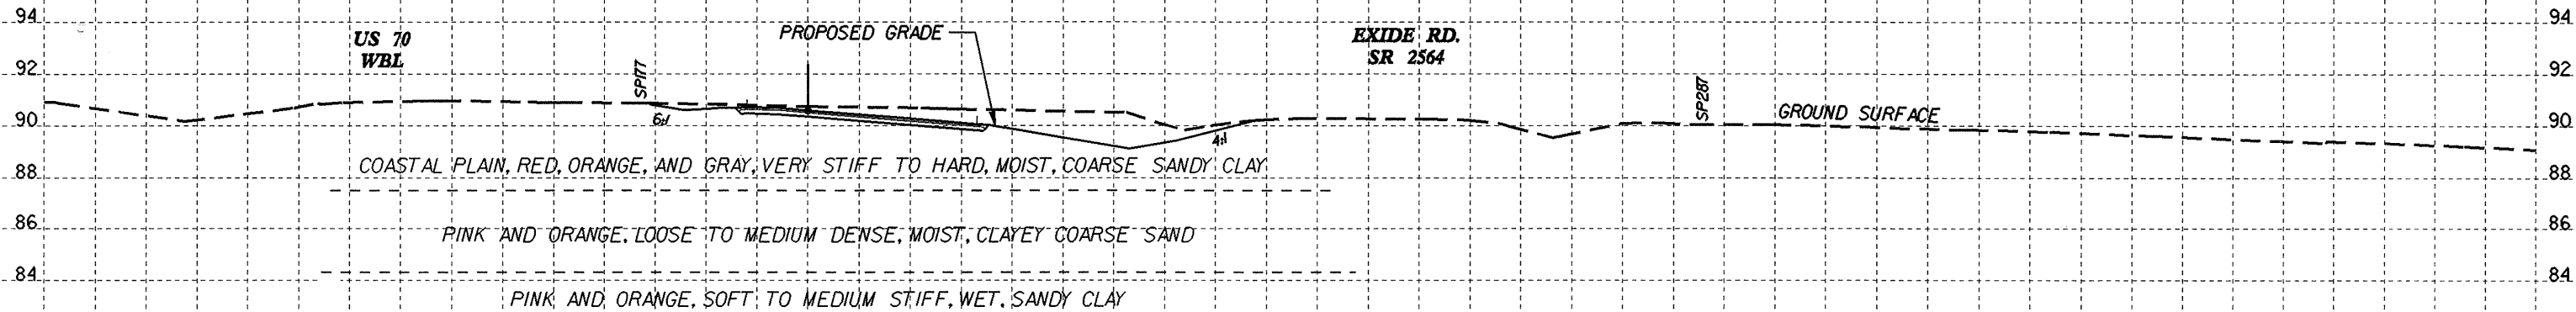

-RAMP A-

20

10

0

10

20

30

40

50

60