


### SOIL TEST RESULTS

SAMPLE NO.	OFFSET	STATION	DEPTH INTERVAL	AASHTO CLASS.	L.L.	P.L. I.	% BY WEIGHT				% PASSING SIEVES		
							C. SAND	F. SAND	SILT	CLAY	10	40	200
S-515	-4l	116+86	6.50-7.00	A-2-7(3)	60	36	66.1	8.9	4.8	20.2	96	43	25
S-512	0	116+80	2.00-2.50	A-7-6(15)	68	39	40.3	11.1	6.3	42.3	97	67	49
S-513	0	116+80	4.50-5.00	A-2-7(4)	60	32	56.9	10.1	4.8	28.2	95	49	34
S-514	0	116+80	6.00-7.00	A-7-6(9)	49	23	30.4	25.8	9.5	34.3	97	72	53

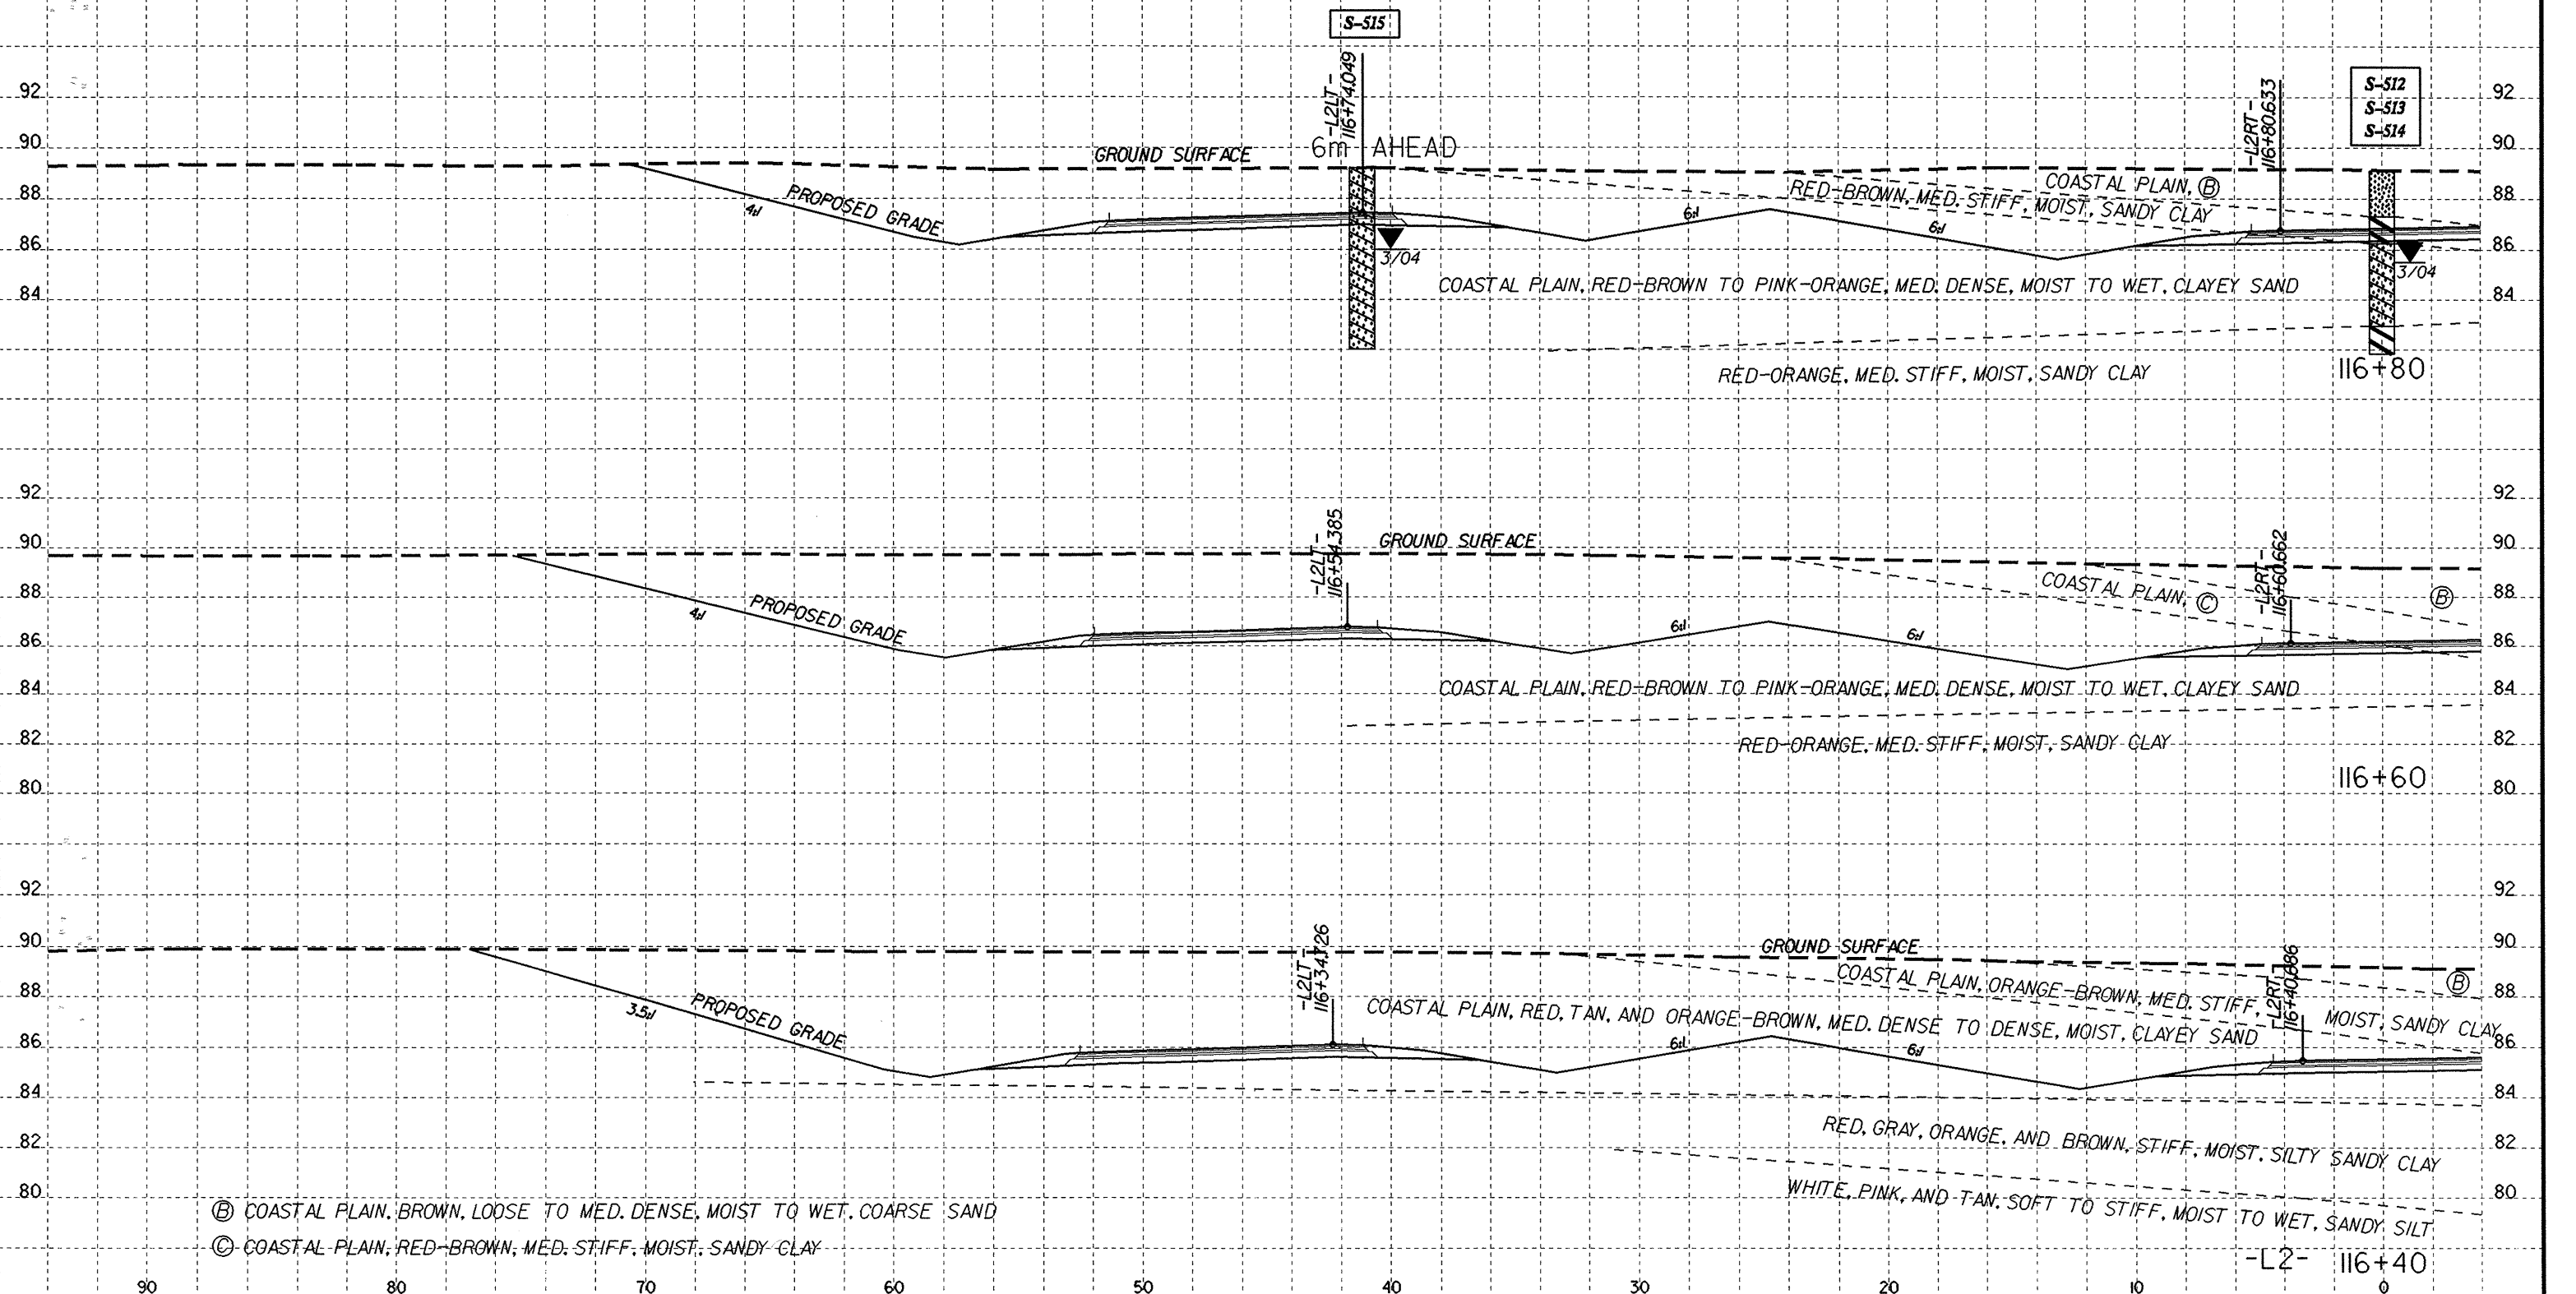

ⓑ COASTAL PLAIN, BROWN, LOOSE TO MED. DENSE, MOIST TO WET, COARSE SAND  
 ⓒ COASTAL PLAIN, RED-BROWN, MED. STIFF, MOIST, SANDY CLAY